

HTE# SPD-1504-0005

Harnett County Department of Public Health

25449

PERMIT # 30448

Operation Permit

- New Installation
 Septic Tank
 Nitrification Line
 Repair
 Expansion

PROPERTY LOCATION: 321429 Chalkwater RD

Name: (owner) LGI Homes

SUBDIVISION Avery Pond

LOT # 175

System Installer: Quakley Septic - 6mg

Registration # _____

Basement with plumbing: Garage Number of Bedrooms 3

Type of Water Supply: Community Public Well Distance from well _____ feet


System Type: 25% Reductor System Type B6 Types V and VI Systems expire in 5 years.

(In accordance with Table V a)

Owner must contact Health Department 6 months prior to expiration for permit renewal.

Carbon such 4

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

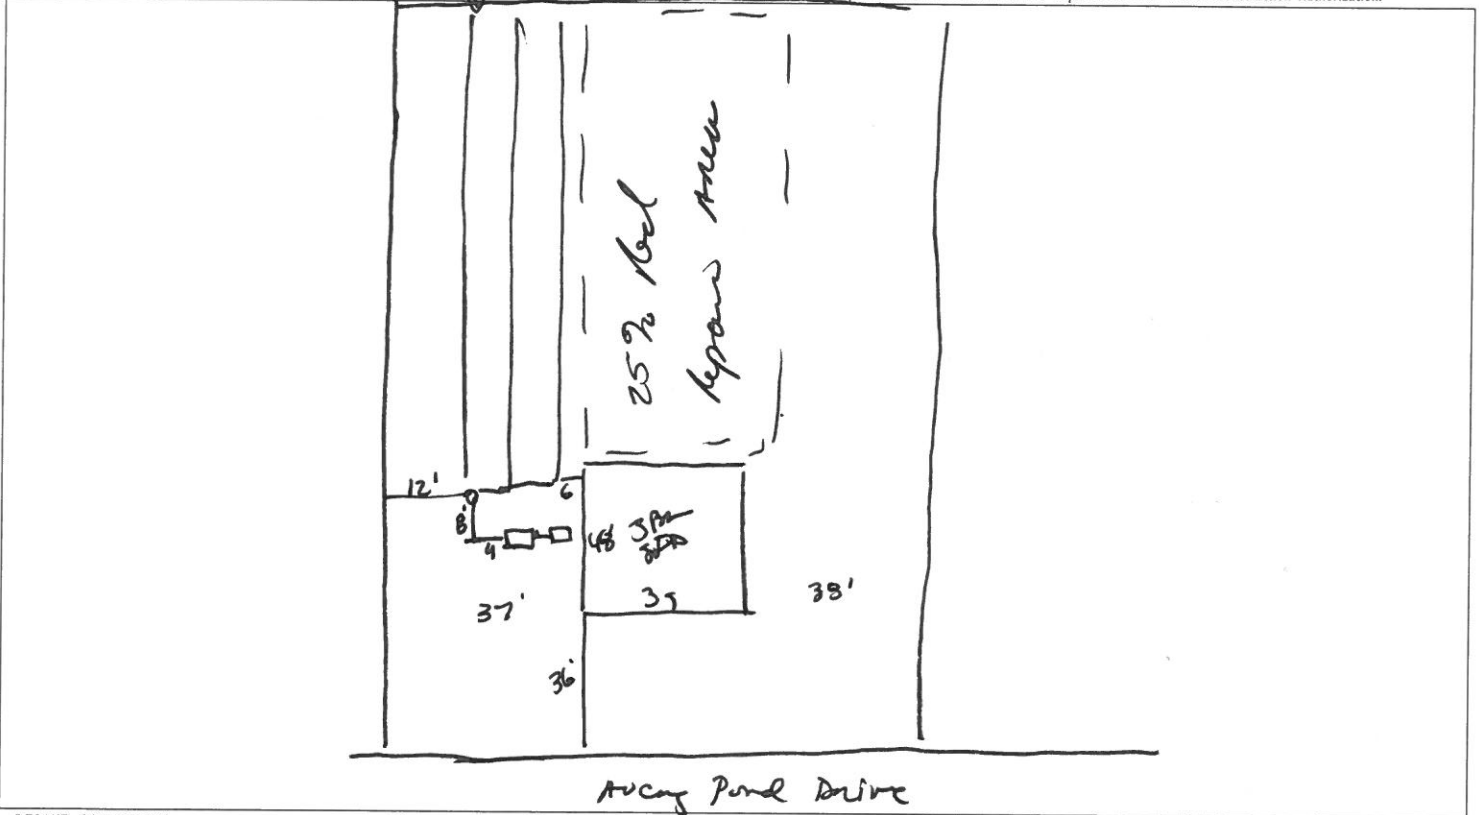

PERMIT CONDITIONS:

- I. Performance: System shall perform in accordance with Rule .1961.
- II. Monitoring: As required by Rule .1961.
- III. Maintenance: As required by Rule .1961. Other: _____

Subsurface system operator required? Yes No

If yes, see attached sheet for additional operation conditions, maintenance and reporting.

IV. Operation: _____

V. Other: _____

D-Box Pump Alarm H2O Line PWR Line

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system: Conventional Other 25% B6 Septic Tank: 1000 gallons Pump Tank: 1000 gallons

Subsurface Drainage Field: No. of ditches 3 exact length of each ditch 100 feet width of ditches 3 feet depth of ditches 22-18 inches

French Drain Required: _____ Linear feet

Authorized State Agent James E. Marshall REHS

Date 7-22-19