

18-5-44325

HTE# CPSFR-50044325

Harnett County Department of Public Health

25584

PERMIT # _____

Operation Permit

New Installation Septic Tank Nitrification Line Repair Expansion
PROPERTY LOCATION: Thomas Kelly Rd

Name: (owner) Howard, Tim & Tara SUBDIVISION _____ LOT # _____

System Installer: LARRY SHARRG Registration # _____


Basement with plumbing: Garage Number of Bedrooms 4

Type of Water Supply: Community Public Well Distance from well 100 feet

System Type: IIIg Types V and VI Systems expire in 5 years.

(In accordance with Table V a) Owner must contact Health Department 6 months prior to expiration for permit renewal.

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

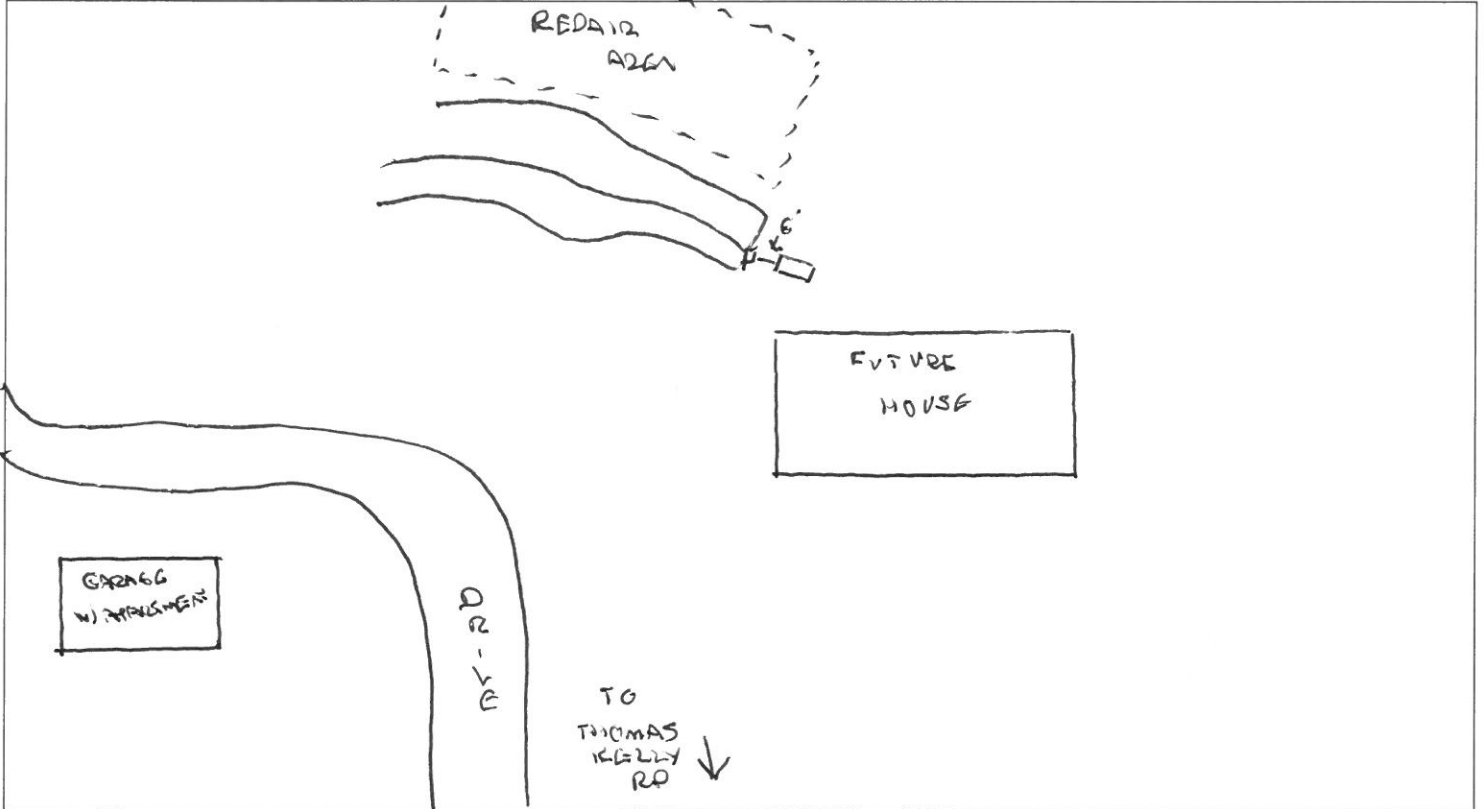

PERMIT CONDITIONS:

- I. Performance: System shall perform in accordance with Rule .1961.
- II. Monitoring: As required by Rule .1961.
- III. Maintenance: As required by Rule .1961. Other: _____

Subsurface system operator required? Yes No

If yes, see attached sheet for additional operation conditions, maintenance and reporting.

IV. Operation: _____

V. Other: SYSTEM DESIGNED FOR HOUSE AND GARAGE/APARTMENT

D-Box Pump Alarm H2O Line PWR Line

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system: Conventional Other EZFLOW Septic Tank: 1250 gallons Pump Tank: _____ gallons

Subsurface Drainage Field: No. of ditches 3 exact length of each ditch 160 feet width of ditches 3 feet depth of ditches 18 inches on downhill side

French Drain Required: _____ Linear feet

Authorized State Agent _____

REAS

Date 6/20/19