

# Harnett County Department of Public Health

PERMIT # SFD 1905-0052

## Operation Permit

- New Installation  
  Septic Tank  
  Nitrification Line  
  Repair  
  Expansion

PROPERTY LOCATION: 26418 Raven Rd

Name: (owner) Christopher + Chloe Chicinai    SUBDIVISION Captains Landing    LOT # 1

System Installer: A Doock Excavation

Basement with plumbing:     Garage     Number of Bedrooms 3

Type of Water Supply:  Community     Public     Well    Distance from well \_\_\_\_\_ feet


System Type: 25% REDUCED SYSTEM Type # 6    Types V and VI Systems expire in 5 years.

(In accordance with Table V a)

Owner must contact Health Department 6 months prior to expiration for permit renewal.

*BZUNg*

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

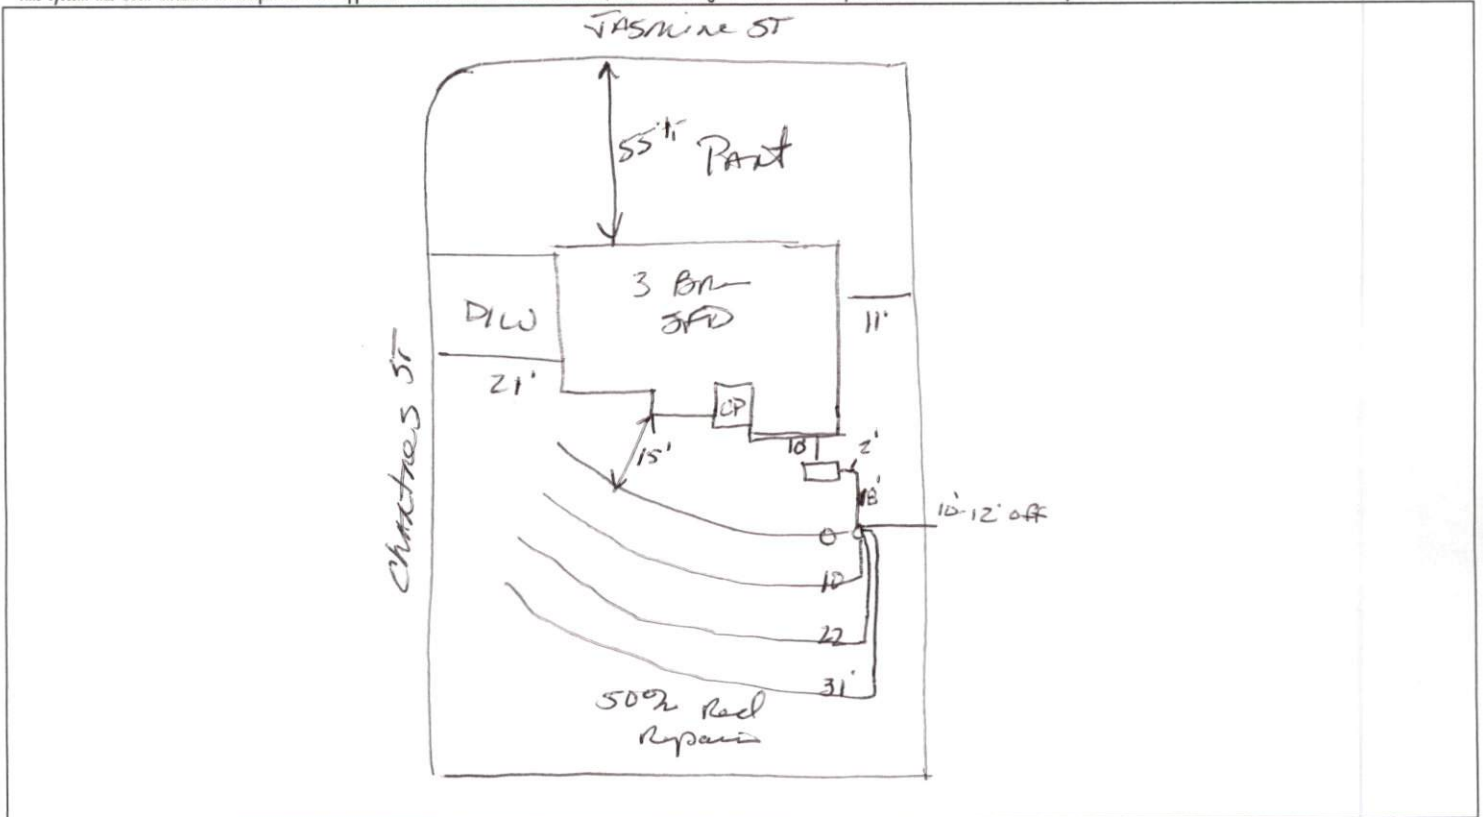

**PERMIT CONDITIONS:**

- I. Performance: System shall perform in accordance with Rule .1961.
- II. Monitoring: As required by Rule .1961.
- III. Maintenance: As required by Rule .1961. Other: \_\_\_\_\_  
 Subsurface system operator required? Yes  No   
 If yes, see attached sheet for additional operation conditions, maintenance and reporting.
- IV. Operation: \_\_\_\_\_
- V. Other: \_\_\_\_\_

\_\_\_\_\_ D-Box   
  \_\_\_\_\_ Pump   
  \_\_\_\_\_ Alarm   
  \_\_\_\_\_ H2O Line   
  \_\_\_\_\_ PWR Line

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system:  Conventional     Other 25% REDUCED SYSTEM   
 Septic Tank: 1800 gallons    Pump Tank: \_\_\_\_\_ gallons  
 Subsurface    No. of    exact length    width of    depth of  
 Drainage Field    ditches 4    of each ditch 60 feet    ditches 3 feet    ditches 24-18 inches  
 French Drain Required: \_\_\_\_\_ Linear feet

Authorized State Agent James E. Manhart    Date 11-21-22