




REAR ELEVATION
1/4" = 1'-0"

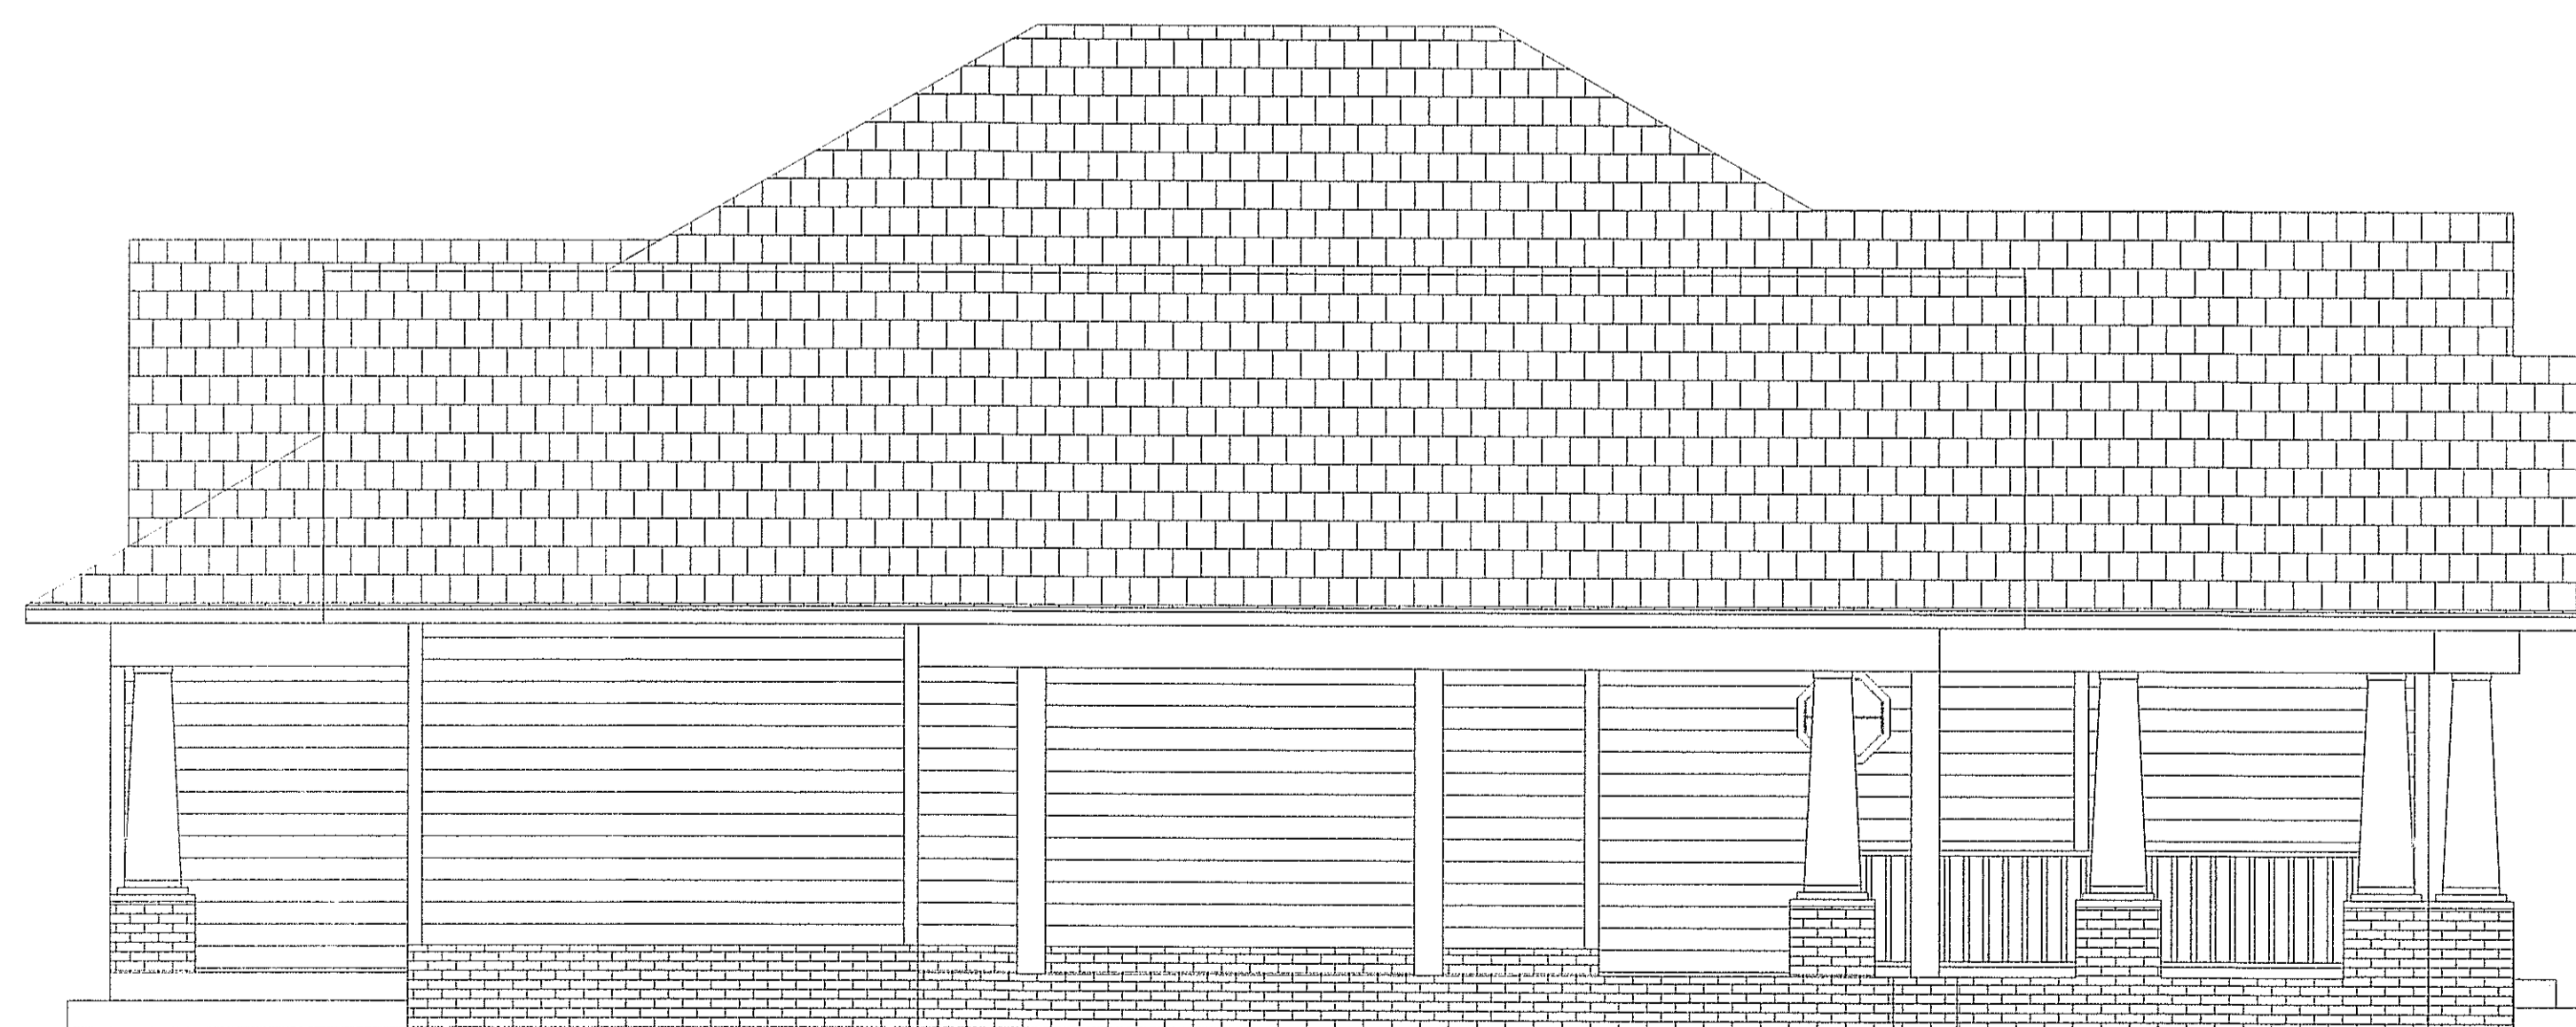

LEFT ELEVATION
1/4" = 1'-0"

Engineer shall not include construction means, methods, techniques, sequences, procedures or safety precautions. Any deviations or discrepancies on plans are to be brought to the attention of the client. Tyndall Engineering & Design, P.A. shall not be held responsible for any errors or omissions on these drawings. Tyndall Engineering & Design, P.A. liability. When review these documents carefully. Tyndall Engineering & Design, P.A. will interpret that all dimensions were intended acceptable once construction begins.

TYNDALL
ENGINEERING & DESIGN, P.A.
200 Shipwash Drive • Greenville, SC 29615
803.772.1000 • 803.772.0505
www.tyndalldesign.com

Client: **ANN DENNING**
Project: **DENNING RESIDENCE**

ELEVATIONS

Project #: **1901-010273**
Date: **7/29/19**
Drawn/Design By: **IJE**
DWG. Checked By: **PTII**
Scale: **SEE PLAN**

REVISIONS		
No.	Date	Remarks
△		
△		
△		

Sheet Number

2

P:\DWG_FILES\2019\RESIDENCE\1901-010273\1901-010273.DWG - ANN DENNING - DENNING RESIDENCE (1901-010273) DWG SHEET 02 - SHOWN LAST PLOT DATE: 7/29/2019 11:29 AM

Engineers and designers do not include construction means, methods, techniques, equipment, procedure or safety precautions. Also, deviations or alterations on these are to be brought to the immediate attention of Tyndall Engineering & Design, P.A. Failure to do so will void Tyndall Engineering & Design, P.A. liability.
 Please review these documents carefully. Tyndall Engineering & Design, P.A. will interpret that all dimensions, nomenclature, etc. presented in these documents were deemed acceptable once construction begins.

TYNDALL
 ENGINEERING & DESIGN, P.A.
 199 773 3200 • 410 773 3888
 250 Shipyard Drive • Greenville, SC 29615
 www.tyndallengineering.com

Client: **ANN DENNING**
 Title: **DENNING RESIDENCE**


FIRST FLOOR PLAN

Project #: 1901-010273
 Date: 7/29/19
 Drawn/Design By: LJE
 ENG. Checked By: PTII
 Scale: SEE PLAN

REVISIONS		
No.	Date	Remarks

Sheet Number
3
 3 of 6

HEATED/HABITABLE SQUARE FOOTAGE	
First Floor	1942
TOTAL HEATED	1942
UNHTD SQUARE FOOTAGE	
Lanai	300
Front Porch	397
Carport	657
Storage	180
TOTAL UNHEATED	1534

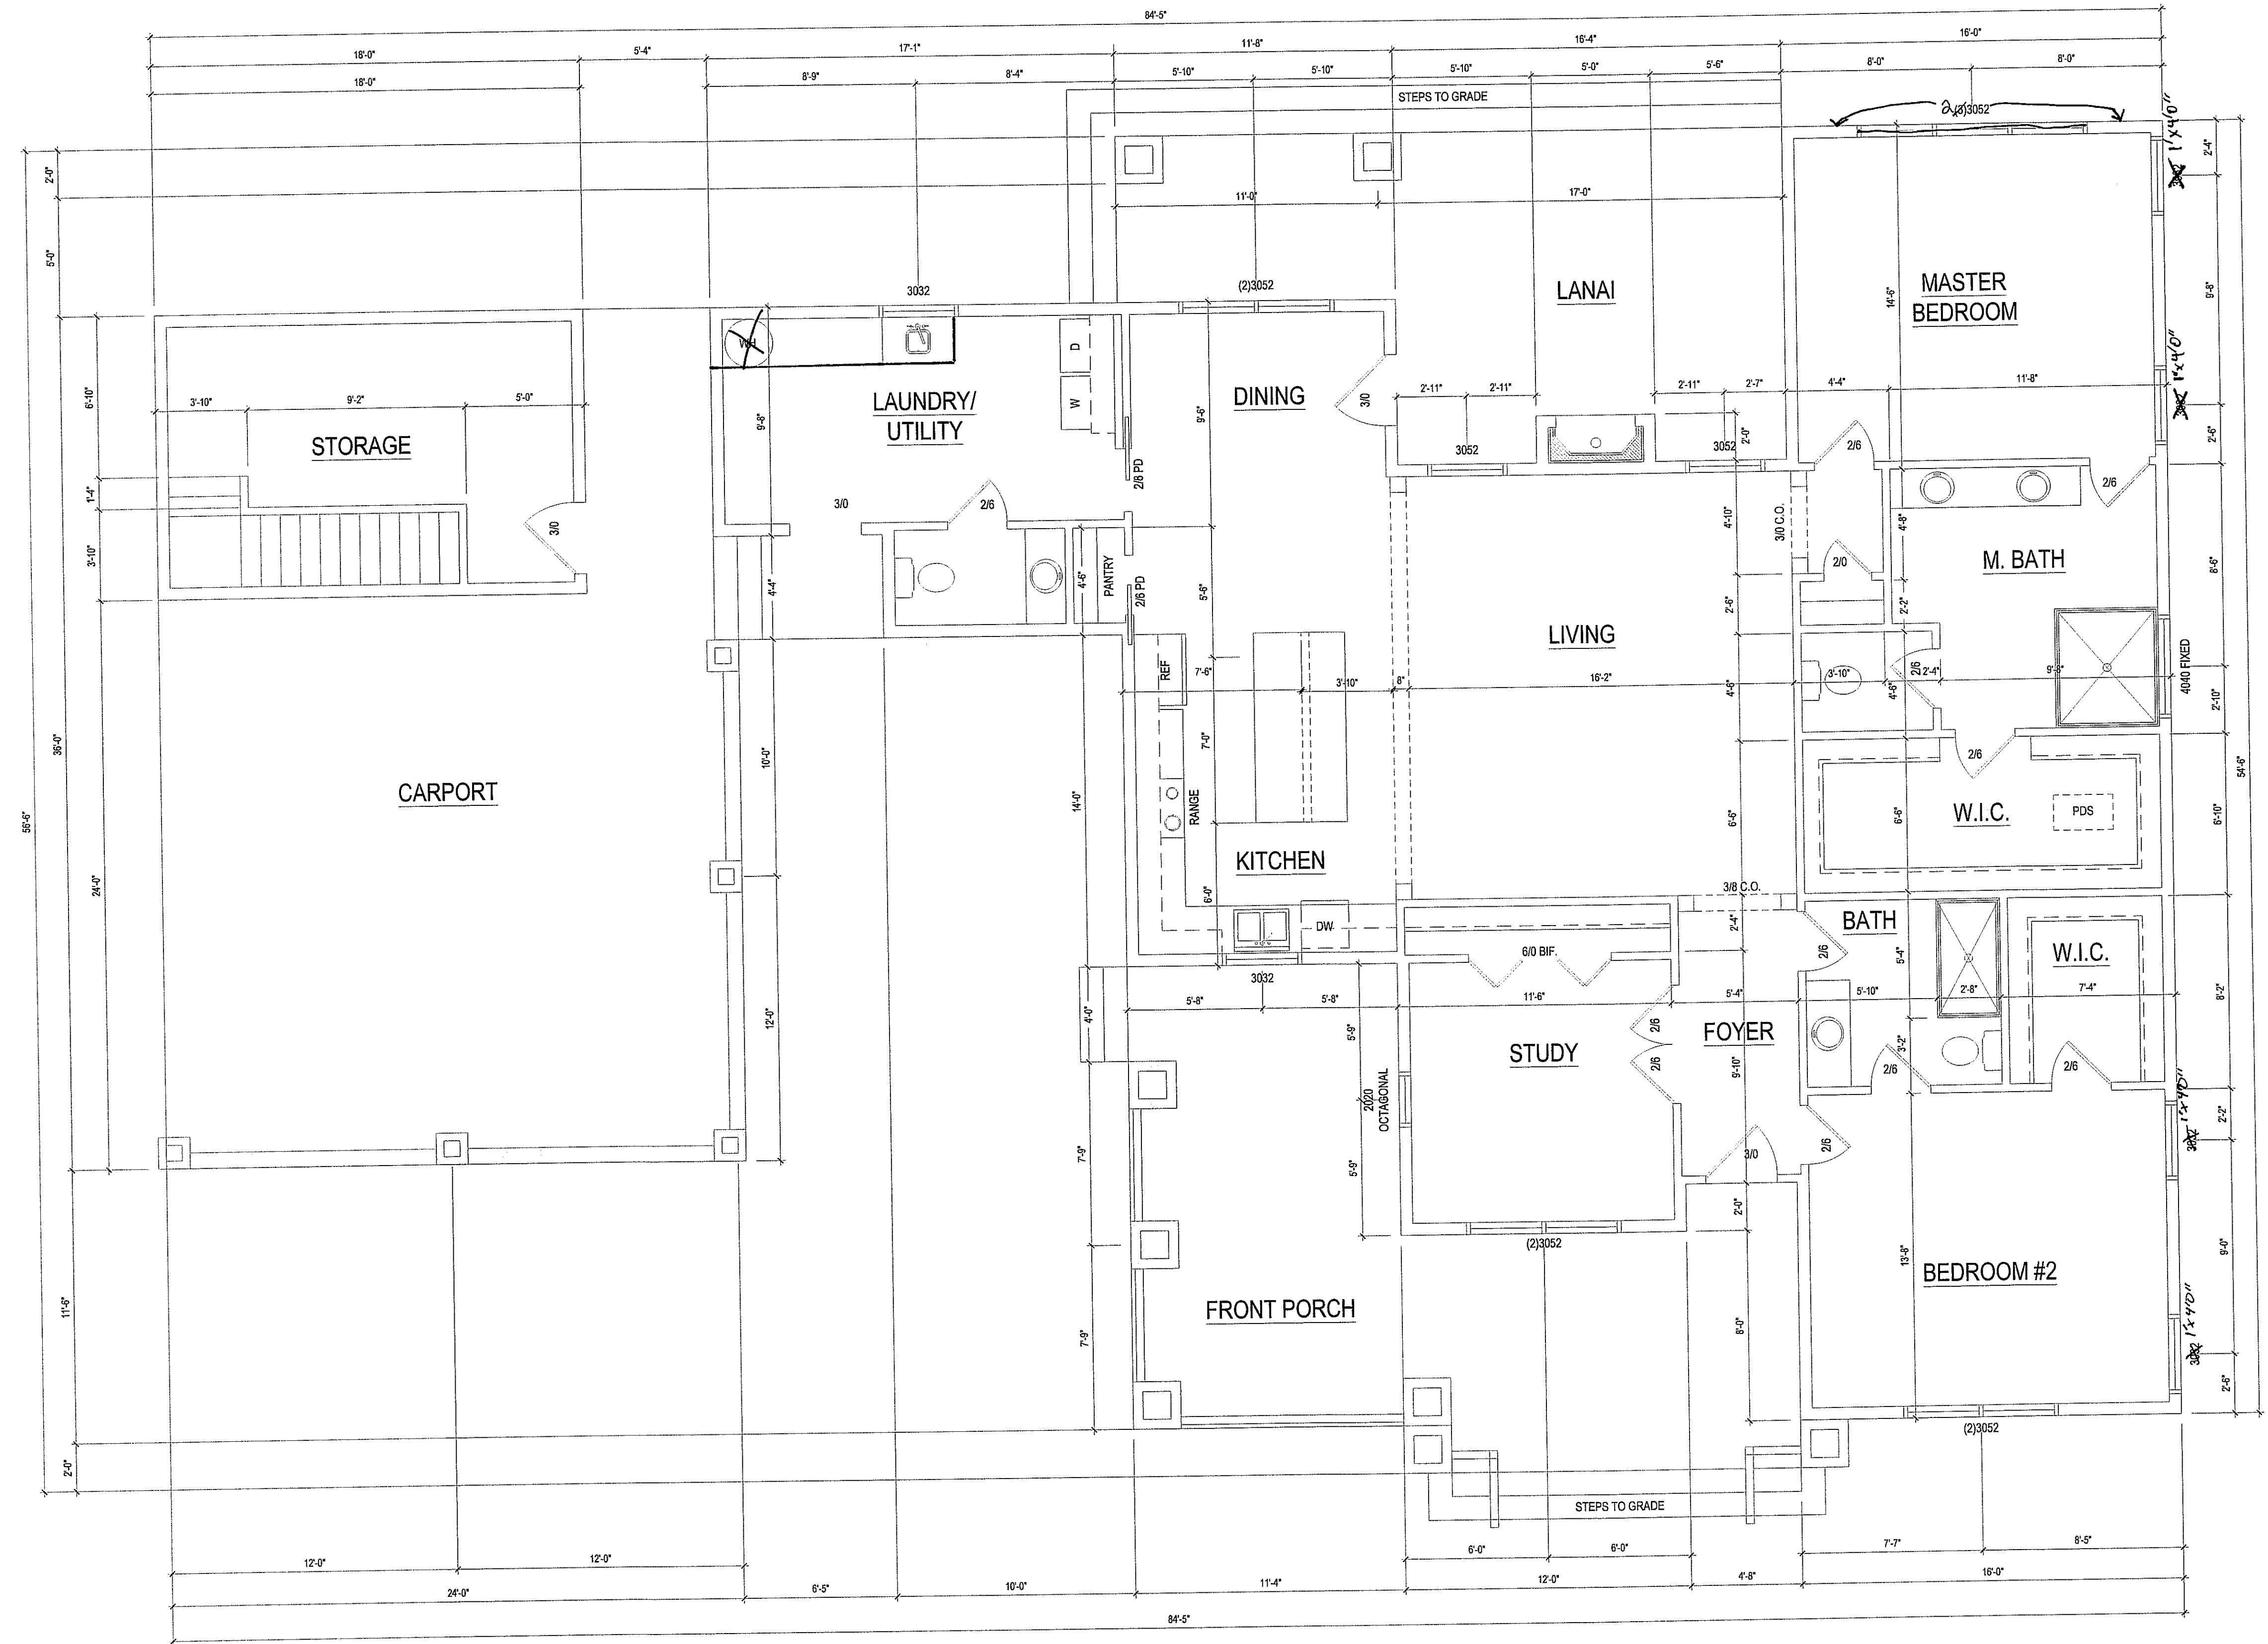

FIRST FLOOR PLAN
 1/4" = 1'-0" CEILING HGT. = 9'-0"

Handwritten notes:
 Slab
 Stick Frame vs Truss Frame
 Laundry 7/8" brick LVP
 Bath 1/2" Tile
 Engineer's Handwritten

FIGURE 2 - RESIDENTIAL CONSTRUCTION PROJECTS (1901-010273) - ANN DENNING - DENNING RESIDENCE (1901-010273) DWG. SAVED BY: SEAN LUST FLOOR DATE: 7/29/2019 11:20 AM

DESIGN LOADS

	LIVE LOAD (PSF)	DEAD LOAD (PSF)	DEFLECTION	
			L	T
FLOOR (primary)	40	10	L/360	L/240
FLOOR (secondary)	40	10	L/360	L/240
ATTIC (w/ storage)	20	10	L/240	L/180
ATTIC (w/ access)	10	5	L/240	L/180
EXTERNAL BALCONY	40	10	L/360	L/240
ROOF	20	10	L/240	L/180
ROOF TRUSS	20	20	L/240	L/180
WIND LOAD	BASED ON 120 MPH (EXPOSURE B)			
SEISMIC	BASED ON SEISMIC ZONES A, B & C			


STRUCTURAL NOTES

- ALL CONSTRUCTION SHALL CONFORM TO THE LATEST REQUIREMENTS OF "NORTH CAROLINA STATE 2018 RESIDENTIAL BUILDING CODE", IN ADDITION TO ALL LOCAL CODES AND REGULATIONS.
- IT IS THE CONTRACTOR'S RESPONSIBILITY TO VERIFY ALL DIMENSIONS AND SQUARE FOOTAGE PRIOR TO CONSTRUCTION. TYNDAL ENGINEERING & DESIGN, P.A. IS NOT RESPONSIBLE FOR DIMENSIONS AND SQUARE FOOTAGE ERRORS ONCE CONSTRUCTION BEGINS.
- ALL LUMBER SHALL BE SIP #2 (UNO)
ALL LVL LUMBER TO BE 1.75" WIDE NOMINAL EACH SINGLE MEMBER AND F_b = 2600 PSI, E = 1.9M PSI (I.E. LEVEL MICRO ILM)
ALL LVL LUMBER IS TO BE 1.55E (F_b = 2325 PSI)
- ALL LOAD BEARING EXTERIOR WINDOW HEADERS WITH MAXIMUM SPAN OF 5'-0" SHOULD BE A (2) 2x10 w/ (1) 2x4 KING STUD AND (1) 2x4 JACK STUD NAILED TOGETHER w/ (2) 10d @ 8" O.C. PROVIDED THAT THE TOP OF THE WINDOW HEIGHT IS 6'-8" MINIMUM BOTTOM OF THE WINDOW HEIGHT IS 1'-6", OTHERWISE REFER TO TABLE R602.7(1).
- ALL INTERIOR LOAD BEARING HEADERS TO BE (2) 2x10 (UNO.) REFER TO TABLE R602.7(2) FOR JACK STUD REQUIREMENTS FOR HEADER SPANS FOR INTERIOR AND EXTERIOR LOAD CONDITIONS (UNO)
- REFER TO 2018 IBC BUILDING CODE SECTION R602 FOR CONSTRUCTION OF ALL WALLS OVER 10'-0" IN HEIGHT.
- ALL STRUCTURAL STEEL SHALL BE ASTM A992 GRADE 50 F_y = 50 KSI MIN. (UNO)
- ALL EXTERIOR LUMBER TO BE #2 SIP PT
- ALL CONCRETE, I.C. = 3000 PSI MIN.
- PRESUMPTIVE BEARING CAPACITY = 2000 PSF
- 1/2" ANCHOR BOLTS SPACED AT MAXIMUM OF 6'-0" O.C. AND NOT MORE THAN 12" FROM THE CORNER. THERE SHALL BE A MINIMUM OF (2) BOLTS PER PLATE SECTION. ANCHOR BOLTS SHALL BE SPACED AT 3'-0" O.C. FOR BASEMENTS. ANCHOR BOLT SHALL EXTEND 7" INTO CONCRETE OR MASONRY.
- PSL COLUMNS DESIGNED WITH MAX. HEIGHT OF 9'-0" (UNO)
- PROVIDE A MINIMUM OF 500# UPLIFT & LATERAL CONNECTION AT TOP AND BOTTOM OF PIER COLUMNS. (UNO.)
- PROVIDE CONTINUOUS SHEATHING PER SECTION 602.10.4 OF THE 2018 IRC.
- MAXIMUM MASONRY PIER HEIGHT SHALL NOT EXCEED FOUR TIMES ITS LEAST HORIZONTAL DIMENSION.
- UPLIFT LOADS GREATER THAN 500# SHALL BE CONTINUOUSLY ANCHORED TO THE FOUNDATION.
- METAL HANGERS SHALL BE SIMPSON OR APPROVED EQUAL.

STRUCTURAL SHEATHING NOTES

- DESIGNED FOR SEISMIC ZONE A-C AND WIND SPEEDS OF 120 MPH OR LESS.
- WALLS SHALL BE BRACED IN ACCORDANCE WITH SECTION R602.10 OF THE 2018 IBC.
- BRACING REQUIREMENTS SHALL BE PER TABLE R602.10.3. REFER TO SECTION R602.10 FOR LOAD PATH DETAILS INCLUDING CONNECTIONS & SUPPORT OF BRACED WALL PANELS.
- INTERIOR BRACED WALL PANELS (IBWP) INDICATED SHALL BE SHEATHED IN ACCORDANCE WITH THE CB METHOD OR WSP METHOD AS PRESCRIBED IN SECTION R602.10.1 (UNO)
 - REFERENCE FIGURE R602.10.4.3 OF THE 2018 IBC.
 - 1/2" GYPSUM BOARD (GB) MINIMUM LENGTH OF 8'-0" (ISOLATED PANELS) OR 4'-0" (CONTINUOUS SHEATHING) SECURE w/ 5d COOLER NAILS (OR EQUAL PER TABLE R702.3.3) SPACED @ 7" O.C. AT PANEL EDGES INCLUDING TOP AND BOTTOM PLATES & 7" O.C. AT INTERMEDIATE SUPPORTS
 - 3/8" WOOD STRUCTURAL PANEL (WSP) SECURE w/ 6d COMMON NAILS SPACED AT 6" O.C. AT PANEL EDGES AND 12" O.C. AT INTERMEDIATE SUPPORTS
- EXTERIOR BRACED WALL PANELS (EBWP) SHALL BE CONSTRUCTED IN ACCORDANCE WITH CS-WSP METHOD AS PRESCRIBED IN SECTION R602.10.3 (UNO)
- ALL SHEATHABLE SURFACES OF EXTERIOR WALLS (INCLUDING AREAS ABOVE AND BELOW OPENINGS AND GABLE END WALLS) SHALL BE CONTINUOUSLY SHEATHED WITH WOOD STRUCTURAL PANEL (WSP) SHEATHING WITH A MINIMUM THICKNESS OF 3/8" SHEATHING SHALL BE SECURED WITH MINIMUM 6d COMMON NAILS SPACED AT 6" O.C. AT PANEL EDGES AND SPACED AT 12" O.C. AT INTERMEDIATE SUPPORTS.
- MINIMUM BRACED WALL PANEL LENGTHS WITH CS-WSP METHOD SHALL BE AS FOLLOWS:
 - 24" ADJACENT TO OPENINGS NOT MORE THAN 67% OF WALL HEIGHT.
 - 30" ADJACENT TO OPENINGS GREATER THAN 67% AND LESS THAN 85% OF WALL HEIGHT.
 - 48" FOR OPENINGS GREATER THAN 85% OF WALL HEIGHT.
- SHEATH INTERIOR & EXTERIOR
- FOR CS-WSP METHOD, A MINIMUM 24" BRACED WALL PANEL CORNER RETURN SHALL BE PROVIDED AT BOTH ENDS OF A BRACED WALL LINE IN ACCORDANCE WITH FIGURE R602.10.3(4). IN LIEU OF A CORNER RETURN, EITHER A MIN 48" BRACED WALL PANEL SHALL BE PROVIDED AT THE CORNER OR A HOLD-DOWN DEVICE WITH A MINIMUM UPLIFT DESIGN VALUE OF 800# SHALL BE FASTENED TO THE EDGE OF THE BRACED WALL PANEL CLOSEST TO THE CORNER AND TO THE FOUNDATION OR FRAMING BELOW.
 - MINIMUM 800# HOLD-DOWN DEVICE


STORAGE	1ST FLOOR
BRACING PANEL LENGTHS REQUIRED:	BRACING PANEL LENGTHS REQUIRED:
BWL D = 2.3 FT	BWL A = 2.6 FT
BWL E = 2.3 FT	BWL B = 8.7 FT
BWL C = 2.0 FT	BWL A = 2.1 FT
BWL D = 2.0 FT	BWL I = 6.3 FT
	BWL 2 = 6.3 FT
BRACING PANEL LENGTHS PROVIDED:	BRACING PANEL LENGTHS PROVIDED:
BWL D = 18.0 FT CS-WSP	BWL A = 9.67 FT CS-WSP
BWL E = 18.0 FT CS-WSP	BWL B = 14.0 FT CS-WSP
BWL C = 12.0 FT CS-WSP	BWL C = 35.42 FT CS-WSP
BWL D = 8.17 FT CS-WSP	BWL I = 25.25 FT CS-WSP
	BWL 2 = 15.0 FT CS-WSP

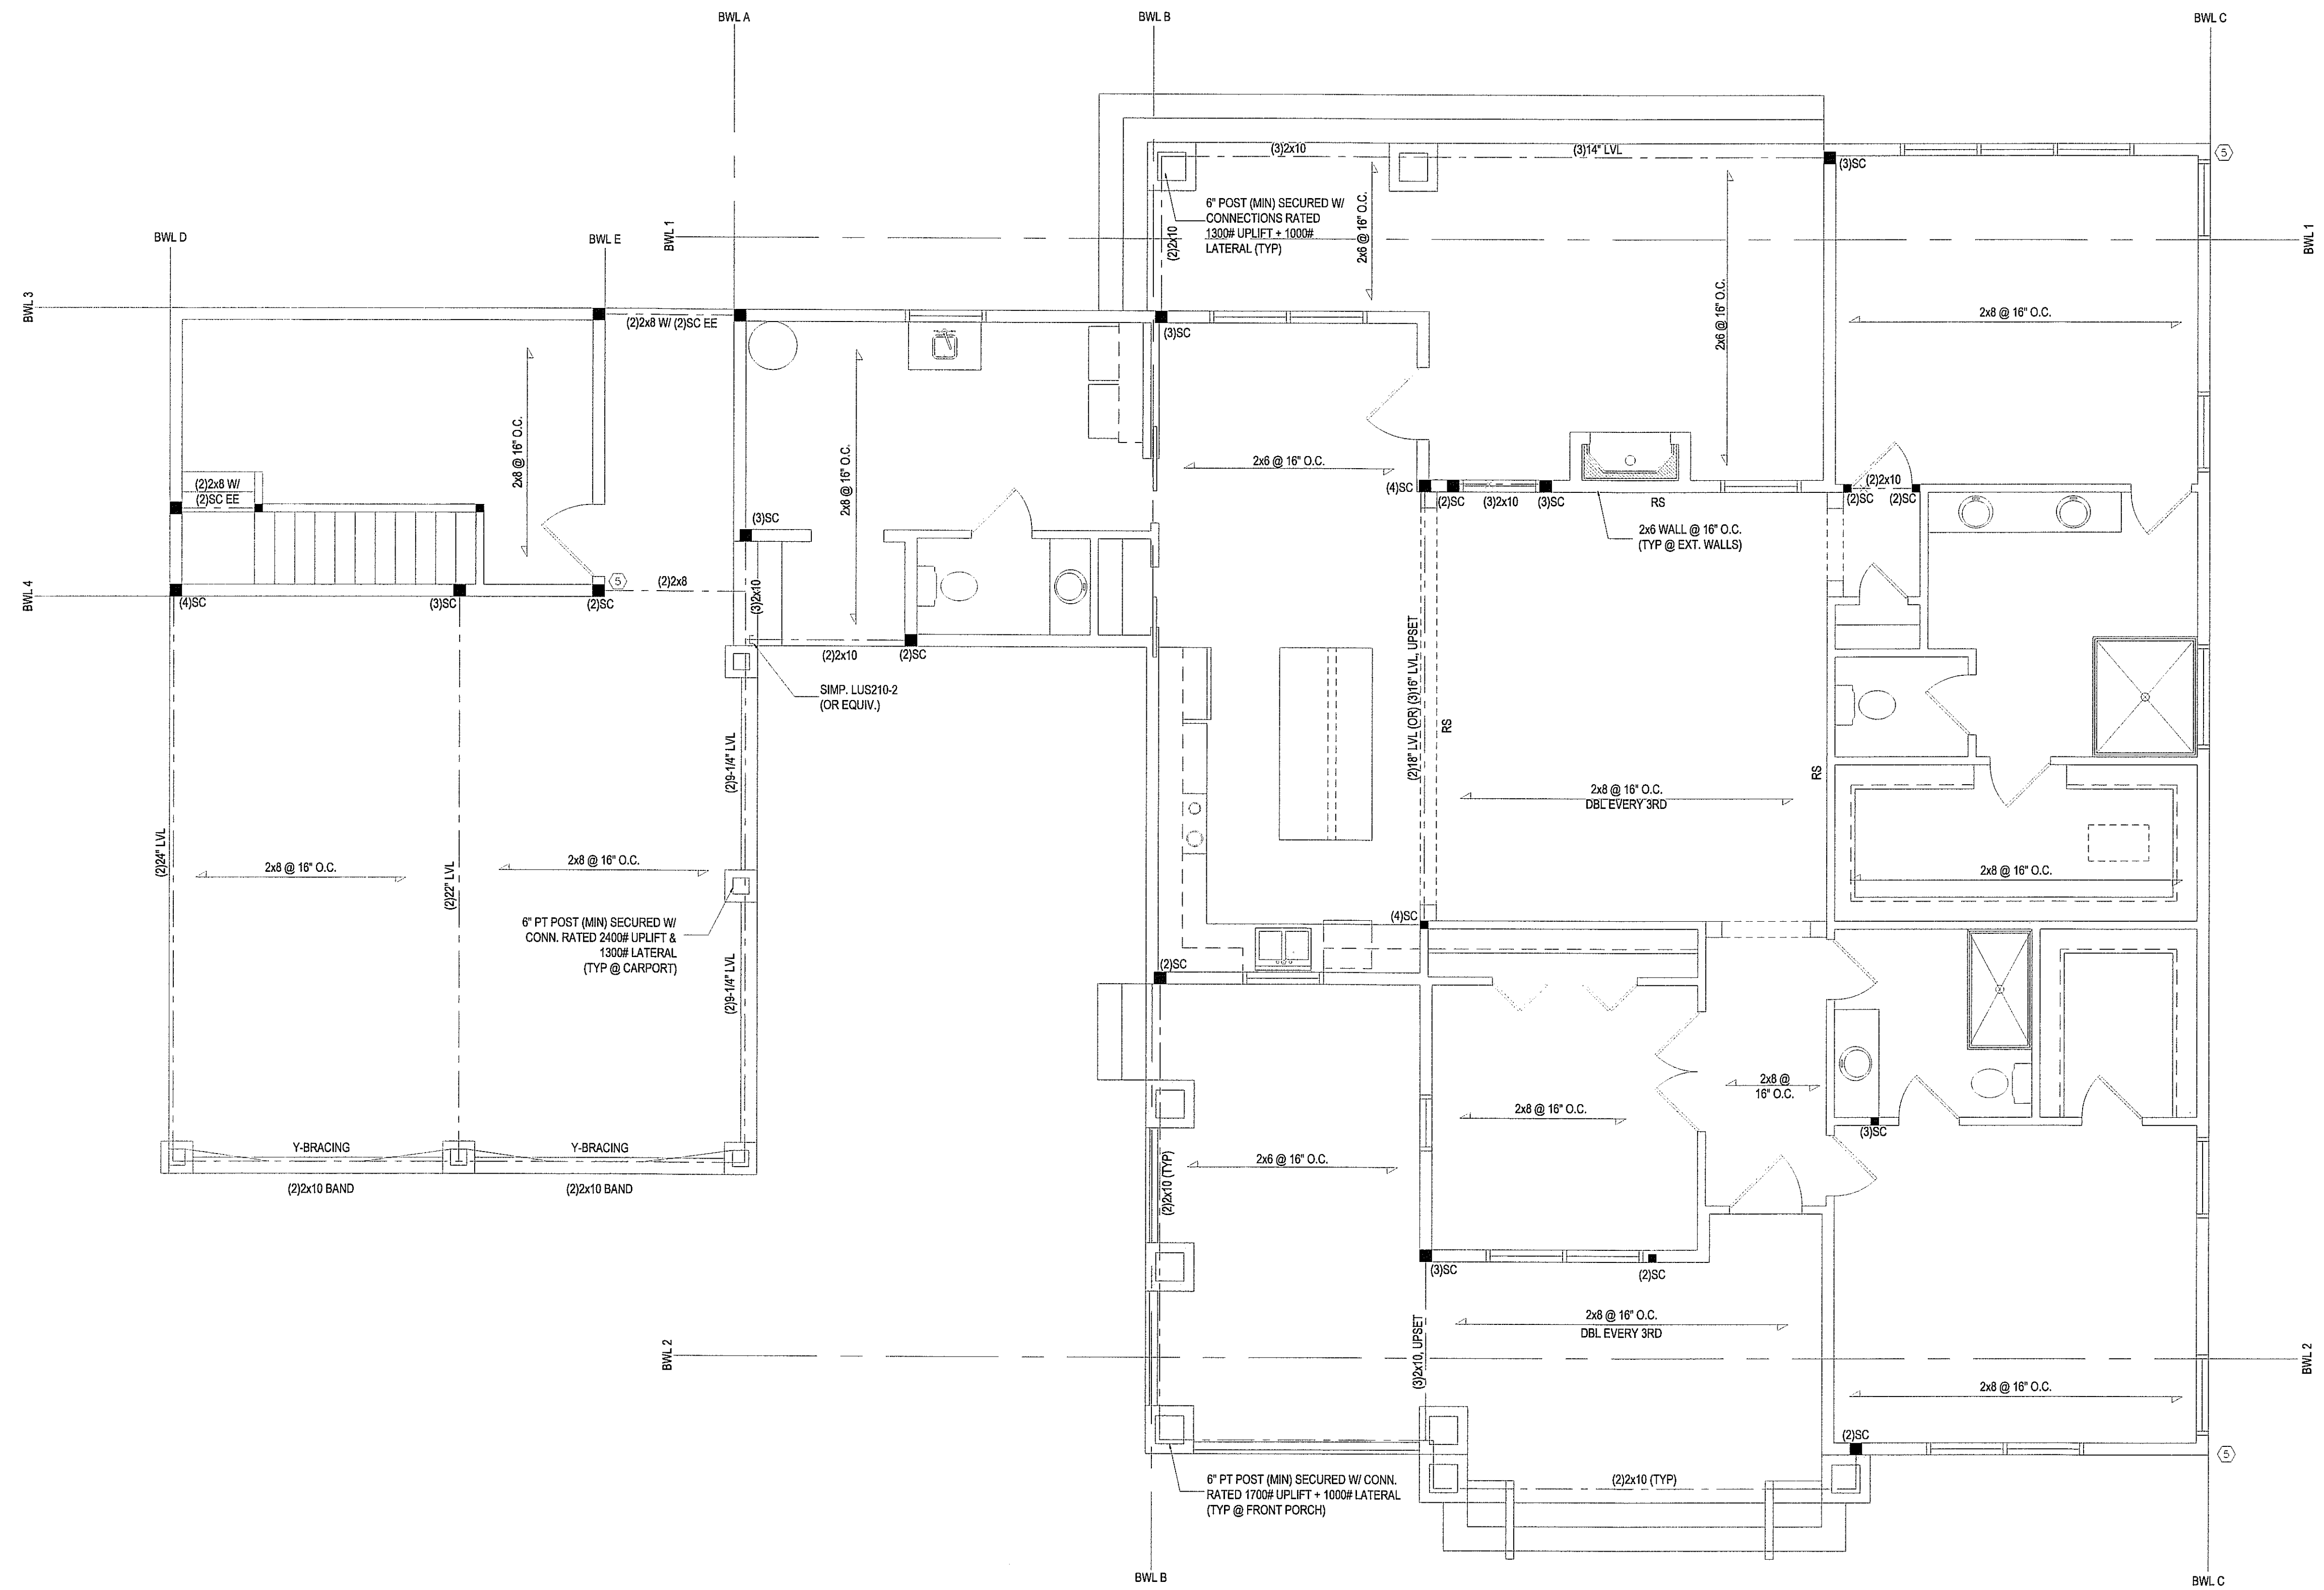

FIRST FLOOR STRUCTURAL PLAN

1/4" = 1'-0" CEILING HGT. = 9'-0"

*Engineer seal does not include construction means, methods, techniques, sequences, procedures or safety practices. Any deviation or discrepancy on plans are to be brought to the attention of the engineer. Tyndal Engineering & Design, P.A. Failure to do so will void Tyndal Engineering & Design, P.A. liability. When review these documents carefully, Tyndal Engineering & Design, P.A. will interpret that all documents were prepared in accordance with the recommendations, etc. presented in these documents were deemed acceptable once construction begins.

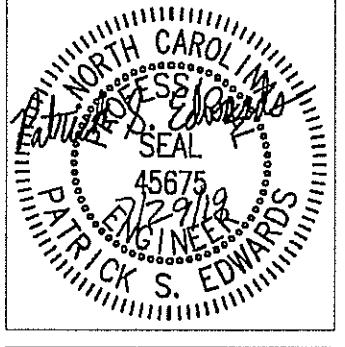

TYNDAL
ENGINEERING DESIGN, P.A.
189773031 • 800 772 8888
200 Shawhatch Drive • Garner, N.C. 27530
www.tyndalengineering.com

CLIENT: ANN DENNING
PROJECT: DENNING RESIDENCE


FIRST FLOOR STRUCTURAL PLAN

Project #: 1901-010273
Date: 7/29/19
Drawn/Design By: IJE
DWG. Checked By: PTH
Scale: SEE PLAN

No.	Date	Remarks

Sheet Number
S2
5 of 6

*Engineers shall not include construction means, methods, techniques, sequences, procedures or safety precautions.
 *Any deviation or interpretation on plans are to be brought to the immediate attention of Tyndall Engineering & Design, P.A. Failure to do so will void Tyndall Engineering & Design, P.A. liability.
 *Please review these documents carefully. Tyndall Engineering & Design, P.A. will interpret this all dimensions, recommendations, etc. presented in these documents were deemed acceptable once construction begins.

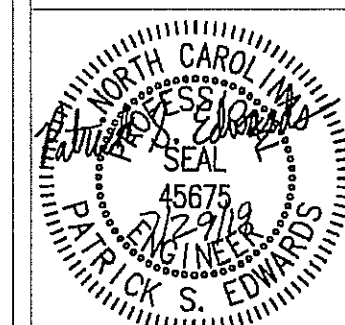

TYNDALL
 ENGINEERING & DESIGN, P.A.
 1199 793 SOUTH • 499 775-8668
 210 Shipwash Drive • Garner, North Carolina • 27828
 www.tyndallengineering.com

Client: **ANN DENNING**
 Project: **DENNING RESIDENCE**

ROOF PLAN

Project #: **1901-010273**
 Date: **7/29/19**
 Drawn/Design By: **IJE**
 DWG. Checked By: **PTII**
 Scale: **SEE PLAN**

REVISIONS		
No.	Date	Remarks

Sheet Number
S3
 6 of 6



RS = ROOF SUPPORT
ROOF PLAN
 1/4" = 1'-0"

RELEASE: T:_PROJECTS\2019\2019-010273\1901-010273.DWG - ANN DENNING - DENNING RESIDENCE PROJECT\1901-010273 - ANN DENNING - DENNING RESIDENCE PROJECT\1901-010273.DWG 7/29/19 11:28 AM

STRUCTURAL NOTES

- ALL CONSTRUCTION SHALL CONFORM TO THE LATEST REQUIREMENTS OF "NORTH CAROLINA STATE 2018 RESIDENTIAL BUILDING CODE", IN ADDITION TO ALL LOCAL CODES AND REGULATIONS.
- DESIGN LOADS.

	LIVE LOAD (PSF)	DEAD LOAD (PSF)	DEFLECTION	
			LL	TL
ALL FLOORS	40	10	L/360	L/240
ATTC (w/ w/ stairs)	30	10	L/360	L/240
ATTC (w/ down access)	20	10	L/240	L/180
ATTC (no access)	10	5	L/240	L/180
EXTERNAL BALCONY	40	10	L/360	L/240
ROOF	20	10	L/240	L/180
ROOF TRUSS	20	20	L/240	L/180

WIND LOAD BASED ON 120 MPH (EXPOSURE B)

SEISMIC SEISMIC ZONES A, B & C
- MINIMUM ALLOWABLE SOIL BEARING PRESSURE = 2000 PSF
- CONCRETE SHALL HAVE A MINIMUM 28 DAY COMPRESSIVE STRENGTH OF 3000 PSI AND A MAXIMUM SLUMP OF FIVE INCHES UNLESS NOTED OTHERWISE. (U.N.O.)
- MAXIMUM DEPTH OF UNBALANCED FILL AGAINST FOUNDATION WALLS TO BE LESS THAN 4'-0" WITHOUT USING SUFFICIENT WALL BRACING. REFER TO SECTION R404 OF 2018 IBC BUILDING CODE FOR BACKFILL LIMITATIONS BASED ON WALL HEIGHT, WALL THICKNESS, SOIL TYPE, AND UNBALANCED BACKFILL HEIGHT.
- ALL FRAMING LUMBER SHALL BE SYP #2 (F_b = 800 PSI, BASED ON 2X10 UNJO.) ALL FRAMING LUMBER EXPOSED TO THE ELEMENTS SHALL BE TREATED MATERIAL. ALL LVL LUMBER TO BE 1.75" WIDE NOMINAL EACH SINGLE MEMBER AND F_b = 2600 PSI, E = 1.9M PSI (U.N.O.) ALL LSL LUMBER TO BE 3.5" WIDE NOMINAL EACH SINGLE MEMBER AND F_b = 2325 PSI, E = 1.6M PSI (U.N.O.) ALL PSL LUMBER TO BE 3.5" WIDE NOMINAL EACH SINGLE MEMBER AND F_b = 2400 PSI, E = 1.8M PSI (U.N.O.)
- ALL LOAD BEARING EXTERIOR HEADERS SHALL BE AT (2) 2X10. (U.N.O.) REFER TO TABLE R602.7(1) & (2) FOR JACK STUD REQUIREMENTS FOR HEADER SPANS FOR INTERIOR AND EXTERIOR LOAD CONDITIONS UNLESS SPECIFICALLY NOTED ON PLANS.
- ALL STRUCTURAL STEEL W-SHAPES (I-BEAMS) SHALL BE ASTM A992 GRADE 50. ALL STEEL ANGLES, PLATES, AND C-CHANNELS SHALL BE ASTM A36. ALL STEEL PIPE SHALL BE ASTM A53 GRADE B.
- STEEL BEAMS SHALL BE SUPPORTED AT EACH END WITH A MINIMUM BEARING LENGTH OF 3-1/2" AND FULL FLANGE WIDTH PROVIDE SOLID BEARING FROM BEAM SUPPORT TO FOUNDATION. BEAMS SHALL BE ATTACHED TO EACH SUPPORT WITH TWO (2) LAG SCREWS (1/2" x 4" LONG). LATERAL SUPPORT IS CONSIDERED ADEQUATE PROVIDED THE JOISTS ARE TOE NAILED TO THE SOLE PLATES, AND THE SOLE PLATES ARE NAILED OR BOLTED TO THE BEAM FLANGES @ 48" O.C.
- PROVIDE ANCHOR BOLT PLACEMENT PER SECTION 403.1.8. 1/2" ANCHOR BOLTS SPACED AT 6'-0" O.C. AND PLACED 1" FROM THE END OF EACH PLATE SECTION. ANCHOR BOLTS SHALL BE SPACED AT 2'-0" O.C. FOR BASEMENTS. ANCHOR BOLT SHALL EXTEND 7" INTO CONCRETE OR MASONRY. THE BOLTS SHALL BE LOCATED IN THE MIDDLE THIRD OF THE WIDTH OF THE PLATE. THERE SHALL BE A MINIMUM TWO ANCHOR BOLTS PER PLATE SECTION.
- FOUNDATION DRAINAGE-DAMP PROOFING OR WATERPROOFING PER SECTION 405 AND 406 OF THE BUILDING CODE.
- WALL AND ROOF CLADDING VALUES. WALL CLADDING SHALL BE DESIGNED FOR 38.0 POUNDS PER SQUARE FOOT (LBS/SOFT) OR GREATER POSITIVE AND NEGATIVE PRESSURE. ROOF VALUES BOTH POSITIVE AND NEGATIVE SHALL BE AS FOLLOWS:
30.0 LBS/SOFT FOR ROOF PITCHES 0/12 TO 1.5/12
36.0 LBS/SOFT FOR ROOF PITCHES 1.5/12 TO 6/12
18.0 LBS/SOFT FOR ROOF PITCHES 6/12 TO 12/12
**MEAN ROOF HEIGHT 30'-0" OR LESS
- FOR ROOF SLOPES FROM 2/12 THROUGH 4/12, BUILDER TO INSTALL 2 LAYERS OF 15# FELT PAPER.
- REFER TO SECTION R602.3 FOR FRAMING OF ALL WALLS OVER 10'-0" IN HEIGHT.
- PROVIDE CONTINUOUS SHEATHING PER SECTION 602.10.3 OF THE 2018 IRC.
- UPLIFT LOADS GREATER THAN 500g SHALL BE CONTINUOUSLY ANCHORED TO THE FOUNDATION.
- REFER TO TABLE N1102.1 FOR PRESCRIPTIVE BUILDING ENVELOPE THERMAL COMPONENT CRITERIA.
- PSL COLUMNS DESIGNED WITH MAXIMUM HEIGHT OF 9'-0" (U.N.O.)
- PROVIDE A MINIMUM OF 500g UPLIFT & LATERAL CONNECTION AT TOP AND BOTTOM OF PORCH COLUMNS. (U.N.O.)
- MAXIMUM MASONRY PER HEIGHT SHALL NOT EXCEED FOUR TIMES ITS LEAST HORIZONTAL DIMENSION.
- IT IS THE CONTRACTORS RESPONSIBILITY TO VERIFY ALL DIMENSIONS AND SQUARE FOOTAGE PRIOR TO CONSTRUCTION. TYNDALE ENGINEERING & DESIGN, P.A. IS NOT RESPONSIBLE FOR DIMENSION OR SQUARE FOOTAGE ERRORS ONCE CONSTRUCTION BEGINS.

TABLE N1102.1 CLIMATE ZONES 3-5



CLIMATE ZONES	FENESTRATION U-FACTOR ¹	SH-GLIGHT U-FACTOR ²	GLAZED FENESTRATION SHGC ^{3,4}	CEDILING R-VALUE	ROOF R-VALUE	MASS WALL R-VALUE	FLOOR R-VALUE	BASEMENT ⁵ WALL R-VALUE	SLAB ⁶ R-VALUE AND DEPTH	CEILING SPACE R-VALUE
3	0.35	0.55	0.30	38 or 30 cont ¹	15 or 13 ⁷	5/13 or 5/10 cont ¹	19	5/13 ⁸	10	5/13
4	0.35	0.55	0.30	38 or 30 cont ¹	15 or 13 ⁷	5/13 or 5/10 cont ¹	19	11/15	10	10/15
5	0.35	0.55	NR	38 or 30 cont ¹	15 or 13 ⁷	5/13 or 5/10 cont ¹	30 ⁹	11/15	10	11/15

- R-VALUES ARE MINIMUM U-FACTORS AND SHGC ARE MAXIMUMS. WHEN INSULATION IS INSTALLED IN A Cavity WHICH IS LESS THAN THE LABEL OR DESIGN THICKNESS OF THE INSULATION, THE INSTALLED R-VALUE OF THE INSULATION SHALL NOT BE LESS THAN THE R-VALUE SPECIFIED IN THE TABLE.
- THE FENESTRATION U-FACTOR COLUMN EXCLUDES SHADERS. THE SOLAR HEAT GAIN COEFFICIENT (SHGC) COLUMN APPLIES TO ALL GLAZED FENESTRATION.
- 1/2" O.C. MEANS R-10 CONTINUOUS EXTERIOR SHEATHING ON THE EXTERIOR SURFACE OF THE WALL OR SLAB. CAVITY INSULATION AT THE INTERIOR OF THE EXTERIOR WALL OR CEILING SHALL BE 15" O.C. MEANS R-10 CONTINUOUS EXTERIOR SHEATHING ON THE EXTERIOR SURFACE OF THE WALL OR CEILING. INSULATION SHALL BE INSTALLED IN A CAVITY WHICH IS LESS THAN THE LABEL OR DESIGN THICKNESS OF THE INSULATION, THE INSTALLED R-VALUE OF THE INSULATION SHALL NOT BE LESS THAN THE R-VALUE SPECIFIED IN THE TABLE.
- CEILING SHALL BE 15" O.C. MEANS R-10 CONTINUOUS EXTERIOR SHEATHING ON THE EXTERIOR SURFACE OF THE CEILING. INSULATION SHALL BE INSTALLED IN A CAVITY WHICH IS LESS THAN THE LABEL OR DESIGN THICKNESS OF THE INSULATION, THE INSTALLED R-VALUE OF THE INSULATION SHALL NOT BE LESS THAN THE R-VALUE SPECIFIED IN THE TABLE.
- BASEMENT WALL INSULATION IS NOT REQUIRED IN BARRIERS-THROUGH LOCATIONS AS DEFINED BY SECTION 404.2 AND TABLE N1102.1.
- INSULATION SUFFICIENT TO FILL THE CAVITY. R-10 MEANS 10" O.C. MEANS R-10 CONTINUOUS EXTERIOR SHEATHING ON THE EXTERIOR SURFACE OF THE WALL OR CEILING. INSULATION SHALL BE INSTALLED IN A CAVITY WHICH IS LESS THAN THE LABEL OR DESIGN THICKNESS OF THE INSULATION, THE INSTALLED R-VALUE OF THE INSULATION SHALL NOT BE LESS THAN THE R-VALUE SPECIFIED IN THE TABLE.
- INSULATION PLUS R-13 MEANS R-13 CONTINUOUS EXTERIOR SHEATHING ON THE EXTERIOR SURFACE OF THE WALL OR CEILING. INSULATION SHALL BE INSTALLED IN A CAVITY WHICH IS LESS THAN THE LABEL OR DESIGN THICKNESS OF THE INSULATION, THE INSTALLED R-VALUE OF THE INSULATION SHALL NOT BE LESS THAN THE R-VALUE SPECIFIED IN THE TABLE.
- INSULATION PLUS R-13 MEANS R-13 CONTINUOUS EXTERIOR SHEATHING ON THE EXTERIOR SURFACE OF THE WALL OR CEILING. INSULATION SHALL BE INSTALLED IN A CAVITY WHICH IS LESS THAN THE LABEL OR DESIGN THICKNESS OF THE INSULATION, THE INSTALLED R-VALUE OF THE INSULATION SHALL NOT BE LESS THAN THE R-VALUE SPECIFIED IN THE TABLE.
- INSULATION PLUS R-13 MEANS R-13 CONTINUOUS EXTERIOR SHEATHING ON THE EXTERIOR SURFACE OF THE WALL OR CEILING. INSULATION SHALL BE INSTALLED IN A CAVITY WHICH IS LESS THAN THE LABEL OR DESIGN THICKNESS OF THE INSULATION, THE INSTALLED R-VALUE OF THE INSULATION SHALL NOT BE LESS THAN THE R-VALUE SPECIFIED IN THE TABLE.
- INSULATION PLUS R-13 MEANS R-13 CONTINUOUS EXTERIOR SHEATHING ON THE EXTERIOR SURFACE OF THE WALL OR CEILING. INSULATION SHALL BE INSTALLED IN A CAVITY WHICH IS LESS THAN THE LABEL OR DESIGN THICKNESS OF THE INSULATION, THE INSTALLED R-VALUE OF THE INSULATION SHALL NOT BE LESS THAN THE R-VALUE SPECIFIED IN THE TABLE.
- INSULATION PLUS R-13 MEANS R-13 CONTINUOUS EXTERIOR SHEATHING ON THE EXTERIOR SURFACE OF THE WALL OR CEILING. INSULATION SHALL BE INSTALLED IN A CAVITY WHICH IS LESS THAN THE LABEL OR DESIGN THICKNESS OF THE INSULATION, THE INSTALLED R-VALUE OF THE INSULATION SHALL NOT BE LESS THAN THE R-VALUE SPECIFIED IN THE TABLE.
- INSULATION PLUS R-13 MEANS R-13 CONTINUOUS EXTERIOR SHEATHING ON THE EXTERIOR SURFACE OF THE WALL OR CEILING. INSULATION SHALL BE INSTALLED IN A CAVITY WHICH IS LESS THAN THE LABEL OR DESIGN THICKNESS OF THE INSULATION, THE INSTALLED R-VALUE OF THE INSULATION SHALL NOT BE LESS THAN THE R-VALUE SPECIFIED IN THE TABLE.
- INSULATION PLUS R-13 MEANS R-13 CONTINUOUS EXTERIOR SHEATHING ON THE EXTERIOR SURFACE OF THE WALL OR CEILING. INSULATION SHALL BE INSTALLED IN A CAVITY WHICH IS LESS THAN THE LABEL OR DESIGN THICKNESS OF THE INSULATION, THE INSTALLED R-VALUE OF THE INSULATION SHALL NOT BE LESS THAN THE R-VALUE SPECIFIED IN THE TABLE.
- INSULATION PLUS R-13 MEANS R-13 CONTINUOUS EXTERIOR SHEATHING ON THE EXTERIOR SURFACE OF THE WALL OR CEILING. INSULATION SHALL BE INSTALLED IN A CAVITY WHICH IS LESS THAN THE LABEL OR DESIGN THICKNESS OF THE INSULATION, THE INSTALLED R-VALUE OF THE INSULATION SHALL NOT BE LESS THAN THE R-VALUE SPECIFIED IN THE TABLE.
- INSULATION PLUS R-13 MEANS R-13 CONTINUOUS EXTERIOR SHEATHING ON THE EXTERIOR SURFACE OF THE WALL OR CEILING. INSULATION SHALL BE INSTALLED IN A CAVITY WHICH IS LESS THAN THE LABEL OR DESIGN THICKNESS OF THE INSULATION, THE INSTALLED R-VALUE OF THE INSULATION SHALL NOT BE LESS THAN THE R-VALUE SPECIFIED IN THE TABLE.

1934 SQ. FT. OF CRAWL SPACE / 150 = 12.9 SQ. FT. OF REO'D VENTILATION WITHOUT CROSS VENTILATION
12.9 SQ. FT. OF VENTILATION REO'D / 0.45 SQ.FT. PER VENT = 29 VENTS REO'D

-OR-

1934 SQ. FT. OF CRAWL SPACE / 1500 = 1.29 SQ. FT. OF REO'D VENTILATION WITH CROSS VENTILATION
1.29 SQ. FT. OF VENTILATION REO'D / 0.45 SQ.FT. PER VENT = 3 VENTS REO'D

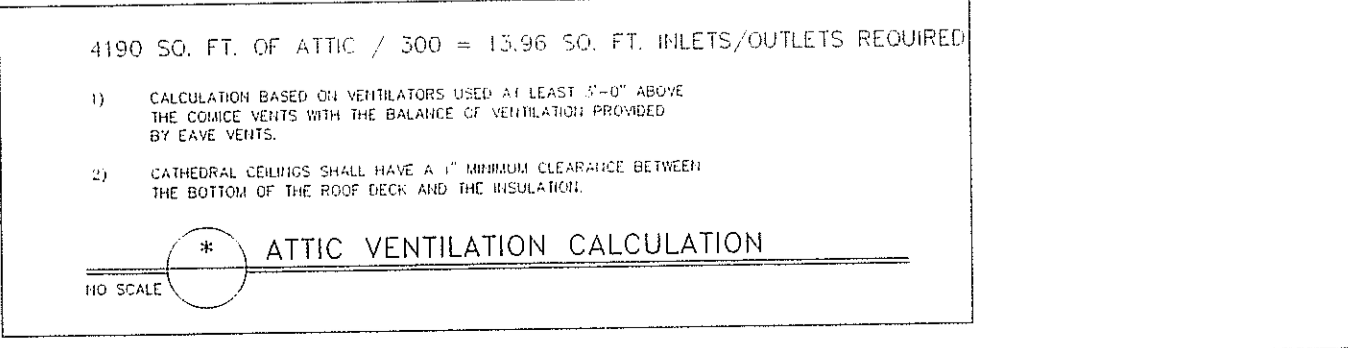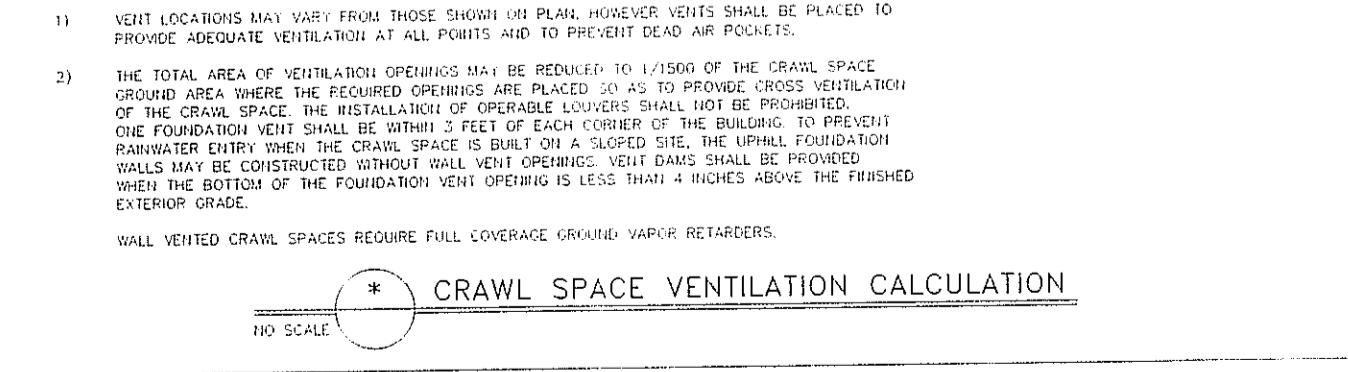

DEFINITIONS FOR COMMON ABBREVIATIONS

- | | |
|-----------------------------|------------------------------|
| ALT = ALTERNATE | MAX = MAXIMUM |
| CAIT = CARTRIDGE | MIN = MINIMUM |
| CJ = CEILING JOIST | NOM = NOMINAL |
| CMU = CONCRETE MASONRY UNIT | O.C. = ON CENTER |
| COL = COLUMN | PL = PLATE |
| CONC = CONCRETE | PT = PRESSURE TREATED |
| CONT = CONTINUOUS | REIN = REINFORCED |
| CT = COLLAR TIE | REQD = REQUIRED |
| DEL = DOUBLE | RJ = ROOF JOIST |
| DIA = DIAMETER | RS = ROOF SUPPORT |
| DJ = DOUBLE JOIST | SC = STUD COLUMN |
| DR = DOUBLE RAFTER | SCH = SCHEDULE |
| EA = EACH | SPEC = SPECIFIED |
| EE = EACH END | TH = THICK |
| FJ = FLOOR JOIST | TJ = TRIPLE JOIST |
| FND = FOUNDATION | TRTD = TREATED |
| FTG = FOOTING | TYP = TYPICAL |
| GALV = GALVANIZED | UNO = UNLESS NOTED OTHERWISE |
| HORIZ = HORIZONTAL | W = WIDE FLANGE BEAM |
| HT = HEIGHT | WWF = WELDED WIRE FABRIC |
| MANUF = MANUFACTURER | XJ = EXTRA JOIST |

1) MAXIMUM HEIGHT OF DECK SUPPORT POSTS AS FOLLOWS.











POST SIZE	MAX. POST HEIGHT**
4 x 4	8'-0"
6 x 6	20'-0"
***	OVER 20'-0"

- THIS TABLE IS BASED ON NO. 2 TREATED SOUTHERN PINE POSTS. MAXIMUM TRIBUTARY AREA IS BASED ON 128 TOTAL SQUARE FEET WHICH MAY BE LOCATED AT DIFFERENT LEVELS.
- FROM TOP OF FOOTING TO BOTTOM OF ORDER
- DECKS WITH POST HEIGHTS OVER 20'-0" SHALL BE DESIGNED AND SEALED BY A PROFESSIONAL ENGINEER OR REGISTERED ARCHITECT.

- DECKS SHALL BE BRACED TO PROVIDE LATERAL STABILITY BY ONE OF THESE METHODS:
 - THE DECK FLOOR HEIGHT IS LESS THAN 4'-0" AND THE DECK IS ATTACHED TO THE STRUCTURE IN ACCORDANCE WITH SECTION (4) ABOVE. LATERAL BRACING IS NOT REQUIRED.
 - 4 x 4 WOOD KNEE BRACES MAY BE PROVIDED ON EACH COLUMN IN BOTH DIRECTIONS. THE KNEE BRACES SHALL ATTACH TO EACH POST AT A POINT NOT LESS THAN 1/3 OF THE POST LENGTH FROM THE TOP OF THE POST, AND THE BRACES SHALL BE ANGLED BETWEEN 45° AND 60° FROM THE HORIZONTAL. KNEE BRACES SHALL BE BOLTED TO THE POST AND ORDER WITH ONE 5/8" HOT DIPPED GALVANIZED BOLT AT EACH END OF THE BRACE.
 - FOR FREESTANDING DECKS WITHOUT KNEE BRACES OR DIAGONAL BRACING, LATERAL STABILITY MAY BE PROVIDED BY EMBEDDING THE POSTS IN ACCORDANCE WITH THE FOLLOWING.

POST SIZE	MAX. TRIBUTARY AREA	MAX. POST HEIGHT	EMBEDMENT DEPTH	CONCRETE DIAMETER
4 x 4	48 SQ. FT.	4'-0"	2'-6"	1'-0"
6 x 6	120 SQ. FT.	6'-0"	3'-6"	1'-8"
- 2 x 6 DIAGONAL VERTICAL CROSS BRACING MAY BE PROVIDED IN TWO (2) PERPENDICULAR DIRECTIONS FOR FREESTANDING DECKS OR PARALLEL TO THE STRUCTURE AT THE EXTERIOR COLUMN LINE FOR ATTACHED DECKS. THE 2 x 6s SHALL BE ATTACHED TO THE POSTS WITH ONE 5/8" HOT DIPPED GALVANIZED BOLT AT EACH END OF EACH BRACING MEMBER.
- FOR EMBEDMENT OF PILES IN COASTAL REGIONS, SEE CHAPTER 16.

POST SIZE	MAX. TRIBUTARY AREA	MAX. POST HEIGHT	EMBEDMENT DEPTH	CONCRETE DIAMETER
4 x 4	48 SQ. FT.	4'-0"	2'-6"	1'-0"
6 x 6	120 SQ. FT.	6'-0"	3'-6"	1'-8"

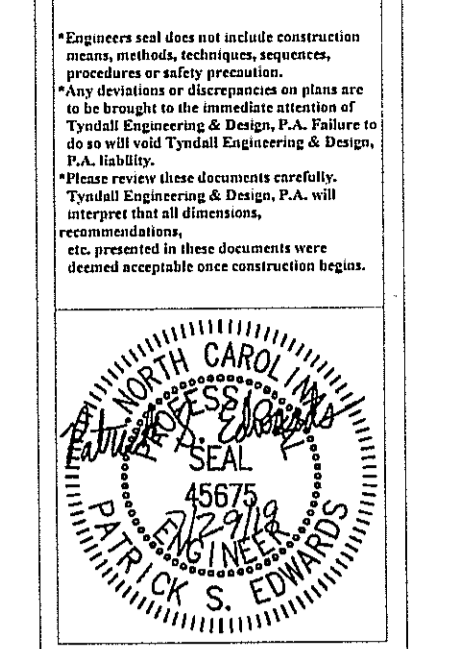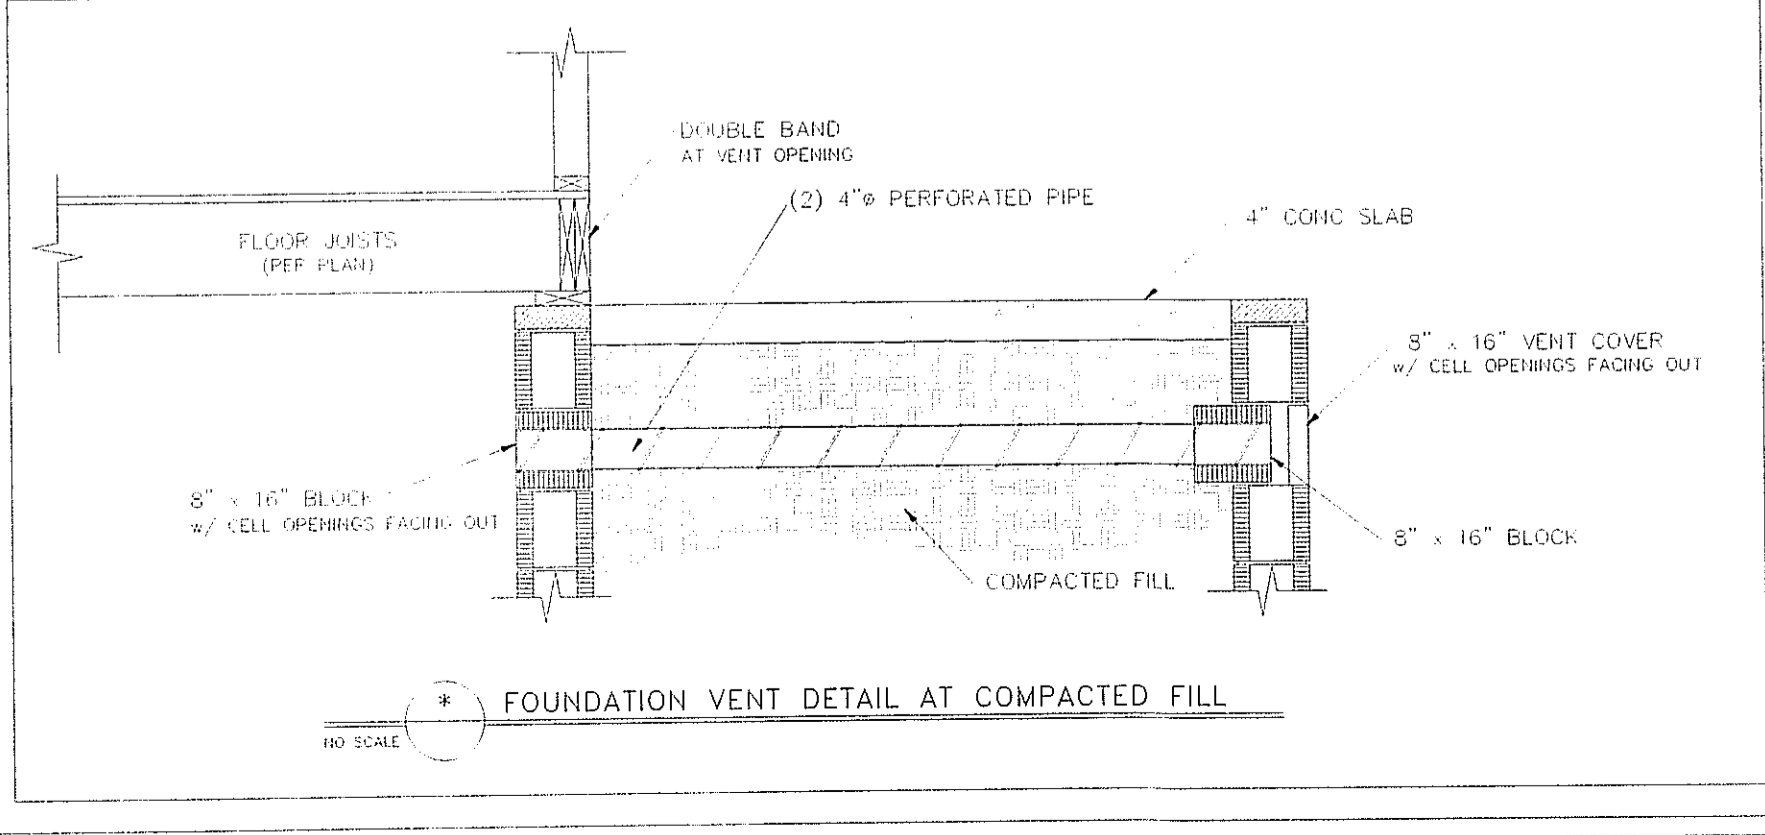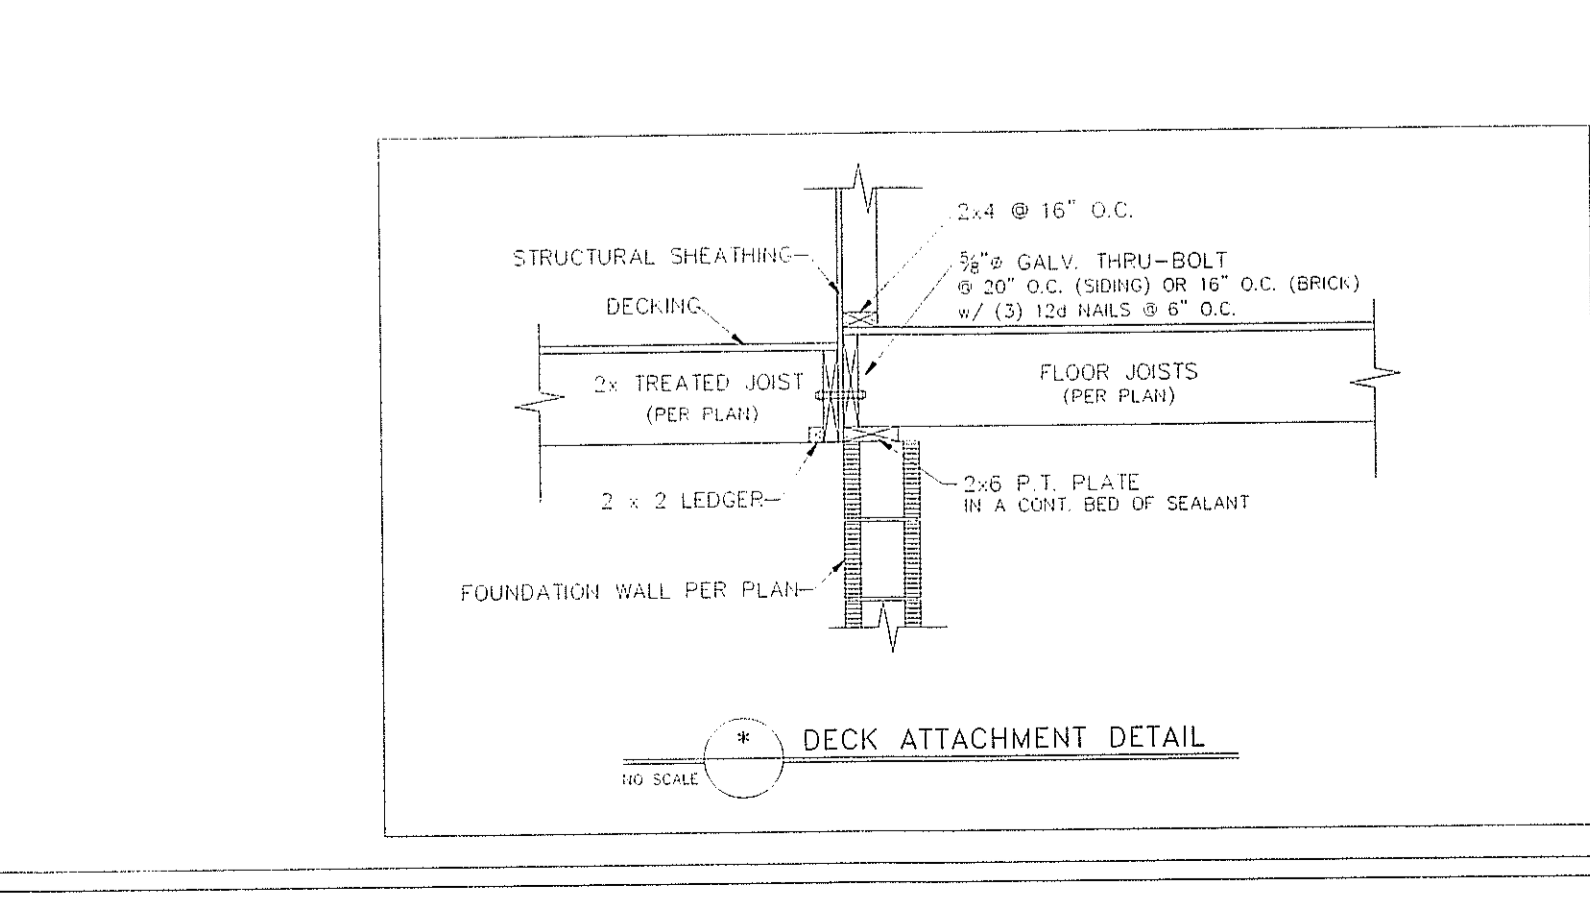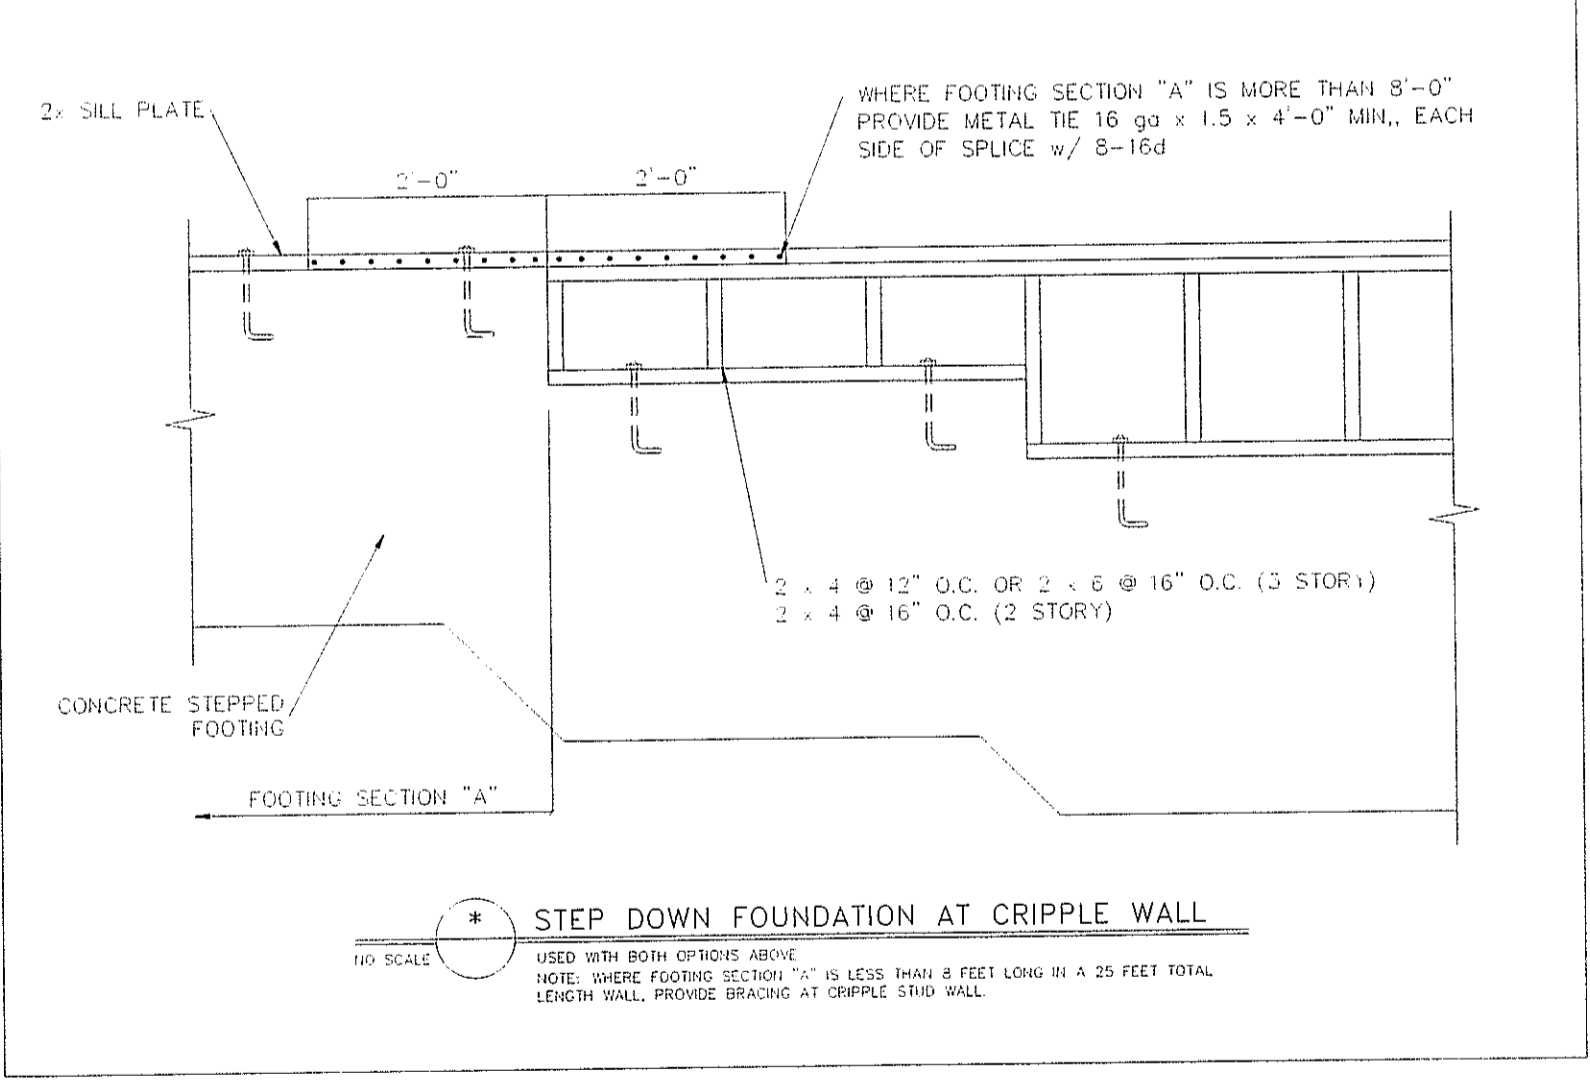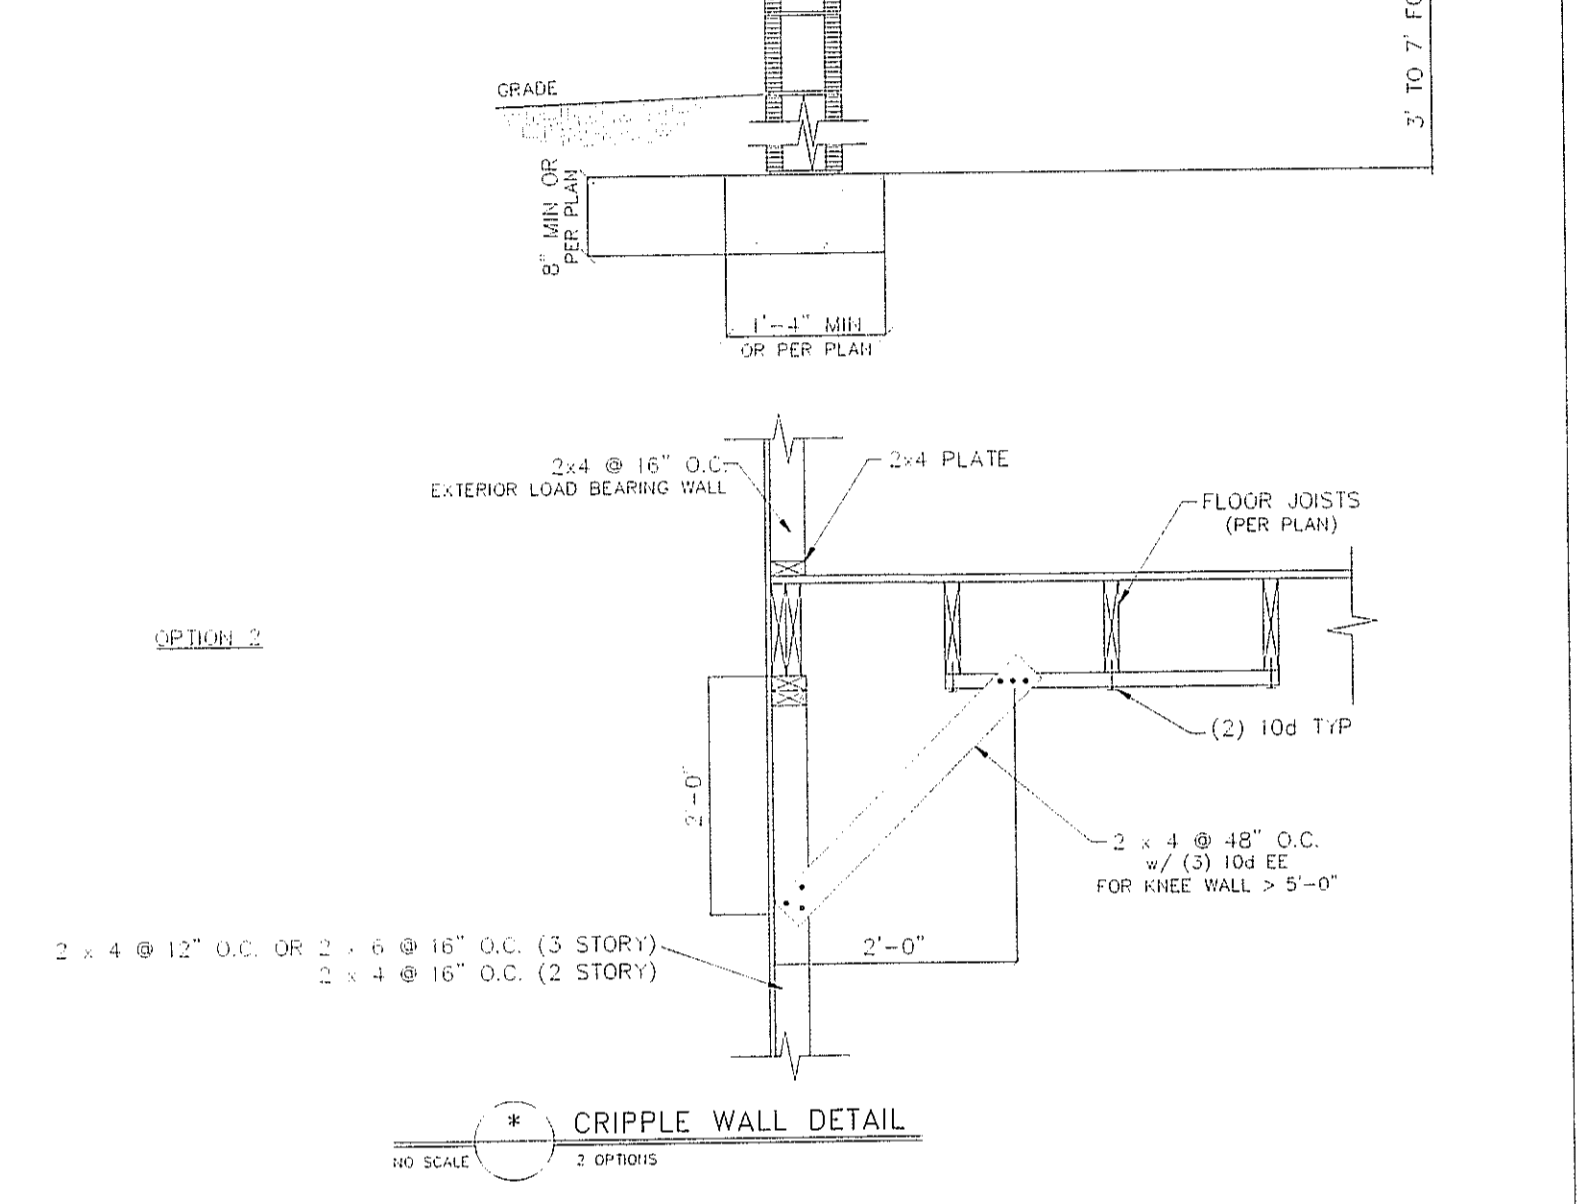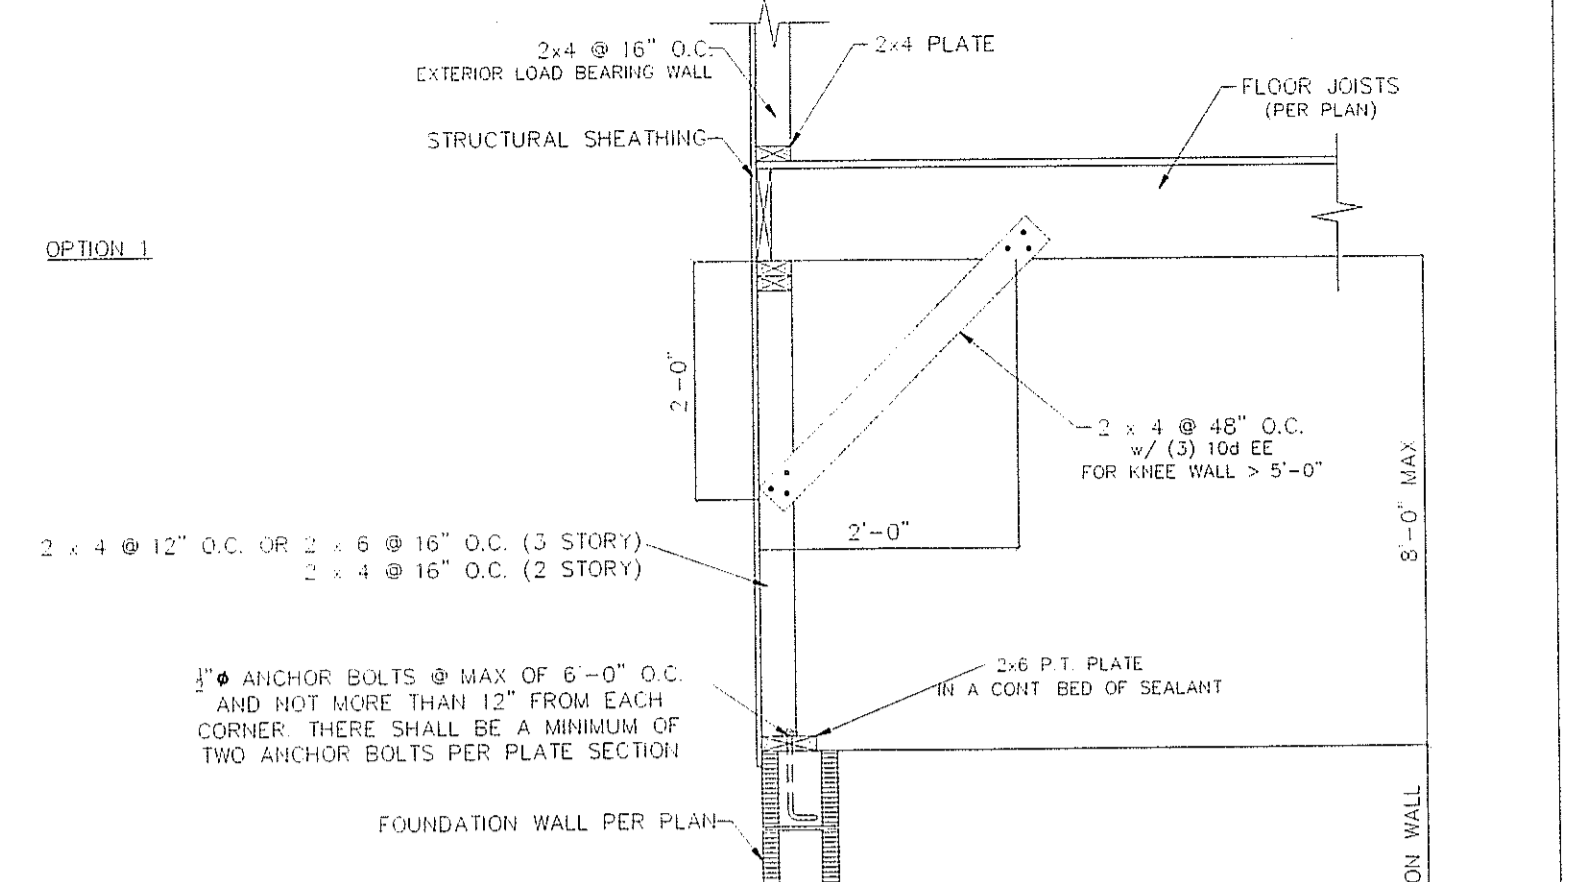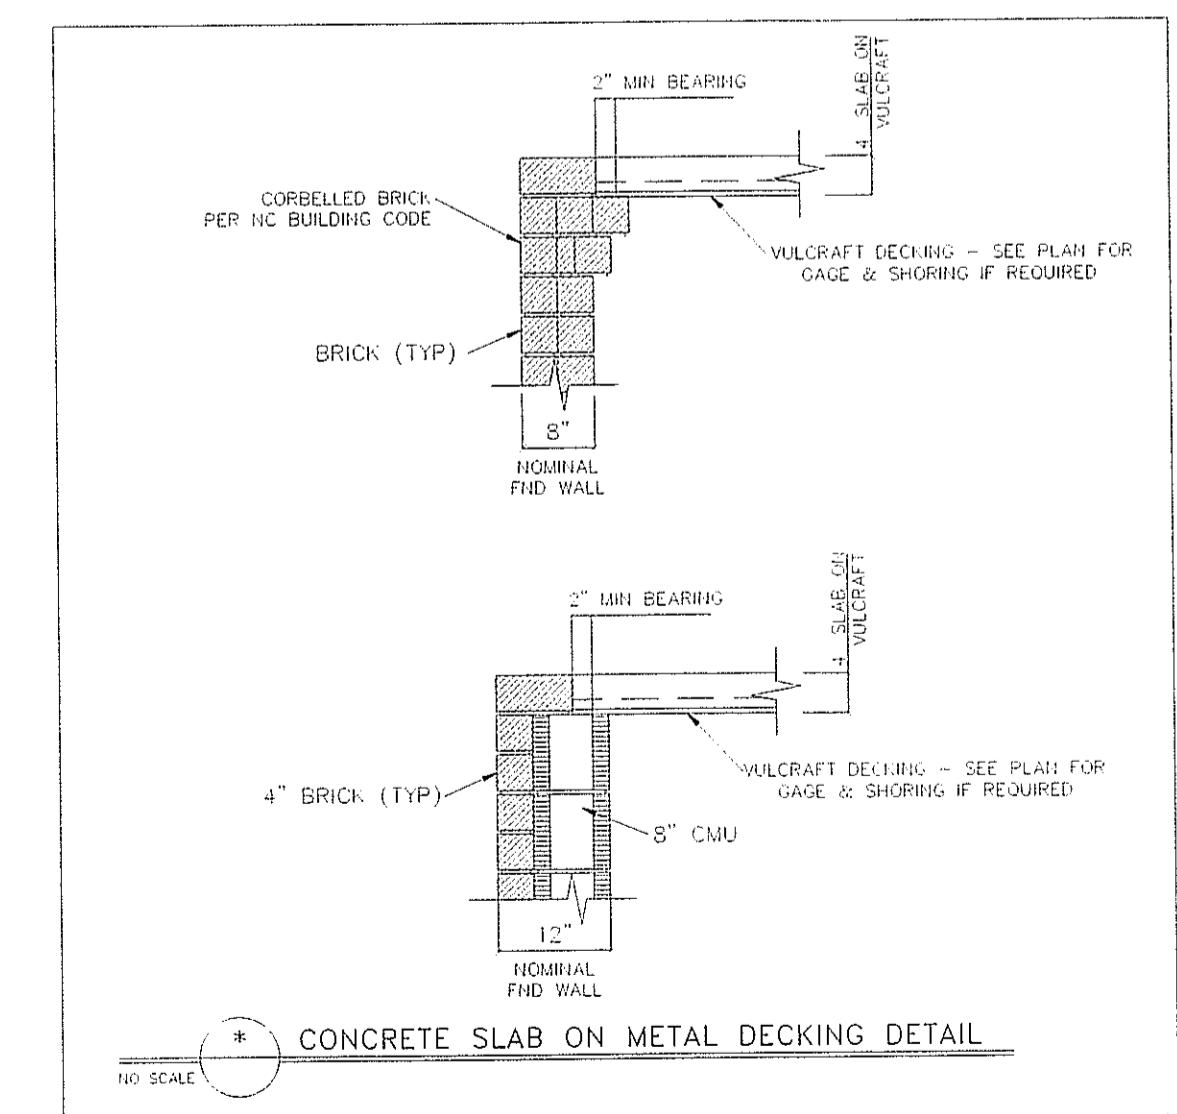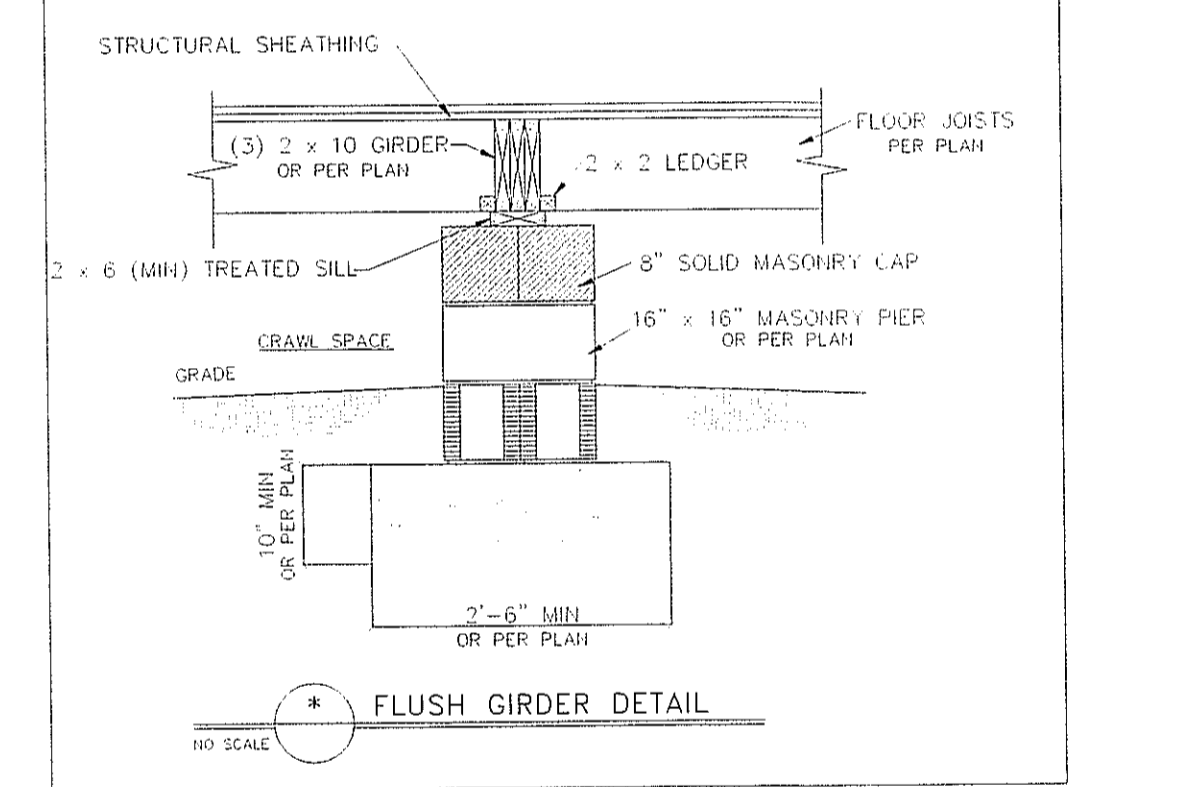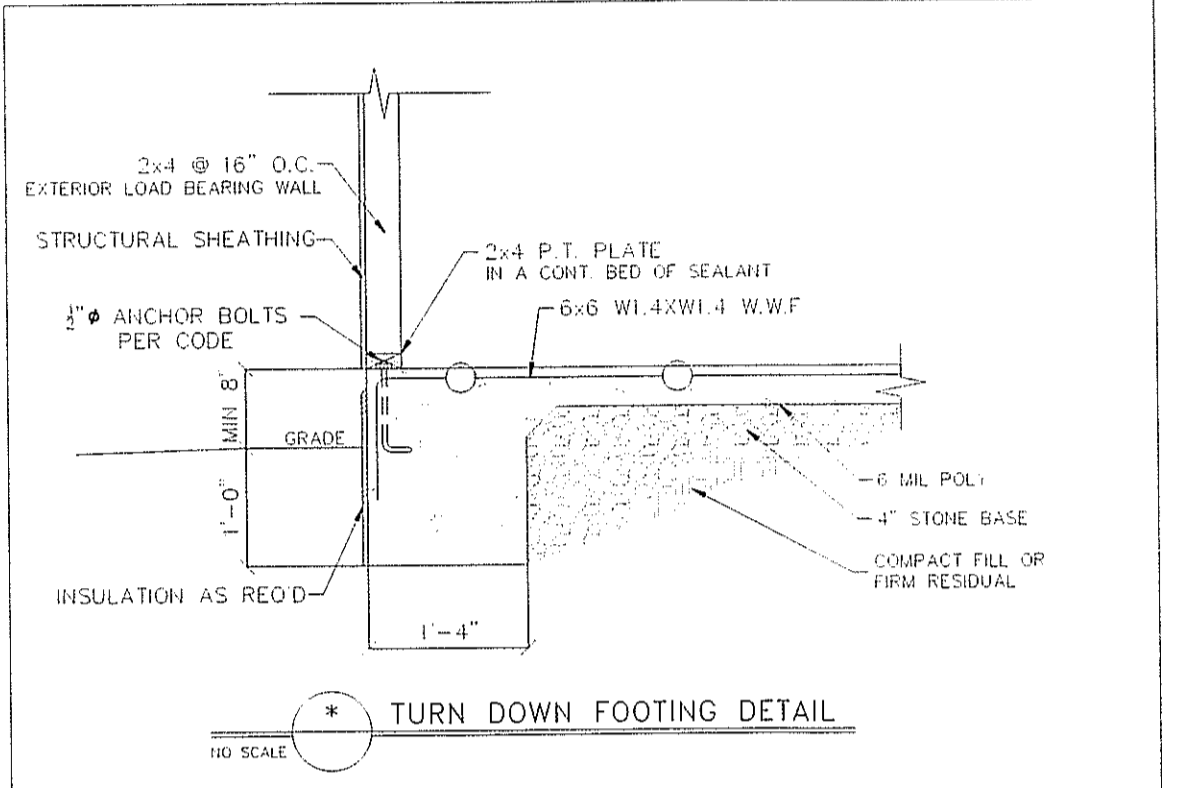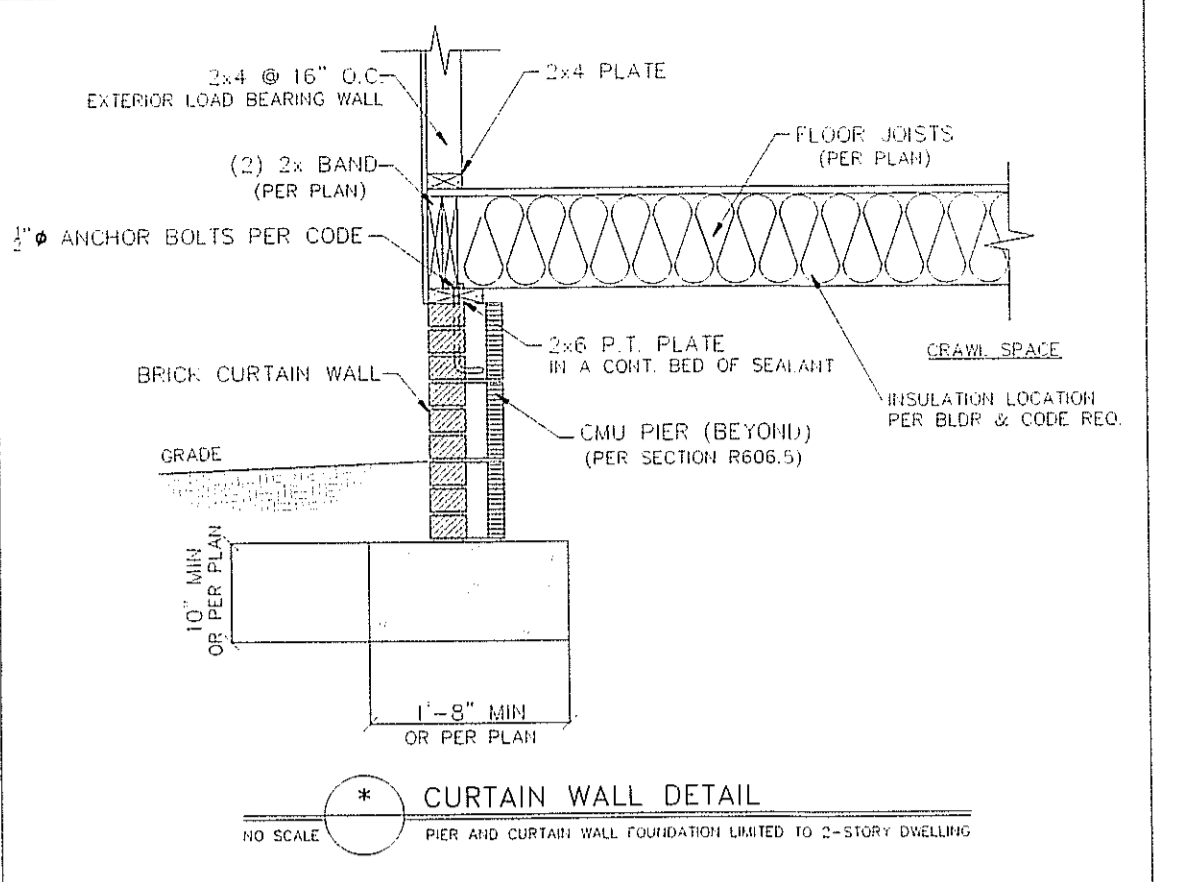

TYNDAL ENGINEERING & DESIGN, P.A.
280 Blenheim Drive • Charlotte, NC 28207
919.777.0200 • 919.777.0488
tyndaleng.com

ANN DENNING
DENNING RESIDENCE

STANDARD DETAILS





Project #: 1901-010273
Date: 7/29/19
Drawn/Design By: JWA
DWG. Checked By: PTII
Scale: NOT TO SCALE

REVISIONS

No.	Date	Remarks






Sheet Number **D1**

of 3

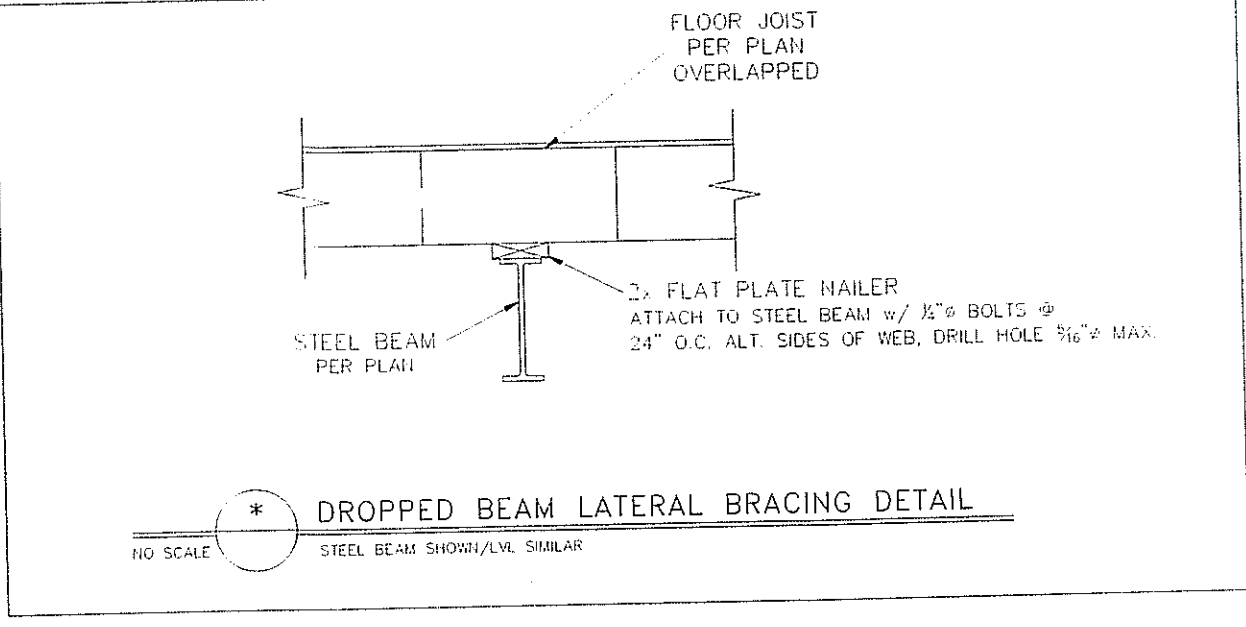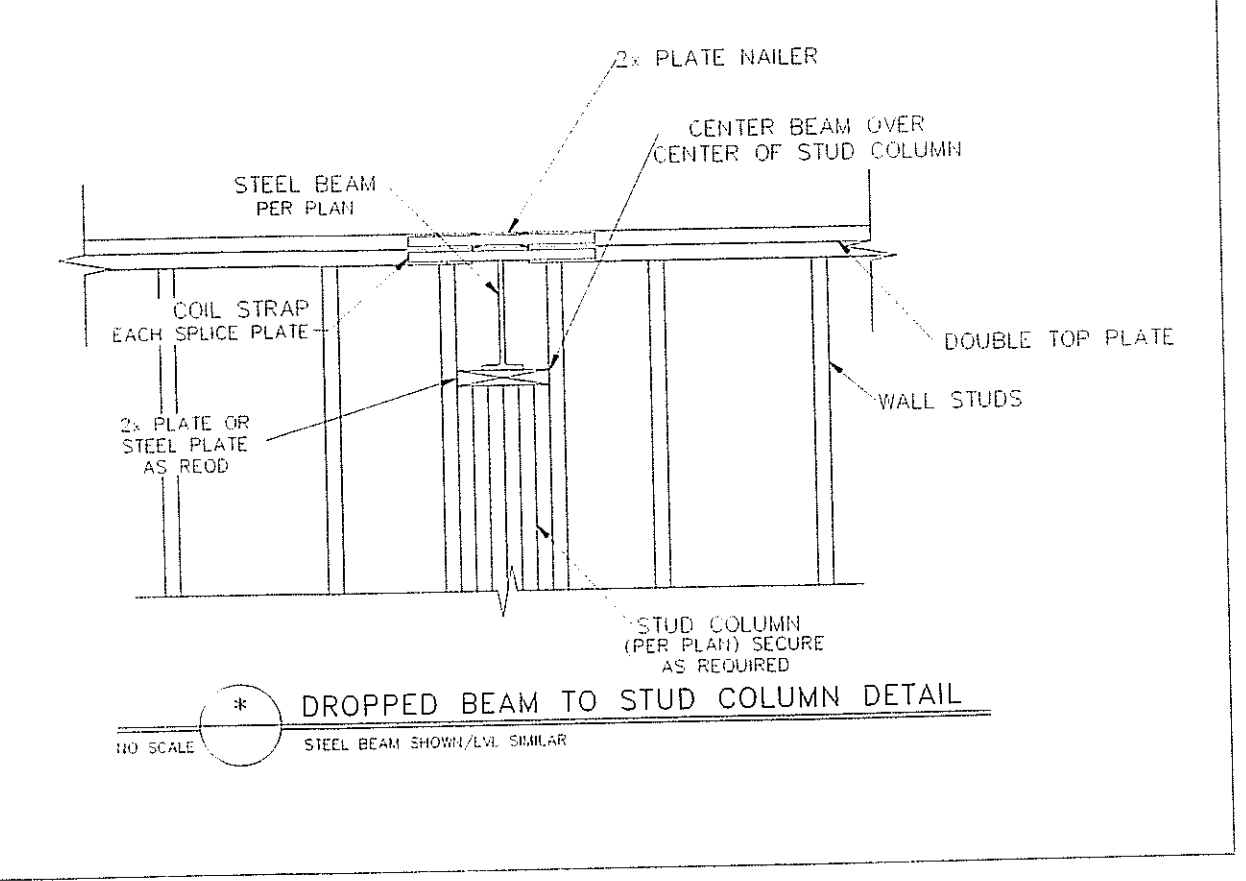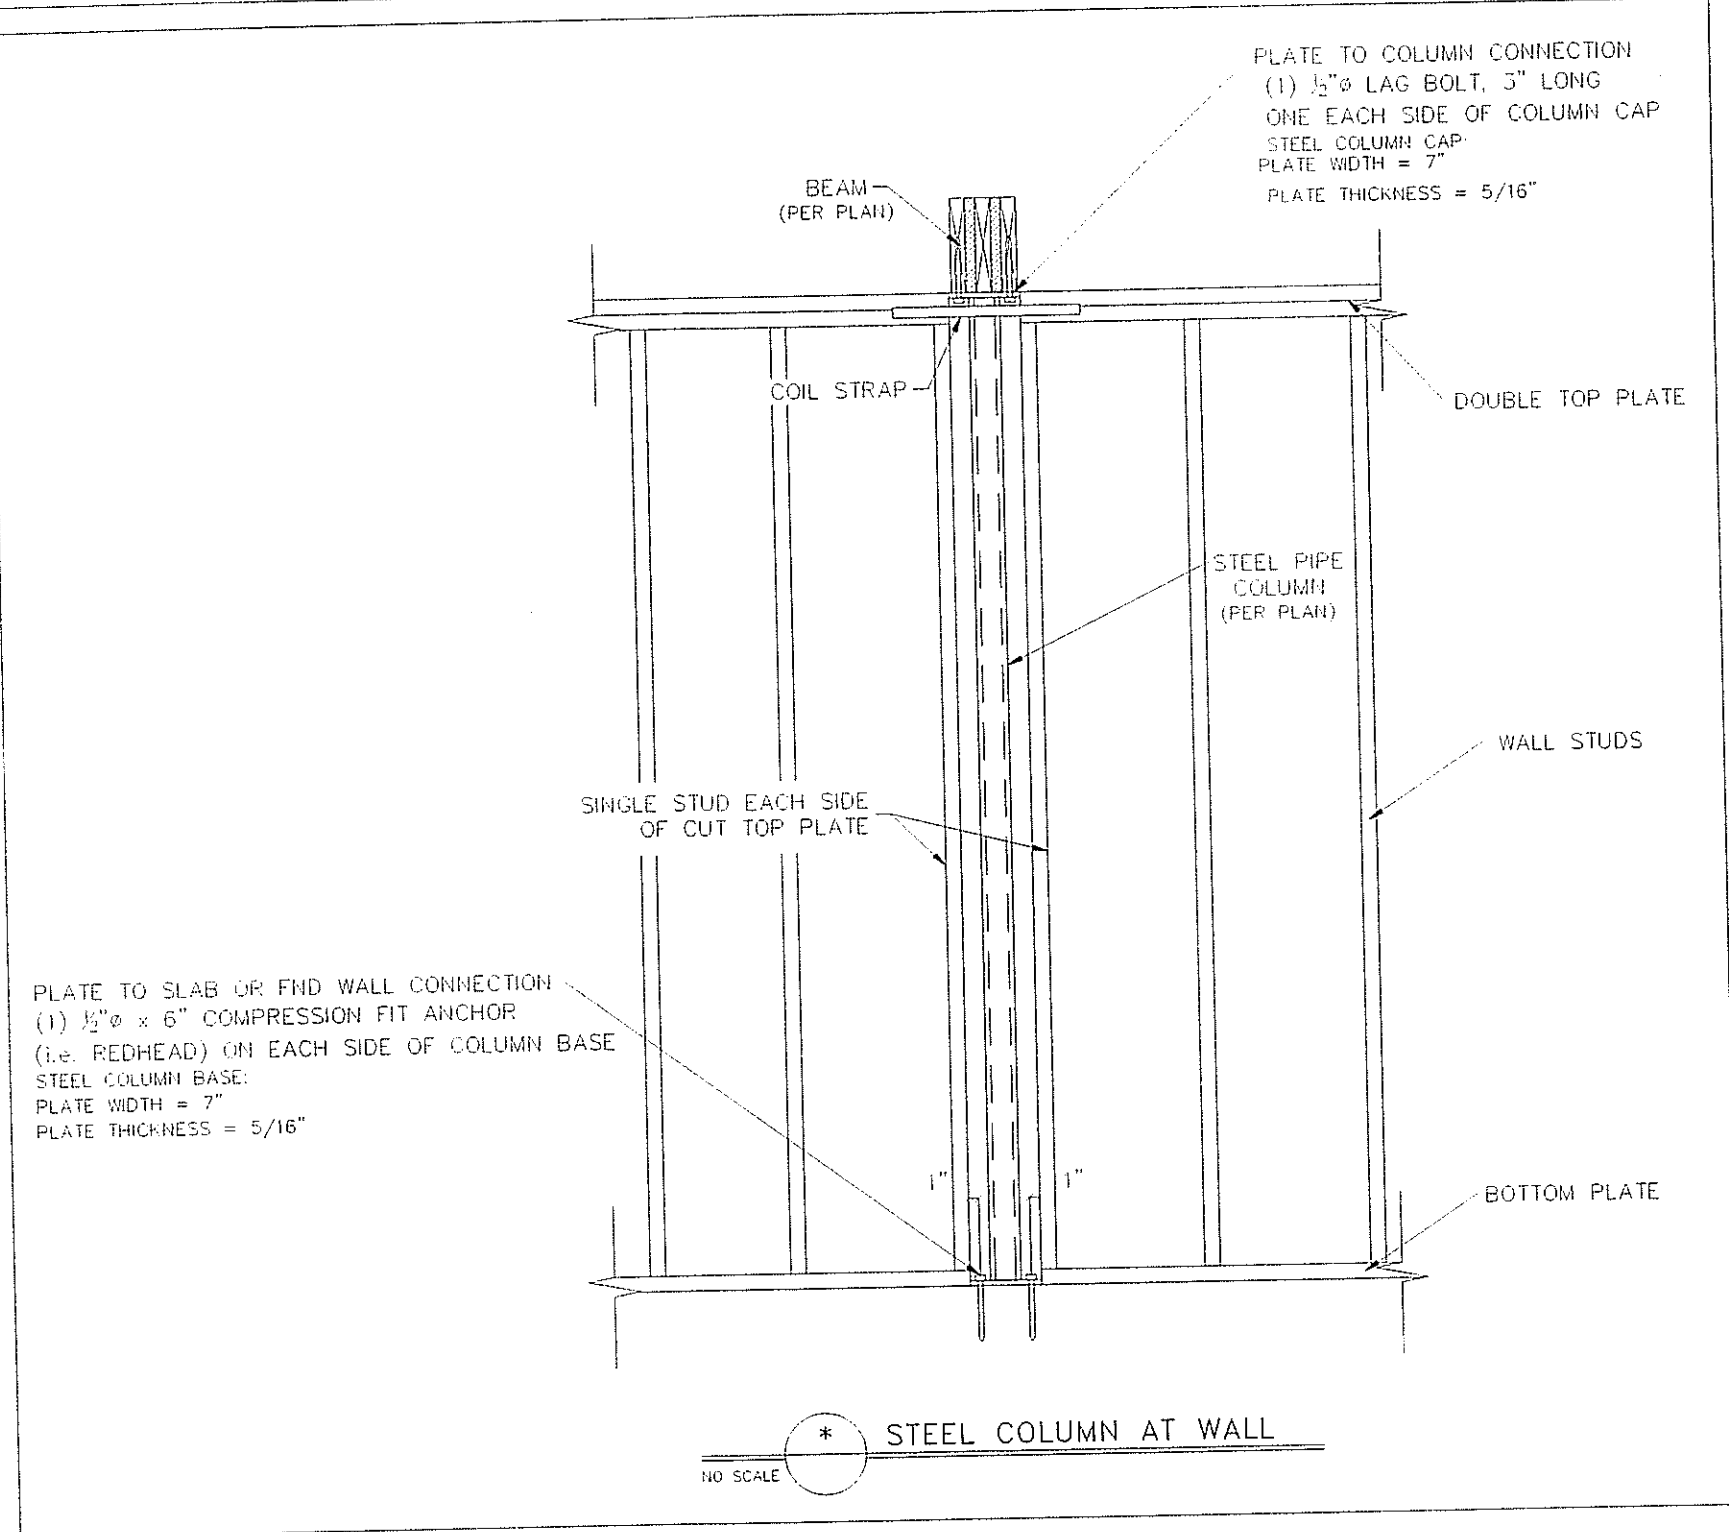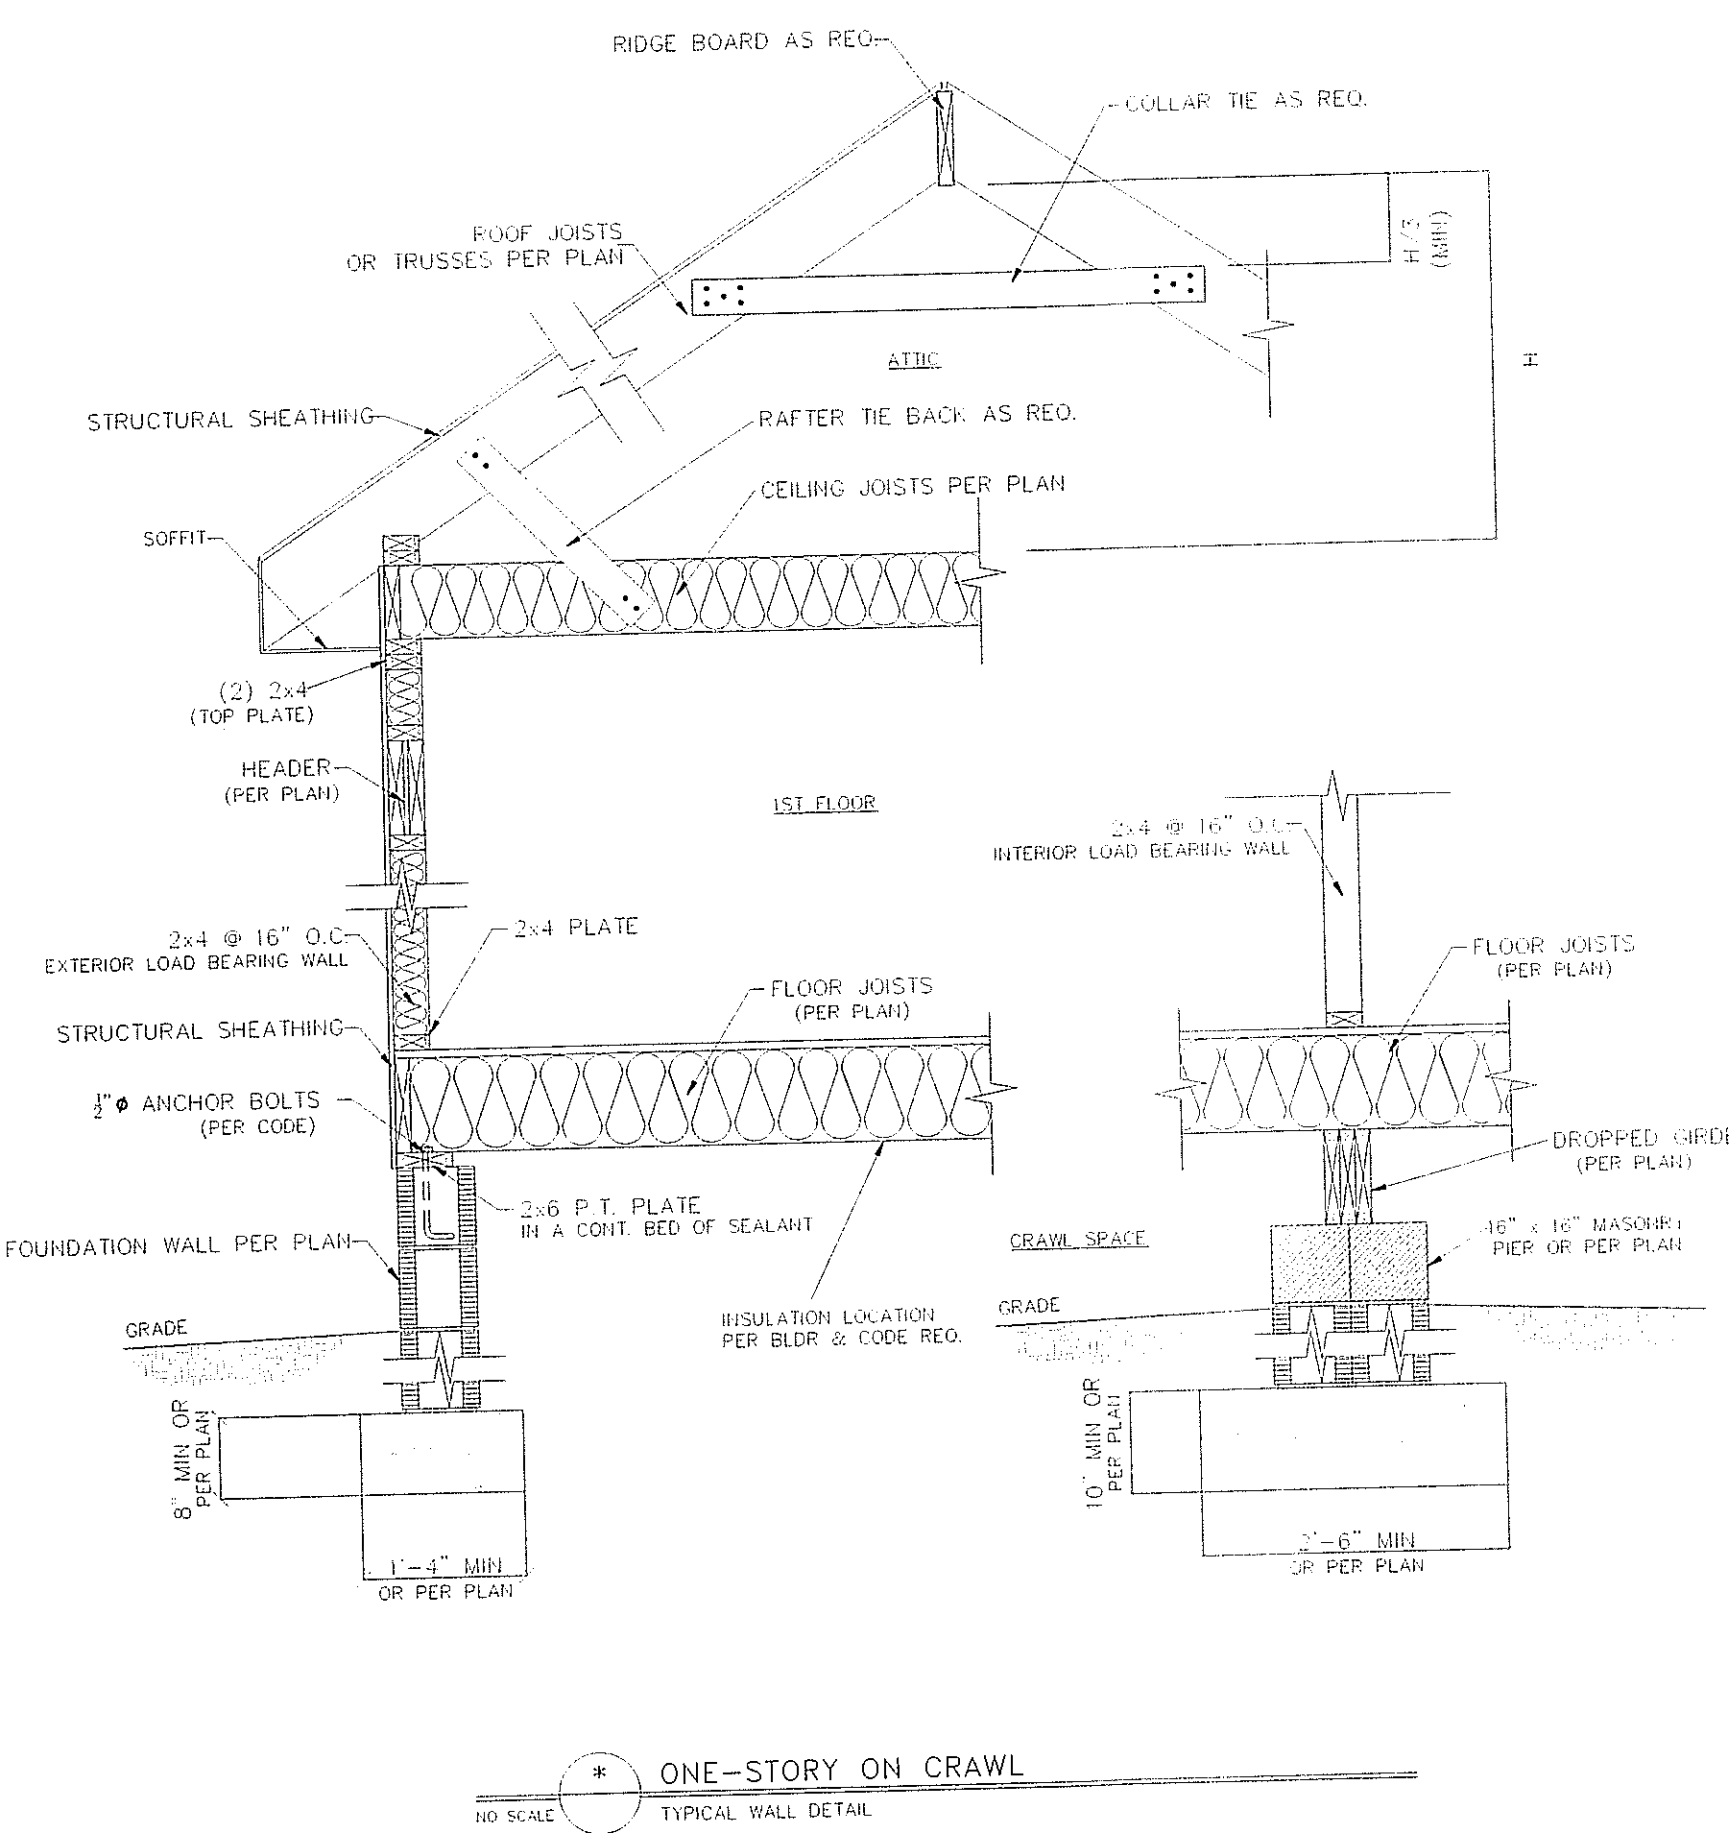

HARDWARE CROSS-REFERENCE CHART


SIMPSON STRONG-TIE PRODUCT NUMBER	USP STRUCTURAL CONNECTORS PRODUCT NUMBER
A35	MPA1
ABE	PAE
CBS0	CBS0
CCO	KCC0
CMSTC16	CMSTC16
CS	RS
H1	RT15
H2.5A	RT7A
W10	RT16
HD08-SDS3	UPH08
HDU2-SDS2.5	PHD3
HDU5-SDS2.5	PHD5
HETA	HTA
HGAM10KTA	HGAM
HH014-SDS2.5	UPHD14
HTS	HTW
HIT	HTI
HUS	HUS
LTA1	LPTA
LTHJA26	HJC26
LTP4	MP4F
LUS	JUS
MAS	FA3
MSTAM	MSTAM
PC	PCM
PHD-SDS3	PHD
SSP	RSP16
STC	TRI
STHD	STAD

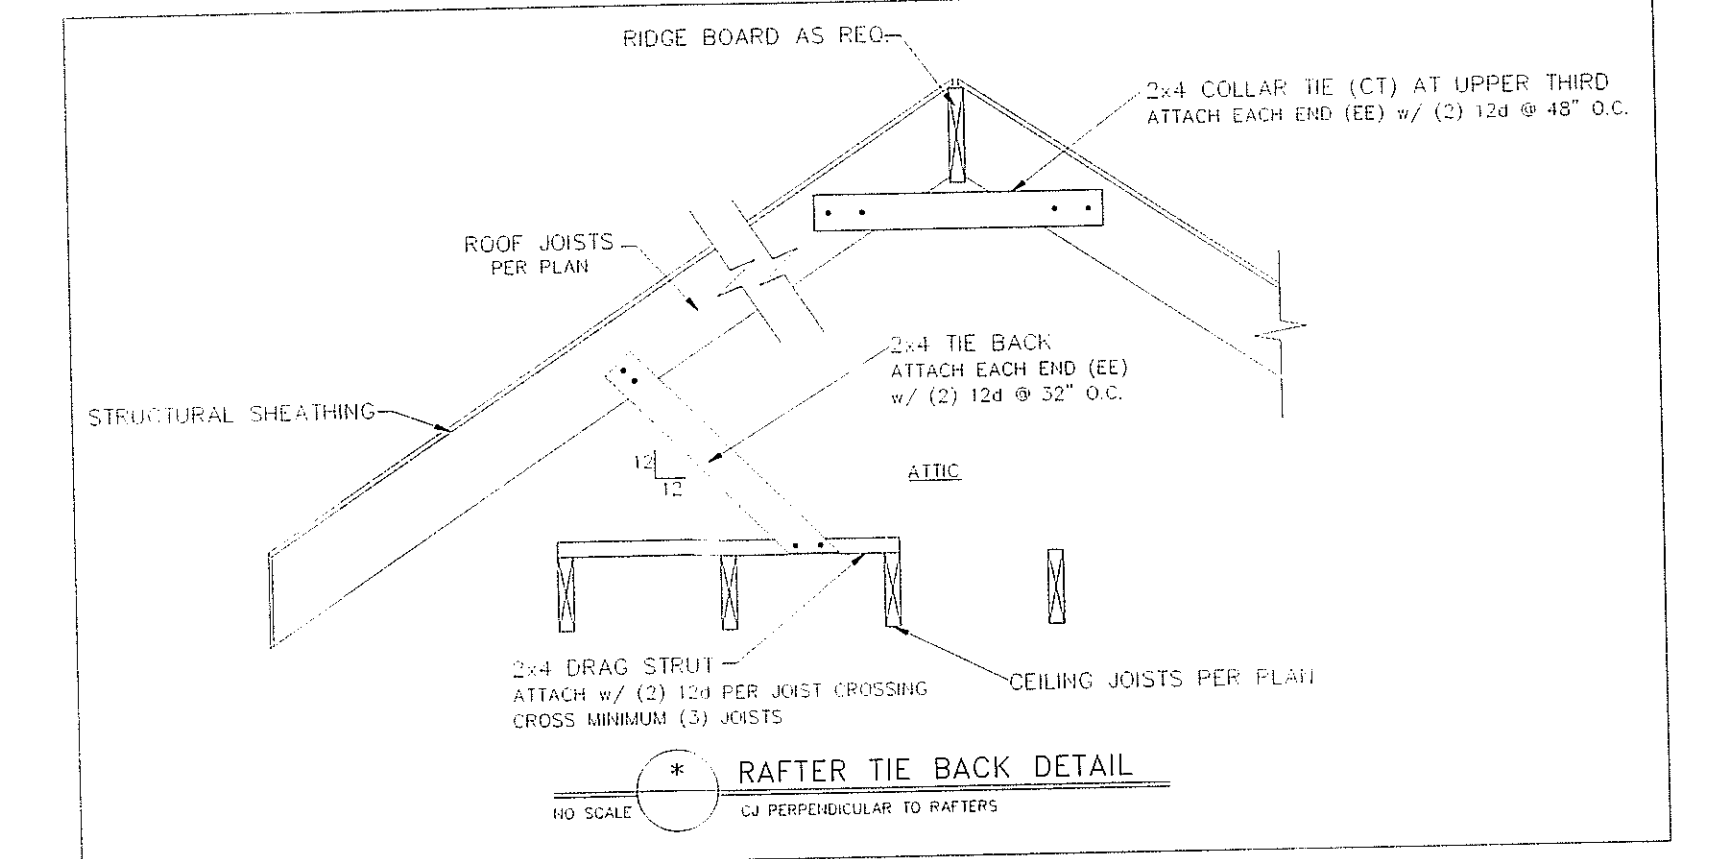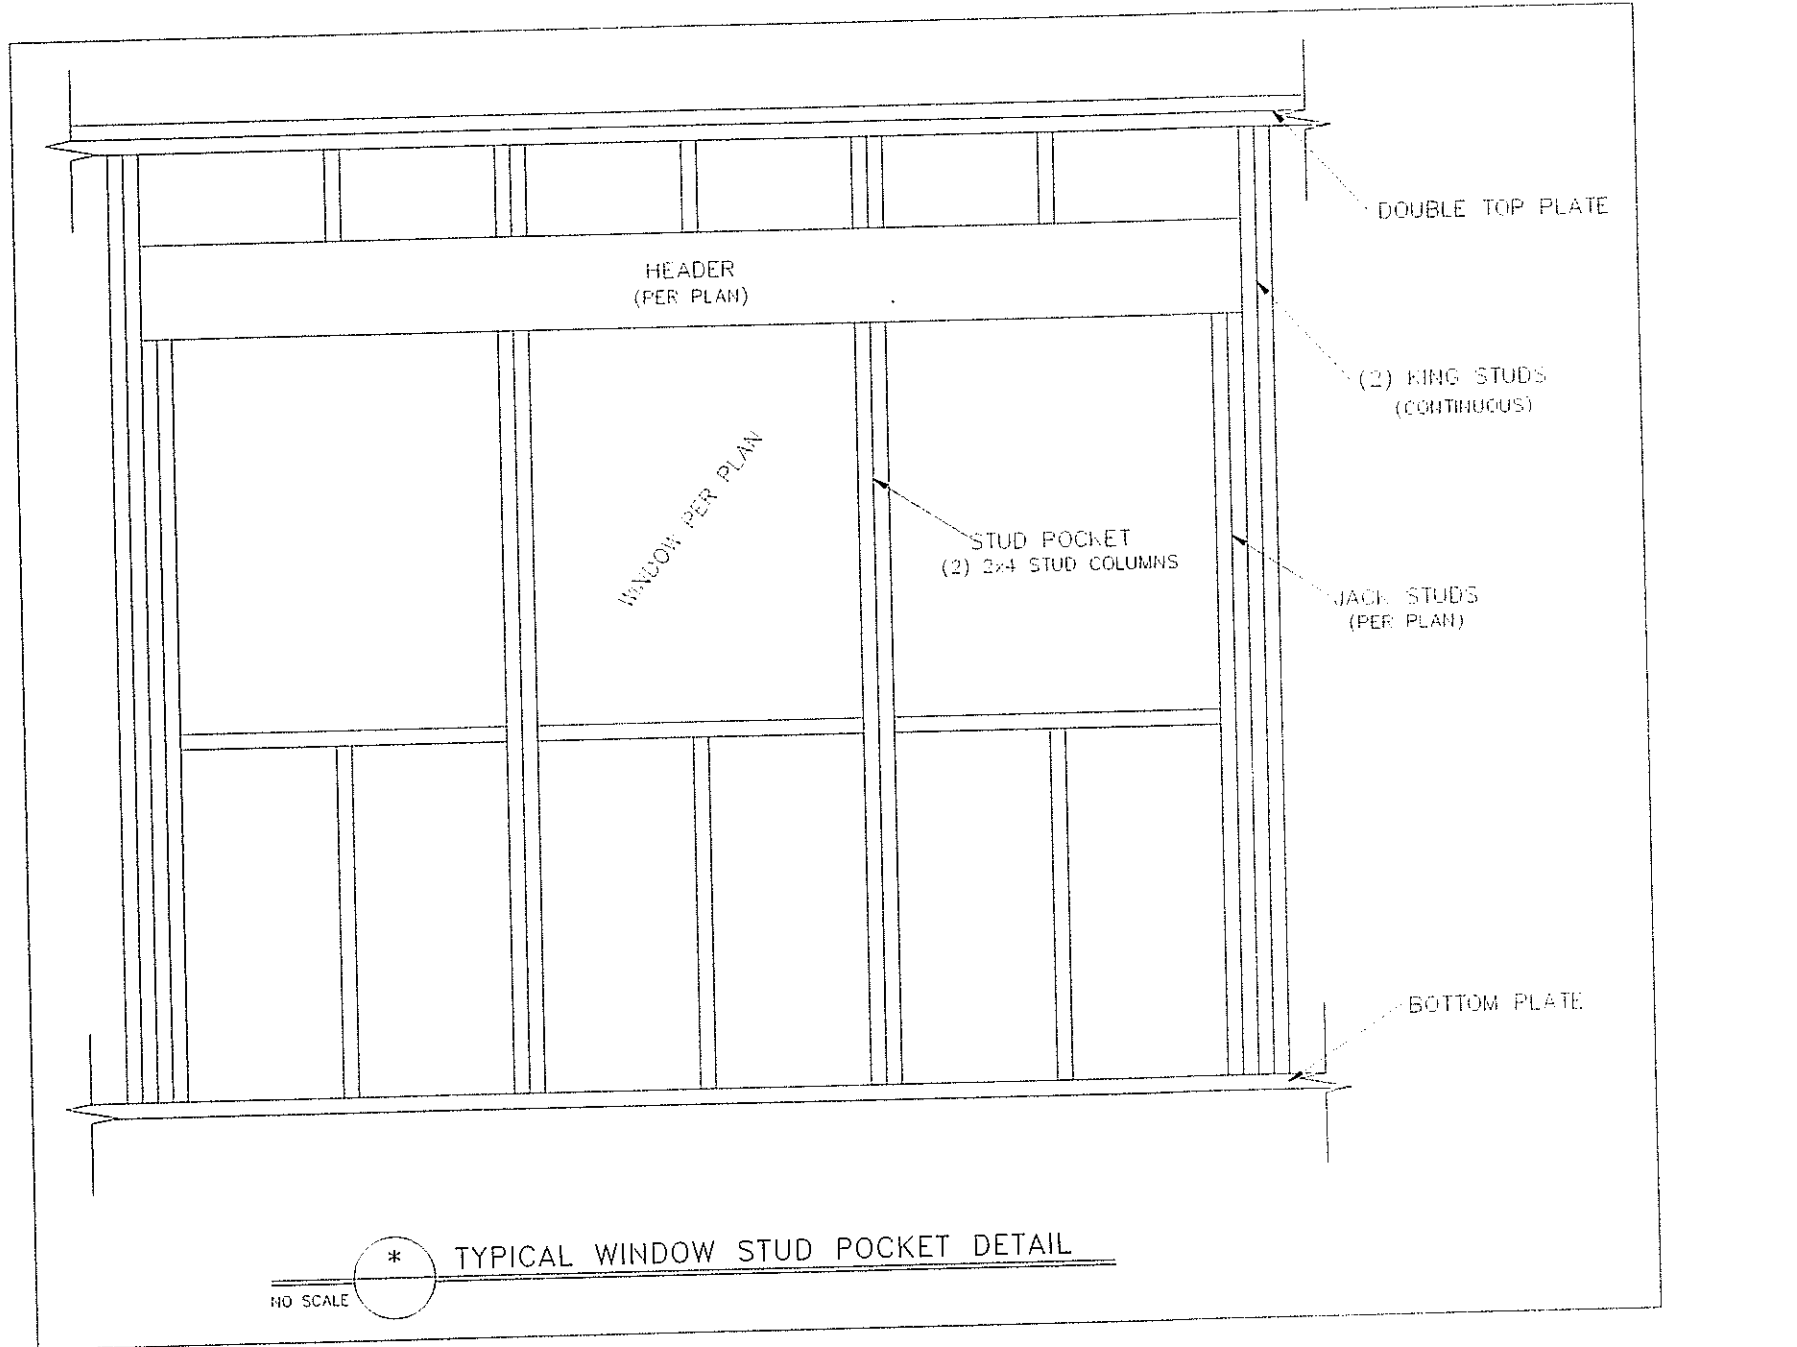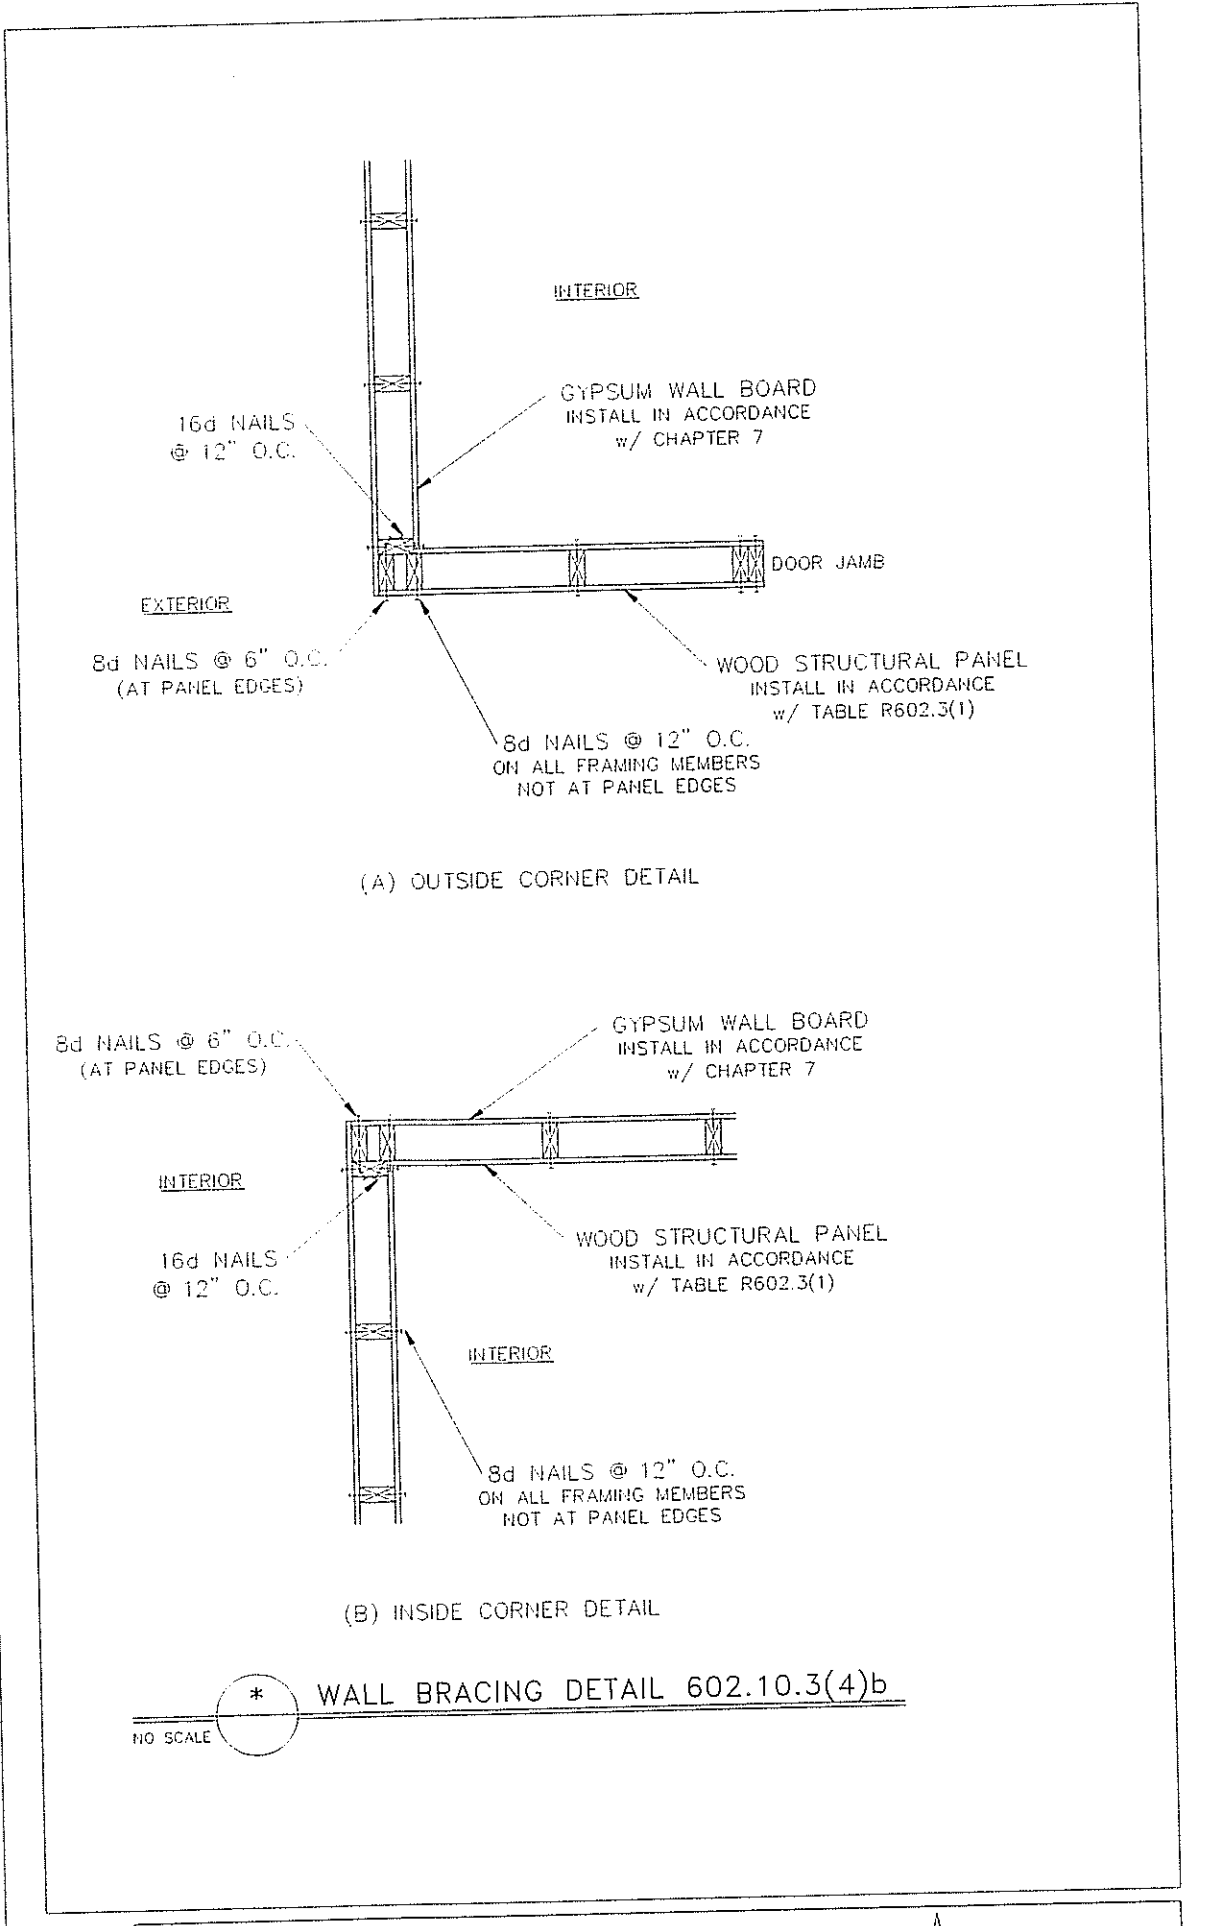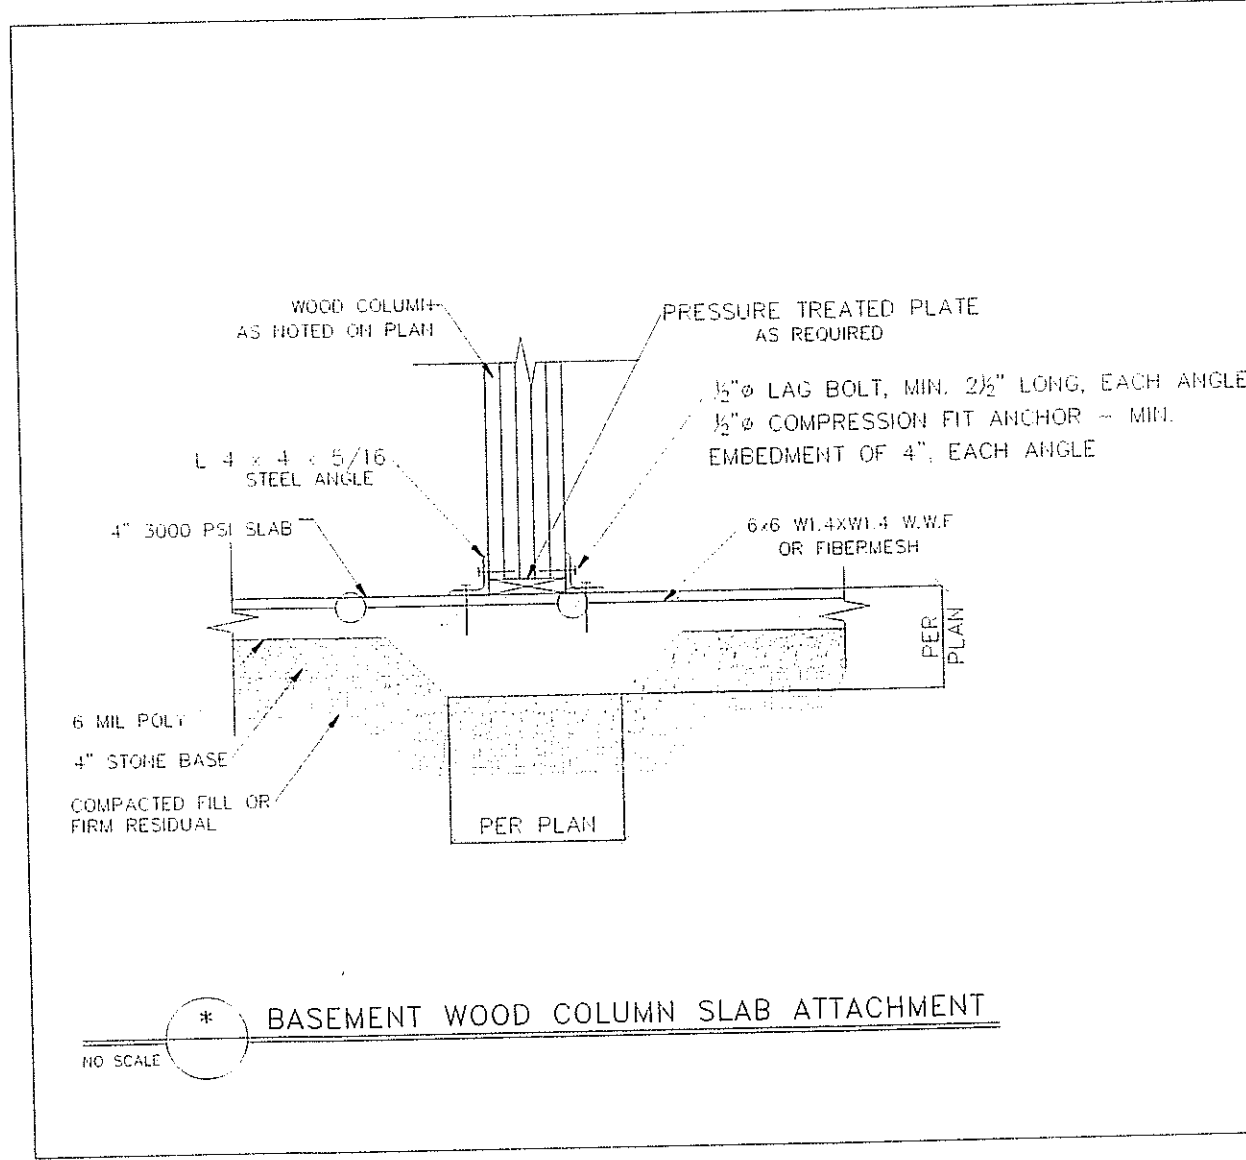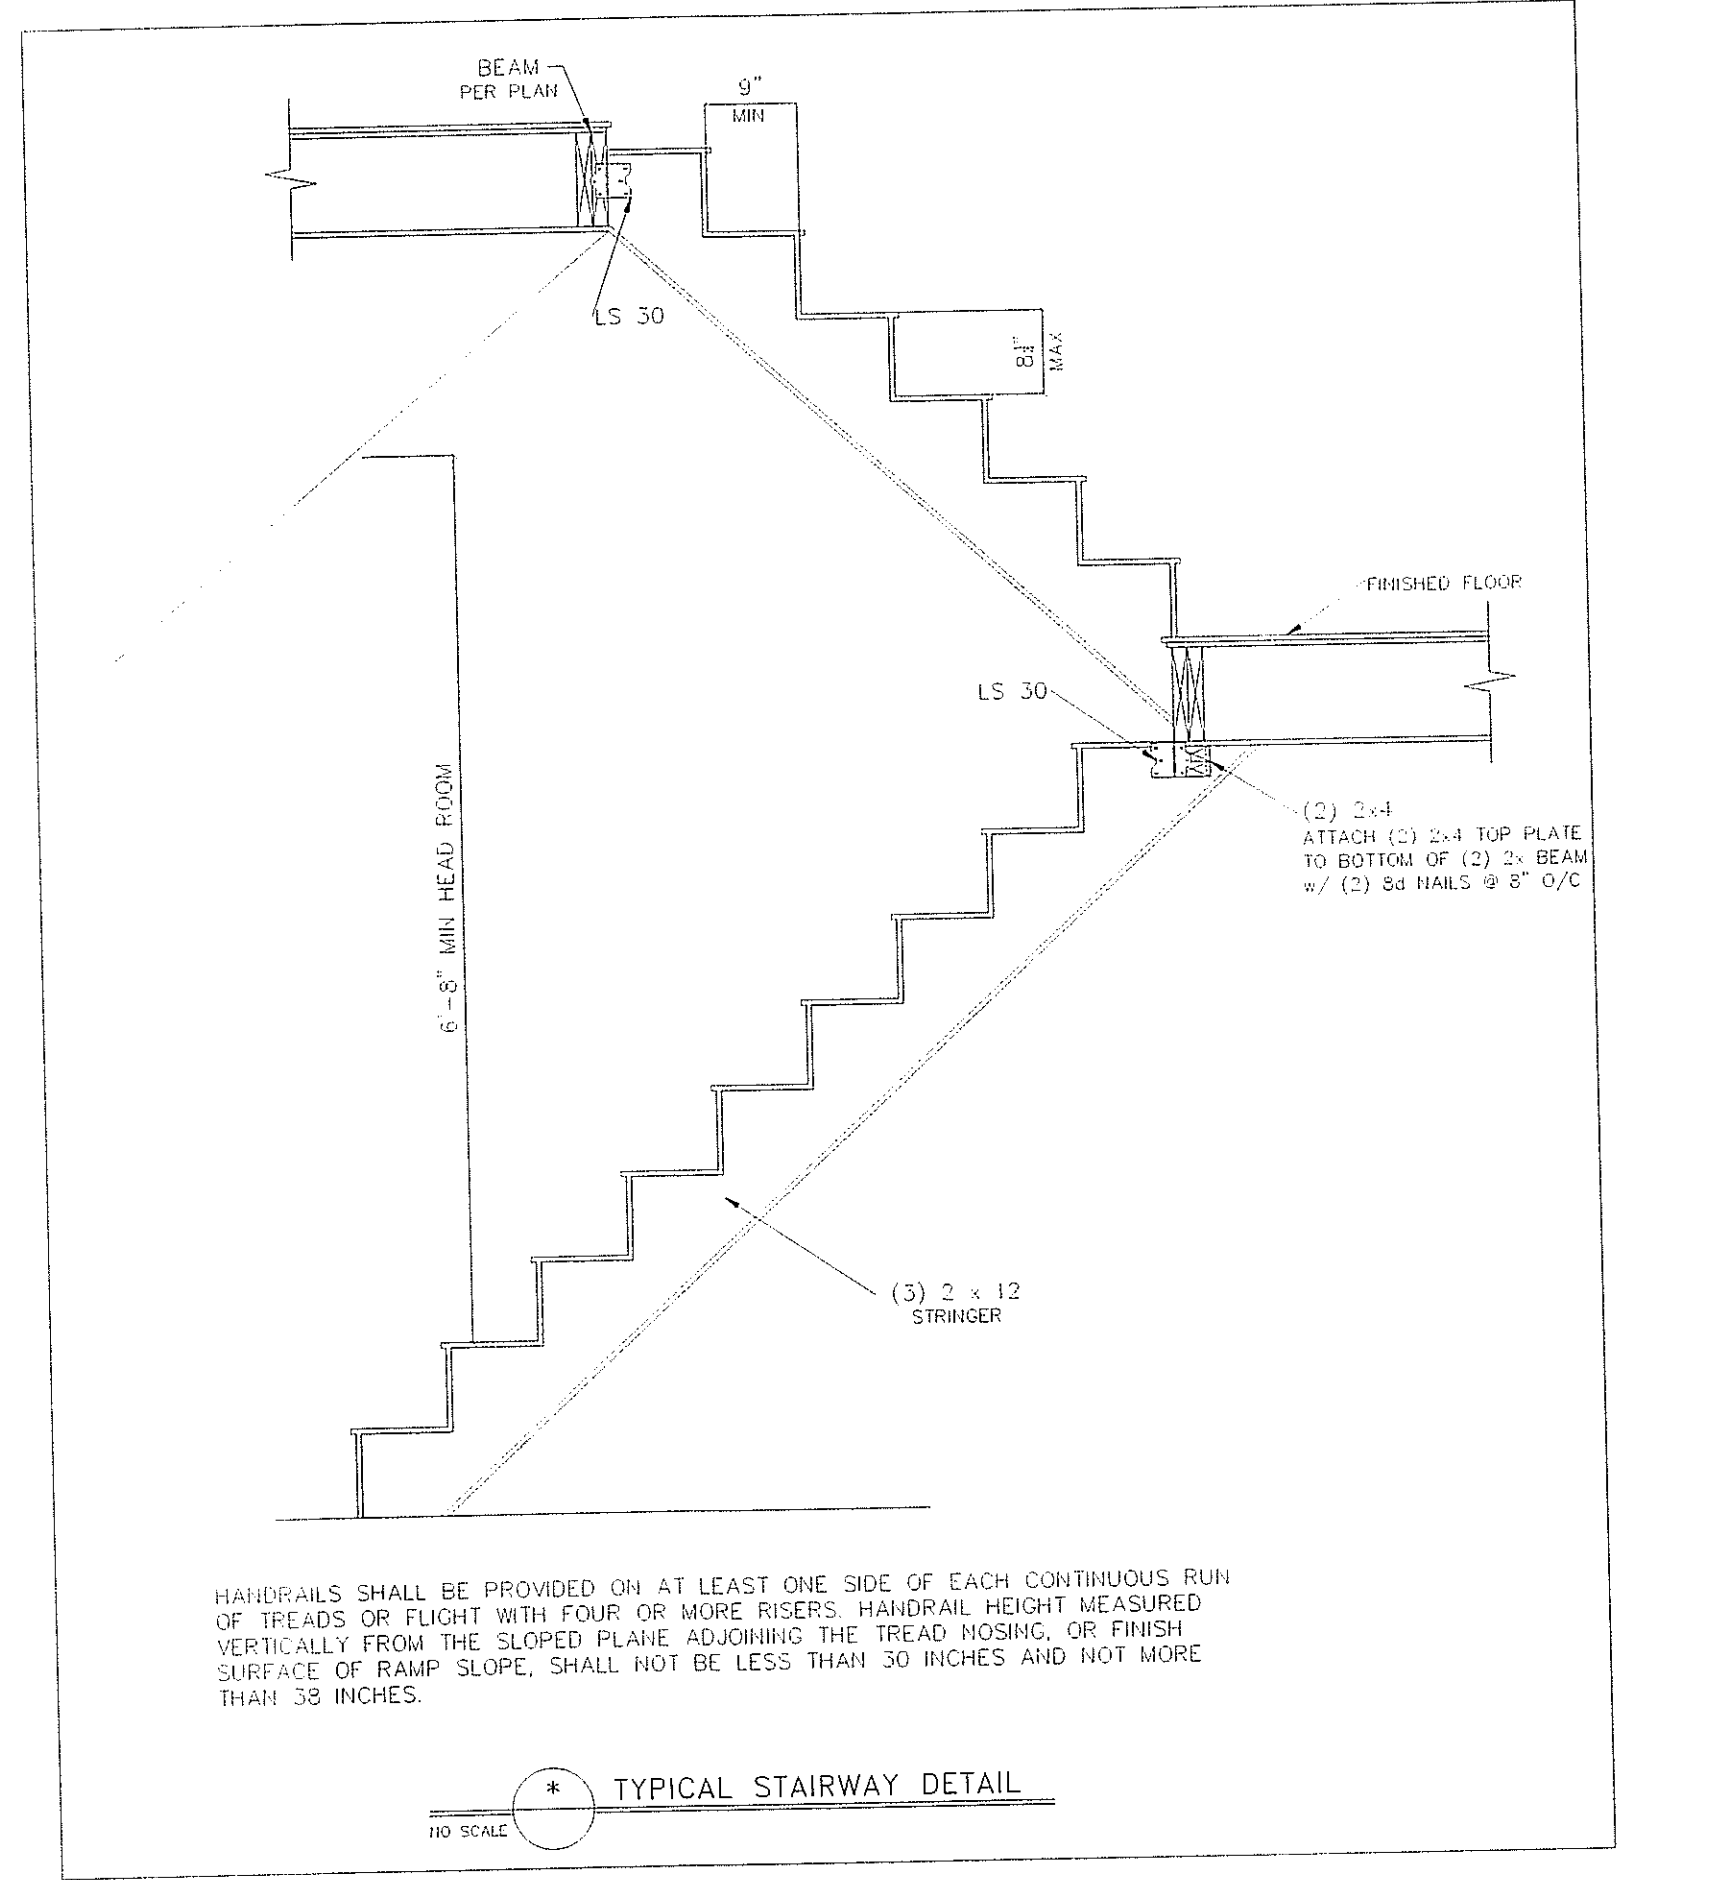

ALLOWABLE SPANS FOR LITELS SUPPORTING MASONRY VENEER

SIZE OF ANGLE (1,3)	NO STORY ABOVE (5)	1 STORY ABOVE (5)	2 STORIES ABOVE (5)	# OF 3/8\"/>
L 3 x 3 x 1/2	6'-0"	4'-6"	3'-0"	1
L 4 x 3 x 1/2	8'-0"	6'-0"	4'-6"	1
L 5 x 3 1/2 x 3/8	10'-0"	8'-0"	6'-0"	2
L 6 x 3 1/2 x 3/8	14'-0"	9'-6"	7'-0"	2
2L 5 x 3 1/2 x 3/8	20'-0"	12'-0"	9'-6"	4

- LONG LEG OF THE ANGLE SHALL BE PLACED IN A VERTICAL POSITION.
- DEPTH OF REINFORCED LITELS SHALL NOT BE LESS THAN 8" AND ALL CELLS OF HOLLOW MASONRY LITELS SHALL BE GRouted. REINFORCING BARS SHALL EXTEND NOT LESS THAN 6" INTO THE SUPPORT.
- STEEL MEMBERS INDICATED ARE ADEQUATE TYPICAL EXAMPLES; OTHER STEEL MEMBERS MEETING STRUCTURAL DESIGN REQUIREMENTS SHALL BE PERMITTED TO BE USED.
- OTHER STEEL ANGLE OR REINFORCED LITEL SHALL SPAN OPENING.
- SPANS OVER 4'-0" SHALL BE SHORED UP UNTIL CURED.

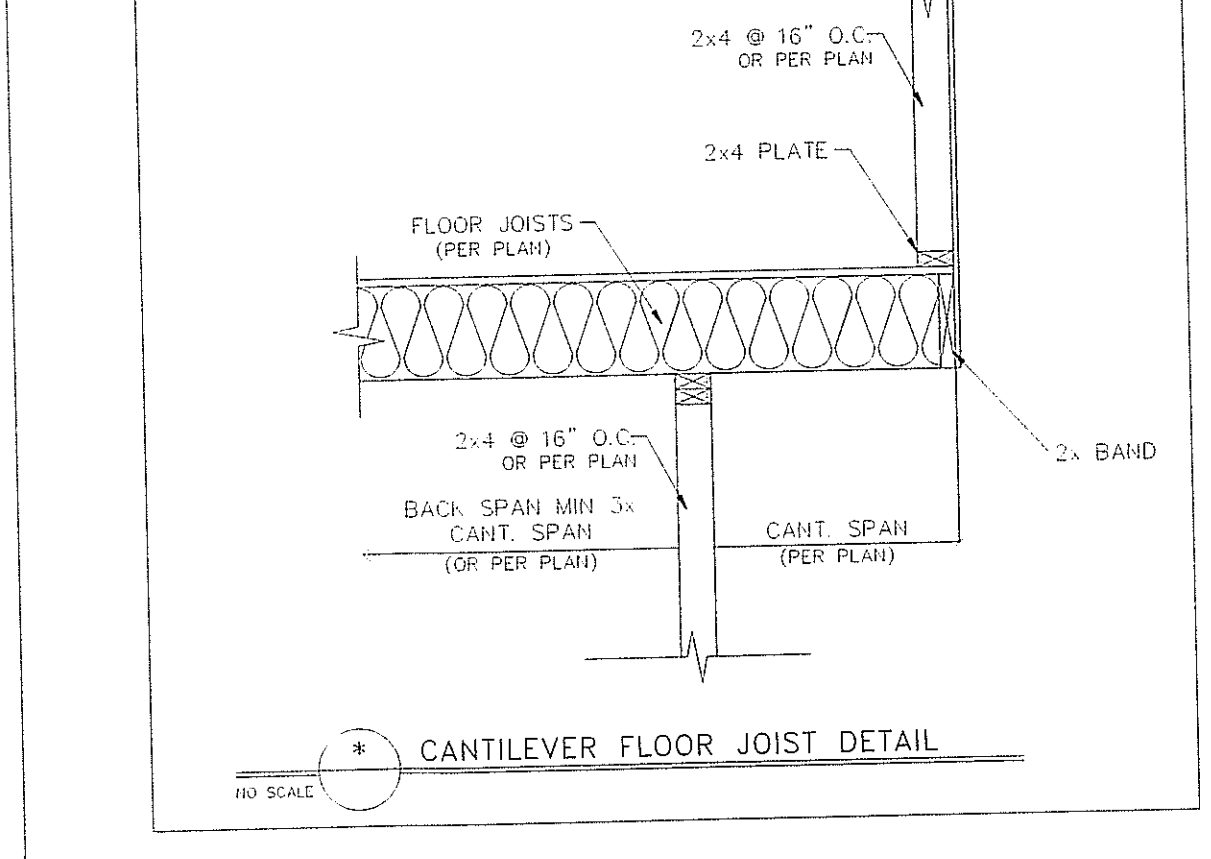

Engineer seal does not include construction means, methods, techniques, practices, procedures or safety precautions. Any deviation or distribution in plans are to be brought to the immediate attention of Tyndall Engineering & Design, P.A. Failure to do so will void Tyndall Engineering & Design, P.A. liability. Please review these documents carefully. Tyndall Engineering & Design, P.A. will interpret that all dimensions, recommendations, etc. presented in these documents were derived acceptable case construction begins.

TYNDALL ENGINEERING & DESIGN, P.A.
 45675
 2500 Highway Drive - Cummer, NC 28529
 www.tyndallengineering.com

ANN DENNING
 DENNING RESIDENCE

STANDARD DETAILS


Project #: 1901-010273
 Date: 7/29/19
 Drawn/Design By: JWA
 DWG. Checked By: PTH
 Scale: NOT TO SCALE

REVISIONS

No.	Date	Remarks

Sheet Number: **D2**
 of 3

FILENAME: Z:\RESOURCES\ENGINEERING\DWG STRUCTURAL PRODUCTS\1901-010273 - ANN DENNING - DENNING RESIDENCE\1901-010273.DWG SHEET 01 OF 03 DATE: 7/29/2019 11:20 AM

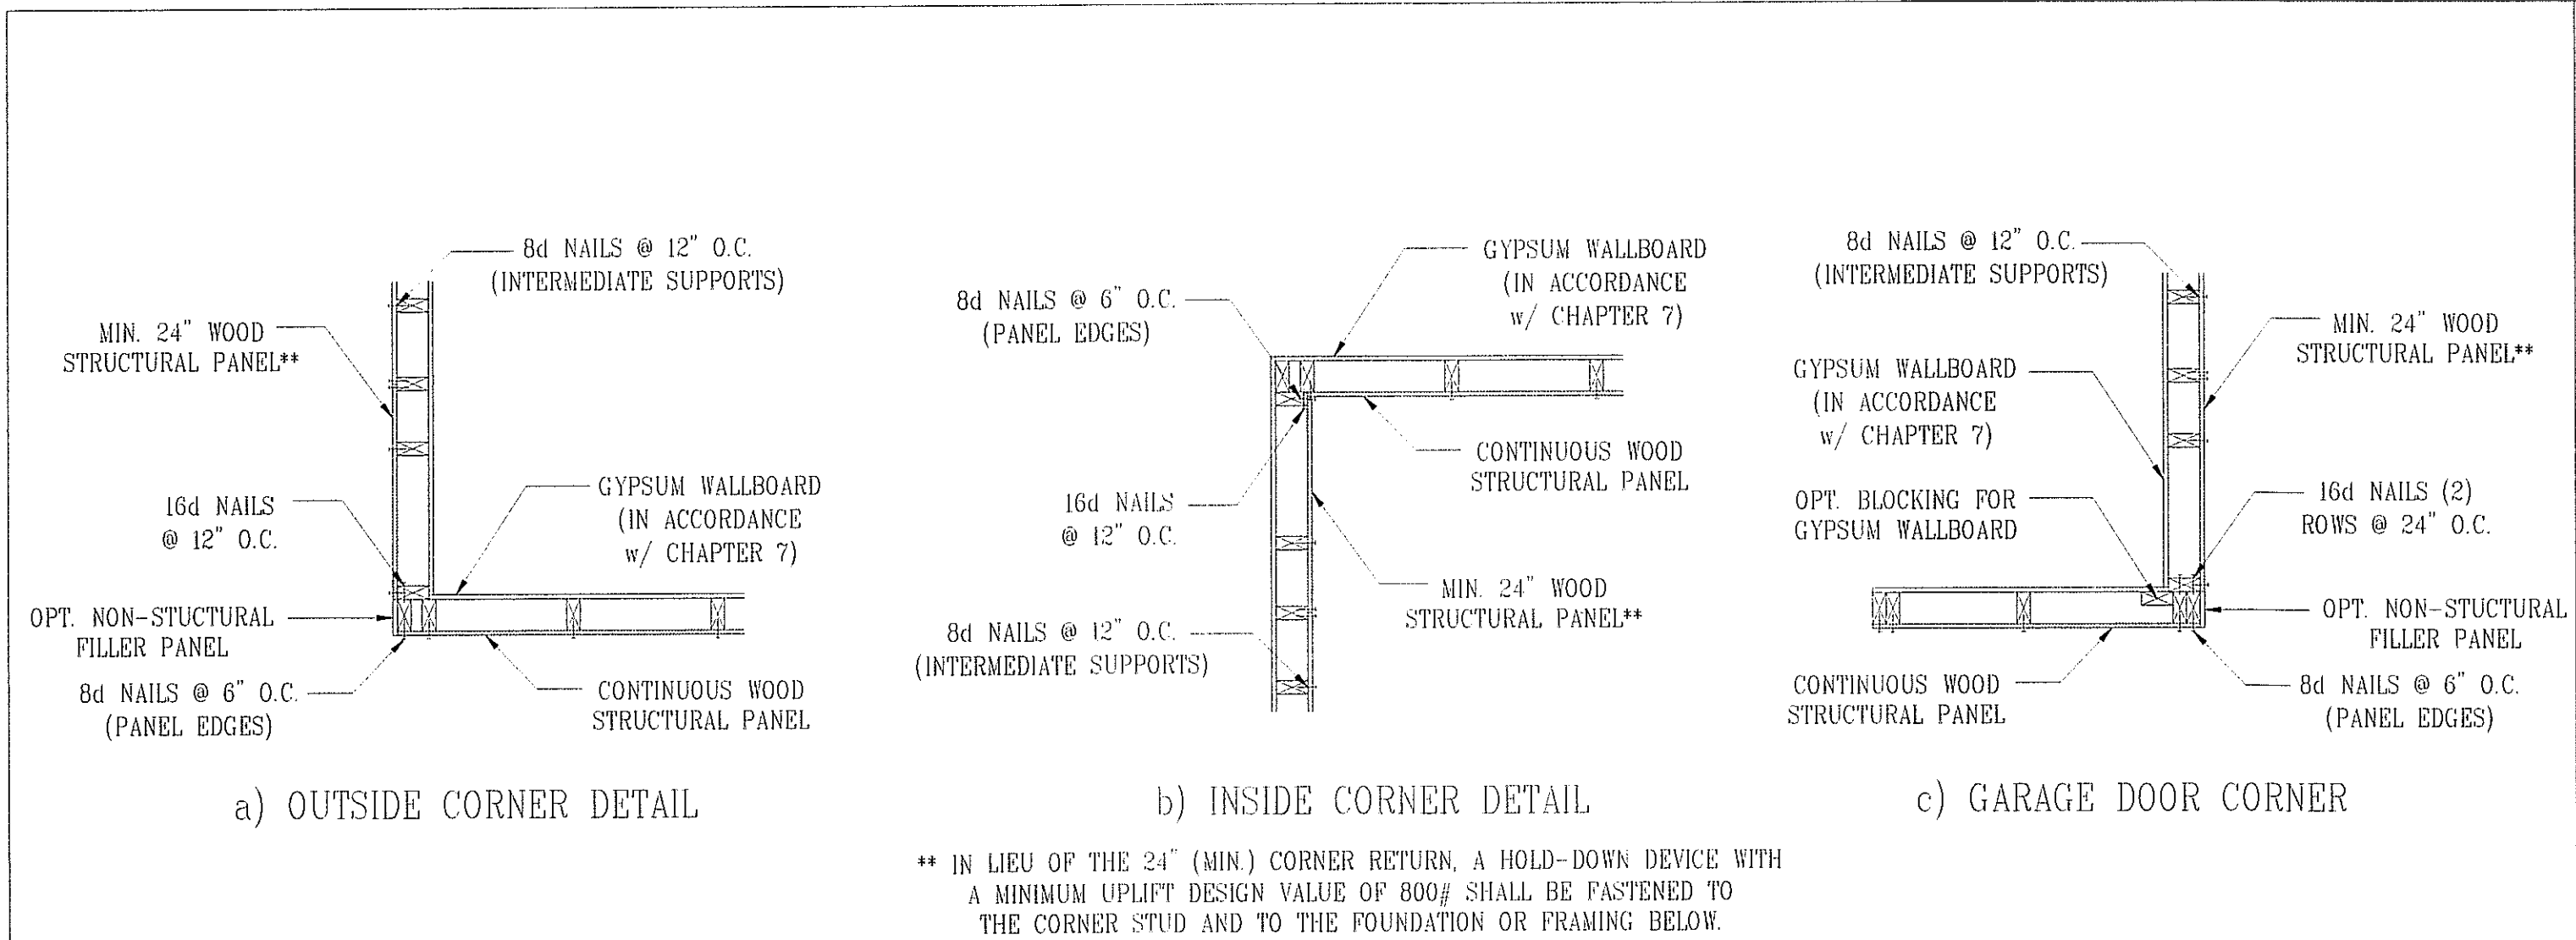


B1: TYPICAL EXTERIOR CORNER FRAMING FOR CONTINUOUS SHEATHING
NO SCALE

- STRUCTURAL SHEATHING NOTES**
- DESIGNED FOR SEISMIC ZONE A-C AND WIND SPEEDS OF 120 MPH OR LESS.
 - WALLS SHALL BE BRACED IN ACCORDANCE WITH SECTION R602.10 OF THE 2018 IBC.
 - BRACING REQUIREMENTS SHALL BE PER TABLE R602.10.3. REFER TO SECTION R602.10.4 FOR LOAD PATH DETAILS INCLUDING CONNECTIONS & SUPPORT OF BRACED WALL PANELS.
 - REFERENCE FIGURE R602.10.4.3 OF THE 2018 IBC.
 - INTERIOR BRACED WALL PANELS (BWP) INDICATED SHALL BE SHEATHED IN ACCORDANCE WITH THE GB METHOD OR WSP METHOD AS PRESCRIBED IN SECTION R602.10.1 (UHO)
 - 1/2" GYPSUM BOARD (GB) MINIMUM LENGTH OF 8'-0" (ISOLATED PANELS) OR 4'-0" (CONTINUOUS SHEATHING) SECURE w/ 5d COOLER NAILS (OR EQUAL PER TABLE R702.3.5) SPACED @ 7" O.C. AT PANEL EDGES, INCLUDING TOP AND BOTTOM PLATES @ 7" O.C. AT INTERMEDIATE SUPPORTS
 - 3/8" WOOD STRUCTURAL PANEL (WSP) SECURE w/ 6d COMMON NAILS SPACED AT 6" O.C. AT PANEL EDGES AND 12" O.C. AT INTERMEDIATE SUPPORTS
 - EXTERIOR BRACED WALL PANELS (BWP) SHALL BE CONSTRUCTED IN ACCORDANCE WITH CS-WSP METHOD AS PRESCRIBED IN SECTION R602.10.3 (UHO)
 - ALL SHEATHABLE SURFACES OF EXTERIOR WALLS (INCLUDING AREAS ABOVE AND BELOW OPENINGS AND GABLE END WALLS) SHALL BE CONTINUOUSLY SHEATHED WITH WOOD STRUCTURAL PANEL (WSP) SHEATHING WITH A MINIMUM THICKNESS OF 3/8" SHEATHING SHALL BE SECURED WITH MINIMUM 6d COMMON NAILS SPACED AT 6" O.C. AT PANEL EDGES AND SPACED AT 12" O.C. AT INTERMEDIATE SUPPORTS.
 - MINIMUM BRACED WALL PANEL LENGTHS WITH CS-WSP METHOD SHALL BE AS FOLLOWS
 - 2'-0" ADJACENT TO OPENINGS NOT MORE THAN 67% OF WALL HEIGHT
 - 30" ADJACENT TO OPENINGS GREATER THAN 67% AND LESS THAN 85% OF WALL HEIGHT.
 - 48" FOR OPENINGS GREATER THAN 85% OF WALL HEIGHT
 - SHEATH INTERIOR & EXTERIOR
 - FOR CS-WSP METHOD, A MINIMUM 24" BRACED WALL PANEL CORNER RETURN SHALL BE PROVIDED AT BOTH ENDS OF A BRACED WALL LINE IN ACCORDANCE WITH FIGURE R602.10.3(4) IN LIEU OF A CORNER RETURN. EITHER A MIN. 48" BRACED WALL PANEL SHALL BE PROVIDED AT THE CORNER OR A HOLD-DOWN DEVICE WITH A MINIMUM UPLIFT DESIGN VALUE OF 800# SHALL BE FASTENED TO THE EDGE OF THE BRACED WALL PANEL CLOSEST TO THE CORNER AND TO THE FOUNDATION OR FRAMING BELOW.
 - MINIMUM 800# HOLD-DOWN DEVICE



REQUIRED BRACED WALL PANEL CONNECTIONS

METHOD	MATERIAL	MIN. THICKNESS	REQUIRED CONNECTION	
			@ PANEL EDGES	@ INTERMEDIATE SUPPORTS
CS-WSP	WOOD STRUCTURAL PANEL	3/8"	6d COMMON NAILS @ 6" O.C.	6d COMMON NAILS @ 12" O.C.
GB	GYPSUM BOARD	1/2"	5d COOLER NAIL** @ 7" O.C.	5d COOLER NAIL** @ 7" O.C.
WSP	WOOD STRUCTURAL PANEL	3/8"	6d COMMON NAILS @ 6" O.C.	6d COMMON NAILS @ 12" O.C.

**OR EQUIVALENT PER TABLE R702.3.5
B3: BRACE WALL PANEL CONNECTIONS
NO SCALE

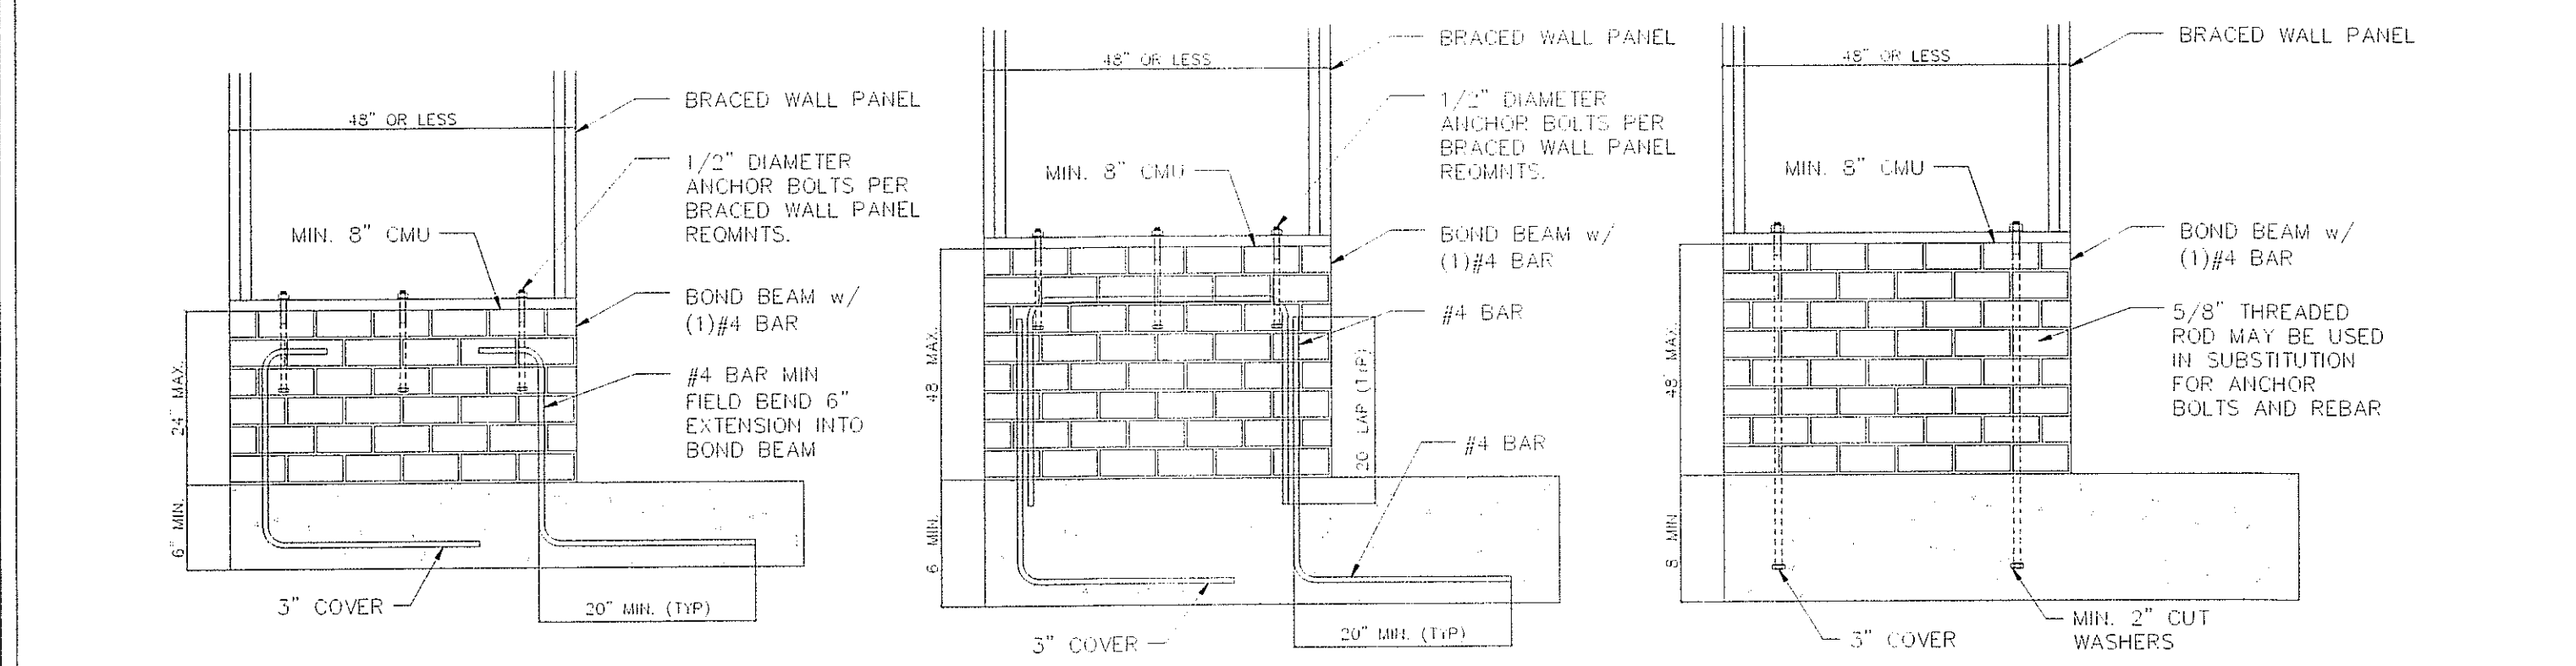


B4: MASONRY STEM WALL SUPPORTING BRACED WALL PANELS
FIGURE R602.10.4.3 OF THE 2018 IBC
NOTE: GROUT BOND BEAMS AND ALL CELLS WHICH CONTAIN REBAR, THREADED RODS AND ANCHOR BOLTS

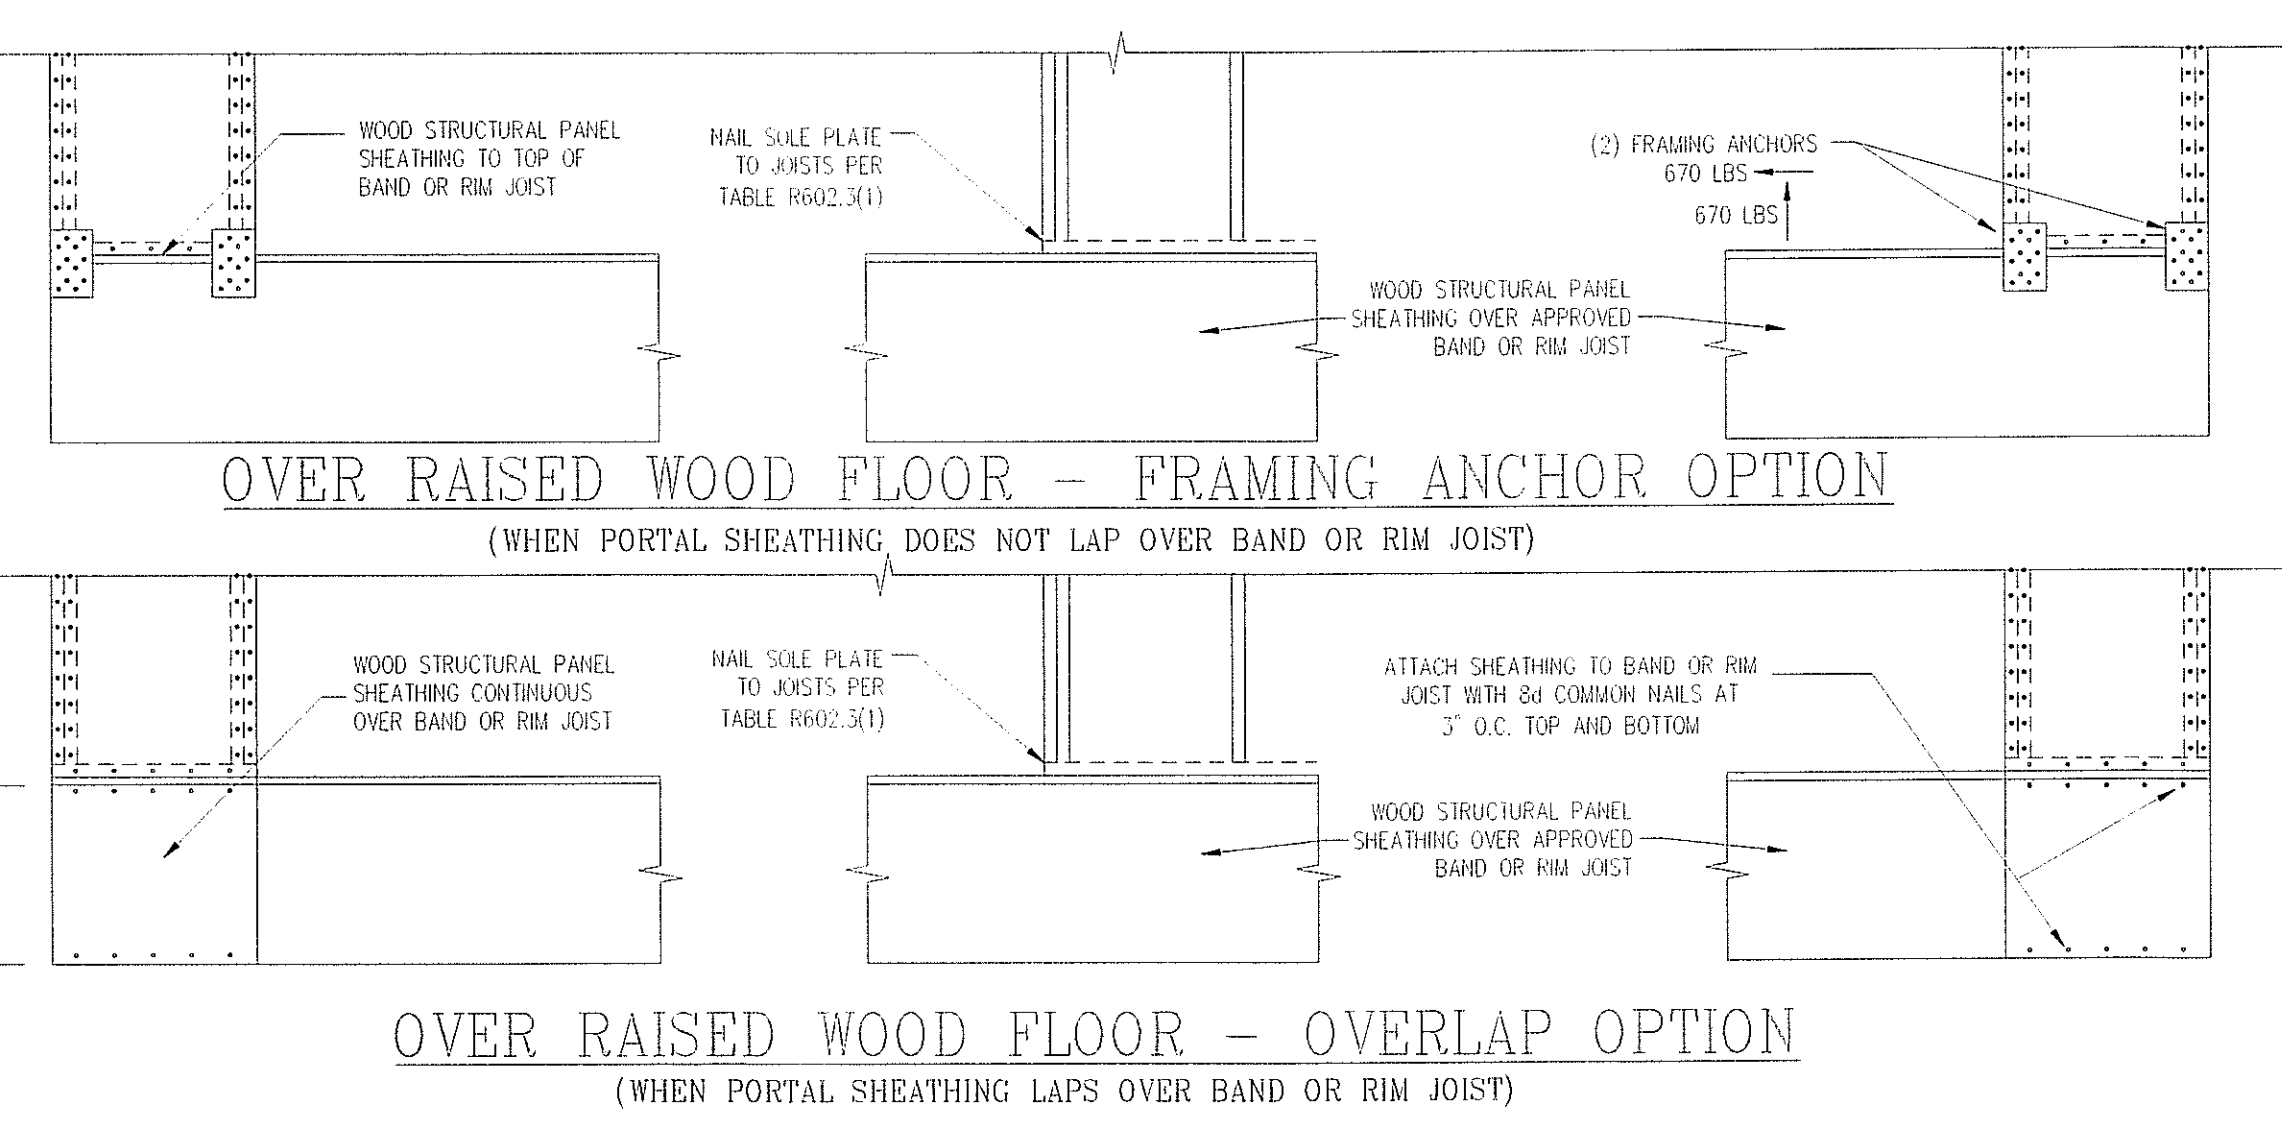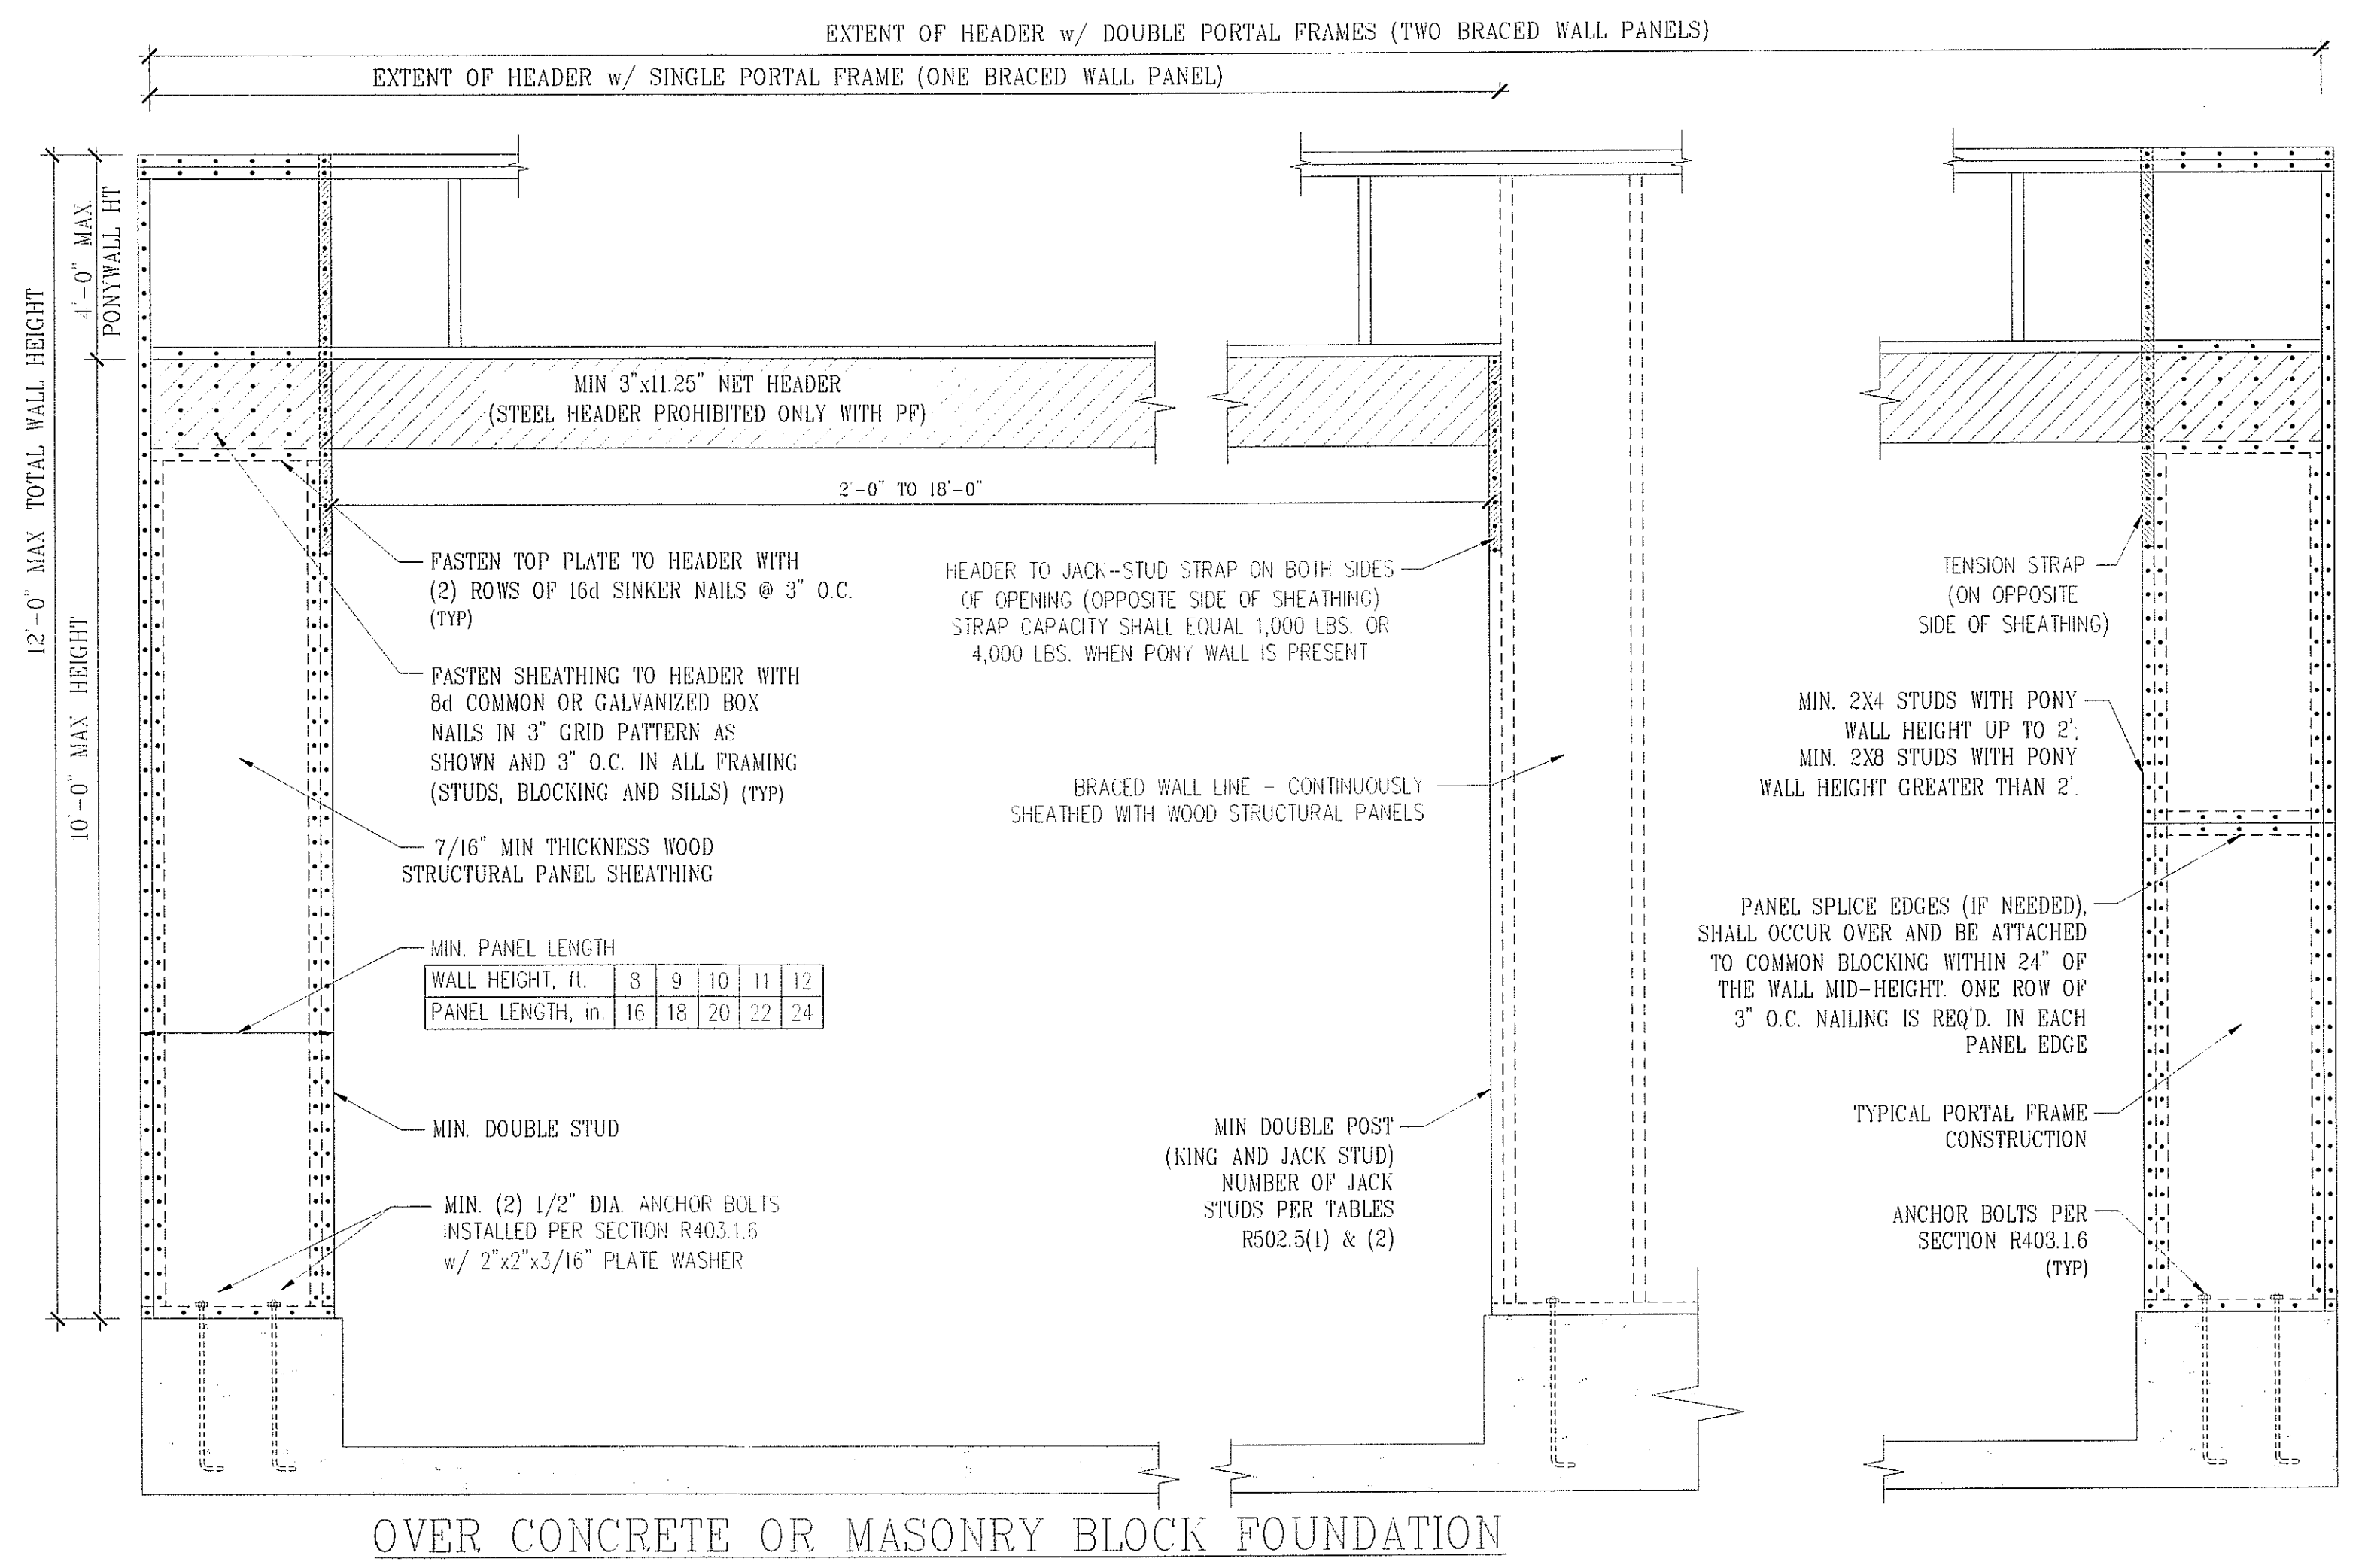

B2: METHOD CS-PF: CONTINUOUSLY SHEATHED PORTAL FRAME
FIGURE R602.10.1

*Engineer seal does not include construction means, methods, techniques, sequences, procedure or safety practices.
Any deviation or discrepancy on plans are to be brought to the immediate attention of Tyn dall Engineering & Design, P.A. Failure to do so will nullify Tyn dall Engineering & Design, P.A. liability.
Please review these documents carefully. Tyn dall Engineering & Design, P.A. will not be responsible for any errors or omissions, etc. presented in these documents were created acceptable once construction begins.

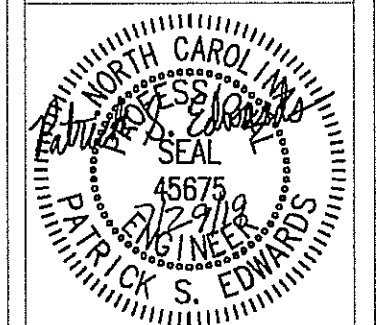

TYNDALL
ENGINEERING & DESIGN, P.A.
199 773-1000 • 919 773-0668
www.tyndallengineering.com
250 Shawmut Drive • Greensboro, NC 27409

ANN DENNING
DENNING RESIDENCE

SHEATHING DETAILS

Project #: 1901-010273
Date: 7/29/19
Drawn/Design By: JWA
DWG. Checked By: PTH
Scale: NOT TO SCALE

REVISIONS

No.	Date	Remarks

Sheet Number
D3
of 3