

DATE: 3-27-19

RAWN BY: WO

KENT

KENT REVISION LIST - STRUCTURAL:

1.)

KENT REVISION LIST - ARCHITECTURAL:


1.) ADDED NOTE TO EXTEND STAIR CLIP IN POWDER ROOM THE LENGTH OF THE ROOM (3-19)


2.) SHOWED AHU AND MECH, LOCATIONS ON SECOND FLOOR (3-19) 3.) UPDATED PLAN TO NEW CAD FORMAT AND ADDED COVER SHEET (3-19)

4.) UPDATED CUTSHEETS (3-19)

 $C: \label{locuments} \label{locuments} C: \label{locuments} Wade \label{locuments} Documents \label{locuments} Projects \label{locuments} Wade \label{locuments} Projects \label{locuments} Wade \label{locuments} Documents \label{locuments} Wade \label{locuments} Documents \label{locuments} Wade \label{locuments} Documents \label{locuments} Wade \label{locuments} Projects \label{locuments} Wade \label{locument$

COVER SHEET

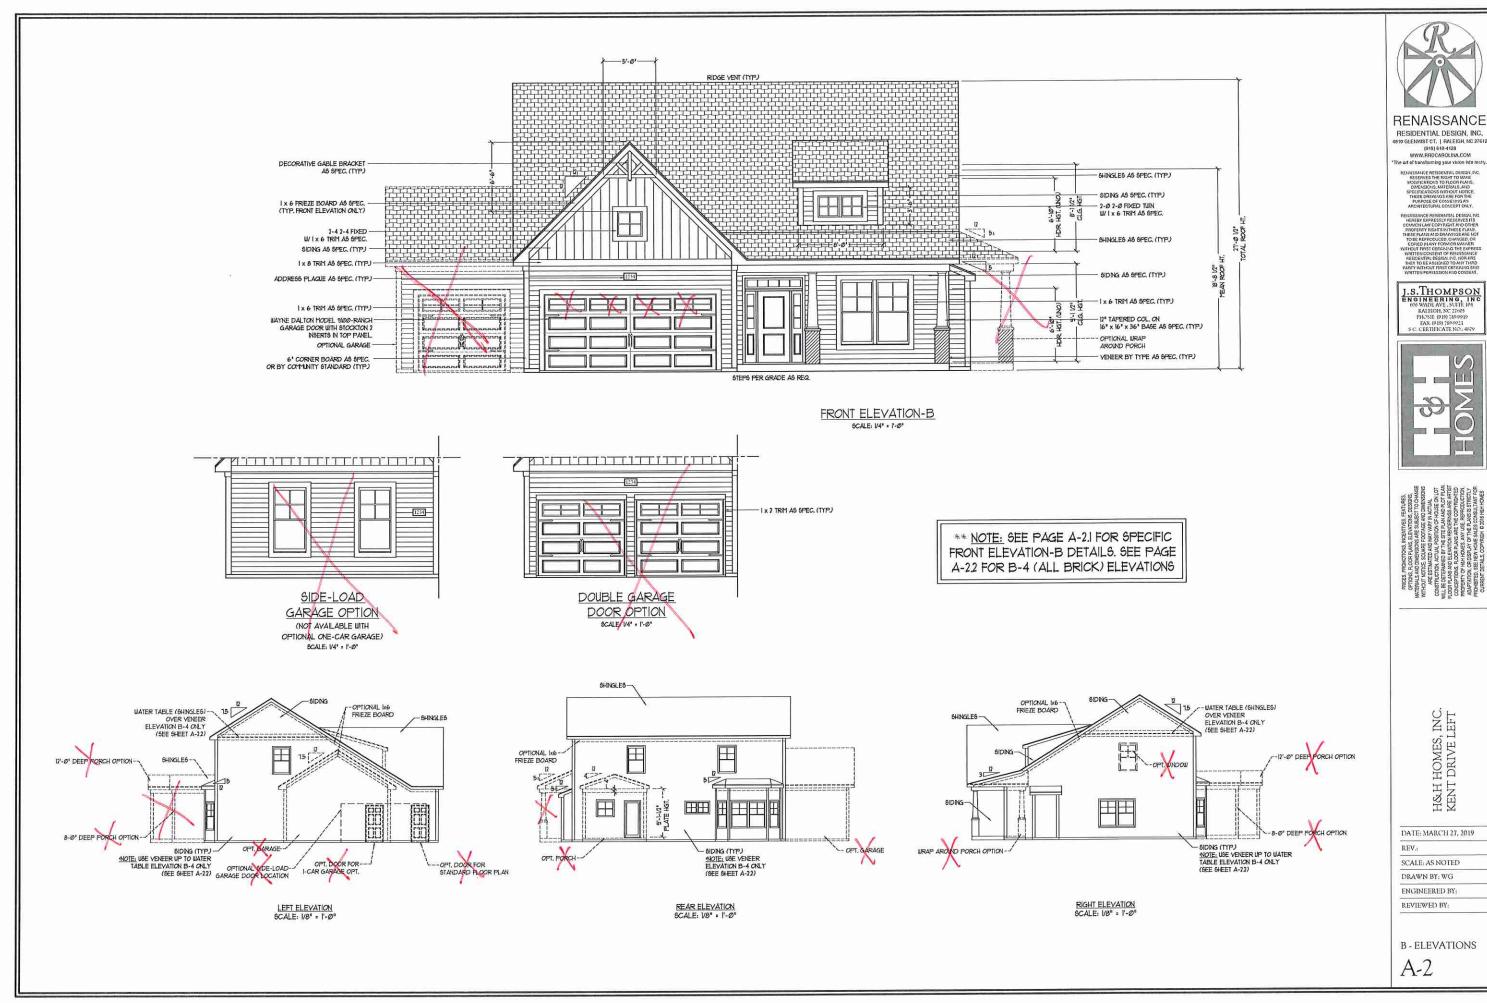

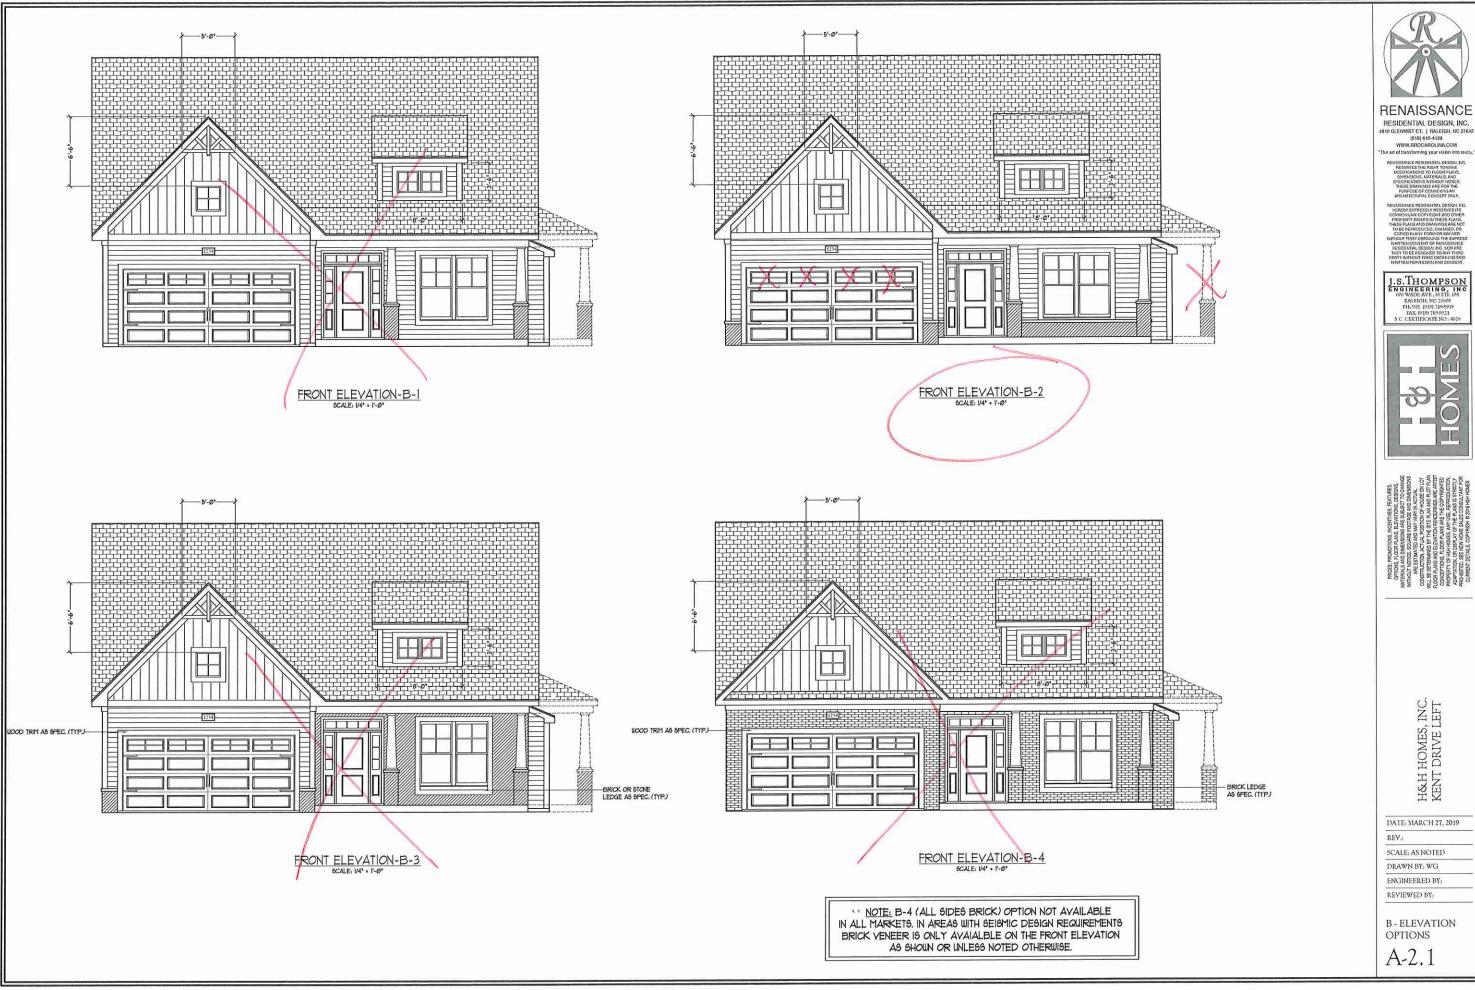





DATE: MARCH 27, 2019




| Ist FLOOR: | ITO SQ. FT. 2nd FLOOR: | 830 SQ. FT. TOTAL: | 2000 SQ. FT. FRONT PORCH: | 120 SQ. FT. GARAGE: | 423 SQ. FT.

OPTIONAL 12'-0" DEEP REAR PORCH

3-05-0 3-05-0

1-641-64

OPTIONAL VENER (SEE ELEVATION PAGES FOR LOCATIONS AND CONDITIONS)

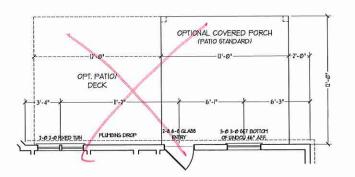

TIONAL COVERED PORCH (PATIO STANDARD)

OPTIONAL VENEER
(SEE ELEVATION PAGES
FOR LOCATIONS
AND CONDITIONS)

6 x 6 TRTD, POST MIN W-PVC SLEEVE, FOR OPT, PORCH

OPT. PATIO/ DECK


SQUARE FOOTAGE (OPTIONS)

IST FLOOR (BRICK): 1222 SQ. FT. 860 SQ. FT. 2ND FLOOR (BRICK): TOTAL (BRICK): 2082 SQ. FT. GARAGE (BRICK): 443 SQ. FT. OPT. WRAP-AROUND FORCH: 60 SQ. FT. REAR PORCH (8-0 DEEP): 96 SQ. FT. REAR PORCH (12-Ø DEEP): 144 SQ. FT. OPT. PATIO/ DECK (8-Ø DEEP): 96 SQ. FT. OPT. PATIO/ DECK (12-Ø DEEP): 144 SQ. FT. I-CAR GARAGE (STUD): 24Ø SQ. FT. I-CAR GARAGE (BRICK): 277 SQ. FT.

INOTE: ALL EXTERIOR WALLS AND ATTIC WALLS ARE TO BE 2 x 4 @ 16" O.C. MIN. (UNO). 2 x 6 @ 16" O.C. EXTERIOR WALLS MAY BE CONSTRUCTED IN LIEU OF 2 x 4 WALLS. ALL INTERIOR LOAD BEARING WALLS ARE TO BE 2 x 4 @ 16" O.C. (UNO) AND NON-LOAD BEARING INTERIOR WALLS ARE TO BE 2 x 4 @ 24" O.C. (UNO).

2x6 WALL

• SHADED WALLS ARE TO BE 2 x 6 @ 16" O.C. (LOAD BEARING) OR 2 x 6 @ 24" O.C. (NON-LOAD BEARING) REGARDLESS OF EXTERIOR WALL CONDITION

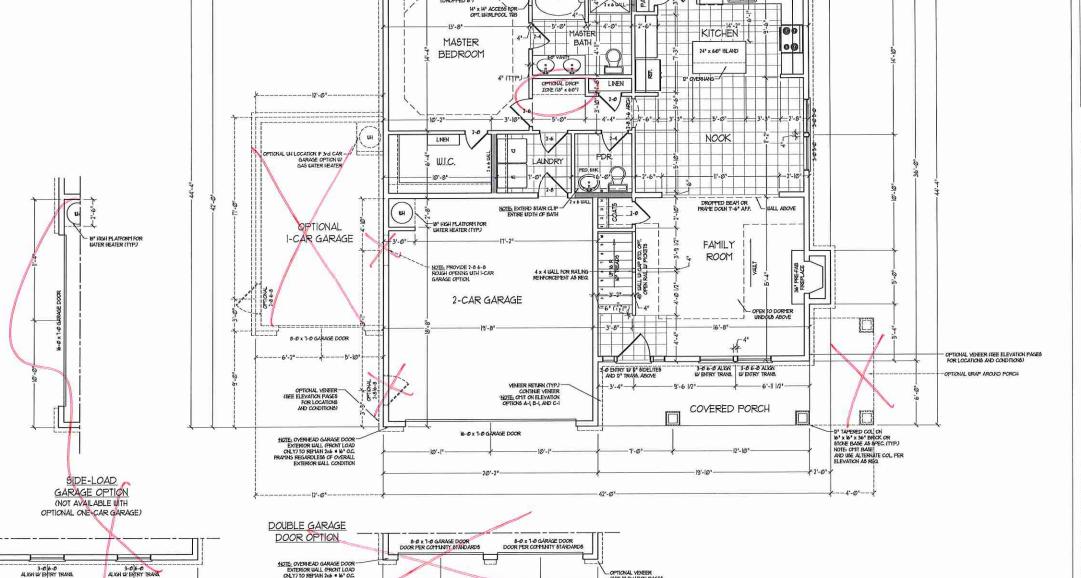



RENAISSANCE

RESIDENTIAL DESIGN, INC. 4810 GLENMIST CT. | RALEIGH, NC 27612 (919) 649-4128 WWW.RRDCAROLBVA.COM

*The art of transforming your vision into realty

REMAISSAINCE RESIDENTIAL DESIGN, IN RESERVES THE RIGHT TO MAKE MODIFICATIONS TO FLOOR PLANS, DIVENSIONS, MATERIALS, AND SPECIFICATIONS WITHOUT NOTICE THESE DRAWNINGS ARE FOR THE RESIDES OF CONVENTION AND

HEREAY EARNESS IN RESERVES ITS COMMON LAW CERRISH AND OTHER PROPERTY RIGHTS IN THESE FIAIR. THESE FIAIR. THESE FIAIR. THESE FIAIR. THESE FIAIR TO BE REPRICULED, CHANGED, OR COMED HANT CORNOR MAMERIA WITHOUT FRAST OBTINING THE EARNE WHITTEN CONSERT OF SHALLSSANCE FROM THE EARNESS AND TH

J.S.THOMPSON ENGINEERING, INC 605 WADE AVE, SUITE 104 EALFIGH, NC 27605

6 WADE AVE , SUITE 104 RALEIGH, NC 27605 PHONE (919) 789-9919 FAX (919) 789-9921 CERTIFICATE NO.: 4679



THE SERVICE AND THE SERVICES. SERVICES SERVICES

H&H HOMES, INC. KENT DRIVE LEFT

DATE: MARCH 27, 2019 REV.:

SCALE: 1/4"=1'-0"

DRAWN BY: WG

REVIEWED BY:


FIRST FLOOR PLAN

A-6

NOTE: ALL EXTERIOR WALLS AND ATTIC WALLS ARE TO BE 2 x 4 9 16" O.C. MIN. (UNO). 2 x 6 @ 16" O.C. EXTERIOR WALLS MAY BE CONSTRUCTED IN LIEU OF 2 x 4 WALLS. ALL INTERIOR LOAD BEARING WALLS ARE TO BE 2 x 4 @ 16" O.C. (UNO) AND NON-LOAD BEARING INTERIOR WALLS ARE TO BE 2 x 4 @ 24" O.C. (UNO).

2x6 WALL

· SHADED WALLS ARE TO BE 2 x 6 @ 16" O.C. (LOAD BEARING) OR 2 x 6 @ 24" O.C. (NON-LOAD BEARING) REGARDLESS OF EXTERIOR WALL CONDITION

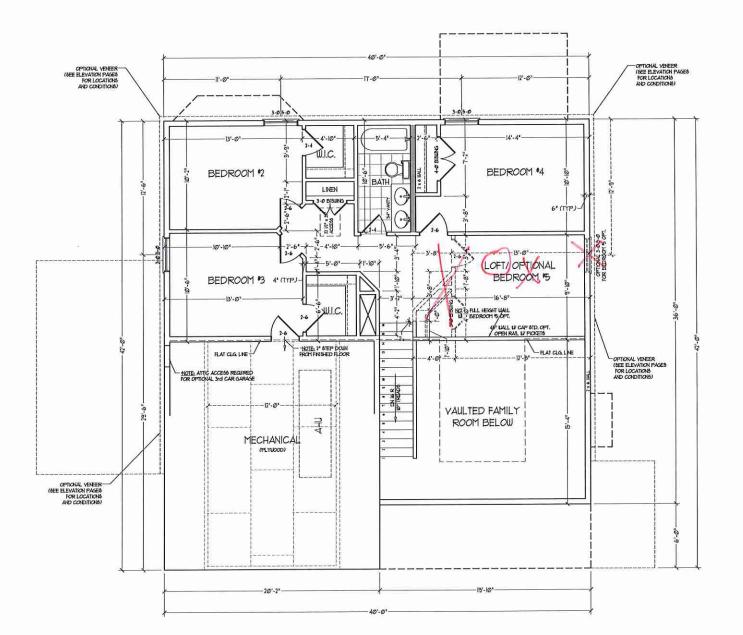



RENAISSANCE

RESIDENTIAL DESIGN, INC.
4810 GLENMIST CT. | RALEIGH, NC 27612
[919] 649-4128
WWW.RRDCAROLENA.COM
The art of transforming your vision into realsy.



H&H HOMES, INC. KENT DRIVE LEFT

DATE: MARCH 27, 2019

REV.:


SCALE: 1/4"=1'-0" DRAWN BY: WG

ENGINEERED BY:

REVIEWED BY:

SECOND FLOOR PLAN

A-7

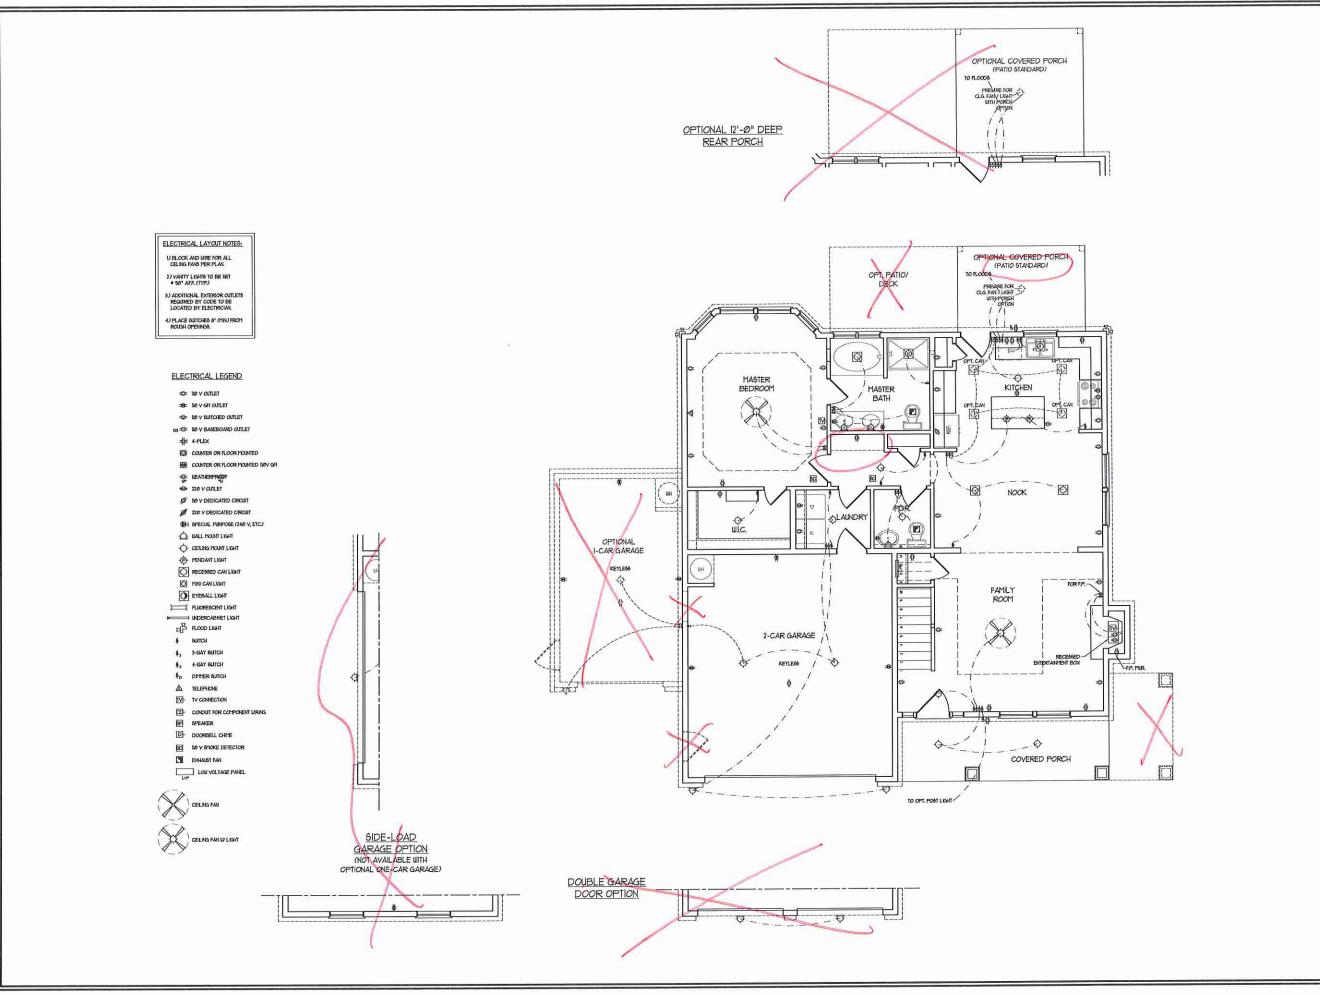



RENAISSANCE

RESIDENTIAL DESIGN, INC.
4810 GLENMIST CT. | FALEIGH, NC 27612
(919) 619-4128
WWW.RRDCAROLENA.COM
*The art of transforming your vision into really.

RENAISSANCE RESIDENTIAL DESIGN, INC.
RESERVES THE FIGHT TO MAKE
MODIFICATIONS TO FLOOR PLANS.

SPECIFICATIONS WITHOUT NOTICE.
THESE DRAWINGS ARE FOR THE
PURPOSE OF CONVEYING AN
ARCHITECTURAL CONCEPT ONLY.

PROPERTY RIGHTS IN THESE FLANS.
THESE FLANS AND DRAWINGS ARE IN
TO BE REPRODUCED, CHANGES, OR
COPED IN AIM FORM OR MANISER
WITHOUT FIRST CRETAINING THE EXPRE WITHOUT FIRST CRETAINING THE EXPRE WITHTO CONSERT OF FRANKSAND,
RESIDENTIAL DESIGN, IDC. LOSA ARE
THEY TO BE ASSISTED TO AIM THERE

J.S.THOMPSON

No WADE AVE , SUITÉ 104 RALFIGH, NC 31605 PHONE (919) 769.0919 FAX. (919) 769.0921 C. CERTIFICATE NO.: 4679



H&H HOMES, INC. KENT DRIVE LEFT

DATE: MARCH 27, 2019

REV.:

SCALE: 1/4"=1"0" DRAWN BY: WG

ENGINEERED BY:

REVIEWED BY:

FIRST FLOOR ELECTRICAL

E-1

ELECTRICAL LAYOUT NOTES

U BLOCK AND WIFE FOR ALL CELING FAND FER FLAN

2) VANITY LIGHTS TO BE SET • 90° AFF. (TYP)

4) PLACE BUTCHES S' (MN) FROM ROUSH OPENINGS.

ELECTRICAL LEGEND


- ⇒ No voutlet
- SE TO Y GH OUTLET
- THE Y SUITCHED OUTLET 10 Y BASEBOARD OUTLET
- 4 4-PLEX
- COUNTER OR FLOOR MOUNTED
- 翻 COUNTER OR FLOOR HOUNTED NOV GFI
- DE LEATHERPROOF
- ₩ novamen M V DEDICATED CIRCUIT
- no v DEDICATED CROUIT
- (DH 6FECIAL FURPOSE (240 V, ETC.)
- THE WALL HOURT LIGHT
- CEILNG MOUNT LIGHT
- PENDANT LIGHT RECESSED CAN LIGHT
- MINI CAN LIGHT
- TYEBALL LIGHT

)_____(FLUORESCENT LIGHT INDERCABNET LIGHT

- HOOD FRAIL
- \$3 3-LIAY BUTCH
- \$4 4-MAY BUTCH
- DITTER SUTTCH
- ▲ TELEPHONE
- TY CONTECTION E- CONDUIT FOR COMPONENT WIRNS
- EF GFEAKER
- D- DOORBELL CHIME
- 10 V 6YOKE DETECTOR
- EXHAUST FAN





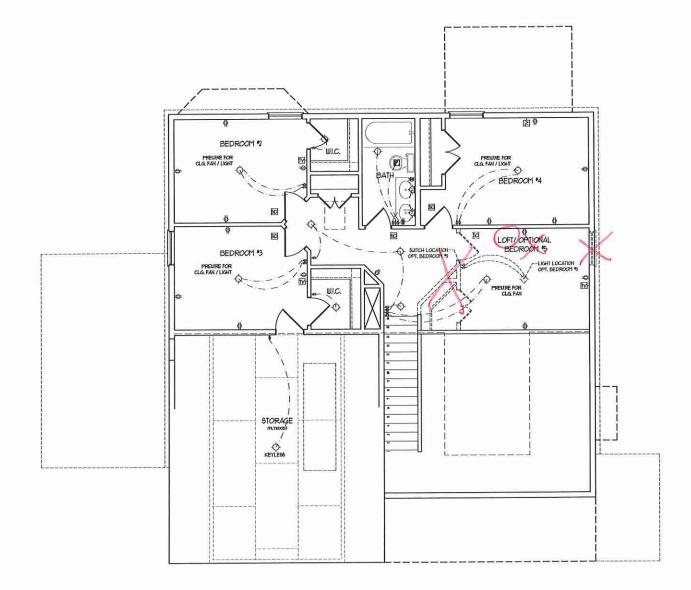



RENAISSANCE

RESIDENTIAL DESIGN, INC, 4810 GLENMIST CT. | RALEIGH, NC 27612 (919) 649-4128 WWW.RRDCAROLINA.COM "The art of transforming your vision into realty,



H&H HOMES, INC. KENT DRIVE LEFT

DATE: MARCH 27, 2019


REV.:

SCALE: 1/4"-1'-0"

DRAWN BY: WG ENGINEERED BY:

REVIEWED BY: SECOND FLOOR

ELECTRICAL PLAN E-2

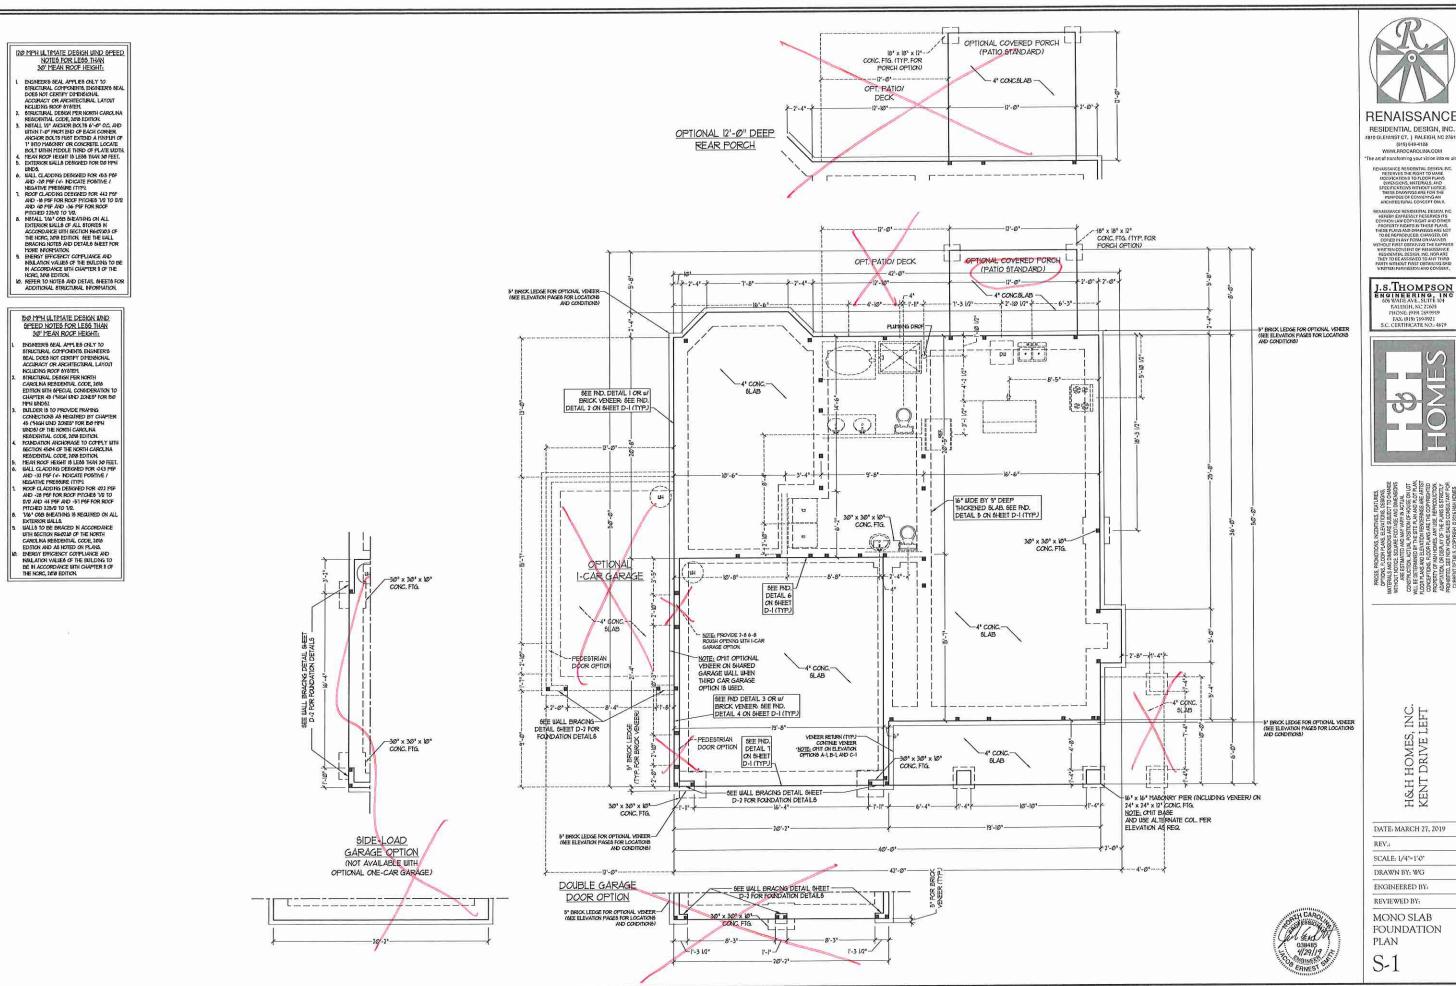



RENAISSANCE

4810 GLENMIST CT. 1 RALEIGH, NC 27612

he art of transforming your vision into re at



HOMES, INC. H&H I

FOUNDATION

BRACED WALL DESIGN NOTES

- BRACED WALL DESIGN FER SECTION R60710 OF THE
- BRACED WALL SHOWN FER SECTION REWIND OF THE NCRC 2019 EDITION C5-USP REFERS TO "CONTRACTOR 18 TO NSTALL THE" 058 ON ALL EXTERIOR WALLS ATTACHED W 8d NAILS SPACED 6" O.C. ALONG PANEL EDGES AND 12" O.C. IN THE FIELD.

 'GB REFERS TO 'GYPSUM BOARD" CONTRACTOR IS TO INSTALL
- 1/2" (MIN.) GYPSUM WALL BOARD WHERE NOTED ON THE FLANS.
- I/A* (TRIV OF POUT WALL BOARD WHENE MOTED ON THE FLANS. FASTEN GB WITH JUY "SCREED OR 15/8" NAILS SPACED TO G.C. ALCAIS PANEL EDGES AND IN THE FIELD INCLUDING TOP AND BOTTOM FLATES. BRACED WALL DESIGN APPLIED IN WIND ZONES UP TO 13/8 MPH. FOR HIGH WIND ZONES, BRACE WALLS ARE TO BE CONSTRUCTED IN ACCORDANCE WITH CHAPTER 45 OF THE NICRO 2018 EDITION SEE NOTES AND DETAIL SHEETS FOR ADDITIONAL BRACED WALL INCREMENTATION.

BRACED WALL DESIGN

RECTANGLE A SIDE IA (FRONT LOAD) RECTANGLE B SIDE IB METHOD: FF METHOD: CS-WSP/GB/FF TOTAL REQUIRED LENGTH: 1358'

SIDE 2A METHOD: C5-USP/GB TOTAL REQUIRED LENGTH: 13.58' SIDE 3A METHOD: C5-WSP

TOTAL REQUIRED LENGTH: 1235' TOTAL REQUIRED LENGTH: 14.45' TOTAL PROVIDED LENGTH: 29.33' TOTAL PROVIDED LENGTH: 24.45 SIDE 4A (SIDE LCAD)
METHOD: CS-USP/FT
TOTAL FEGURED LENGTH: 235
TOTAL PROVIDED LENGTH: 2445

TOTAL PROVIDED LENGTH: 2445

TOTAL REQUIRED LENGTH: 285' TOTAL PROVIDED LENGTH: 6' SIDE 2B METHOD: C5-WSP TOTAL REQUIRED LENGTH: 285' TOTAL PROVIDED LENGTH: 16.831 TOTAL PROVIDED LENGTH: 121 SIDE 3B / 4A SHARED METHOD: C5-W5P/GB

NOTE: ALL EXTERIOR WALLS AND ATTIC WALLS ARE TO BE 2 x 6 @ 16" O.C. MIN. (UNO), 2 x 4 @ 16" O.C. EXTERIOR WALLS MAY BE CONSTRUCTED IN LIEU OF 2 x 6 WALLS (UNO), ALL INTERIOR LOAD BEARING WALLS ARE TO BE 2 x 4 @ 161 O.C. (UNO) AND NON-LOAD BEARING INTERIOR WALLS ARE TO BE 2 x 4 @ 24" O.C. (UNO).

STRUCTURAL NOTES:

- ALL FRAMING LUMBER TO BE SIFT 12 (UNO), ALL TREATED LUMBER TO BE SIFT 12 (UNO) ALL LOAD BEARNY HEADERS TO BE (2) 2 x 6 (UNO).
- PROVIDE AN EXTRA JOIST UNDER WALLS PARALLEL
- TO FLOOR JOISTS WHERE NOTED ON THE PLANS, WINDOW AND DOOR HEADERS TO BE SUPPORTED W/ (I) JACK STUD AND (I) KINS STUD FA BND (INO.), SEE TABLE R602.TIS FOR ADDITIONAL KING STUD REQUIREMENTS.
- RECUIREMENTS.

 5. SQUIACES DENOTE POINT LOADS WHICH RECUIRE SOLID BLOCKING TO GIRDER OR FOUNDATION. ALL SQUIARES TO BE (2) STUDS (MOJ).

 6. FOR HIGH WIND ZONES, ALL EXTERIOR WALLS TO BE SHEATHED WITH 1/16" OSB SHEATHING WITH JOINTS
- BLOCKED AND SECURED WITH 8d NAILS AT 3" O.C. ALONG EDGES AND SECRED WITH 25 THE FIELD.
 FOR HIGH WIND ZONES, SECURE ALL EXTERIOR WALL
 SHEATHING PAVELS TO DOUBLE TOP PLATES, BANDS, JOISTS, AND GIRDERS WITH (2) ROWS OF 8d NAILS STAGGERED AT 3" OC. PANELS SHALL EXTEND 12" BEYOND CONSTRUCTION JOINTS AND SHALL OVERLAP GIRDERS AND DOUBLE SILL PLATES THEIR FULL
- DEPTH.

 ALL 4 x 4 POSTS SHALL BE ANCHORED TO SLABS u/ SIMPSON ABU44 POST BASES (OR EQUAL) AND 6 x 6 POSTS W ABUSE POST BASES (OR EQUAL) (IND). ALL 4 x 4 AND 6 x 6 POSTS TO BE INSTALLED WITH 100 LB CAPACITY UPLET CONNECTIONS AT TOP (IND) FOR FIEERISLASS, ALUMNUM, OR COLUMN ENS. BY
- OTHERS SECURE TO SLAB #/ (2) METAL ANGLES USING 2" CONC. SCREUE, FASTEN AVALES TO COLUMNS W/ W*
 THROUGH BOLTS W/ NUTS AND WASHERS. LOCATE
 AVAILES ON OPPOSITE SIDES OF COLUMN. THROUGH BOLTS MUST BE INSTALLED PRIOR TO SETTING
- Ø. REFER TO NOTES AND DETAIL SHEETS FOR ADDITIONAL STRUCTURAL INFORMATION

'DSP' INDICATES DOUBLE STUD POCKET BETWEEN WINDOW UNITS.

MINIMUM NUMBER OF FULL HEIGHT STUDS AT EACH END OF HEADERS IN EXTERIOR WALLS

HEADER SPAN (FEET)	MAXIMIM STILD SPACING (INCHES) (PER TABLE R6(013/5)		
	16	24	
UP TO 3	1	1.	
4'	2	1.	
8'	3	2	
12'	5	3	
16'	6	4	

	CHEDULE FOR AL STONE SUPPORT	
LENGTH (FT.)	SIZE OF LINTEL	
UP TO 4 FT.	L 3 1/2 x 3 1/2 x 1/4	
4-8	L 5 x 3 V2 x 5/16 LLY	
8 AND GREATER	L 6 x 4 x 5/16 LLY	

BRICK SUPPORT NOTES:

- LINTEL SCHEDULE APPLIES TO ALL OPENINGS IN BRICK VENEER (INO) SEE ARCH DUGS, FOR SIZE AND LOCATION OF
- OPENNGS.
 (ILY) = LONG LEG VERTICAL
 LENGTH = CLEAR OPENNG
 EYBED ALL ANGLE IRONG MN 4" EACH
 SIDE NIO VENEER TO PROVIDE BEARNG
 FOR ALL HEADERS 8". 0" AND GREATER IN LENGTH, ATTACH STEEL ANGLE TO HEADER W 1/2" LAG SCREWS . D" O.C.
- HEADER W 1/2" LAS SCREUS 12" O.C.

 STAGGERED.

 FOR ALL BRICK SUPPORT ROOF LINES,
 FASTEN (7)" 2 × 10" BLOCKING BETWEEN

 STUDS W (4) I/3 NAILS FER FLY, FASTEN

 A 6" x 4" x 5/6" STEEL ANGLE TO (7)" 2 x

 10" BLOCKING W (7)" LAS SCREUS 12"

 CELOCKING W (7)" LA O.C. STAGGERED, SEE SECTION R103821 OF THE 2018 NORC FOR ADDITIONAL BRICK SUPPORT NEORMATION
- PRECAST REINFORCED CONCRETE
 LINTELS ENGINEERED BY OTHERS MAY BE

(3) 13/4" x 16" LYL CONT. ROTH FRONT CORNER W (3) 2 x 6 E4 BEARNS POINT. OR FOR BRICK. (3) 13/4" x 18" LYL W (3) 2 x 6 E4 BRS PT. SIDE-LOAD GARAGE OPTION

(NOT AVAILABLE WITH

OPTIONAL ONE-CAR GARAGE)


DOUBLE GARAGE

DOOR OPTION

(3) 2 x 12 CONT. FROM CORNER (2) 2 x 6 EA BRG, PI

FILL BETWEEN JACK STUDS W KING STUDS, SECURE-

HEADERS TOGETHER u/ (2) 4" LONG CS/6 STRAPS. INSTALL (I) STRAP ACROSS TOP AND (I) STRAP ACROSS BOTTOM OF HEADERS ON INSIDE FACE.

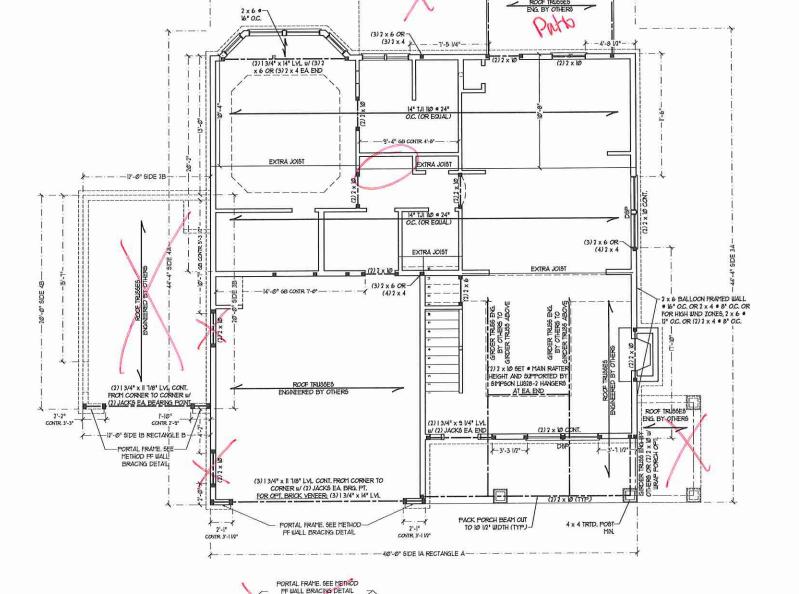

(3) 2 x 12 CONT

2 x 6 EA BRG P

6 x 6 TRID. POST-MIN (TYP.)

40'-0" SIDE 24-

4 x 4 TRID, POST-MN. (TYP.)

OPTIONAL 12'-Ø" DEEP

REAR PORCH

(2) 2 × 10

PACK PORCH BEAM OUT

PACK PORCH BEAM OUT

TO 8" WIDTH (TYP)

(2) 2 x 10 (TYP)



RENAISSANCE

RESIDENTIAL DESIGN, INC. 1810 GLENMIST CT. | RALEIGH, NC 27612 (919) 649-4128 WWW.RRDCAROLENA.COM

REMASSANCE RESIDENTIAL DESIGN, NO. RESERVED THE PROHIT TO MAKE ACCEPTATIVES TO PLOOP PLANS DOMENICIAS, MATERIALS, AND SECURICATIONS WITHOUT NOTICE, THESE DRAWNAS ARE FOR THE PURPOSE OF CONVEYNO AN ARCHITECTURAL CONCEPT ONLY.

J.S.THOMPSON



, INC. HOMES, DRIVE L H&H I

DATE: MARCH 27, 2019 REV.:

SCALE: 1/4"=1'-0"

DRAWN BY: WG ENGINEERED BY-

REVIEWED BY:

SECOND FLOOR FRAMING PLAN

S-2

BRACED WALL DESIGN NOTES:

- BRACED WALL DESIGN PER SECTION R607J0 OF THE NCRC 2018 EDITION.
 CS-USP REFERS TO "CONTINUOUS SHEATHING WOOD STRUCTURAL PAYELS" CONTRACTOR IS TO INSTALL 1716" OSB ON ALL EXTERIOR WALLS ATTACHED W BO MAILS SPACED 6" OC. ALONG PAYEL EDISES NO 12" OC. N THE FIELD.
 'GB REFERS TO "GYPSIM BOARD" CONTRACTOR IS TO INSTALL
- GB REFERS TO "GYPSUM BOARD" CONTRACTOR IS TO INSTALL IN" (MINU GYPSUM WALE NOTEO ON THE FLAMS, FASTEN GB WITH I VA" SCREWS OR I 5/8" NAILS SPACED TO OC. ALONG PANEL EDGES AND IN THE FIELD INCLUDING TOP AND BOTTOM PLATES.

 BRACED WALL EDGES AND IN THE FIELD INCLUDING TOP AND BOTTOM PLATES.

 BRACED WALL DESIGN APPLIED IN WIND ZONES WE TO 150 M MPH. FOR HIGH WIND ZONES, BRACE WALLS ARE TO BE CONSTRUCTED IN ACCORDANCE WITH CHAPTER 45 OF THE NCRC 2019 EDITION. SEE NOTES AND DETAIL SHEETS FOR ADDITIONAL BRACED WALL INFORMATION.
- WALL INFORMATION

- PER SECTION R602/032 OF THE 2018 NCRC, THE AMOUNT OF BRACING ON THE SECOND FLOOR EXCEEDS THE AMOUNT REQUIRED FOR THE FIRST FLOOR AND NO BRACED WALL ANALYSIS IS REQUIRED. SHEATH ALL EXTERIOR WALLS WITH 1/16" OSB SHEATHING
- ATTACHED WITH 8d NAILS AT 6" O.C. ALONG PANEL EDGES AND 12" O.C. IN THE FIELD.

NOTE: ALL EXTERIOR WALLS AND ATTIC WALLS ARE TO BE 2 x 6 @ 16" O.C. MIN. (UNO), 2 x 4 @ 16" O.C. EXTERIOR WALLS MAY BE CONSTRUCTED IN LIEU OF 2 x 6 WALLS (UNO). ALL INTERIOR LOAD BEARING WALLS ARE TO BE 2 x 4 @ 16" O.C. (UNO) AND NON-LOAD BEARING INTERIOR WALLS ARE TO BE 2 x 4 @ 24" O.C. (UNO).

	CHEDULE FOR AL STONE SUPPORT
LENGTH (FT.)	SIZE OF LINTEL
UP TO 4 FT.	L 3 V2 x 3 V2 x V4
4-8	L 5 x 3 1/2 x 5/16 LLV
8 AND GREATER	L 6 x 4 x 5/16 LLY

BRICK SUPPORT NOTES:

- LINTEL SCHEDULE APPLIES TO ALL OPENINGS IN BRICK VENEER (UNO), SEE ARCH DUGS, FOR SIZE AND LOCATION OF
- ARCH DUGS, FOR SIZE AND LOCATION OF OPENINGS.
 (ILLY) * LONG LEG VERTICAL.
 LENSITH * CLEAR OPENING
 EPRED ALL ANGLE RONG MN 4" EACH
 SIDE NITO VENEER TO PROVIDE BEARNS,
 FOR ALL HEADERS 8" 8" 4" AND GREATER

 **NO STEATURE OF THE STEATURE OF
- IN LENGTH, ATTACH STEEL ANGLE TO HEADER W 1/2" LAG SCREUS . 12" O.C.
- HEADER W 1/3" LAS SCHEUP ® 12" OC.
 STAGGERED.
 FOR ALL BRICK SUPPORT © ROOF LINES,
 FASTEN (3) 2 x W BLOCKING BETWEEN
 STUDS W (4) 1/2 A MAILS PER PLY, FASTEN
 A 6" x 4" x 5/6" STEEL AYALE TO (3) 2 x
 W BLOCKINS W (7) 1/3" LAS GORGUS 6 12"
 OC. STAGGERED. SEE SECTION R1/3932)
 CK. TIE 2/30 A MORE DEM A DOUTLON! OF THE 2018 NORC FOR ADDITIONAL BRICK SUPPORT INFORMATION.
- PRECAST REINFORCED CONCRETE LINTELS ENGINEERED BY OTHERS MAY BE USED IN LIEU OF STEEL LINTELS.

STRUCTURAL NOTES:

- ALL FRAMING LUMBER TO BE SET 12 (UNO). ALL TREATED LIMBER TO BE SYP 19 (UNO.)
 ALL LOAD BEARING HEADERS TO BE (2) 2 x
 6 (UNO.)
 UNIDOW AND DOOR HEADERS TO BE
- SUPPORTED W (1) JACK STUD AND (1) KING STUD EA END (UNO.). SEE TABLE R602.15
- FOR ADDITIONAL KING STUD REQUIREMENTS. SQUARES DENOTE POINT LOADS WHICH REQUIRE SOLID BLOCKING TO GIRDER OR FOUNDATION. ALL SQUARES TO BE (2) STUDS (UNO.)
- FOR HIGH WIND ZONES, ALL EXTERIOR WALLS
 TO BE SHEATHED WITH TIME" OSB SHEATHING
 WITH JOINTS BLOCKED AND SECURED WITH 8d NAILS AT 3" O.C. ALONG EDGES AND 6" OC IN THE FIELD
- OF, IN THE FIELD.
 FOR HIGH WIND ZONES, SECURE ALL
 EXTERIOR WALL SHEATHING PANELS TO
 DOUBLE TOP PLATES, BANDS, JOISTS, AND
 GIRDERS WITH (2) ROUS OF 8d NAILS STAGGERED AT 3" OC. PANELS SHALL EXTEND B" BEYOND CONSTRUCTION JONES AND SHALL OVERLAP GIRDERS AND DOUBLE SILL PLATES THEIR RILL DEPTH. REFER TO NOTES AND DETAIL SHEETS FOR

ADDITIONAL STRUCTURAL INFORMATION NOTE: TEP DENOTES TRIPLE STUD POCKET TABLE R602.15 MNIMM NUMBER OF FULL HEIGHT STUDS AT EACH END OF HEADERS IN EXTERIOR WALLS

HEADER SPAN (FEET)	MAXIMIM STUD SPACING (NCHES) (PER TABLE R6073/5)		
	16	24	
UP TO 3'	1	1	
4"	2	1	
8'	3	2	
12*	5	3	
161	6	4	

(3) 2 × 6 OR -(3) 2 × 4 ROOF TRUSSES ENGINEERED BY OTHERS (ELEY, C ONLY) ROOF TRUSSES ENGINEERED BY OTHERS (ELEV. C ONLY) TRUSS HANGER BY OTHERS GIRDER TRUSS ENGINEERED BY OTHERS - (3) 2 × 6 OR (4) 2 × 4 BALLOON FRAMED WALL FROM BELOW (3) 2 x 6 OR -P 2/2 x 10 SET & MAIN RAFTER
HEIGHT AND SUPPORTED BY
SIMPSON LUSZO-2 HANGERS AT EA END



RENAISSANCE

RESIDENTIAL DESIGN, INC.

J.S.THOMPSON ENGINEERING, INC 606 WADE AVE., SUITE ION RALEIGH, NC 27605 PHONE (919) 789-9919



HOMES, INC. DRIVE LEFT H&H J

DATE: MARCH 27, 2019 REV.:

SCALE: 1/4"=1'-0" DRAWN BY: WG

ENGINEERED BY-REVIEWED BY:

ATTIC FLOOR

FRAMING PLAN S-3

ATTIC VENT CALCULATION:

1915 80, FT. OF ATTIC DIVIDED BY 1500 REQUIRES 125 80, FT. OF NET FREE VENTILATING AREA (MIN.).


BRICK SUPPORT NOTE:


ENTER OUT ON THE NORTH CARD. NO PER PECTION RIGHT NO PER PLY, FASTEN A 6" x 4" x 5/6" STEEL. AVALE TO (2) 2 x lb elocking w(2) 1/2" LAS SCREWS 9 12" O.C. STAGGERED, SEE SECTION RIDGOS). OF THE 10% NORCH FOR ADDITIONAL BRICK SUPPORT NORTHALIAN.

WHERE ROOF SLOFES EXCEED 1-10, NSTALL 3" x 3" x 4" of STEEL. FLATE STOPS AT 24" O.C. PER SECTION RIDGOS). OF THE NORTH CAROLINA RESIDENTIAL CODE, 20% EDITION.

STRUCTURAL NOTES:

- ALL FRAMING LUMBER TO BE 12
- SFF (UNO) CIRCLES DENOTE (3) 2 x 4 POSTS
- CIRCLES DENOTE (3) 2 x 4 POSTS FOR ROCF SUPPORT. PRAFE DORTER WALLS ON TOP OF DOUBLE OR TRIFLE RAFTERS. IHP SPLICES ARE TO BE SPACED A MN. OF 8'-9". FASTEN METBERS WITH TIRREE ROUS OF DO MAILS & 16" OC. (TYP) STICK FRAME OVER FRAMED BOOK SPECIOSA WILLY & BRIGGES
- ROOF SECTIONS W 2 x 8 RIDGES, 2 x 6 RAFTERS # 16" O.C. AND
- PLAT 2 x 10 VALLEYS OR USE VALLEY TRUSCES. FASTEN FLAT VALLEYS TO FASTEN FLAT VALLETS 10
 RAFTERS OR TRIBSSES WITH
 9MPSON HOSEA HURRICANE TIES #
 32° O.C. MAX. PASS HURRICANE
 TIES THEOLEH MOTCH IN ROCE
 9HEATHING. EACH RAFTER 16 TO
 BE FASTENED TO THE FLAT
 VALLEY WITH A MIN. OF 64 10 to VALLEY WITH A MIN OF (6) 12d
- TOE NAILS.
 REFER TO SECTION REWAIL OF THE
 2018 NORC FOR REGUIRED UPLIFT
 RESISTANCE AT RAFTERS AND
- TRUSSES,
 REFER TO NOTES AND DETAIL
 SLEETS FOR ADDITIONAL
 STRUCTURAL INFORMATION

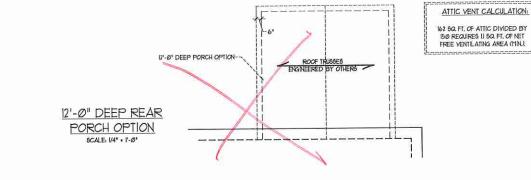

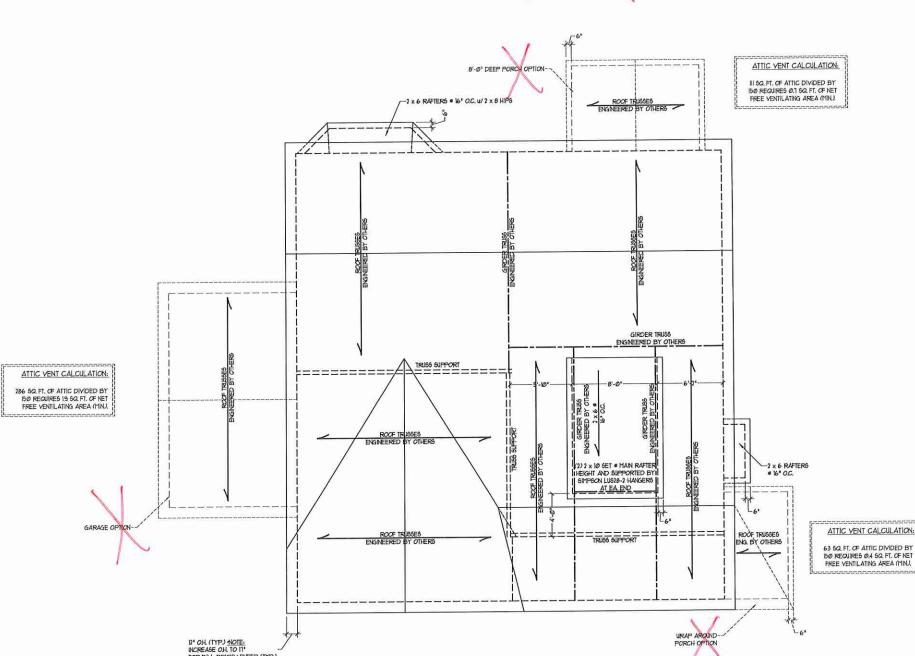



RENAISSANCE

RESIDENTIAL DESIGN, INC.

4610 GLEMMIST CT. | RALEKSH, NC 27612 (919) 649-4128 WWW.RRDCAROLINA.COM "The art of wansforming your vision into re alty



H&H HOMES, INC. KENT DRIVE LEFT

DATE: MARCH 27, 2019

REV.:

SCALE: 1/4*=1'-0*

DRAWN BY: WG

ENGINEERED BY:

REVIEWED BY:

ROOF PLAN **ELEVATION - B**

- SIDING AS SPEC.

6.但ATHNG

-61DNG AS SPEC.

64EATHNG

STARTER STREE

DETAIL

1-4"

TYPICAL SLAB DETAIL

DETAIL 3

WALL FRAMING AND TRID.— 5LL PLATE PER PLAN

TRID, BOTTON PLATE SECURED BY IN' DIA-BOLTS, IN' REDHEAD WICKORS, OR IN' SHYSON TIEN HO BOLDS WITHIN IN' OF EACH CORNER (TINNIAN OF TWO MICKORS PER PLATE SECTION). SEE CHART FOR SPACING MO BYBEDYBNI REQ.

4" CONCRETE SLAB-W REER RENFORCING


HL VAPOR BASSIES

TRID, BOTTON PLATE SECURED BY MY DIA-BOLTS, MY REDIEAD AYCHORS, OR MY STIPSON TITEN HO BOLTS WITH MY OF EACH CORNER WINNING OF TWO AYCHOS FER PLATE SECURAL SEE CHART FOR SPACING AND BYDEDY DIT FEQ.

4" COMPACTED— WELL-DRANNG SOIL OR WASHED STOKE

4" COMPACTED-

MONOLITHIC SLAB DETAILS



TYPICAL STEM WALL DETAIL

(W/ OPTIONAL WATERTABLE)

OPTIONAL DETAIL I SILL PLATE FER FLAN IRID, BOTTOM PLATE SECURED BY IN' DIA-BOLTS OR THREADED RODS, WITHN II' OF EACH CORNER (TINNISH) OF TUD MICKORS FER PLATE SECTION, SEE CHART FOR SPACING AND EMBEDTENT REQ. SEATHING -NOTCH BRICK FER DETAIL &, SEE THREADED ROD THROUGH BRICK DETAIL 4" LEDGE (I) ADDITIONAL LADDER

VERY BELOW TOP BRICK

SO Z COURSE CAST NTO SLAB 6 ML VAPOR BARRER 4" COMPACTED-UELL-DRANNG SOL OR UASHED STONE FINSHED GRADE -LADDER WRE EVERY OTHER COURSE B' CHI BLOCK TOP TWO COURSES OF STEM WALL AND ALL CELLS W REINF, TO BE GROUTED SOLID 6' UDE BY 8' DEEP

OPTIONAL STEM WALL DETAIL

DETAIL 3

-SIDING AS SPEC

LADDER WIRE EVERY OTHER COURSE

e' CHI BLOCK

BULL FRAMING AND TRID.— SILL PLATE PER PLAN

TILL PLAIF FER PLAIN

INTO BOTTOM PLAIF SECURED BY IA DIA—
BOLTS OR THEADOR ROOS, WITHIN IT OF
EACH CORRER (MINIMUM OF TWO MOCHORS
FER PLAITE SECTION). SEE CHART FOR
SEACHS NO DEPETCENT FEQ.

4' COMPACTED

UNDISTURBED EARTH-COMPACTED FILL OR WASHED STOKE

OR WASHED STONE

DETAIL 4 TRID, BOTTOM PLATE SECURED BY M' DIA-BOLTS, M' REDHEAD ANCHORS, OR M' SYMPSON TITEN HD BOLTS WITHIN B' OF EACH LEEP HOLES FNSHL

GRADE

LEEDINGE GRADE

LEEDINGE GRADE 4" COMPACIED— UELL-DRANNG SOIL OR WASHED STORE

DETAIL 2

BRICK VENEER DETAIL

PWKCK TIES .

-4" BRICK VENEER

H ASIDIS

SEEP HOLES

5' LEDGE

UALL FRAMING AND TRID: SILL PLATE PER PLAN

INID, BOTTOT FLATE SECURED BY M* DIA— BOLTS, M* PEDIEAD ANCHORS, OR M* SYPSON TITEN HO BOLTS WITH BY OF EACH CONER MINISTH OF THE ANCHORS FER FLATE SECTION SEE CHART FOR SPACHIS AND TREATMENT FOR A* CONCRETE SLAD— WHERE REPORTS

4" COMPACTED

WELL-DRAINING SOIL


OR WASHED STONE

GARAGE CURB BRICK LEDGE DETAIL GARAGE CURB DETAIL

DETAIL 2 WALL FRAMING AND TRITO-SILL PLATE FER PLAN TRID. BOTTOM PLATE SECURED BY IN' DIA-BOLTS OR THREADED ROOS, WITHIN IN' OF EACH CORBER TRINING TO UN ANCHORS' FER PLATE SECTION, SEE CHART FOR SPACING AND EMBEDDMENT REQ. -4" BRICK YENEER -FLASHING 6 ML VAPOR BARRER 4" COMPACTED-WELL-DRANNG SOIL OR WASHED STONE UNDISTURBED EARTH-COMPACTED FILL OR -D' CHI BLOCK -20" WIDE BY 8" DEEP CONT, CONC. FTG. WALL AND ALL CELLS U/ REINF. TO BE GROUTED SOLID.


TYPICAL STEM WALL FND. W/ BRICK DETAIL

TYPICAL STEM WALL FND. DETAIL W/ CURB @ GARAGE



TRID, BOTTOM PLATE SECURED BY IN' DIA-BOLTS, IN' REDHEAD ANGLORS, OR IN' SMPSON TITEN HD BOLTS WITHN IN' OF EACH " CONCRETE SLAB IN FIBER RENFORCE 10' 6' STEP IN GARAGE DETAIL


DETAIL 6




THICKENED SLAB DETAIL

OPTIONAL DETAIL 3 2 x 6 WALL FRAMING AND TRID: SILL PLATE FER PLAN -SIDING AS SPEC. 4" CONCRETE SLAB-UV FIDER REINFORCING OR UELDED LINE FABRIC FINSHED GRADE 4" COMPACTED UELL-DRAINING SOIL OR WASHED STOKE -LADDER WRE EVERY OTHER COURSE UNDISTURBED EARTH, COMPACTED FILL OR UASHED STONE -8" CHILBLOCK

OPTIONAL STEM WALL FND. DETAIL W/ CURB @ GARAGE



TYPICAL STEM WALL FND. DETAIL W/ BRICK AND CURB @ GARAGE



MASONRY STEMWALL SPECIFICATIONS

WALL HEIGHT (FEET)	MASONRY WALL TYPE			
	8" CTN	4" BRICK AND 4" CMJ	4" BRICK AND 8" CMJ	iz" CHN
2 AND BELOW	UNGROUTED	GROUT SOLID	UNGROUTED	UNGROUTED
3	UNGROUTED	GROUT SOLID	UNGROUTED	UNGROUTED
4	GROUT SOLID	GROUT SOLID w/ 14 REBAR # 48" O.C.	GROUT SOLID	GROUT SOLID w/ 14 REBAR # 64" O.C.
Б	GROUT SOLID w/ *4 REBAR # 36* O.C.	NOT APPLICABLE	GROUT SOLID u/ "4 REBAR # 36" O.C.	GROUT SOLID u/ 14 REBAR # 64" O.C.
6	GROUT SOLID u/ *4 REBAR # 24* O.C.	NOT APPLICABLE	GROUT SOLID u/ 14 REBAR # 24" O.C.	GROUT SOLID u/ 14 REBAR # 64" O.C.
1 AND GREATER	ENGINEERED DESIGN BASED ON SITE CONDITIONS			

STRUCTURAL NOTES:

WALL HEIGHT MEASURED FROM TOP OF FOOTING TO TOP OF THE WALL. TIE MALTIFLE WITHES TOGETHER WITH LADDER WIRE AT 16° OC. VERTICALLY. CHART APPLICABLE FOR HOUSE FOUNDATION CALLY, CONSULT ENGINEER FOR DESIGN OF GARAGE

3. CHART APPLICABLE FOR HOUSE FOUNDATION CALT, CONSULT INSINEER FOR DESIGN OF GARACEE FOUNDATION NOT CONTROL TO HOUSE.

4. BACKFILL OF CLEAN 59.1 / 69 WASHED STONE IS ALLOWABLE.

5. BACKFILL OF WELL DRANED OR SAND - GRAVEL MIXTURE SOILS (45 PSF-8T BELOW GRADE) CLASSFIED AS GROUP I ACCORDING TO INFIED SOILS (45 PSF-8T BELOW GRADE) CLASSFIED AS GROUP I ACCORDING TO INFIED SOILS (45 PSF-8T BELOW GRADE) CHASTELD AND FEW BACKFILL OF THE 2018 INTERNATIONAL RESIDENTIAL CODE ARE ALLOWABLE.

6. PERP SLAS PER RESIDE LENGTH.

8. WHERE REGUIPED, FILL BLOCK SOLID WITH TIFFE "S" MORTAR OR 3000 PSI GROUT, USE OF "LOW LIFT GROUTING" METHOD REQUIRED WHEN FILLING WALLS WITH GROUT AT HEIGHTS OF 5" AND GREATER.

AN	ICHOR SPACING AND	D EMBEDMENT
WIND ZONE	120 MPH	130 MPH
SPACING	6'-0" O.C.	4"-Ø" O.C.
EMBEDMENT	1'	15" INTO MAGONRY 1" INTO CONCRETE

O N 127605 0 Q (619) 0 FAX: 61 M R R 789.991 II. S WADE A

Z % > W

0

YAXXAXXAXXXXXXXXX

SPEED WIND E DESIGN DETAILS ULTIMATE I NDATION D 130 MPH. 120

DATE SOVEMBER 14 2018 SCALE NTS DRAWN BY: JST NGINEERED BY, JES

D-1 FOUNDATION DETAILS



- L WALL BRACING DESIGNED IN ACCORDANCE WITH CHAPTER 6 OF THE 2018 NO RESIDENTIAL BUILDING CODE (NORC). TABLES AND FIGURES REFERENCED ARE FROM THE 2018 NCRC.
- TABLES AND FRANCE RETERENCED ARE TRAIT HE 2000 NORSE.


 SEE THIS SHEET FOR GENERAL DETAILS, REFER TO THE 2000 NORSE FOR ADDITIONAL INFORMATION AS NEEDED.


 SEE STRUCTURAL SHEETIS FOR BRACED WALL LOCATIONS, DIPOSIONS, HOLD DOWN TYPE AND LOCATIONS, BRACED WALL
 LINE KEY WITH WALL DESIGN SUMMARY OF REQUIRED/PROVIDED TOTALS FOR EACH WALL LINE AND ANY SPECIAL NOTES
 OF DEPAULICEMENTS.
- OR REQUIREMENTS.


 4. ALL EXTERIOR WALLS ARE TO BE SHEATHED WITH CS-WSP IN ACCORDANCE WITH SECTION R607.03 UNLESS NOTED
- 5. ALL EXTERIOR AND INTERIOR WALLS TO HAVE IN! GYPSUM INSTALLED, WHEN NOT USING METHOD "GB", GYPSUM TO BE FASTENED PER TABLE R10235, METHOD GB TO BE FASTENED PER TABLE R602J0J
- FASTENED FOR TABLE RIM335, NETHOD GB TO BE FASTENED FOR TABLE RIM3180, BY TABLE RIM3180, BY THE CONTINUES RELEATING & LOUDO PRINCIPLEAR PARLES WALL BRACKING PETHOD. 176° 05B SHEATHING IS TO BE INSTALLED ON ALL EXTERIOR WALLS ATTACHED W 6d COTHON NAILS OR BD (2 LOV X 01B) DIAMPERS NAILS SPACED 6° 0C. ALONE PARLE LOCKES AND 10° 0C. IN THE FIELD OUND).


 1. GB REFERS TO THE "GYPRUM BOARD" WALL BRACKING METHOD. 12° (THIN GYPRUM BUALL BOARD IS TO BE INSTALLED ON BOTH SIDER OF THE BRACED WALL BASINED WITH 14" SCREW OR IS BN MAILS PARCED 1"O. ALONE PAREL EDGES INCLIDING TOP AND BOTTOM PLATES AND INTERPEDIATE SUPPORTS (UND.). VEREY ALL FASTENER OPPICES FOR 12° AND 5/8" GYPSIM PRIOR TO CONSTRUCTION, FOR INTERIOR FASTENER OPTIONS SEE TABLE RT0235. FOR EXTERIOR FASTENER OPTIONS SEE TABLE R6/013(1). EXTERIOR GB TO BE INSTALLED VERTICALLY.
- OF THAN SEE THESE PROMUNIC EXTENSIVED TO BE NO FALLED VENTICALLT.

 RECUIRED BRACED WALL LENGTH FOR EACH SIDE OF THE CIRCUMSCRIBED RECTAYGLE ARE INTERPOLATED FER TABLE RESOL. 103, METHOD CS-USP CONTRIBUTES TO ACTUAL LENGTH, AND METHOD FF CONTRIBUTES TO THESE THE ACTUAL LENGTH, AND METHOD FF CONTRIBUTES TO THESE THE ACTUAL LENGTH.

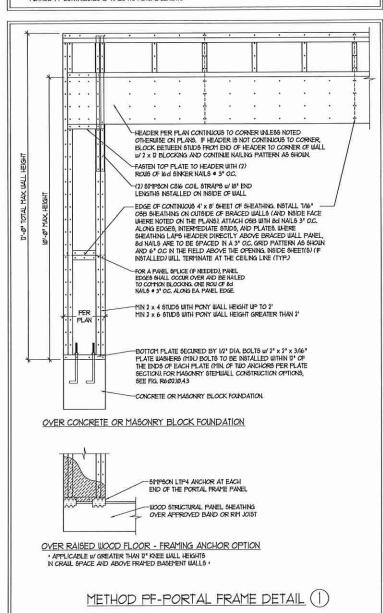


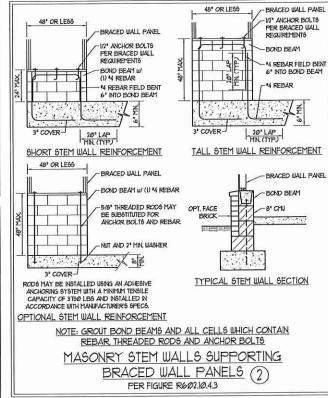

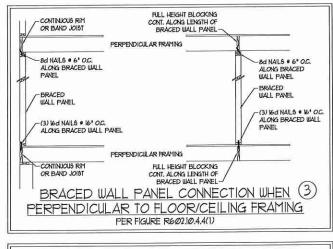

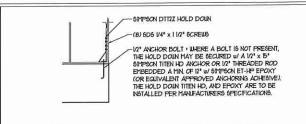

HOLD DOWN DETAIL FOR MASONRY FOUNDATION OR MONOLITHIC SLAB · APPLICABLE ONLY WHERE SPECIFIED ON PLAN ·

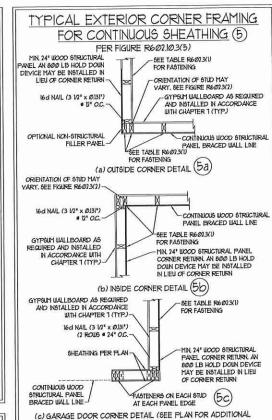



STRUCTURAL INFORMATION OR ALTERNATE CONFIGURATIONS)


This sealed page is to be used in conjunction with a full plan set engineered by J.S. Thompson Engineering, Inc.


only. Use of this individual sealed page within

architectural pages or shop drawings by others is a punishable offense under N.C. Statute § 89C-23





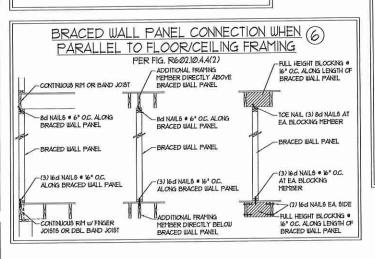



SPEED WIND DESIGN S MPH ULTIMATE I BRACING NOTES

D-7 BRACED WALL





Z 27605

3

0

DATE: NOVEMBER 14, 2018 SCALE: 1/4" - 110" DRAWN BY: JST

NGINEERED BY: JST

MPH - 130 | WALL I

20

NOTES AND DETAILS AND PF DETAIL

Obtain and Noterickin stand Noterickandard Structural Notes 10-18 days 18/14/2018 12:53:43 FM, Whitney Radinor 35 Thompson Engineering Fix

- ENGINEER'S SEAL APPLIES ONLY TO STRUCTURAL COMPONENTS INCLUDING ROOF RAFTERS, HIPS, VALLEYS, RIDGES, FLOORS, WALLS, BEAMS, HEADERS, COLUNS, CANTILEVERS, OFFST LOAD BEARNS WALLS, PIERS, GIRDER SYSTEM AND FOOTNS. ENSINEER'S SEAL DOES NOT CERTIFY DIMENSIONAL ACCURACY OF ARCHITECTURAL LAYOUT NOLUDING ROOF. ENSINEER'S SEAL DOES NOT APPLY TO 1-JOIST OR FLOOR/ROOF TRUSS
- 2. ALL CONSTRUCTION SHALL CORPORM TO THE LATEST REQUIREMENTS OF THE NORTH CAROLINA RESIDENTIAL CODE (NCRC), 2018 EDITION, PLUS ALL LOCAL CODES AND REGULATIONS. THE STRUCTURAL ENGINEER IS NOT RESPONSIBLE FOR, AND WILL NOT HAVE CONTROL OF, CONSTRUCTION MEANS, METHODS, TECHNIQUES, GROUPLICES OR PROCEDURES, OR SAFETY PRECAUTIONS AND PROGRAMS IN CONNECTION WITH THE CONSTRUCTION WORK NOR WILL THE ENGINEER BE RESPONSIBLE FOR THE CONTRACTORS FAILURE TO CARRY OUT THE CONSTRUCTION WORK IN ACCORDANCE
- 3. STRUCTURAL DESIGN BASED ON THE PROVISIONS OF THE NCRC, 2018 EDITION (R3014 R301.7)

DESIGN CRITERIA:	LIVE LOAD (PSF)	DEAD LOAD (POF)	DEFLECTION (IN)
ATTIC WITH LIMITED STORAGE	20	Ю	L040 (L/360 W/ BRITTLE FINISHES)
ATTIC WITHOUT STORAGE	10	10	L/360
DECKS	40	10	L/360
EXTERIOR BALCONIES	40	10	L/36Ø
FIRE ESCAPES	40	10	L/360
HANDRAILS/GUARDRAILS	200 LB OR 50 (PLF)	10	L/360
PASSENGER VEHICLE GARAGE	50	Ø	L/360
ROOMS OTHER THAN SLEEPING ROOM	40	Ø	L/36Ø
SLEEPING ROOMS	30	Ø	L/36Ø
STAIRS	40	Ø	L/360
WIND LOAD	(BASED ON TABLE R3/212(4) WIND ZONE AND EXPOSURE)		
GROUND SNOW LOAD: Pa	20 (PSF)		

- I-JOIST SYSTEMS DESIGNED WITH IZ PSF DEAD LOAD AND DEFLECTION (IN) OF L/480
- FLOOR TRUSS SYSTEMS DESIGNED WITH IS PSF DEAD LOAD
- FOR 15 AND 120 MPH WIND ZONES, FOUNDATION ANCHORAGE IS TO COMPLY WITH SECTION R40316 OF THE NORC, 70/8 EDITION. FOR 130 MPH, 140 MPH, AND 150 MPH WIND ZONES, FOUNDATION ANCHORAGE IS TO COMPLY WITH SECTION 45/04 OF THE NORC, 2018 EDITION
- 5. ENERGY EFFICIENCY COMPLIANCE AND INSULATION VALUES OF THE BUILDING TO BE IN ACCORDANCE WITH CHAPTER II OF THE NCRC, 2018 EDITION.

FOOTING AND FOUNDATION NOTES

- I FOUNDATION DESIGN BASED ON A MINIMAN ALLOWABLE BEARING CAPACITY OF 2000 PSF. CONTACT GEOTECHNICAL ENGINEER IF BEARING
- 2 FOR ALL CONCRETE ALABA AND FOOTING THE AREA WITHIN THE PERMETER OF THE BUILDING ENVELOPE SHALL HAVE ALL VEGETATION, TOP FOR ALL CONCRETE SLADS AND POOTNAS, THE AREA WITHIN THE PERIMETER OF THE BUILDING STYLEOFE SHALL NAVE ALL YESSELATION, OF SOIL AND POPERISH MATERIAL REMOVED. FILL MATERIAL SHALL BE FREE OF VEGETATION AND FOREIGN MATERIAL. THE FILL SHALL BE COMPACTED TO ASSURE UNFORM SUPPORT OF THE SLAB, AND EXCEPT WHERE APPROVED, THE FILL DEPTHS SHALL NOT EXCEED 24" FOR CLEAN SAND OR GRAVEL. A 4" THICK BASED COURSE CONSISTING OF CLEAN GRADED SAND OR GRAVEL SHALL BE PLACED. A BASE CURRED IS NOT REQUIRCE UNFERS A CONCRETE SLAB IS NOTALLED ON WELL-DRAINED OR SAND-GRAVEL MIXTURE SOILS CLASSIFICATION SYSTEM IN ACCORDANCE WITH TABLE R4051 OF THE INTER, 2018 CELASSIFICATION SYSTEM IN ACCORDANCE WITH TABLE R4051 OF THE INTER, 2018 CELASSIFICATION SYSTEM IN ACCORDANCE WITH TABLE R4051 OF THE INTER, 2018 CELASSIFICATION SYSTEM IN ACCORDANCE WITH TABLE R4051 OF THE INCRE, 2018 CELASSIFICATION SYSTEM IN ACCORDANCE WITH TABLE R4051 OF THE INCRE, 2018 CELASSIFICATION.
- 3. PROPERLY DEWATER EXCAVATION PRIOR TO POURING CONCRETE WHEN BOTTOM OF CONCRETE SLAB 15 AT OR BELOW WATER TABLE. IF APPLICABLE, 3/4* I" DEEP CONTROL, JOINTS ARE TO BE SAUED WITHIN 4 TO 12 HOURS OF CONCRETE FINISHING AND WALL LOCATIONS HAVE BEEN MARKED. ADJUST WHERE NECESSARY
- 4. CONCRETE SHALL CONFORM TO SECTION R4092 OF THE NORC, 2018 EDITION. CONCRETE REINFORCING STEEL TO BE ASTM A615 GRADE 6:0.

 WELDED WIRE FABRIC TO BE ASTM A65. MAINTAIN A MINIMAM CONCRETE COVER AROUND REINFORCING STEEL OF 3" IN FOOTINGS AND 1/12" IN

 SLABS, FOR POURED CONCRETE WALLS, CONCRETE COVER FOR REINFORCING STEEL MEASURED FROM THE INSIDE FACE OF THE WALL SHALL

 NOT BE LESS THAN 1/12" FOR 75 BARS OR SMALLER AND NOT LESS THAN 2" FOR "65 BARS OR LARGER.
- 5. MASONRY UNITS TO CONFORM TO ACE 530/ASCE 5/TMS 402. MORTAR SHALL CONFORM
- 6. THE UNSUPPORTED HEIGHT OF MASONRY PIERS SHALL NOT EXCEED FOUR TIMES THEIR LEAST DIMENSION FOR UNFILLED HOLLOW CONCRETE MASONRY UNITS AND TEN TIMES THEIR LEAST DIMENSION FOR SOLID OR SOLID FILLED PIERS, PERS MY SE FILLED SOLID WITH CONCRETE OR TYPE H OR 8 HORTIAR PIERS AND WALLS SHALL BE CAPPED WITH 8" OF SOLID MASONRY.
- 1. THE CENTER OF EACH OF THE PIERS SHALL BEAR IN THE MIDDLE THIRD OF ITS RESPECTIVE FOOTING, EACH GIRDER SHALL BEAR IN THE MIDDLE THIRD OF THE PIERS.
- 8. ALL CONCRETE AND MASONRY FOUNDATION WALLS ARE TO BE CONSTRUCTED IN ACCORDANCE 3. ALL CONCRETE AND MASONRY FORMDATION WALLS ARE TO BE CONSTRUCTED IN ACCORDANCE WITH THE PROVISIONS OF SECTION RAVE OF THE NORS, 2008 EDITION OF IN ACCORDANCE WITH ACI 383, NCHA TREB-A OR ACE 530/IASCE 50719 402. MASONRY FORMDATION WALLS ARE TO BE REINFORCED FOR TABLE RAVELIN, RAVALUS, PROJULYS, PROJULYS, OR RAVALUS OF THE NORS, 2008 EDITION. STORDATION WALLS ARE TO BE REINFORCED FER TABLE RAVALUS OF THE NORS, 2008 EDITION. STORD CONTRETE FORMDATION WALLS ARE TO BE REINFORCED FER TABLE RAVALUS OF THE NORS, 2008 EDITION. STORD CONTRETE FORMDATION WALLS TO 2 x 6 FRAFED WALLS AT 16" OR. WHERE GRADE FERMITS (INDO.)

This sealed page is to be used in conjunction with a full plan set engineered by J.S. Thompson Engineering, Inc. only. Use of this individual sealed page within tural pages or shop drawings by others is a punishable offense under N.C. Statute § 89C-23

FRAMING NOTES

- L ALL FRAMING LUMBER SHALL BE 12 SPF MINIMUM (FIb = 815 PS), Fv = 315 PS), E = 16000000 PS() UNLESS NOTED OTHERUISE (UNO), ALL TREATED LIMBER SHALL BE 12 SYP MINIMIM (Fb = 915 PSI, FV = 115 PSI, E = 16000000 PSI) UNLESS NOTED OTHERWISE (UNO).
- 2. LAMNATED VENEER LUMBER (LVL) SHALL HAVE THE FOLLOWING MINIMUM PROPERTIES: Fo +2600 PSI, FV + 785 PSI, E + 19000000 PSI. LAMNATED STRAND LUMBER (LGL) SHALL HAVE THE FOLLOWING MINIMM PROPERTIES: Hb . 2325 PSI, Fv . 310 PSI, E . 8500000 PSI. PARALLEL STRAYD LIMBER (PSL) UP TO 1" DEPTH SHALL HAVE THE FOLLOWING MINIMUM PROPERTIES: Fo . 2500 PSI, E . 18000000 PSI PARALLEL STRAND LUMBER (PSL) MORE THAN 1" DEPTH SHALL HAVE THE FOLLOWING MINIMUM PROPERTIES: FC . 2900 PSI, E . 20000000 PSI INSTALL ALL CONNECTIONS PER MANUFACTURER'S SPECIFICATIONS.
- 3. STRUCTURAL STEEL SHALL CONFORM TO THE FOLLOWING ASTM SPECIFICATIONS

W AND WT SHAPES: CHANNELS AND ANGLES: **ASTM A997** PLATES AND BARS: ASTM A36 HOLLOW STRUCTURAL SECTIONS: ASTM A500 GRADE B ASTM A53, GRADE B, TYPE E OR S STEEL PIPE:

STEEL BEAYS SHALL BE SUPPORTED AT EACH BID WITH A MINIMM BEARNS, LENSTH OF 3 12" AND FULL FLANSE WIDTH (INO). PROVIDE SOLID BEARNS FROM BEAY SUPPORT TO FOUNDATION. BEAYS SHALL BE ATTACHED AT THE BOTTOM FLANSE TO EACH SUPPORT AS

A WOOD FRAMING (2) 1/2" DIA x 4" LONG LAG SCREWS (2) 1/2" DIA x 4" WEDGE ANCHORS B. CONCRETE (2) V2" DIA x 4" LONG SIMPSON TITEN HD ANCHORS C. MASONRY (FULLY GROUTED)

LATERAL SUPPORT IS CONSIDERED ADEQUATE PROVIDING THE JOISTS ARE TOE NAILED TO THE 2x NAILER ON TOP OF THE STEEL BEAM, AND THE 2x NAILER IS SECURED TO THE TOP OF THE STEEL BEAM W (2) ROUS OF SELF TAPPING SCREWS ** IS** OC., OR (2) ROUS OF IS** DIAP'ETER BOLTS . IG. OC. IF IN. BOLTS ARE USED TO FASTEN THE NAILER, THE STEEL BEAM SHALL BE FABRICATED II/ (2) ROUS OF 9/16" DIAMETER

- 5. SQUARES DENOTE POINT LOADS WHICH REQUIRE SOLID BLOCKING TO GIRDER OR FOUNDATION, SHADED SQUARES DENOTE POINT LOADS FROM ABOVE WHICH REQUIRE SOLID BLOCKING TO SUPPORTING MEMBER BELOW.
- ALL LOAD BEARN'S HEADERS TO CONFORM TO TABLE REQUITED AND REQUITED OF THE NORC, 2019 EDITION OR BE (2) 2 x 6 WITH (II) JACK
 AND (I) KNYS STILD EACH END (INNO), UNICHEVER 19 GREATER ALL HEADERS TO BE SECURED TO EACH JACK STILD WITH (4) 8d NAILS. ALL BEANS TO BE SUFFORTED WITH (2) STUDS AT EACH BEARNS FONT (INO), INSTALL KING STUDS FER SECTION R6/02.15 OF THE NORTH CAROLINA RESIDENTIAL CODE, 2018 EDITION.
- ALL BEAYS, HEADERS, OR GIRDER TRUSSES PARALLEL TO WALL ARE TO BEAR RULLY ON (1) JACK OR (7) STUDS MINIMUM OR THE NUMBER OF JACKS OR STUDS NOTED. ALL BEAYS OR GIRDER TRUSSES PERPENDICULAR TO WALL AND SUPPORTED BY (3) STUDS OR LESS ARE TO HAVE I 1/2" MINMM BEARNS (UNO). ALL BEAMS OR GIRDER TRUSSES PERPENDICULAR TO WALL AND SUPPORTED BY MORE THAN (3) STUDS OR OTHER NOTED COLUMN ARE TO BEAR FULLY ON SUPPORT COLUMN FOR ENTIRE WALL DEPTH (UNO), BEAM ENDS THAT BUTT INTO ONE NOTHER ARE TO EACH BEAR EQUAL LENGTHS (UNO).
- 8. FLITCH BEAMS SHALL BE BOLTED TOGETHER USING IO! DIAMETER BOLTS (ASTM ASOT) WITH WASHERS PLACED AT THREADED END OF BOLT. BOLTS SHALL BE SPACED AT 24" CENTERS (MAXIMUM), AND STAGGERED AT TOP AND BOTTOM OF BEAM (2" EDGE DISTANCE), WITH (2) BOLTS LOCATED AT 6' FROM EACH END (UNO).
- ALL I-JOIST OR TRUSS LAYOUTS ARE TO BE IN COMPLIANCE WITH THE OVERALL DESIGN SPECFIED ON THE PLANS. ALL DEVIATIONS ARE TO BE BROUGHT TO THE ATTENTION OF THE ENGINEER OF RECORD PRIOR TO INSTALLATION
- 10. BRACED WALL PANELS SHALL BE CONSTRUCTED ACCORDING TO THE NORTH CAROLINA RESIDENTIAL CODE 2018 EDITION WALL BRACING CRITERIA THE AMOINT, LENGTH, AND LOCATION OF BRACING SHALL COMPLY WITH ALL APPLICABLE TABLES IN SECTION R602.10
- PROVIDE DOUBLE JOIST UNDER ALL WALLS PARALLEL TO FLOOR JOISTS. PROVIDE SUPPORT UNDER ALL WALLS PARALLEL TO FLOOR RUSSES OR 1-JOISTS FER MANUFACTURER'S SPECIFICATIONS. INSTALL BLOCKING BETHEEN JOISTS OR TRUSSES FOR POINT LOAD SUPPORT
- FOR ALL HEADERS SUPPORTING BRICK YENEER THAT ARE LESS THAN 8'-0" IN LENGTH, REST A 6" x 4" x 5/16" STEEL ANGLE WITH 6" MINIMUM THE PRINT AT SIDES FOR BRICK SUPPORT (UND). FOR ALL HEADERS 3°-8° AND GREATER IN LENGTH, BOLT A 6° x 4" x 5/16" STEEL ANALE TO HEADER WITH 0" LAG SCREWS AT 10" OC. STAGGERED FOR BRICK SUPPORT, FOR ALL BRICK SUPPORT AT ROOF LINES, BOLT A 6" x 4" x 5/16" STEEL ANGLE TO (2) 2 x 10 BLOCKING INSTALLED W (4) 12d NAILS EA PLY BETWEEN WALL STUDS WITH (2) ROUG OF 1/2" LAG SCREWS AT 12" O.C. STAGGERED AND IN ACCORDANCE WITH SECTION R103.82.1 OF THE NORC, 2018 EDITION
- B. FOR STICK FRAMED ROOFS: CIRCLES DENOTE (3) 2 x 4 POSTS FOR ROOF MEMBER SUPPORT. HIP SPLICES ARE TO BE SPACED A MINIMUM OF 8"-0"; FASTEN MEMBERS WITH TRIKEE ROUS OF I'D NALLS AT IS" OC. FRAME DORMER WALLS ON TOP OF DOUBLE OR TRIPLE RAFTERS AS
- 14. FOR TRUSSED ROOFS: FRAME DORMER WALLS ON TOP OF 2 x 4 LADDER FRAMING AT 24" O.C. BETWEEN ADJACENT ROOF TRUSSES. STICK PRAME OVER-FRAMED ROOF SECTIONS WITH 2 x 8 RIDGES, 2 x 6 RAFTERS AT 16" O.C. AND FLAT 2 x 10 VALLEYS (UNO).
- B. ALL 4 x 4 AND 6 x 6 POSTS TO BE INSTALLED WITH 1000 LB CAPACITY UPLIFT CONNECTORS TOP AND BOTTOM (UNO.) POSTS MAY BE SECURED USING ONE SPIPSON HE OR LISU LIFLET CONNECTOR FASTENED TO THE BAYD AT THE BOTTOM AND THE BEAM AT THE TOP OF EACH POST, ONE IS "SECTION OF SPIPSON CSIS COIL STRAPPING WITH (8) 8d HOG NAILS AT EACH END MAY BE USED IN LIEU OF EACH TUIST STRAP F DESIRED. FOR MASONRY OR CONCRETE FOUNDATION USE SIMPSON POST BASE.

YANYANYANYANYANY

SPEED WIND ON ULTIMATE DESIGN D STRUCTURAL NO - 130 MPH L STANDARE - 130 MPH 20

DATE: NOVEMBER 14, 2018 SCALE 1/4" + 1'0"

RAWN BY: JES INEERED BY: JST

S-0

STRUCTURAL NOTES

