

Harnett County Department of Public Health

PERMIT # SFDPA11-0001

Operation Permit

New Installation Septic Tank Nitrification Line Repair Expansion

PROPERTY LOCATION: 1050 Spring Hill Ch. Rd (SR 1238)

Name: (owner) Juliette Dezief SUBDIVISION _____ LOT # _____

System Installer: Ricky Holland (Precision Septic)


Basement with plumbing: Garage Number of Bedrooms 7

Type of Water Supply: Community Public Well Distance from well _____ feet

System Type: Type III 9 Types V and VI Systems expire in 5 years.

(In accordance with Table V a) _____ Owner must contact Health Department 6 months prior to expiration for permit renewal.

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and/Disposal, and all conditions of the Improvement Permit and Construction Authorization.

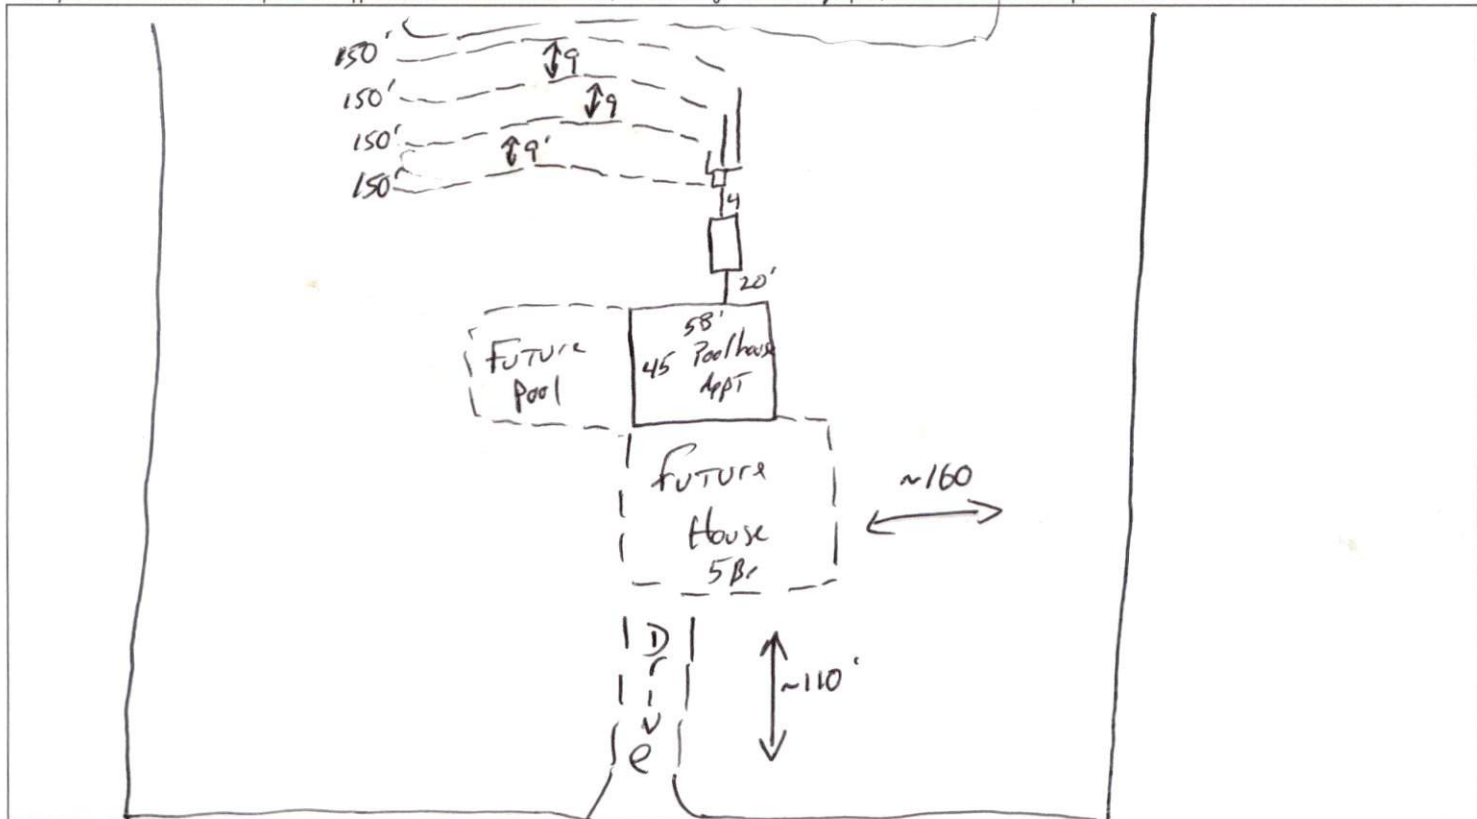

PERMIT CONDITIONS:

- I. Performance: System shall perform in accordance with Rule .1961.
- II. Monitoring: As required by Rule .1961.
- III. Maintenance: As required by Rule .1961. Other: _____
Subsurface system operator required? Yes No
If yes, see attached sheet for additional operation conditions, maintenance and reporting.
- IV. Operation: _____
- V. Other: _____

D-Box Pump Alarm H2O Line PWR Line

Following are the specifications for the sewage disposal system on the above captioned property.
 Type of system: Conventional Other 25% reduction (IQU) Septic Tank: 1520 gallons Pump Tank: _____ gallons
 Subsurface Drainage Field No. of ditches 4 exact length of each ditch 150 feet width of ditches 3 feet depth of ditches 23"-18" inches
 French Drain Required: _____ Linear feet

Authorized State Agent Moh A. El-H Date 8-24-21