

HTE# SFD 1911-0011

# Harnett County Department of Public Health

No. **26646**

PERMIT # \_\_\_\_\_

## Operation Permit

- New Installation
- Septic Tank
- Nitrification Line
- Repair
- Expansion

PROPERTY LOCATION: 79 GUYTON RD (301290)

Name: (owner) STEVE THOMAS SUBDIVISION \_\_\_\_\_ LOT # \_\_\_\_\_

System Installer: Danny Carlisle Registration # \_\_\_\_\_

Basement with plumbing:  Garage  Number of Bedrooms 3

Type of Water Supply:  Community  Public  Well Distance from well \_\_\_\_\_ feet


System Type: 25% (CONCRETE) System Type B6 Types V and VI Systems expire in 5 years.

(In accordance with Table V a)

Owner must contact Health Department 6 months prior to expiration for permit renewal.

Charles QUINN

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

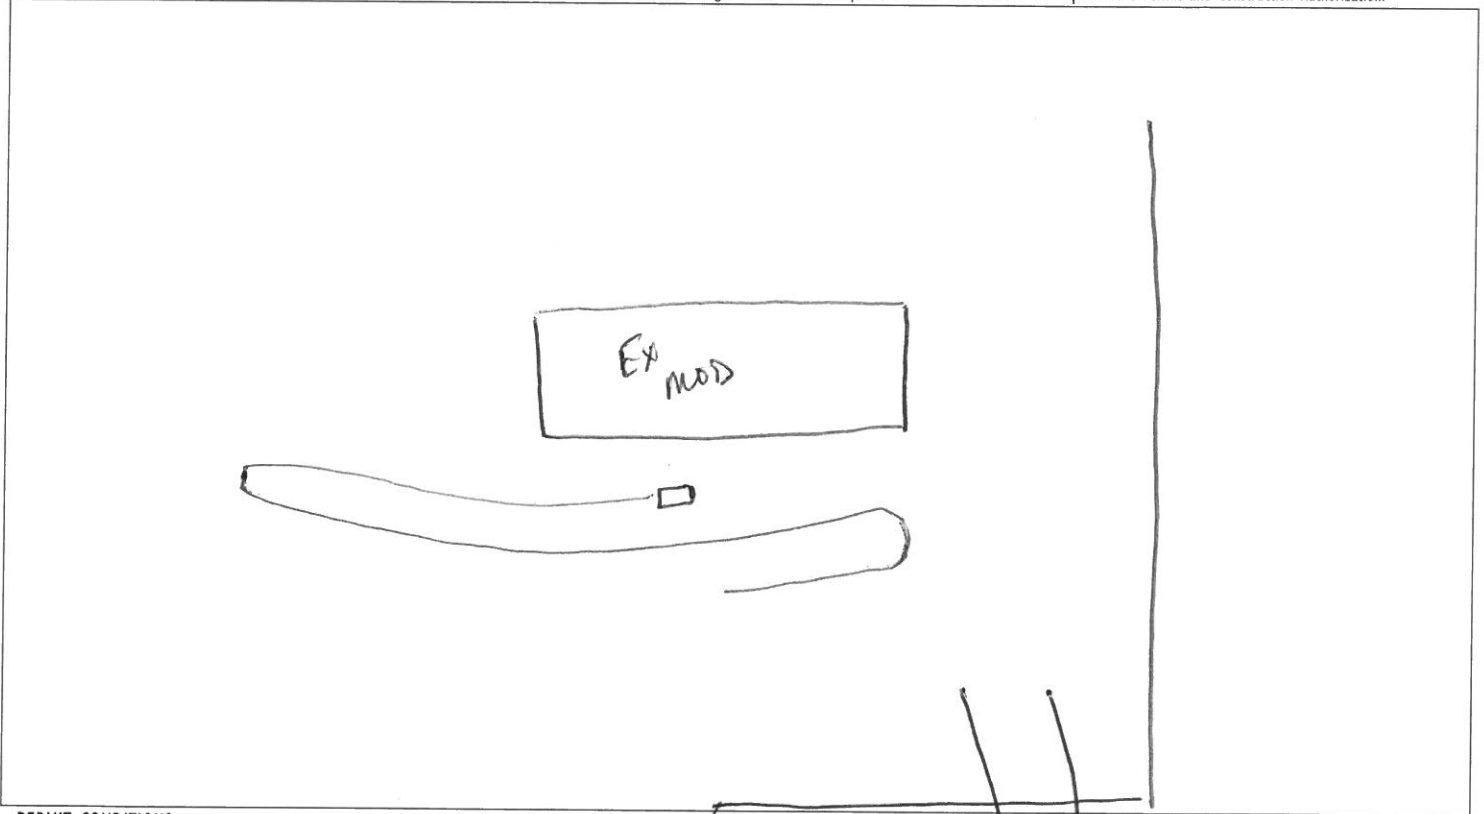

### PERMIT CONDITIONS:

I. Performance: System shall perform in accordance with Rule .1961.

II. Monitoring: As required by Rule .1961.

III. Maintenance: As required by Rule .1961. Other: \_\_\_\_\_

Subsurface system operator required? Yes  No

~~If yes, see attached sheet for additional operation conditions, maintenance and reporting.~~

IV. Operation: \_\_\_\_\_

V. Other: \_\_\_\_\_

- D-Box
- Pump
- Alarm
- H2O Line
- PWR Line

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system:  Conventional  Other 25% CONCRETE Septic Tank: 1000 gallons Pump Tank: \_\_\_\_\_ gallons

Subsurface Drainage Field No. of ditches 1 exact length of each ditch 240 feet width of ditches 3 feet depth of ditches 30-18 inches

French Drain Required: \_\_\_\_\_ Linear feet

Authorized State Agent James S. Martin Date 10-15-20