

Trenco
818 Soundside Rd
Edenton, NC 27932


Re: 20-045195F
MICHAEL JOHNSON/McKOY RESIDENCE

The truss drawing(s) referenced below have been prepared by Truss Engineering Co. under my direct supervision based on the parameters provided by Stock Building Supply.

Pages or sheets covered by this seal: T20340515 thru T20340522

My license renewal date for the state of North Carolina is December 31, 2020.

North Carolina COA: C-0844

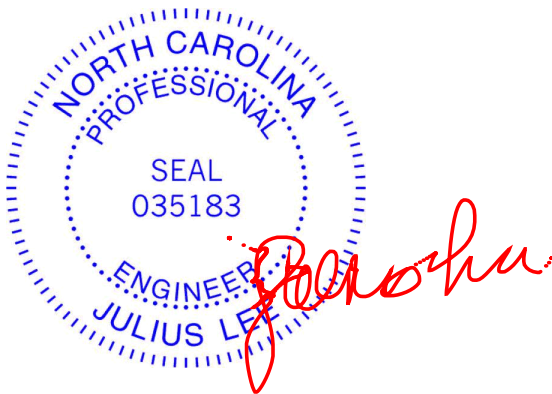

June 1, 2020

Lee, Julius


IMPORTANT NOTE: The seal on these truss component designs is a certification that the engineer named is licensed in the jurisdiction(s) identified and that the designs comply with ANSI/TPI 1. These designs are based upon parameters shown (e.g., loads, supports, dimensions, shapes and design codes), which were given to MiTek or TRENCO. Any project specific information included is for MiTek's or TRENCO's customers file reference purpose only, and was not taken into account in the preparation of these designs. MiTek or TRENCO has not independently verified the applicability of the design parameters or the designs for any particular building. Before use, the building designer should verify applicability of design parameters and properly incorporate these designs into the overall building design per ANSI/TPI 1, Chapter 2.

Job 20-045195F	Truss F01	Truss Type Floor	Qty 5	Ply 1	MICHAEL JOHNSON/McKOY RESIDENCE Job Reference (optional)	T20340515
-------------------	--------------	---------------------	----------	----------	---	-----------

BMC (Middlesex, NC), Middlesex, NC - 27557,

8.240 s Mar 9 2020 MiTek Industries, Inc. Mon Jun 1 10:50:54 2020 Page 1

ID:iqMLf0FP35O92HkawnsmqzGdq7-whrk3ZbhTdS9MJwvOR4hEzQoD4Qzu0Ehw1OwtzAgWV



0-1-8
Scale = 1:37.1

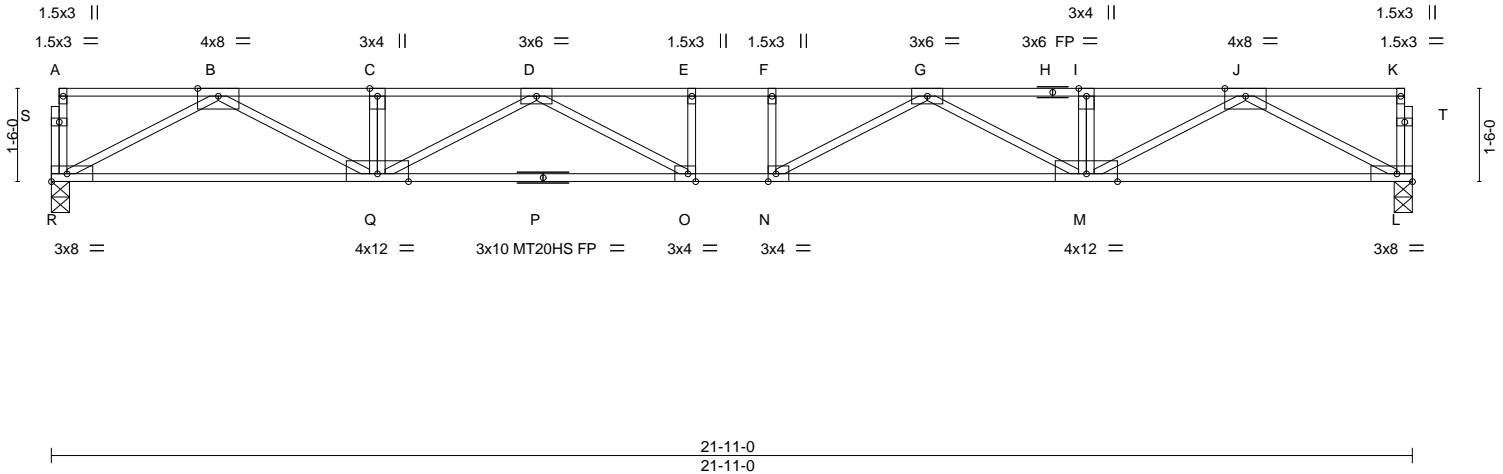


Plate Offsets (X,Y)--	[N:0-1-8,Edge], [O:0-1-8,Edge]				
LOADING (psf)	SPACING- 1-7-3	CSI.	DEFL. in (loc) l/defl L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL 1.00	TC 0.64	Vert(LL) -0.35 N-O >751 480	MT20	244/190
TCDL 10.0	Lumber DOL 1.00	BC 0.69	Vert(CT) -0.47 O >548 360	MT20HS	187/143
BCLL 0.0	Rep Stress Incr YES	WB 0.63	Horz(CT) 0.09 L n/a n/a		
BCDL 5.0	Code IRC2015/TPI2014	Matrix-S		Weight: 115 lb	FT = 20%F, 11%E


LUMBER-
TOP CHORD 2x4 SP No.2(flat)
BOT CHORD 2x4 SP 1650F 1.5E or 2x4 SP No.1 or 2x4 SP SS(flat)
WEBS 2x4 SP No.3(flat)

BRACING-
TOP CHORD Structural wood sheathing directly applied or 5-10-10 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (size) R=0-3-8, L=0-3-8
Max Grav R=948(LC 1), L=948(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD B-C=-2748/0, C-D=-2748/0, D-E=-3755/0, E-F=-3755/0, F-G=-3755/0, G-I=-2748/0, I-J=-2748/0
BOT CHORD Q-R=0/1589, O-Q=0/3455, N-O=0/3755, M-N=0/3455, L-M=0/1589
WEBS J-L=-1799/0, B-R=-1799/0, J-M=0/1315, B-Q=0/1315, G-M=-802/0, D-Q=-802/0, G-N=-63/602, D-O=-63/602

NOTES-
1) Unbalanced floor live loads have been considered for this design.
2) All plates are MT20 plates unless otherwise indicated.
3) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.

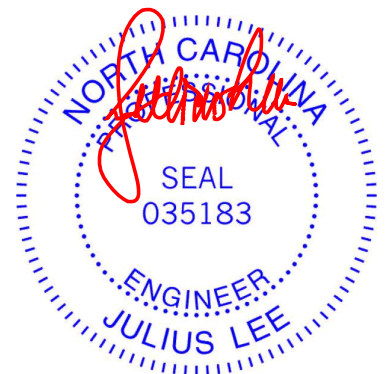

June 1, 2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 10/03/2015 BEFORE USE.
Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 218 N. Lee Street, Suite 312, Alexandria, VA 22314.




818 Soundside Road
Edenton, NC 27932

Job 20-045195F	Truss F02	Truss Type Floor	Qty 4	Ply 1	MICHAEL JOHNSON/McKOY RESIDENCE T20340516
-------------------	--------------	---------------------	----------	----------	--

BMC (Middlesex, NC), Middlesex, NC - 27557,

8.240 s Mar 9 2020 MiTek Industries, Inc. Mon Jun 1 10:50:55 2020 Page 1

ID:iqMLf0FP35O92HkawNsmqQzGdq7-OuP6HucJExa0_TU5x8bwmAzwXTICdR?q8FnxSjzAgWU

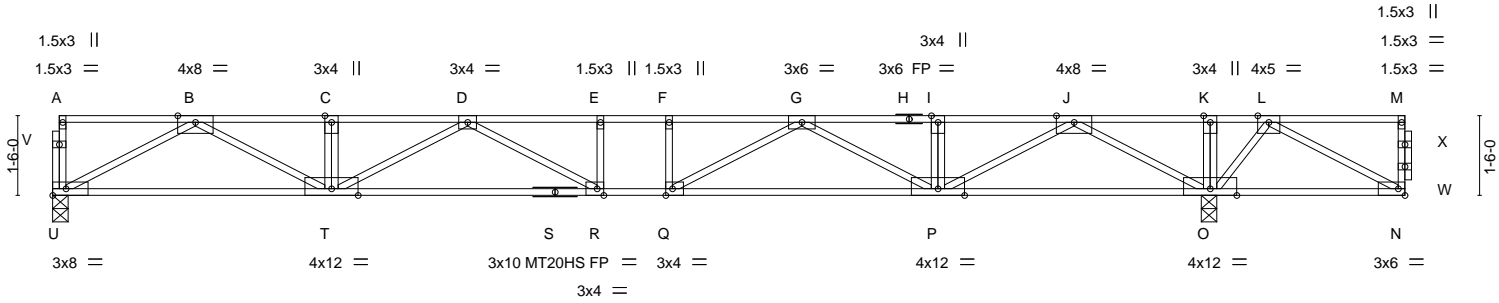

	21-9-8	21-11-0	25-7-0
	21-9-8	0-1-8	3-8-0

LOADING (psf)	SPACING-	1-7-3	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL	1.00	TC 0.86	Vert(LL)	-0.34	Q-R	>754	MT20	244/190
TCDL 10.0	Lumber DOL	1.00	BC 0.76	Vert(CT)	-0.46	R-T	>565	MT20HS	187/143
BCLL 0.0	Rep Stress Incr	NO	WB 0.72	Horz(CT)	0.08	O	n/a		
BCDL 5.0	Code IRC2015/TPI2014		Matrix-S						
								Weight: 136 lb	FT = 20%F, 11%E


LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2(flat)	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP 1650F 1.5E or 2x4 SP No.1 or 2x4 SP SS(flat)	BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.
WEBS 2x4 SP No.3(flat)	

REACTIONS. (size) U=0-3-8, O=0-3-8
Max Grav U=921(LC 3), O=1765(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD M-N=-482/0, B-C=-2649/0, C-D=-2649/0, D-E=-3545/0, E-F=-3545/0, F-G=-3545/0, G-I=-2422/378, I-J=-2422/378, J-K=0/1456, K-L=0/1456
BOT CHORD T-U=0/1540, R-T=0/3305, Q-R=0/3545, P-Q=-23/3180, O-P=-882/1215, N-O=-891/0
WEBS B-U=-1743/0, J-O=-1937/0, B-T=0/1258, J-P=0/1513, D-T=-745/1, G-P=-1006/0, D-R=-310/533, G-Q=0/852, F-Q=-269/0, L-N=0/1017, L-O=-891/0

- NOTES-**
- Unbalanced floor live loads have been considered for this design.
 - All plates are MT20 plates unless otherwise indicated.
 - Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - CAUTION, Do not erect truss backwards.
 - Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 400 lb down at 25-4-12 on top chord. The design/selection of such connection device(s) is the responsibility of others.
 - In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard
1) Dead + Floor Live (balanced): Lumber Increase=1.00, Plate Increase=1.00
Uniform Loads (plf)
Vert: N-U=-8, A-M=-80
Concentrated Loads (lb)
Vert: M=-400(F)

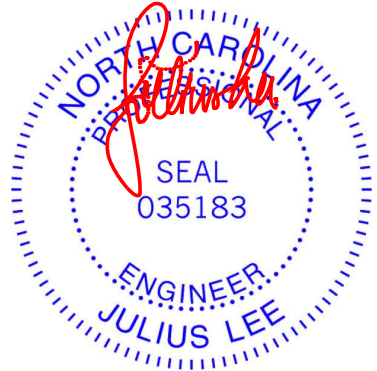



June 1, 2020

<p>WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 10/03/2015 BEFORE USE.</p> <p>Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information available from Truss Plate Institute, 218 N. Lee Street, Suite 312, Alexandria, VA 22314.</p>	<p>ENGINEERING BY TRENCO A MiTek Affiliate</p> <p>818 Soundside Road Edenton, NC 27932</p>
---	---

Job 20-045195F	Truss F03	Truss Type Floor	Qty 7	Ply 1	MICHAEL JOHNSON/McKOY RESIDENCE Job Reference (optional)	T20340517
-------------------	--------------	---------------------	----------	----------	---	-----------

BMC (Middlesex, NC), Middlesex, NC - 27557,

8.240 s Mar 9 2020 MiTek Industries, Inc. Mon Jun 1 10:50:56 2020 Page 1
ID:iqMLf0FP35O92HkawnSmqQzGdq7-s4yUUEdx?Eitbd3HVvs69JOV8Xt6QMwfvNwV?IzAgWT

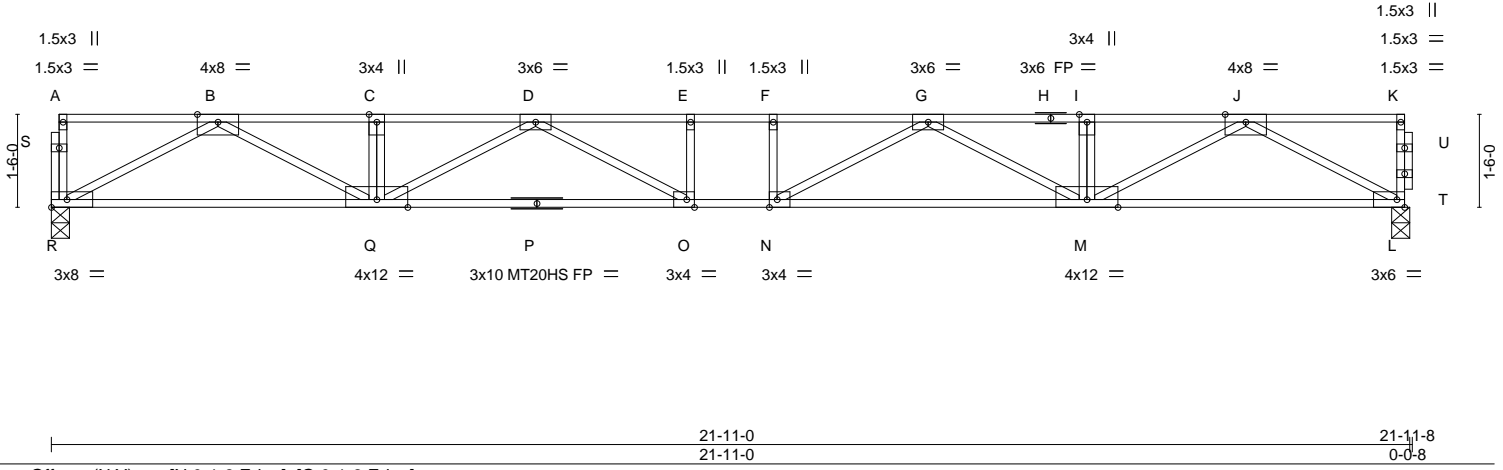


LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 40.0	Plate Grip DOL 1.00	TC 0.66	Vert(LL) -0.34 O >754 480	MT20 244/190	
TCDL 10.0	Lumber DOL 1.00	BC 0.69	Vert(CT) -0.47 O >548 360	MT20HS 187/143	
BCLL 0.0	Rep Stress Incr YES	WB 0.63	Horz(CT) 0.09 L n/a n/a		
BCDL 5.0	Code IRC2015/TPI2014	Matrix-S			Weight: 115 lb FT = 20%F, 11%E

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2(flat)	TOP CHORD Structural wood sheathing directly applied or 5-10-10 oc purlins, except end verticals.
BOT CHORD 2x4 SP 1650F 1.5E or 2x4 SP No.1 or 2x4 SP SS(flat)	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.3(flat)	


REACTIONS. (size) R=0-3-8, L=0-3-8
Max Grav R=947(LC 1), L=952(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD B-C=-2745/0, C-D=-2745/0, D-E=-3747/0, E-F=-3747/0, F-G=-3747/0, G-I=-2721/0, I-J=-2721/0
 BOT CHORD Q-R=0/1587, O-Q=0/3449, N-O=0/3747, M-N=0/3437, L-M=0/1555
 WEBS J-L=-1774/0, B-R=-1797/0, J-M=0/1324, B-Q=0/1313, G-M=-812/0, D-Q=-800/0, G-N=-55/612, D-O=-65/602

- NOTES-**
- Unbalanced floor live loads have been considered for this design.
 - All plates are MT20 plates unless otherwise indicated.
 - Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - CAUTION, Do not erect truss backwards.

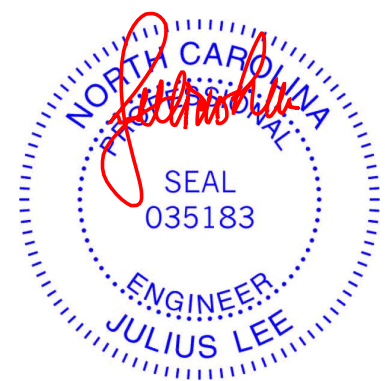

June 1, 2020

<p>WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 10/03/2015 BEFORE USE.</p> <p>Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information available from Truss Plate Institute, 218 N. Lee Street, Suite 312, Alexandria, VA 22314.</p>	<p>ENGINEERING BY</p>  <p>A MiTek Affiliate</p> <p>818 Soundside Road Edenton, NC 27932</p>
---	--

Job 20-045195F	Truss F04	Truss Type Floor	Qty 7	Ply 1	MICHAEL JOHNSON/McKOY RESIDENCE Job Reference (optional)	T20340518
-------------------	--------------	---------------------	----------	----------	---	-----------

BMC (Middlesex, NC), Middlesex, NC - 27557,

8.240 s Mar 9 2020 MiTek Industries, Inc. Mon Jun 1 10:50:57 2020 Page 1
ID:iqMLf0FP35O92HkawNsmqQzGdq7-LGWsiaeamYqkDneU3ZdOs2IMHQP5OZ7cZG2XBzAgWS

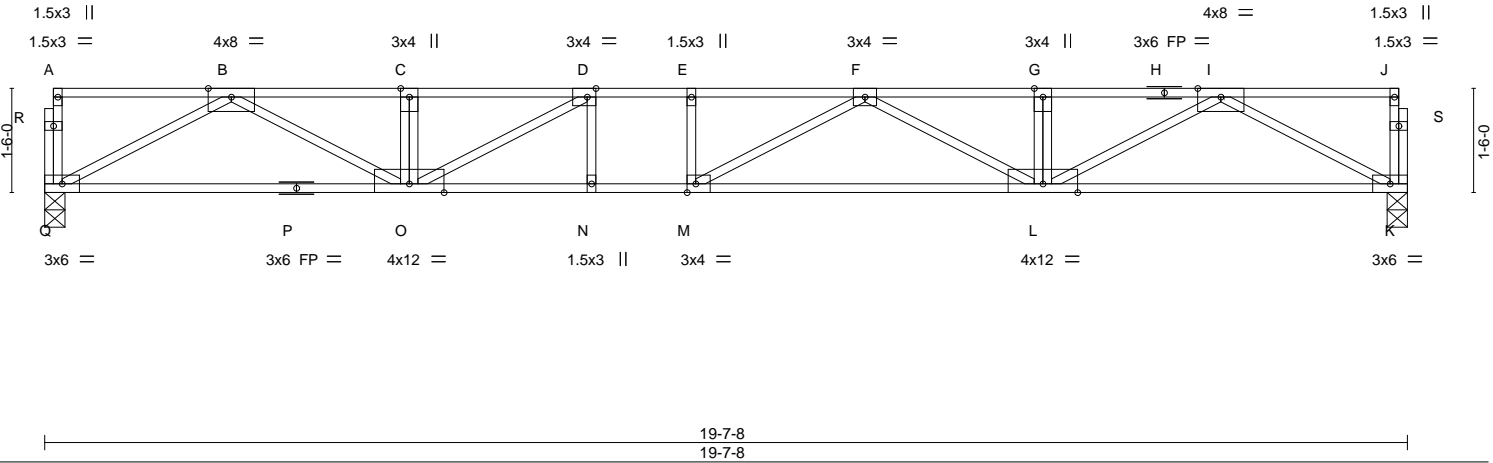



Plate Offsets (X,Y)--	[D:0-1-8,Edge], [M:0-1-8,Edge]								
LOADING (psf)	SPACING-	1-7-3	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL 1.00		TC 0.72	Vert(LL) -0.29	L-M >811	480		MT20	244/190
TCDL 10.0	Lumber DOL 1.00		BC 0.77	Vert(CT) -0.41	L-M >565	360			
BCLL 0.0	Rep Stress Incr YES		WB 0.52	Horz(CT) 0.06	K n/a	n/a			
BCDL 5.0	Code IRC2015/TPI2014		Matrix-S						
								Weight: 105 lb	FT = 20%F, 11%E

LUMBER-		BRACING-	
TOP CHORD	2x4 SP No.2(flat)	TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD	2x4 SP No.2(flat) *Except* K-P: 2x4 SP 1650F 1.5E or 2x4 SP No.1 or 2x4 SP SS(flat)	BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS	2x4 SP No.3(flat)		

REACTIONS. (size) Q=0-3-8, K=0-3-8
Max Grav Q=847(LC 1), K=847(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD B-C=-2362/0, C-D=-2362/0, D-E=-2957/0, E-F=-2957/0, F-G=-2376/0, G-I=-2376/0
BOT CHORD O-Q=0/1399, N-O=0/2957, M-N=0/2957, L-M=0/2894, K-L=0/1405
WEBS I-K=-1590/0, B-Q=-1584/0, I-L=0/1102, B-O=0/1093, F-L=-588/0, D-O=-805/0, F-M=-195/380

NOTES-
1) Unbalanced floor live loads have been considered for this design.
2) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.

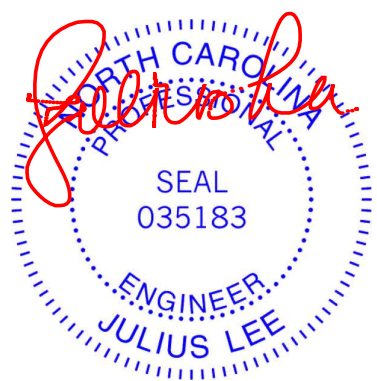


June 1, 2020

<p>WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 10/03/2015 BEFORE USE.</p> <p>Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information available from Truss Plate Institute, 218 N. Lee Street, Suite 312, Alexandria, VA 22314.</p>	<p>ENGINEERING BY TRENCO A MiTek Affiliate</p> <p>818 Soundside Road Edenton, NC 27932</p>
---	---

Job 20-045195F	Truss F05	Truss Type Floor	Qty 8	Ply 1	MICHAEL JOHNSON/McKOY RESIDENCE T20340519 Job Reference (optional)
-------------------	--------------	---------------------	----------	----------	--

BMC (Middlesex, NC), Middlesex, NC - 27557,

8.240 s Mar 9 2020 MiTek Industries, Inc. Mon Jun 1 10:50:57 2020 Page 1
ID:iqMLf0FP35O92HkawnsmqQzGdq7-LGWsiaeamYqkDneU3zdOsb2KcHOU5Pm7cZG2XBzAgWS



Scale = 1:32.5

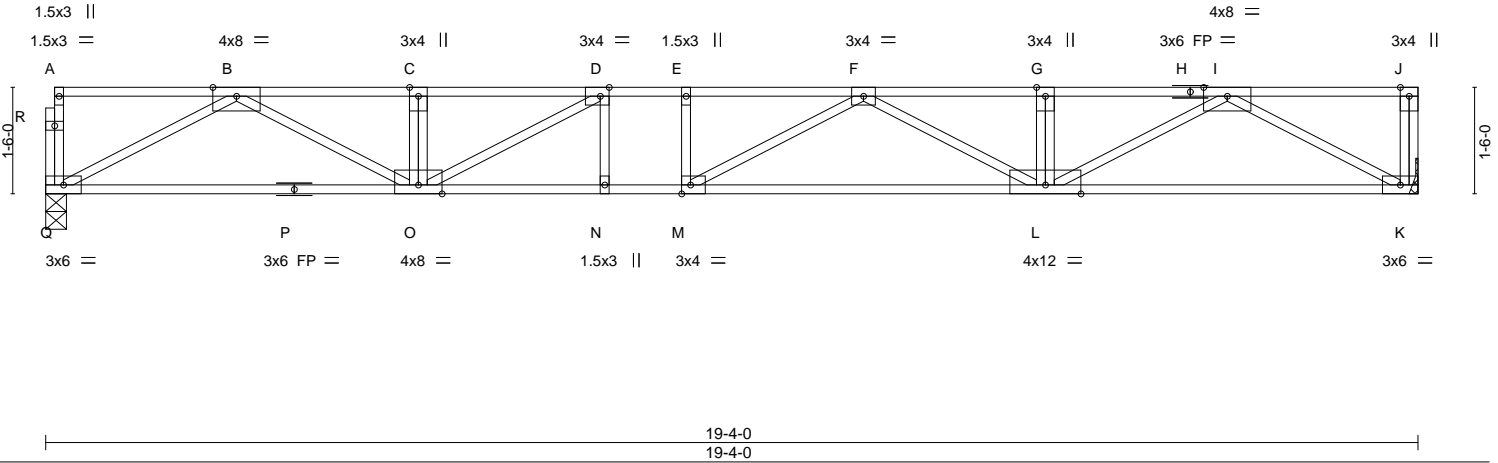


Plate Offsets (X,Y)--	D:0-1-8,Edge], [M:0-1-8,Edge]								
LOADING (psf)	SPACING-	1-7-3	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL 1.00		TC 0.64	Vert(LL) -0.26	L-M >891	480		MT20	244/190
TCDL 10.0	Lumber DOL 1.00		BC 0.96	Vert(CT) -0.37	L-M >613	360			
BCLL 0.0	Rep Stress Incr YES		WB 0.51	Horz(CT) 0.06	K n/a	n/a			
BCDL 5.0	Code IRC2015/TPI2014		Matrix-S						
								Weight: 104 lb	FT = 20%F, 11%E


LUMBER-
TOP CHORD 2x4 SP No.2(flat)
BOT CHORD 2x4 SP No.2(flat)
WEBS 2x4 SP No.3(flat)

BRACING-
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 2-2-0 oc bracing.

REACTIONS. (size) Q=0-3-8, K=Mechanical
Max Grav Q=834(LC 1), K=839(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD B-C=-2317/0, C-D=-2317/0, D-E=-2872/0, E-F=-2872/0, F-G=-2327/0, G-I=-2327/0
BOT CHORD O-Q=0/1375, N-O=0/2872, M-N=0/2872, L-M=0/2823, K-L=0/1382
WEBS I-K=-1568/0, B-Q=-1557/0, I-L=0/1074, B-O=0/1069, F-L=-562/0, D-O=-748/0, F-M=-204/352

- NOTES-**
- 1) Unbalanced floor live loads have been considered for this design.
 - 2) Refer to girder(s) for truss to truss connections.
 - 3) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - 4) CAUTION, Do not erect truss backwards.

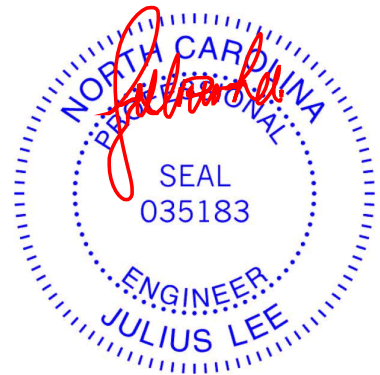

June 1, 2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 10/03/2015 BEFORE USE.
Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 218 N. Lee Street, Suite 312, Alexandria, VA 22314.

ENGINEERING BY
TRENCO
A MiTek Affiliate
818 Soundside Road
Edenton, NC 27932

Job 20-045195F	Truss KW01	Truss Type Floor Supported Gable	Qty 1	Ply 1	MICHAEL JOHNSON/McKOY RESIDENCE Job Reference (optional)	T20340520
-------------------	---------------	-------------------------------------	----------	----------	---	-----------


BMC (Middlesex, NC), Middlesex, NC - 27557,

8.240 s Mar 9 2020 MiTek Industries, Inc. Mon Jun 1 10:50:58 2020 Page 1
ID:iqMLf0FP35O92HkawnsmqQzGdq7-pT4FvwfCXsybrwDgdH8dOpbd1hxOqzVGrD?c3ezAgWR

0-1_H⁸

0-1_H⁸

Scale = 1:37.1

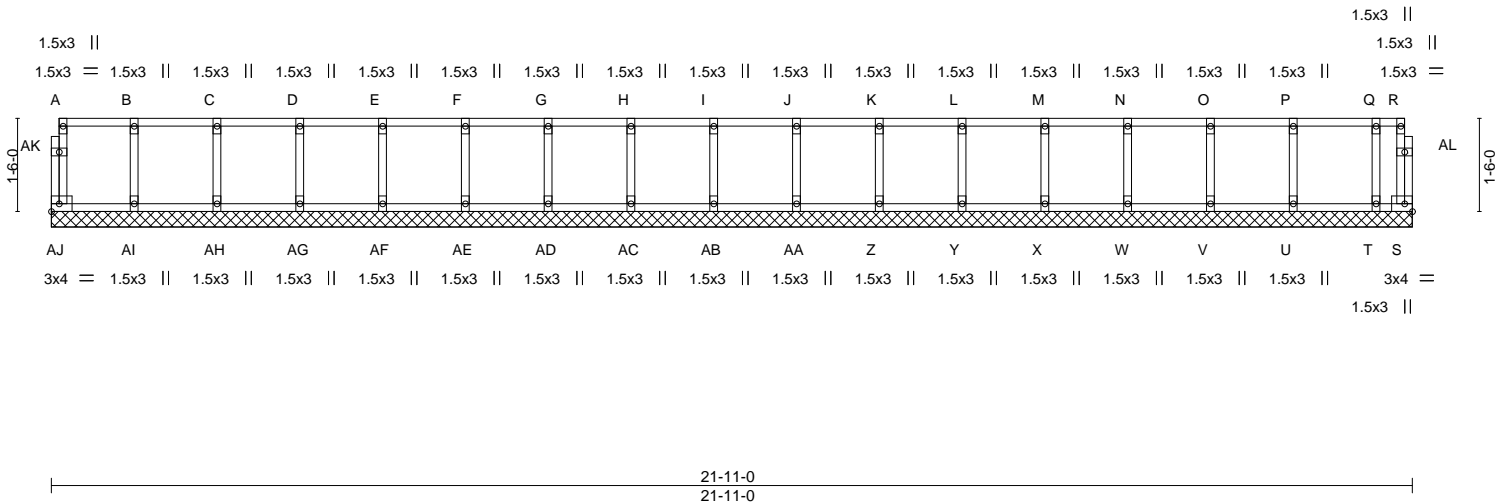

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL	1.00	TC 0.08	Vert(LL)	n/a	-	n/a	MT20	244/190
TCDL 10.0	Lumber DOL	1.00	BC 0.02	Vert(CT)	n/a	-	n/a		
BCLL 0.0	Rep Stress Incr	YES	WB 0.03	Horz(CT)	0.00	S	n/a		
BCDL 5.0	Code IRC2015/TPI2014		Matrix-R						
								Weight: 101 lb	FT = 20%F, 11%E


LUMBER-
 TOP CHORD 2x4 SP No.2(flat)
 BOT CHORD 2x4 SP No.2(flat)
 WEBS 2x4 SP No.2(flat) *Except*
 AJ-AK,S-AL: 2x4 SP No.3(flat)
 OTHERS 2x4 SP No.3(flat)

BRACING-
 TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. All bearings 21-11-0.
 (lb) - Max Grav All reactions 250 lb or less at joint(s) AJ, S, AI, AH, AG, AF, AE, AD, AC, AB, AA, Z, Y, X, W, V, U, T

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-
 1) Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
 2) Gable studs spaced at 1-4-0 oc.
 3) N/A
 4) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.

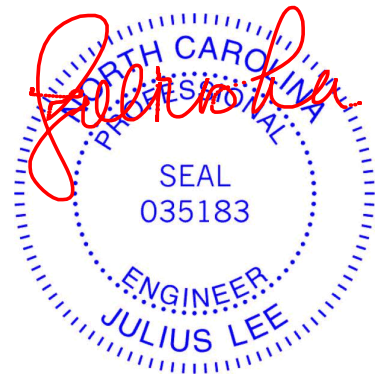

June 1, 2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 10/03/2015 BEFORE USE.
 Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 218 N. Lee Street, Suite 312, Alexandria, VA 22314.

ENGINEERING BY
TRENCO
 A MiTek Affiliate
 818 Soundside Road
 Edenton, NC 27932

Job 20-045195F	Truss KW02	Truss Type Floor Supported Gable	Qty 1	Ply 1	MICHAEL JOHNSON/McKOY RESIDENCE Job Reference (optional)	T20340521
-------------------	---------------	-------------------------------------	----------	----------	---	-----------


BMC (Middlesex, NC), Middlesex, NC - 27557,

8.240 s Mar 9 2020 MiTek Industries, Inc. Mon Jun 1 10:50:59 2020 Page 1
ID:iqMLf0FP35O92HkawnsmqQzGdq7-Hfed6Gfq194RS4osa_gsx07p75HnZQmQ3t19c4zAgWQ

0-1/8

0-1/8

Scale = 1:33.2

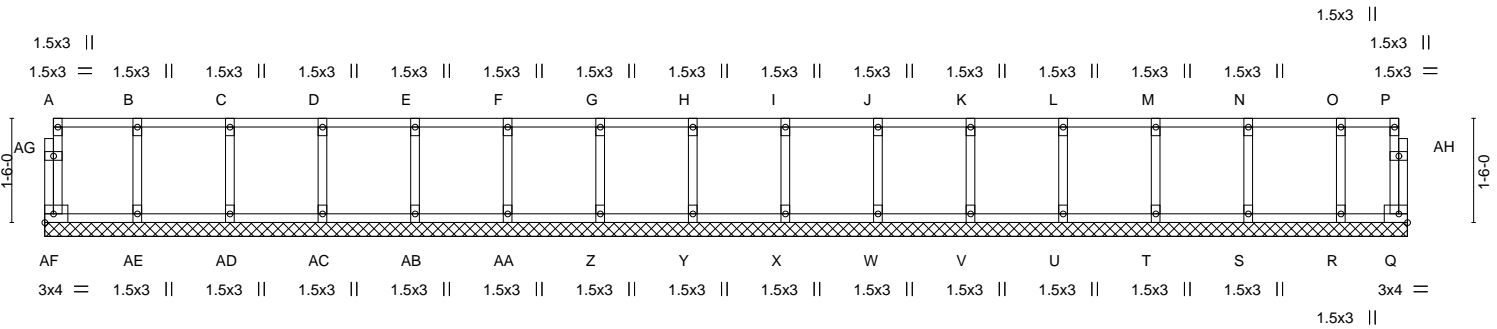

LOADING (psf)		SPACING-		CSI.		DEFL.				PLATES		GRIP	
TCLL	40.0	Plate Grip DOL	1.00	TC	0.06	in	(loc)	l/defl	L/d	MT20	244/190		
TCDL	10.0	Lumber DOL	1.00	BC	0.01	Vert(LL)	n/a	-	n/a				
BCLL	0.0	Rep Stress Incr	YES	WB	0.03	Vert(CT)	n/a	-	n/a				
BCDL	5.0	Code IRC2015/TPI2014		Matrix-R		Horz(CT)	0.00	Q	n/a			Weight: 91 lb FT = 20%F, 11%E	


LUMBER-
 TOP CHORD 2x4 SP 1650F 1.5E or 2x4 SP No.1 or 2x4 SP SS(flat)
 BOT CHORD 2x4 SP 1650F 1.5E or 2x4 SP No.1 or 2x4 SP SS(flat)
 WEBS 2x4 SP No.3(flat) *Except*
 A-AF,P-Q: 2x4 SP No.2(flat)
 OTHERS 2x4 SP No.3(flat)

BRACING-
 TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. All bearings 19-7-8.
 (lb) - Max Grav All reactions 250 lb or less at joint(s) AF, Q, AE, AD, AC, AB, AA, Z, Y, X, W, V, U, T, S, R

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-**
- 1) Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
 - 2) Gable studs spaced at 1-4-0 oc.
 - 3) N/A
 - 4) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.

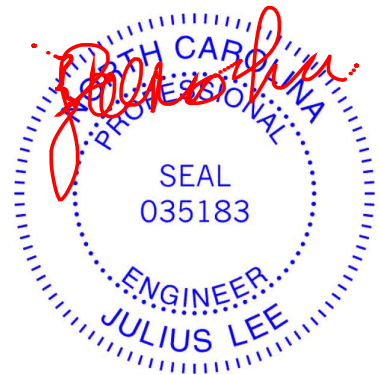

June 1, 2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 10/03/2015 BEFORE USE.
 Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 218 N. Lee Street, Suite 312, Alexandria, VA 22314.

ENGINEERING BY
TRENCO
 A MiTek Affiliate
 818 Soundside Road
 Edenton, NC 27932

Job 20-045195F	Truss KW03	Truss Type Floor Supported Gable	Qty 1	Ply 1	MICHAEL JOHNSON/McKOY RESIDENCE Job Reference (optional)	T20340522
-------------------	---------------	-------------------------------------	----------	----------	---	-----------


BMC (Middlesex, NC), Middlesex, NC - 27557,

8.240 s Mar 9 2020 MiTek Industries, Inc. Mon Jun 1 10:51:00 2020 Page 1

ID:iqMLf0FP35O92HkawNsmqZqGdq7-lrC?KcgS3TCI4EN3kiB5TEgzZUd?It0ZIXUi8WzAgWP

0-1-8

Scale = 1:11.5

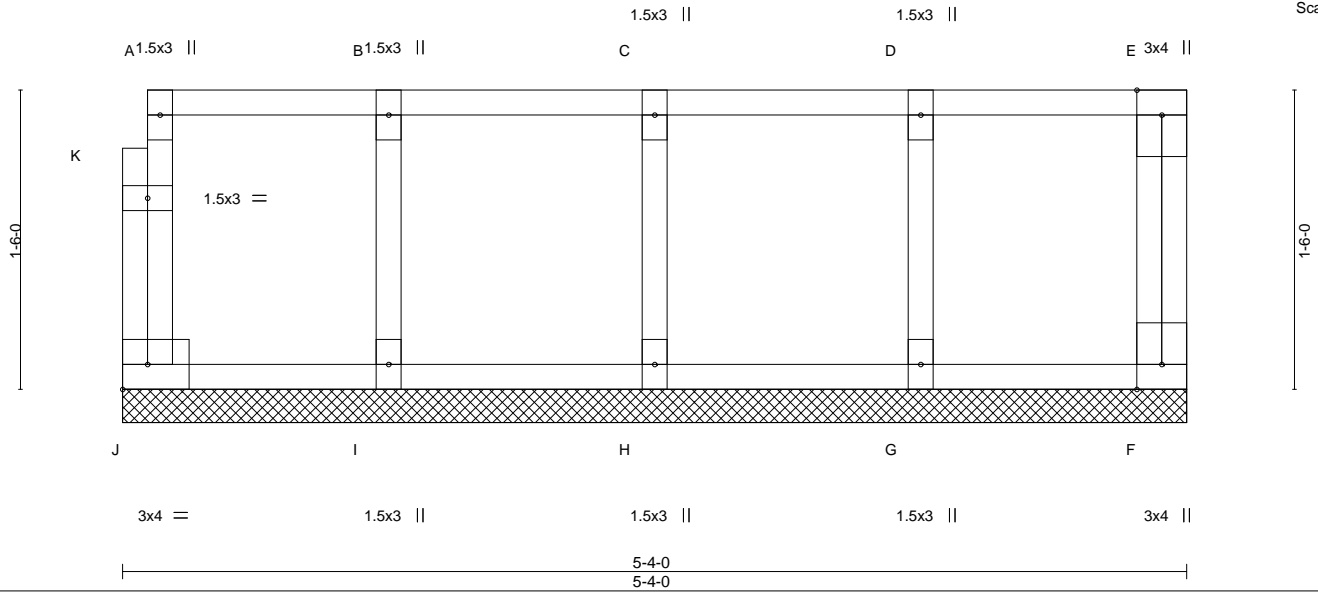

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL	1.00	TC 0.08	Vert(LL)	n/a	-	n/a	MT20	244/190
TCDL 10.0	Lumber DOL	1.00	BC 0.01	Vert(CT)	n/a	-	n/a		
BCLL 0.0	Rep Stress Incr	YES	WB 0.03	Horz(CT)	0.00	F	n/a		
BCDL 5.0	Code IRC2015/TPI2014		Matrix-R						
								Weight: 28 lb	FT = 20%F, 11%E


LUMBER-
TOP CHORD 2x4 SP No.2(flat)
BOT CHORD 2x4 SP No.2(flat)
WEBS 2x4 SP No.2(flat) *Except*
J-K: 2x4 SP No.3(flat)
OTHERS 2x4 SP No.3(flat)

BRACING-
TOP CHORD Structural wood sheathing directly applied or 5-4-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. All bearings 5-4-0.
(lb) - Max Grav All reactions 250 lb or less at joint(s) J, F, I, H, G

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-**
- 1) Gable requires continuous bottom chord bearing.
 - 2) Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
 - 3) Gable studs spaced at 1-4-0 oc.
 - 4) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - 5) CAUTION, Do not erect truss backwards.

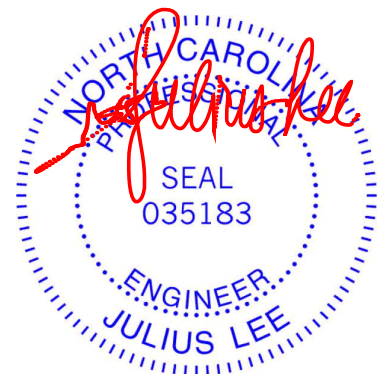

June 1, 2020




WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 10/03/2015 BEFORE USE.
Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 218 N. Lee Street, Suite 312, Alexandria, VA 22314.



818 Soundside Road
Edenton, NC 27932

Symbols

PLATE LOCATION AND ORIENTATION

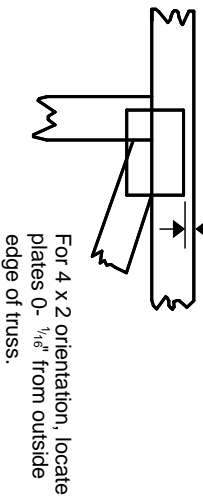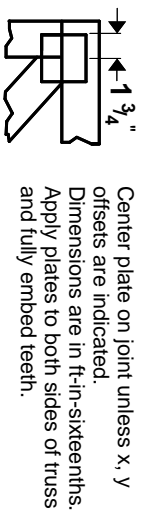


* Plate location details available in **MITrak 20/20 software or upon request.**

PLATE SIZE

4 X 4


The first dimension is the plate width measured perpendicular to slots. Second dimension is the length parallel to slots.

LATERAL BRACING LOCATION



Indicated by symbol shown and/or by text in the bracing section of the output. Use T or I bracing if indicated.

BEARING




Indicates location where bearings (supports) occur. Icons vary but reaction section indicates joint number where bearings occur. Min size shown is for crushing only.

Industry Standards:

ANSI/TPI 1: National Design Specification for Metal Plate Connected Wood Truss Construction.
DSB-89: Design Standard for Bracing.
BCSI: Building Component Safety Information, Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses.

Numbering System

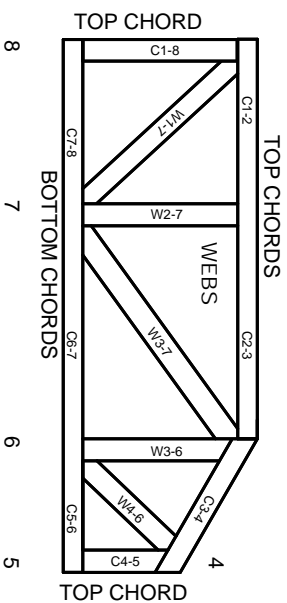

JOINTS ARE GENERALLY NUMBERED/LETTERED CLOCKWISE AROUND THE TRUSS STARTING AT THE JOINT FARTHEST TO THE LEFT.

CHORDS AND WEBS ARE IDENTIFIED BY END JOINT NUMBERS/LETTERS.

PRODUCT CODE APPROVALS

ICC-ES Reports:

ESR-1311, ESR-1352, ESR1988
ER-3907, ESR-2362, ESR-1397, ESR-3282

Trusses are designed for wind loads in the plane of the truss unless otherwise shown.

Lumber design values are in accordance with ANSI/TPI 1 section 6.3 These truss designs rely on lumber values established by others.

© 2012 MITTEK® All Rights Reserved



MITek Engineering Reference Sheet: MII-7473 rev. 10/03/2015



General Safety Notes

Failure to Follow Could Cause Property Damage or Personal Injury

1. Additional stability bracing for truss system, e.g. diagonal or X-bracing, is always required. See BCSI.
2. Truss bracing must be designed by an engineer. For wide truss spacing, individual lateral braces themselves may require bracing, or alternative Tor I bracing should be considered.
3. Never exceed the design loading shown and never stack materials on inadequately braced trusses.
4. Provide copies of this truss design to the building designer, erection supervisor, property owner and all other interested parties.
5. Cut members to bear tightly against each other.
6. Place plates on each face of truss at each joint and embed fully. Knots and wane at joint locations are regulated by ANSI/TPI 1.
7. Design assumes trusses will be suitably protected from the environment in accord with ANSI/TPI 1.
8. Unless otherwise noted, moisture content of lumber shall not exceed 19% at time of fabrication.
9. Unless expressly noted, this design is not applicable for use with fire retardant, preservative treated, or green lumber.
10. Camber is a non-structural consideration and is the responsibility of truss fabricator. General practice is to camber for dead load deflection.
11. Plate type, size, orientation and location dimensions indicated are minimum plating requirements.
12. Lumber used shall be of the species and size, and in all respects, equal to or better than that specified.
13. Top chords must be sheathed or purlins provided at spacing indicated on design.
14. Bottom chords require lateral bracing at 10 ft. spacing, or less, if no ceiling is installed, unless otherwise noted.
15. Connections not shown are the responsibility of others.
16. Do not cut or alter truss member or plate without prior approval of an engineer.
17. Install and load vertically unless indicated otherwise.
18. Use of green or treated lumber may pose unacceptable environmental, health or performance risks. Consult with project engineer before use.
19. Review all portions of this design (front, back, words and pictures) before use. Reviewing pictures alone is not sufficient.
20. Design assumes manufacture in accordance with ANSI/TPI 1 Quality Criteria.