



August 10, 2020

Mr. Oliver Hudson
LGI Homes
7201 Creedmoor Road, Suite 147
Raleigh, NC 27613

**Subject: Summary of Foundation Bearing Material Evaluation & 3rd Party Inspection
Lot No. 90 – (170 Old Head Way)
Avery Pond Subdivision
Fuquay-Varina, North Carolina
Permit Number: 1911-0049
SUMMIT Project Number: 1203-08R (29161-00)**

Dear Mr. Hudson:

On July 29 and 30, 2020, a representative of SUMMIT Engineering, Laboratory and Testing, P.C. (SUMMIT) visited the subject site for the purpose of observing the near surface foundation bearing materials and to perform a third-party inspection for the proposed residential structure. The following is a summary of our onsite observations and evaluation.

The residential footings were excavated approximately 16 inches wide and approximately 12 inches below the existing ground surface prior to our site visit. We observed that the interior and exterior wall foundations were prepared per the structural plans provided onsite. Reinforced steel (rebar) was placed in accordance with the plans provided onsite. Additionally, we observed that the vapor barrier was installed and that foundation insulation was placed along the exterior walls.

Our work included testing and bearing grade evaluations of the in-place soil at the bottom of the foundation excavations. Hand auger borings were incrementally advanced by manually twisting a sharpened steel auger into the soil at selected locations along the footing excavation. The soil consistency in the bottom of the excavation and at selected intervals below the bearing grade were evaluated by Dynamic Cone Penetrometer (DCP) testing. The conical point of the DCP was first seated to penetrate any loose cuttings and then driven three additional 1-3/4 inch increments with blows from a 15-pound hammer falling 20 inches. The soil's strength characteristics and foundation support capability was determined based on the average blows per increment (bpi) over the last two increments to achieve this penetration. Additionally, the entire excavated foundation was evaluated by hand probing using a ½ inch diameter steel probe rod to check for soft areas at the surface intermediate of our hand auger boring locations.

The materials exposed at the bottom of excavations generally consisted of tan and gray, sandy-silt and sandy-clay (fill soils) and were free of significant quantities of organics and debris. It


should be noted that a slope was observed within 10 feet of the left and rear exterior wall footing lines. The contractor was informed and **SUMMIT** recommended over-excavating 12 inches below the existing foundation bearing elevation in the areas designated in marking paint. **SUMMIT** returned on July 30, 2020 and observed that the recommended over-excavations had been completed. We recommend backfilling the over-excavated areas with full depth concrete due to the close proximity of the existing slopes. If additional testing for the purpose of estimating volumetric change (shrink/swell) potential or to estimate consolidation of the tested soils is desired, **SUMMIT** can provide these services.

SUMMIT tested the four exterior wall corners of the residential foundation and fill soils were encountered to a minimum approximate depth of 3 feet below the foundation bearing elevation. **SUMMIT** assumes that the fill placement was observed and tested to verify that the fill material was placed and compacted properly. Based on the results of our DCP testing, the completed remedial measures, and the assumption that the fill placed throughout the building pad is similar or better than the properly compacted fill material encountered in the hand auger borings, the soils encountered are suitable for support of the residential structure utilizing a net allowable soil bearing pressure of **2,000 pounds-per-square-foot**. Concrete is ready to be placed for the foundation and slab areas.

If foundation bearing materials are exposed to inclement weather or adverse construction activities, **SUMMIT** should be contacted to re-evaluate the foundation bearing materials prior to concrete placement. If it is imminent that inclement weather is forecasted prior to concrete placement, then the footings can be over-excavated (deepened) approximately 2 to 4 inches and a mud-mat (lean concrete) can be placed up to the foundation bearing elevation to help protect the foundation bearing materials from softening.

SUMMIT appreciates the opportunity to provide our professional services to you on this project. If you have any questions concerning the information in this report or if we can be of further service, please contact us.

Sincerely,
SUMMIT Engineering, Laboratory and Testing, P.C.

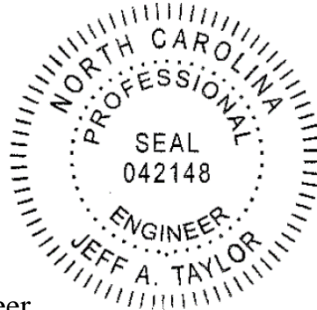

Jeff A. Taylor, P.E.
Geotechnical Engineer

A handwritten signature in black ink, appearing to read "Adam D. Perry".

Adam D. Perry, E.I.
Staff Professional