

Trenco
818 Soundside Rd
Edenton, NC 27932

Re: J0120-0389
Lot 4 Mann Rd. / Harnett

The truss drawing(s) referenced below have been prepared by Truss Engineering Co. under my direct supervision based on the parameters provided by Comtech, Inc - Fayetteville.

Pages or sheets covered by this seal: E14309118 thru E14309120

My license renewal date for the state of North Carolina is December 31, 2020.

North Carolina COA: C-0844



April 17, 2020

Gilbert, Eric


IMPORTANT NOTE: The seal on these truss component designs is a certification that the engineer named is licensed in the jurisdiction(s) identified and that the designs comply with ANSI/TPI 1. These designs are based upon parameters shown (e.g., loads, supports, dimensions, shapes and design codes), which were given to MiTek or TRENCO. Any project specific information included is for MiTek's or TRENCO's customers file reference purpose only, and was not taken into account in the preparation of these designs. MiTek or TRENCO has not independently verified the applicability of the design parameters or the designs for any particular building. Before use, the building designer should verify applicability of design parameters and properly incorporate these designs into the overall building design per ANSI/TPI 1, Chapter 2.

Job J0120-0389	Truss C1	Truss Type ATTIC	Qty 2	Ply 1	Lot 4 Mann Rd. / Harnett Job Reference (optional)	E14309118
-------------------	-------------	---------------------	----------	----------	------------------------------------------------------	-----------

Comtech, Inc., Fayetteville, NC - 28314,

8.330 s Mar 23 2020 MiTek Industries, Inc. Fri Apr 17 10:48:58 2020 Page 1

ID:k6oy8H5VlguX6Drpe63zywztnYn-N55ildzKaSjgiOvjP3dzku?IGXnB5yziMLM9CrzPqsJ



5x8 =

Scale = 1:79.4

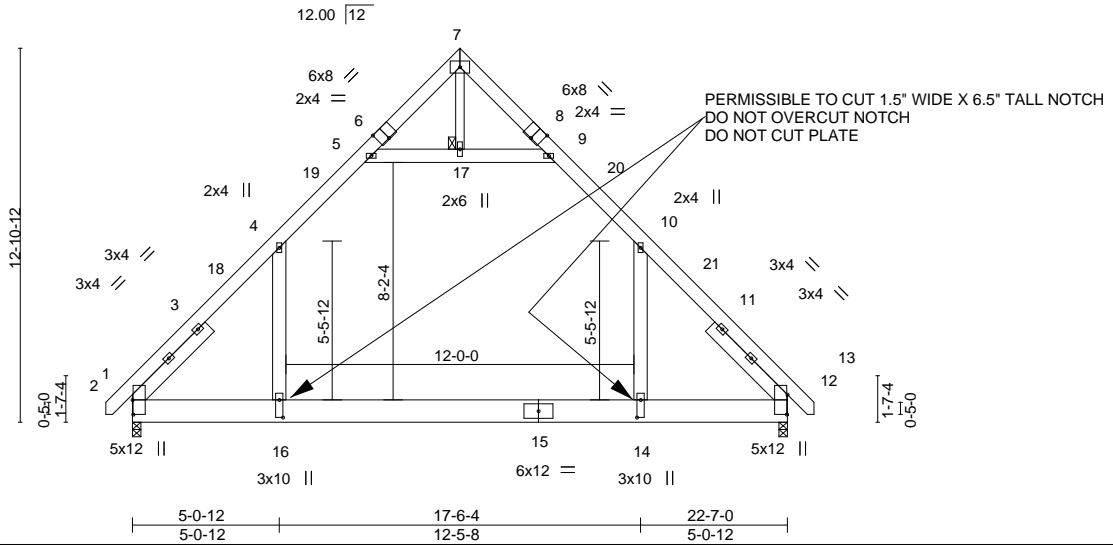


Plate Offsets (X,Y)-- [2:0-6-0,0-0-4], [6:0-4-0,Edge], [8:0-4-0,Edge], [12:0-8-4,0-0-4], [14:0-7-4,0-1-8], [16:0-7-4,0-1-8]

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.15	TC 0.63	Vert(LL)	-0.25 14-16	>999	360	MT20	244/190
TCDL 10.0	Lumber DOL	1.15	BC 0.77	Vert(CT)	-0.42 14-16	>649	240		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.15	Horz(CT)	0.01 12	n/a	n/a		
BCDL 10.0	Code IRC2015/TP12014		Matrix-R	Attic	-0.14 14-16	1032	360		
								Weight: 233 lb	FT = 20%

LUMBER-

TOP CHORD 2x6 SP 2400F 2.0E
 BOT CHORD 2x10 SP No.1
 WEBS 2x6 SP No.1 *Except*
 7-17: 2x4 SP No.2
 SLIDER Left 2x6 SP No.1 -x 3-8-0, Right 2x6 SP No.1 -x 3-8-0

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
 BOT CHORD Rigid ceiling directly applied or 9-7-6 oc bracing.
 JOINTS 1 Brace at Jt(s): 17

REACTIONS.

(size) 2=0-3-8, 12=0-3-8
 Max Horz 2=-292(LC 5)
 Max Grav 2=1534(LC 18), 12=1534(LC 17)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-4=-2081/0, 4-5=-1101/169, 9-10=-1101/169, 10-12=-2080/0
 BOT CHORD 2-16=0/1150, 14-16=0/1150, 12-14=0/1150
 WEBS 5-17=-1329/228, 9-17=-1329/228, 4-16=0/1060, 10-14=0/1060

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=5.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) -0-9-10 to 3-7-3, Interior(1) 3-7-3 to 6-10-11, Exterior(2) 6-10-11 to 15-8-5, Interior(1) 15-8-5 to 18-11-13, Exterior(2) 18-11-13 to 23-4-10 zone; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas with a clearance greater than 6-0-0 between the bottom chord and any other members.
- Ceiling dead load (10.0 psf) on member(s). 4-5, 9-10, 5-17, 9-17; Wall dead load (5.0psf) on member(s). 4-16, 10-14
- Bottom chord live load (40.0 psf) and additional bottom chord dead load (10.0 psf) applied only to room. 14-16
- Attic room checked for L/360 deflection.



April 17, 2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 10/03/2015 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 218 N. Lee Street, Suite 312, Alexandria, VA 22314.




818 Soundside Road
 Edenton, NC 27932

Job J0120-0389	Truss C2	Truss Type ATTIC	Qty 9	Ply 1	Lot 4 Mann Rd. / Harnett	E14309119
-------------------	-------------	---------------------	----------	----------	--------------------------	-----------

Comtech, Inc., Fayetteville, NC - 28314,

8.330 s Mar 23 2020 MiTek Industries, Inc. Fri Apr 17 10:48:59 2020 Page 1

ID:k6oy8H5VlguX6Drpe63zywztnYn-rHf5Vz_yLIRXKYUwzm8CG5XS0w7QqPDRb?6ikHzPqsl



5x8 =

Scale = 1:79.4

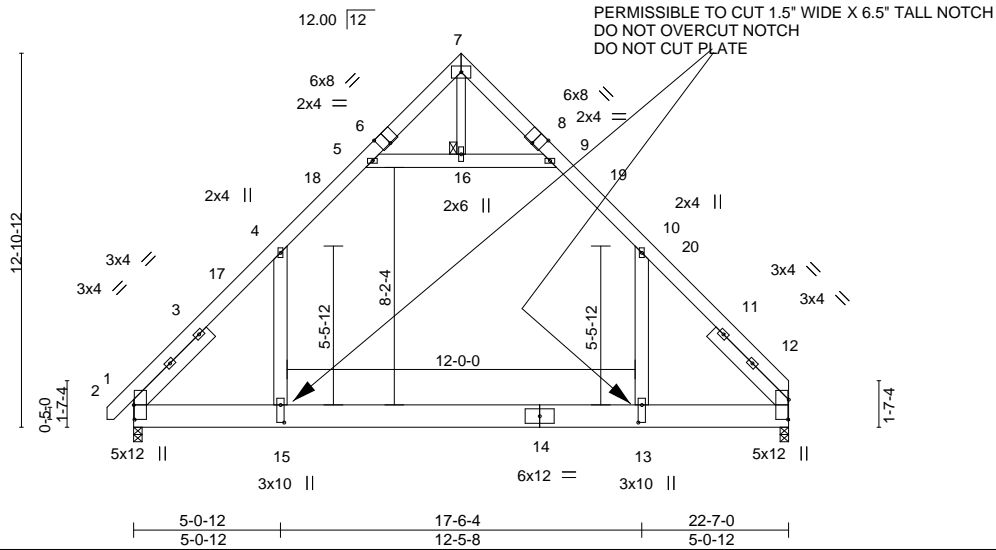


Plate Offsets (X,Y)-- [2:0-6-0,0-0-4], [6:0-4-0,Edge], [8:0-4-0,Edge], [12:0-8-4,0-0-4], [13:0-7-4,0-1-8], [15:0-7-4,0-1-8]

LOADING (psf)	SPACING-	2-0-0	CSI.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.15	TC 0.63	Vert(LL) -0.25	13-15	>999	MT20	244/190
TCDL 10.0	Lumber DOL	1.15	BC 0.77	Vert(CT) -0.42	13-15	>649		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.15	Horz(CT) 0.01	12	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-R	Attic -0.14	13-15	1032		
							Weight: 230 lb	FT = 20%

LUMBER-

TOP CHORD 2x6 SP 2400F 2.0E
 BOT CHORD 2x10 SP No.1
 WEBS 2x6 SP No.1 *Except*
 7-16: 2x4 SP No.2
 SLIDER Left 2x6 SP No.1 -x 3-8-0, Right 2x6 SP No.1 -x 3-8-0

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
 BOT CHORD Rigid ceiling directly applied or 9-7-14 oc bracing.
 JOINTS 1 Brace at Jt(s): 16

REACTIONS.

(size) 2=0-3-8, 12=0-3-8
 Max Horz 2=-294(LC 5)
 Max Grav 2=1534(LC 18), 12=1503(LC 17)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-4=-2083/0, 4-5=-1102/172, 9-10=-1101/172, 10-12=-2081/0
 BOT CHORD 2-15=0/1152, 13-15=0/1152, 12-13=0/1152
 WEBS 5-16=-1331/236, 9-16=-1331/236, 4-15=0/1061, 10-13=0/1060

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCCL=6.0psf; BCDL=5.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) -0-9-10 to 3-7-3, Interior(1) 3-7-3 to 6-10-11, Exterior(2) 6-10-11 to 15-8-5, Interior(1) 15-8-5 to 18-2-3, Exterior(2) 18-2-3 to 22-7-0 zone; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas with a clearance greater than 6-0-0 between the bottom chord and any other members.
- Ceiling dead load (10.0 psf) on member(s). 4-5, 9-10, 5-16, 9-16; Wall dead load (5.0psf) on member(s). 4-15, 10-13
- Bottom chord live load (40.0 psf) and additional bottom chord dead load (10.0 psf) applied only to room. 13-15
- Attic room checked for L/360 deflection.



April 17, 2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 10/03/2015 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 218 N. Lee Street, Suite 312, Alexandria, VA 22314.




818 Soundside Road
 Edenton, NC 27932

Job J0120-0389	Truss C3	Truss Type ATTIC	Qty 1	Ply 2	Lot 4 Mann Rd. / Harnett E14309120
-------------------	-------------	---------------------	----------	----------	---------------------------------------

Comtech, Inc., Fayetteville, NC - 28314,

8.330 s Mar 23 2020 MiTek Industries, Inc. Fri Apr 17 10:49:00 2020 Page 1

ID:k6oy8H5VlguX6Drpe63zywztnYn-JTCTJ?a63ZOxi26XUfRpJ4e6KWIZt1?qrFHkzPqsH



5x8 =

Scale = 1:79.4

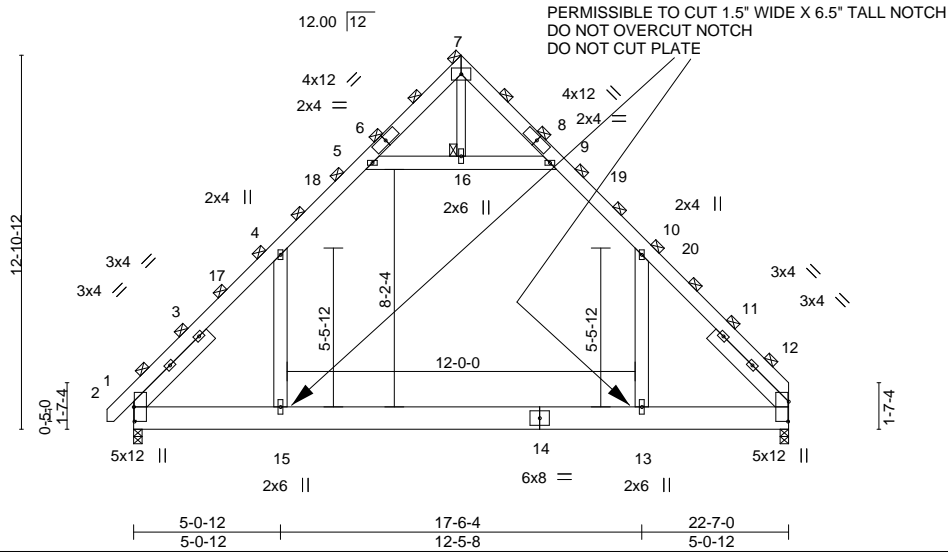


Plate Offsets (X,Y)-- [2:0-6-0,0-0-4], [12:0-8-4,0-0-4]

LOADING (psf)	SPACING-	3-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.15	TC 0.55	Vert(LL)	-0.19 13-15	>999	360	MT20	244/190
TCDL 10.0	Lumber DOL	1.15	BC 0.63	Vert(CT)	-0.31 13-15	>865	240		
BCLL 0.0 *	Rep Stress Incr	NO	WB 0.11	Horz(CT)	0.01 12	n/a	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-R	Attic	-0.11 13-15	1376	360		
								Weight: 461 lb	FT = 20%

LUMBER-

TOP CHORD 2x6 SP 2400F 2.0E
 BOT CHORD 2x10 SP No.1
 WEBS 2x6 SP No.1 *Except*
 7-16: 2x4 SP No.2
 SLIDER Left 2x6 SP No.1 -x 3-8-0, Right 2x6 SP No.1 -x 3-8-0

BRACING-

TOP CHORD 2-0-0 oc purlins (6-0-0 max.)
 (Switched from sheeted: Spacing > 2-8-0).
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
 JOINTS 1 Brace at Jt(s): 7, 16

REACTIONS.

(size) 2=0-3-8, 12=0-3-8
 Max Horz 2=440(LC 5)
 Max Grav 2=2302(LC 18), 12=2254(LC 17)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-4=-3124/0, 4-5=-1653/258, 5-7=-175/308, 7-9=-174/308, 9-10=-1652/257,
 10-12=-3121/0
 BOT CHORD 2-15=0/1729, 13-15=0/1729, 12-13=0/1729
 WEBS 5-16=-1996/353, 9-16=-1996/353, 4-15=0/1591, 10-13=0/1590

NOTES-

- 2-ply truss to be connected together with 10d (0.148"x3") nails as follows:
 Top chords connected as follows: 2x6 - 2 rows staggered at 0-9-0 oc.
 Bottom chords connected as follows: 2x10 - 2 rows staggered at 0-9-0 oc.
 Webs connected as follows: 2x6 - 2 rows staggered at 0-9-0 oc; 2x4 - 1 row at 0-9-0 oc.
- All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=5.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) -0-9-10 to 3-7-3, Interior(1) 3-7-3 to 6-10-11, Exterior(2) 6-10-11 to 15-8-5, Interior(1) 15-8-5 to 18-2-3, Exterior(2) 18-2-3 to 22-7-0 zone; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas with a clearance greater than 6-0-0 between the bottom chord and any other members.
- Ceiling dead load (10.0 psf) on member(s). 4-5, 9-10, 5-16, 9-16; Wall dead load (5.0psf) on member(s).4-15, 10-13
- Bottom chord live load (40.0 psf) and additional bottom chord dead load (10.0 psf) applied only to room. 13-15
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
- Attic room checked for L/360 deflection.



April 17, 2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 10/03/2015 BEFORE USE.


Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 218 N. Lee Street, Suite 312, Alexandria, VA 22314.




818 Soundside Road
 Edenton, NC 27932

Symbols

PLATE LOCATION AND ORIENTATION

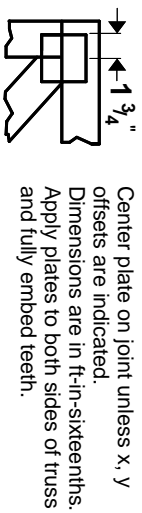

For 4 x 2 orientation, locate plates 0- $\frac{1}{16}$ " from outside edge of truss.




* Plate location details available in **MITrak 20/20 software or upon request.**

PLATE SIZE

4 X 4


The first dimension is the plate width measured perpendicular to slots. Second dimension is the length parallel to slots.

LATERAL BRACING LOCATION



Indicated by symbol shown and/or by text in the bracing section of the output. Use T or I bracing if indicated.

BEARING




Indicates location where bearings (supports) occur. Icons vary but reaction section indicates joint number where bearings occur. Min size shown is for crushing only.

Industry Standards:

ANSI/TPI 1: National Design Specification for Metal Plate Connected Wood Truss Construction.
DSB-89: Design Standard for Bracing.
BCSI: Building Component Safety Information, Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses.

Numbering System

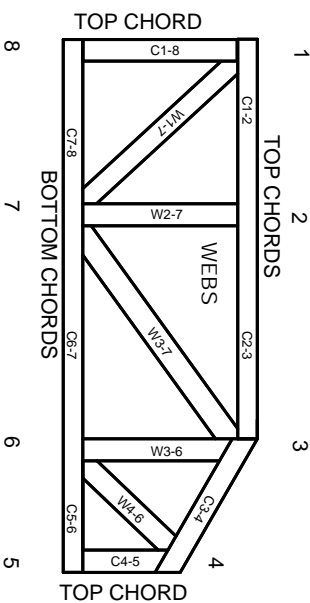

JOINTS ARE GENERALLY NUMBERED/LETTERED CLOCKWISE AROUND THE TRUSS STARTING AT THE JOINT FARTHEST TO THE LEFT.

CHORDS AND WEBS ARE IDENTIFIED BY END JOINT NUMBERS/LETTERS.

PRODUCT CODE APPROVALS

ICC-ES Reports:

ESR-1311, ESR-1352, ESR1988
ER-3907, ESR-2362, ESR-1397, ESR-3282

Trusses are designed for wind loads in the plane of the truss unless otherwise shown.

Lumber design values are in accordance with ANSI/TPI 1 section 6.3 These truss designs rely on lumber values established by others.

© 2012 MITteK® All Rights Reserved



MITek Engineering Reference Sheet: Mill-7473 rev. 10/03/2015



General Safety Notes

Failure to Follow Could Cause Property Damage or Personal Injury

1. Additional stability bracing for truss system, e.g. diagonal or X-bracing, is always required. See BCSI.
2. Truss bracing must be designed by an engineer. For wide truss spacing, individual lateral braces themselves may require bracing, or alternative Tor I bracing should be considered.
3. Never exceed the design loading shown and never stack materials on inadequately braced trusses.
4. Provide copies of this truss design to the building designer, erection supervisor, property owner and all other interested parties.
5. Cut members to bear tightly against each other.
6. Place plates on each face of truss at each joint and embed fully. Knots and wane at joint locations are regulated by ANSI/TPI 1.
7. Design assumes trusses will be suitably protected from the environment in accord with ANSI/TPI 1.
8. Unless otherwise noted, moisture content of lumber shall not exceed 19% at time of fabrication.
9. Unless expressly noted, this design is not applicable for use with fire retardant, preservative treated, or green lumber.
10. Camber is a non-structural consideration and is the responsibility of truss fabricator. General practice is to camber for dead load deflection.
11. Plate type, size, orientation and location dimensions indicated are minimum plating requirements.
12. Lumber used shall be of the species and size, and in all respects, equal to or better than that specified.
13. Top chords must be sheathed or purlins provided at spacing indicated on design.
14. Bottom chords require lateral bracing at 10 ft. spacing, or less, if no ceiling is installed, unless otherwise noted.
15. Connections not shown are the responsibility of others.
16. Do not cut or alter truss member or plate without prior approval of an engineer.
17. Install and load vertically unless indicated otherwise.
18. Use of green or treated lumber may pose unacceptable environmental, health or performance risks. Consult with project engineer before use.
19. Review all portions of this design (front, back, words and pictures) before use. Reviewing pictures alone is not sufficient.
20. Design assumes manufacture in accordance with ANSI/TPI 1 Quality Criteria.