



Course	Bearing	Distance
L1	S 69°25'36" E	4.70'
L2	S 69°25'36" E	8.42'
L3	N 76°27'31" E	2.77'

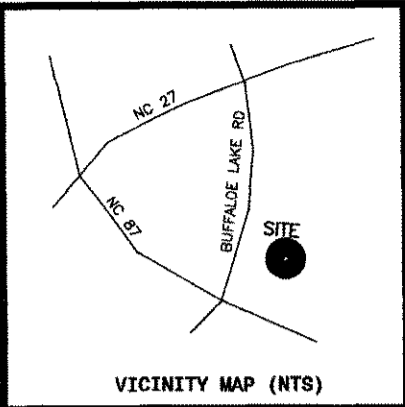

- LEGEND**
- NTS NOT TO SCALE
 - EIP EXISTING IRON PIPE
 - PP POWER POLE
 - W/M WATER METER
 - TB TELEPHONE BOX
 - IPS IRON PIPE SET
 - CP&L TRANSFORMER
 - CATV CABLE TV BOX
 - L POLE LIGHT POLE
 - OHPL OVERHEAD POWER LINE
 - F.E.S. FLARED END SECTION (PIPE)
 - RCP REINFORCED CONC. PIPE
 - B.O.C. BACK OF CURB
 - F.H. FIRE HYDRANT
 - C/O SEWER CLEAN OUT
 - EIS EXISTING IRON STAKE
 - MH MANHOLE
 - FFE FINISHED FLOOR ELEVATION
 - W/V WATER VALVE
 - CP COMPUTED POINT ONLY

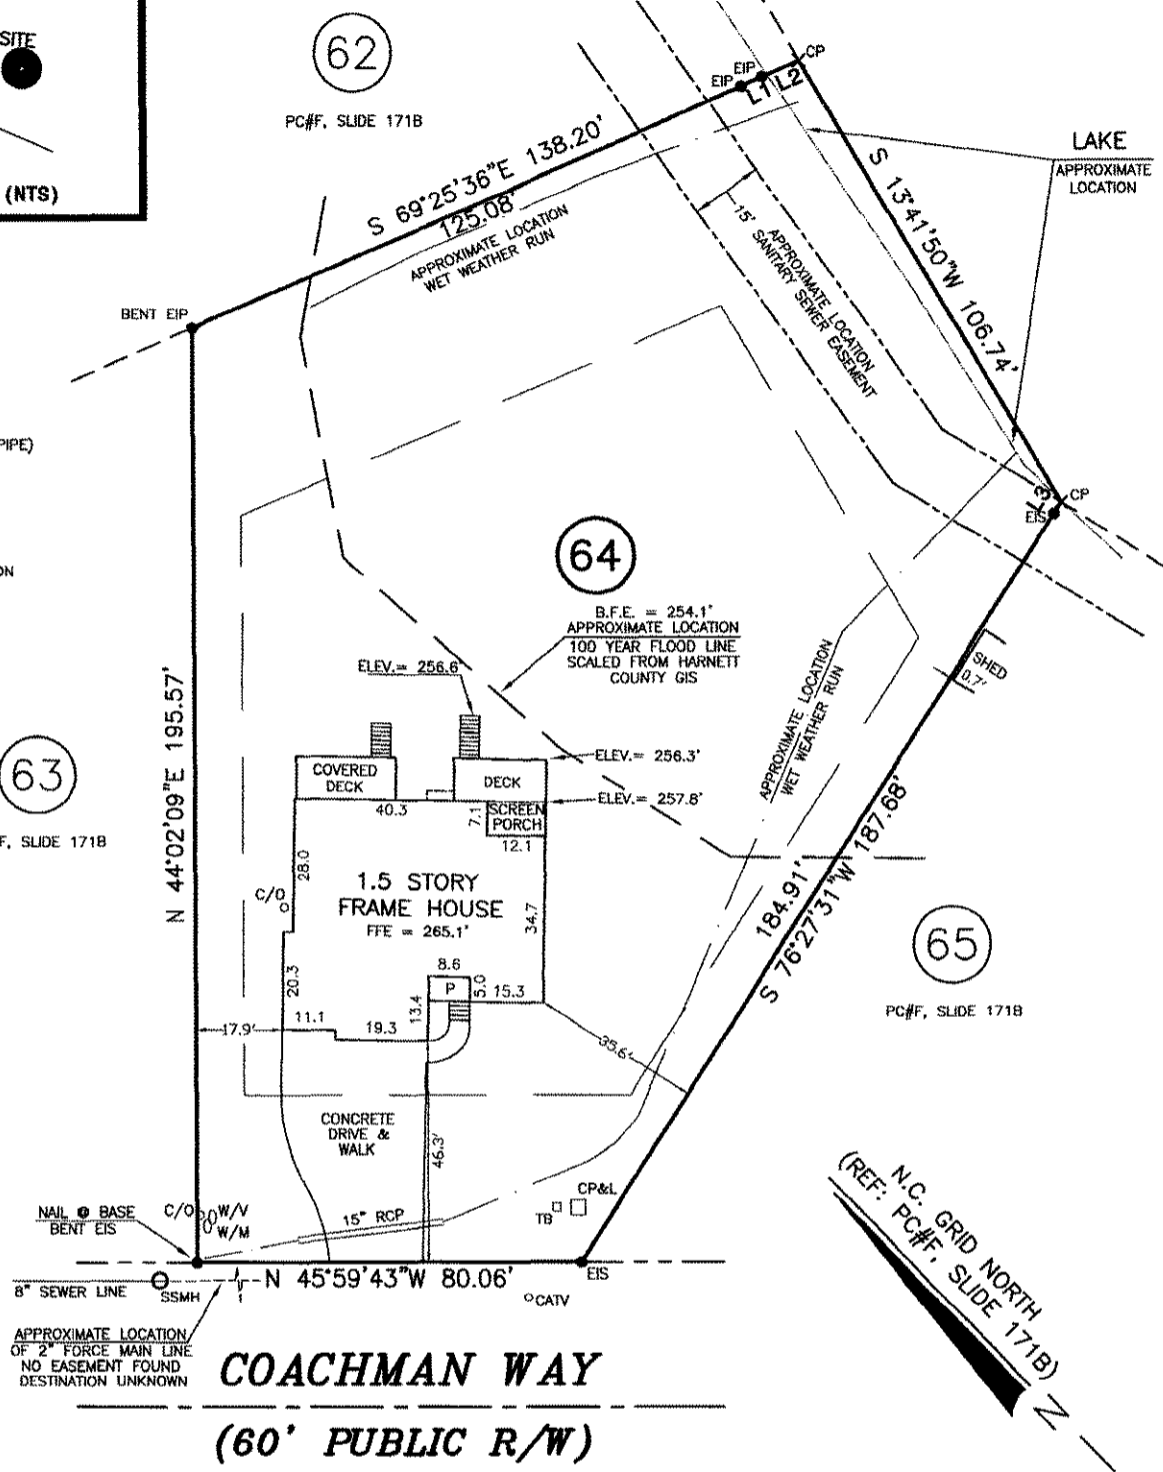


NOTES:
 (A) THE PROPERTY SHOWN HEREON IS SUBJECT TO ALL EASEMENTS OF RECORD AFFECTING SAME.
 (B) NO TITLE SEARCH HAS BEEN PERFORMED BY THIS FIRM DURING THE COURSE OF THIS SURVEY.
 (C) THIS SURVEYOR DOES NOT CERTIFY TO THE EXISTENCE OR NON-EXISTENCE OF ANY UNDER GROUND UTILITIES THAT MAY OR MAY NOT BE PRESENT ON THIS SITE.

THE STRUCTURE IS NOT LOCATED IN THE FLOOD ZONE.

F.E.M.A. MAP# 3710958400J PANEL 9584
 ZONE - AE, EFFECTIVE DATE 10/03/2006
 B.F.E. = 254.1'

NOTE: SHOWN IS LOT 64 OF CAROLINA LAKES S/D BLOCK S, PHASE 7 REF: PC#F, SLIDE 171B

AREA = 0.719 ACRES
 835 COACHMAN WAY

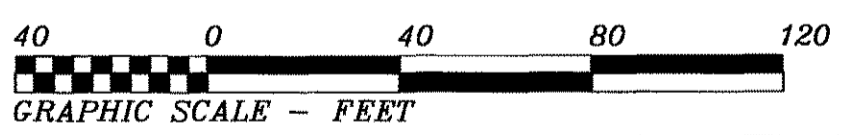

THIS IS TO CERTIFY THAT THIS MAP WAS PREPARED FROM AN ACTUAL SURVEY OF THE PREMISES, MADE UNDER MY SUPERVISION, AND THAT THERE ARE NOT ANY ENCROACHMENTS, EXCEPT AS NOTED TO THE BEST OF MY KNOWLEDGE. THAT THE RATIO OF PRECISION AS CALCULATED BY LATITUDES AND DEPARTURES IS 1:10,000. THIS MAP WAS PREPARED FOR TITLE COMPANY USE AND IS NOT INTENDED FOR RECORDATION OR CONVEYANCES WITHOUT WRITTEN AUTHORIZATION OF THE SURVEYOR AND OTHER APPROPRIATE OFFICIALS.



SURVEY FOR:
SOUTH SCAN INC.

BARBECUE TWS., HARNETT CO., N.C.
 SCALE 1" = 40' MARCH 9, 2021

MAULDIN - WATKINS SURVEYING, P.A.
 P.O. BOX 444 / 139 N. MAIN ST.
 FUQUAY VARINA, NORTH CAROLINA 27526
 (919) 552-9326 C-929

PROFESSIONAL LAND SURVEYOR
 L-3247 *James W. Mauldin* 03/09/21