



ROOF & FLOOR TRUSSES & BEAMS

Reilly Road Industrial Park
Fayetteville, N.C. 28309
Phone: (910) 864-8787
Fax: (910) 864-4444

Bearing reactions less than or equal to 3000# are deemed to comply with the prescriptive Code requirements. The contractor shall refer to the attached Tables (derived from the prescriptive Code requirements) to determine the minimum foundation size and number of wood studs required to support reactions greater than 3000# but not greater than 15000#. A registered design professional shall be retained to design the support system for any reaction that exceeds those specified in the attached Tables. A registered design professional shall be retained to design the support system for all reactions that exceed 15000#.


Signature _____
David Landry

LOAD CHART FOR JACK STUDS

(BASED ON TABLES ROEHLIC 6 (D))

NUMBER OF JACK STUDS REQUIRED @ EA END OF HEADERS/GIRDERS

END REACTION (IP-TON)	REQ'D STUDS FOR 10' BY BEAM	END REACTION (IP-TON)	REQ'D STUDS FOR 10' BY BEAM
1700	1	2550	1
3400	2	5100	2
5100	3	7650	3
6800	4	10200	4
8500	5	12750	5
10200	6	15300	6
11900	7		
13600	8		
15300	9		

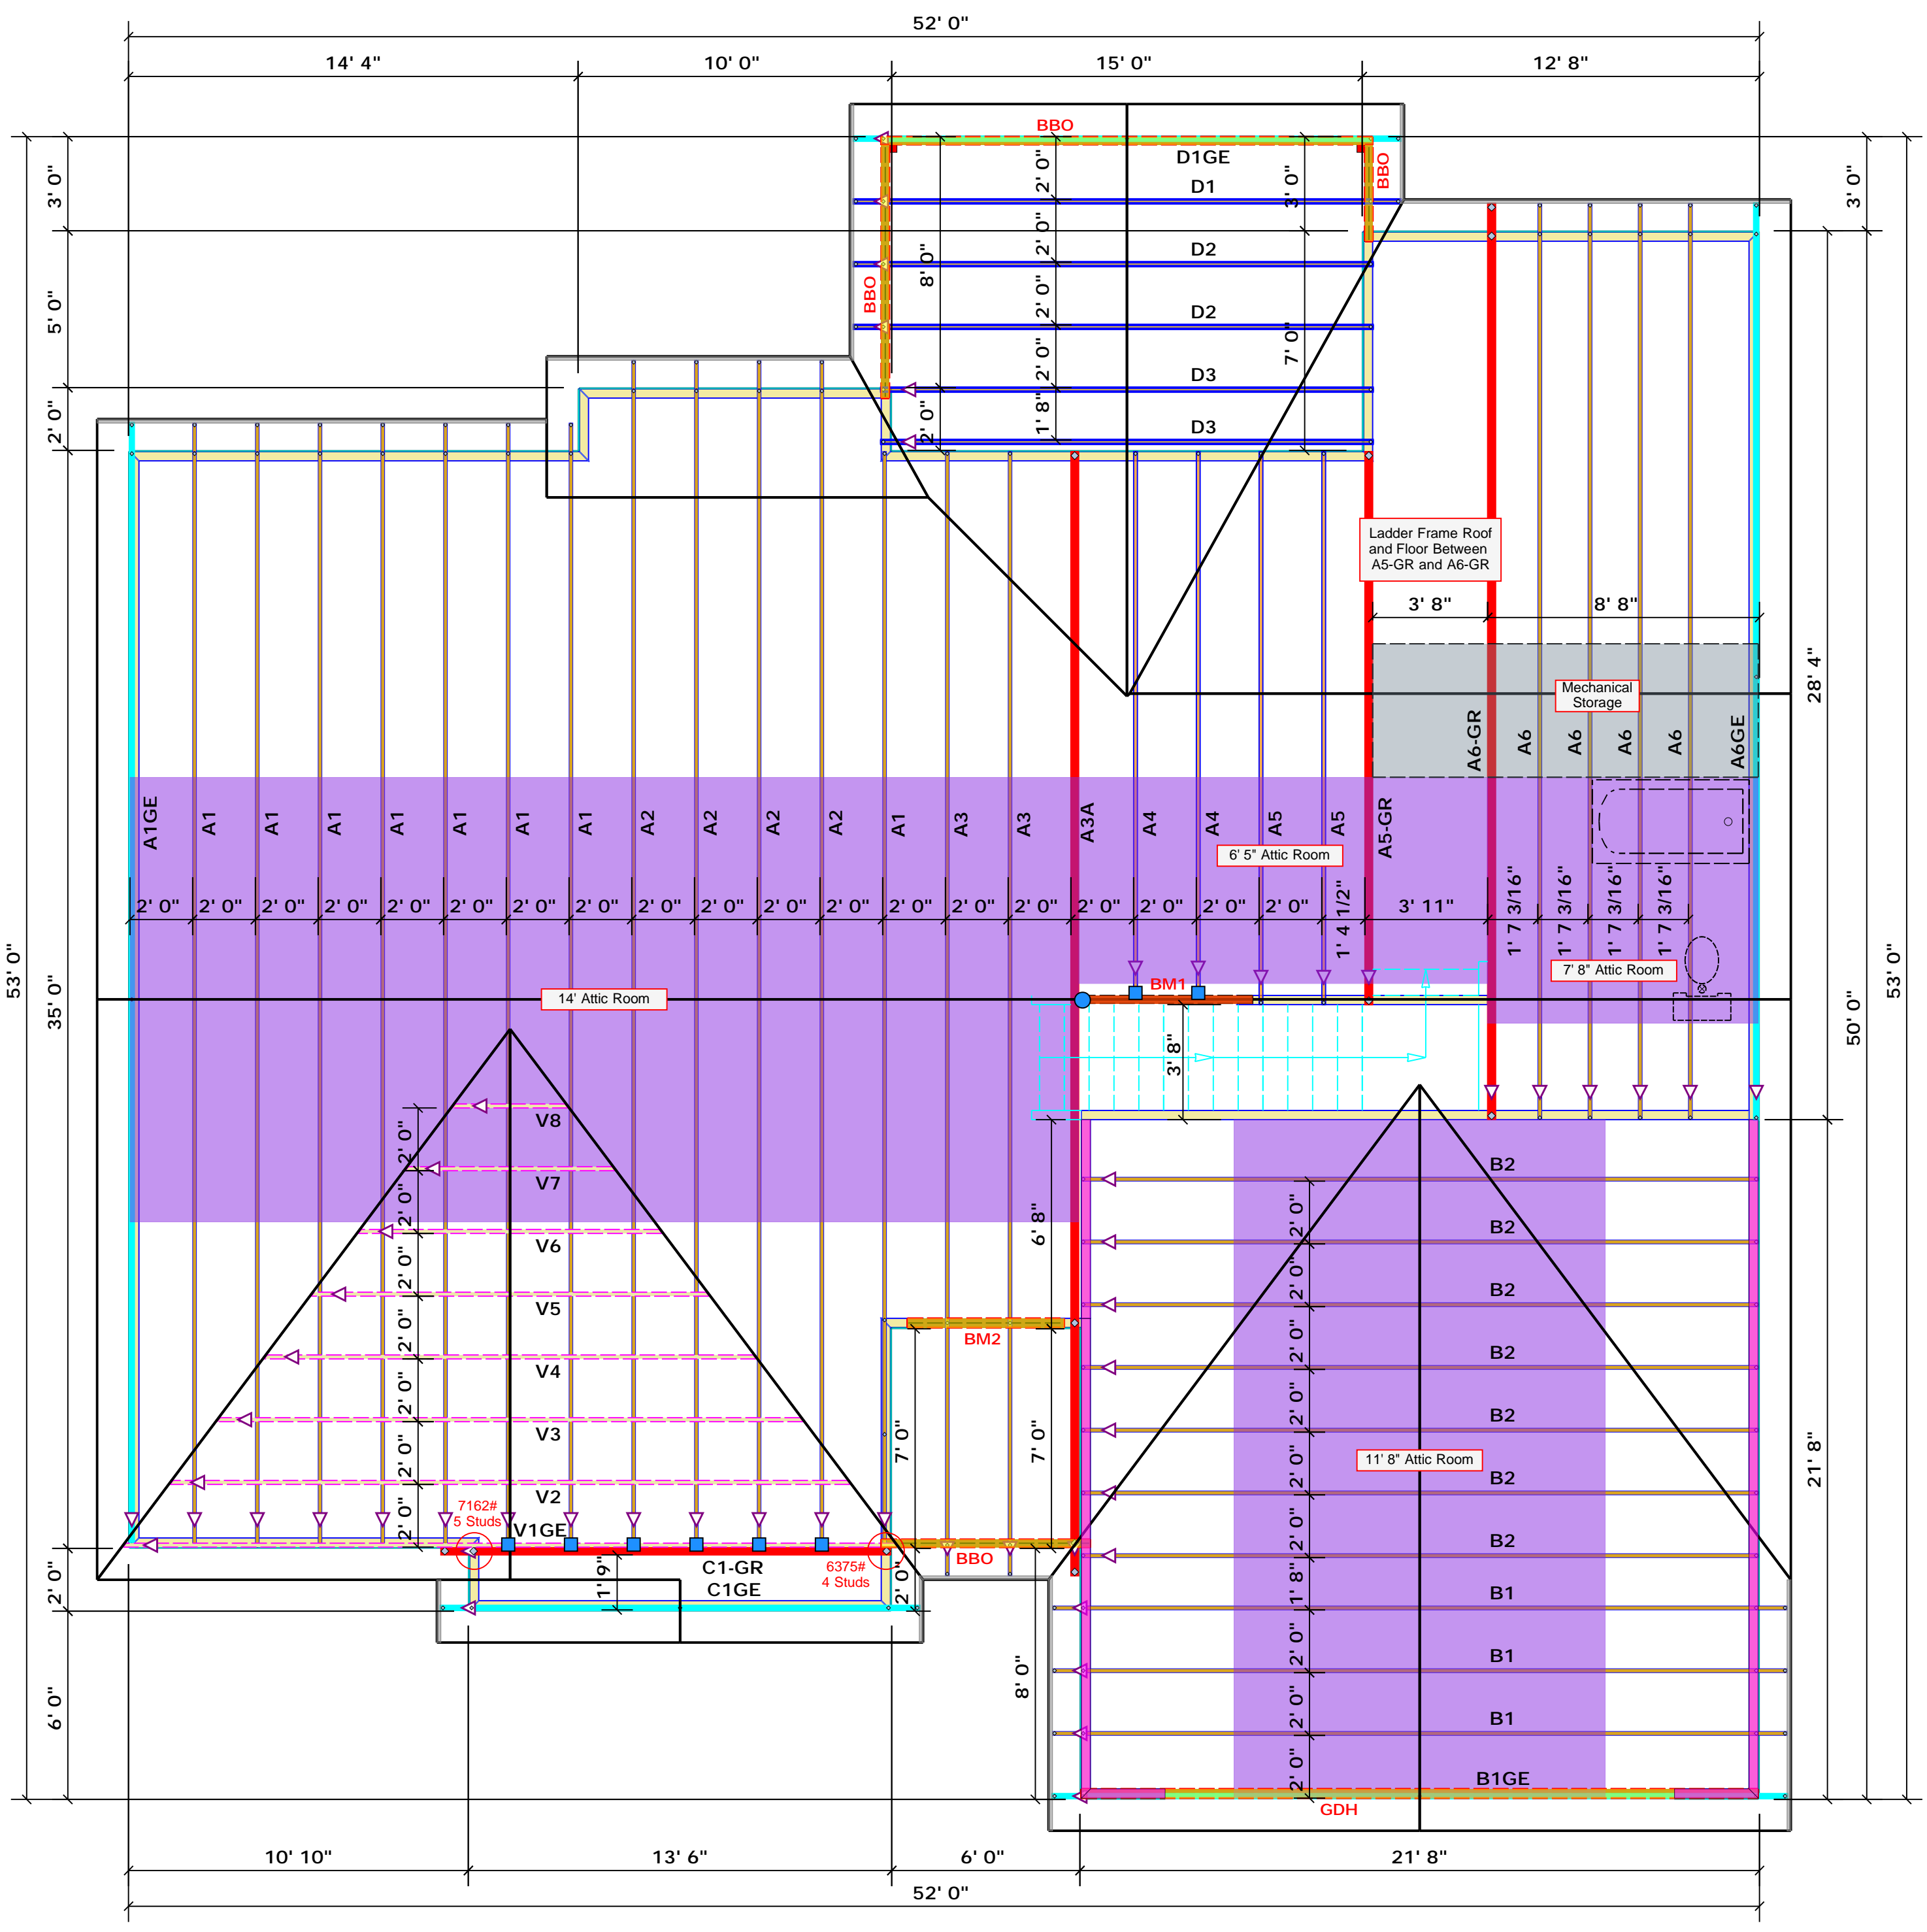

Products

PlotID	Length	Product	Plyes	Net Qty
BM1	6' 0"	2x10 SPF No.2	2	2
BM2	5' 0"	1-3/4"x 9-1/4" LVL Kerto-S	2	2
GDH	22' 0"	1-3/4"x 11-7/8" LVL Kerto-S	2	2

All Walls Shown Are Considered Load Bearing

Hatch Legend

[Hatched Box]	Padded HVAC
[Pink Box]	Garage Walls Dropped 1'-0"

Truss Placement Plan
Scale: 1/4"=1'

Dimension Notes

- All exterior wall to wall dimensions are to face of sheathing unless noted otherwise
- All interior wall dimensions are to face of frame wall unless noted otherwise
- All exterior wall to truss dimensions are to face of frame wall unless noted otherwise

Roof Area = 3179.51 sq.ft.
Ridge Line = 116.21 ft.
Hip Line = 0 ft.
Horiz. OH = 88.97 ft.
Raked OH = 221.34 ft.
Decking = 109 sheets

Connector Information				Nail Information	
Sym	Product	Manuf	Qty	Supported Member	Header / Truss
[Blue Box]	HUS26	USP	8	Varies	16d/3-1/2" / 16d/3-1/2"
[Blue Circle]	HUS410	USP	1	Varies	16d/3-1/2" / 16d/3-1/2"

BUILDER	WEAVER DEVELOPMENT	COUNTY	HARNETT
JOB NAME	Lot 2 Pittman Farm	ADDRESS	Lot 2 Pittman Farm
PLAN	Halifax II	MODEL	Roof / GR / 4BR
SEAL DATE	Seal Date	DATE REV.	01/03/20 07:48:05
QUOTE #	Quote #	DRAWN BY	David Landry
JOB #	J0120-0019	SALESMAN	Lenny Norris

THIS IS A TRUSS PLACEMENT DIAGRAM ONLY. These trusses are designed as individual building components to be incorporated into the building design at the specification of the building designer. See individual design sheets for each truss design identified on the placement drawing. The building designer is responsible for temporary and permanent bracing of the roof and floor system and for the overall structure. The design of the truss support structure including headers, beams, walls, and columns is the responsibility of the building designer. For general guidance regarding bracing, consult BCSI-B1 and BCSI-B3 provided with the truss delivery package or online @ sbcindustry.com



ROOF & FLOOR TRUSSES & BEAMS

Reilly Road Industrial Park
Fayetteville, N.C. 28309
Phone: (910) 864-8787
Fax: (910) 864-4444


Bearing reactions less than or equal to 3000# are deemed to comply with the prescriptive Code requirements. The contractor shall refer to the attached Tables (derived from the prescriptive Code requirements) to determine the minimum foundation size and number of wood studs required to support reactions greater than 3000# but not greater than 15000#. A registered design professional shall be retained to design the support system for any reaction that exceeds those specified in the attached Tables. A registered design professional shall be retained to design the support system for all reactions that exceed 15000#.

Signature _____
David Landry

LOAD CHART FOR JACK STUDS

(BASED ON TABLES ROEHLIC 6 (D))

NUMBER OF JACK STUDS REQUIRED BY EA END OF HEAD-TO-ROOFER		NUMBER OF JACK STUDS REQUIRED BY EA END OF HEAD-TO-HEADER	
END REACTION (IP-TON)	REQ'D STUDS FOR 10' BY BEAM	END REACTION (IP-TON)	REQ'D STUDS FOR 10' BY BEAM
1700	1	2550	1
3400	2	5100	2
5100	3	7650	3
6800	4	10200	4
8500	5	12750	5
10200	6	15300	6
11900	7		
13600	8		
15300	9		

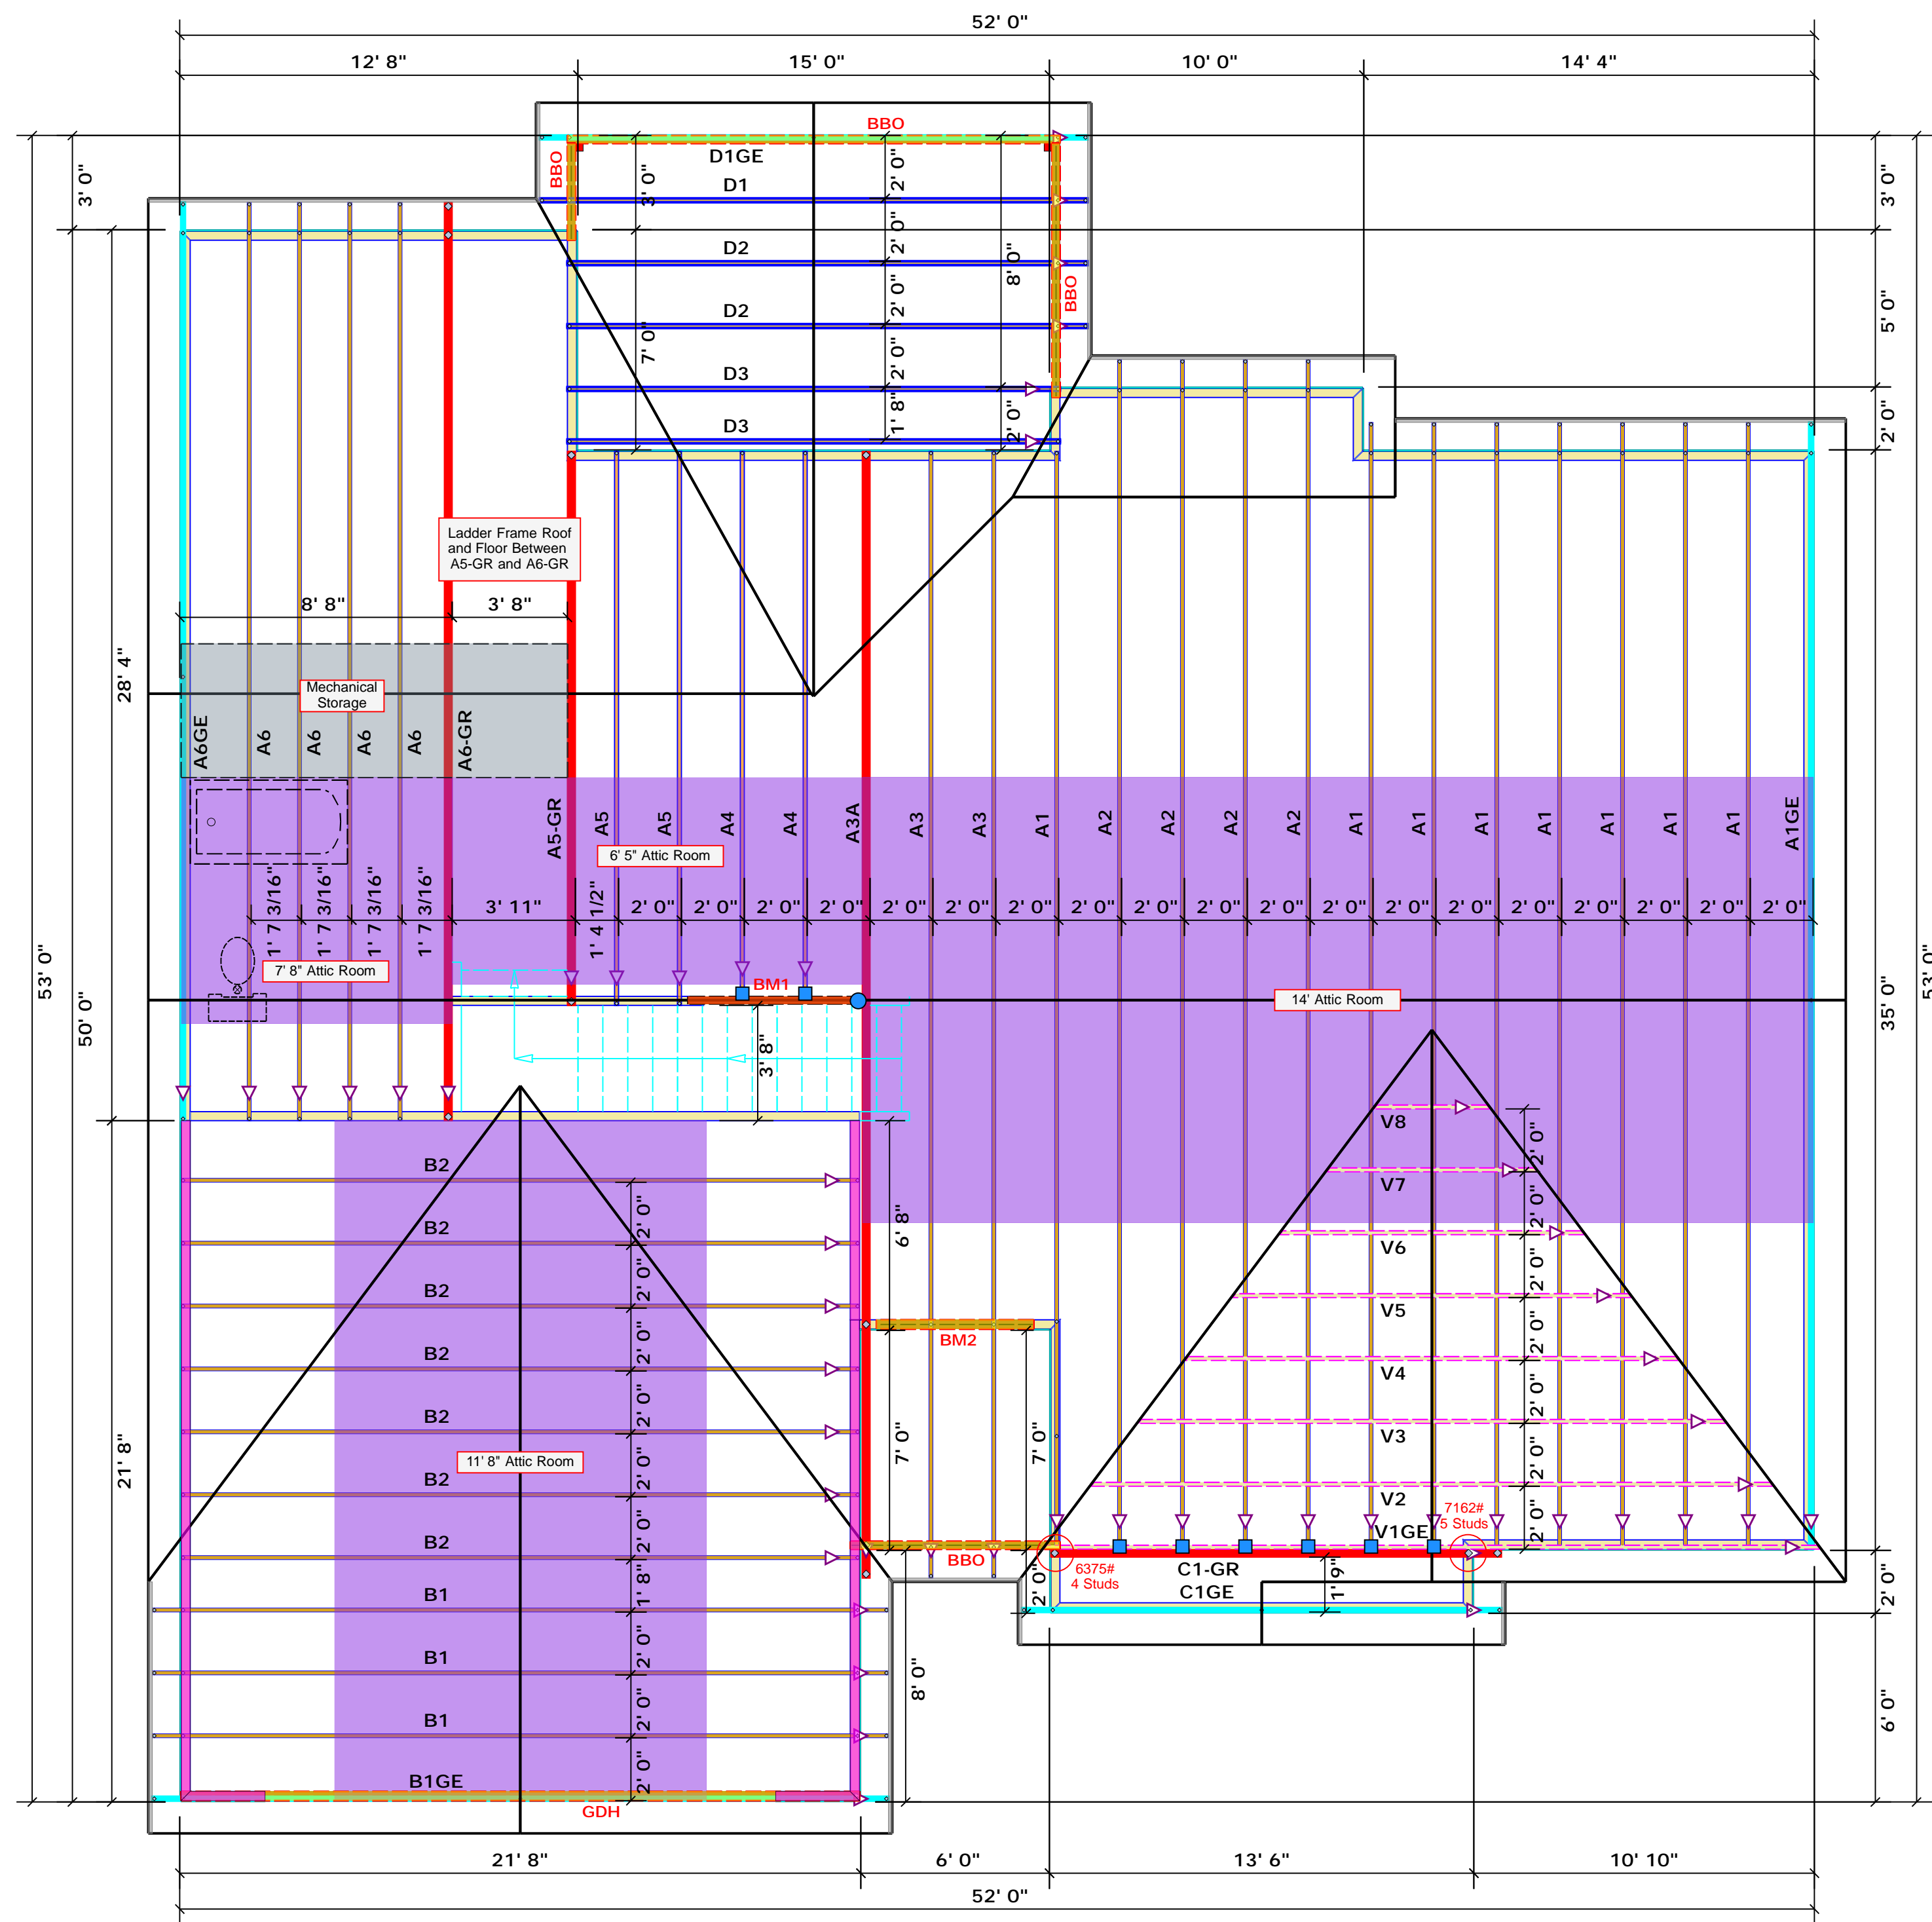

Products				
PlotID	Length	Product	Plies	Net Qty
BM1	6' 0"	2x10 SPF No.2	2	2
BM2	5' 0"	1-3/4"x 9-1/4" LVL Kerto-S	2	2
GDH	22' 0"	1-3/4"x 11-7/8" LVL Kerto-S	2	2

All Walls Shown Are Considered Load Bearing

Hatch Legend	
	Padded HVAC
	Garage Walls Dropped 1'-0"

1 Truss Placement Plan
Scale: 1/4"=1'

Dimension Notes

- All exterior wall to wall dimensions are to face of sheathing unless noted otherwise.
- All interior wall dimensions are to face of frame wall unless noted otherwise.
- All exterior wall to truss dimensions are to face of frame wall unless noted otherwise.

Roof Area = 3179.51 sq.ft.
Ridge Line = 116.21 ft.
Hip Line = 0 ft.
Horiz. OH = 88.97 ft.
Raked OH = 221.34 ft.
Decking = 109 sheets

Connector Information				Nail Information	
Sym	Product	Manuf	Qty	Supported Member	Header / Truss
	HUS26	USP	8	Varies	16d/3-1/2" / 16d/3-1/2"
	HUS410	USP	1	Varies	16d/3-1/2" / 16d/3-1/2"

THIS IS A TRUSS PLACEMENT DIAGRAM ONLY. These trusses are designed as individual building components to be incorporated into the building design at the specification of the building designer. See individual design sheets for each truss design identified on the placement drawing. The building designer is responsible for temporary and permanent bracing of the roof and floor system and for the overall structure. The design of the truss support structure including headers, beams, walls, and columns is the responsibility of the building designer. For general guidance regarding bracing, consult BCSI-B1 and BCSI-B3 provided with the truss delivery package or online @ sbcindustry.com

BUILDER	WEAVER DEVELOPMENT	COUNTY	HARNETT
JOB NAME	Lot 2 Pittman Farm	ADDRESS	Lot 2 Pittman Farm
PLAN	Halifax II	MODEL	Roof / GR / 4BR
SEAL DATE	Seal Date	DATE REV.	01/03/20 07:48:05
QUOTE #		DRAWN BY	David Landry
JOB #	J0120-0019	SALESMAN	Lenny Norris