

Products				
PlotID	Length	Product	Plies	Net Qty
Window Hdr.	7-0-0	1-3/4"x 11-7/8" LVL Kerto-S	2	2
GDH	23-0-0	1-3/4"x 14" LVL Kerto-S	2	2
FB1	12-0-0	1-3/4"x 14" LVL Kerto-S	2	2
FB2	23-0-0	1-3/4"x 23-7/8" LVL Kerto-S	3	3

■ = USP HUS410 2x Hanger

■ = USP MSH422 2x Strap Hanger

△ = Indicates Left End of Truss
(Reference Engineered Truss Drawing)
Do NOT Erect Truss Backwards

Truss Placement Plan
SCALE: NTS


LOAD CHART FOR JACK STUDS

MEMBER ACTION (UP TO 10)	REACTING MEMBER ACTION (UP TO 10)	MEMBER ACTION (UP TO 10)	REACTING MEMBER ACTION (UP TO 10)
1700 1	2550 1	3400 1	
3400 2	5100 2	6500 2	
5100 3	7650 3	10500 3	
6800 4	10200 4	13500 4	
8500 5	12750 5	17000 5	
10200 6	15300 6		
11900 7			
13600 8			
15300 9			

BUILDER	Weaver Development Co. Inc.	COUNTY	Harnett
JOB NAME	Lot 4 Pittman Farm	ADDRESS	Lot 4 Pittman Farm
PLAN	The Gaston II (181035B)	MODEL	Floor
SEAL DATE	N/A	DATE REV.	/ /
QUOTE #	Quote #	DRAWN BY	Marshall Naylor
JOB #	J0120-0048	SALESMAN	Lenny Norris

THIS IS A TRUSS PLACEMENT DIAGRAM ONLY. These trusses are designed as individual building components to be incorporated into the building design at the specification of the building designer. See individual design sheets for each truss design identified on the placement drawing. The building designer is responsible for temporary and permanent bracing of the roof and floor system and for the overall structure. The design of the truss support structure including headers, beams, walls, and columns is the responsibility of the building designer. For general guidance regarding bracing, consult BCSI-B1 and BCSI-B3 provided with the truss delivery package or online @ sbcindustry.com	
Bearing reactions less than or equal to 3000# are deemed to comply with the prescriptive Code requirements. The contractor shall refer to the attached Tables (derived from the prescriptive Code requirements) to determine the minimum foundation size and number of wood studs required to support reactions greater than 3000# but not greater than 15000#. A registered design professional shall be retained to design the support system for any reaction that exceeds those specified in the attached Tables. A registered design professional shall be retained to design the support system for all reactions that exceed 15000#.	
Signature	Marshall Naylor

<p>ROOF & FLOOR TRUSSES & BEAMS</p> <p>Reilly Road Industrial Park Fayetteville, N.C. 28309 Phone: (910) 864-8787 Fax: (910) 864-4444</p>	
--	--

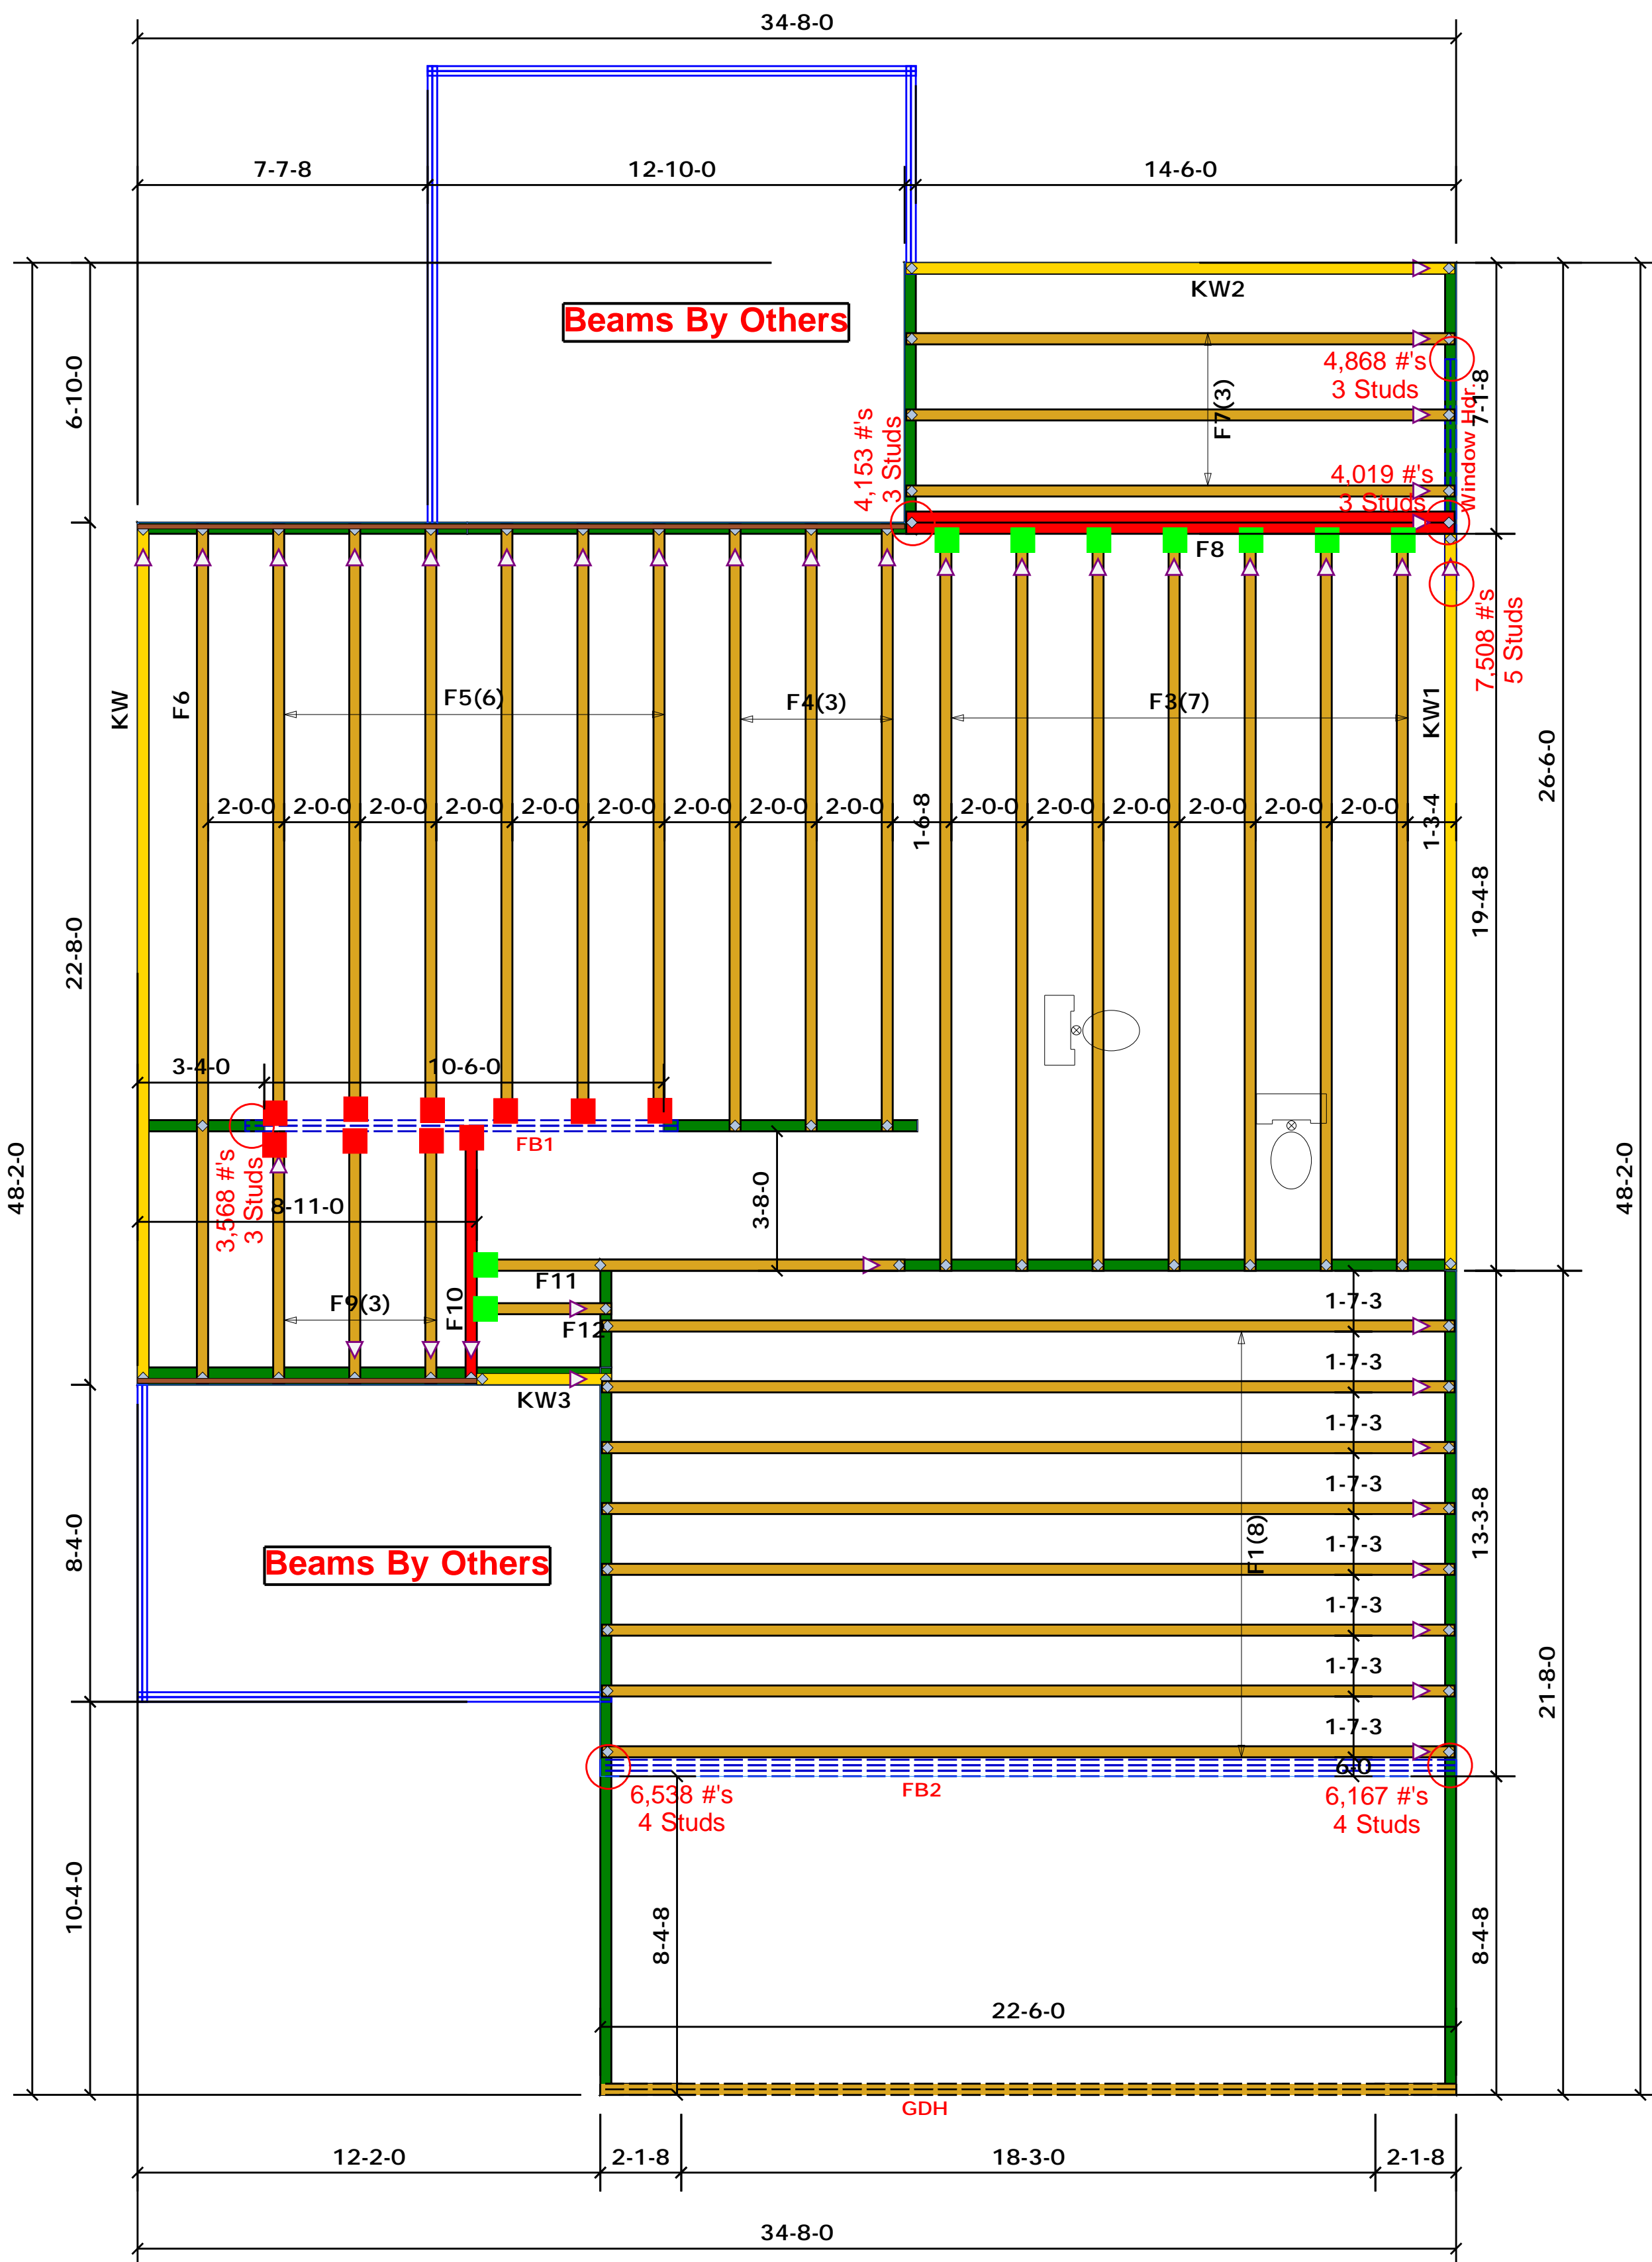

ProductID	Length	Product	Plies	Net Qty
Window Hdr.	7-0-0	1-3/4"x 11-7/8" LVL Kerto-S	2	2
GDH	23-0-0	1-3/4"x 14" LVL Kerto-S	2	2
FB1	12-0-0	1-3/4"x 14" LVL Kerto-S	2	2
FB2	23-0-0	1-3/4"x 23-7/8" LVL Kerto-S	3	3

- = USP HUS410 2x Hanger
- = USP MSH422 2x Strap Hanger

△ = Indicates Left End of Truss
 (Reference Engineered Truss Drawing)
 Do NOT Erect Truss Backwards

Truss Placement Plan
 SCALE: NTS

LOAD CHART FOR JACK STUDS

MEMBER SIZE (UP TO 10')	MEMBER SIZE (10'-0" TO 15'-0")	MEMBER SIZE (15'-0" TO 20'-0")	MEMBER SIZE (20'-0" TO 25'-0")	MEMBER SIZE (25'-0" TO 30'-0")
1700	1	2550	1	3400
3400	2	5100	2	6800
5100	3	7650	3	10200
6800	4	10200	4	13600
8500	5	12750	5	17000
10200	6	15300	6	
11900	7			
13600	8			
15300	9			

BUILDER	Weaver Development Co. Inc.	COUNTY	Harnett
JOB NAME	Lot 4 Pittman Farm	ADDRESS	Lot 4 Pittman Farm
PLAN	The Gaston II (181035B)	MODEL	Floor
SEAL DATE	N/A	DATE REV.	//
QUOTE #	Quote #	DRAWN BY	Marshall Naylor
JOB #	J0120-0048	SALESMAN	Lenny Norris

THIS IS A TRUSS PLACEMENT DIAGRAM ONLY. These trusses are designed as individual building components to be incorporated into the building design at the specification of the building designer. See individual design sheets for each truss design identified on the placement drawing. The building designer is responsible for temporary and permanent bracing of the roof and floor system and for the overall structure. The design of the truss support structure including headers, beams, walls, and columns is the responsibility of the building designer. For general guidance regarding bracing, consult BCSH-B1 and BCSH-B3 provided with the truss delivery package or online @ sbcindustry.com	
Bearing reactions less than or equal to 3000# are deemed to comply with the prescriptive Code requirements. The contractor shall refer to the attached Tables (derived from the prescriptive Code requirements) to determine the minimum foundation size and number of wood studs required to support reactions greater than 3000# but not greater than 15000#. A registered design professional shall be retained to design the support system for any reaction that exceeds those specified in the attached Tables. A registered design professional shall be retained to design the support system for all reactions that exceed 15000#.	
Signature:	Marshall Naylor

Reilly Road Industrial Park
 Fayetteville, N.C. 28309
 Phone: (910) 864-8787
 Fax: (910) 864-4444

comtech
 ROOF & FLOOR
 TRUSSES & BEAMS