
Harnett County Department of Public Health

	, D			
	Improvement Permit			
	A building permit cannot be issued with only an Improvement			
	PROPERTY LOCATION: 47 White	Cloud Ln (SR#1320		
ISSUED TO: Galt Land Developmen	t SUBDIVISION Summerlin		LOT # 52	
	NSION Site Improvements red	quired prior to Construction Authoriz	ration Issuance:	
Type of Structure: SFD 52'x48'				
Proposed Wastewater System Type: 25% Red	uction			
Projected Daily Flow: 480 GPD				
Number of bedrooms: 4 Number of 0	ccupants: <u>8</u> max			
Basement Yes No				
	equired based on final location and elevations of facilities			
Type of Water Supply: Community 🔀 Public	Well Distance from well feet	Permit valid for:	▼ Five years	
Permit conditions:			No expiration	
6	,			
Authorized State Agents:	DEH'S I Date: 6/5/2020	ATTA 222	CHED SITE SKETCH	
Authorized State Agent:	uarantees the issuance of other permits. The permit holder is responsible for che			
	use changes. The Improvement Permit shall not be affected by a change in own			
the Laws and Rules for Sewage Treatment and Disposal and to con-		5 5 55	2	
	Construction Authorization			
The construction and installation requirements of Pules 1000 100	(Required for Building Permit) 2, 1954, 1955, 1956, 1957, 1958, and 1959 are incorporated by references	into this parmit and shall be mot furtame.	shall be installed in accordance	
with the attached system layout.	5. 1734, 1733, 1730, 1737, 1730. and 1737 are incorporated by references	into tius permit and shan be met systems :	man pe mstaneu m accordance	
Control control of the Control of th				
ISSUED TO: Galt Land Developmen	nt PROPERTY LOCATION: 47 W	hite Cloud Ln (SR#1	1320)	
	SUBDIVISION Summerlin		LOT # 52	
Facility Type: SFD 52'x48'	New □ Expansion □ Repair			
	Fixtures? Yes No			
Type of Wastewater System** 25% Red		(Initial) Wastewater Flow:	480 GPD	
(See note below, if applicable)		(
25% Rec	duction (Repair)			
	Number of trenches 1			
Installation Requirements/Conditions		Turnel Consider O		
Septic Tank Size 1000 gallons	Exact length of each trench 300 feet	Trench Spacing: 9		
Pump Tank Sizegallons	Trenches shall be installed on contour at a		nches	
	Maximum Trench Depth of: 18inches	(Maximum soil cover shall no		
	(Trench bottoms shall be level to +/-1/4"	36" above the trench botto	om)	
	in all directions)			
Pump Requirements:ft. TDH vs	GPM		inches below pipe	
		Aggregate Depth:	inches above pipe	
Conditions:			inches total	
WATER LINES (INCLUDING IRRIGATION) MILE	ST BE 10FT. FROM ANY PART OF SEPTIC SYSTEM OR I	DEDAID ADEA		
		KETAIK AKEA.		
NO UTILITIES ALLOWED IN INITIAL OR REPAI	R DRAIN FIELD AREA.			
**If applicable: I understand the system type speci	ified is different from the type specified on the application.	. I accept the specifications of the	his permit.	
	,, ,	* *		
ner/Legal Representative Signature: Date:				
This Construction Authorization is subject to revocation if the site plan, plat, or the intended use changes. The Construction Authorization shall not be transferred when there is a change in ownership of the site. This				
Construction Authorization is subject to compliance with the provisions of the Laws and Rules for Sewage Treatment and Disposal and to the conditions of this permit.				
1 1	1/1/			
Authorized State Agent: Date: 6/5/2020				
HULIIOTIZEU STATE ABEITT.	7		_	
Construction Authorization Expiration Date: 6/5/2025				

Harnett County Department of Public Health Site Sketch

Property Location: 47 White Cloud Ln (SR # 1320)
Issued To: Gat Land Development subdivision Summerin	Lot # 52
Authorized State Agent: BABAL REHS-I	Date: 45 2020

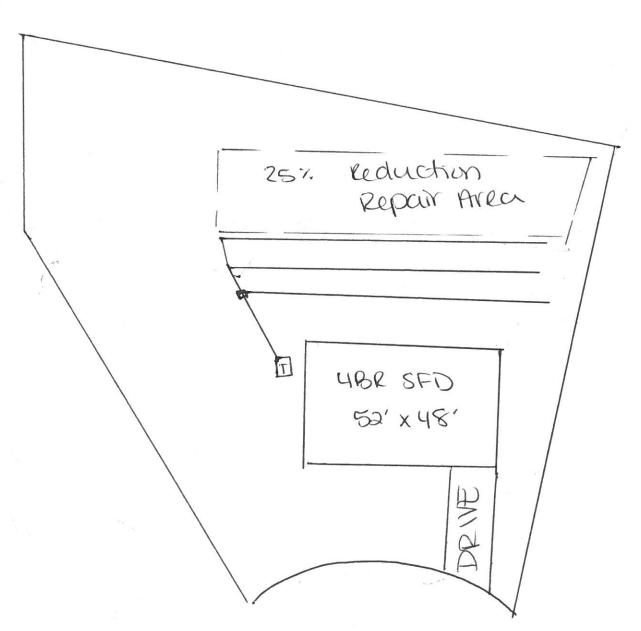

This drawing is for illustrative purposes only. System installation must meet all pertinent laws, rules, and regulations.