

HTE# SFD 2006-0052

Harnett County Department of Public Health

No. 26740

PERMIT # NA

Operation Permit

SL1429

New Installation Septic Tank Nitrification Line Repair Expansion

PROPERTY LOCATION: 59 DOONBROOK DR. (CHALMERS ROAD)

Name: (owner) LEE HOMES NC LLC SUBDIVISION AGONY POND PH III LOT # 157

System Installer: THORNTONS PLUMBING Registration # _____


Basement with plumbing: Garage Number of Bedrooms 3

Type of Water Supply: Community Public Well Distance from well NA feet

System Type: 25% REDUCTION SS-III-B Types V and VI Systems expire in 5 years.

(In accordance with Table V a) Owner must contact Health Department 6 months prior to expiration for permit renewal.

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

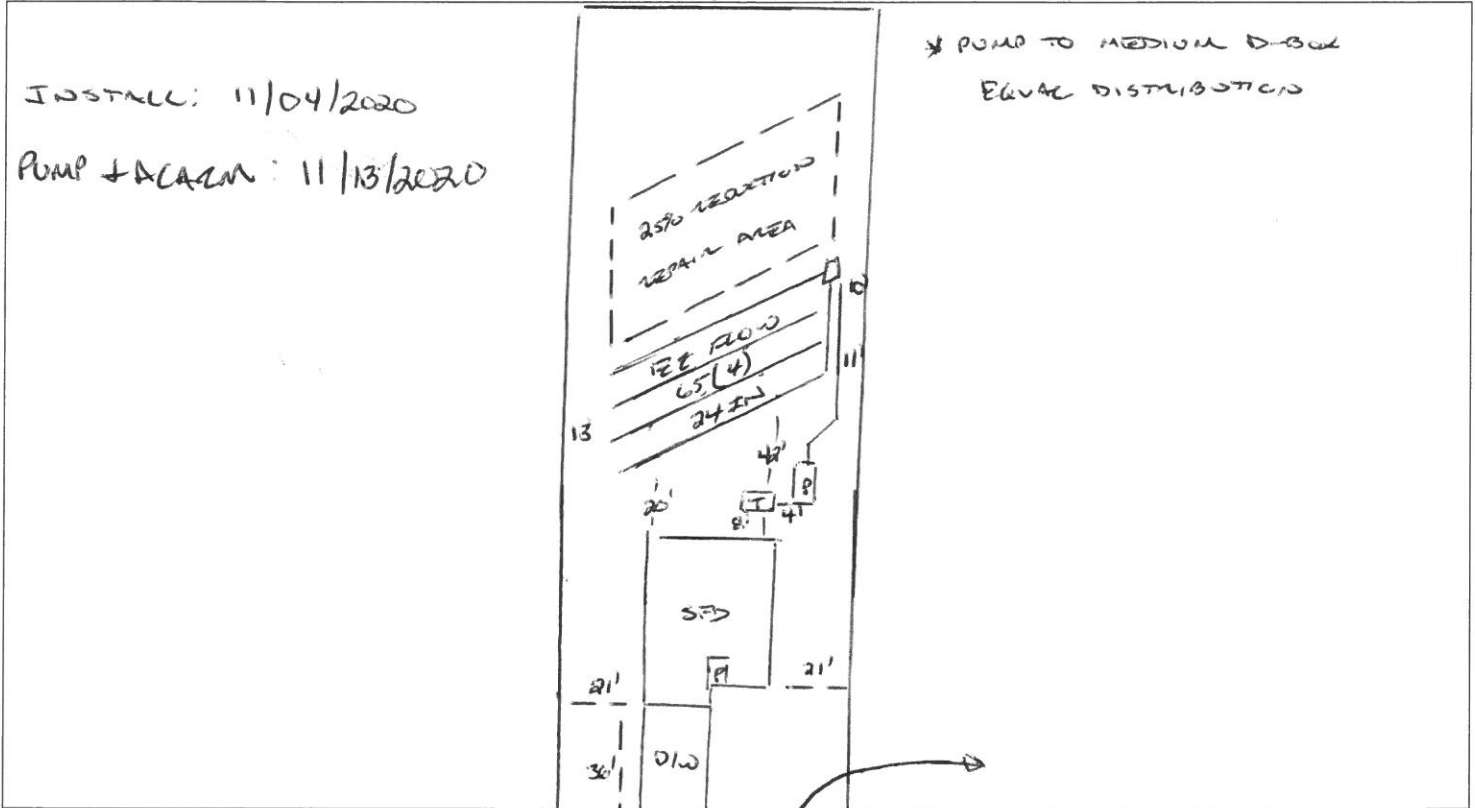

PERMIT CONDITIONS:

- I. Performance: System shall perform in accordance with Rule .1961.
- II. Monitoring: As required by Rule .1961.
- III. Maintenance: As required by Rule .1961. Other: _____
Subsurface system operator required? Yes No
If yes, see attached sheet for additional operation conditions, maintenance and reporting.
- IV. Operation: _____
- V. Other: _____

D-Box Pump Alarm H2O Line PWR Line

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system: Conventional Other 12' FLOW III-B Septic Tank: 1000 gallons Pump Tank: 1000 gallons

Subsurface No. of 4 exact length width of depth of
Drainage Field ditches _____ of each ditch 65 feet ditches 3 feet ditches 24 inches

French Drain Required: _____ Linear feet

Authorized State Agent [Signature] Date 11/13/2020