## Harnett County Department of Public Health

## Improvement Permit

A building permit cannot be issued with only an Improvement Permit


ISSUED TO: LGI Homes - NC, LLC	PROPERTY LOCATION: 76 Doonbeg SUBDIVISION Avery Pond	Dr. (Chalybeate Rd SR 142
NEW   REPAIR   EXPANSION   EX		prior to Construction Authorization Issuance:
Type of Structure: 39x48 sfd, 3 beds 2 baths		The second secon
Proposed Wastewater System Type: 25% Reduction Sys.		
Projected Daily Flow: 360 GPD		
The state of the s	max	
Basement ☐Yes ☒ No ☐ May be required based on final lo	ration and elevations of facilities	
· · · · · · · · · · · · · · · · · · ·	e from well NA feet	Permit valid for: X Five years
Permit conditions:		No expiration
111		,
Authorized State Agent:	Date: <u>97/21/2030</u>	
The issuance of this permit by the Health Department in no way guarantees the issuance of other site is subject to revocation if the site plan, plat, or the intended use changes. The Improvement I the Laws and Rules for Sewage Treatment and Disposal and to conditions of this permit.	permits. The permit holder is responsible for checking wermit shall not be affected by a change in ownership of	with appropriate governing bodies in meeting their requirements. This of the site. This permit is subject to compliance with the provisions of
	iction Authorization	
AND THE RESIDENCE OF THE PARTY	ired for Building Permit)	
The construction and installation requirements of Rules .1950, .1952, .1954, .1955, .1956, .1957, with the attached system layout.	1958, and .1959 are incorporated by references into th	ns permit and shall be met. Systems shall be installed in accordance
ISSUED TO: LGI Homes - NC, LLC	PROPERTY LOCATION: 76 Doon SUBDIVISION Avery Pond	beg Dr. (Chalybeate Rd SR 1
Facility Type: 39x48 sfd, 3 beds 2 baths New	☐ Expansion ☐ Repair	
Basement? Yes No Basement Fixtures? Yes	□ No	
Type of Wastewater System** 25% Reduction System		(Initial) Wastewater Flow: 360 GPD
(See note below, if applicable ) Sp1:4 50% 13 PPGP3	? \$J\$. (Repair)	
Installation Requirements/Conditions Number of trench	es <u>1</u>	
Septic Tank Size 1000 gallons Exact length of e		nch Spacing: 9 Feet on Center
,		Cover: 6-12 inches
	and the same and t	Maximum soil cover shall not exceed
	hall be level to +/-1/4"	36" above the trench bottom)
in all directions)		NIA
Pump Requirements:ft. TDH vsGPM	Age	NA inches below pipe
Conditions: Gravity to 225ft Serial	Agg	gregate Depth: NA inches above pipe NA inches total
Conditions. Cravity to 2201 Condi		INC. Inches total
WATER LINES (INCLUDING IRRIGATION) MUST BE 10FT. FROM AN NO UTILITIES ALLOWED IN INITIAL OR REPAIR DRAIN FIELD AREA		IR AREA.
**If applicable: 1 understand the system type specified is different from the	e type specified on the application. I ac	rcept the specifications of this permit.
Owner/Legal Representative Signature:		Date:
This Construction Authorization is subject to revocation if the site plan, plat, or the intended use of	anges. The Construction Authorization shall not be trans	
Construction Authorization is subject to compliance with the provisions of the Laws and Rules for Se	wage Treatment and Disposal and to the conditions of	this permit. SEE ATTACHED SITE SKETCH
		. 1
Authorized State Agent:	Date:	07/21/2000
	ection Authorization Expiration Date:	67/21/2005

## Harnett County Department of Public Health Site Sketch


Property Location: 76 Doonbeg Dr. (Chalybeate Rd. - SR 1429)

Issued To: LGI Homes - NC, LLC Subdivision Avery Pond Lot # 161

Authorized State Agent: Date: 07 | 21 | 2020

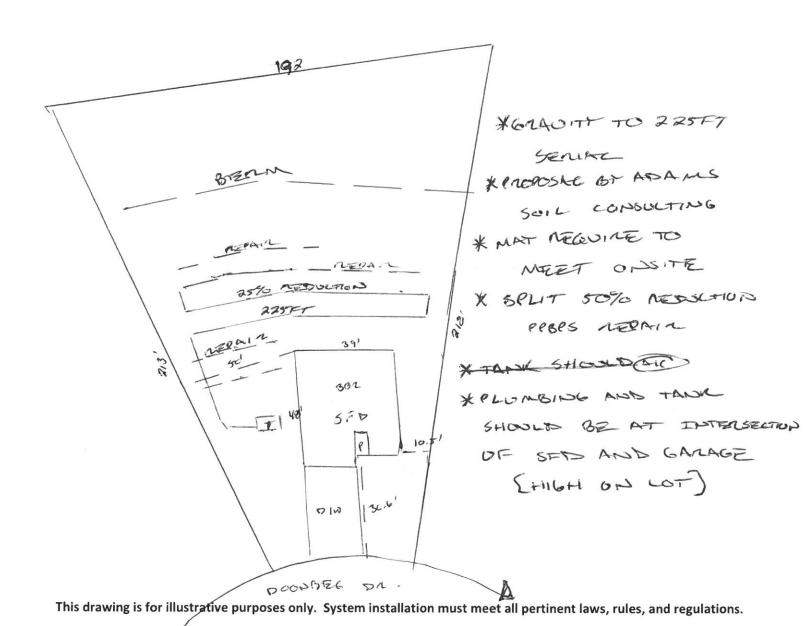

## Avery Pond 3-Bedroom Septic Proposal Lot #161

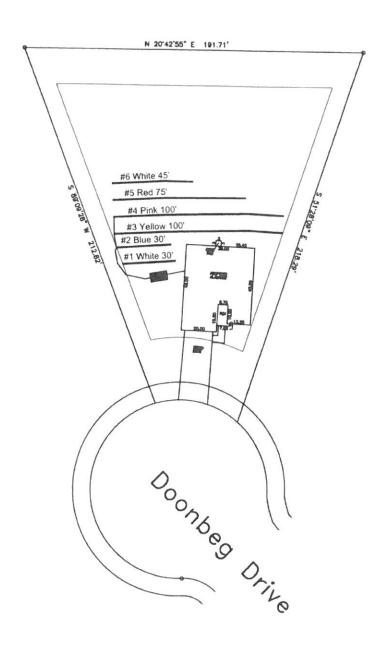

System: Gravity to Serial Dist

Lines: 2-4 (225')

0.4LTAR


18-24" Trench Bottom Accepted Status System Repair: Pressure Manifold

Lines: 1, 5-6 (150')

0.4 LTAR

18" Trench Bottom

T&J Panel 50% Reduction System



Adams Soil Consulting 919-414-6761 Job #708

Avery Pond Lot #161

3-Bedroom Home (360 gal./day)

LINE #	COLOR	BS	Ш	FS	ELEVATION	LINE LENGTH	Design Length
TBM		2.0		100.0		in field	installation
INST. 1			102.0				
1	White			5.7	96.3	30	30
2	Blue			6.1	95.9	30	30
3	Yellow			6.6	95.4	100	100
4	Pink			7	95	110	100
5	Red			7.4	94.6	75	75
6	White			7.7	94.3	45	45
Total							
				System		Repair	
				Lines 2-4		Lines 1, 5-6	
System Type		Accep	Accepted Status System		% Reduction Syste	em	
				EZ-FLOW		T&J Panel	
Suggested Soil LTAR		0.40			0.40		
222							
Total Line Length			230		150		
	<b>-</b>	202		700		450	
Square Footage		690			450		
Propo	sed Trench E	Rottom		24"		24"	
Поро	sed HellCh L	ottom		24		. 24	
						Pressure	
			G	ravity to		Manifold to T& J	
Dist	ribution Met	thod	S	erial Dist.		Panel System	