


# Olde Mill Village 4-Bedroom Septic Proposal Lot #6

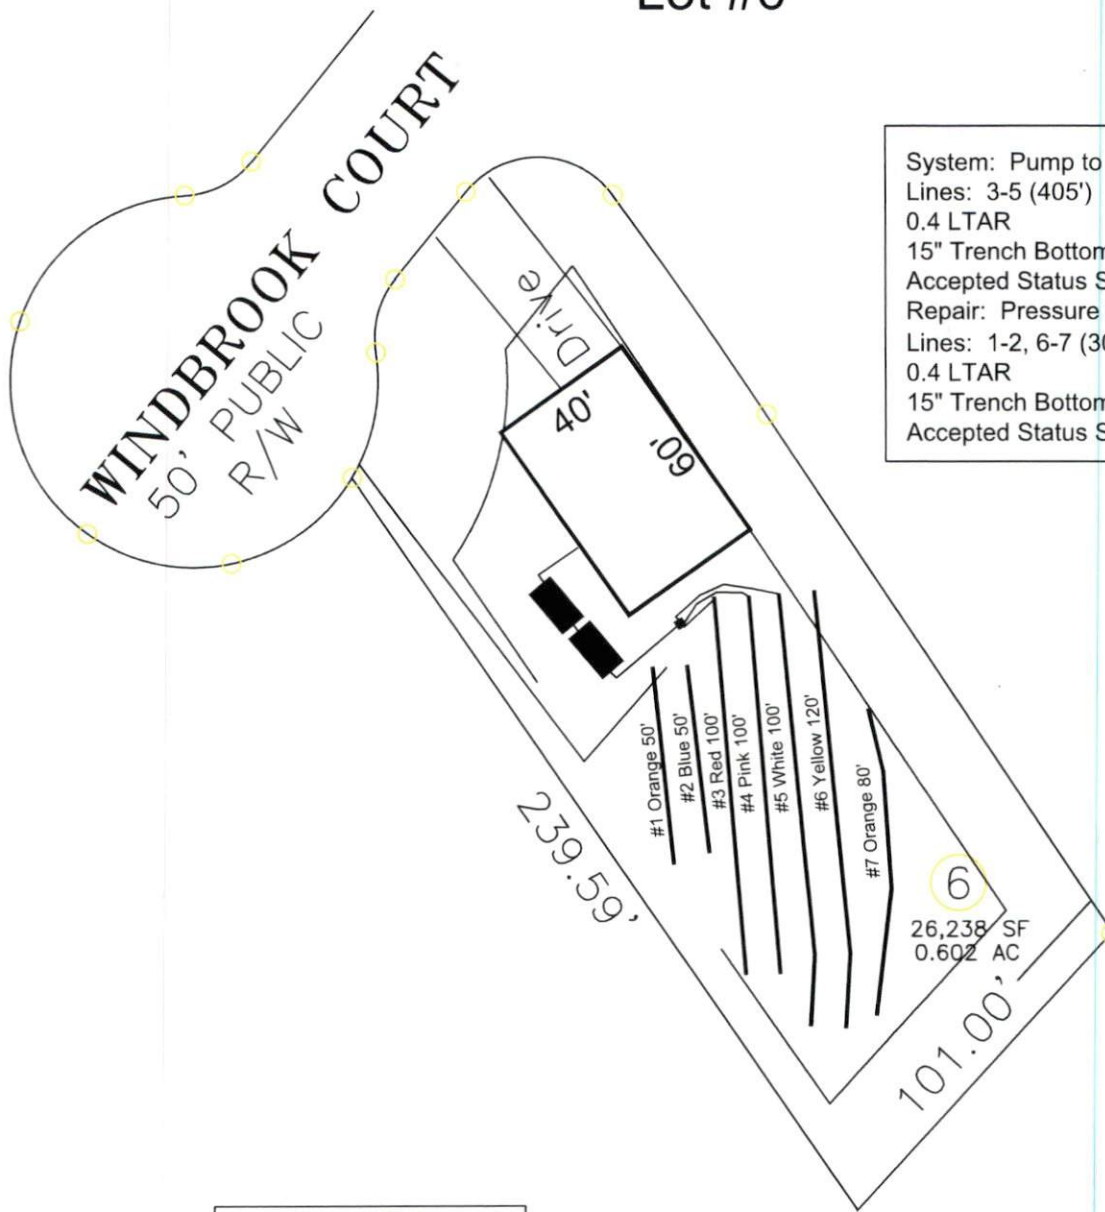

System: Pump to D-Box  
Lines: 3-5 (405')  
0.4 LTAR  
15" Trench Bottom  
Accepted Status System  
Repair: Pressure Manifold  
Lines: 1-2, 6-7 (300')  
0.4 LTAR  
15" Trench Bottom  
Accepted Status System

**\*Preliminary Design  
Not a Permit**

GRAPHIC SCALE  
1" = 50'



Adams  
Soil Consulting  
919-414-6761  
Job #699