



--- 19
RFC49-16

--- 1
RFC49-18

RELIABLE Model RFC49 Concealed Pendant Spr FP
K=4.9, 155F°, 7/16" Orifice, Maximum Spacing 16"x16"
Sprinkler head demand: 13 gpm @ 7.04


RELIABLE Model RFC49 Concealed Pendant Spr FP
K=4.9, 155F°, 7/16" Orifice, Maximum Spacing 18"x18"
Sprinkler head demand: 17 gpm @ 12.03

SPRINKLER DESCRIPTIONS


Most Demanding Single Head Information	
Information	Results
Flow Required at Head (GPM):	17
Source Pressure at Head (PSI):	12.03
Maximum Spacing (length):	18
Maximum Spacing (Width):	18
Domestic Flow Added (GPM):	0
Sprinkler Model:	RFC49
Elevation of Highest Head:	108
K-Factor	4.9
Temperature Rating:	155
Flow Required at Source (GPM)	17
Pressure Required at Source (psi)	33.19
Source Reference Point:	At Ref Pt STR
C-Factor of Sprinkler Pipe	150
C-Factor of Service Line	150
Head Reference Point:	H.5

Most Demanding Two Head Information	
Information	Results
Flow Required at Head (GPM):	13
Source Pressure at Head (PSI):	7.04
Maximum Spacing (length):	16
Maximum Spacing (Width):	16
Domestic Flow Added (GPM):	0
Sprinkler Model:	RFC49
Elevation of Highest Head:	117
K-Factor	4.9
Temperature Rating:	155
Flow Required at Source (GPM)	26.229
Pressure Required at Source (psi)	50.22
Source Reference Point:	At Ref Pt STR
C-Factor of Sprinkler Pipe	150
C-Factor of Service Line	150
Head Reference Point:	H.20 & H.16

LEGEND	
	Manifold
	Inter Level Connection
	Hot Water Fixture
	Cold Water Fixture
	Type K Copper w/ ProPress Fittings
	Type L Copper w/ ProPress Fittings
	Type M Copper w/ ProPress Fittings
	ViegaPEX Ultra Black
	ViegaPEX Ultra Blue - Cold Plumbing
	ViegaPEX Ultra Red - Hot Plumbing

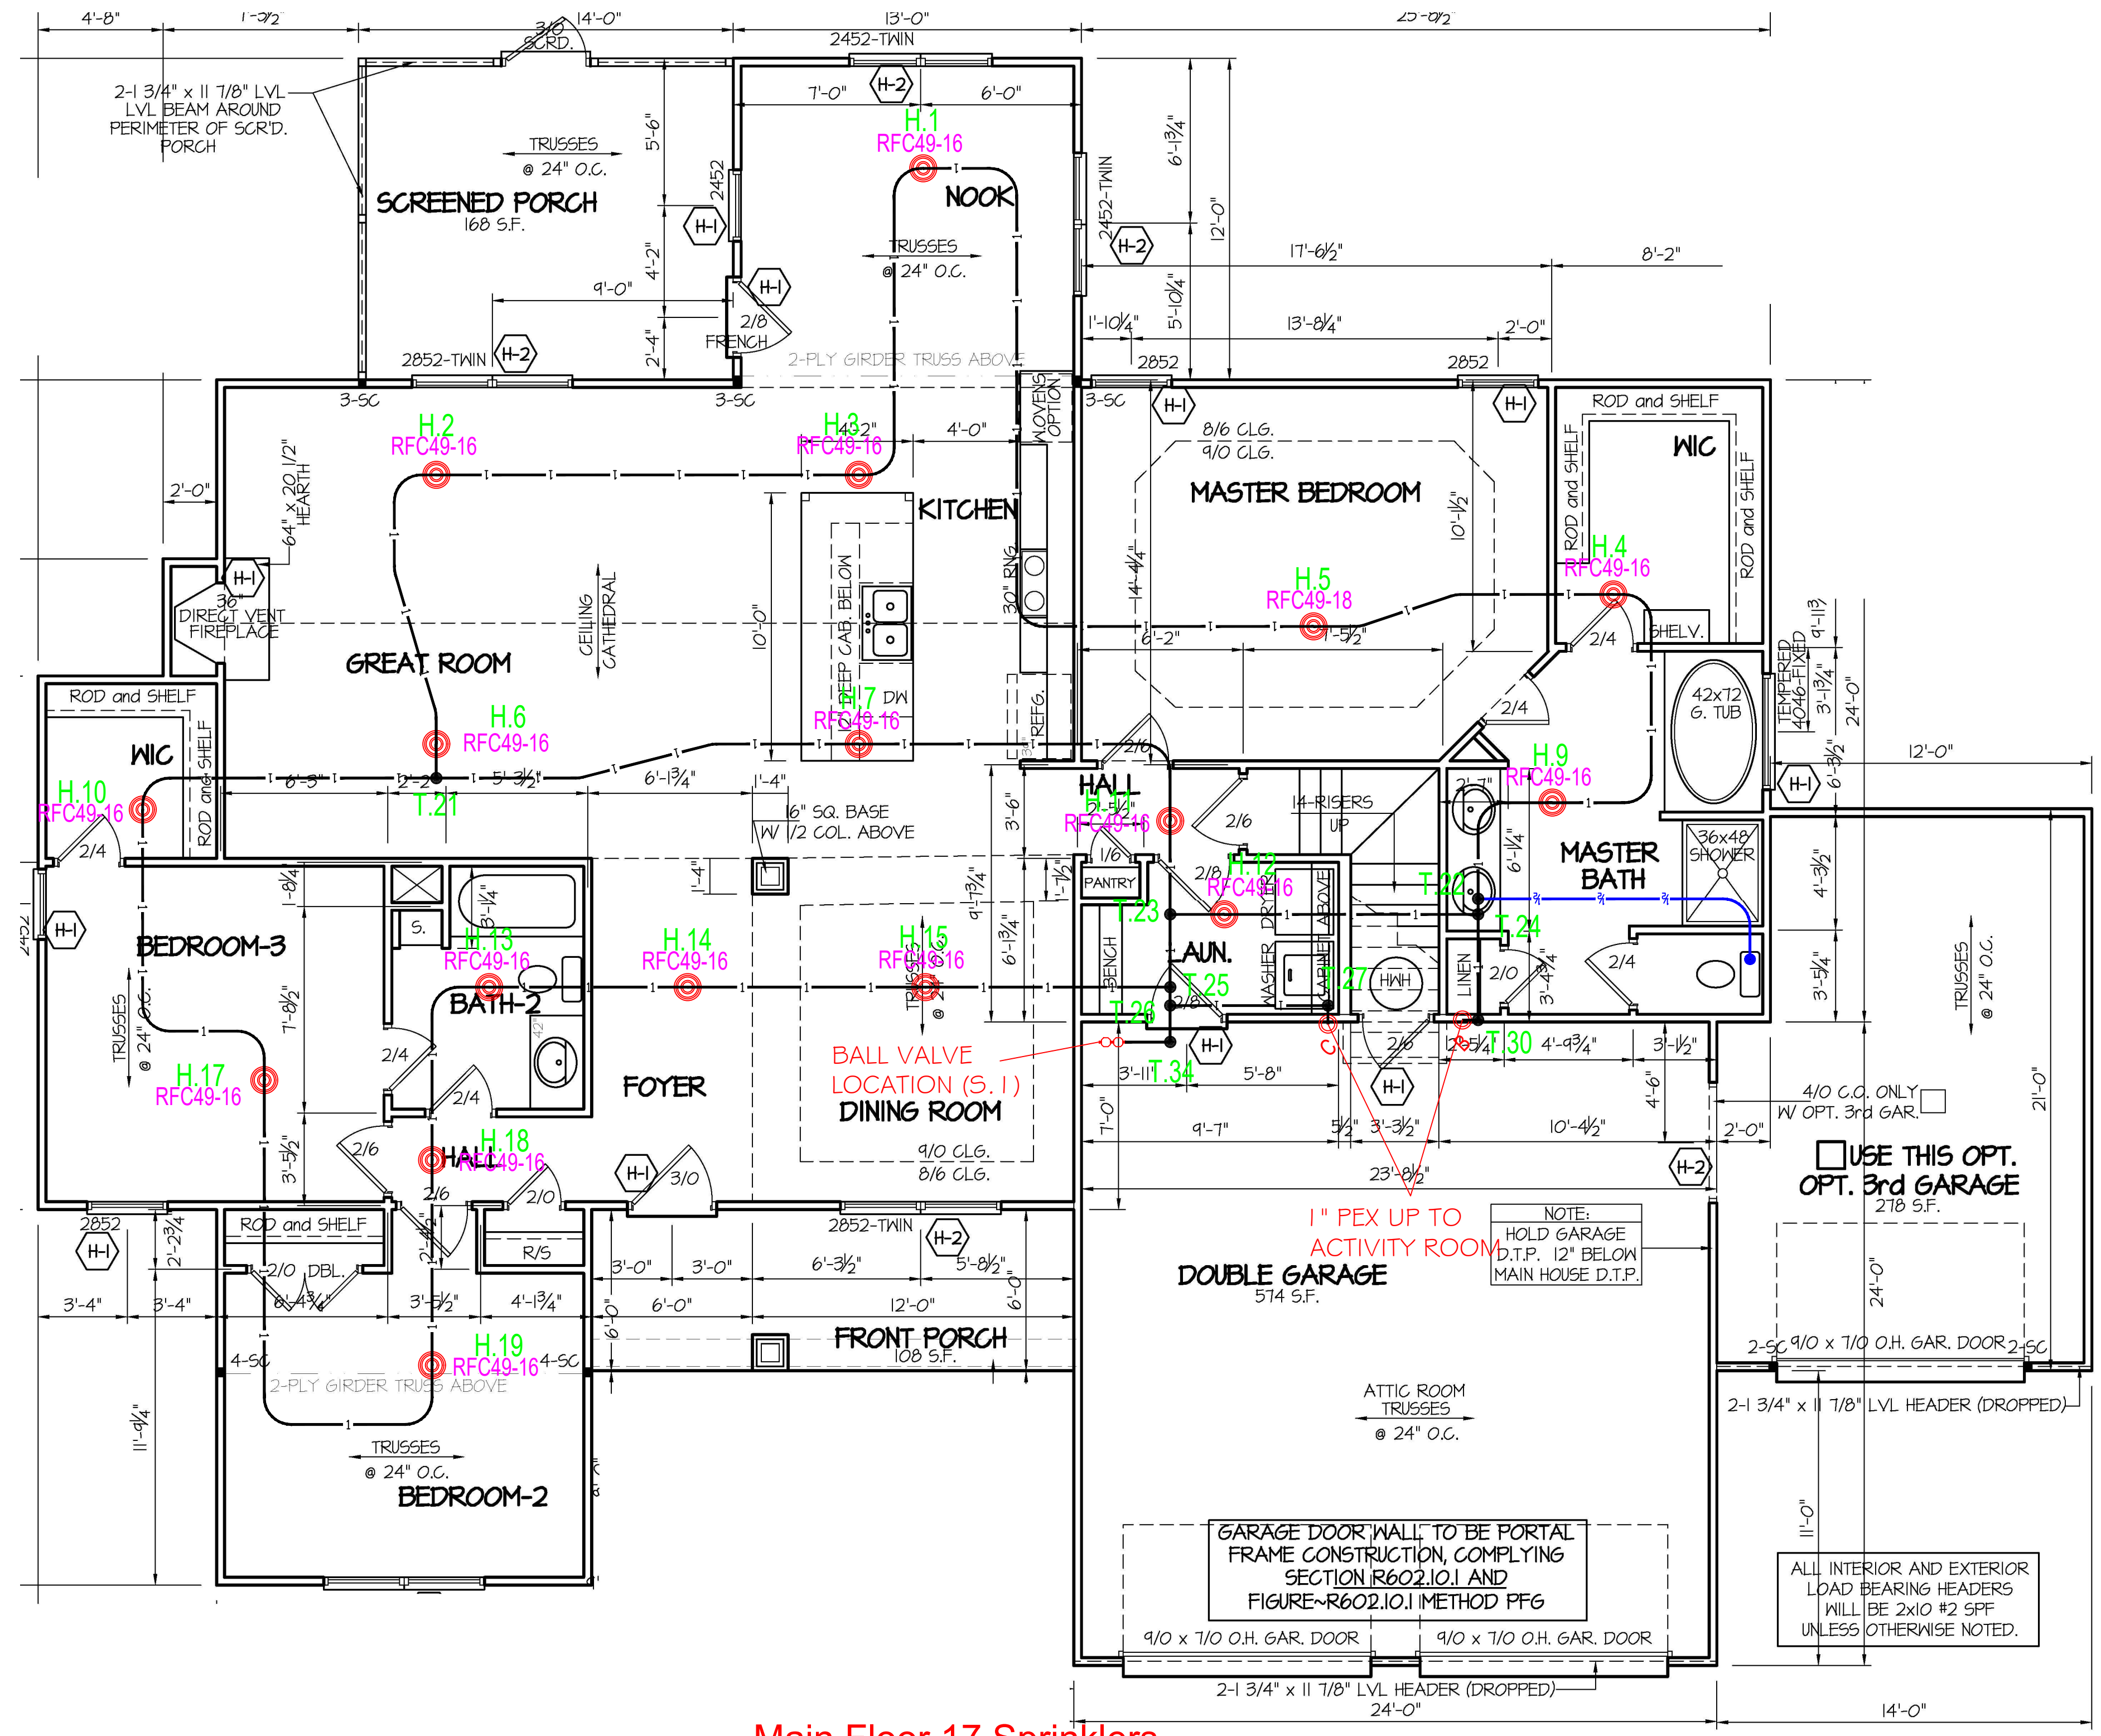

Main Floor 17 Sprinklers

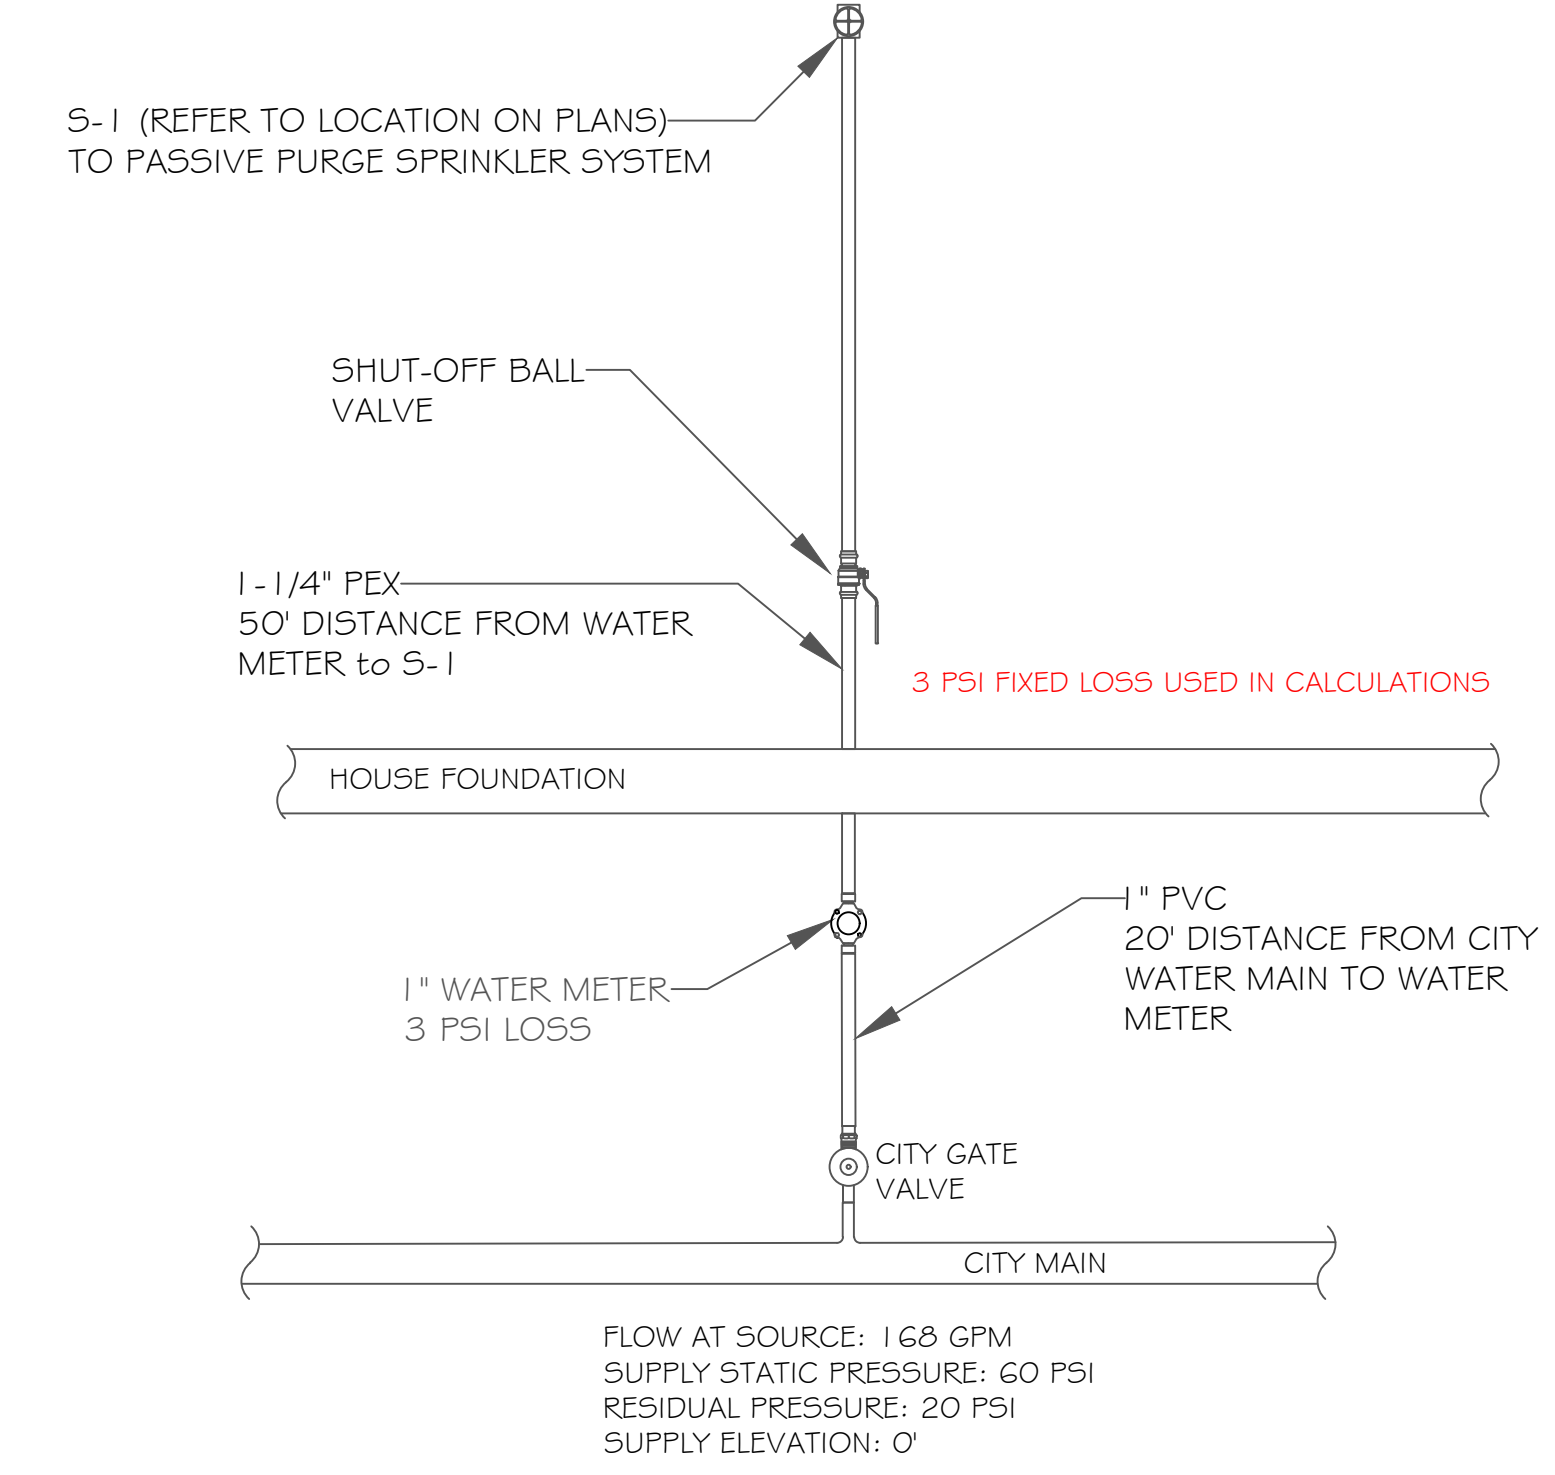

WATER SERVICE DETAIL

1) CHECK AND CONFIRM ALL PIPE SIZES, CALCULATIONS, MATERIALS, PLUMBING AND/OR FIRE CODES USED OR APPLICABLE; AND
2) PRESENT THE DRAWINGS TO YOUR PROFESSIONAL ENGINEER FOR REVIEW AND APPROVAL AND HAVE THE DRAWINGS MARKED "FINAL" BY YOUR PROFESSIONAL ENGINEER.

IF YOUR PROFESSIONAL ENGINEER REPORTS ANY ERRORS IN THE DRAWINGS OR MAKES ANY CHANGES IN THE DRAWINGS, THESE ERRORS OR CHANGES MUST BE COMMUNICATED TO VIEGA LLC'S DESIGN SERVICES DEPARTMENT FOR A DETERMINATION IF A REVISION TO THE DESIGN IS NECESSARY.

VIEGA LLC DISCLAIMS ANY WARRANTIES, EXPRESS OR IMPLIED, ASSOCIATED WITH THE DESIGN OF THE SYSTEM OR ITS USE. ALL DESIGNS ARE PROVIDED "AS IS" AND IT IS YOUR SOLE RESPONSIBILITY TO CONFIRM AND ENSURE THAT THE SYSTEM TO BE INSTALLED WILL OPERATE AND FUNCTION IN COMPLIANCE WITH ALL APPLICABLE CODES AND IN ACCORDANCE WITH ALL APPLICABLE SPECIFICATIONS.

Design Services Department
1900 Southwood Drive - Nashua, NH 03063
Tel: 877-843-4262 x 351 Fax: 316-425-8466

Project:
218 OAKHAVEN DRIVE, LOT 4
HOLLY SPRINGS, NC 27540

Dwg no.:
FP 1

Title:
MAIN FLOOR PLAN

Quotation no.: FPNM2103-002 NC

Drawn by: N.M.

Approved by:

Date Submitted: 3/3/2021

Scale: 1/4" = 1'

Revision No: Revision Date:


VEIGA LLC'S DESIGN SERVICES DEPARTMENT HAS PREPARED THIS SERIES OF DRAWINGS AS THE FIRST DESIGN FOR PLUMBING, RADIANT, SNOW MELTING OR FIRE SUPPRESSION SYSTEMS FOR THE USE OF YOU, OUR CUSTOMER, IN PREPARING / OBTAINING SPECIFICATIONS, BIDS AND PROPOSALS IN RELATION TO THE SALE OF THESE SYSTEMS. THESE DRAWINGS ARE BASED UPON INFORMATION PROVIDED BY YOU AND HAVE BEEN PREPARED TO APPROPRIATE PROFESSIONAL STANDARDS OF DESIGN BASED UP THAT INFORMATION. THESE DRAWINGS ARE NOT TO BE CONSIDERED FINAL AND, PRIOR TO PERFORMING ANY WORK ASSOCIATED WITH THESE DESIGNS OR DRAWINGS, YOU MUST:

- 1) CHECK AND CONFIRM ALL PIPE SIZES, CALCULATIONS, MATERIALS, PLUMBING AND / OR FIRE CODES USED OR APPLICABLE; AND
- 2) PRESENT THE DRAWINGS TO YOUR PROFESSIONAL ENGINEER FOR REVIEW AND APPROVAL AND HAVE THE DRAWINGS MARKED "FINAL" BY YOUR PROFESSIONAL ENGINEER.

IF YOUR PROFESSIONAL ENGINEER REPORTS ANY ERRORS IN THE DRAWINGS OR MAKES ANY CHANGES IN THE DRAWINGS, THESE ERRORS OR CHANGES MUST BE COMMUNICATED TO VEIGA LLC'S DESIGN SERVICES DEPARTMENT FOR A DETERMINATION IF A REVISION TO THE DESIGN IS NECESSARY.

VEIGA LLC DISCLAIMS ANY WARRANTIES, EXPRESS OR IMPLIED, ASSOCIATED WITH THE DESIGN OF THE SYSTEM OR ITS USE. ALL DESIGNS ARE PROVIDED "AS IS" AND IT IS YOUR SOLE RESPONSIBILITY TO CONFIRM AND ENSURE THAT THE SYSTEM TO BE INSTALLED WILL OPERATE AND FUNCTION IN COMPLIANCE WITH ALL APPLICABLE CODES AND IN ACCORDANCE WITH ALL APPLICABLE SPECIFICATIONS.

Design Services Department
1900 Southwood Drive - Nashua, NH 03063
Tel: 877-843-4262 x 351 Fax: 316-425-8466

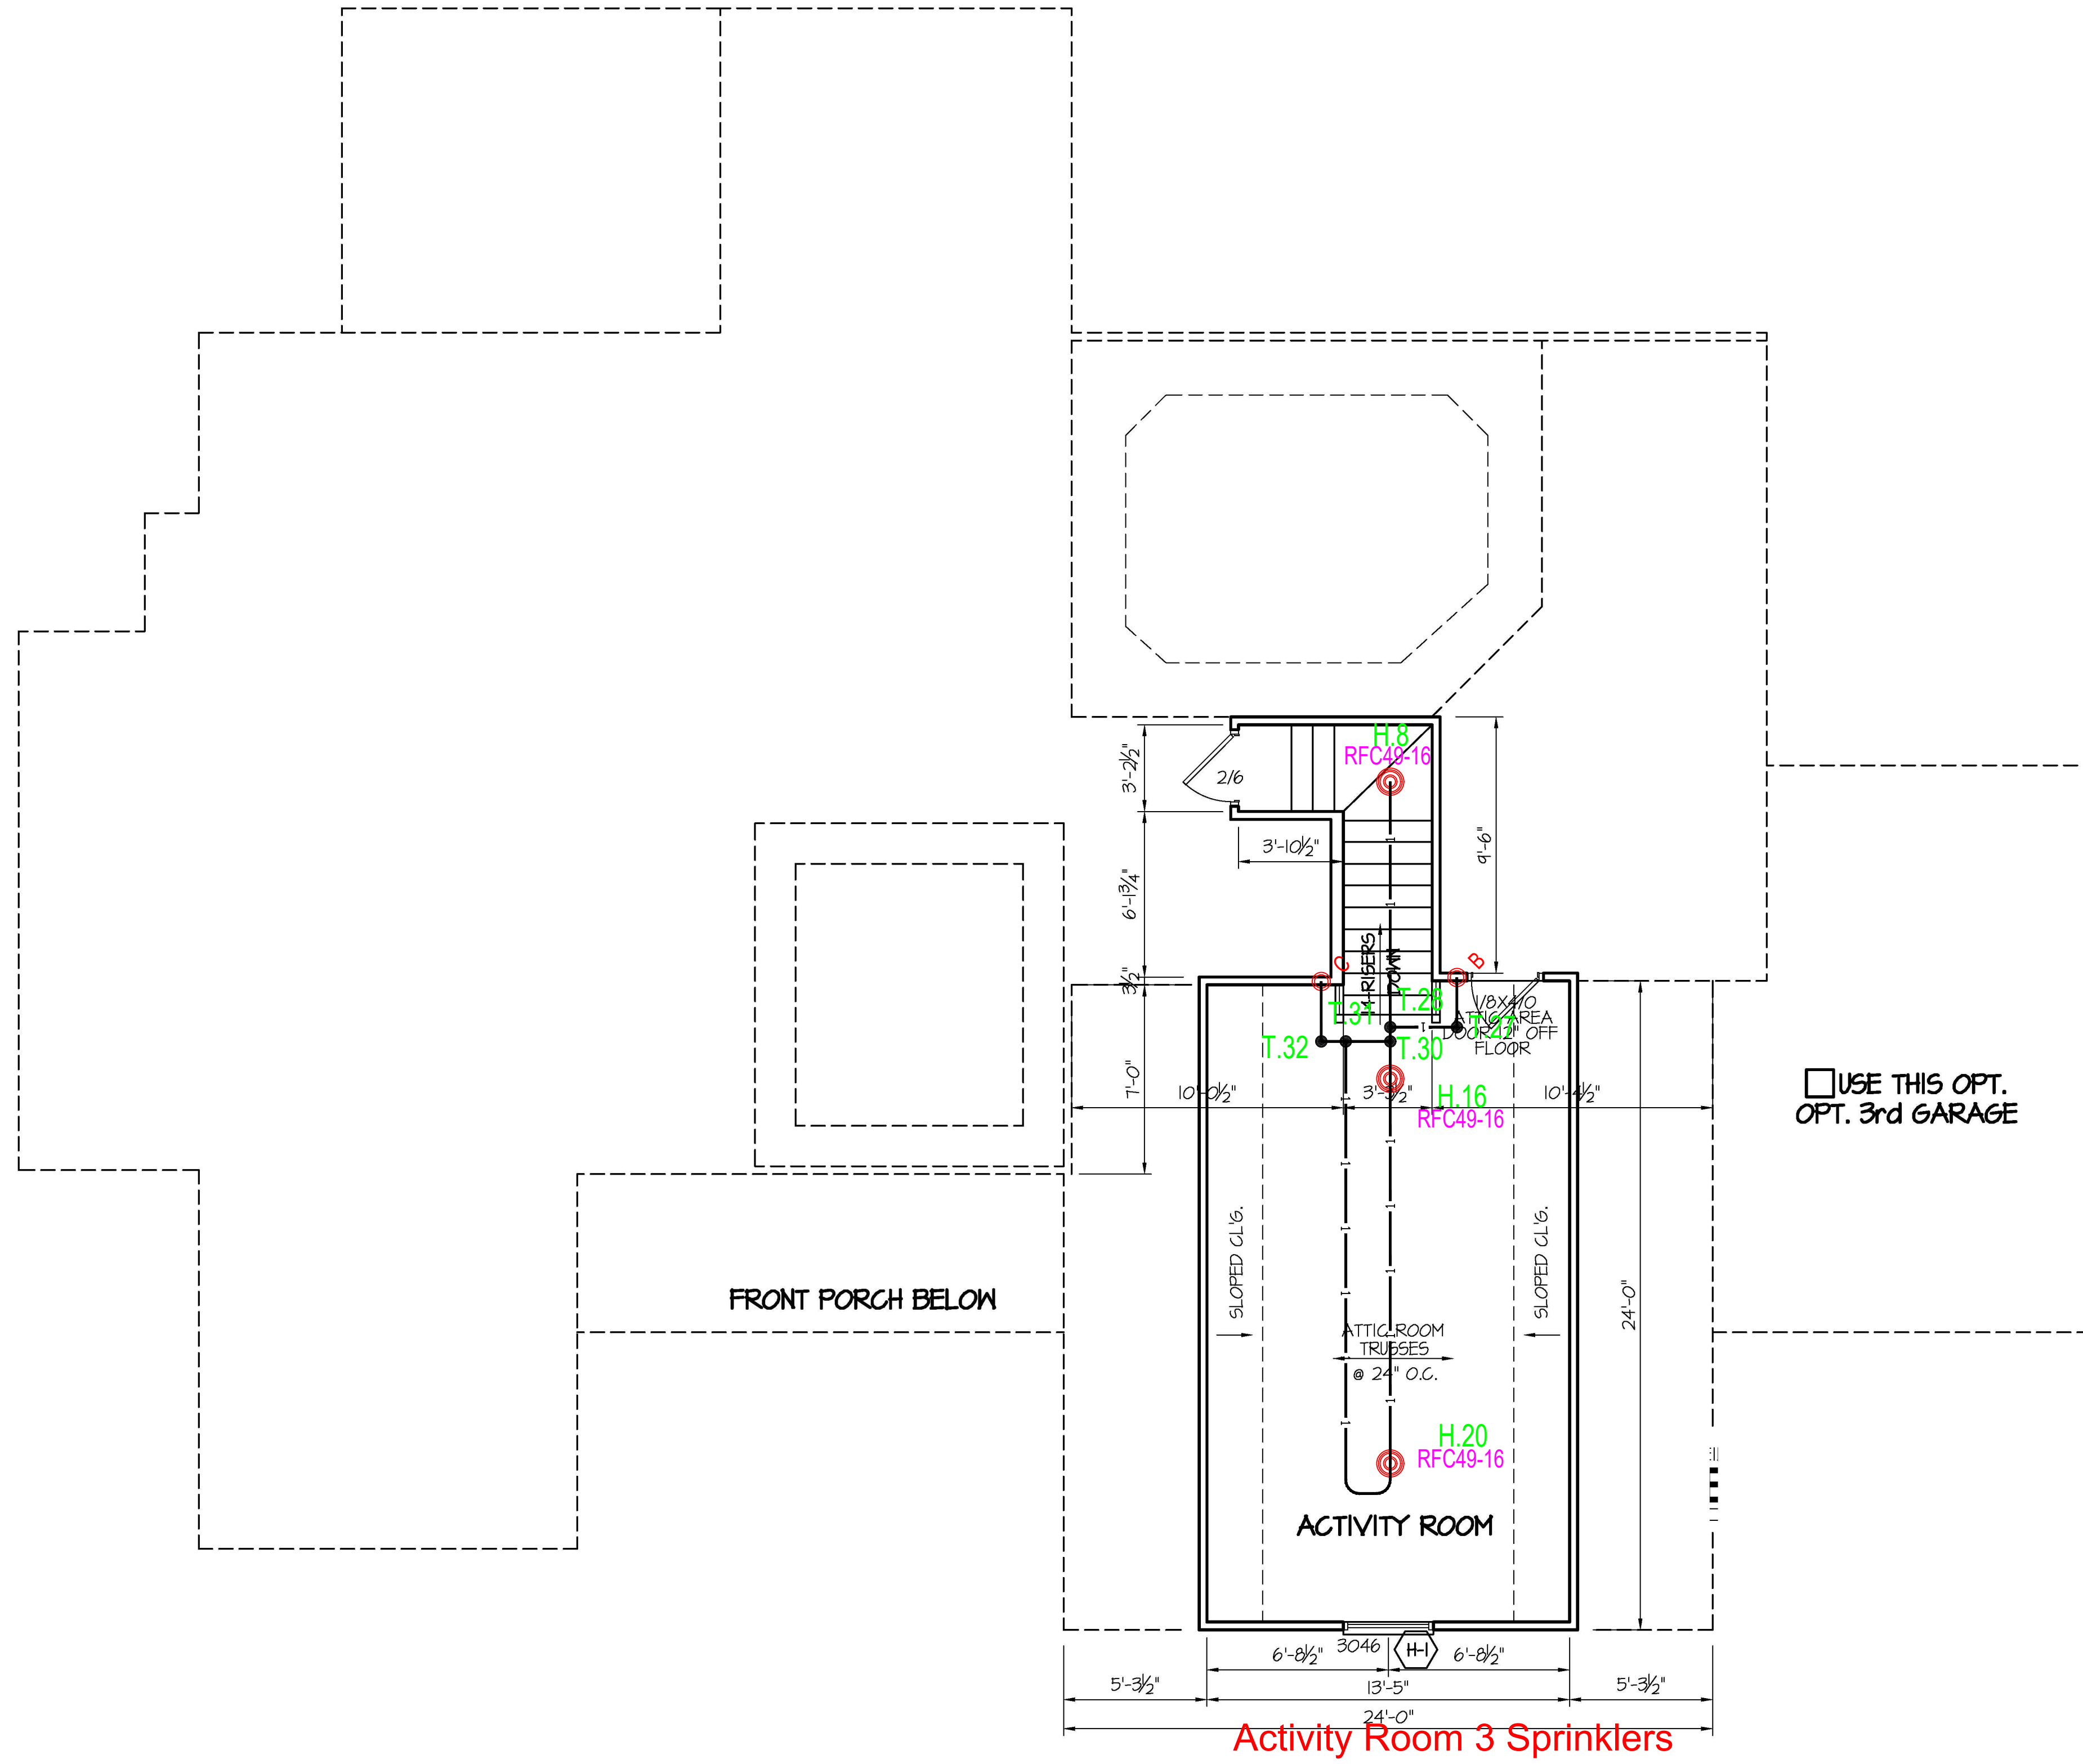

Project:

218 OAKHAVEN DRIVE, LOT 4
HOLLY SPRINGS, NC 27540

Dwg no.:
FP 2

Title:
ACTIVITY ROOM PLAN

Quotation no.: FPNM2103-002 NC

Drawn by: N.M.

Approv. by:

Date Submitted: 3/3/2021

Scale: 1/4" = 1'

Revision No: Revision Date:

FIRE PROTECTION INSTALLATION NOTES:

- INSTALLATION OF THE FIRE PROTECTION SYSTEM SHALL BE INSTALLED IN ACCORDANCE WITH THE 2016 EDITION OF NFPA 13D OR SECTION P2904 OF THE 2018 INTERNATIONAL RESIDENTIAL CODE (IRC). NFPA 13D IS THE STANDARD FOR THE INSTALLATION OF SPRINKLER SYSTEMS IN ONE- AND TWO-FAMILY DWELLINGS AND MANUFACTURED HOMES.
- INSTALLATION OF THE FIRE PROTECTION SYSTEM SHALL COMPLY WITH ALL LOCAL RESIDENTIAL FIRE PROTECTION CODES AND ALL APPLICABLE STATE REGULATIONS.
- SPRINKLER HEADS SHALL MEET ALL GENERAL CARE AND INSTALLATION REQUIREMENTS OF THE SPRINKLER MANUFACTURER. SUBSTITUTION OF SPRINKLER HEADS IS NOT PERMITTED.
- AFTER INSTALLATION OF THE SPRINKLERS, THE ENTIRE SYSTEM SHALL BE PRESSURE TESTED IN ACCORDANCE WITH STATE AND LOCAL CODE REQUIREMENTS. SPRINKLERS SHALL BE LOCATED PER THE LAYOUT. DO NOT INSTALL SPRINKLERS IN AREAS EXPOSED TO TEMPERATURES THAT EXCEED THE MAXIMUM RECOMMENDED AMBIENT TEMPERATURE FOR THE TEMPERATURE RATING USED. MINIMUM DISTANCE OF SPRINKLER HEADS FROM HEAT SOURCES SHALL COMPLY WITH TABLE 7.5.6.3 IN THE 2016 EDITION OF NFPA 13D, INSTALLATION OF SPRINKLER SYSTEMS IN ONE - AND TWO - FAMILY DWELLINGS AND MANUFACTURED HOMES.
- NO DEVIATIONS FROM THE PLAN SHALL BE ALLOWED WITHOUT APPROVAL FROM THE AUTHORITY HAVING JURISDICTION AND DESIGNER.
- PIPING AND SPRINKLER FITTINGS SHALL BE SUPPORTED IN COMPLIANCE WITH LOCAL PLUMBING CODE AND THE 2016 EDITION OF NFPA 13D, INSTALLATION OF SPRINKLER SYSTEMS IN ONE - AND TWO - FAMILY DWELLINGS AND MANUFACTURED HOMES.
- SMOKE DETECTORS SHALL BE INSTALLED IN ACCORDANCE WITH NFPA 72, NATIONAL FIRE ALARM CODE. WHEN NOT EQUIPPED WITH SMOKE DETECTORS, LOCAL WATERFLOW ALARMS SHALL BE REQUIRED.
- WATER SOFTENERS AND WATER FILTRATION DEVICES SHALL NOT BE INSTALLED IN THE SYSTEM WITHOUT A REVIEW OF THE HYDRAULIC CALCULATIONS OF THE SYSTEM.
- A SIGN SHALL BE AFFIXED ADJACENT TO THE MAIN SHUTOFF VALVE THAT STATES IN MINIMUM 1/4" LETTERS, "WARNING: THE WATER SYSTEM FOR THIS HOME SUPPLIES FIRE SPRINKLERS THAT REQUIRE CERTAIN FLOWS AND PRESSURES TO FIGHT A FIRE. DEVICES THAT RESTRICT THE FLOW OR DECREASE THE PRESSURE OR AUTOMATICALLY SHUT OFF THE WATER TO THE FIRE SPRINKLER SYSTEM, SUCH AS WATER SOFTENERS, FILTRATION SYSTEMS, AND AUTOMATIC SHUT-OFF VALVES, SHALL NOT BE ADDED TO THIS SYSTEM WITHOUT A REVIEW OF THE FIRE SPRINKLER SYSTEM BY A FIRE PROTECTION SPECIALIST. DO NOT REMOVE THIS SIGN."
- ALL PIPING AND FITTINGS SHALL BE PROPERLY INSULATED AND PROTECTED SO THAT THEY ARE NOT EXPOSED TO TEMPERATURES BELOW 40° F.
- WHEN THE MAXIMUM STATIC PRESSURE EXCEEDS 80 PSI, A PRESSURE-REDUCING VALVE SHALL BE INSTALLED. NFPA 13D RESTRICTS THE OPERATING PRESSURE OF PEX SYSTEMS TO 80 PSI. PRESSURE DROP THROUGH THE PRESSURE-REDUCING DEVICE SHALL BE INCLUDED IN THE HYDRAULIC CALCULATIONS.
- WHEN A FIRE DEPARTMENT CONNECTION IS REQUIRED, PEX TUBING SHALL NOT BE PERMITTED. CONSULT WITH THE AUTHORITY HAVING JURISDICTION (AHJ) ABOUT THIS REQUIREMENT PRIOR TO INSTALLATION.

PLUMBING INSTALLATION NOTES:

- INSTALLATION OF HOT AND COLD WATER DISTRIBUTION SYSTEMS SHALL BE IN ACCORDANCE WITH THE LOCAL PLUMBING CODE.
- WATER SOFTENERS AND WATER FILTRATION DEVICES SHALL NOT BE INSTALLED WITHOUT A REVIEW OF THE HYDRAULIC CALCULATIONS OF THE SYSTEM.
- FINAL APPROVAL OF MULTIPURPOSE AND PASSIVE PURGE FIRE SPRINKLER INSTALLATIONS SHALL BE FROM THE AUTHORITY HAVING JURISDICTION.

TESTING:

- EVERY VIEGA NFPA 13D FIRE PROTECTION INSTALLATION SHALL BE PRESSURE TESTED IN ACCORDANCE WITH NFPA 13D, WHICH STATES THAT SYSTEMS WITHOUT FIRE DEPARTMENT CONNECTIONS SHALL BE TESTED FOR LEAKAGE AT THE NORMAL SYSTEM OPERATING WATER PRESSURE.
- THE AUTHORITY HAVING JURISDICTION (AHJ) MAY REQUIRE A FLOW VERIFICATION TEST OF THE MOST HYDRAULICALLY REMOTE SPRINKLER HEAD(S). THIS FLOW VERIFICATION TEST IS AVAILABLE TO ENSURE THE INSTALLED FIRE PROTECTION SYSTEM OPERATES AS DESIGNED. DOCUMENTATION ON HOW TO PERFORM A FLOW VERIFICATION TEST IS AVAILABLE THROUGH VIEGA TECHNICAL SERVICES.
- THE FLOW VERIFICATION TEST SHALL BE PERFORMED AFTER ALL PIPING, FITTINGS, SPRINKLER HEADS AND PLUMBING CONNECTIONS HAVE BEEN INSTALLED AND PRESSURE TESTING OF THE SYSTEM HAS BEEN COMPLETED. THE FLOW TEST SHOULD OCCUR WHILE IN THE "ROUGH" STAGE OF CONSTRUCTION. FLOW TEST RESULTS SHOULD BE COMPARED TO THE SYSTEM DESIGN VALUES. RESIDUAL PRESSURE (PSI) AND FLOW (GPM) MUST BE EQUAL TO OR GREATER THEN THE DESIGN VALUES TO ENSURE A PROPERLY FUNCTIONING SYSTEM.

DRAWING AND DESIGN NOTES:

- DESIGN SHALL ENSURE WATER SUPPLY TO THE MOST HYDRAULICALLY DEMANDING SINGLE AND DUAL SPRINKLER HEADS.
- TUBING AND FITTINGS SHALL BE U.L. LISTED FOR RESIDENTIAL FIRE PROTECTION SYSTEMS IN ACCORDANCE WITH NFPA 13D.
- VIEGAFEX ULTRA (BLACK IN COLOR) LISTED TO U.L. 1821 FOR RESIDENTIAL WET-PIPE FIRE PROTECTION SYSTEMS IN ACCORDANCE WITH NFPA 13D.
- VIEGA PEX PRESS FITTINGS (POLYMER AND BRONZE) LISTED TO U.L. 1821 FOR RESIDENTIAL WET-PIPE FIRE PROTECTION SYSTEMS IN ACCORDANCE WITH NFPA 13D.
- APPROVED SMOKE DETECTION SYSTEMS AND/OR WATER FLOW ALARMS SHALL BE INSTALLED WHERE REQUIRED BY THE AUTHORITY HAVING JURISDICTION (AHJ).

MATERIALS LIST NOTES:

- SERVICE ENTRANCE MATERIALS FROM WATER MAIN CONNECTION TO DISTRIBUTION MANIFOLD ARE EXCLUDED.
- SPRINKLERS AND ASSOCIATED ESCUTCHEONS OR COVER PLATES ARE NOT SUPPLIED BY VIEGA.
- MATERIAL LIST IS SUGGESTED ONLY. CONTRACTOR SHALL CONFIRM REQUIRED MATERIALS PRIOR TO PLACEMENT OF ORDER.

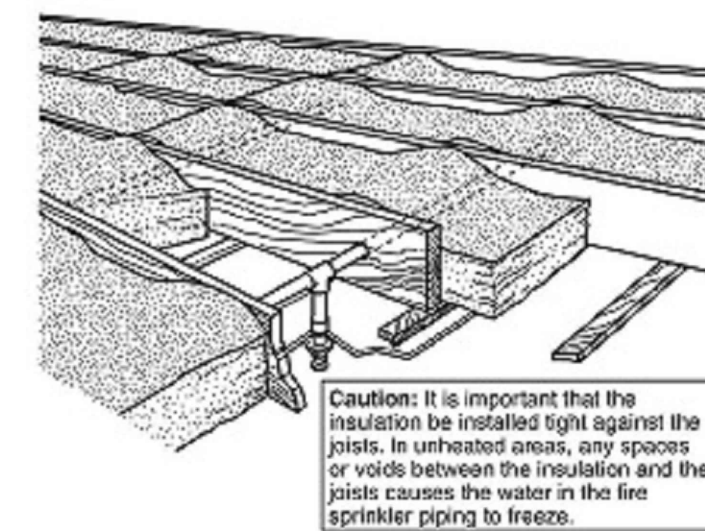


FIGURE A.9.1.1(a) Insulation Recommendations — Arrangement 1.

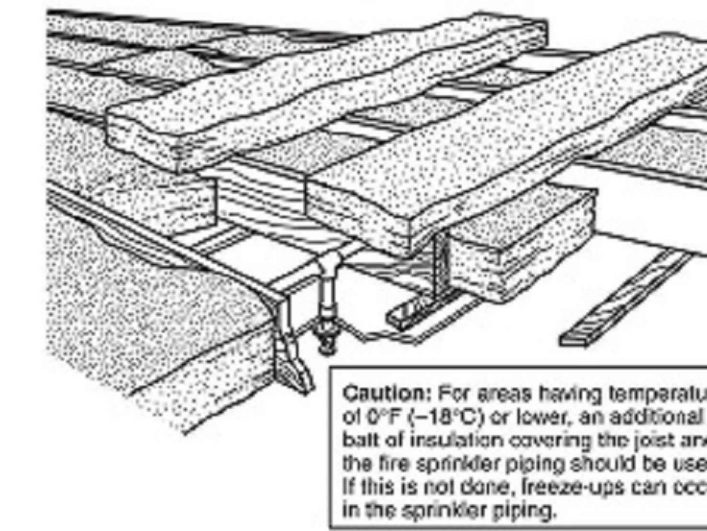


FIGURE A.9.1.1(b) Insulation Recommendations — Arrangement 2.

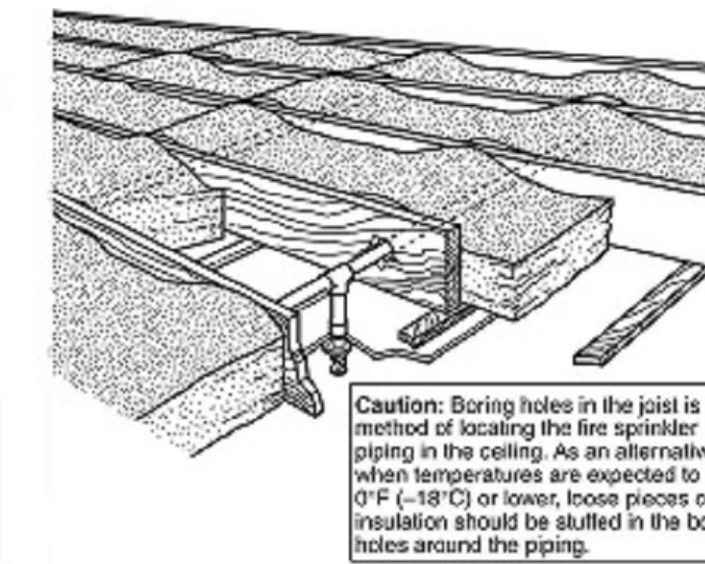


FIGURE A.9.1.1(c) Insulation Recommendations — Arrangement 3.

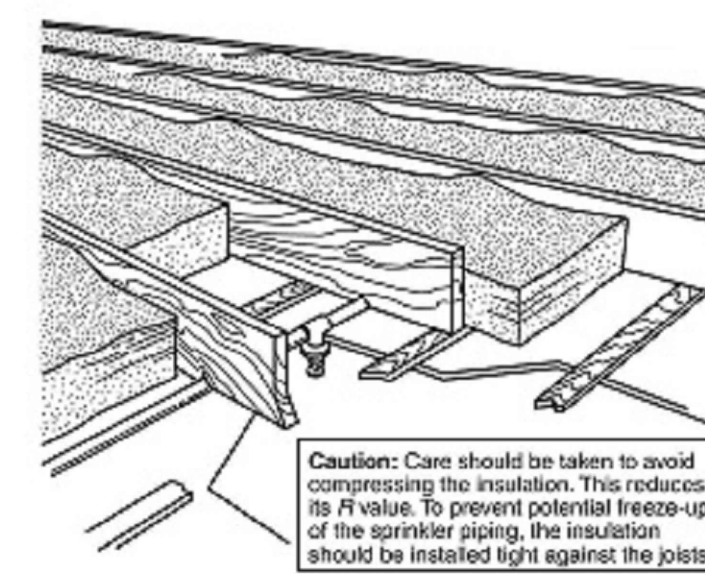


FIGURE A.9.1.1(d) Insulation Recommendations — Arrangement 4.

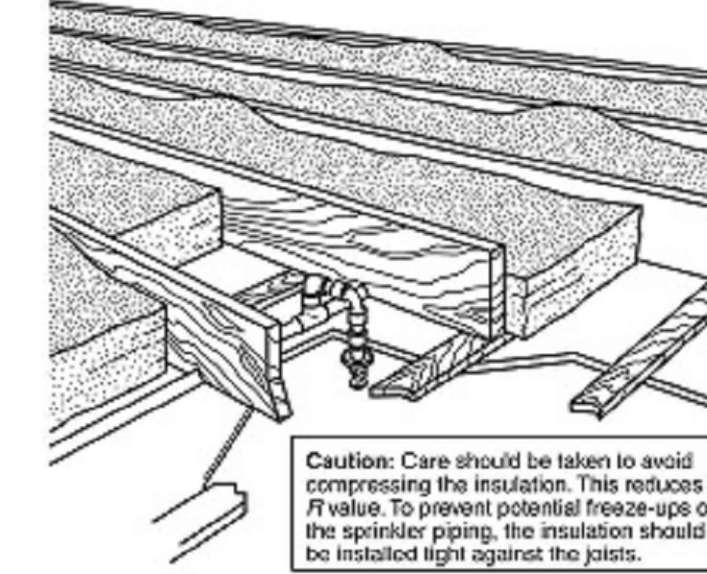


FIGURE A.9.1.1(e) Insulation Recommendations — Arrangement 5.

INSULATION DETAILS - ANNEX A.9.1.1 (NFPA 13D 2016)





WATER METER PRESSURE LOSSES (PSI) - TABLE 10.4.4(A) NFPA 13D (2016)						
Meter Size (in.)	Flow (gpm)					
	18 or less	23	26	31	39	52
5/8"	9	14	18	26	38	*
3/4"	7	11	14	22	35	*
1"	2	3	3	4	6	10
1-1/2"	1	1	2	2	4	7
2"	1	1	1	1	2	3

TABLE 10.4.4(a) (NFPA 13D 2016)

DISTANCES FROM HEAT SOURCES - TABLE 7.5.6.3 NFPA 13D (2016)		
Heat Source	Ordinary Temp. 135° - 170°	Intermediate Temp. 175° - 220°
Side of Fireplace	36"	12"
Front of Fireplace	60"	36"
Coal or Wood Burning Stove	42"	12"
Kitchen Range	18"	9"
Wall Oven	18"	9"
Hot Air Flues	18"	9"
Uninsulated Heat Ducts	18"	9"
Uninsulated Hot Water Pipes	12"	6"
Side of Hot Air Diffusers	24"	12"
Front of Hot Air Diffusers	36"	18"
Hot Water Heater or Furnace	6"	3"
Light Fixture 0 W - 250 W	6"	3"
Light Fixture 250 W - 499 W	12"	6"

TABLE 7.5.6.3 (NFPA 13D 2016)

INSTALLATION NOTES

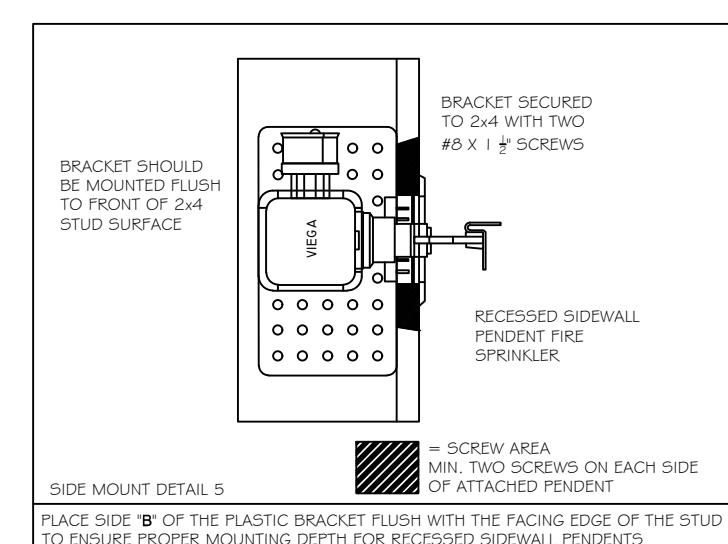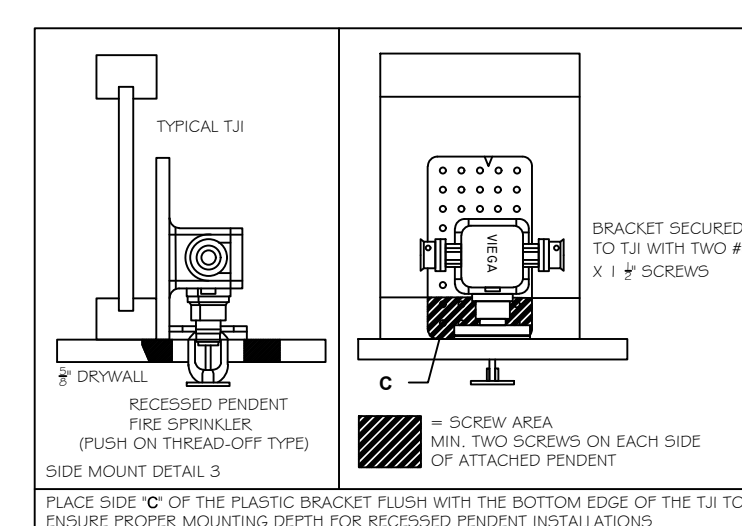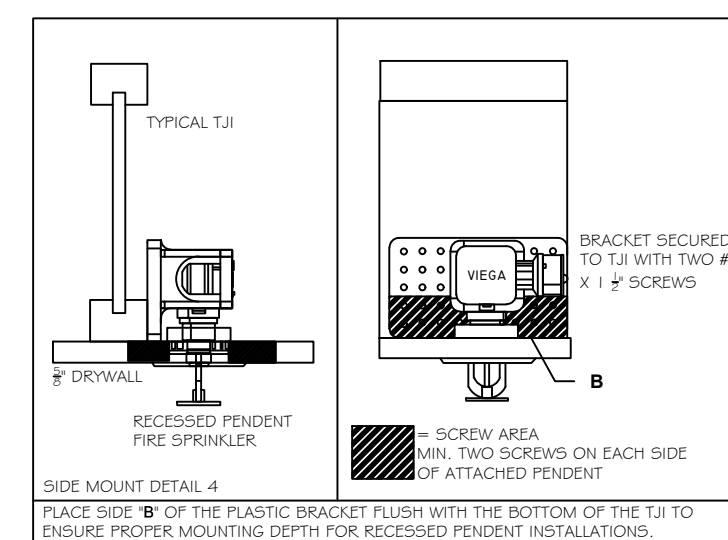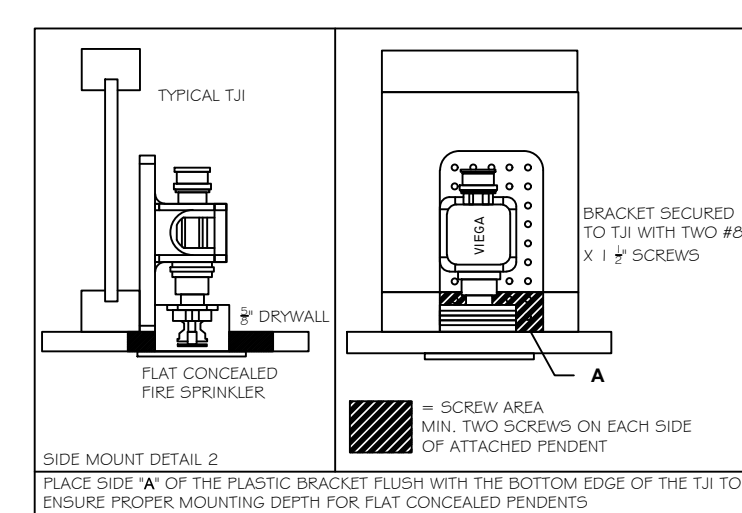

INSTALLATION DETAIL - SPRINKLER BRACKETS

Project:

218 OAKHAVEN DRIVE, LOT 4
HOLLY SPRINGS, NC 27540

Dwg no.:

FP 3

Title:

NOTES & DETAILS

Quotation no.: FPNM2103-002 NC

Drawn by:

N.M.

Approved by:

Date Submitted: 3/3/2021

Scale:

N/A

Revision No.:

Revision Date:

VIEGA LLC'S DESIGN SERVICES DEPARTMENT HAS PREPARED THIS SERIES OF DRAWINGS AS THE FIRST DESIGN FOR PLUMBING, RADIANT, SNOW MELTING OR FIRE SUPPRESSION SYSTEMS FOR THE USE OF YOU, OUR CUSTOMER, IN PREPARING OR OBTAINING SPECIFICATIONS, BIDS AND PROPOSALS IN RELATION TO THE SALE OF THESE SYSTEMS. THESE DRAWINGS ARE BASED UPON INFORMATION PROVIDED BY YOU AND HAVE BEEN PREPARED TO APPROPRIATE PROFESSIONAL STANDARDS OF DESIGN BASED UPON THAT INFORMATION. THESE DRAWINGS ARE NOT TO BE CONSIDERED FINAL AND, PRIOR TO PERFORMING ANY WORK ASSOCIATED WITH THESE DESIGNS OR DRAWINGS, YOU MUST:

- CHECK AND CONFIRM ALL PIPE SIZES, CALCULATIONS, MATERIALS, PLUMBING AND / OR FIRE CODES USED OR APPLICABLE; AND
- PRESENT THE DRAWINGS TO YOUR PROFESSIONAL ENGINEER FOR REVIEW AND APPROVAL AND HAVE THE DRAWINGS MARKED "FINAL" BY YOUR PROFESSIONAL ENGINEER.

IF YOUR PROFESSIONAL ENGINEER REPORTS ANY ERRORS IN THE DRAWINGS OR MAKES ANY CHANGES IN THE DRAWINGS, THESE ERRORS OR CHANGES MUST BE COMMUNICATED TO VIEGA LLC'S DESIGN SERVICES DEPARTMENT FOR A DETERMINATION IF A REVISION TO THE DESIGN IS NECESSARY.

VIEGA LLC DISCLAIMS ANY WARRANTIES, EXPRESS OR IMPLIED, ASSOCIATED WITH THE DESIGN OF THE SYSTEM OR ITS USE. ALL DESIGNS ARE PROVIDED "AS IS" AND IT IS YOUR SOLE RESPONSIBILITY TO CONFIRM AND ENSURE THAT THE SYSTEM TO BE INSTALLED WILL OPERATE AND FUNCTION IN COMPLIANCE WITH ALL APPLICABLE CODES AND IN ACCORDANCE WITH ALL APPLICABLE SPECIFICATIONS.

Design Services Department
1900 Southwood Drive - Nashua, NH 03063
Tel: 877-843-4262 x 351 Fax: 316-425-8466



viega



Viega LLC
Technical Services Department
1900 Southwood Drive
Nashua, NH 03063
603-882-7171

Job Name : 218 OAKHAVEN DRIVE, LOT 4 - One Head Calculation (H.5)
Building : SINGLE FAMILY RESIDENCE
Location : HOLLY SPRINGS NC 27540
System : NFPA 13D
Contract : FPNM2103-002 NC
Data File : FPNM2103-002 NC (218 Oakhaven Drive).wx1

HYDRAULIC DESIGN INFORMATION SHEET

Name - 218 OAKHAVEN DRIVE LOT 4 Date - 3/3/2021
Location -
Building - SINGLE FAMILY RESIDENCE System No. - NFPA 13D
Contractor - x Contract No. - FPNM2103-002 NC
Calculated By - VIEGA LLC Drawing No. - FPNM2103-002 NC
Construction: (X) Combustible () Non-Combustible Ceiling Height 10
OCCUPANCY - RESIDENTIAL

S Type of Calculation: ()NFPA 13 Residential ()NFPA 13R (X)NFPA 13D
Y Number of Sprinklers Flowing: (X)1 ()2 ()4 ()
S ()Other

T ()Specific Ruling Made by Date

E
M Listed Flow at Start Point - 17 Gpm System Type
Listed Pres. at Start Point - 12.03Psi (X) Wet () Dry
D MAXIMUM LISTED SPACING 18 x 18 () Deluge () PreAction
E Domestic Flow Added - 0 Gpm Sprinkler or Nozzle
S Additional Flow Added - Gpm Make RELIABLE Model RFC49
I Elevation at Highest Outlet - 108 Feet Size 7/16 K-Factor 4.9
G Note: Temperature Rating 155
N

Calculation Gpm Required 17 Psi Required 33.19 At Ref Pt STR
Summary C-Factor Used: Overhead 150 Underground 150

W Water Flow Test: Pump Data: Tank or Reservoir:
A Date of Test - x Rated Cap. Cap.
T Time of Test - x @ Psi Elev.
E Static (Psi) - 60 Elev.
R Residual (Psi) - 20 Other Well
Flow (Gpm) - 168 Proof Flow Gpm
S Elevation - 100

P Location: x
P
L Source of Information: x
Y


Water Supply Curve C

Viega LLC
218 OAKHAVEN DRIVE, LOT 4 - One Head Calculation (H.5)

Page 2
Date 3/3/2021

City Water Supply:
C1 - Static Pressure : 60
C2 - Residual Pressure: 20
C2 - Residual Flow : 168

Demand:
D1 - Elevation : 3.465
D2 - System Flow : 16.995
D2 - System Pressure : 33.191
Hose (Demand) :
D3 - System Demand : 16.995
Safety Margin : 26.232

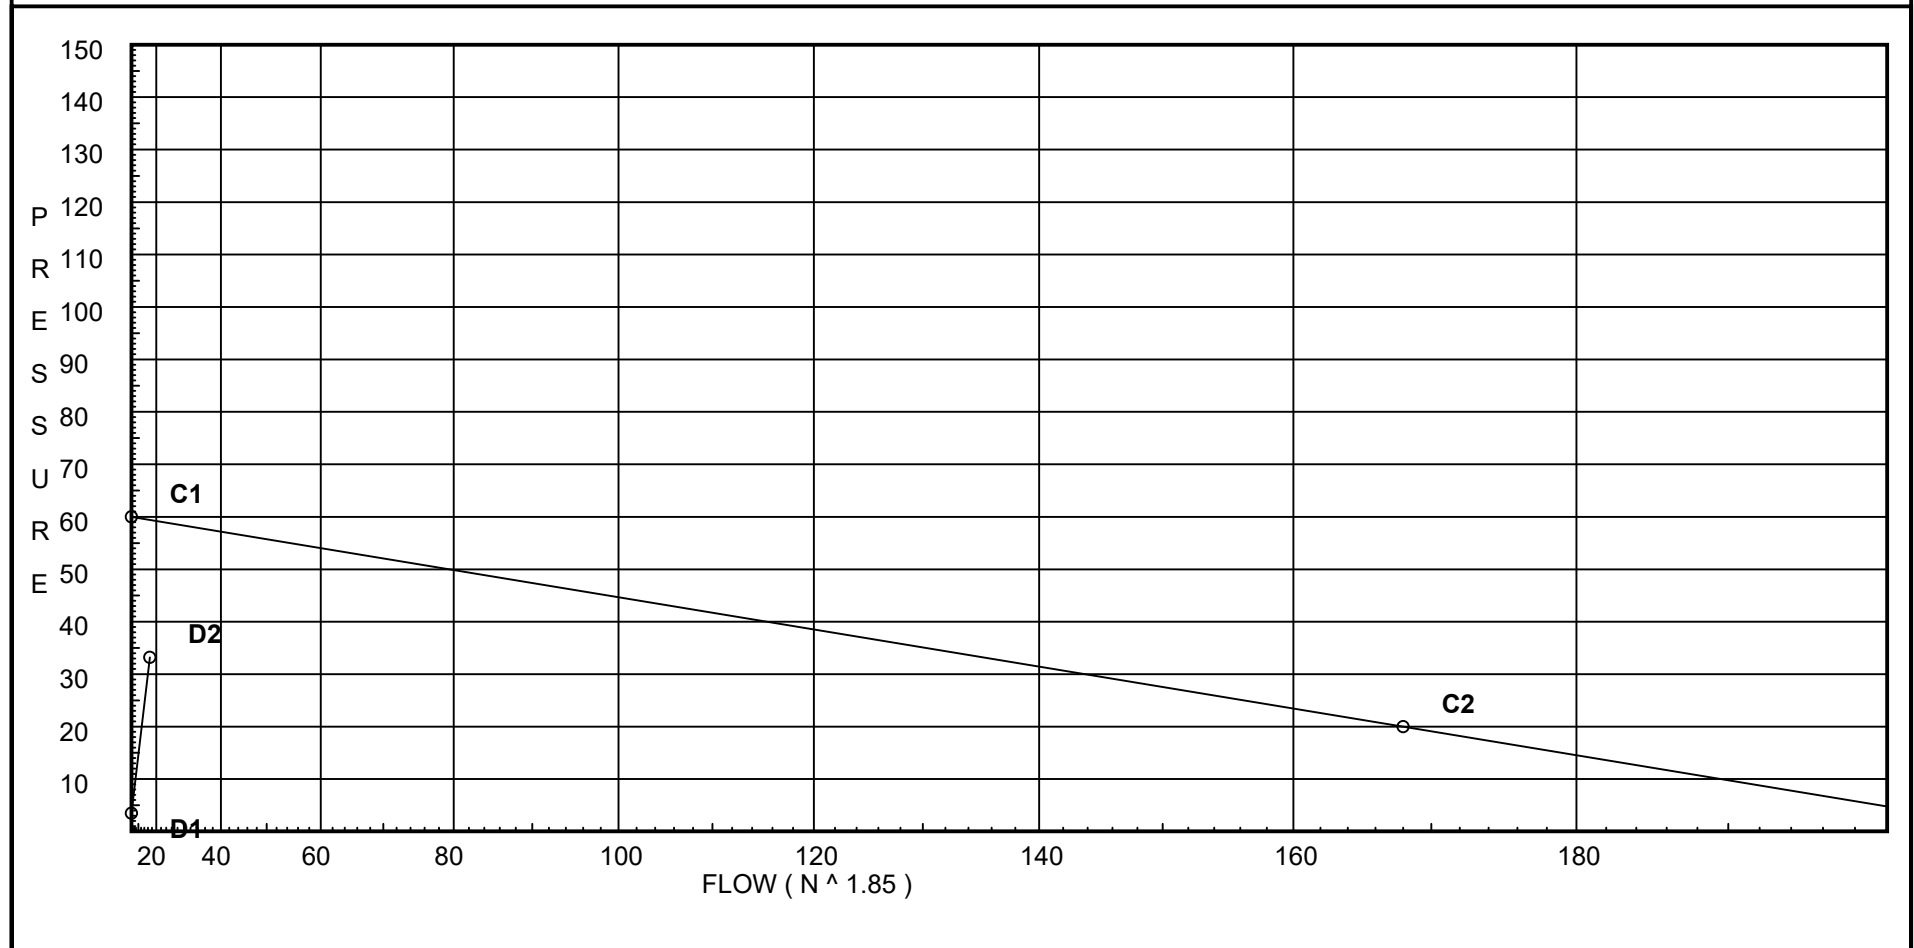

Fittings Used Summary

Viega LLC
218 OAKHAVEN DRIVE, LOT 4 - One Head Calculation (H.5)

Page 3
Date 3/3/2021

Fitting Legend

Abbrev.	Name	1/2	3/4	1	1 1/4	1 1/2	2	2 1/2	3	3 1/2	4	5	6	8	10	12	14	16	18	20	24
E	90' Standard Elbow	2	2	2	3	4	5	6	7	8	10	12	14	18	22	27	35	40	45	50	61
T	90' Flow thru Tee	3	4	5	6	8	10	12	15	17	20	25	30	35	50	60	71	81	91	101	121
Vpel *	PEX Press 90 Elbow - Poly	12.6	18.9	17.7	18.6	29.4	36.4	0	0	0											
Vprt *	PEX Press Tee - Run-Poly	3.9	3.6	3.8	6.4	7.9	10.2	0	0	0											
Vptb *	PEX Press Tee - Branch-Poly	14	19.1	18.4	18.7	28.3	37.5	0	0	0											

Units Summary

Diameter Units Inches
 Length Units Feet
 Flow Units US Gallons per Minute
 Pressure Units Pounds per Square Inch

Flow Summary - NFPA 2007

Viega LLC
 218 OAKHAVEN DRIVE, LOT 4 - One Head Calculation (H.5)

Page 4
 Date 3/3/2021

SUPPLY ANALYSIS

<i>Node at Source</i>	<i>Static Pressure</i>	<i>Residual Pressure</i>	<i>Flow</i>	<i>Available Pressure</i>	<i>Total Demand</i>	<i>Required Pressure</i>
STR	60.0	20	168.0	59.423	17.0	33.191

NODE ANALYSIS

<i>Node Tag</i>	<i>Elevation</i>	<i>Node Type</i>	<i>Pressure at Node</i>	<i>Discharge at Node</i>	<i>Notes</i>
H.5	108.0	4.9	12.03	17.0	
H.1	108.0		13.23		
H.3	108.0		13.81		
H.2	108.0		14.46		
H.6	108.0		14.92		
T.21	108.0		15.52		
H.7	108.0		15.75		
H.11	108.0		15.96		
T.22	108.0		16.04		
T.24	108.0		16.44		
T.25	108.0		16.9		
T.33	108.0		17.23		
S.1	104.0		23.52		
MTR	100.0		31.53		
STR	100.0		33.19		
H.4	108.0		13.15		
H.9	108.0		14.09		
T.23	108.0		14.83		
H.12	108.0		15.49		
T.29	108.0		15.11		
T.27	117.0		11.36		
T.28	117.0		11.86		
T.30	117.0		11.92		
T.31	117.0		12.03		
T.32	117.0		12.32		
T.26	108.0		16.37		
H.10	108.0		15.63		
H.17	108.0		15.77		
H.19	108.0		15.92		
H.18	108.0		15.98		
H.13	108.0		16.07		
H.14	108.0		16.15		
H.15	108.0		16.24		
H.16	117.0		11.93		
H.20	117.0		11.96		

Final Calculations - Hazen-Williams

Viega LLC
218 OAKHAVEN DRIVE, LOT 4 - One Head Calculation (H.5)

Page 5
Date 3/3/2021

Hyd. Ref. Point	Qa Qt	Dia. "C" Pf/Ft	Fitting or Eqv.	Ln.	Pipe Ftg's Total	Pt Pe Pf	Pt Pv Pn	*****	Notes	*****
H.5 to H.1	6.88	0.863 150.0	Vprt	3.8 0.0	35.000 3.800	12.030 0.0			K Factor = 4.90	
H.1 to H.3	6.88	0.0310		0.0	38.800	1.201			Vel = 3.77	
H.1 to H.3	0.0	0.863 150.0	Vprt	3.8 0.0	15.000 3.800	13.231 0.0				
H.3 to H.2	6.88	0.0310		0.0	18.800	0.582			Vel = 3.77	
H.3 to H.2	0.0	0.863 150.0	Vprt	3.8 0.0	17.000 3.800	13.813 0.0				
H.2 to H.6	6.88	0.0310		0.0	20.800	0.644			Vel = 3.77	
H.2 to H.6	0.0	0.863 150.0	Vprt	3.8 0.0	11.000 3.800	14.457 0.0				
H.6 to T.21	6.88	0.0309		0.0	14.800	0.458			Vel = 3.77	
H.6 to T.21	0.0	0.863 150.0	Vptb	18.4 0.0	1.000 18.400	14.915 0.0				
T.21 to H.7	6.88	0.0310		0.0	19.400	0.601			Vel = 3.77	
T.21 to H.7	-3.05	0.863 150.0	Vprt	3.8 0.0	19.000 3.800	15.516 0.0				
H.7 to H.11	3.83	0.0104		0.0	22.800	0.238			Vel = 2.10	
H.7 to H.11	0.0	0.863 150.0	Vprt	3.8 0.0	16.000 3.800	15.754 0.0				
H.11 to T.22	3.83	0.0105		0.0	19.800	0.207			Vel = 2.10	
H.11 to T.22	0.0	0.863 150.0	Vprt	3.8 0.0	4.000 3.800	15.961 0.0				
T.22 to T.24	3.83	0.0105		0.0	7.800	0.082			Vel = 2.10	
T.22 to T.24	5.86	0.863 150.0	Vprt	3.8 0.0	3.000 3.800	16.043 0.0				
T.24 to T.25	9.69	0.0584		0.0	6.800	0.397			Vel = 5.31	
T.24 to T.25	3.06	0.863 150.0	Vprt	3.8 0.0	1.000 3.800	16.440 0.0				
T.25 to T.33	12.75	0.0967		0.0	4.800	0.464			Vel = 6.99	
T.25 to T.33	4.25	0.863 150.0		0.0 0.0	2.000 0.0	16.904 0.0				
T.33 to T.33	17.0	0.1650		0.0	2.000	0.330			Vel = 9.32	
T.33 to S.1	0.0	0.863 150.0	Vpel T	17.7 2.92	7.000 20.620	17.234 1.732				
S.1 to MTR	17.0	0.1649		0.0	27.620	4.554			Vel = 9.32	
S.1 to MTR	0.0	1.053 150.0	2E	2.429 0.0	50.000 2.429	23.520 4.732			** Fixed Loss = 3	
MTR to STR	17.0	0.0626		0.0	52.429	3.280			Vel = 6.26	
MTR to STR	0.0	1.049 150.0	2E	6.044 0.0	20.000 6.044	31.532 0.0				
STR to H.5	17.0	0.0637		0.0	26.044	1.659			Vel = 6.31	
STR to H.5	0.0 17.00					33.191			K Factor = 2.95	
H.5 to H.4	10.11	0.863 150.0	Vprt	3.8 0.0	14.000 3.800	12.030 0.0				
H.4 to H.9	10.11	0.0631		0.0	17.800	1.123			Vel = 5.55	
H.4 to H.9	0.0	0.863 150.0	Vprt	3.8 0.0	11.000 3.800	13.153 0.0				
H.9 to H.9	10.11	0.0631		0.0	14.800	0.934			Vel = 5.55	

Final Calculations - Hazen-Williams

Viega LLC
218 OAKHAVEN DRIVE, LOT 4 - One Head Calculation (H.5)

Page 6
Date 3/3/2021

Hyd. Ref. Point	Qa Qt	Dia. "C" Pf/Ft	Fitting or Eqv. Ln.	Pipe Ftg's Total	Pt Pe Pf	Pt Pv Pn	*****	Notes	*****
H.9 to T.23	0.0 10.11	0.863 150.0 0.0631	Vprt 3.8 0.0	8.000 3.800	14.087 0.0			Vel = 5.55	
T.23 to H.12	-4.25 5.86	0.863 150.0 0.0230	Vptb 18.4 0.0	10.000 18.400	14.832 0.0			Vel = 3.21	
H.12 to T.22	0.0 5.86	0.863 150.0 0.0230	Vptb 18.4 Vprt 3.8 0.0	2.000 22.200 24.200	15.486 0.0 0.557			Vel = 3.21	
	0.0 5.86					16.043		K Factor = 1.46	
T.23 to T.29	4.25 4.25	0.863 150.0 0.0127	Vpel 17.7 0.0	4.000 17.700	14.832 0.0			Vel = 2.33	
T.29 to T.27	0.0 4.25	0.863 150.0 0.0127	0.0 0.0	12.000 0.0 12.000	15.107 -3.898 0.153			Vel = 2.33	
T.27 to T.28	0.0 4.25	0.863 150.0 0.0127	Vptb 18.4 Vpel 17.7 0.0	3.000 36.100 39.100	11.362 0.0 0.496			Vel = 2.33	
T.28 to T.30	0.0 4.25	0.863 150.0 0.0125	Vprt 3.8 0.0	1.000 3.800	11.858 0.0			Vel = 2.33	
T.30 to T.31	-1.50 2.75	0.863 150.0 0.0057	Vptb 18.4 0.0	2.000 18.400	11.918 0.0			Vel = 1.51	
T.31 to T.32	1.50 4.25	0.863 150.0 0.0127	Vpel 17.7 Vprt 3.8 0.0	1.000 21.500 22.500	12.034 0.0 0.286			Vel = 2.33	
T.32 to T.26	0.0 4.25	0.863 150.0 0.0127	0.0 0.0	12.000 0.0 12.000	12.320 3.898 0.152			Vel = 2.33	
T.26 to T.25	0.0 4.25	0.863 150.0 0.0127	Vpel 17.7 Vptb 18.4 0.0	6.000 36.100 42.100	16.370 0.0 0.534			Vel = 2.33	
	0.0 4.25					16.904		K Factor = 1.03	
T.21 to H.10	3.05 3.05	0.863 150.0 0.0068	Vprt 3.8 0.0	13.000 3.800	15.516 0.0			Vel = 1.67	
H.10 to H.17	0.0 3.05	0.863 150.0 0.0069	Vprt 3.8 0.0	16.000 3.800	15.631 0.0			Vel = 1.67	
H.17 to H.19	0.0 3.05	0.863 150.0 0.0069	Vprt 3.8 0.0	19.000 3.800	15.768 0.0			Vel = 1.67	
H.19 to H.18	0.0 3.05	0.863 150.0 0.0069	0.0 0.0	8.000 0.0 8.000	15.925 0.0 0.055			Vel = 1.67	

Final Calculations - Hazen-Williams

Viega LLC
 218 OAKHAVEN DRIVE, LOT 4 - One Head Calculation (H.5)

Page 7
 Date 3/3/2021

Hyd. Ref. Point	Qa Qt	Dia. "C" Pf/Ft	Fitting or Eqv.	Ln.	Pipe Ftng's Total	Pt Pe Pf	Pt Pv Pn	*****	Notes	*****
H.18 to H.13	0.0 3.05	0.863 150.0 0.0069	Vprt	3.8 0.0	9.000 3.800	15.980 0.0			Vel = 1.67	
H.13 to H.14	0.0 3.05	0.863 150.0 0.0069	Vprt	3.8 0.0	8.000 3.800	16.068 0.0			Vel = 1.67	
H.14 to H.15	0.0 3.05	0.863 150.0 0.0069	Vprt	3.8 0.0	10.000 3.800	16.149 0.0			Vel = 1.67	
H.15 to T.24	0.0 3.05	0.863 150.0 0.0069	Vptb	18.4 0.0	10.000 18.400	16.244 0.0			Vel = 1.67	
	0.0 3.05					16.440			K Factor = 0.75	
T.30 to H.16	1.50 1.5	0.863 150.0 0.0019	Vprt	3.8 0.0	2.000 3.800	11.918 0.0			Vel = 0.82	
H.16 to H.20	0.0 1.5	0.863 150.0 0.0019		0.0 0.0	16.000 0.0	11.929 0.0			Vel = 0.82	
H.20 to T.31	0.0 1.5	0.863 150.0 0.0018	Vptb Vprt	18.4 3.8 0.0	19.000 22.200 41.200	11.959 0.0 0.075			Vel = 0.82	
	0.0 1.50					12.034			K Factor = 0.43	



viega



Viega LLC
Technical Services Department
1900 Southwood Drive
Nashua, NH 03063
603-882-7171

Job Name : 218 OAKHAVEN DRIVE, LOT 4 - Two Head Calculation (H.20 & H.16)
Building : SINGLE FAMILY RESIDENCE
Location : HOLLY SPRINGS NC 27540
System : NFPA 13D
Contract : FPNM2103-002 NC
Data File : FPNM2103-002 NC (218 Oakhaven Drive).wx2

HYDRAULIC DESIGN INFORMATION SHEET

Name - 218 OAKHAVEN DRIVE LOT 4 Date - 3/3/2021
Location -
Building - SINGLE FAMILY RESIDENCE System No. - NFPA 13D
Contractor - x Contract No. - FPNM2103-002 NC
Calculated By - VIEGA LLC Drawing No. - FPNM2103-002 NC
Construction: (X) Combustible () Non-Combustible Ceiling Height 10
OCCUPANCY - RESIDENTIAL

S Type of Calculation: ()NFPA 13 Residential ()NFPA 13R (X)NFPA 13D
Y Number of Sprinklers Flowing: ()1 (X)2 ()4 ()
S ()Other

T ()Specific Ruling Made by Date

E
M Listed Flow at Start Point - 13 Gpm System Type
Listed Pres. at Start Point - 7.04 Psi (X) Wet () Dry
D MAXIMUM LISTED SPACING 16 x 16 () Deluge () PreAction
E Domestic Flow Added - 0 Gpm Sprinkler or Nozzle
S Additional Flow Added - Gpm Make RELIABLE Model RFC49
I Elevation at Highest Outlet - 117 Feet Size 7/16 K-Factor 4.9
G Note: Temperature Rating 155
N

Calculation Gpm Required 26.229 Psi Required 50.22 At Ref Pt STR
Summary C-Factor Used: Overhead 150 Underground 150

W Water Flow Test: Pump Data: Tank or Reservoir:
A Date of Test - x Rated Cap. Cap.
T Time of Test - x @ Psi Elev.
E Static (Psi) - 60 Elev.
R Residual (Psi) - 20 Other Well
Flow (Gpm) - 168 Proof Flow Gpm
S Elevation - 100

P Location: x
P
L Source of Information: x
Y


Water Supply Curve C

Viega LLC
218 OAKHAVEN DRIVE, LOT 4 - Two Head Calculation (H.20 & H.16)

Page 2
Date 3/3/2021

City Water Supply:
C1 - Static Pressure : 60
C2 - Residual Pressure: 20
C2 - Residual Flow : 168

Demand:
D1 - Elevation : 7.363
D2 - System Flow : 26.229
D2 - System Pressure : 50.217
Hose (Demand) : _____
D3 - System Demand : 26.229
Safety Margin : 8.495

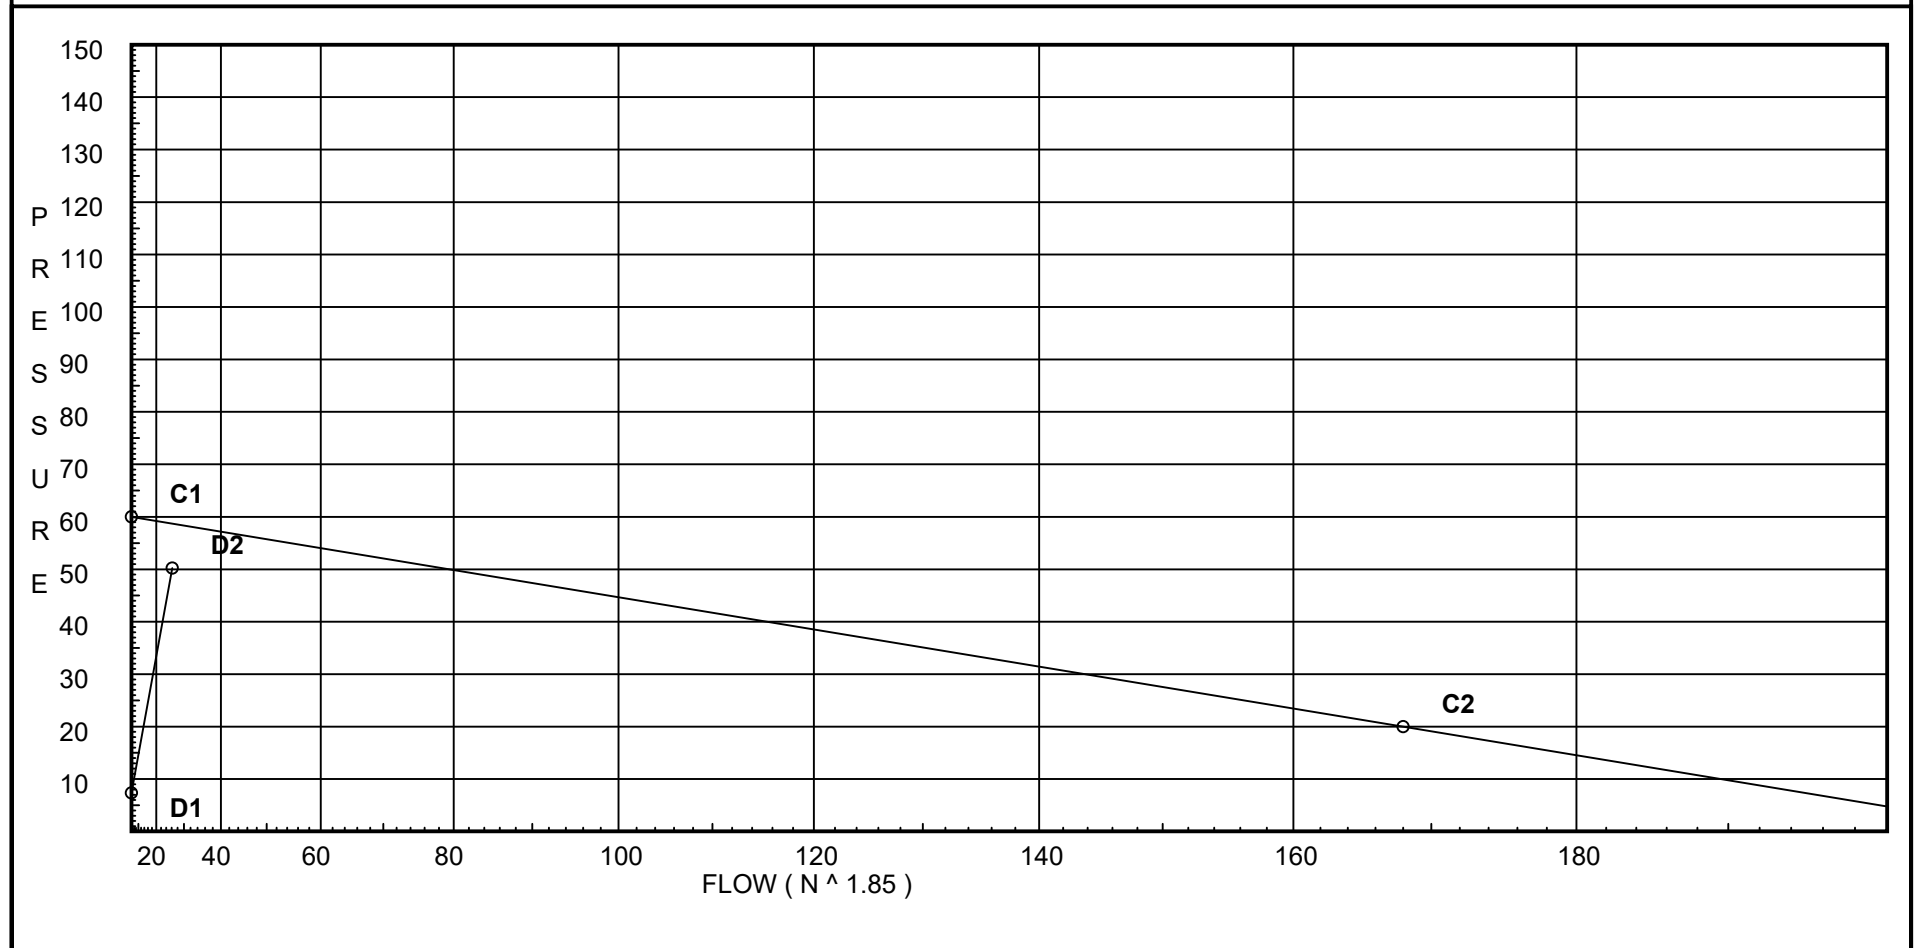

Fittings Used Summary

Viega LLC
 218 OAKHAVEN DRIVE, LOT 4 - Two Head Calculation (H.20 & H.16)

Page 3
 Date 3/3/2021

Fitting Legend

Abbrev.	Name	1/2	3/4	1	1 1/4	1 1/2	2	2 1/2	3	3 1/2	4	5	6	8	10	12	14	16	18	20	24
E	90' Standard Elbow	2	2	2	3	4	5	6	7	8	10	12	14	18	22	27	35	40	45	50	61
T	90' Flow thru Tee	3	4	5	6	8	10	12	15	17	20	25	30	35	50	60	71	81	91	101	121
Vpel *	PEX Press 90 Elbow - Poly	12.6	18.9	17.7	18.6	29.4	36.4	0	0	0											
Vprt *	PEX Press Tee - Run-Poly	3.9	3.6	3.8	6.4	7.9	10.2	0	0	0											
Vptb *	PEX Press Tee - Branch-Poly	14	19.1	18.4	18.7	28.3	37.5	0	0	0											

Units Summary

Diameter Units Inches
 Length Units Feet
 Flow Units US Gallons per Minute
 Pressure Units Pounds per Square Inch

Flow Summary - NFPA 2007

Viega LLC
 218 OAKHAVEN DRIVE, LOT 4 - Two Head Calculation (H.20 & H.16)

Page 4
 Date 3/3/2021

SUPPLY ANALYSIS

<i>Node at Source</i>	<i>Static Pressure</i>	<i>Residual Pressure</i>	<i>Flow</i>	<i>Available Pressure</i>	<i>Total Demand</i>	<i>Required Pressure</i>
STR	60.0	20	168.0	58.712	26.23	50.217

NODE ANALYSIS

<i>Node Tag</i>	<i>Elevation</i>	<i>Node Type</i>	<i>Pressure at Node</i>	<i>Discharge at Node</i>	<i>Notes</i>
H.20	117.0	4.9	7.04	13.0	
T.31	117.0		8.83		
T.32	117.0		11.5		
T.26	108.0		16.83		
T.25	108.0		21.83		
T.33	108.0		22.57		
S.1	104.0		34.46		
MTR	100.0		46.51		
STR	100.0		50.22		
H.16	117.0	4.9	7.29	13.23	
T.30	117.0		8.35		
T.28	117.0		8.76		
T.27	117.0		12.14		
T.29	108.0		17.08		
T.23	108.0		18.95		
H.12	108.0		20.07		
T.22	108.0		21.02		
T.24	108.0		21.42		
H.9	108.0		19.1		
H.4	108.0		19.28		
H.5	108.0		19.5		
H.1	108.0		19.97		
H.3	108.0		20.2		
H.2	108.0		20.46		
H.6	108.0		20.64		
T.21	108.0		20.88		
H.10	108.0		20.94		
H.17	108.0		21.02		
H.19	108.0		21.12		
H.18	108.0		21.15		
H.13	108.0		21.2		
H.14	108.0		21.25		
H.15	108.0		21.3		
H.7	108.0		20.94		
H.11	108.0		21.0		

Final Calculations - Hazen-Williams

Viega LLC
218 OAKHAVEN DRIVE, LOT 4 - Two Head Calculation (H.20 & H.16)

Page 5
Date 3/3/2021

Hyd. Ref. Point	Qa Qt	Dia. "C" Pf/Ft	Fitting or Eqv.	Ln.	Pipe Ftg's Total	Pt Pe Pf	Pt Pv Pn	*****	Notes	*****
H.20 to T.31	8.27	0.863 150.0	Vptb Vprt	18.4 3.8	19.000 22.200	7.040 0.0			K Factor = 4.90	
T.31 to T.32	8.27	0.0435		0.0	41.200	1.792			Vel = 4.54	
T.31 to T.32	5.97	0.863 150.0	Vpel Vprt	17.7 3.8	1.000 21.500	8.832 0.0				
T.32 to T.26	14.24	0.1188		0.0	22.500	2.673			Vel = 7.81	
T.32 to T.26	0.0	0.863 150.0		0.0	12.000	11.505				
T.26 to T.25	14.24	0.1188		0.0	12.000	1.426			Vel = 7.81	
T.26 to T.25	0.0	0.863 150.0	Vpel Vptb	17.7 18.4	6.000 36.100	16.829 0.0				
T.25 to T.33	14.24	0.1188		0.0	42.100	5.002			Vel = 7.81	
T.25 to T.33	11.99	0.863 150.0		0.0	2.000	21.831				
T.33 to S.1	26.23	0.3680		0.0	2.000	0.736			Vel = 14.39	
T.33 to S.1	0.0	0.863 150.0	Vpel T	17.7 2.92	7.000 20.620	22.567 1.732				
S.1 to MTR	26.23	0.3679		0.0	27.620	10.162			Vel = 14.39	
S.1 to MTR	0.0	1.053 150.0	2E	2.429	50.000	34.461				
MTR to STR	26.23	0.1396		0.0	2.429	4.732			** Fixed Loss = 3	
MTR to STR	0.0	1.049 150.0	2E	6.044	20.000	46.513			Vel = 9.66	
STR	26.23	0.1422		0.0	26.044	3.704			Vel = 9.74	
	0.0									
	26.23					50.217			K Factor = 3.70	
H.20 to H.16	4.73	0.863 150.0		0.0	16.000	7.040				
H.16 to T.30	4.73	0.0155		0.0	16.000	0.248			Vel = 2.59	
H.16 to T.30	13.23	0.863 150.0	Vprt	3.8	2.000	7.288			K Factor = 4.90	
T.30 to T.31	17.96	0.1826		0.0	3.800	0.0			Vel = 9.85	
T.30 to T.31	-11.99	0.863 150.0	Vptb	18.4	2.000	8.347				
T.31	5.97	0.0238		0.0	18.400	0.0			Vel = 3.27	
	0.0				20.400	0.485				
	5.97					8.832			K Factor = 2.01	
T.30 to T.28	11.99	0.863 150.0	Vprt	3.8	1.000	8.347				
T.28 to T.27	11.99	0.0865		0.0	3.800	0.0			Vel = 6.58	
T.28 to T.27	0.0	0.863 150.0	Vptb Vpel	18.4 17.7	3.000 36.100	8.762 0.0				
T.27 to T.29	11.99	0.0864		0.0	39.100	3.380			Vel = 6.58	
T.27 to T.29	0.0	0.863 150.0		0.0	12.000	12.142				
T.29 to T.23	11.99	0.0865		0.0	0.0	3.898				
T.29 to T.23	0.0	0.863 150.0	Vpel	17.7	4.000	17.078			Vel = 6.58	
T.23	11.99	0.0865		0.0	17.700	0.0				
					21.700	1.876			Vel = 6.58	

Final Calculations - Hazen-Williams

Viega LLC
218 OAKHAVEN DRIVE, LOT 4 - Two Head Calculation (H.20 & H.16)

Page 6
Date 3/3/2021

Hyd. Ref. Point	Qa Qt	Dia. "C" Pf/Ft	Fitting or Eqv. Ln.	Pipe Ftg's Total	Pt Pe Pf	Pt Pv Pn	*****	Notes	*****
T.23 to H.12	-4.17 7.82	0.863 150.0 0.0393	Vptb 18.4 0.0	10.000 18.400 28.400	18.954 0.0 1.115		Vel = 4.29		
H.12 to T.22	0.0 7.82	0.863 150.0 0.0392	Vptb 18.4 3.8 Vprt 0.0	2.000 22.200 24.200	20.069 0.0 0.949		Vel = 4.29		
T.22 to T.24	1.89 9.71	0.863 150.0 0.0585	Vprt 3.8 0.0	3.000 3.800 6.800	21.018 0.0 0.398		Vel = 5.33		
T.24 to T.25	2.28 11.99	0.863 150.0 0.0865	Vprt 3.8 0.0	1.000 3.800 4.800	21.416 0.0 0.415		Vel = 6.58		
	0.0 11.99				21.831		K Factor = 2.57		
T.23 to H.9	4.17 4.17	0.863 150.0 0.0123	Vprt 3.8 0.0	8.000 3.800 11.800	18.954 0.0 0.145		Vel = 2.29		
H.9 to H.4	0.0 4.17	0.863 150.0 0.0122	Vprt 3.8 0.0	11.000 3.800 14.800	19.099 0.0 0.181		Vel = 2.29		
H.4 to H.5	0.0 4.17	0.863 150.0 0.0122	Vprt 3.8 0.0	14.000 3.800 17.800	19.280 0.0 0.218		Vel = 2.29		
H.5 to H.1	0.0 4.17	0.863 150.0 0.0122	Vprt 3.8 0.0	35.000 3.800 38.800	19.498 0.0 0.475		Vel = 2.29		
H.1 to H.3	0.0 4.17	0.863 150.0 0.0122	Vprt 3.8 0.0	15.000 3.800 18.800	19.973 0.0 0.230		Vel = 2.29		
H.3 to H.2	0.0 4.17	0.863 150.0 0.0123	Vprt 3.8 0.0	17.000 3.800 20.800	20.203 0.0 0.255		Vel = 2.29		
H.2 to H.6	0.0 4.17	0.863 150.0 0.0122	Vprt 3.8 0.0	11.000 3.800 14.800	20.458 0.0 0.181		Vel = 2.29		
H.6 to T.21	0.0 4.17	0.863 150.0 0.0122	Vptb 18.4 0.0	1.000 18.400 19.400	20.639 0.0 0.237		Vel = 2.29		
T.21 to H.10	-1.89 2.28	0.863 150.0 0.0040	Vprt 3.8 0.0	13.000 3.800 16.800	20.876 0.0 0.068		Vel = 1.25		
H.10 to H.17	0.0 2.28	0.863 150.0 0.0040	Vprt 3.8 0.0	16.000 3.800 19.800	20.944 0.0 0.080		Vel = 1.25		
H.17 to H.19	0.0 2.28	0.863 150.0 0.0040	Vprt 3.8 0.0	19.000 3.800 22.800	21.024 0.0 0.091		Vel = 1.25		
H.19 to H.18	0.0 2.28	0.863 150.0 0.0041		8.000 0.0 8.000	21.115 0.0 0.033		Vel = 1.25		

Final Calculations - Hazen-Williams

Viega LLC
 218 OAKHAVEN DRIVE, LOT 4 - Two Head Calculation (H.20 & H.16)

Page 7
 Date 3/3/2021

Hyd. Ref. Point	Qa Qt	Dia. "C" Pf/Ft	Fitting or Eqv. Ln.	Pipe Ftng's Total	Pt Pe Pf	Pt Pv Pn	*****	Notes	*****
H.18 to H.13	0.0 2.28	0.863 150.0 0.0040	Vprt 3.8 0.0	9.000 3.800 12.800	21.148 0.0 0.051		Vel = 1.25		
H.13 to H.14	0.0 2.28	0.863 150.0 0.0040	Vprt 3.8 0.0	8.000 3.800 11.800	21.199 0.0 0.047		Vel = 1.25		
H.14 to H.15	0.0 2.28	0.863 150.0 0.0041	Vprt 3.8 0.0	10.000 3.800 13.800	21.246 0.0 0.056		Vel = 1.25		
H.15 to T.24	0.0 2.28	0.863 150.0 0.0040	Vptb 18.4 0.0	10.000 18.400 28.400	21.302 0.0 0.114		Vel = 1.25		
	0.0 2.28				21.416		K Factor = 0.49		
T.21 to H.7	1.88 1.88	0.863 150.0 0.0029	Vprt 3.8 0.0	19.000 3.800 22.800	20.876 0.0 0.065		Vel = 1.03		
H.7 to H.11	0.0 1.88	0.863 150.0 0.0028	Vprt 3.8 0.0	16.000 3.800 19.800	20.941 0.0 0.055		Vel = 1.03		
H.11 to T.22	0.0 1.88	0.863 150.0 0.0028	Vprt 3.8 0.0	4.000 3.800 7.800	20.996 0.0 0.022		Vel = 1.03		
	0.0 1.88				21.018		K Factor = 0.41		