


Level, DB04
2 piece(s) 2 x 10 Spruce-Pine-Fir No. 1 / No. 2

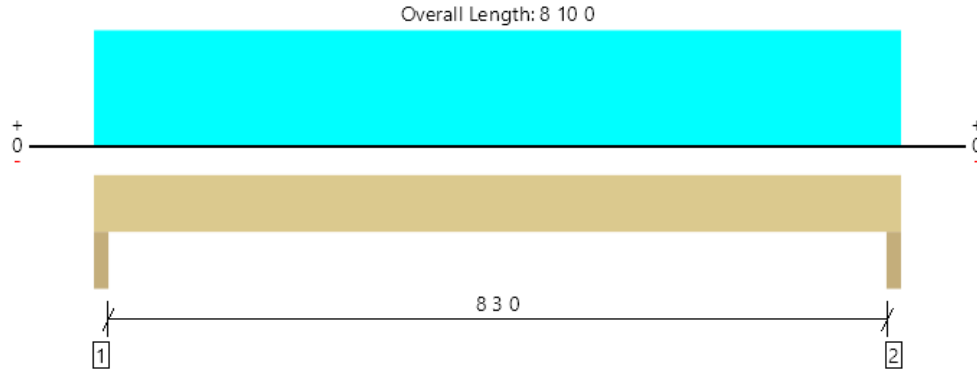

All locations are measured from the outside face of left support (or left cantilever end). All dimensions are horizontal.

Design Results	Actual @ Location	Allowed	Result	LDF	Load: Combination (Pattern)
Member Reaction (lbs)	605 @ 0 2 0	4463 (3.50")	Passed (14%)	--	1.0 D + 1.0 S (All Spans)
Shear (lbs)	460 @ 1 0 12	2872	Passed (16%)	1.15	1.0 D + 1.0 S (All Spans)
Moment (Ft-lbs)	1238 @ 4 5 0	3946	Passed (31%)	1.15	1.0 D + 1.0 S (All Spans)
Live Load Defl. (in)	0.025 @ 4 5 0	0.425	Passed (L/999+)	--	1.0 D + 1.0 S (All Spans)
Total Load Defl. (in)	0.058 @ 4 5 0	0.567	Passed (L/999+)	--	1.0 D + 1.0 S (All Spans)

System : Roof
Member Type : Drop Beam
Building Use : Residential
Building Code : IBC 2018
Design Methodology : ASD
Member Pitch : 0/12

- Deflection criteria: LL (L/240) and TL (L/180).
- Allowed moment does not reflect the adjustment for the beam stability factor.
- Applicable calculations are based on NDS.

Supports	Bearing Length			Loads to Supports (lbs)			Accessories
	Total	Available	Required	Dead	Snow	Total	
1 - Column - SPF	3.50"	3.50"	1.50"	340	265	605	None
2 - Column - SPF	3.50"	3.50"	1.50"	340	265	605	None

Lateral Bracing	Bracing Intervals	Comments
Top Edge (Lu)	8 10 0 o/c	
Bottom Edge (Lu)	8 10 0 o/c	

•Maximum allowable bracing intervals based on applied load.

Vertical Loads	Location (Side)	Tributary Width	Dead (0.90)	Snow (1.15)	Comments
0 - Self Weight (PLF)	0 0 0 to 8 10 0	N/A	7.0	--	
1 - Uniform (PSF)	0 0 0 to 8 10 0 (Top)	2 0 0	10.0	30.0	Default Load
2 - Uniform (PLF)	0 0 0 to 8 10 0 (Top)	N/A	50.0	-	

Weyerhaeuser Notes

Weyerhaeuser warrants that the sizing of its products will be in accordance with Weyerhaeuser product design criteria and published design values. Weyerhaeuser expressly disclaims any other warranties related to the software. Use of this software is not intended to circumvent the need for a design professional as determined by the authority having jurisdiction. The designer of record, builder or framer is responsible to assure that this calculation is compatible with the overall project. Accessories (Rim Board, Blocking Panels and Squash Blocks) are not designed by this software. Products manufactured at Weyerhaeuser facilities are third-party certified to sustainable forestry standards. Weyerhaeuser Engineered Lumber Products have been evaluated by ICC-ES under evaluation reports ESR-1153 and ESR-1387 and/or tested in accordance with applicable ASTM standards. For current code evaluation reports, Weyerhaeuser product literature and installation details refer to www.weyerhaeuser.com/woodproducts/document-library.

The product application, input design loads, dimensions and support information have been provided by ForteWEB Software Operator

ForteWEB Software Operator	Job Notes
Cameron Lallathin Carolina Structural Systems (336) 423-2910 clallathin@carolinastructuralsystems.com	

