

September 3, 2020

Harnett County Government Complex
307 W. Cornelius Harnett Boulevard
Lillington, NC 27546

Re: Application for improvement permit for 46 Sherman Pines Dr
Health Department file number SFD2008-0014

ph: 910-893-7547
fax: 910-893-9371

Dear Mr. & Mrs. Kearney,

The Harnett County Health Department, Environmental Health Division evaluated the above referenced property at the site designated on the plat/site plan that accompanied your improvement permit application. According to your application the site is to serve a 2 bedroom home (State minimum) with a design wastewater flow of 240 gallons per day. The evaluation was done in accordance with the laws and rules governing wastewater systems in NC General Statute 130A-333 including related statutes and Title 15A, Subchapter 18A, of the NC Administrative Code, Rule .1900 and related rules.

Based on the criteria set out in Title 15A, Subchapter 18A, of the NC Administrative Code, Rule .1940 through .1948, the evaluation indicated that the site is UNSUITABLE for a sanitary system of sewage treatment and disposal. Therefore, we must deny your request for an improvement permit. A copy of the site evaluation is enclosed. The site is unsuitable based on the following:

- Unsuitable soil topography and/or landscape position (Rule .1940)
- Unsuitable soil characteristics (structure or clay mineralogy) (Rule .1941)
- Unsuitable soil wetness condition (Rule .1942)
- Unsuitable soil depth (Rule .1943)
- Presence of restrictive horizon (Rule .1944)
- X Insufficient space for septic system and repair area (Rule .1945)
- Unsuitable for meeting required setbacks (Rule .1950)
- Other (Rule .1946) _____

These severe soil or site limitations could cause premature system failure, leading to the discharge of untreated sewage on the ground surface, into surface waters, directly to ground water or inside your structure.

The site evaluation included consideration of possible site modifications, as well as use of modified, innovative, or alternative systems. However, the Health Department has determined that none of the above options will overcome the severe conditions on this site. A possible option might be a system designed to dispose of sewage to another area of suitable soil or off-site to additional property.

For the reasons set out above, the property is currently classified UNSUITABLE, and no improvement permit shall be issued for this site in accordance with Rule .1948(c).

Note that a site classified as UNSUITABLE may be classified as PROVISIONALLY SUITABLE if written documentation is provided that meets the requirements of Rule .1948(d). A copy of this rule is enclosed. You may hire a consultant to assist you if you wish to try to develop a plan under which your site could be reclassified as PROVISIONALLY SUITABLE.

You have a right to an informal review of this decision. You may request an informal review by the soil scientist or environmental health supervisor at the local health department. You may also request an information review by the NC Department of Health and Human Services regional soil scientist. A request for informal review must be made in writing to the local health department.

You also have a right to a formal appeal of this decision. To pursue a formal appeal, you must file a petition for a contested case hearing with the Office of Administrative Hearings, 6714 Mail Service Center, Raleigh, NC 27699-6714. To get a copy of a petition form, you may write the Office of Administrative Hearings or call the office at (919) 431-3000 or download it from the OAH web site at <http://www.ncoah.com/forms.html> . The petition for a contested case hearing must be filed in accordance with the provision of NC General Statutes 130A-24 and 150B-23 and all other applicable provisions of Chapter 150B. NC General Statute 130A-335 (g) provides that your hearing would be held in the county where your property is located.

Please note: If you wish to pursue a formal appeal, you must file the petition form with the Office of Administrative Hearings **WITHIN 30 DAYS OF THE DATE OF THIS LETTER**. The date of this letter is September 3, 2020. Meeting the 30 day deadline is critical to your formal appeal.

If you file a petition for a contested case hearing with the Office of Administrative Hearings, you are required by law (NC General Statute 150B-23) to serve a copy of your petition on the Office of General Counsel, NC Department of Health and Human Services, 2001 Mail Service Center, Raleigh, N.C. 27699-2001.

Do not serve the petition on your local health department. Sending a copy of your petition to the local health department will not satisfy the legal requirement in NC General Statute 150B-23 that you send a copy to the Office of General Counsel, NC Department of Health and Human Services.

You may call or write the local health department if you need any additional information or assistance.

Sincerely,

 Oliver Tolksdorf REHS

Enclosures: Copy of Operation Permit
Copy of Rule .1948

PERMIT # 26721

Operation Permit

22213

New Installation Septic Tank Nitrification Line Repair Expansion

PROPERTY LOCATION: SHERMAN PINES DR

Name: (owner) JOHN P. BENSON SUBDIVISION SHERMAN PINES LOT # 20

System Installer: RICKY HOLLAND Registration # _____

Basement with plumbing: Garage Number of Bedrooms 3


Type of Water Supply: Community Public Well Distance from well 100 feet

System Type: IIIb Types V and VI Systems expire in 5 years.

(In accordance with Table V a)

Owner must contact Health Department 6 months prior to expiration for permit renewal.

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

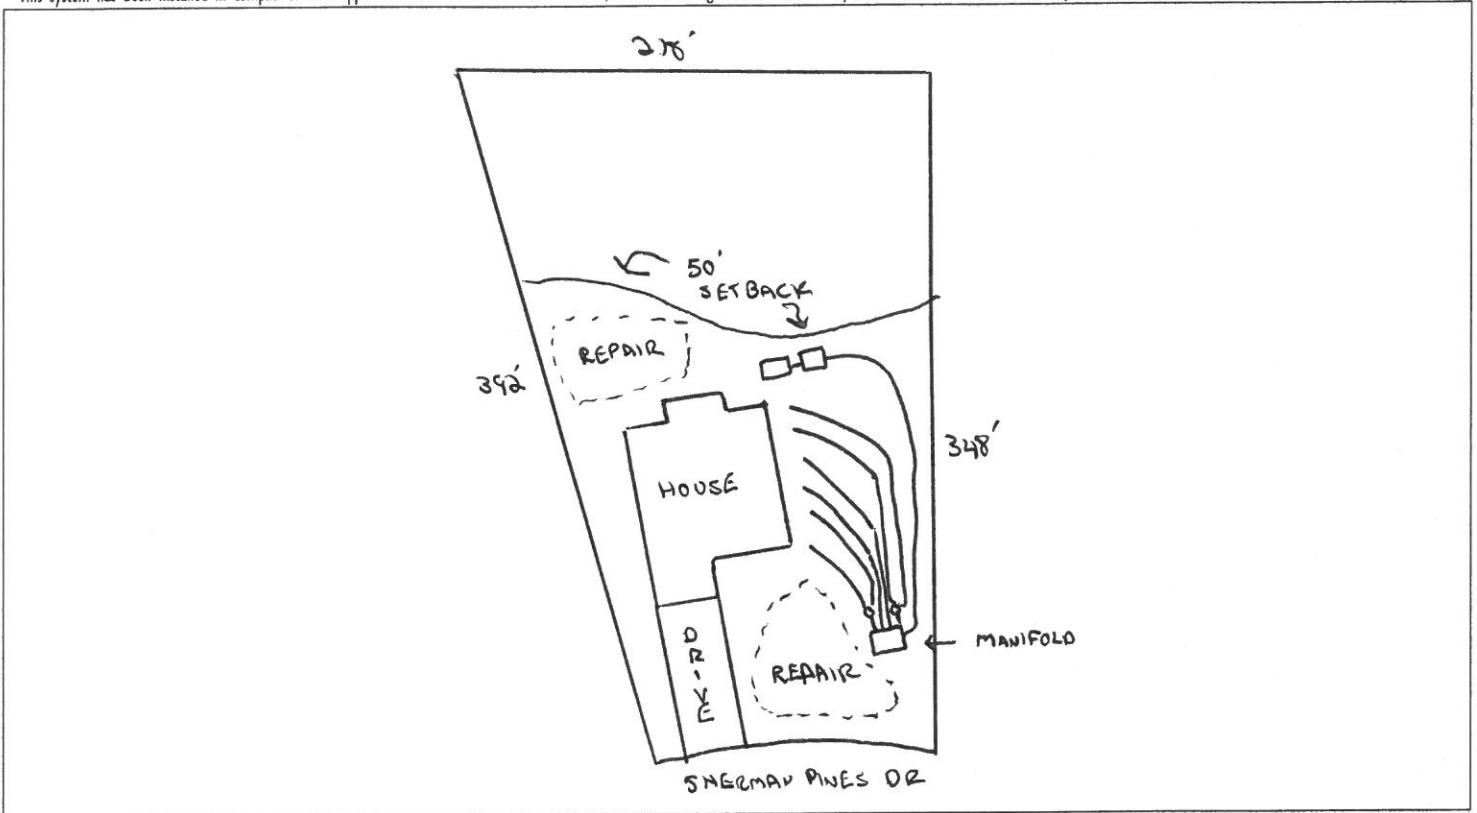

PERMIT CONDITIONS:

I. Performance: System shall perform in accordance with Rule .1961.

II. Monitoring: As required by Rule .1961.

III. Maintenance: As required by Rule .1961. Other: _____
 Subsurface system operator required? Yes No
 If yes, see attached sheet for additional operation conditions, maintenance and reporting.

IV. Operation: REPLACE BATTERY IN PANEL ONCE A YEAR

V. Other: DISTRIBUTION THROUGH MANIFOLD. ALL SYSTEM SPECIFICATIONS ON FILE AT HEALTH DEPARTMENT
 D-Box Pump Alarm H2O Line PWR Line

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system: Conventional Other PUMP TO CHAMBER (PWC) Septic Tank: 1000 gallons Pump Tank: 1000 gallons
 Subsurface No. of exact length width of depth of
 Drainage Field ditches 6 of each ditch VARIOUS feet ditches 3 feet ditches 12 inches
 French Drain Required: _____ Linear feet 240' TOTAL

Authorized State Agent [Signature] LEHS Date 2/14/12

15A NCAC 18A .1948 SITE CLASSIFICATION

(a) Sites classified as SUITABLE may be utilized for a ground absorption sewage treatment and disposal system consistent with these Rules. A suitable classification generally indicates soil and site conditions favorable for the operation of a ground absorption sewage treatment and disposal system or have slight limitations that are readily overcome by proper design and installation.

(b) Sites classified as PROVISIONALLY SUITABLE may be utilized for a ground absorption sewage treatment and disposal system consistent with these Rules but have moderate limitations. Sites classified Provisionally Suitable require some modifications and careful planning, design, and installation in order for a ground absorption sewage treatment and disposal system to function satisfactorily.

(c) Sites classified UNSUITABLE have severe limitations for the installation and use of a properly functioning ground absorption sewage treatment and disposal system. An improvement permit shall not be issued for a site which is classified as UNSUITABLE. However, where a site is UNSUITABLE, it may be reclassified PROVISIONALLY SUITABLE if a special investigation indicates that a modified or alternative system can be installed in accordance with Rules .1956 or .1957 of this Section.

(d) A site classified as UNSUITABLE may be used for a ground absorption sewage treatment and disposal system specifically identified in Rules .1955, .1956, or .1957 of this Section or a system approved under Rule .1969 if written documentation, including engineering, hydrogeologic, geologic or soil studies, indicates to the local health department that the proposed system can be expected to function satisfactorily. Such sites shall be reclassified as PROVISIONALLY SUITABLE if the local health department determines that the substantiating data indicate that:

- (1) a ground absorption system can be installed so that the effluent will be non-pathogenic, non-infectious, non-toxic, and non-hazardous;
- (2) the effluent will not contaminate groundwater or surface water; and
- (3) the effluent will not be exposed on the ground surface or be discharged to surface waters where it could come in contact with people, animals, or vectors.

The State shall review the substantiating data if requested by the local health department.

*History Note: Authority G.S. 130A-335(e);
Eff. July 1, 1982;
Amended Eff. April 1, 1993; January 1, 1990.*