



FRONT ELEVATION


Scale: 1/4" = 1'0"

9'0" CEILING HEIGHT FIRST FLOOR
7'6" HEADER HEIGHT
8'0" CEILING HEIGHT SECOND FLOOR
7' HEADED HEIGHT
FRAME WINDOWS TO HEADER HEIGHT




LEFT ELEVATION

Scale: 1/8" = 1'0"

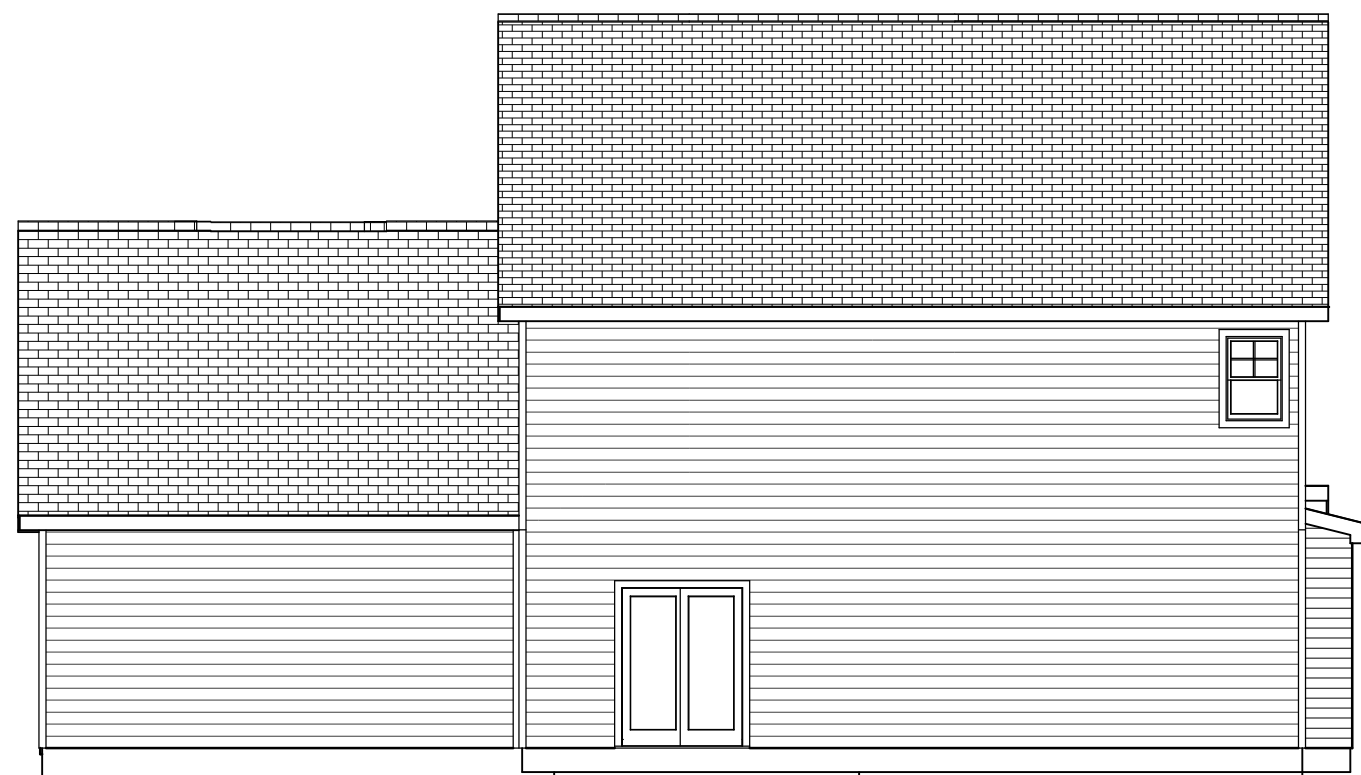


REAR ELEVATION

Scale: 1/8" = 1'0"

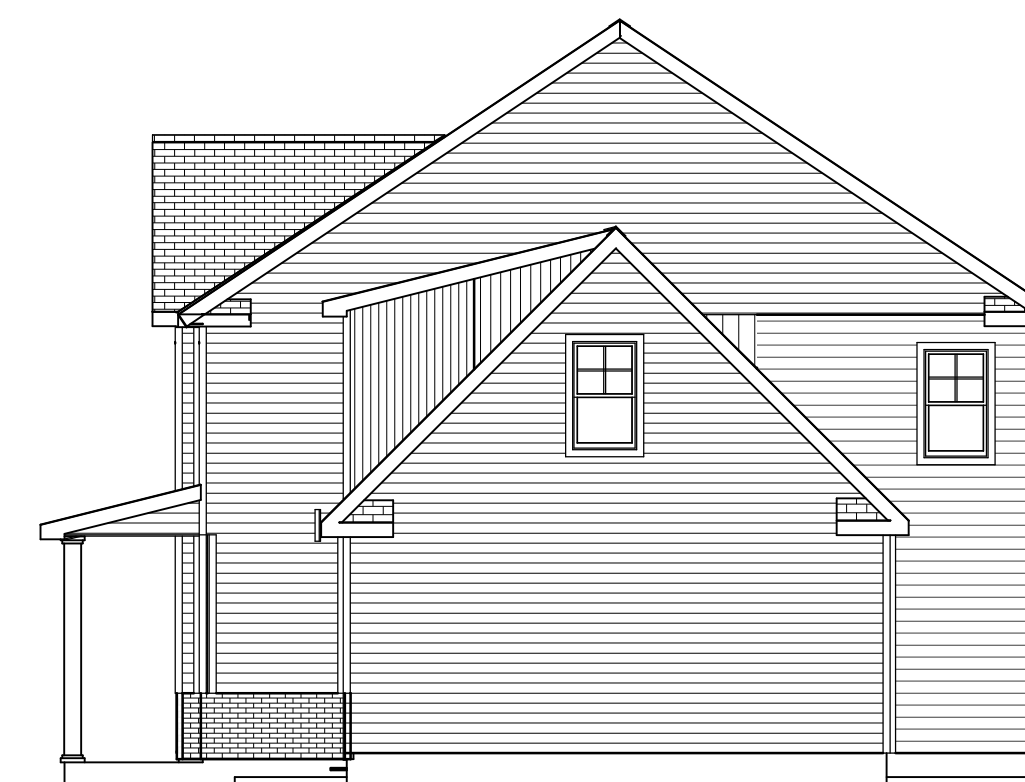

RIGHT ELEVATION

Scale: 1/8" = 1'0"

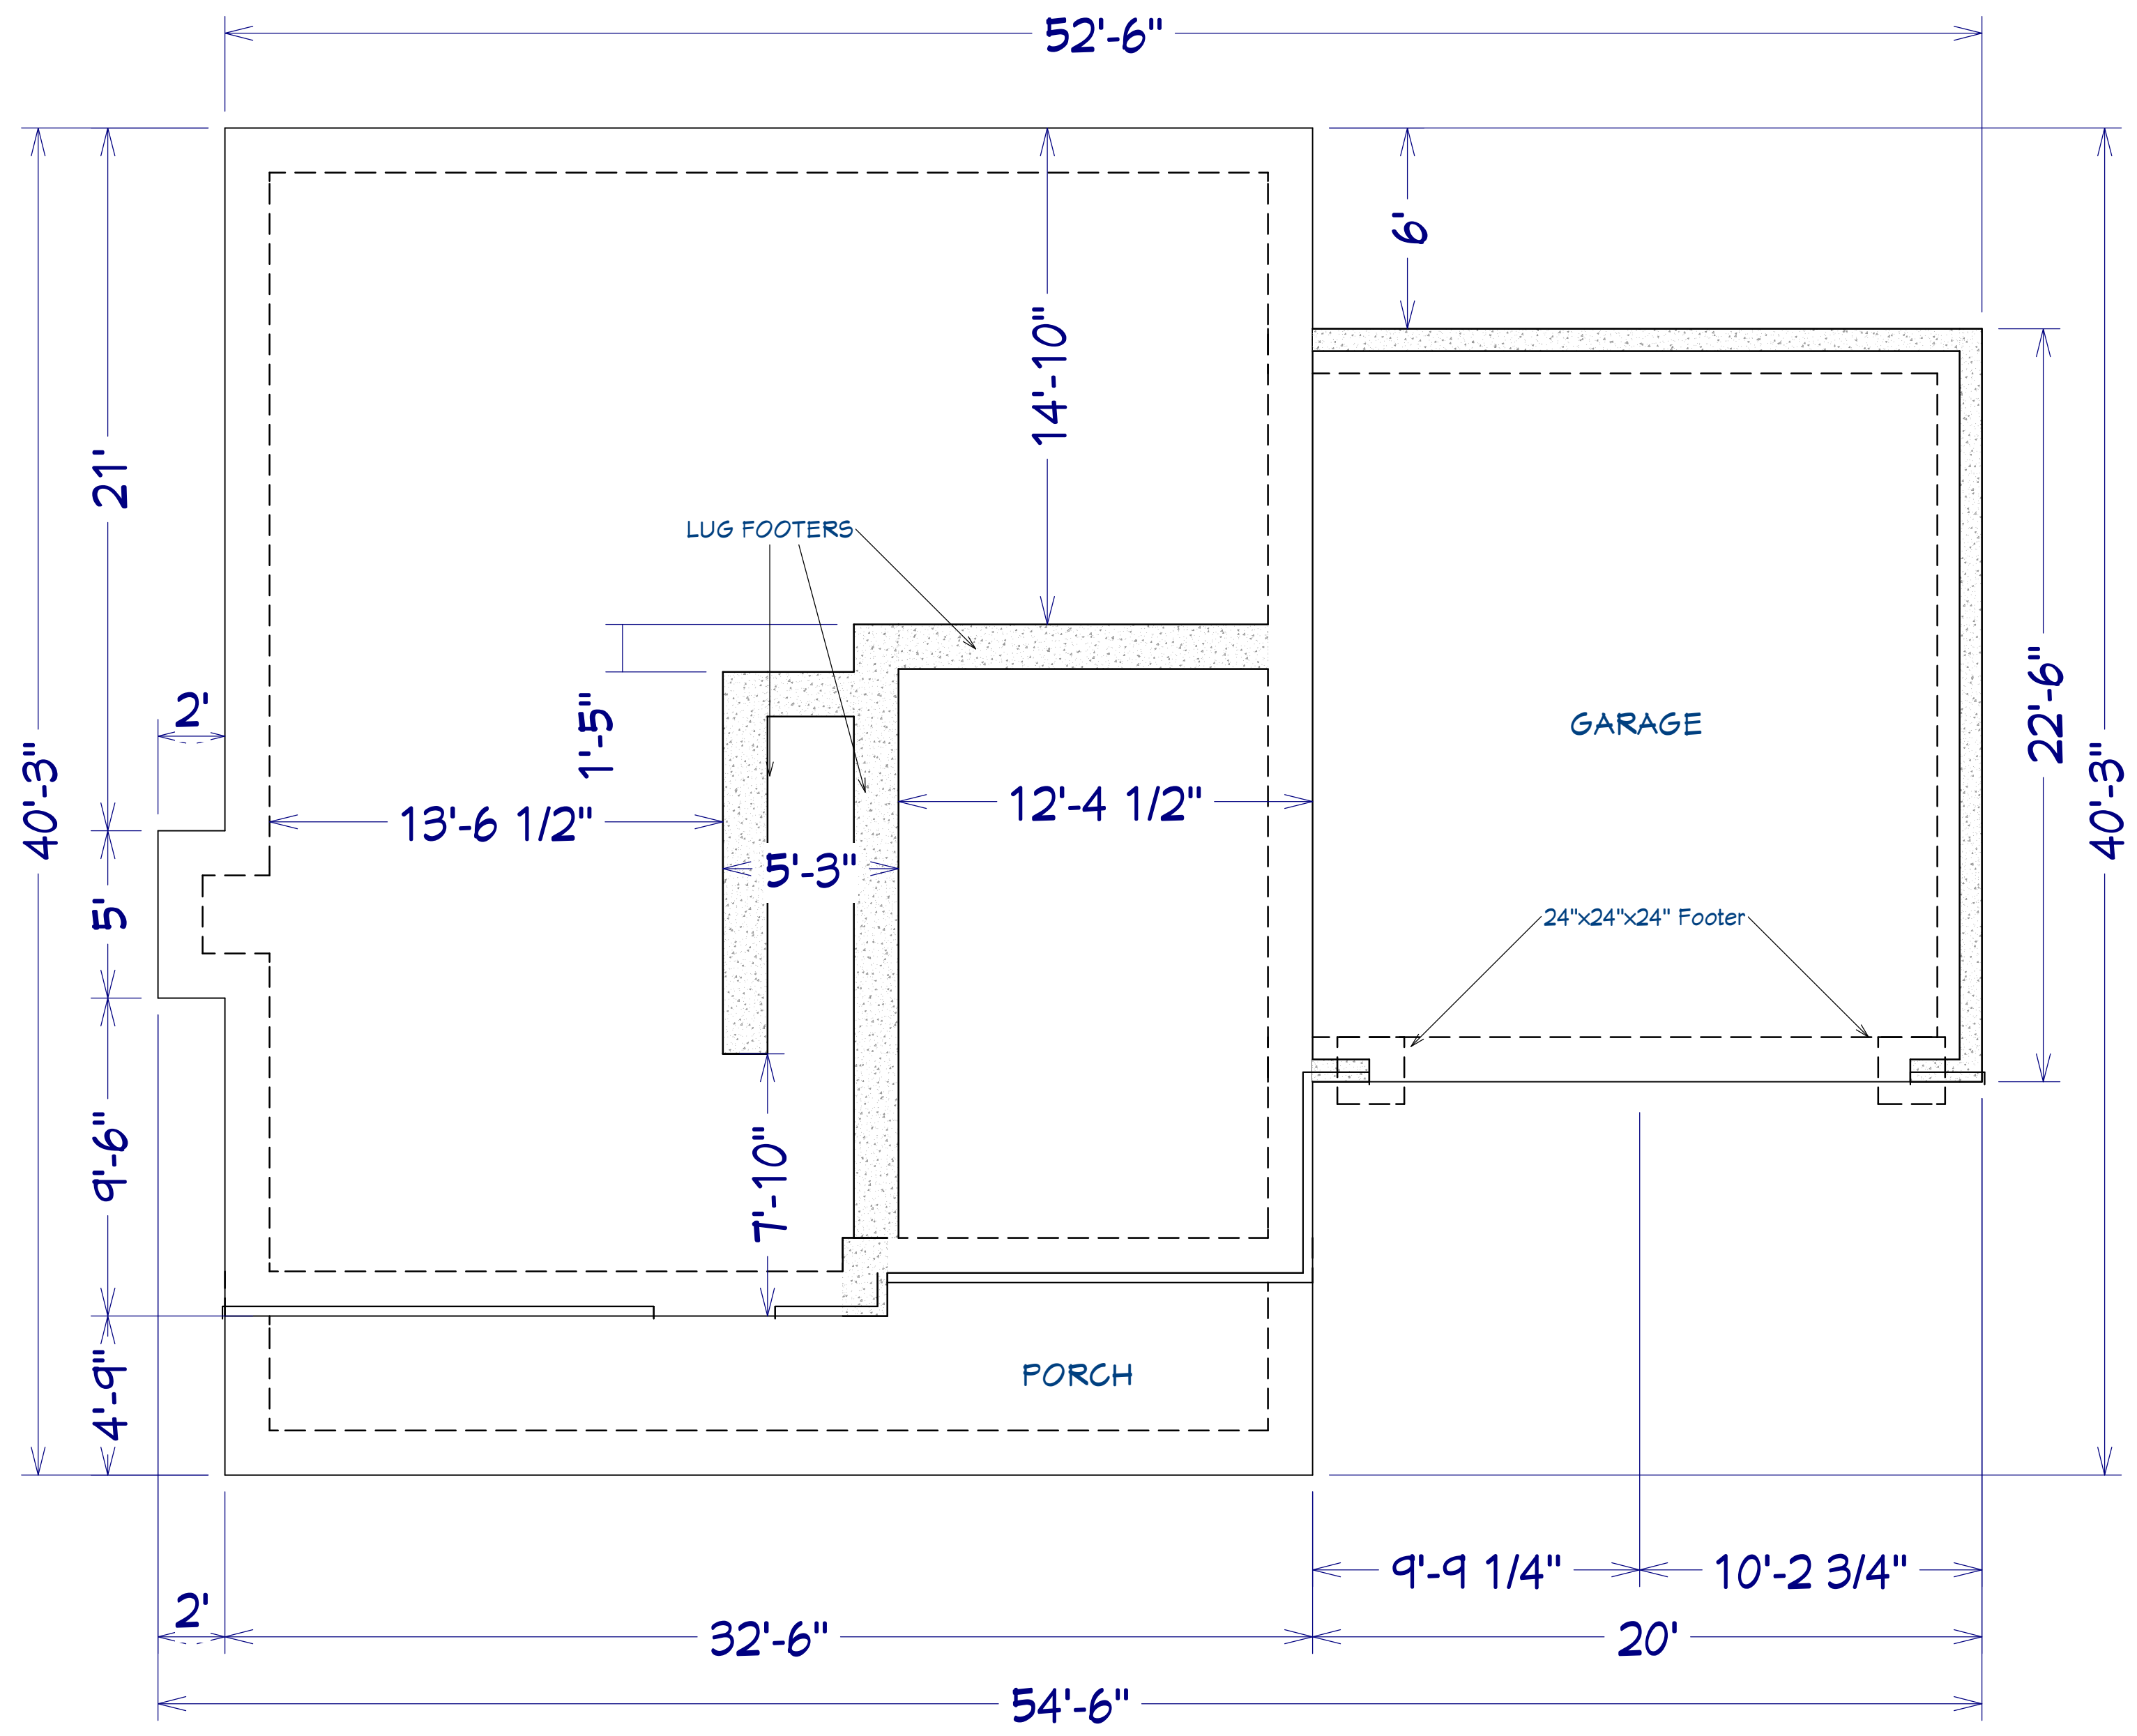

| AREA SCHEDULE | |
|------------------|----------|
| NAME | AREA |
| 1st FLOOR | 1,112 SF |
| 2nd FLOOR | 1,131 SF |
| BONUS ROOM | 279 SF |
| GARAGE | 452 SF |
| FRONT PORCH | 189 SF |
| TOTAL HEATED | 2,522 SF |
| | |
| TOTAL UNDER ROOF | 3,163 SF |

FOUNDATION PLAN
Scale: 1/4" = 1'0"

SHEET TITLE:
FOUNDATION


PROJECT ADDRESS:
138 NAVAHO TRAIL
SUMMERLIN LOT 41

DESIGNED BY:
Precision Custom Homes
Raeferd, NC
Shaun@PrecisionCustomHomesNC.com

DATE:
11/14/20

SCALE:
1/4" = 1'

SHEET:
A-2

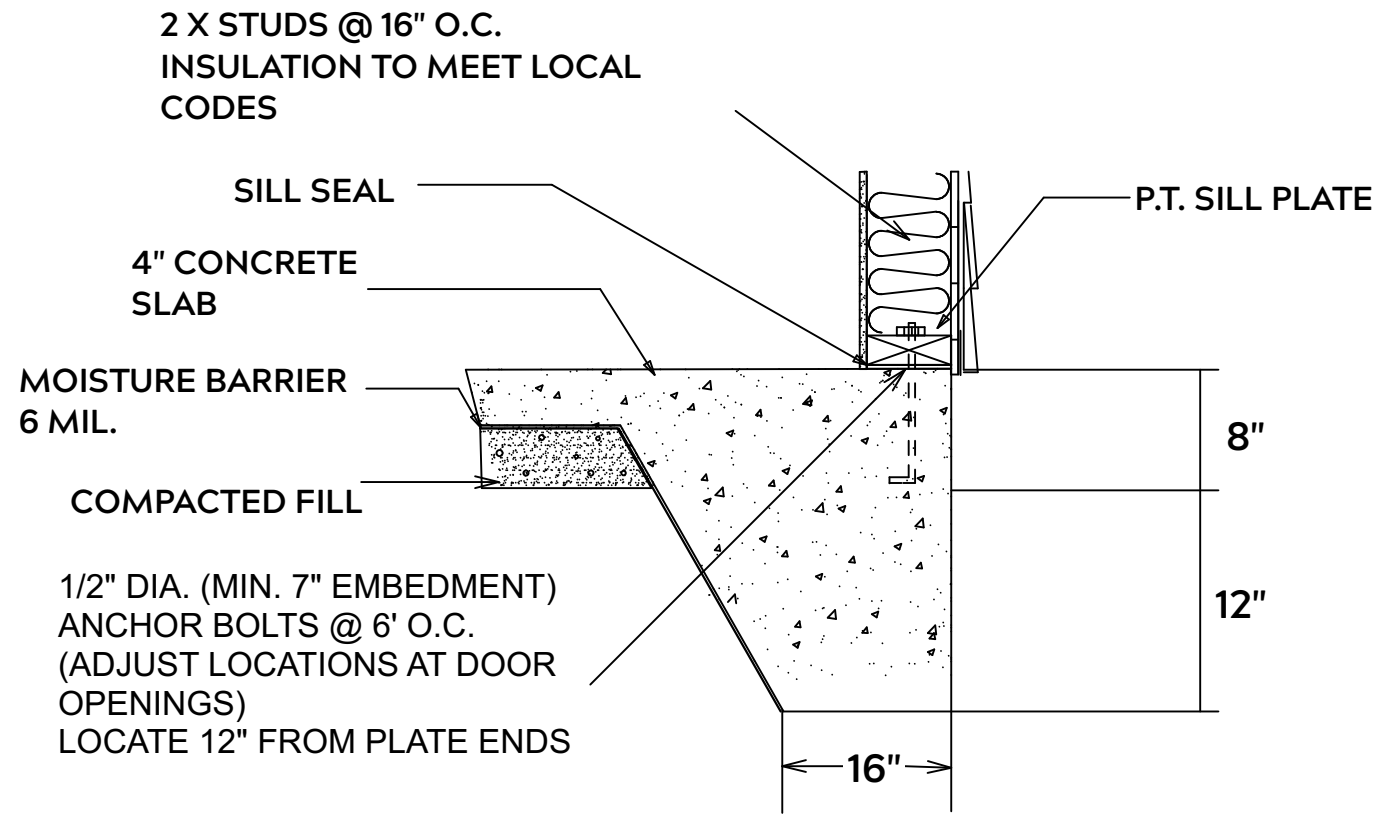

MONOLITHIC SLAB

FOUNDATION NOTES:


ALL FOOTINGS SHALL BEAR ON ORIGINAL UNDISTURBED SOIL
THE 28 DAY COMPRESSIVE STRENGTH OF ALL FOOTINGS IS 3000 PSI

PROVIDE WATER PROOFING AND PERIMTER DRAINS AS REQUIRED

FOOTING WIDTHS ARE BASED ON A LOAD BEARING SOIL CAPACITY OF 2000 PSI

PROVIDE 6 MIL POLY VAPOR BARRIER TO COVER GROUND IN CRAWL SPACE AND GROUND UNDER POURED CONCRETE

ALL ANCHOR BOLTS TO BE 1/2" X 12" LONG. ANCHOR BOLTS SHALL BE SPACED AT A MAXIMUM OF 6' ON CENTER AND NO MORE THEN 1' FROM EACH CORNER

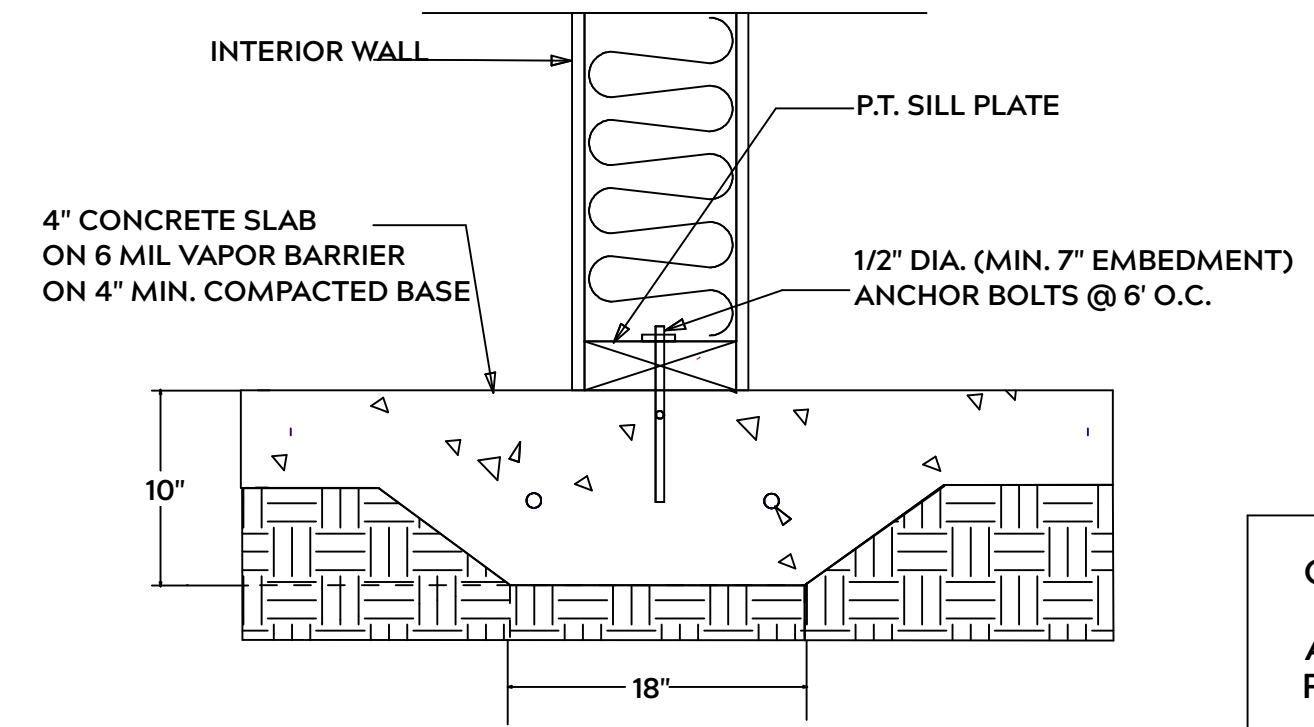

LUG FOOTING

GENERAL FRAMING NOTES:

ALL LUMBER IN CONTACT WITH CONCRETE OR MASONRY SHALLE BE PRESSURE TREATED

FRAMING LUMBER SHALL BE SYP #2 GRADE AND / OR SPRUCE PINE FIR #1 AND / OR KILN DRIED

WHERE PRE-ENGINEERED JOISTS AND TRUSSES ARE USED, MANUFACTURER SHALL PROVIDE DRAWINGS / SCHEMATICS, WHICH SHALL BEAR OF A N.C. ENGINEER

STUDS AND JOISTS SHALL NOT BE CUT TO INSTALL PLUMBING OR WIRING WITHOUT ADDING METAL OR WOOD SIDE PANELS TO STRENGTHEN MEMBER TO ITS ORIGINAL CAPACITY

NAIL MULTIPLE MEMBERS WITH 2 ROWS OF 16d NAILS STAGGERED 32" O.C. AND USE 3 X 16d NAILS 2" IN AT EACH END.


NAIL FLOOR JOISTS TO SILL PLATE WITH WITH 8d TOE NAILS

ALL EXPOSED FRAMING ON PORCHES OR DECKS SHALL BE PRESSURE TREATED


PROVIDE WATERPROOFING AND DRAINS AS REQUIRED

ALL FRAMING TO BE 16" O.C. WALL FRAMING DIMENSIONS ARE BASED ON 2X4 OR 2X6 EXTERIOR WALLS AND 2X4 INTERIOR WALLS. DOULBE / TRIPLE JACK STUDS AS NECESSARY UNDER HEADERS AS REQUIRED

LVL'S TO BE SIZED BY OTHERS (TRUSS MANUFACTURER)

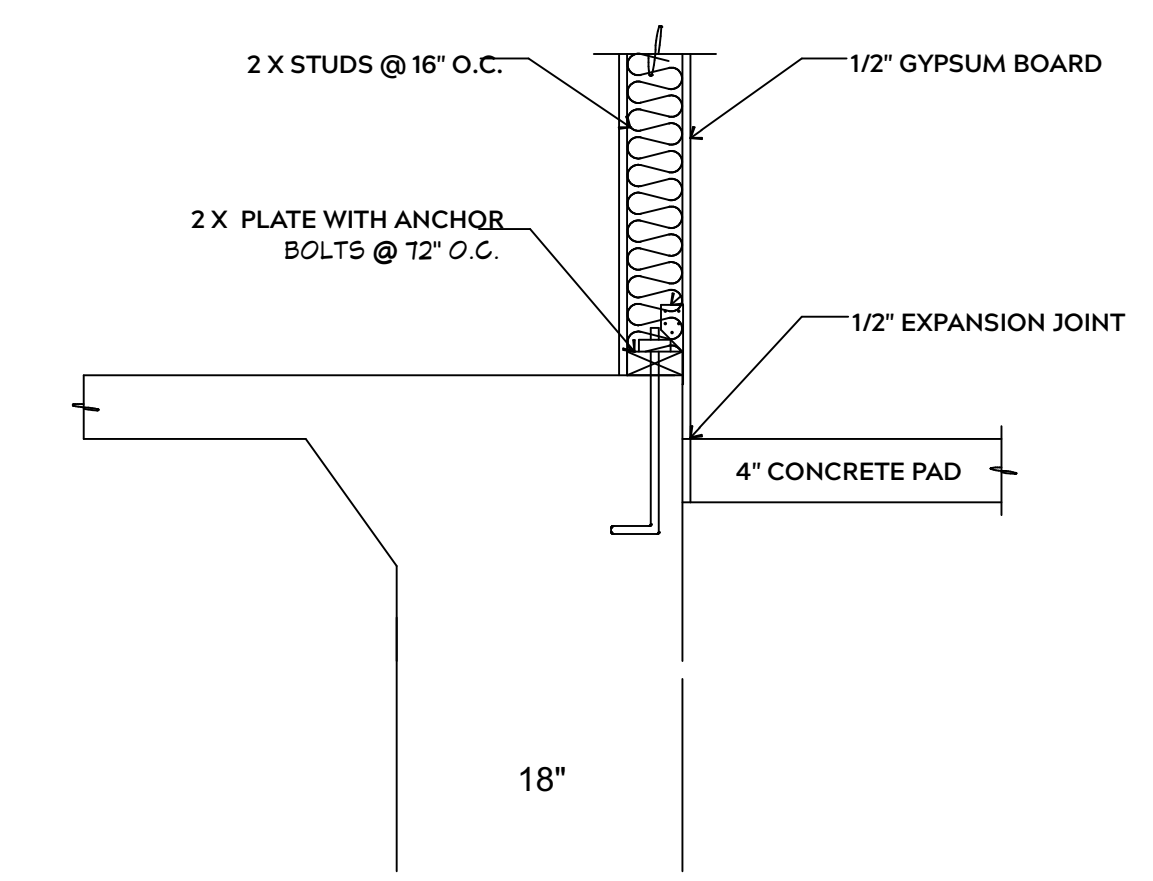


INTERIOR WALL @ GARAGE STEP DOWN

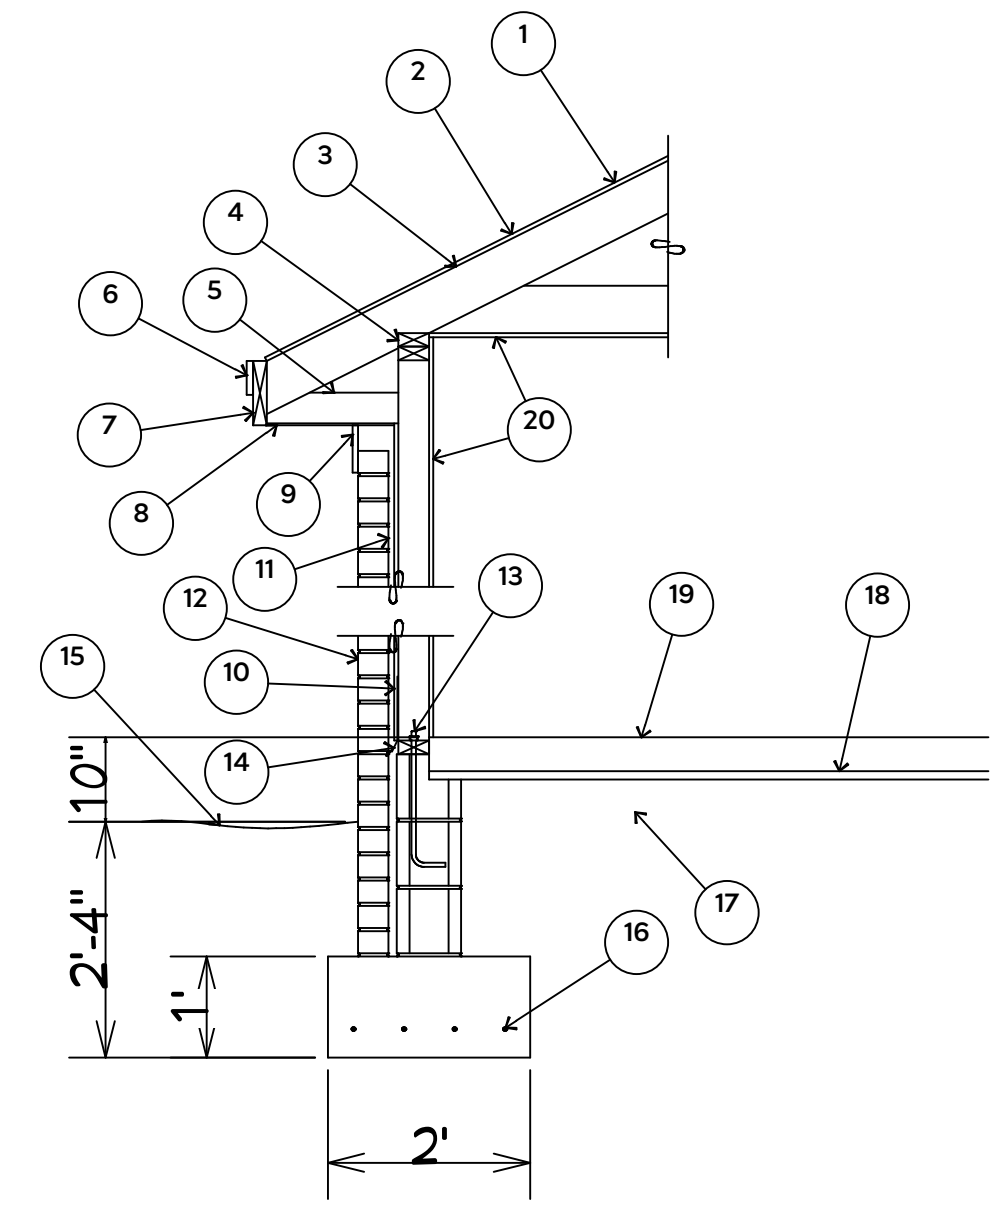


1. 15# FELT UNDERLAYMENT UNDER COMPOSITION SHINGLES.
2. ROOF DECKING.
3. 2 X RAFTERS / ENGINEERED TRUSSES
4. DOUBLE TOP PLATE.
5. 2 X 4 RETURN.
6. 3/4" FASCIA OR PVC TRIM COIL
7. 2 X FASCIA
8. 1/4" PLYWOOD OR VINYL SOFFIT
9. 1 X FREIZE BOARD (TO BE USED WITH BRICK VENEERS)
10. INSULATION BOARD.
11. AIR SPACE.
12. BRICK WITH BRICK TIES PER MANUFACTURER'S SPECIFICATIONS.
13. 1/2" X 15" ANCHOR BOLTS, 6'-0" O.C., 12" FROM CORNERS.
14. FLASHING WITH WEEP HOLES @ 48" O.C.
15. FINISHED GRADE.
16. (4) #4 REBARs ALL IN SOLID FOOTING 3" OFF BOTTOM.
17. COMPACTED EARTH FILL.
18. 1" STYROFOAM WITH 6 MIL VAPOR BARRIER.
19. 4" CONCRETE SLAB, 3,000 P.S.I. WITH 6" X 6" 10 GA. X 10 GA. WELDED WIRE FABRIC.
20. 1/2" GYPSUM BOARD.

EXTERIOR WALL SECTION

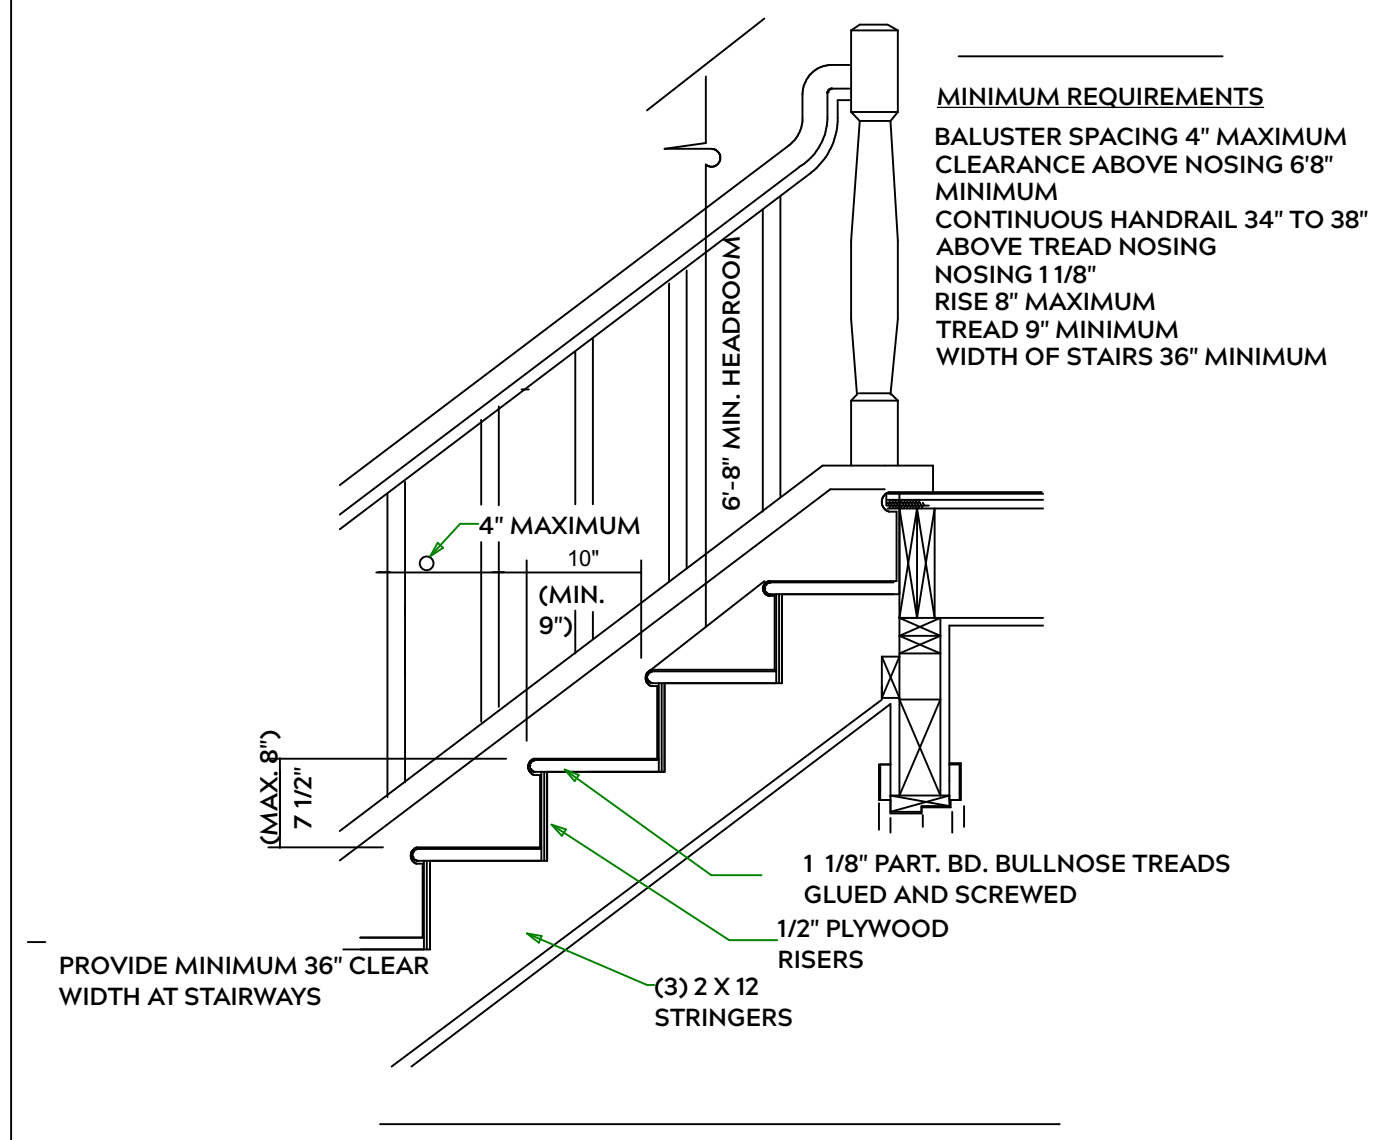

STAIR DETAIL

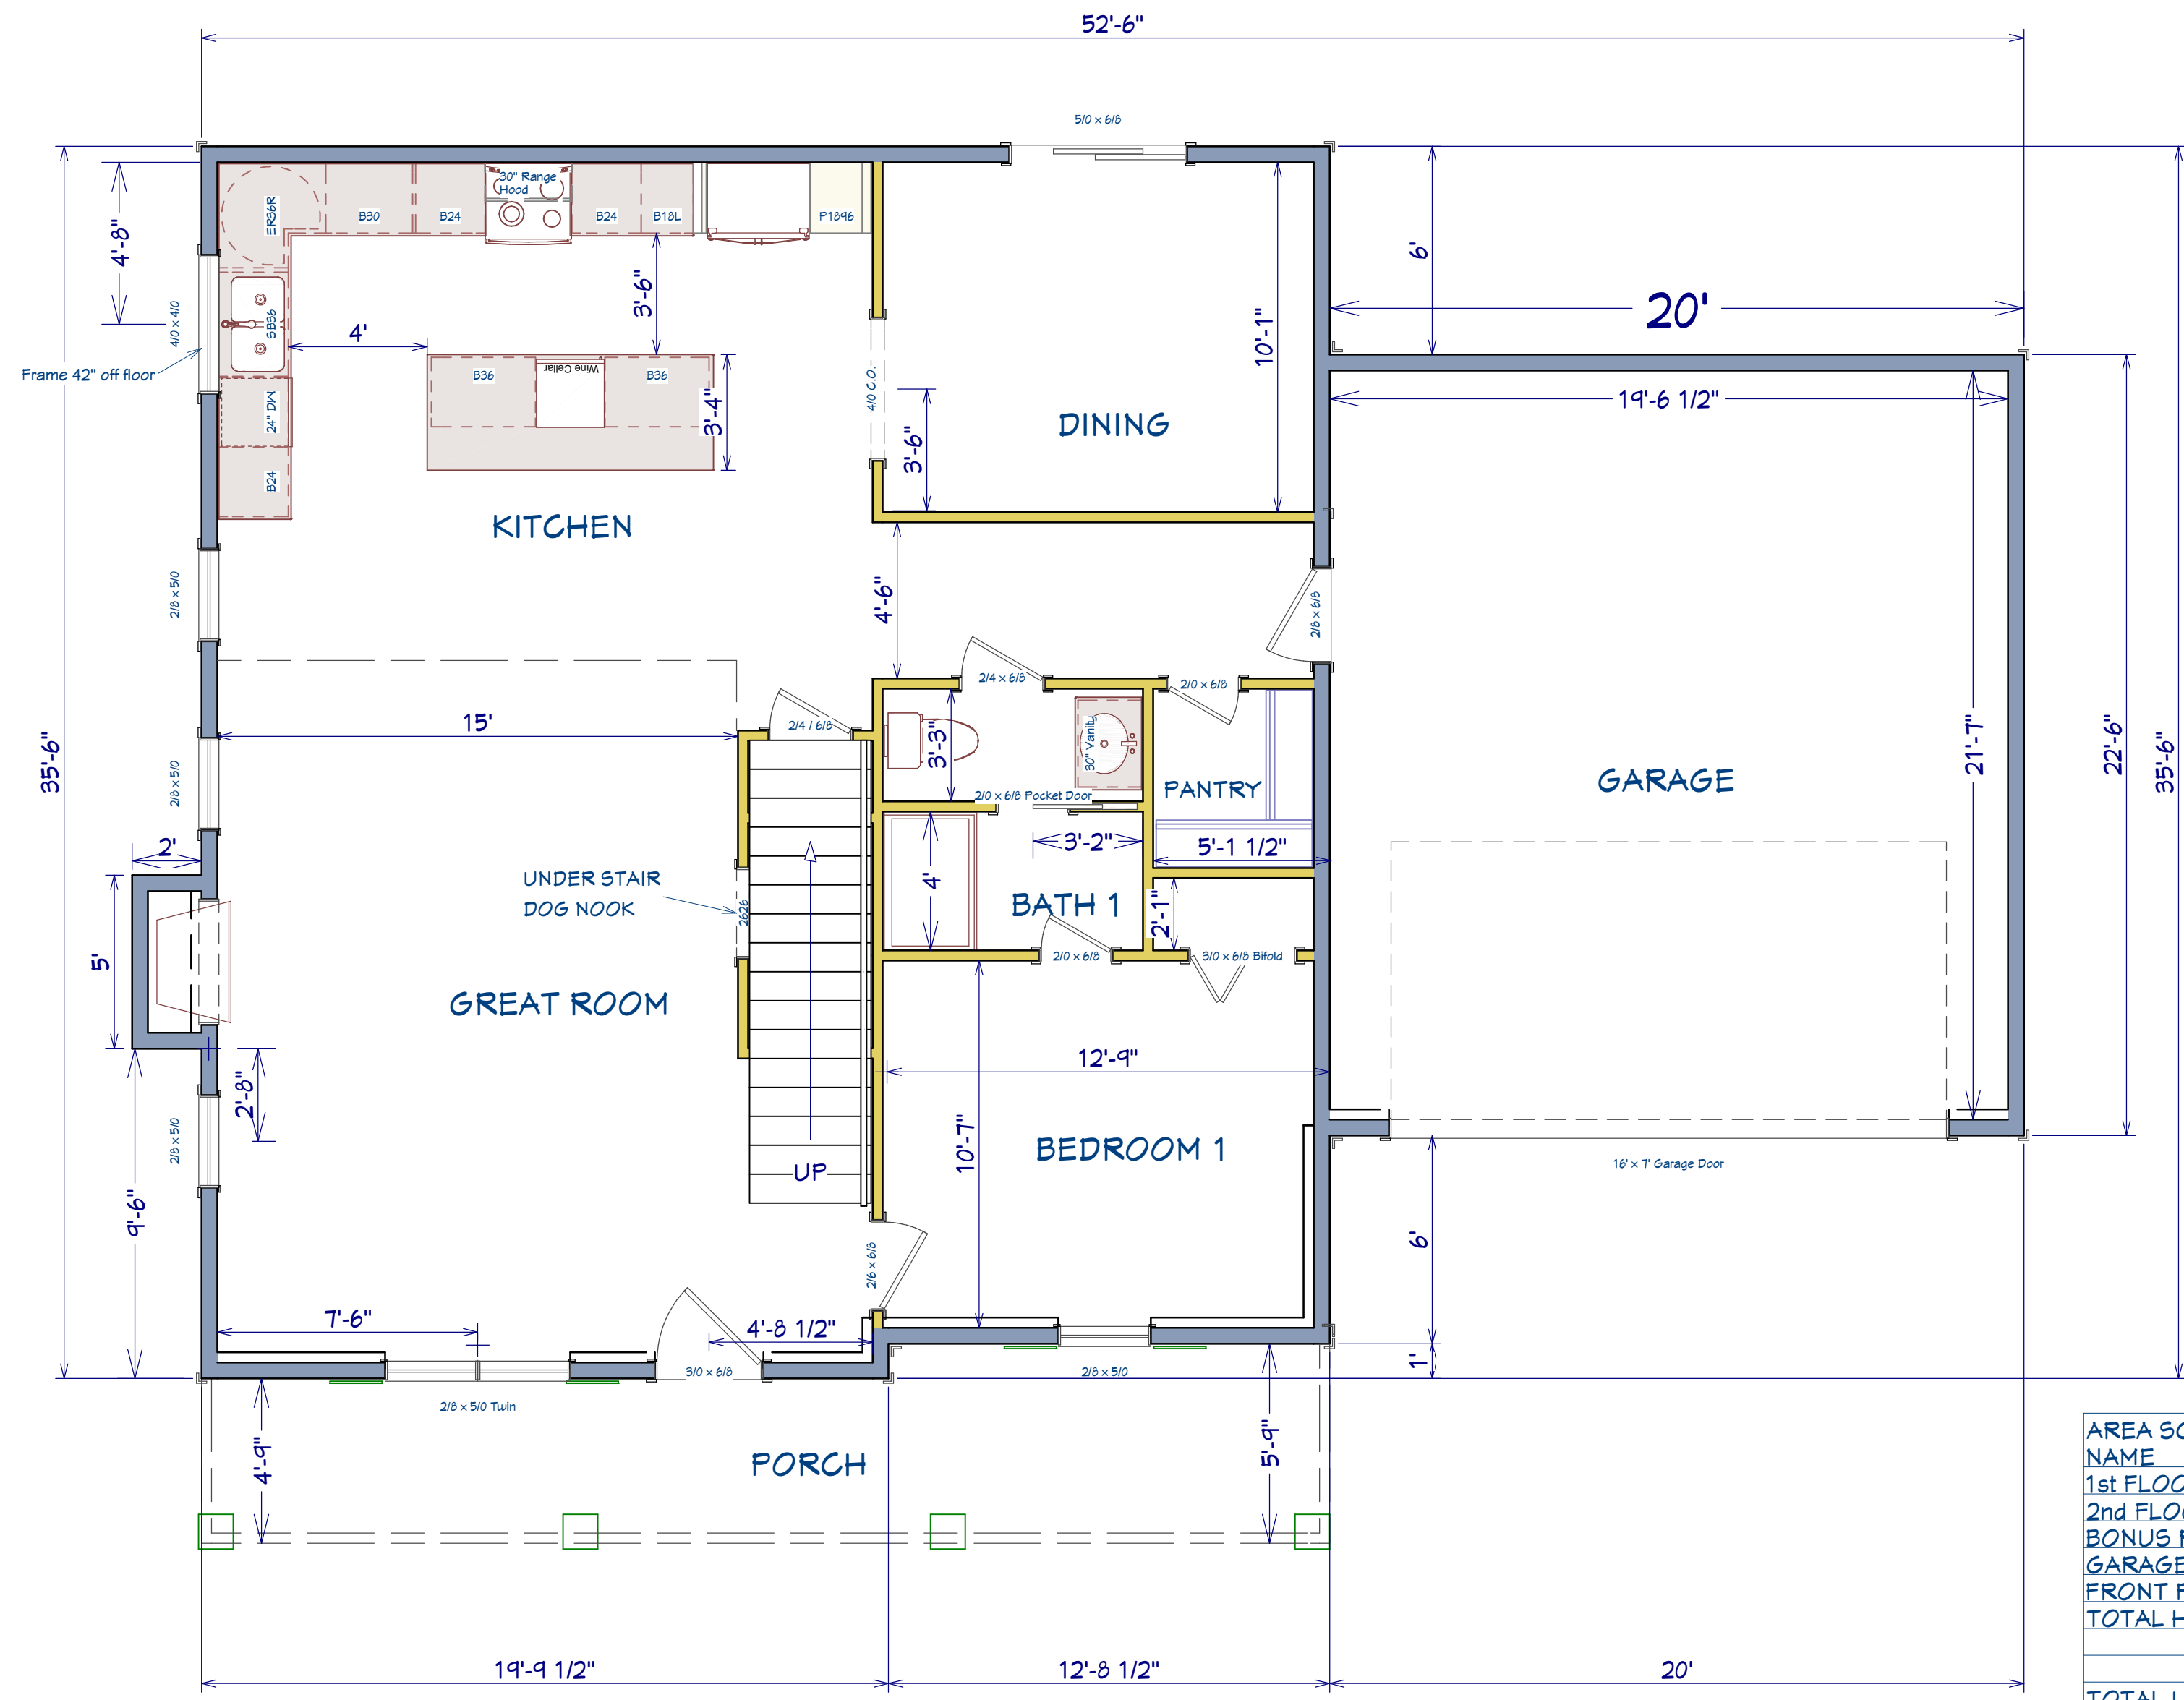

| AREA SCHEDULE NAME | AREA |
|--------------------|----------|
| 1st FLOOR | 1,112 SF |
| 2nd FLOOR | 1,131 SF |
| BONUS ROOM | 279 SF |
| GARAGE | 452 SF |
| FRONT PORCH | 189 SF |
| TOTAL HEATED | 2,522 SF |
| TOTAL UNDER ROOF | 3,163 SF |

1st Floor
Scale: 1/4" = 1'0"

SHEET TITLE:
1st FLOOR


PROJECT ADDRESS:
138 NAVAHO TRAIL
SUMMERLIN LOT 41

DESIGNED BY:
Precision Custom Homes
RaeFord, NC
Shaun@PrecisionCustomHomesNC.com

DATE:
11/14/20

SCALE:
1/4" = 1'

SHEET:
A-4

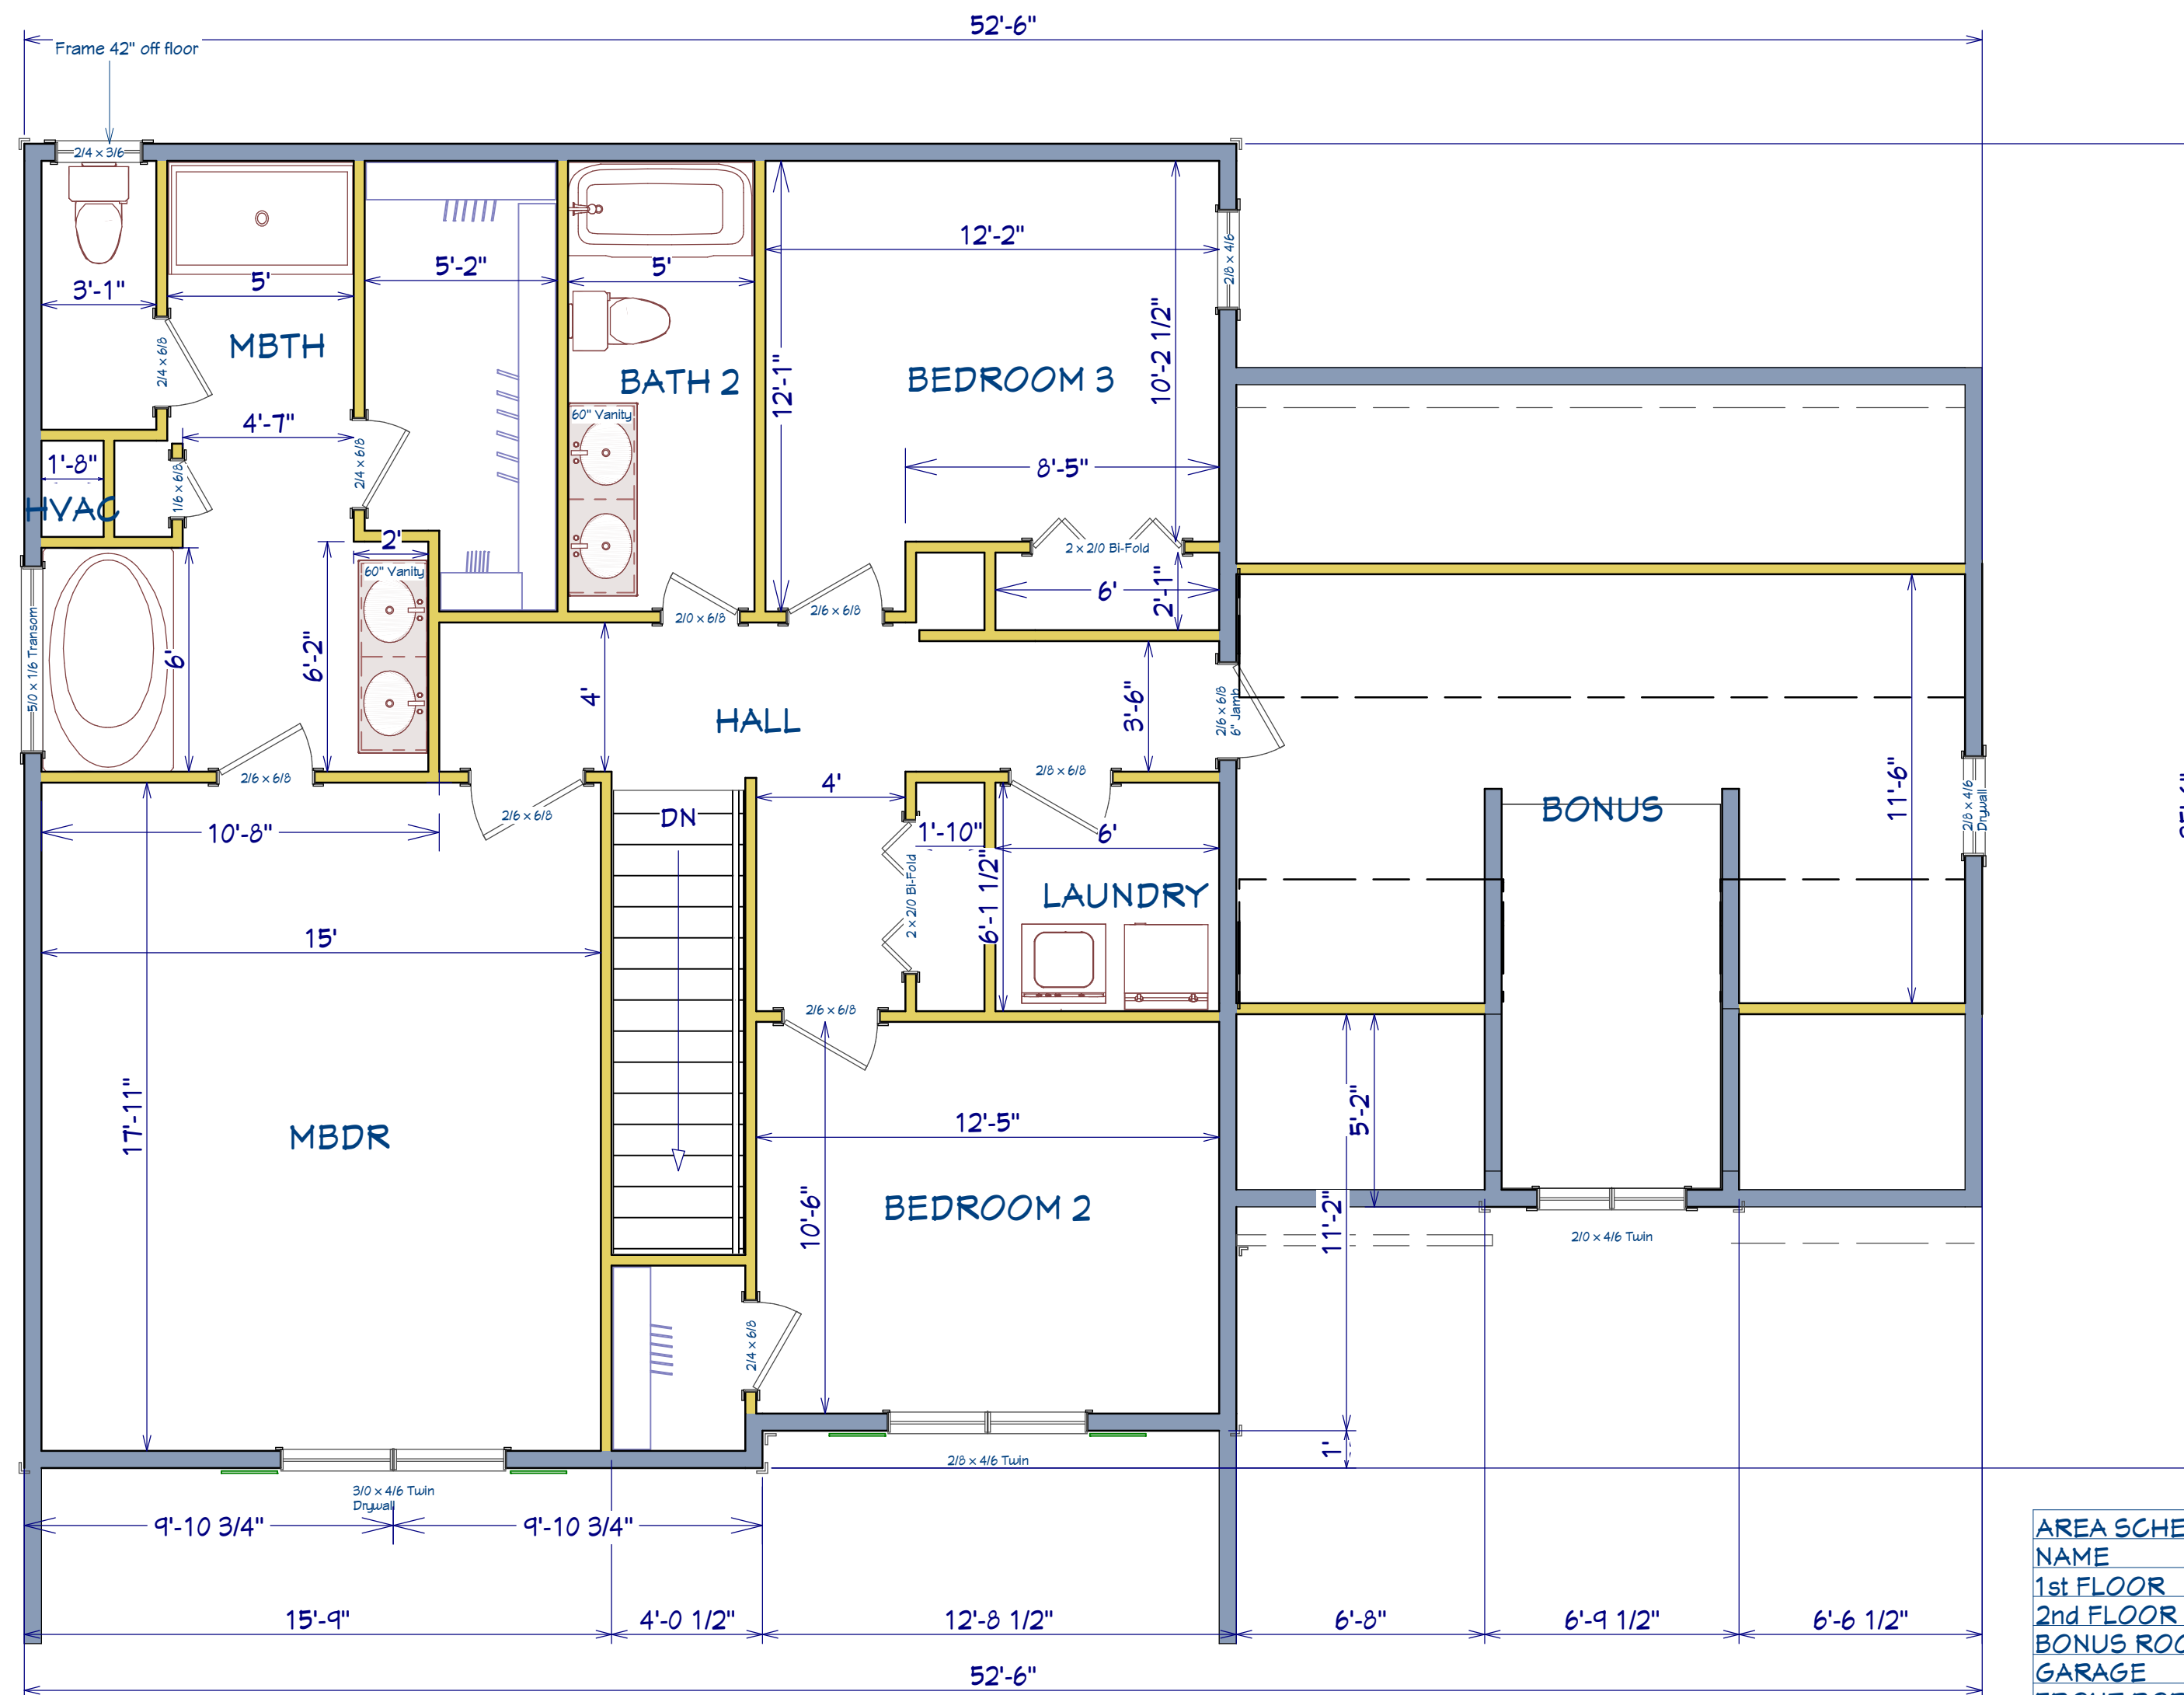

| AREA SCHEDULE | |
|------------------|----------|
| NAME | AREA |
| 1st FLOOR | 1,112 SF |
| 2nd FLOOR | 1,131 SF |
| BONUS ROOM | 279 SF |
| GARAGE | 452 SF |
| FRONT PORCH | 189 SF |
| TOTAL HEATED | 2,522 SF |
| | |
| TOTAL UNDER ROOF | 3,163 SF |

2nd Floor
Scale: 1/4" = 1'0"