

NOTICE TO CONTRACTOR
All construction must comply with current NC Building Codes and is subject to field inspection and verification.

APPROVED
Limited building only review
Permit holder responsible for full compliance with the code

11/06/2020

Signature



ELEVATION NOTES:
GRADE ELEVATIONS SHOWN DO NOT NECESSARILY REFER TO THIS OR ANY OTHER LOT. THEY ARE FOR DIAGRAMMATIC PURPOSES ONLY AND MAY VARY. BUILDER IS RESPONSIBLE FOR ADAPTING THIS PLAN TO SUIT THE EXISTING TOPOGRAPHY OF THE SITE.

ROOF VENTILATION TO BE DETERMINED BY BUILDER AS PER CODE.

ALL EGRESS OR RESCUE WINDOWS FROM SLEEPING ROOMS MUST HAVE A MIN. NET CLEAR OPENING OF 4.0 SQ FT. THE MIN NET CLEAR OPENING HEIGHT DIMENSION SHALL BE 27". THE MIN NET CLEAR OPENING WIDTH SHALL BE 20".

EACH EGRESS WINDOW FROM SLEEPING ROOMS MUST HAVE A SILL HEIGHT OF NO MORE THAN 44" FROM THE FLOOR. ALL WINDOW SIZES ARE NOMINAL AND ARE TO BE VERIFIED WITH MANUFACTURER FOR AVAILABILITY AND CONFORMITY TO STATE AND LOCAL CODE REQUIREMENTS.

PORCHES, BALCONIES, OR RAISED FLOOR SURFACES LOCATED MORE THAN 30" ABOVE THE FLOOR OR GRADE BELOW SHALL HAVE GUARDRAILS NOT LESS THAN 37" IN HEIGHT.

I. ASSUME NO RESPONSIBILITY FOR ANY DISTANCES AFTER START OF CONSTRUCTION.
CONTRACTOR/BUILDER SHALL CONSULT WITH HOME OWNER ON ALL INTERIOR AND EXTERIOR HOLDINGS, TRIMS, COLORS, FINISHES, CABINET LAYOUTS, AND MANUFACTURERS BEFORE CONSTRUCTION BEGINS.
ALL BEAMS AND FRAMING MEMBERS ARE SIZED BY OTHERS.

1.1 This plan has been drawn to comply with the 2018 NC Building Code

- 1.2 Minimum Design Loads for Building and Other Structures ASCE T-9B
- 2 Roof Dead Load 115 PSF
- 3 Roof Live Load 20 PSF
- 4 Typical Floor Dead Load 10 PSF
- 5 Floor Live Loads
 - 5.1 Rooms other than sleeping rooms 40 PSF
 - 5.2 Sleeping Rooms 30 PSF
 - 5.3 Stairs 40 PSF
 - 5.4 Decks 40 PSF
 - 5.5 Exterior Balconies 60 PSF
- 6 Wind Loads
 - 6.1 Ultimate Design Wind Speeds 15 MPH
 - 6.2 Wind Importance Factor, I_w 1.00
 - 6.3 Exposure B
 - 6.4 Walls (Component and Cladding) 25 PSF
 - 6.5 Roofs (Component and Cladding)
 - 6.5.1 Roof Slopes 2.25/12 to 7/12 34.8 PSF
 - 6.5.2 Roof Slopes 7/12 to 12/12 21 PSF

It is the sole responsibility of the Contractor and/or Builder to conform to all standards, provisions, requirements, methods of construction and uses of materials provided in buildings and/or structures as required by NC Uniform Building Code, Local Agencies and in accordance with good engineering practices. Verify all dimensions prior to construction.



FRONT ELEVATION
SCALE: 1" = 1/4"



REAR ELEVATION
SCALE: 1" = 1/4"



RIGHT ELEVATION
SCALE: 1" = 1/4"



LEFT ELEVATION
SCALE: 1" = 1/4"

GENERAL FRAMING NOTES:

ALL LUMBER IN CONTACT WITH CONCRETE OR MASONRY SHALL BE PRESSURE TREATED.

FRAMING LUMBER SHALL BE SYP #2 GRADE AND/OR SPRUCE FINE FIR #1 AND/OR #2, KILN DRIED.

WHERE PRE-ENGINEERED JOISTS ARE USED, JOIST MANUFACTURER SHALL PROVIDE SHOP DRAWINGS, WHICH BEAR SEAL OF A N.C. ENGINEER.

STUDS AND JOISTS SHALL NOT BE CUT TO INSTALL PLUMBING OR WIRING WITHOUT ADDING METAL OR WOOD SIDE PANELS TO STRENGTHEN THE MEMBER TO ITS ORIGINAL CAPACITY.

NAIL MULTIPLE MEMBERS WITH 2 ROWS OF 16d NAILS STAGGERED 32" OC AN USE 3-16d NAILS 2" IN AT EACH END. DOUBLE ALL STUDS UNDER ROOF FOOTINGS UNO.

NAIL FLOOR JOISTS TO GILL FLATE WITH 8d TOE NAILS.


ALL EXPOSED FRAMING ON PORCHES AND DECKS SHALL BE PRESSURE TREATED. PROVIDE WATERPROOFING AND DRAINS AS REQUIRED.

ALL FRAMING TO BE 16" OC UNO. WALL FRAMING DIMENSIONS ARE BASED ON 2 X 4 STUDS UNO. DOUBLE STUDS UNDER ALL HEADERS.

LVL'S AND TJI'S TO BE SIZED BY OTHERS.

EXTERIOR WALLS IN LIVING AREAS ARE 2 X 4

OPENING SCHEDULE			
SIZE	HINGE	COUNT	LIBRARY NAME
2'-8"	R	1	Exterior Door\Colonial
5'-0"	LR	1	Exterior Door\French
18'-0"	U	1	Garage
6'-0"	LR	1	Interior Door\Bifold
1'-6"	L	1	Interior Door\Colonial
1'-8"	R	1	Interior Door\Colonial
2'-0"	R	1	Interior Door\Colonial
2'-4"	L	1	Interior Door\Colonial
2'-4"	R	1	Interior Door\Colonial
2'-6"	L	1	Interior Door\Colonial
2'-6"	R	2	Interior Door\Colonial
5'-0"	LR	2	Interior Door\Colonial
5'-0"	LR	1	Interior Door\French
2'-4"	N	1	Interior Door\Pocket
3'-0"	L	1	Manufacturer\Jeld-Wen\Wood Entry\Classic\Oak
2'-8" x 5'-0"	U	1	Window\Double Hung
2'-8" x 5'-0"	U	10	Window\Double Hung
2'-8" x 5'-0" Dbl	UU	1	Window\Double Hung
2'-6" x 2'-6"	UU	1	Window\Double Hung
3'-0" x 3'-0"	UU	1	Window\Double Hung
3'-0" x 1'-0"	N	1	Window\Transom

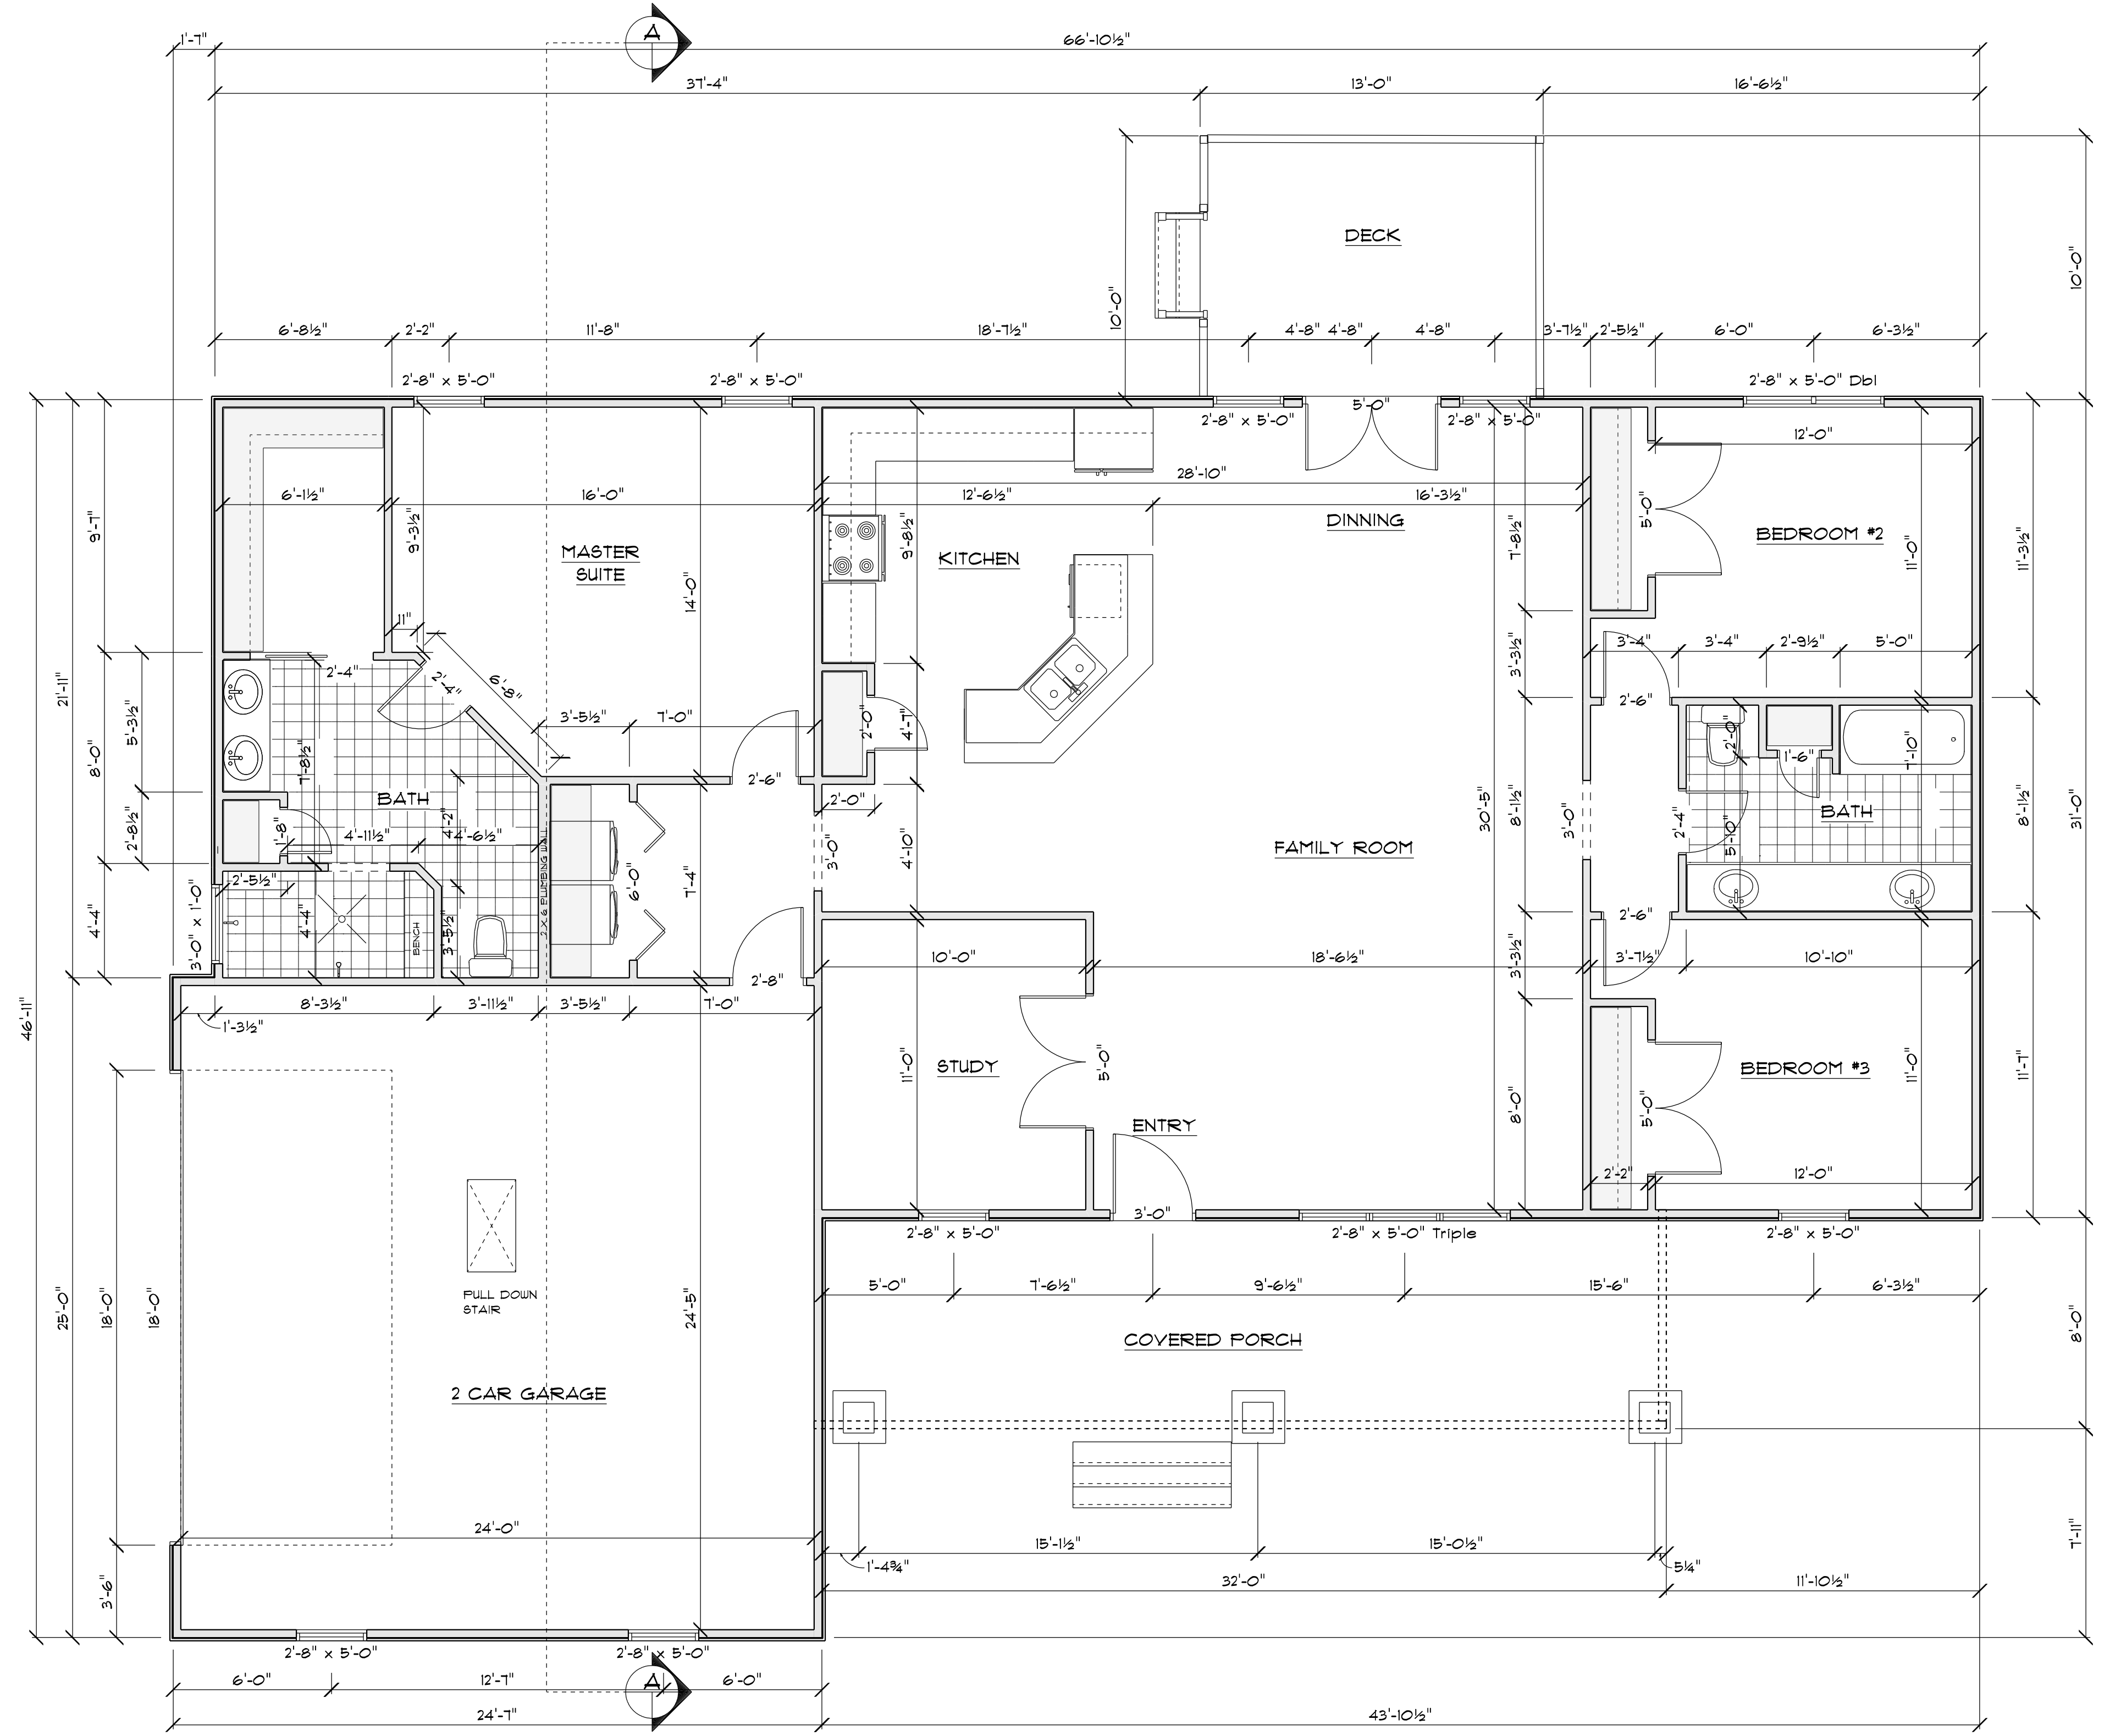

FLOOR PLAN
SCALE: 1" = 1/4"

AREA SCHEDULE	
NAME	AREA
Heated Sq Ft	1894.1 sq ft.
Garage Sq Ft	616.7 sq ft.
Covered Porch Sq Ft	251.0 sq ft.
Treated Deck Sq Ft	193.7 sq ft.


RE: P20-08023 - 475 McARTHUR RD
Site Information:
 Project Customer: Project Name:
 Lot/Block: Subdivision:
 Model:
 Address:
 City: State:
Trenco
 818 Soundside Rd
 Eden, NC 27932

General Truss Engineering Criteria & Design Loads (Individual Truss Design
Drawings Show Special Loading Conditions):
 Design Code: IRC2018/TP12014 Design Program: MITek 20/20 8.3
 Wind Code: N/A Wind Speed: 130 mph Design Method: User defined
 Roof Load: 40.0 psf Floor Load: N/A psf
 Mean Roof Height (feet): 12 Exposure Category: B


No.	Seal#	Truss Name	Date
1	E14797303	M01	8/28/20
2	E14797304	T01	8/28/20
3	E14797305	T01GE	8/28/20
4	E14797306	T01S	8/28/20
5	E14797307	T01SSE	8/28/20
6	E14797308	T02GE	8/28/20
7	E14797309	T03	8/28/20
8	E14797310	T04	8/28/20
9	E14797311	T05	8/28/20
10	E14797312	T06	8/28/20
11	E14797313	T07	8/28/20

The truss drawing(s) referenced above have been prepared by Truss Engineering Co. under my direct supervision based on the parameters provided by Longleaf Truss Company.
 Truss Design Engineer's Name: Gilbert, Eric

My license renewal date for the state of North Carolina is December 31, 2020
IMPORTANT NOTE: This seal on these truss component designs is a certification that the engineer named is licensed in the jurisdiction(s) identified and that the designs comply with ANS/ITP 1. These designs are based upon parameters shown (e.g., loads, supports, dimensions, shapes and design codes), which were given to MITek or TRENCO. Any project specific information included is for MITek's or TRENCO's customers the reference purpose only, and was not taken into account in the preparation of these designs. MITek or TRENCO has not independently verified the design and renders the designs for any particular building. Before use, the building designer shall verify the design and details of the design and incorporate these designs into the overall building design per ANS/ITP 1, Chapter 2.



Job	Truss	Truss Type	Qty	Ply	475 MCARTHUR RD	E14797306
P20-08023	TOISGE	CABLE	1	1		
Longleaf Truss Company	West End, NC - 27376				6 330 E. JILL 2020 WITK INDUSTRIES, INC. FILED AUG 28 09:25:47 2020 Page 1	
	4'-0" @ 6'-0" @ 10'-0"		15.6 @ 15.6 @		ID:W2QGVv000ehYvCPSt9TYjNGN-SvMTqLpOZMe7AA0_pmlTnEBwTjLud0mepYvWvYyMGI	
			6.00 [12]	444	22-2-8	
					5-8-8	
					22-2-8	
					6-8-8	
						Scale = 1/31.1

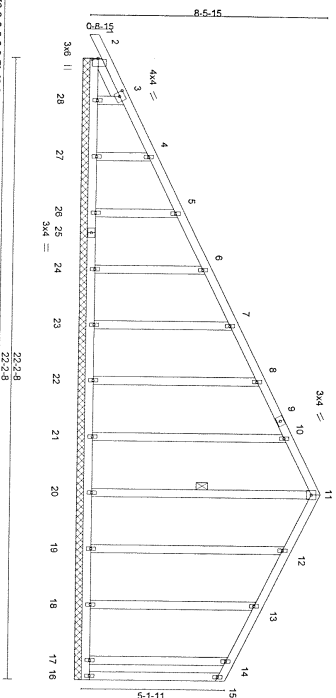

LOADING (psf)	SPACING	CSI	DEFL.	h	(in)	I/dell	L/D	PLATES
LL (roof)	2.0-0	TC	0.14	-0.00	1	120	M70	GRIP
SLL (floor)	1.15	BC	0.03	-0.00	1	120	M70	244/190
TCDL	11.6/100	Rep Stress	Insr	Horz(C/T)	-0.00	n/a	n/a	
BCDL	0.0 *	Matrix-S						Weight: 160 lb FT = 20%
LUMBER:								
TOP CHORD	2x4 SP No.1							
BOT CHORD	2x4 SP No.1							
WEBBS	2x4 SP No.3							
SLIDERS	2x4 SP No.3							
	Let 2x4 SP No. 3 x 16-13							
BRACING:								
	Sheathed or 6x6-D or purins, except end verticals							
	BOT CHORD							
	WEBBS							
	1 Row at night							


Plate Offsets (X,Y) = [0.0,2.8,0.0,1] [0.0,1.18,0.2,0]

Reactions:
 (lb) - Max Horz 2-205(L,C 11)
 Max Uplift: All uplift 100 lb or less at joints (S) 2, 16, 21, 22, 23, 24, 26, 27, 28, 19, 18, 17
 Max Grav: All reactions 250 lb or less at joints (S) 2, 16, 20, 21, 22, 23, 24, 26, 27, 28, 19, 18, 17

FORCES: (lb) - Max Comp/Mom. Ten. - All forces 250 (lb) or less except when shown.

NOTES:

- Unbalanced roof live loads have been considered for this design.
- Wind ASCE 7-16, V-W=30mph (3-second gust) V-wind=103mph; TCDL=6.0psf; BCCL=6.0psf; h=12ft; B=44ft; L=24ft; eave=2ft; Cal plate offg DOL=1.60; W/WFRS (directional), cantilever left and right exposed, end vertical left and right exposed; Lumber DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/APA 1
- TCDL ASCE 7-16, P=20.0 psf (roof LL, Lum DOL=1.15 Plate DOL=1.15); Pg=15.0 psf; Pr=11.6 psf (Lum DOL=1.15 Plate DOL=1.15); h=10; Rough Cat B; Partially Exp.; Ce=1.0; Cs=1.00; Cw=1.10
- DOL=1.15; h=10; Rough Cat B; Partially Exp.; Ce=1.0; Cs=1.00; Cw=1.10
- This truss has low loads have been considered for this design. non-concurrent with other live loads
- All plates are 1.5x4 M70 unless otherwise indicated.
- Gable requires continuous bottom chord bracing.
- Gable studs spaced at 2-0-0 oc
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Will fit between the bottom chord and the load of 20 psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide
- Provide mechanical connection (by others) to bearing plate capable of withstanding 100 lb uplift at joints (S) 2, 16, 21, 22, 23, 24, 26, 27, 28, 19, 18, 17
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/APA 1.




August 28, 2020

ERENCO
 ENGINEERS, INC.
 818 Saunders Road
 Eden, NC 27932

Job	P20-09023	Truss	Truss Type	Div	Qty	Ply	475 McARTHUR RD	E14797307
	102	West End, NC - 27316	Road Special	16	1			
Client	Longleaf Truss Company,						Lab Reference (Optional)	
							R 330 s JUL 22 2020 MATERIALS INC. FRAUG 28 09:25:51 2020 Page 1	
Drawn	0-10-8	7-10-12	16-6-0	19-9-0	24-0-0	30-10-4	W2GCV4006BIVYOPRPHBT7YNNQ40BWSUBSZNMCYUJXHVY7OZ4H4H13QMMCE	39-10-8
Checked	0-10-8	7-10-12	7-7-4	4-3-0	4-3-0	6-10-4	34-8-12	38-0-0
							4-3-4	0-10-8
							3-10-8	

Scale = 1/8" = 1'-0"

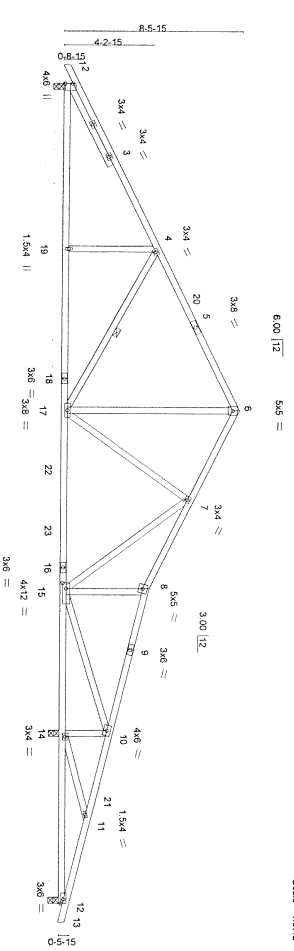

LOADING (psf)	SPACING	CSL	DEFL.	PLATES	GRIP
TCLL (roof)	2-0-0	0.79	in (top)	M170	244/190
Show (p/f/r/g)	11.6/15.0	0.67	in (top)	M170	244/190
DCL	7-0-0	0.67	in (top)	M170	244/190
BDL	7-0-0	0.67	in (top)	M170	244/190
BCDL	10-0	0.83	in (top)	M170	244/190


BRACING
 TOP CHORD Sheathed or 2x4 oc purlins
 BOT CHORD Rigid ceiling directly applied or 6x0 oc bracing
 WEBS 1 Row at midsp.
 4-17

REACTIONS (size) 2x4-3/8, 1x40-3/8, 12x0-3/8
 Max Up lift 2x21(LC 21) 2x26(LC 21)
 Max Grav 2x137(LC 24), 1x220(LC 25), 12x199(LC 39)

FORCES (lb) - Max Comp Max Ten - All forces 250 (lb) or less except when shown.
 TOP CHORD 2x4-2139/35 4x6-1437/77 6x7-1408/85 7x8-1724/81 8x10-1604/25
 BOT CHORD 2x4-90/150 2x4-172/200 2x4-151/207 2x4-141/200 1x41-56/95 1x41-28/10
 WEBS 4x19-90/314 4x17-74/202 6x17-90/308 7x17-90/302 7x15-90/303 8x15-67/390
 10x15-90/279 10x14-160/275 11x14-42/167

NOTES
 1) Unsheathed roof live loads have been considered for this design.
 2) IJC 2015 ASCE 7-16 (Sustained Snow) Yes=1 Compri, BCDL=6 Gpsf, h=12ft, B=45ft, L=39ft, S=5ft, Cal plate gfrs DOL=1.60
 3) IJC 2015 ASCE 7-16 (Sustained Snow) No=1 Compri, BCDL=6 Gpsf, h=12ft, B=45ft, L=39ft, S=5ft, Cal plate gfrs DOL=1.60
 4) Unsheathed snow loads have been considered for this design.
 5) non-concurrent with other live loads
 6) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads
 7) This truss has been designed for a live load of 20 Gpsf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10 Gpsf.
 8) Provide mechanical connection (By others) of truss to bearing plate capable of withstanding 100 lb uplift at joints 2, 12, and 21.
 9) referenced standard ANSI TPI 1.

WARNING: Read design parameters and READ NOTES ON THIS AND INCLUDED INTER-REFERENCE PAGE M17179W, 5/19/2019 BEFORE USE
 This design is for use only on the design system. It is the responsibility of the user to verify the applicability of design parameters and properly incorporate this design into the overall design. The user must ensure that the design system is properly installed and maintained. The user must ensure that the design system is properly installed and maintained. The user must ensure that the design system is properly installed and maintained.
 AIA/CES Learning Unit: 1.0
 818 Souders Blvd
 Edenton, NC 27932



Job	Truss	Truss Type	Qty	Ply	475 McARTHUR RD	E 14193969
P20-08023	T03	GABLE	1	1		
Longleaf Truss Company, West End, NC - 27376.					Job Reference (optional)	
					B 330 s Jul 22 2020 MTEK Industries, Inc. Fri Aug 28 09:25:57 2020 Page 1	
0-10-8	7:10:12	15:6:0	16:0:0	2:0:0	ID:W2GVK0068VY0P9SH9YJN8N-HZCVXMKCRHndmstfZLNzAGOPR8HIGWHMjwK08	
0-10-8	7:10:12	7:4:4	4:3:0	4:3:0	7:3:10	
					7:6:9	
					0-10:8	
						Scale = 1/8" = 1'-0"


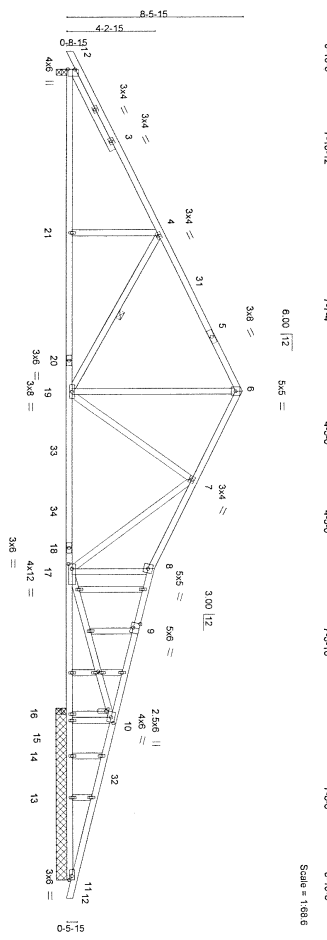


PLATE OFFSETS (X-Y)	[0:0-0:0-1:12]	[0:0-0:0-3:0-EG9]	[10:0-1:0-1:4]	[10:0-2:12-0-2-0]	[17:0-2:12-0-2-0]	[28:0-1:10-0-0-12]	[28:0-1:13-0-0-0]	[31:0-0	[31:3-10	[39:0-0		
LOADING (psf)	20.0	SPACING	2.0-0	CSI	TC	0.80	DEFL	In (0.0)	Used	Lfd	PLATES	GRP
TCLL (roof)	11.6/15.0	Plate Grip DOL	1.15	BC	0.66	1.15	Vert(L)	-0.22	17-19	240	MT20	244/190
Show (psf)	0.0	Lumber DOL	1.15	WB	0.93	180	Vert(R)	-0.40	17-19	180		
BCCL	0.0	Rep Stress Incr	YES	Matrix S		n/a	Hzr(CT)	0.05	18	n/a		
BCCL	100	Code (IRC2018)TP2014										Weight: 218 lb
												FT = 20%
LUMBER:	TOP CHORD	2x4 SP No.1		BRACING:								
	BOT CHORD	2x4 SP No.1		TOP CHORD	Sheathed or 3-4.5 or pulfins							
	WEBS	2x4 SP No.3		BOT CHORD	Rigid ceiling directly applied or 6-0-0 oc bracing							
	OTHERS	2x4 SP No.3		WEBS	1 Row at midpt							
	SLIDER	Left 2x4 SP No.3 x 4-4-11										

REACTIONS: All bearings 8-3/8 except (if length) 2-0-3/8.
 (b) - Max Horiz 2-1/4(LC 10)
 Max Uplift All uplift 100 lb or less at joint(s) 2, 14, 11 except 15-17(LC 12)
 Max Gravity All reactions 250 lb or less at joint(s) 13, 14, 11 except 2-14(LC 24), 15-17(LC 7), 16-56(LC 1)

FORCES: (b) - Max Comp/Max Ten - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-4--2199/33, 4-6--1566/77, 6-7--1473/88, 7-8--2022/80, 8-10--1820/24, 10-11--0/533
 BOT CHORD 2-21--0/1960, 18-21--0/1960, 17-19--0/1505, 16-17--459/13, 15-16--459/13
 14-15--459/13, 13-14--459/13, 11-13--459/13
 4-21--0/314, 4-19--739/69, 6-19--0/969, 7-19--443/72, 7-17--8/453, 8-17--718/89
 10-17--0/2260, 10-15--1634/67


- NOTES:**
- Unbalanced roof live loads have been considered for this design.
 - Wind ASCE 7-16, Valt=30mph (3 second gust), Valt=103mph, TCDL=6 Opst, BCDL=6 Opst, h=12ft, B=45ft, L=39ft, eave=9ft, Cat III, Exp B, Enclosed, MWFRS (directional), cantilever left and right exposed, end vertical left and right exposed, Lumber DOL=1.60 plate grip DOL=1.60
 - Gable End Details as applicable, or consult qualified building designer as per ANSIRFP 1.
 - TCLL ASCE 7-16, Pr=2.0 psf (roof L; Lum DOL=1.15 Plate DOL=1.15; Pr=1.5 psf (Lum DOL=1.15 Plate DOL=1.15); Isr=1.0; Rough Cat B; Partially Exp. Cat=1.0; Ch=1.0; Min. fill roof snow load governs.
 - Unbalanced snow loads have been considered for this design.
 - This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 11.6 psf on overhangs
 - All plates are 1/4" thick A36 steel unless otherwise indicated.
 - Gable studs spaced at 24" oc.
 - This truss has been designed for a 10' 0" psf bottom chord live load nonconcurrent with any other live loads.
 - This truss has been designed for a live load of 20 psf on the bottom chord in all areas where a rectangle 3'-6" tall by 2'-0" wide with one end parallel to the ridge and the other end perpendicular to the ridge.
 - Refer to mechanical conditions (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 14, 11 except (b) 15-17.
 - This truss is designed in accordance with the 2018 International Residential Code sections R502.1.1 and R602.10.2 and reference standard ANSIRFP 1.



WARNING - Verify design parameters and field notes on THIS AND INCLUDED SETS. REFERENCE PAGE M0271 rev. 5/19/2020 BEFORE USE.
 Design valid for use only with MTEK connections. This design is based on typical parameters shown, and is for an individual building component, not a complete system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall design. The building designer is responsible for ensuring that the design is based on the correct information and that the design is based on the correct information and that the design is based on the correct information. The building designer is responsible for ensuring that the design is based on the correct information and that the design is based on the correct information. The building designer is responsible for ensuring that the design is based on the correct information and that the design is based on the correct information.

TRENGCO
 ENGINEERING
 818 Sandstone Road
 Edison, NJ 07033

Job: P20-08023 Truss Type: Common QTY: 5 PLY: 1 Job Reference (optional): E-14197310
 West End, NC - 27316 ID: W-0474060891VCYCPHSHPTYNBN-N-483SVWKG2G2QW9H9E2Z2R0D9B4QFSLU9MC8
 8-330 s Jul 22 2020 MITK Industries, Inc. Fri Aug 28 09:25:59 2020 Page 1
 4-10-8 7-10-12 15-6-0 7-7-4 7-7-4 7-10-12
 4-10-8 7-10-12 7-10-12 7-10-12 7-10-12 7-10-12 7-10-12
 Scale = 1/4" = 1'-0"

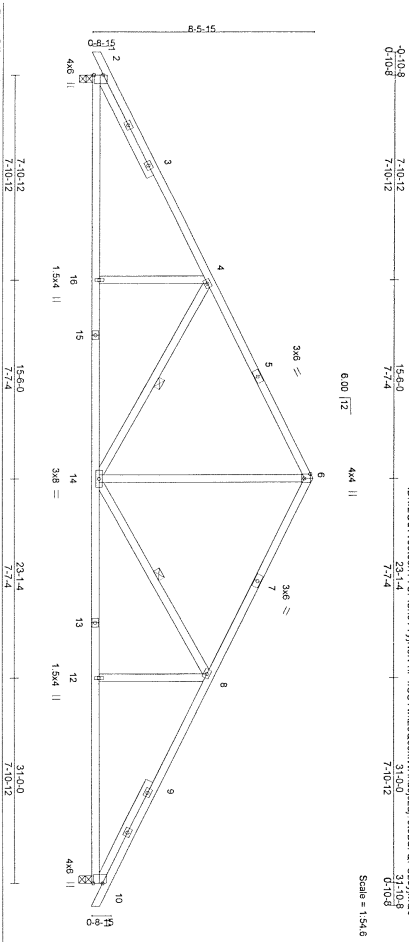

LOADING (psf)	SPACING	2-0-0	CSI	DEFL.	PLATES	GRIP
TOLL (roof)	Plate Gap DOL	1.15	TC	in (top)	L/d	M/20
Shed (ridge)	Lumber DOL	1.15	BC	Vert(L)	240	244/190
YLL	Rep Stress Inv	YES	WB	Vert(R)	180	
BCLL	Code IRC2018/1P2014		M/S	Horz(L)	n/a	
BCCL				Horz(R)	n/a	
						Weight: 159 lb FT = 20%


LUMBER:
 TOP CHORD 2x4 SP No.1
 BOT CHORD 2x4 SP No.1
 WEBS 2x4 SP No.3
 SLIDER Left 2x4 SP No.3 x 4-4-11, Right 2x4 SP No.3 x 4-4-11

BRACING:
 TOP CHORD Sheathed or 3-6-14 oc purlins.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
 WEBS 1 Row at midpt 8-14, 4-14

REACTIONS:
 Max Horiz 2=49(LC 11)
 Max Unit 2=21(LC 12), 10=21(LC 13)
 Max Grav 2=129(LC 2), 10=129(LC 3)


FORCES: (R) - Max Comp/Max Ten - All forces 550 (lb) or less except when shown.
 (L) - Max Shear - All forces 200 (lb) or less except when shown.
 (B) - Max Bolt Shear - All forces 200 (lb) or less except when shown.
 BOT CHORD 2-16=0/1738, 14-16=0/1738, 12-14=0/1738, 10-12=0/1738
 WEBS 6-14=0/765, 8-14=560/65, 8-12=0/325, 4-14=560/65, 4-16=0/325

- NOTES:**
- 1) Unbraced roof live loads have been considered for this design.
 - 2) All connections shall be made in accordance with AISC 13th Edition, Table J10.1-10, unless otherwise indicated.
 - 3) TOLL ASCE 7-16, P=20 psf (roof), L=15 Plate DOL=1.15, P=15.0 psf, P=11.8 psf (Lum DOL=1.15 Plate DOL=1.15), Is=1.0, Rough Cat B, Partially Exp., Ce=1.0, Cs=1.00, Ch=1.10
 - 4) Unbraced snow loads have been considered for this design.
 - 5) This truss has been designed for greater than roof live load of 12.0 psf or 1.00 times flat roof load of 11.8 psf on overhangs.
 - 6) All plates are 3/4" M20 unless otherwise indicated.
 - 7) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 8) This truss has been designed for a live load of 20 psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - 9) Provide mechanical connection (B) others for truss to bearing plate capable of withstanding 100 lb uplift at joints 2, 10 and 12.
 - 10) This truss is designed in accordance with the 2018 International Residential Code sections R502.1.1, and R502.10.2 and references standard ANSI/TPI 1.



WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED WITH REFERENCE PAGE NO. 2/21 Rev. 8/19/2020 BEFORE USE.
 Design values for use only with Mitre Connectors. This design is based on design parameters and is for an individual building component, not a complete system. Design values are based on the published design manual. Verify the applicability of design parameters and properly incorporate this design into the overall design. Design values are based on the published design manual. Verify the applicability of design parameters and properly incorporate this design into the overall design. A design is required for stability and to prevent collapse with possible personal injury and property damage. For general inquiries regarding the design, contact the manufacturer at 1-800-368-6666. Safety information available from Truss Plate Institute, 2011 Chain Highway, Suite 203 Waldorf, MD 20681.

TRENGCO
 818 Souders Road
 Eldersburg, MD 21783

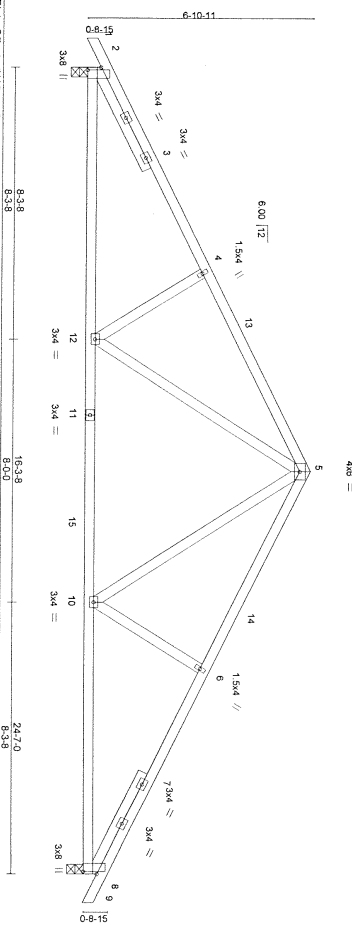


LOADING (psf)	SPACING-	SPACING-	CSI	DEFL.	In	(lip)	Wdth	L4	PLATES	GRP.
TCL (roof)	Plate Grip DOL	Lumber DOL	TC	Vert(L)	-0.13	10-12	>889	240	M70	240/190
TDI	Lumber DOL	Rsp Stress INL	BC	Vert(R)	-0.22	2-12	>899	180	M70	240/190
BCL	Code IRC2018RP2014	Matrix	WB	Horz(CT)	0.05	8	N/A	N/A	Weight: 125 lb	FT = 20%
BCLR										

LUMBER-
 TOP CHORD 2x4 SP No.1
 BOT CHORD 2x4 SP No.1
 WEBS 2x4 SP No.3
 SLIDER Lefl 2x4 SP No.3 x 3-6-0, Right 2x4 SP No.3 x 3-6-0
 REACTIONS:
 (5e9) 2-0, 3-8, 8-0-3-8
 Max Horiz 2x-2(11LC 10)
 Max Uplift 2x-2(11LC 12), 8x-2(11C 12)
 Max Grav 2x-1(148LC 24), 8x-1(148LC 25)

BRACING-
 TOP CHORD Sheathed or 4x7.0 oc purlins
 BOT CHORD Right ceiling directly applied or 10-0-0 oc bracing

FORCES: (B) - Max Comp/Max Ten - All forces 550 (lb) or less except when shown.
 TOP CHORD 2-12-0(1058), 10-12-0(1058), 8-10-0(1443), 6-9-0-1(2242)
 BOT CHORD 2-12-0(1058), 10-12-0(1058), 8-10-0(1443), 6-9-0-1(2242)
 WEBS 5-10-0(648), 6-10-0(648), 5-12-0(648), 4-12-0(648)


- NOTES:**
- Unshaded roof live loads have been considered for this design.
 - Use of Enclosed LUMBERS (check seal) (see also 1031pt) TCOL=6 Ogsf, ECOL=6 Ogsf, h=12ft, B=45ft, L=25ft, leave=ft, Cnl plate grip DOL=1.50
 - TCLL ASCE 7-16, P=20 psf (roof LL, Lum DOL=1.15 Plate DOL=1.50, P9=15.0 psf, P=11.6 psf (Lum DOL=1.15 Plate DOL=1.50), Is=1.0, Rough Cat B, Partially Exp., Ce=1.0, Cs=1.00, Ch=1.10
 - Unshaded snow loads have been considered for this design.
 - Design roof dead load greater than roof live load of 12.0 psf or 1.00 times flat roof load of 11.8 psf on overhangs non-concurrent with other live loads.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - This truss has been designed for a live load of 20 Ogsf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with ECOL = 10 Ogsf.
 - Provide mechanical connection (By others) to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 8.
 - Members are designed in accordance with the 2016 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard AS/NZS 1711.



WARNING: Many design parameters and READ NOTES ON THIS AND INCLUDED WRITE REFERENCE PAGE M-127 rev. 5/19/2016 BEFORE USE.
 Design valid for use only with MRK's conditions. This design is based only upon parameters shown, and is for an individual building component, not a building system. Before use, the user must verify the applicability of design parameters and properly incorporate this design into the overall design of the structure. The design is not intended to be used for any other purpose. A design is not intended to be used for any other purpose. A design is not intended to be used for any other purpose. A design is not intended to be used for any other purpose.
 Always required for stability and to prevent collapse with possible partial lurch and property damage. For general questions regarding the design, please contact the manufacturer at 800-438-7572. For general questions regarding the design, please contact the manufacturer at 800-438-7572. For general questions regarding the design, please contact the manufacturer at 800-438-7572.
 Safety information available from Truss Plate Institute, 3070 Crane Highway, Suite 203 Waldorf, MD 20693.

TRUSCO
 818 Southside Road
 Edison, NC 27627

Job: Truss Type: Common Qty: 8 Ply: 1 475 MCARTHUR RD E1473/12
 P20-00023 T06 West End, NC - 27376 6-330 s Jul 22 2020 MTRK industries, inc. Filing 28:09:26:03:2020 Page 1
 Longleaf Truss Company. ID: w2GNYk0h0eBvYCP39t9NYhN6K1K416Dh0hEd4dE3r7mWz2IMuLKYrL_Zz22n9Lzjmc2
 6-10-8 6-3-8 6-3-8 12-2-8 18-3-8 6-5-0 6-5-0 6-5-8 6-5-8 Scale = 1/4" = 1'-0"

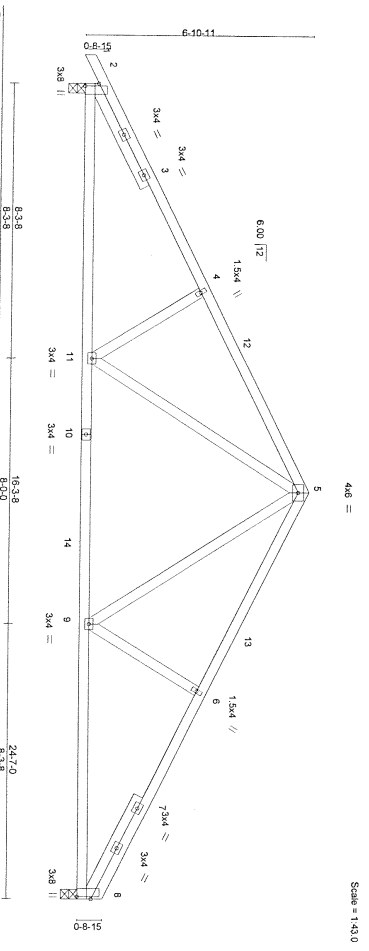


LOADING (psf)	SPACING	CSI	DEFL	in (loc)	l/d	PLATES
20.0	Plate Grip DOL	T	-0.13	9.0	240	GRIP
11.6/15.0	Lumber DOL	BC	-0.23	9.0	240	M70
0.0	Rap Stress Incr	WB	0.25	8	N/A	244/190
0.0	Code IRC2018/TP2014	Matrix S	0.05	8	N/A	
10.0						Weight: 123 lb FT = 20%

BRACING - SHEATHED OR 2x6-15 OC PURLINS
 TOP CHORD Rigid ceiling directly applied or 10x0-0 ec bracing
 BOT CHORD

REACTIONS: (See) R=0, L=2, R=0-3,8
 Max Horz 2-21/4 k (C 11)
 Max Grav 8-1/10 k (C 25), 2-1/4 k (C 24)


FORCES: (R) - Max Comp/Max Ten - All forces 250 (lb) or less except when shown.
 TOP CHORD 24 SP No. 1
 BOT CHORD 24 SP No. 3
 WEBS Left 24 SP No. 3 x 3-6-0 Right 24 SP No. 3 x 3-6-0
 Sluider Left 24 SP No. 3 x 3-6-0 Right 24 SP No. 3 x 3-6-0

- NOTES:
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) II, Exp. B Enclosed I/W/R/S (See section) Vessel=0.03mpt, TCOL=6.0psf, BCOL=6.0psf, H=12ft, B=44.5ft, L=25ft, eave=4ft, Cat Plate grip DOL=1-60
 - 3) TOLL ASCE 7-16, P=20.0 psf (roof L), Lum DOL=1.15, Plate DOL=1.15, Pp=15.0 psf, Pf=11.6 psf (Lum DOL=1.15, Plate DOL=1.15), Is=10, Rough Cat B, Partially Exp, Ce=1.0, Cs=1.00, Ch=1.10
 - 4) Unbalanced snow loads have been considered for this design.
 - 5) non-combustible roof designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 11.6 psf on overhangs
 - 6) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads
 - 7) This truss has been designed for a live load of 20 psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCOL = 10 psf.
 - 8) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2
 - 9) References are made to the 2018 International Residential Code sections R502.11.1 and R502.10.2 and references standard ANSI/TPI 1.



TRINCO ENGINEERING
 818 Saunders Road
 Eden, NC 27824

Job	Truss	Truss Type	Qty	4/9	McARTHUR RD	E-14737313
P20-08023	107	Common	1	1		
Longleaf Truss Company, West End, NC - 27376		B-330 s JUL 22 2020 NTRK Industries, Inc. FRI Aug 28 09:26:04 2020 Page 1		ID: w2GvYv0d0d9HYCPf5hT1YjNBn-8DUVFRzZzkmPjHtLc7G6gymRNHh6D0yM01		
0-10-8	6-3-8	13-9-8	18-3-8	6-5-0	6-3-8	24-7-0
0-10-8	6-3-8	6-5-0	6-5-0	6-5-0	6-3-8	24-7-0
Scale = 1/4"=0'						

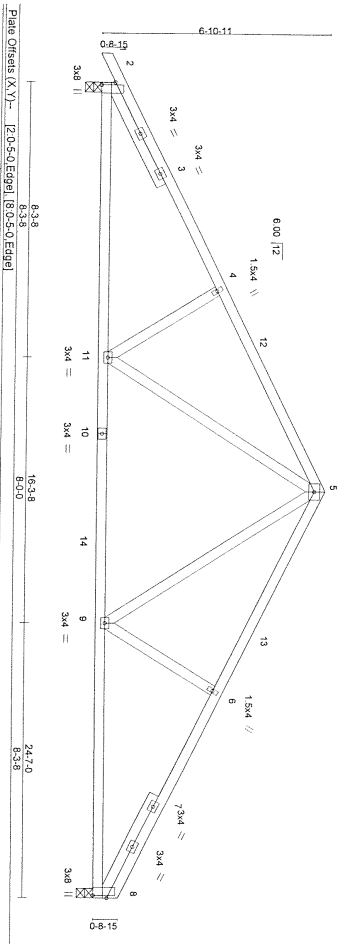


LOADING (psf)	SPACING	CS1	DERL	PLATES
TCL (roof)	2.00	0.46	in (oc)	GRIP
TCL (wall)	1.15	0.60	5'-10	M70
Top (P/F)	1.15	0.60	5'-9	244/190
Wind	0.0	0.26	0.05	
BCL	0.0		0.05	
BCCL	10.0		0.05	
Code: IRC2018/FP2014				
Matrix-S				
Weight: 123 lb FT = 20%				

BRACING:
 TOP CHORD Sheathed or 4x6-15 oc purlins.
 BOT CHORD Rigid ceiling directly applied or 10x0-0 oc bracing.

REACTIONS:
 (see) 8-0, 3-8, 2-0, 3-8
 Max Horiz 2=114(LC 11)
 Max Unit 3=22(LC 12)
 Max Grav 9=110(LC 25), 2=114(LC 24)

FORCES: (R) - Max Comp/Max Ten - All forces 250 (lb) or less except when shown.
 (L) - End B, Endosed, MYFRS (directional), camber left and right exposed, and vertical left and right exposed. Lumber DOL=1.60
 TOP CHORD 2-11=0/150, 9-11=0/1058
 BOT CHORD 2-11=0/150, 9-11=0/1058
 WEBS 5-9=0/852, 6-8=304/109, 5-11=0/648, 4-11=302/107

- NOTES:**
- Unbraced roof live loads have been considered for this design.
 - End B, Endosed, MYFRS (directional), camber left and right exposed, and vertical left and right exposed. Lumber DOL=1.60
 - TCL, ASCE 7-16, P=20.0 psf (roof LL, Lum DOL=1.15, Plate DOL=1.15), Pg=15.0 psf, Pr=11.6 psf (Lum DOL=1.15, Plate DOL=1.15), Cs=1.0, Cc=1.00, Ch=1.10
 - Unbraced snow loads have been considered for this design.
 - Non-concave roof slopes have been considered for this design.
 - This truss has been designed for a 10.0 psf bottom chord live load concurrent with any other live loads.
 - This truss has been designed for a live load of 20 psf on the bottom chord in all areas where a ceiling is 3'-6" tall by 2'-0" wide will fit between the bottom chord and any other members, with BCL = 10 psf.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2.
 - This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and references standard ANSI/TPI 1.



WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDES WITH REFERENCE PAGE No. 272 rev. 5/19/2020 BEFORE USE.
 Design valid for use only with NTRK connections. This design is based on information provided by the client and is not intended to be used for any other purpose. The designer is not responsible for any errors or omissions in the design or for any consequences arising from the use of the design. The client is responsible for providing accurate information and for obtaining all necessary permits and approvals. The designer is not responsible for any damage to property or persons resulting from the use of the design. For general building and professional liability information, see ANSI/TPI Quality Criteria, QCS&S and BCS Building Component Safety Information available from Truss Plate Institute, 2501 West 11th Street, Suite 201, Winston-Salem, NC 27159.


TRENCO
 818 Saunders Road
 Eden, NC 27632

General Safety Notes

Failure to Follow Could Cause Property Damage or Personal Injury

1. Additional stability bracing for truss system, e.g. diagonal or X-bracing, is always required. See BCSI.
2. Truss bracing must be designed by an engineer. For wide truss spacing, individual lateral bracing themselves may require bracing, or alternative Tor 1.
3. Never exceed the design loading shown and never stack materials on inadequately braced trusses.
4. Provide copies of this truss design to the building designer, erection supervisor, property owner and all other interested parties.
5. Cut members to bear tightly against each other.
6. Place plates on each face of truss at each joint and embed fully. Knots and wane at joint locations are regulated by ANSI/TPI 1.
7. Design assumes trusses will be suitably protected from the environment in accord with ANSI/TPI 1.
8. Unless otherwise noted, moisture content of lumber shall not exceed 19% at time of fabrication.
9. Unless expressly noted, this design is not applicable for use with fire retardant, preservative treated, or green lumber.
10. Camber is a non-structural consideration and is the responsibility of truss fabrication. General practice is to camber for dead load deflection.
11. Plate type, size, orientation and location dimensions indicated are minimum plating requirements.
12. Lumber used shall be of the species and size, and in all respects, equal to or better than that specified.
13. Top chords must be sheathed or purlins provided at spacing indicated on design.
14. Bottom chords require lateral bracing at 10 ft spacing or less, if no ceiling is installed, unless otherwise noted.
15. Connections not shown are the responsibility of others.
16. Do not cut or alter truss member or plate without prior approval of an engineer.
17. Install and load vertically unless indicated otherwise.
18. Use of green or treated lumber may pose unacceptable environmental, health or performance risks. Consult with perfect engineer before use.
19. Review all portions of this design (front, back, words and pictures) before use. Re-viewing pictures alone is not sufficient.
20. Design assumes manufacture in accordance with ANSI/TPI 1 Quality Criteria.
21. The design does not take into account any dynamic or other loads other than those expressly stated.

Numbering System

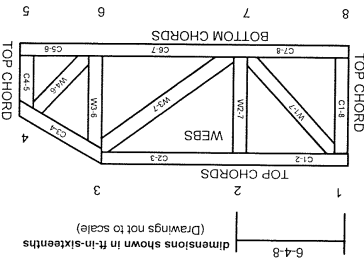

JOINTS ARE GENERALLY NUMBERED/LETTERED CLOCKWISE AROUND THE TRUSS STARTING AT THE JOINT FARTHEST TO THE LEFT.

CHORDS AND WEBS ARE IDENTIFIED BY END JOINT NUMBERS/LETTERS.

PRODUCT CODE APPROVALS

ICC-ES Reports:
 ESR-1311, ESR-1352, ESR1988
 ESR-3907, ESR-2362, ESR-1397, ESR-3282

Trusses are designed for wind loads in the plane of the truss unless otherwise shown.
 Lumber design values are in accordance with ANSI/TPI 1 section 6.3. These truss designs rely on lumber values established by others.




MITek Engineering Reference Sheet, Mill-7473 rev. 5/19/2020

Symbols

PLATE LOCATION AND ORIENTATION

Center plate on joint unless x, y offsets are indicated.
 Dimensions are in 1/16-in-sixteenths.
 Apply plates to both sides of truss and fully embed teeth.



This symbol indicates the required direction of slots in connector plates.



* Plate location details available in MITek 20/20 software or upon request.

PLATE SIZE


4 X 4

The first dimension is the plate width measured perpendicular to slots. Second dimension is the length parallel to slots.



Indicated by symbol shown and/or by text in the bracing section of the reaction section indicates joint (supports) occur. Icons vary but (supports) occur. Icons vary but


BEARING



Indicates location where bearings number where bearings occur (supports) occur. Icons vary but (supports) occur. Icons vary but

Industry Standards:
 ANSI/TPI: National Design Specification for Metal Plate Connected Wood Truss Construction.
 DSB-89: Design Standard for Bracing.
 BCSI: Building Component Safety Information, Guide to Good Practices for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses.

Floor Area: 0 SF
 Roof Plywood: 0
 Roof Area: 3279.86 SF
 Roof Sheeting: 47 Squares

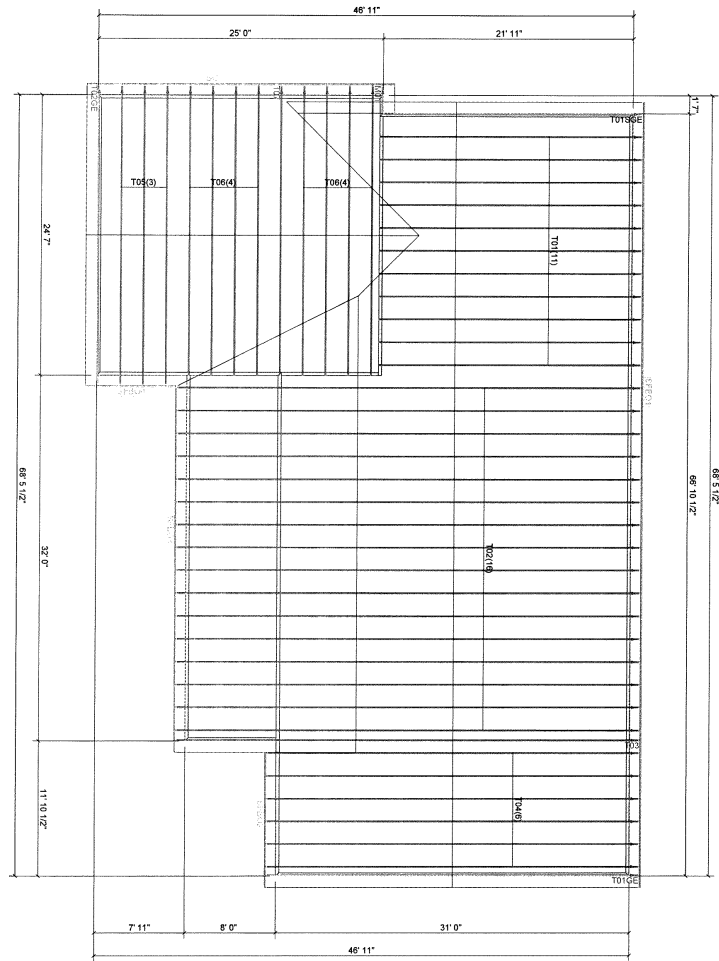

ROOF TRUSS LAYOUT
 148 - 11-18

Client: **SERVICE BUILDING SUPPLY SANF**
 Project: **475 McARTHUR RD**
 Model: **HARRINGTON PROP**
 Lot #: _____
 Subdivision: _____
 Order #: _____ Designer: _____ Date: _____
P20-08023 / /

ONGLEAF RUSS CO.
 4476 Hwy. 21 W
 West End, NC 27376
 (910) 673-4711

NOTE
 IT IS THE RESPONSIBILITY OF THE BUILDING DESIGNER OR ARCHITECT TO PROVIDE AN APPROPRIATE CONNECTION FOR TRUSSES TO SUPPORTING STRUCTURE PERREACTIONS SHOWN ON TRUSS ENGINEERING. SPECIAL CONSIDERATIONS FOR MECHANICAL EQUIPMENT AND/OR PLUMBING (AND THEIR CONNECTIONS) IN TRUSS SPACE MUST BE DIAGRAMMED BY BUILDER ON APPROVED TRUSS LAYOUT PRIOR TO FABRICATION.
 THIS COMPANY IS A TRUSS MANUFACTURER WHOSE RESPONSIBILITIES ARE LIMITED TO THOSE DESCRIBED IN WTC1-1995 "DESIGN RESPONSIBILITIES". ACCORDINGLY, IT DISCLAIMS ANY RESPONSIBILITIES AND/OR LIABILITY FOR THE CONSTRUCTION, DESIGN, DRAWINGS, DOCUMENTS INCLUDING THE INSTALLATION AND BRACING OF TRUSSES MANUFACTURED BY THIS COMPANY. SEE <http://support.sbcindustry.com/pubs/TTBDRsp-D>