

# Harnett County Department of Public Health

PERMIT # SFD2008-0073

## Operation Permit

821415

New Installation    Septic Tank    Nitrification Line    Repair    Expansion

PROPERTY LOCATION: 418 VILLAGE BEND DR. (LAUREL CH. RD)

Name: (owner) DAN RYAN GLDS      SUBDIVISION OLDE MILL VILLAGE      LOT # 17

System Installer: C&M PLUMBING

Basement with plumbing:  Garage  Number of Bedrooms 4


Type of Water Supply:  Community  Public    Well   Distance from well NA feet

System Type: 25% REDUCTION SIS. IIIg      Types V and VI Systems expire in 5 years.

(In accordance with Table V a)

Owner must contact Health Department 6 months prior to expiration for permit renewal.

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

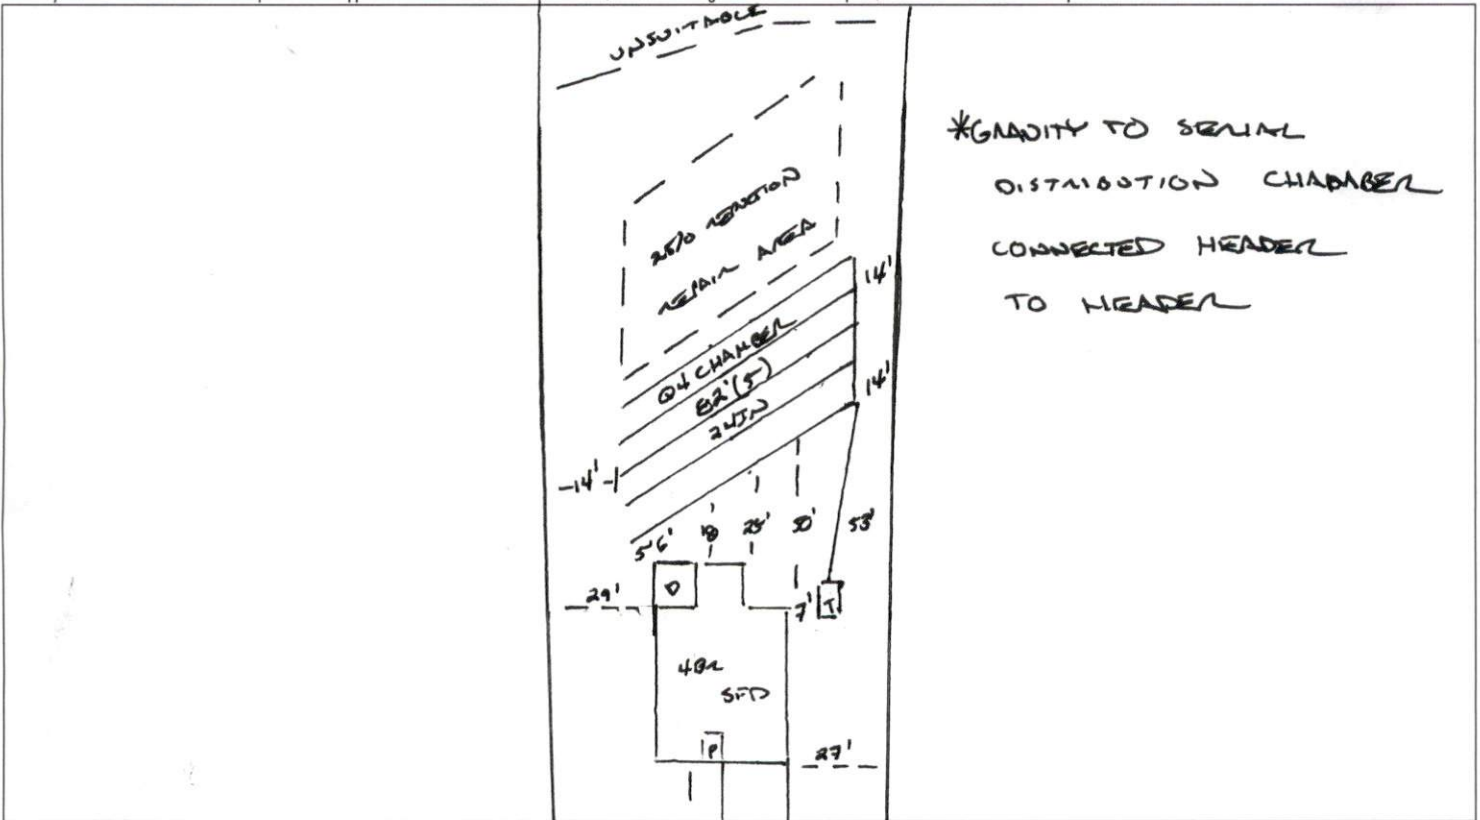

**PERMIT CONDITIONS:**

- I. Performance: System shall perform in accordance with Rule .1961.
- II. Monitoring: As required by Rule .1961.
- III. Maintenance: As required by Rule .1961. Other: VILLAGE BEND DRIVE  
Subsurface system operator required? Yes  No   
If yes, see attached sheet for additional operation conditions, maintenance and reporting.
- IV. Operation: \_\_\_\_\_
- V. Other: \_\_\_\_\_

D-Box    Pump    Alarm    H2O Line    PWR Line

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system:  Conventional    Other 04 CHAMBER IIIg      Septic Tank: 1020 gallons      Pump Tank: \_\_\_\_\_ gallons  
Subsurface      No. of      exact length      width of      depth of  
Drainage Field      ditches 5      of each ditch 82 feet      ditches 3 feet      ditches 24 inches  
French Drain Required: \_\_\_\_\_ Linear feet

Authorized State Agent [Signature]      Date 10/12/2021