

# Harnett County Department of Public Health

PERMIT # SPD2008-0074

## Operation Permit

SL 1415

New Installation    Septic Tank    Nitrification Line    Repair    Expansion

PROPERTY LOCATION: 436 VILLAGE BEND DR. (LANDS CH. D)

Name: (owner) DAN LYN BLDS      SUBDIVISION OLDE MILL VILLAGE      LOT # 18

System Installer: C + M PLUMBING


Basement with plumbing:  Garage  Number of Bedrooms 4

Type of Water Supply:  Community    Public    Well   Distance from well N/A feet

System Type: 250 REDUCTION SYSTEM III      Types V and VI Systems expire in 5 years.

(In accordance with Table V a)      Owner must contact Health Department 6 months prior to expiration for permit renewal.

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

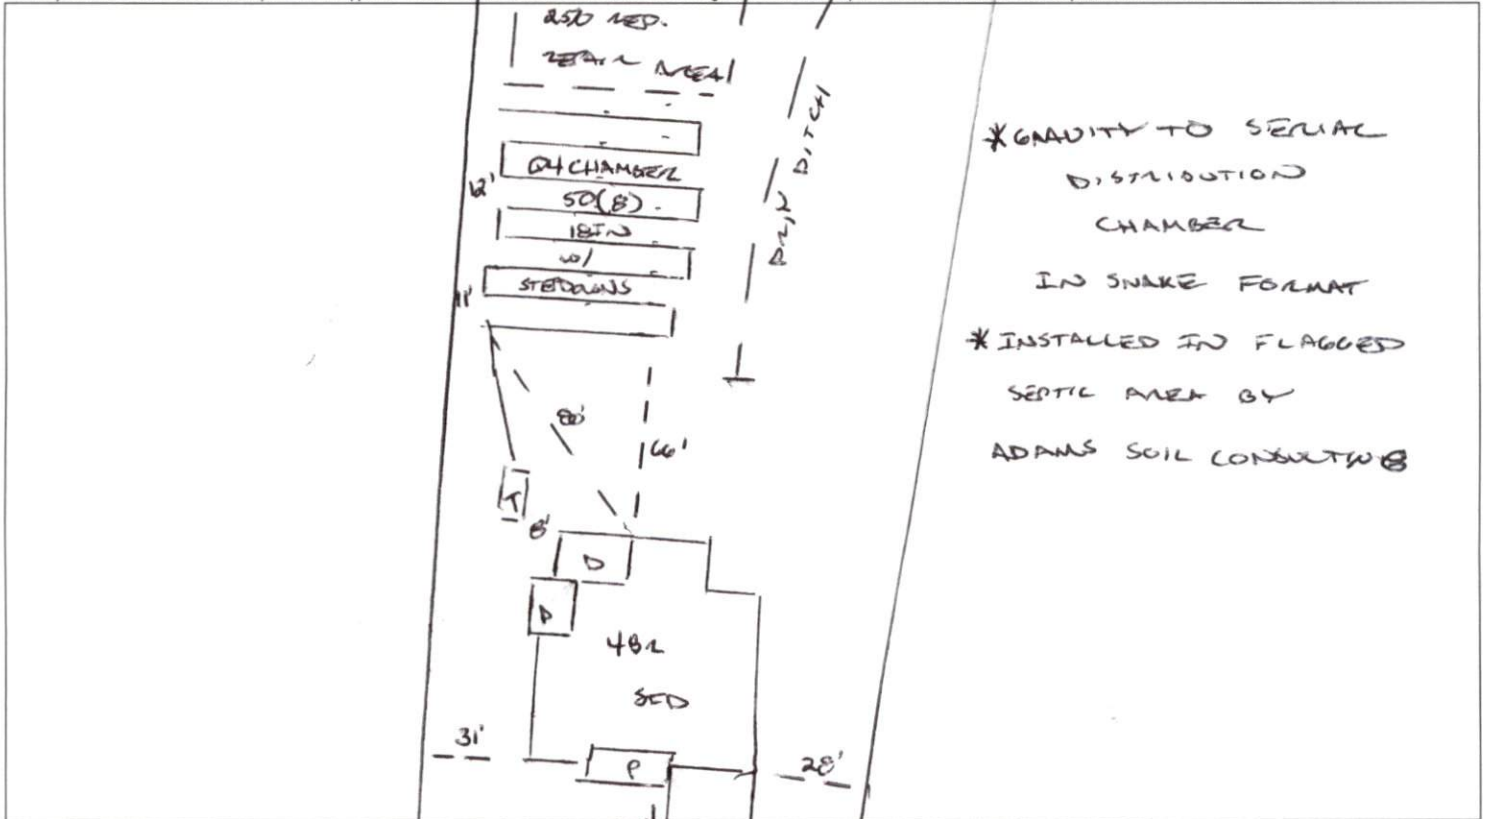

\*GRAVITY TO SERIAL DISTRIBUTION CHAMBER IN SNAKE FORMAT  
\*INSTALLED IN FLAGGED SEPTIC AREA BY ADAMS SOIL CONSULTING

**PERMIT CONDITIONS:**

I. Performance: System shall perform in accordance with Rule .1961.

II. Monitoring: As required by Rule .1961.

III. Maintenance: As required by Rule .1961. Other: VILLAGE BEND DR.

Subsurface system operator required? Yes  No   
If yes, see attached sheet for additional operation conditions, maintenance and reporting.

IV. Operation: \_\_\_\_\_

V. Other: \_\_\_\_\_

D-Box    Pump    Alarm    H2O Line    PWR Line

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system:  Conventional    Other 4 CHAMBER III      Septic Tank: 1000 gallons      Pump Tank: \_\_\_\_\_ gallons

Subsurface      No. of      exact length      width of      depth of  
Drainage Field      ditches 1      of each ditch 400 feet      ditches 3 feet      ditches 18 inches

French Drain Required: \_\_\_\_\_ Linear feet

Authorized State Agent [Signature]      Date 09/21/2021