

Harnett County Department of Public Health

PERMIT # SFD 2008-0076

Operation Permit

521415)

New Installation
 Septic Tank
 Nitrification Line
 Repair
 Expansion
 PROPERTY LOCATION: 488 VILLAGE BEND DR. (RHWLS CH. 20)

Name: (owner) DAN RYAN BUDS SUBDIVISION OLDE MILL VILLAGE LOT # 21

System Installer: C & M PLUMBING


Basement with plumbing: Garage Number of Bedrooms 4

Type of Water Supply: Community Public Well Distance from well N/A feet

System Type: 25% REDUCTION SYS. IIIg Types V and VI Systems expire in 5 years.

(In accordance with Table V a) Owner must contact Health Department 6 months prior to expiration for permit renewal.

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

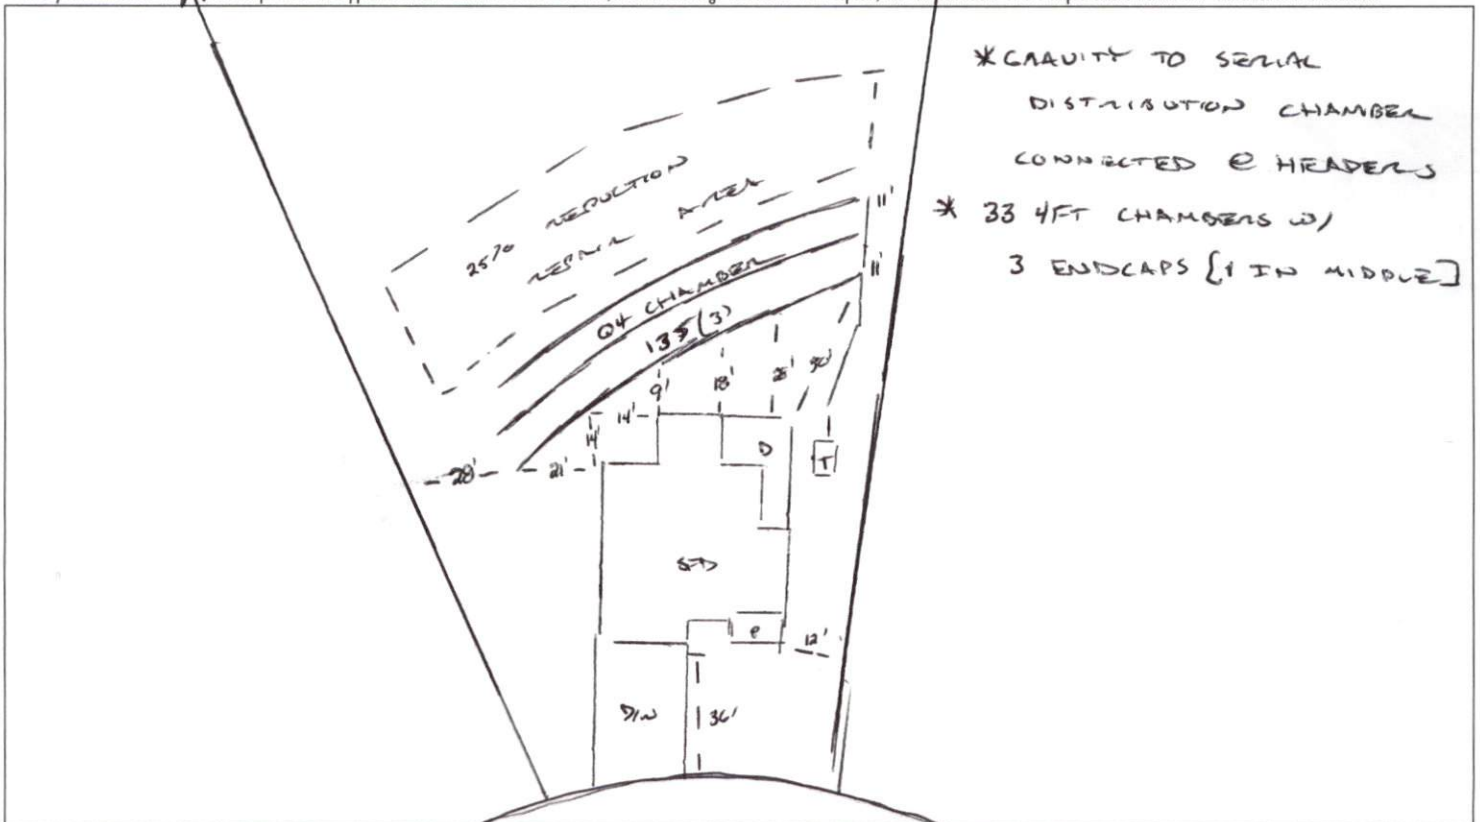

PERMIT CONDITIONS:

- I. Performance: System shall perform in accordance with Rule .1961.
- II. Monitoring: As required by Rule .1961.
- III. Maintenance: As required by Rule .1961. Other: _____
 Subsurface system operator required? Yes No
 If yes, see attached sheet for additional operation conditions, maintenance and reporting.

IV. Operation: _____
 V. Other: _____

_____ D-Box _____ Pump _____ Alarm _____ H2O Line _____ PWR Line

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system: Conventional Other 04 CHAMBER IIIg Septic Tank: ~~1000~~ ¹⁰²⁰ gallons Pump Tank: _____ gallons
 Subsurface No. of exact length width of depth of
 Drainage Field ditches 3 of each ditch 135 feet ditches 3 feet ditches 24 inches
 French Drain Required: _____ Linear feet

Authorized State Agent [Signature] Date 04/21/2021