Harnett County Department of Public Health


Improvement Permit

A building permit cannot be issued with only an Improvement Permit

PROPERTY LOCAT ISSUED TO: Dan Ryan Builders - North Carolina, L SUBDIVISION O	lon: 433 Village Bend Dr. (Rawls Ch. Rd SR
NEW REPAIR EXPANSION	Site Improvements required prior to Construction Authorization Issuance:
Type of Structure: 40x60 sfd, 4 beds 3 baths	
Proposed Wastewater System Type: 25% Reduction System	
Projected Daily Flow: 480 GPD	
Number of bedrooms: 4 Number of Occupants: 8 max Basement Tes No	
Pump Required: Yes No May be required based on final location and elevated.	ions of facilities
Type of Water Supply: Community Public Well Distance from well NA	
Permit conditions:	No expiration
Authorized State Agents:	09/24/2020 SEE ATTACHED SITE SKETCH
Authorized State Agent: The issuance of this permit by the Health Department in no way guarantees the issuance of other permits. The permit is subject to revocation of the site plan, plat, or the intended use changes. The Improvement Permit shall not be all the Laws and Rules for Sewage Treatment and Disposal and to conditions of this permit.	holder is responsible for checking with appropriate governing bodies in meeting their requirements. This
Construction Aut	horization
Required for Buildin. The construction and installation requirements of Rules .1950, .1952, .1954, .1955, .1956, .1957, .1958, and .1959 are	
with the attached system layout.	,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,
	LOCATION: 433 Village Bend Dr. (Rawls Ch. Rd S
Facility Type: 40x60 sfd, 4 beds 3 baths New Expansion	on Repair
Basement? Yes No Basement Fixtures? Yes No	
Type of Wastewater System** 25% Reduction System	(Initial) Wastewater Flow: 480 GPD
(See note below, if applicable)	
	.(Repair)
Installation Requirements/Conditions Number of trenches 4	0
Septic Tank Size 1000 gallons Exact length of each trench 10	
Pump Tank Sizegallons Trenches shall be installed on col Maximum Trench Depth of: 24	ntour at a Soil Cover: 12 inchesinches (Maximum soil cover shall not exceed
(Trench bottoms shall be level to	1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1
in all directions)	30 above the trench bottom)
Pump Requirements:ft. TDH vsGPM	NA inches below pipe
	Aggregate Depth: NA inches above pipe
Conditions: Gravity to D-Box Equal Dist.; Proposal by Adam	ns Soil Consulting NA inches total
WATER LINES (INCLUDING IRRIGATION) MUST BE 10FT. FROM ANY PART OF SE	PTIC SYSTEM OR REPAIR AREA.
NO UTILITIES ALLOWED IN INITIAL OR REPAIR DRAIN FIELD AREA.	
**If applicable: I understand the system type specified is different from the type specified	on the application. I accept the specifications of this permit.
Owner/Legal Representative Signature:	Date:
This Construction Authorization is subject to revocation if the site plan, plat, or the intended use changes. The Constructi	
Construction Authorization is subject to compliance with the provisions of the Laws and Rules for Sewage Treatment and	Disposal and to the conditions of this permit. SEE ATTACHED SITE SKETCH
Authorized State Agent:	Date: 09/24/2020 ration Expiration Date: 09/24/2025
ANONTEW COMIN Construction Authorize	ation Expiration Date: 09/24/2025


Harnett County Department of Public Health Site Sketch

Property Location: 433 Village Bend Dr (Rawls Ch	n. Rd SR 1415)		
Issued To: Dan Ryan Builders - North Carolina, LLC	Subdivision Olde Mill Village		Lot # 27
	ANDREW CURIN	_ Date:	09/24/2020

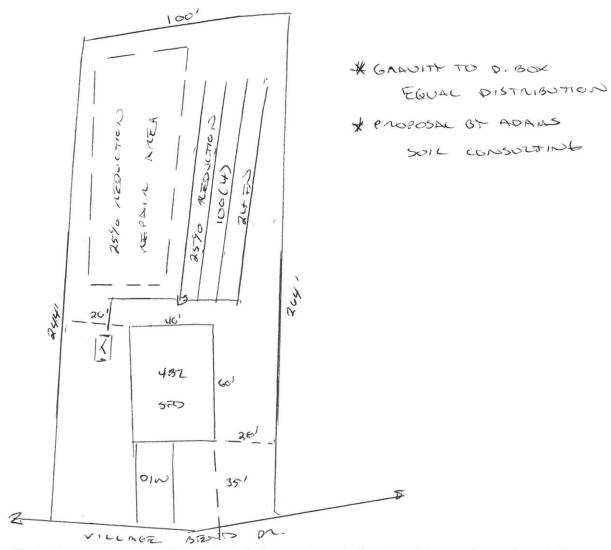

This drawing is for illustrative purposes only. System installation must meet all pertinent laws, rules, and regulations.

Olde Mill Village 4-Bedroom Septic Proposal Lot #27

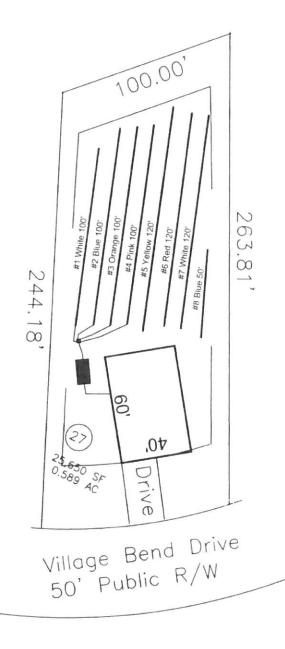

If plumbing is not sufficient a pump and tank may be required to septic drain field.

> *Preliminary Design Not a Permit

Lines: 1-4 (400')
0.3 LTAR
24" Trench Bottom
Accepted Status System
Repair: Pressure Manifold
Lines: 5-8 (400')
0.3 LTAR
24" Trench Bottom
Accepted Status System

System: Pressure Manifold

GRAPHIC SCALE 1" = 50' Adams Soil Consulting 919—414—6761 Job #699