

Trenco  
818 Soundside Rd  
Edenton, NC 27932

Re: 2000682-2000682A  
Freedom PLantation

The truss drawing(s) referenced below have been prepared by Truss Engineering Co. under my direct supervision based on the parameters provided by 84 Components - #2383.

Pages or sheets covered by this seal: I42651912 thru I42651923

My license renewal date for the state of North Carolina is December 31, 2020.

North Carolina COA: C-0844



September 1, 2020

Sevier, Scott

**IMPORTANT NOTE:** The seal on these truss component designs is a certification that the engineer named is licensed in the jurisdiction(s) identified and that the designs comply with ANSI/TPI 1. These designs are based upon parameters shown (e.g., loads, supports, dimensions, shapes and design codes), which were given to MiTek or TRENCO. Any project specific information included is for MiTek's or TRENCO's customers file reference purpose only, and was not taken into account in the preparation of these designs. MiTek or TRENCO has not independently verified the applicability of the design parameters or the designs for any particular building. Before use, the building designer should verify applicability of design parameters and properly incorporate these designs into the overall building design per ANSI/TPI 1, Chapter 2.

Job 2000682-2000682A	Truss A	Truss Type Common	Qty 14	Ply 1	Freedom PLantation	I42651912
-------------------------	------------	----------------------	-----------	----------	--------------------	-----------

84 Components (Dunn),

Dunn, NC - 28334,


8.420 s Aug 25 2020 MiTek Industries, Inc. Tue Sep 1 09:09:52 2020 Page 1

ID:OOOeZ79\_4PNG5Ls7M1kNBMyJy2-rLUf3ur4BvsbPOTx\_M4QUs0NYNdYTrIYM06Qsryi2HD



4x6 ||

Scale = 1:59.1

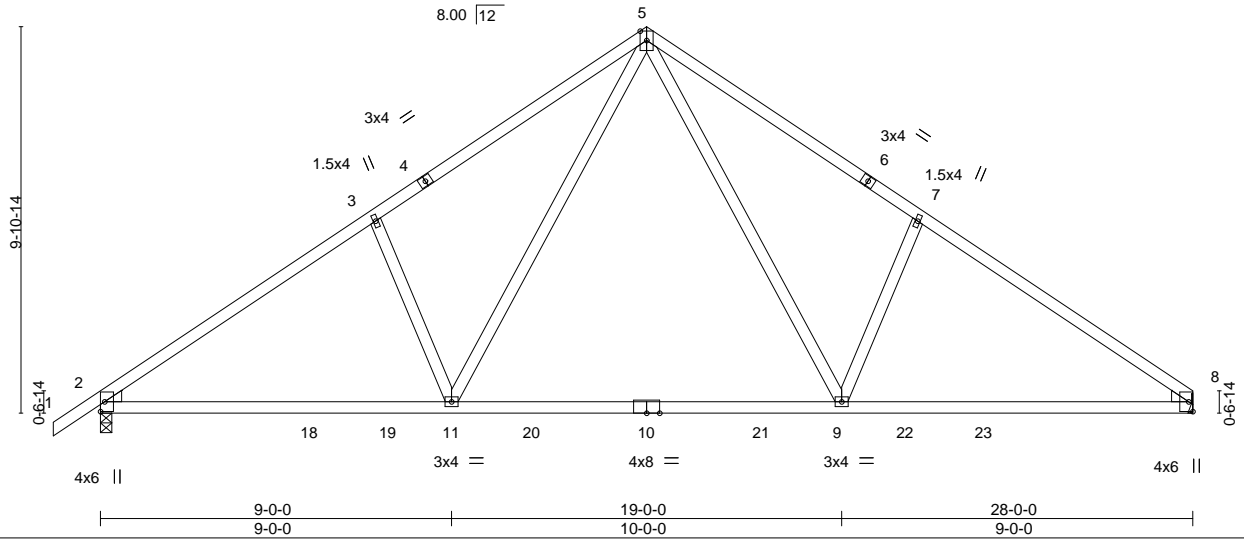

<b>LOADING</b> (psf)	<b>SPACING-</b>	2-0-0	<b>CSI.</b>	<b>DEFL.</b>	in (loc)	l/defl	L/d	<b>PLATES</b>	<b>GRIP</b>
TCLL 20.0	Plate Grip DOL	1.15	TC 0.65	Vert(LL)	-0.41 9-11	>815	240	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.99	Vert(CT)	-0.61 9-11	>552	180		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.40	Horz(CT)	0.04 8	n/a	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-MS					Weight: 142 lb	FT = 20%

**LUMBER-**

TOP CHORD 2x4 SP No.2 or 2x4 SPF No.2  
 BOT CHORD 2x4 SP No.2 or 2x4 SPF No.2  
 WEBS 2x4 SP No.3  
 WEDGE  
 Left: 2x4 SP No.3 , Right: 2x4 SP No.3

**BRACING-**

TOP CHORD Structural wood sheathing directly applied or 3-9-8 oc purlins.  
 BOT CHORD Rigid ceiling directly applied or 2-2-0 oc bracing.

**REACTIONS.**

(size) 2=0-3-8, 8=Mechanical  
 Max Horz 2=244(LC 9)  
 Max Uplift 2=-145(LC 12), 8=-119(LC 13)  
 Max Grav 2=1249(LC 19), 8=1179(LC 20)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-1682/291, 3-5=-1585/388, 5-7=-1591/390, 7-8=-1688/292  
 BOT CHORD 2-11=-205/1482, 9-11=-17/948, 8-9=-141/1319  
 WEBS 5-9=-178/827, 7-9=-414/286, 5-11=-174/818, 3-11=-410/284

**NOTES-**

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=30ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 8=119.
- One H2.5A Simpson Strong-Tie connectors recommended to connect truss to bearing walls due to UPLIFT at jt(s) 2. This connection is for uplift only and does not consider lateral forces.



September 1,2020

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TP1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




818 Soundside Road  
 Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	Freedom PLantation	142651913
2000682-2000682A	A1	ROOF TRUSS	2	1		
Job Reference (optional)						

84 Components (Dunn), Dunn, NC - 28334,

8.420 s Aug 25 2020 MiTek Industries, Inc. Tue Sep 1 09:09:54 2020 Page 1  
 ID:OOOeZ79\_4PNG5Ls7M1kNBMyiJy2-nkbPUatKjX6Jei0J5n7uZH5jzBLCxIgrqKbXxkyi2HB

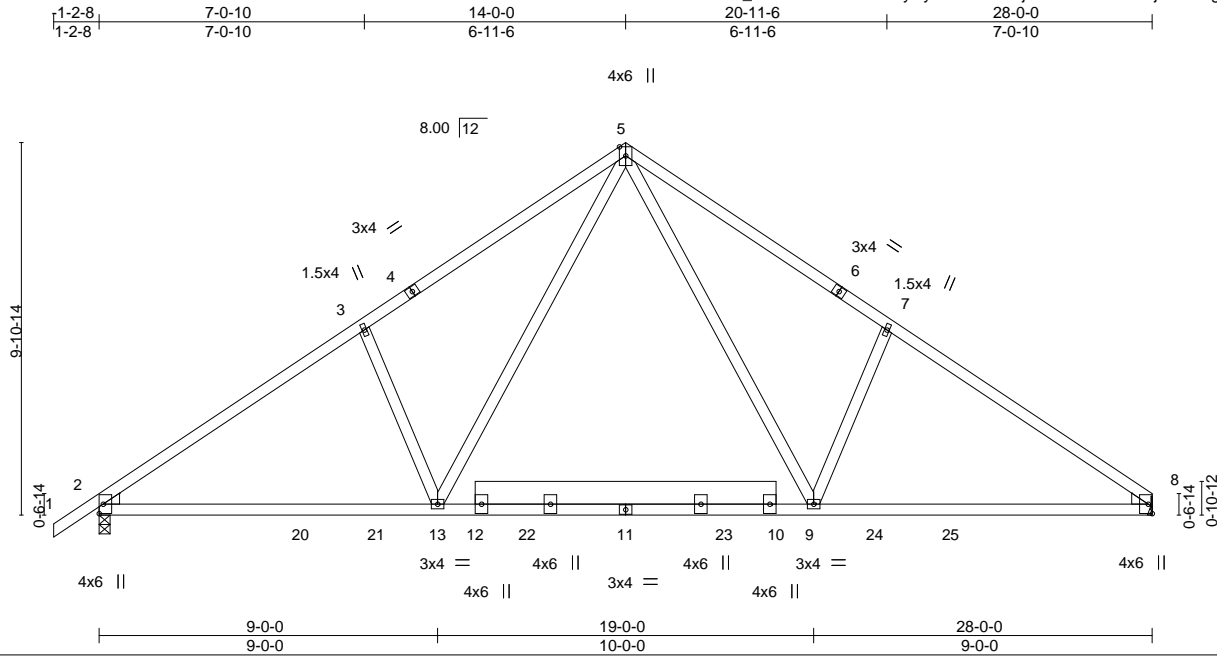

Scale = 1:61.3

<b>LOADING</b> (psf)	<b>SPACING-</b>	2-0-0	<b>CSI.</b>	<b>DEFL.</b>	in (loc)	l/defl	L/d	<b>PLATES</b>	<b>GRIP</b>
TCLL 20.0	Plate Grip DOL	1.15	TC 0.65	Vert(LL)	-0.12 9-19	>999	240	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.79	Vert(CT)	-0.26 9-19	>999	180		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.41	Horz(CT)	0.03 8	n/a	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-MS					Weight: 167 lb	FT = 20%

**LUMBER-**  
 TOP CHORD 2x4 SP No.2 or 2x4 SPF No.2  
 BOT CHORD 2x4 SP No.2 or 2x4 SPF No.2 \*Except\*  
 10-12: 2x8 SP No.2  
 WEBS 2x4 SP No.3  
 WEDGE  
 Left: 2x4 SP No.3 , Right: 2x4 SP No.3

**BRACING-**  
 TOP CHORD Structural wood sheathing directly applied or 3-10-3 oc purlins.  
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS.** (size) 2=0-3-8, 8=Mechanical  
 Max Horz 2=244(LC 9)  
 Max Uplift 2=-145(LC 12), 8=-119(LC 13)  
 Max Grav 2=1239(LC 20), 8=1169(LC 21)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
 TOP CHORD 2-3=-1643/296, 3-5=-1547/393, 5-7=-1554/396, 7-8=-1649/298  
 BOT CHORD 2-13=-209/1453, 9-13=-20/926, 8-9=-145/1289  
 WEBS 5-9=-182/806, 7-9=-423/284, 5-13=-178/797, 3-13=-419/282

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
  - 2) Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=30ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - 4) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
  - 5) Refer to girder(s) for truss to truss connections.
  - 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 8=119.
  - 7) One H2.5A Simpson Strong-Tie connectors recommended to connect truss to bearing walls due to UPLIFT at jt(s) 2. This connection is for uplift only and does not consider lateral forces.
  - 8) ATTIC SPACE SHOWN IS DESIGNED AS UNINHABITABLE.



September 1, 2020

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**  
 Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TP1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601


ENGINEERING BY  
**TRENCO**  
 A MiTek Affiliate  
 818 Soundside Road  
 Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	Freedom PLantation	142651914
2000682-2000682A	A2	Common	8	1		

84 Components (Dunn),

Dunn, NC - 28334,

8.420 s Aug 25 2020 MiTek Industries, Inc. Tue Sep 1 09:09:54 2020 Page 1  
 ID:OOOeZ79\_4PNG5Ls7M1kNBMyiJy2-nkbPUatKjX6Jei0J5n7uZH5kBB11xlvrrqKbXxkyi2HB

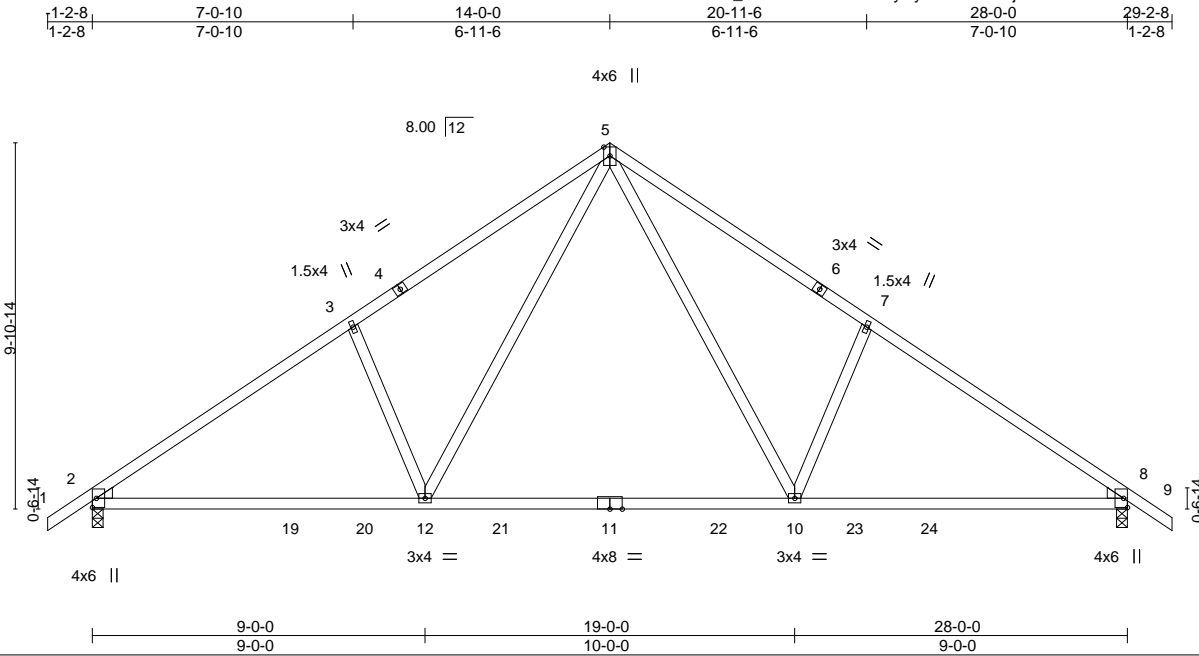

Scale = 1:62.3

<b>LOADING</b> (psf)	<b>SPACING-</b>	2-0-0	<b>CSI.</b>	<b>DEFL.</b>	in (loc)	l/defl	L/d	<b>PLATES</b>	<b>GRIP</b>
TCLL 20.0	Plate Grip DOL	1.15	TC 0.64	Vert(LL)	-0.41 10-12	>815	240	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.99	Vert(CT)	-0.61 10-12	>550	180		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.40	Horz(CT)	0.05 8	n/a	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-MS					Weight: 144 lb	FT = 20%


**LUMBER-**  
 TOP CHORD 2x4 SP No.2 or 2x4 SPF No.2  
 BOT CHORD 2x4 SP No.2 or 2x4 SPF No.2  
 WEBS 2x4 SP No.3  
 WEDGE  
 Left: 2x4 SP No.3 , Right: 2x4 SP No.3

**BRACING-**  
 TOP CHORD Structural wood sheathing directly applied or 3-9-12 oc purlins.  
 BOT CHORD Rigid ceiling directly applied or 2-2-0 oc bracing.

**REACTIONS.** (size) 2=0-3-8, 8=0-3-8  
 Max Horz 2=-251(LC 10)  
 Max Uplift 2=-145(LC 12), 8=-145(LC 13)  
 Max Grav 2=1248(LC 19), 8=1248(LC 20)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
 TOP CHORD 2-3=-1681/288, 3-5=-1583/386, 5-7=-1584/386, 7-8=-1681/288  
 BOT CHORD 2-12=-192/1490, 10-12=-4/957, 8-10=-112/1324  
 WEBS 5-10=-175/819, 7-10=-410/284, 5-12=-175/818, 3-12=-410/284

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
  - 2) Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=30ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - 4) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
  - 5) One H2.5A Simpson Strong-Tie connectors recommended to connect truss to bearing walls due to UPLIFT at jt(s) 2 and 8. This connection is for uplift only and does not consider lateral forces.

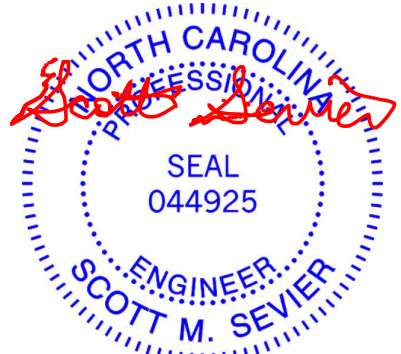

September 1,2020

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**  
 Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TP1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




Job 2000682-2000682A	Truss A2A	Truss Type ROOF TRUSS	Qty 4	Ply 1	Freedom PLantation 142651915
-------------------------	--------------	--------------------------	----------	----------	---------------------------------

84 Components (Dunn),

Dunn, NC - 28334,

8.420 s Aug 25 2020 MiTek Industries, Inc. Tue Sep 1 09:09:56 2020 Page 1  
ID:OOOeZ79\_4PNG5Ls7M1kNBMjy2-k6j9vGvbE8M0t0AiDC9MeiB3b?1nPf17He4e?cyi2H9

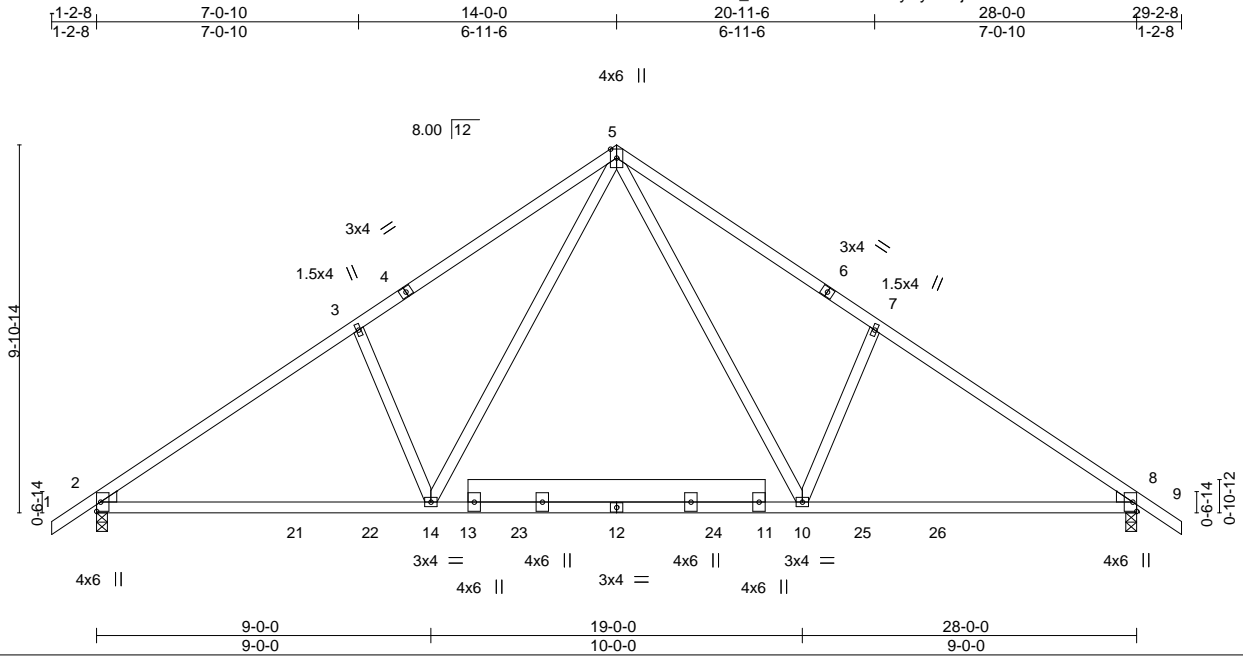

Scale = 1:62.0

<b>LOADING</b> (psf)	<b>SPACING-</b>	2-0-0	<b>CSI.</b>	<b>DEFL.</b>	in (loc)	l/defl	L/d	<b>PLATES</b>	<b>GRIP</b>
TCLL 20.0	Plate Grip DOL	1.15	TC 0.65	Vert(LL)	-0.12 10-20	>999	240	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.78	Vert(CT)	-0.26 10-20	>999	180		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.40	Horz(CT)	0.03 8	n/a	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-MS					Weight: 169 lb	FT = 20%

**LUMBER-**  
TOP CHORD 2x4 SP No.2 or 2x4 SPF No.2  
BOT CHORD 2x4 SP No.2 or 2x4 SPF No.2 \*Except\*  
11-13: 2x8 SP No.2  
WEBS 2x4 SP No.3  
WEDGE  
Left: 2x4 SP No.3 , Right: 2x4 SP No.3

**BRACING-**  
TOP CHORD Structural wood sheathing directly applied or 3-10-5 oc purlins.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS.** (size) 2=0-3-8, 8=0-3-8  
Max Horz 2=251(LC 11)  
Max Uplift 2=-145(LC 12), 8=-145(LC 13)  
Max Grav 2=1238(LC 20), 8=1238(LC 21)


**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 2-3=-1641/294, 3-5=-1546/391, 5-7=-1546/391, 7-8=-1641/294  
BOT CHORD 2-14=-195/1462, 10-14=-7/934, 8-10=-116/1295  
WEBS 5-10=-178/797, 7-10=-419/282, 5-14=-178/797, 3-14=-419/282

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
  - 2) Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=30ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - 4) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
  - 5) One H2.5A Simpson Strong-Tie connectors recommended to connect truss to bearing walls due to UPLIFT at jt(s) 2 and 8. This connection is for uplift only and does not consider lateral forces.
  - 6) ATTIC SPACE SHOWN IS DESIGNED AS UNINHABITABLE.



September 1, 2020

Job	Truss	Truss Type	Qty	Ply	Freedom PLantation	142651916
2000682-2000682A	A3	Common	4	1		
84 Components (Dunn), Dunn, NC - 28334,						8.420 s Aug 25 2020 MiTek Industries, Inc. Tue Sep 1 09:09:57 2020 Page 1
						ID:OOOeZ79_4PNG5Ls7M1kNBMyjy2-CJHX6cvD?SUTv9lumvgbBvjEJOKU86SHWlpBY3yi2H8
						Job Reference (optional)

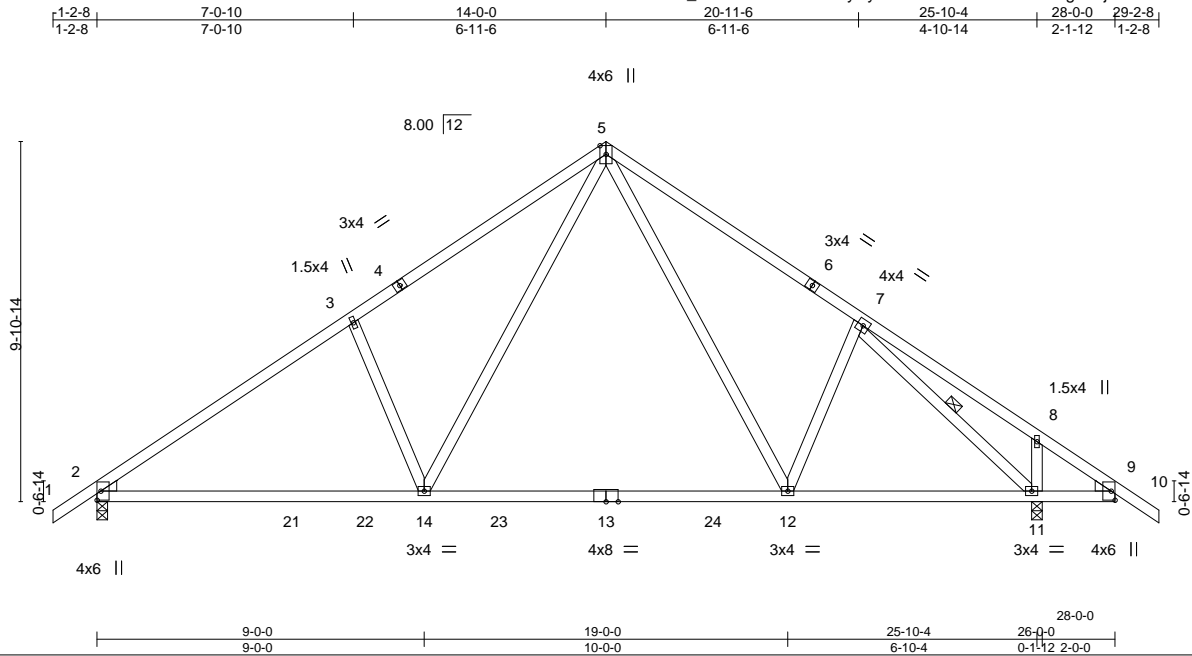

Scale: 3/16"=1'

<b>LOADING</b> (psf)	<b>SPACING-</b>	2-0-0	<b>CSI.</b>	<b>DEFL.</b>	in (loc)	l/defl	L/d	<b>PLATES</b>	<b>GRIP</b>
TCLL 20.0	Plate Grip DOL	1.15	TC 0.65	Vert(LL)	-0.42 12-14	>739	240	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 1.00	Vert(CT)	-0.63 12-14	>496	180		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.41	Horz(CT)	0.04 11	n/a	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-MS						
								Weight: 156 lb	FT = 20%

**LUMBER-**  
TOP CHORD 2x4 SP No.2 or 2x4 SPF No.2  
BOT CHORD 2x4 SP No.2 or 2x4 SPF No.2  
WEBS 2x4 SP No.3  
WEDGE  
Left: 2x4 SP No.3 , Right: 2x4 SP No.3

**BRACING-**  
TOP CHORD Structural wood sheathing directly applied or 4-3-0 oc purlins.  
BOT CHORD Rigid ceiling directly applied or 1-4-12 oc bracing.  
WEBS 1 Row at midpt 7-11

**REACTIONS.** (size) 2=0-3-8, 11=0-3-8  
Max Horz 2=-251(LC 10)  
Max Uplift 2=-140(LC 12), 11=-157(LC 13)  
Max Grav 2=1142(LC 19), 11=1291(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 2-3=-1501/252, 3-5=-1404/349, 5-7=-1154/305, 7-8=-99/286  
BOT CHORD 2-14=-184/1342, 12-14=0/802, 11-12=-23/875  
WEBS 5-12=-121/407, 5-14=-173/831, 3-14=-413/284, 7-11=-1411/289

**NOTES-**  
1) Unbalanced roof live loads have been considered for this design.  
2) Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=30ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60  
3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.  
4) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.  
5) One H2.5A Simpson Strong-Tie connectors recommended to connect truss to bearing walls due to UPLIFT at jt(s) 2 and 11. This connection is for uplift only and does not consider lateral forces.



Job 2000682-2000682A	Truss AE	Truss Type Common Supported Gable	Qty 2	Ply 1	Freedom PLantation I42651917
-------------------------	-------------	--------------------------------------	----------	----------	---------------------------------

84 Components (Dunn), Dunn, NC - 28334,

8.420 s Aug 25 2020 MiTek Industries, Inc. Tue Sep 1 09:09:58 2020 Page 1

ID:OOOeZ79\_4PNG5Ls7M1kNBMyJy2-gVrwKywrmlck7JK5KdBqj7GYeovoteEQlyZk4Vyi2H7

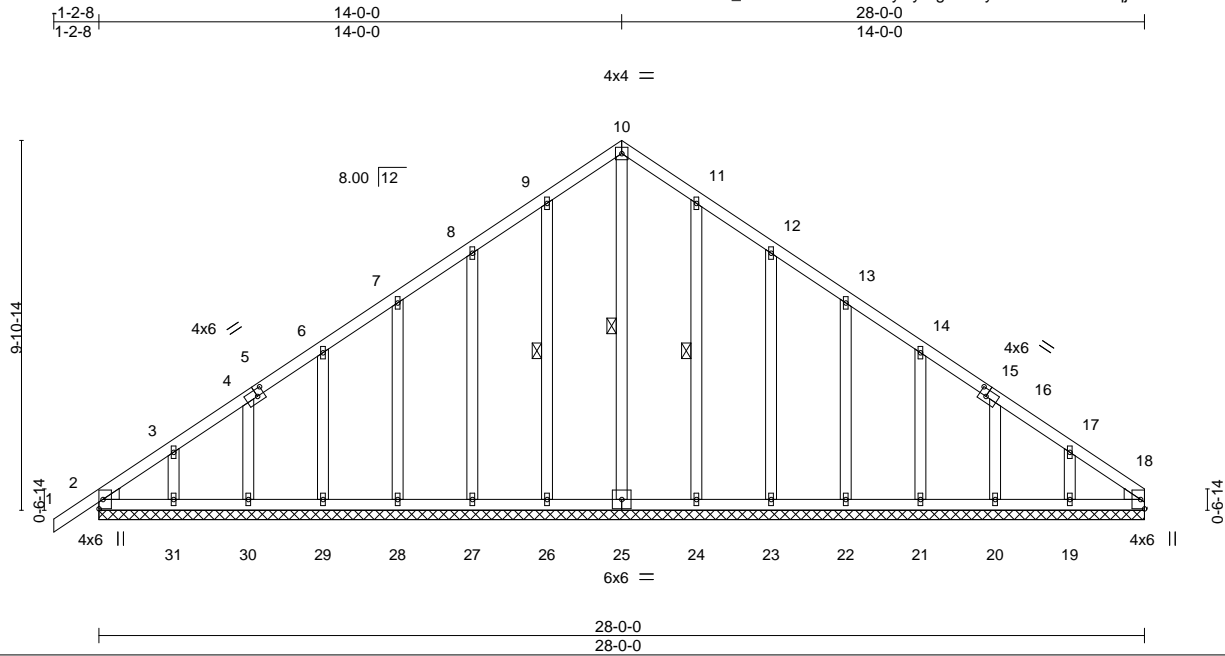


Plate Offsets (X,Y)-- [5:0-2-4,0-2-4], [15:0-2-4,0-2-4]

<b>LOADING</b> (psf)	<b>SPACING-</b>	2-0-0	<b>CSI.</b>	<b>DEFL.</b>	in (loc)	l/def	L/d	<b>PLATES</b>	<b>GRIP</b>
TCLL 20.0	Plate Grip DOL	1.15	TC 0.10	Vert(LL)	-0.00	1	n/r	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.04	Vert(CT)	-0.00	1	n/r		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.12	Horz(CT)	0.01	18	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-S						
								Weight: 193 lb	FT = 20%

**LUMBER-**  
TOP CHORD 2x4 SP No.2 or 2x4 SPF No.2  
BOT CHORD 2x4 SP No.2 or 2x4 SPF No.2  
OTHERS 2x4 SP No.3  
WEDGE  
Left: 2x4 SP No.3 , Right: 2x4 SP No.3

**BRACING-**  
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.  
WEBS 1 Row at midpt 10-25, 9-26, 11-24

**REACTIONS.** All bearings 28-0-0.  
(lb) - Max Horz 2=246(LC 9)  
Max Uplift All uplift 100 lb or less at joint(s) 2, 26, 27, 28, 29, 30, 31, 24, 23, 22, 21, 20, 19, 18  
Max Grav All reactions 250 lb or less at joint(s) 2, 25, 26, 27, 28, 29, 30, 31, 24, 23, 22, 21, 20, 19, 18

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 2-3=-251/193


- NOTES-**
- Unbalanced roof live loads have been considered for this design.
  - Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TCdL=6.0psf; BCdL=6.0psf; h=30ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
  - All plates are 1.5x4 MT20 unless otherwise indicated.
  - Gable requires continuous bottom chord bearing.
  - Gable studs spaced at 2-0-0 oc.
  - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
  - N/A
  - Beveled plate or shim required to provide full bearing surface with truss chord at joint(s) 18.



Job 2000682-2000682A	Truss BE	Truss Type Common Supported Gable	Qty 2	Ply 1	Freedom PLantation I42651918
-------------------------	-------------	--------------------------------------	----------	----------	---------------------------------

84 Components (Dunn), Dunn, NC - 28334,

8.420 s Aug 25 2020 MiTek Industries, Inc. Tue Sep 1 09:09:59 2020 Page 1  
ID:000eZ79\_4PNG5Ls7M1kNBMMyJy2-8hPIXIxTX3kbbkTvHuKi3GKpiuCrc4Bazcllcyxi2H6

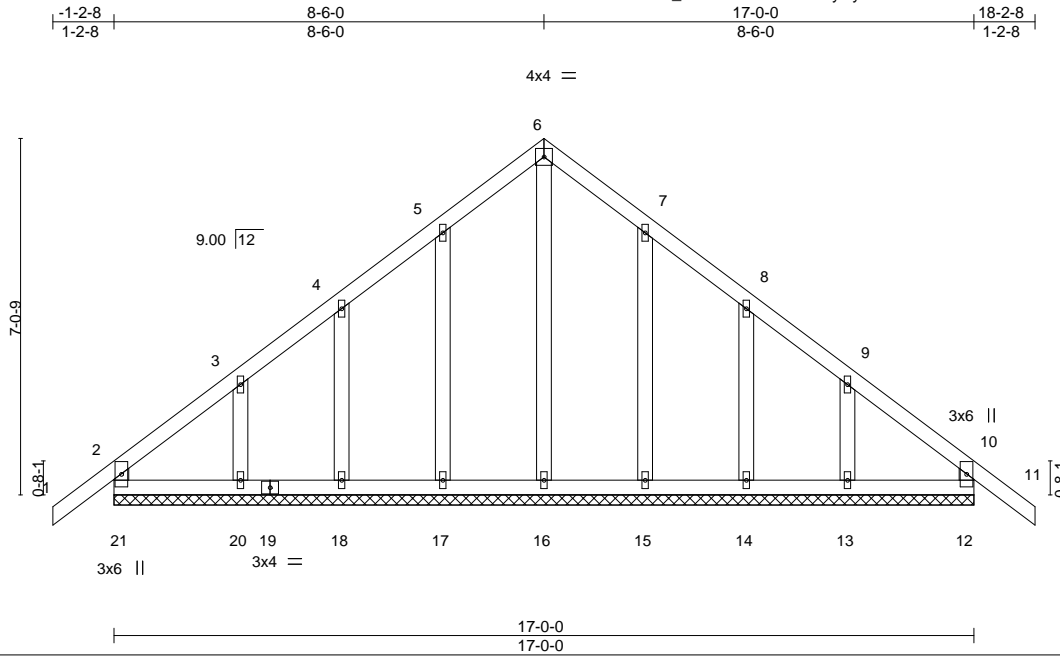

Scale = 1:45.5

<b>LOADING</b> (psf)	<b>SPACING-</b>	2-0-0	<b>CSI.</b>	<b>DEFL.</b>	in (loc)	l/defl	L/d	<b>PLATES</b>	<b>GRIP</b>
TCLL 20.0	Plate Grip DOL	1.15	TC 0.13	Vert(LL)	-0.01 11	n/r	120	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.05	Vert(CT)	-0.01 11	n/r	90		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.14	Horz(CT)	0.00 12	n/a	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-R						
								Weight: 103 lb	FT = 20%

**LUMBER-**  
TOP CHORD 2x4 SP No.2 or 2x4 SPF No.2  
BOT CHORD 2x4 SP No.2 or 2x4 SPF No.2  
WEBS 2x4 SP No.3  
OTHERS 2x4 SP No.3

**BRACING-**  
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.

**REACTIONS.** All bearings 17-0-0.  
(lb) - Max Horz 21=196(LC 11)  
Max Uplift All uplift 100 lb or less at joint(s) 21, 12, 17, 18, 15, 14 except 20=-110(LC 12), 13=-104(LC 13)  
Max Grav All reactions 250 lb or less at joint(s) 21, 12, 16, 17, 18, 20, 15, 14, 13

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
  - Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=30ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
  - All plates are 1.5x4 MT20 unless otherwise indicated.
  - Gable requires continuous bottom chord bearing.
  - Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
  - Gable studs spaced at 2-0-0 oc.
  - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.



September 1, 2020

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**  
Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ENGINEERING BY  
**TRENCO**  
A MiTek Affiliate  
818 Soundside Road  
Edenton, NC 27932



Job 2000682-2000682A	Truss BGR	Truss Type Common Girder	Qty 1	Ply 2	Freedom PLantation 142651919
-------------------------	--------------	-----------------------------	----------	----------	---------------------------------

84 Components (Dunn), Dunn, NC - 28334,

8.420 s Aug 25 2020 MiTek Industries, Inc. Tue Sep 1 09:10:01 2020 Page 1  
ID:OOOeZ79\_4PNG5Ls7M1kNBMyIjy2-44X2zyj3g\_J\_n3g?lXLUu?j0jA4qUtRwnPhqyi2H4

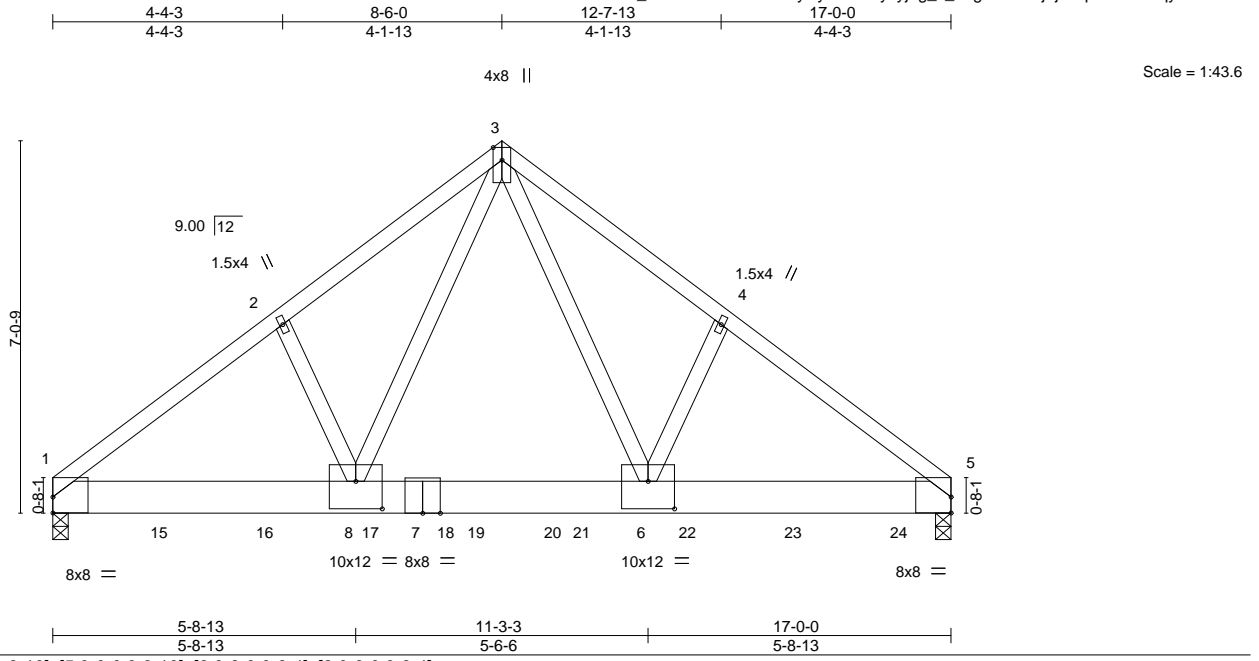


Plate Offsets (X,Y)--	[1:0-0-0,0-3-10], [5:0-0-0,0-3-10], [6:0-6-0,0-6-4], [8:0-6-0,0-6-4]
-----------------------	--

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.36	in (loc) l/defl L/d	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	Lumber DOL 1.15	Vert(LL) -0.07 6-8 >999 240		
BCLL 0.0 *	Rep Stress Incr NO	WB 0.79	Vert(CT) -0.15 6-8 >999 180		
BCDL 10.0	Code IRC2015/TPI2014	Matrix-MS	Horz(CT) 0.02 5 n/a n/a		
				Weight: 229 lb	FT = 20%


LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 4-9-13 oc purlins.
BOT CHORD 2x8 SP No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.3	

**REACTIONS.** (size) 1=0-3-8, 5=0-3-8  
 Max Horz 1=158(LC 34)  
 Max Uplift 1=-557(LC 12), 5=-626(LC 13)  
 Max Grav 1=4783(LC 1), 5=5365(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
 TOP CHORD 1-2=-6104/795, 2-3=-6024/864, 3-4=-6077/871, 4-5=-6154/801  
 BOT CHORD 1-8=-615/4840, 6-8=-345/3329, 5-6=-570/4886  
 WEBS 3-6=-529/3817, 3-8=-516/3710

- NOTES-**
- 2-ply truss to be connected together with 10d (0.120"x3") nails as follows:  
 Top chords connected as follows: 2x4 - 1 row at 0-9-0 oc.  
 Bottom chords connected as follows: 2x8 - 2 rows staggered at 0-6-0 oc.  
 Webs connected as follows: 2x4 - 1 row at 0-9-0 oc.
  - All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
  - Unbalanced roof live loads have been considered for this design.
  - Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TC DL=6.0psf; BCDL=6.0psf; h=30ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; cantilever left and right exposed ; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
  - One H2.5A Simpson Strong-Tie connectors recommended to connect truss to bearing walls due to UPLIFT at jt(s) 1. This connection is for uplift only and does not consider lateral forces.
  - Two H2.5A Simpson Strong-Tie connectors recommended to connect truss to bearing walls due to UPLIFT at jt(s) 5. This connection is for uplift only and does not consider lateral forces.
  - Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 1107 lb down and 139 lb up at 2-0-12, 1107 lb down and 139 lb up at 4-0-12, 1107 lb down and 139 lb up at 6-0-12, 1098 lb down and 139 lb up at 8-0-12, 1101 lb down and 139 lb up at 10-0-12, 1107 lb down and 139 lb up at 12-0-12, and 1107 lb down and 139 lb up at 14-0-12, and 1108 lb down and 138 lb up at 16-0-12 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.

**LOAD CASE(S)** Standard

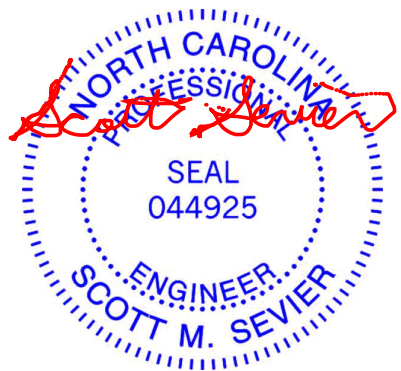

September 1, 2020

Continued on page 2

<p><b>WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.</b>          Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see <b>ANSI/TP1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information</b> available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601</p>	 818 Soundside Road Edenton, NC 27932
---	---

Job	Truss	Truss Type	Qty	Ply	Freedom PLantation	I42651919
2000682-2000682A	BGR	Common Girder	1	<b>2</b>	Job Reference (optional)	

84 Components (Dunn), Dunn, NC - 28334,

8.420 s Aug 25 2020 MiTek Industries, Inc. Tue Sep 1 09:10:01 2020 Page 2  
 ID:OOOeZ79\_4PNG5Ls7M1kNBMyiJy2-44X2zyj3g\_J\_n3g?lIXLlu?j0jA4qUtRwnPhqyi2H4

**LOAD CASE(S)** Standard

1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15

Uniform Loads (plf)

Vert: 1-3=-60, 3-5=-60, 9-12=-20

Concentrated Loads (lb)

Vert: 15=-1098(B) 16=-1098(B) 17=-1098(B) 19=-1098(B) 21=-1098(B) 22=-1098(B) 23=-1098(B) 24=-1099(B)

**WARNING** - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TP1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




818 Soundside Road  
 Edenton, NC 27932

Job 2000682-2000682A	Truss BGR1	Truss Type Common Girder	Qty 1	Ply 2	Freedom PLantation 142651920
-------------------------	---------------	-----------------------------	----------	----------	---------------------------------

84 Components (Dunn), Dunn, NC - 28334,

8.420 s Aug 25 2020 MiTek Industries, Inc. Tue Sep 1 09:10:03 2020 Page 1

ID:000eZ79\_4PNG5Ls7M1kNBMyJy2-0SepNf\_bIE1D4D27An?QAZLFpPeYk59uEGVliyi2H2

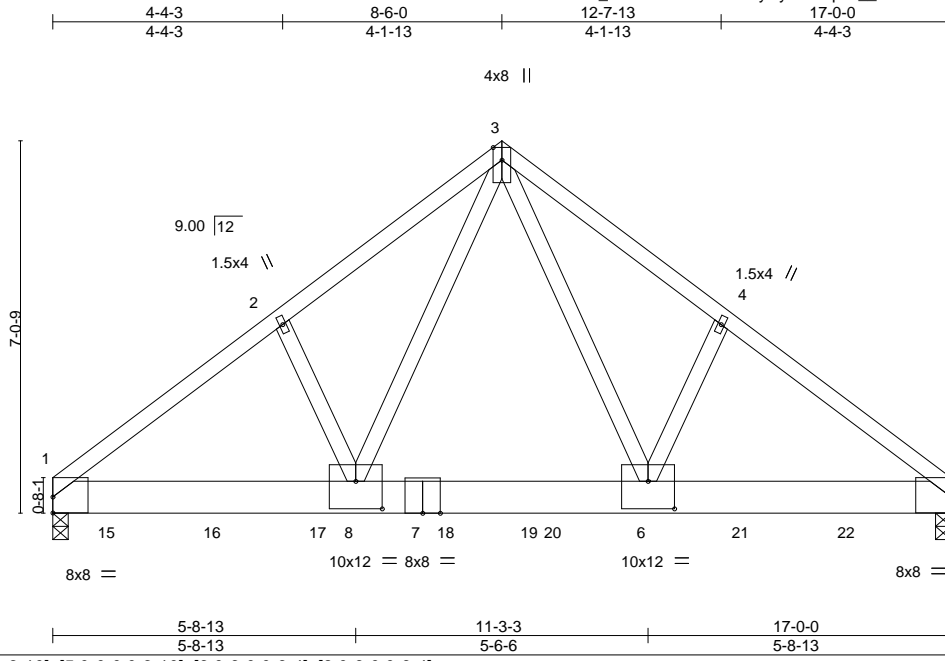

Scale = 1:43.6

Plate Offsets (X,Y)--	[1:0-0-0,0-3-10], [5:0-0-0,0-3-10], [6:0-6-0,0-6-4], [8:0-6-0,0-6-4]
-----------------------	--

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.36	in (loc) l/defl L/d	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.89	Vert(LL) -0.07 6-8 >999 240		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.78	Vert(CT) -0.14 6-8 >999 180		
BCDL 10.0	Rep Stress Incr NO	Matrix-MS	Horz(CT) 0.02 5 n/a n/a		
	Code IRC2015/TPI2014			Weight: 229 lb	FT = 20%

<b>LUMBER-</b>	<b>BRACING-</b>
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 4-9-14 oc purlins.
BOT CHORD 2x8 SP No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.3	

**REACTIONS.** (size) 1=0-3-8, 5=0-3-8  
 Max Horz 1=-158(LC 33)  
 Max Uplift 1=-618(LC 12), 5=-566(LC 13)  
 Max Grav 1=5291(LC 1), 5=4857(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
 TOP CHORD 1-2=-6135/799, 2-3=-6058/868, 3-4=-6027/865, 4-5=-6105/796  
 BOT CHORD 1-8=-619/4871, 6-8=-345/3324, 5-6=-565/4844  
 WEBS 3-6=-518/3729, 3-8=-525/3782

- NOTES-**
- 2-ply truss to be connected together with 10d (0.120"x3") nails as follows:  
 Top chords connected as follows: 2x4 - 1 row at 0-9-0 oc.  
 Bottom chords connected as follows: 2x8 - 2 rows staggered at 0-6-0 oc.  
 Webs connected as follows: 2x4 - 1 row at 0-9-0 oc.
  - All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
  - Unbalanced roof live loads have been considered for this design.
  - Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TC DL=6.0psf; BCDL=6.0psf; h=30ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; cantilever left and right exposed ; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
  - Two H2.5A Simpson Strong-Tie connectors recommended to connect truss to bearing walls due to UPLIFT at jt(s) 1 and 5. This connection is for uplift only and does not consider lateral forces.
  - Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 1098 lb down and 139 lb up at 1-0-12, 1098 lb down and 139 lb up at 3-0-12, 1107 lb down and 139 lb up at 5-0-12, 1099 lb down and 139 lb up at 7-0-12, 1098 lb down and 139 lb up at 9-0-12, 1107 lb down and 139 lb up at 11-0-12, and 1107 lb down and 139 lb up at 13-0-12, and 1107 lb down and 139 lb up at 15-0-12 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.



September 1, 2020

**LOAD CASE(S)** Standard  
 1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15  
 Uniform Loads (plf)  
 Vert: 1-3=-60, 3-5=-60, 9-12=-20

Continued on page 2

<p><b>WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.</b>          Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see <b>ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information</b> available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601</p>	 818 Soundside Road Edenton, NC 27932
--	---

Job 2000682-2000682A	Truss BGR1	Truss Type Common Girder	Qty 1	Ply <b>2</b>	Freedom PLantation I42651920 Job Reference (optional)
-------------------------	---------------	-----------------------------	----------	-----------------	---

84 Components (Dunn), Dunn, NC - 28334,

8.420 s Aug 25 2020 MiTek Industries, Inc. Tue Sep 1 09:10:03 2020 Page 2  
ID:OOOeZ79\_4PNG5Ls7M1kNBMyiJy2-0SepNf\_\_bIE1D4D27An?QAzLFpPeYk59uEGVliyi2H2

**LOAD CASE(S)** Standard

Concentrated Loads (lb)

Vert: 7=-1098(B) 6=-1098(B) 15=-1098(B) 16=-1098(B) 17=-1098(B) 19=-1098(B) 21=-1098(B) 22=-1098(B)

**WARNING** - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TP1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




818 Soundside Road  
Edenton, NC 27932

Job 2000682-2000682A	Truss V1	Truss Type Valley	Qty 2	Ply 1	Freedom PLantation Job Reference (optional)	I42651921
-------------------------	-------------	----------------------	----------	----------	--	-----------

84 Components (Dunn), Dunn, NC - 28334,

8.420 s Aug 25 2020 MiTek Industries, Inc. Tue Sep 1 09:10:04 2020 Page 1

ID:OOOeZ79\_4PNG5Ls7M1kNBMyjy2-VfCBa??cMbMurEnEhtEzOWX\_DxzHMIJ7t03H9yi2H1

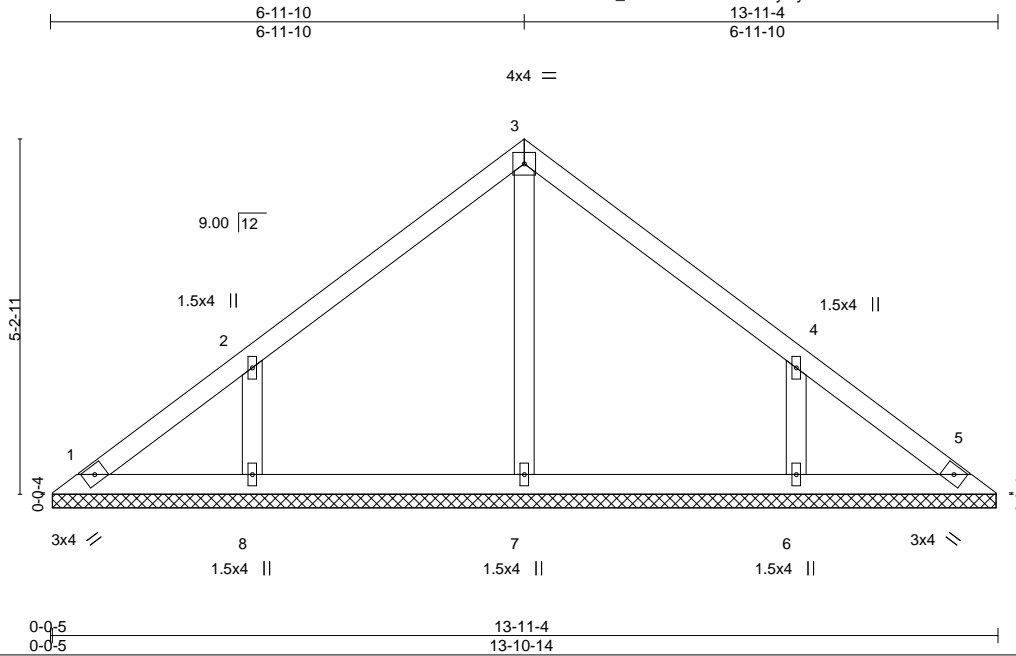

Scale = 1:33.9

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.15	TC 0.30	Vert(LL)	n/a	-	n/a	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.12	Vert(CT)	n/a	-	n/a		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.08	Horz(CT)	0.00	5	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-S					Weight: 57 lb	FT = 20%

**LUMBER-**

TOP CHORD 2x4 SP No.3  
 BOT CHORD 2x4 SP No.2 or 2x4 SPF No.2  
 OTHERS 2x4 SP No.3

**BRACING-**

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.  
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS.**


All bearings 13-10-9.  
 (lb) - Max Horz 1=121(LC 11)  
 Max Uplift All uplift 100 lb or less at joint(s) 1 except 8=-150(LC 12), 6=-150(LC 13)  
 Max Grav All reactions 250 lb or less at joint(s) 1, 5 except 7=254(LC 1), 8=336(LC 19), 6=336(LC 20)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

WEBS 2-8=-265/191, 4-6=-265/191

**NOTES-**

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TC DL=6.0psf; BC DL=6.0psf; h=30ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Gable requires continuous bottom chord bearing.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.

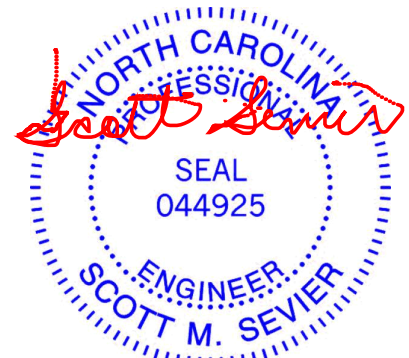

September 1, 2020

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




818 Soundside Road  
 Edenton, NC 27932

Job 2000682-2000682A	Truss V2	Truss Type Valley	Qty 2	Ply 1	Freedom PLantation I42651922
-------------------------	-------------	----------------------	----------	----------	---------------------------------

84 Components (Dunn), Dunn, NC - 28334,

8.420 s Aug 25 2020 MiTek Industries, Inc. Tue Sep 1 09:10:04 2020 Page 1  
ID:OOOeZ79\_4PNG5Ls7M1kNBMyiJy2-VfCBa??cMbMurEnEhtIEzOWT6DspHMVJ7i03H9yi2H1

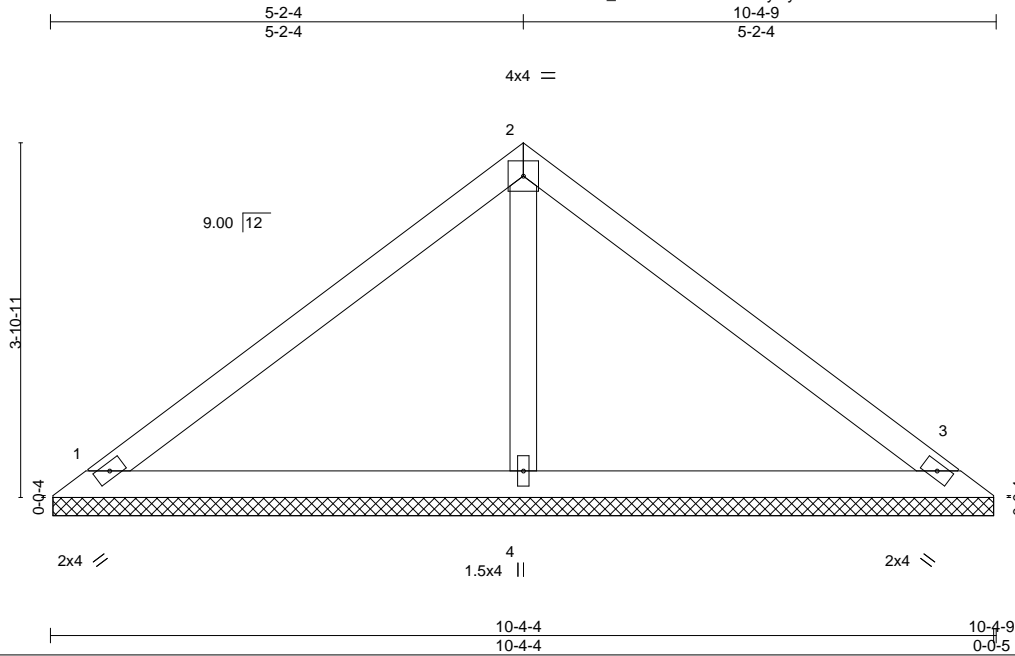

Scale = 1:25.3

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP	
TCLL 20.0	Plate Grip DOL	1.15	TC 0.55	Vert(LL)	n/a	-	n/a	999	MT20	244/190
TCDL 10.0	Lumber DOL	1.15	BC 0.38	Vert(CT)	n/a	-	n/a	999		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.07	Horz(CT)	0.00	3	n/a	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-S						Weight: 38 lb	FT = 20%

**LUMBER-**  
 TOP CHORD 2x4 SP No.3  
 BOT CHORD 2x4 SP No.3  
 OTHERS 2x4 SP No.3

**BRACING-**  
 TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.  
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS.** (size) 1=10-3-14, 3=10-3-14, 4=10-3-14  
 Max Horz 1=88(LC 10)  
 Max Uplift 1=33(LC 12), 3=45(LC 13), 4=10(LC 12)  
 Max Grav 1=192(LC 1), 3=192(LC 1), 4=376(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

**NOTES-**

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TC DL=6.0psf; BC DL=6.0psf; h=30ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Gable requires continuous bottom chord bearing.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.



September 1, 2020

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




818 Soundside Road  
 Edenton, NC 27932


Job 2000682-2000682A	Truss V3	Truss Type Valley	Qty 2	Ply 1	Freedom PLantation I42651923
-------------------------	-------------	----------------------	----------	----------	---------------------------------

84 Components (Dunn), Dunn, NC - 28334,

8.420 s Aug 25 2020 MiTek Industries, Inc. Tue Sep 1 09:10:05 2020 Page 1  
ID:OOOeZ79\_4PNG5Ls7M1kNBMyiJy2-zrmZoL0E7vUISOMREbpTVb3i3dGg0qNSMXIcqbyi2HO



Scale = 1:18.5

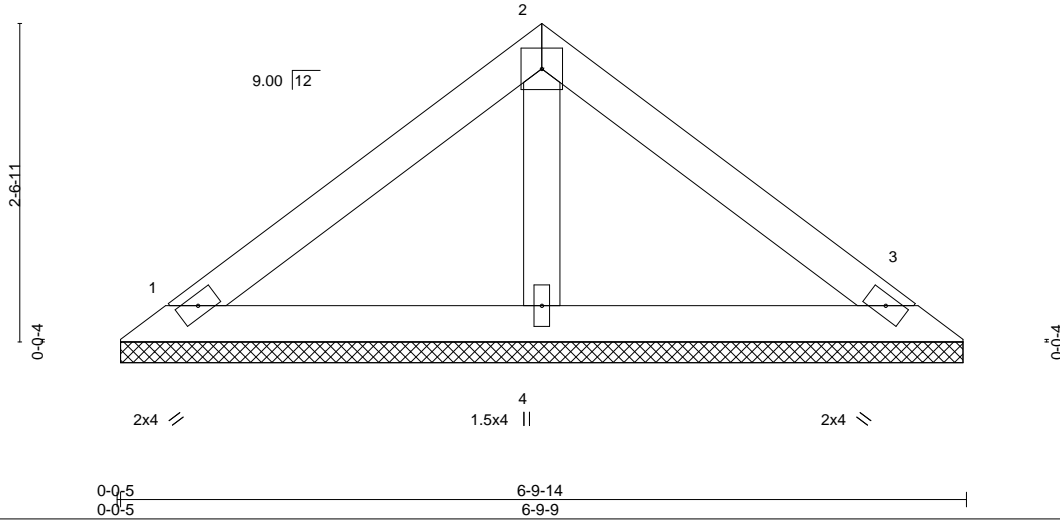

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.28	in (loc) l/defl L/d	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.15	Vert(LL) n/a - n/a 999		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.03	Vert(CT) n/a - n/a 999		
BCDL 10.0	Rep Stress Incr YES	Matrix-P	Horz(CT) 0.00 3 n/a n/a		
	Code IRC2015/TPI2014			Weight: 24 lb	FT = 20%

**LUMBER-**  
TOP CHORD 2x4 SP No.3  
BOT CHORD 2x4 SP No.3  
OTHERS 2x4 SP No.3

**BRACING-**  
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS.** (size) 1=6-9-4, 3=6-9-4, 4=6-9-4  
Max Horz 1=55(LC 11)  
Max Uplift 1=-28(LC 12), 3=-36(LC 13)  
Max Grav 1=131(LC 1), 3=131(LC 1), 4=213(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

**NOTES-**

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TC DL=6.0psf; BC DL=6.0psf; h=30ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Gable requires continuous bottom chord bearing.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.



September 1, 2020

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**


Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




818 Soundside Road  
Edenton, NC 27932

# Symbols

## PLATE LOCATION AND ORIENTATION



Center plate on joint unless x, y offsets are indicated. Dimensions are in ft-in-sixteenths. Apply plates to both sides of truss and fully embed teeth.

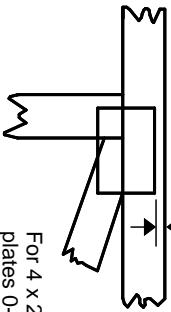

For 4 x 2 orientation, locate plates 0- 1/16" from outside edge of truss.



This symbol indicates the required direction of slots in connector plates.

\* Plate location details available in **MITek 20/20 software or upon request.**

## PLATE SIZE

4 X 4


The first dimension is the plate width measured perpendicular to slots. Second dimension is the length parallel to slots.

## LATERAL BRACING LOCATION



Indicated by symbol shown and/or by text in the bracing section of the output. Use T or I bracing if indicated.

## BEARING




Indicates location where bearings (supports) occur. Icons vary but reaction section indicates joint number where bearings occur. Min size shown is for crushing only.

### Industry Standards:

ANSI/TPI 1: National Design Specification for Metal Plate Connected Wood Truss Construction.  
DSB-89: Design Standard for Bracing, Building Component Safety Information, Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses.

# Numbering System

6-4-8  
dimensions shown in ft-in-sixteenths  
(Drawings not to scale)

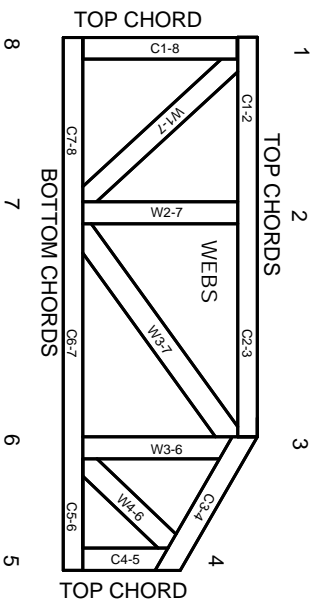

**JOINTS ARE GENERALLY NUMBERED/LETTERED CLOCKWISE AROUND THE TRUSS STARTING AT THE JOINT FARTHEST TO THE LEFT.**

**CHORDS AND WEBS ARE IDENTIFIED BY END JOINT NUMBERS/LETTERS.**

## PRODUCT CODE APPROVALS

ICC-ES Reports:

ESR-1311, ESR-1352, ESR1988  
ER-3907, ESR-2362, ESR-1397, ESR-3282

Trusses are designed for wind loads in the plane of the truss unless otherwise shown.

Lumber design values are in accordance with ANSI/TPI 1 section 6.3 These truss designs rely on lumber values established by others.

© 2012 MITteK® All Rights Reserved



MITek Engineering Reference Sheet: Mill-7473 rev. 5/19/2020



# General Safety Notes

## Failure to Follow Could Cause Property Damage or Personal Injury

1. Additional stability bracing for truss system, e.g. diagonal or X-bracing, is always required. See BCSI.
2. Truss bracing must be designed by an engineer. For wide truss spacing, individual lateral braces themselves may require bracing, or alternative T or I bracing should be considered.
3. Never exceed the design loading shown and never stack materials on inadequately braced trusses.
4. Provide copies of this truss design to the building designer, erection supervisor, property owner and all other interested parties.
5. Cut members to bear tightly against each other.
6. Place plates on each face of truss at each joint and embed fully. Knots and wane at joint locations are regulated by ANSI/TPI 1.
7. Design assumes trusses will be suitably protected from the environment in accord with ANSI/TPI 1.
8. Unless otherwise noted, moisture content of lumber shall not exceed 19% at time of fabrication.
9. Unless expressly noted, this design is not applicable for use with fire retardant, preservative treated, or green lumber.
10. Camber is a non-structural consideration and is the responsibility of truss fabricator. General practice is to camber for dead load deflection.
11. Plate type, size, orientation and location dimensions indicated are minimum plating requirements.
12. Lumber used shall be of the species and size, and in all respects, equal to or better than that specified.
13. Top chords must be sheathed or purlins provided at spacing indicated on design.
14. Bottom chords require lateral bracing at 10 ft. spacing, or less, if no ceiling is installed, unless otherwise noted.
15. Connections not shown are the responsibility of others.
16. Do not cut or alter truss member or plate without prior approval of an engineer.
17. Install and load vertically unless indicated otherwise.
18. Use of green or treated lumber may pose unacceptable environmental, health or performance risks. Consult with project engineer before use.
19. Review all portions of this design (front, back, words and pictures) before use. Reviewing pictures alone is not sufficient.
20. Design assumes manufacture in accordance with ANSI/TPI 1 Quality Criteria.
21. The design does not take into account any dynamic or other loads other than those expressly stated.