



**ROOF & FLOOR TRUSSES & BEAMS**

Reilly Road Industrial Park  
 Fayetteville, N.C. 28309  
 Phone: (910) 864-8787  
 Fax: (910) 864-4444


Bearing reactions less than or equal to 3000# are deemed to comply with the prescriptive code requirements. The contractor shall refer to the attached Tables ( derived from the prescriptive Code requirements ) to determine the minimum foundation size and number of wood studs required to support reactions greater than 3000# but not greater than 15000#. A registered design professional shall be retained to design the support system for any reaction that exceeds those specified in the attached Tables. A registered design professional shall be retained to design the support system for all reactions that exceed 15000#.

Signature David Landry  
 David Landry

**LOAD CHART FOR JACK STUDS**

(BASED ON TABLES ROEHLIC & CO.)  
 NUMBER OF JACK STUDS REQUIRED @ EA END OF HEADERS/STRIPS

END REACTION (IP TO)	REQ'D STUDS FOR JOIST/FLOOR	END REACTION (IP TO)	REQ'D STUDS FOR JOIST/BEAM	END REACTION (IP TO)	REQ'D STUDS FOR JOIST/BEAM
1700	1	2550	1	3400	1
3400	2	5100	2	6800	2
5100	3	7650	3	10200	3
6800	4	10200	4	13600	4
8500	5	12750	5	17000	5
10200	6	15300	6		
11900	7				
13600	8				
15300	9				

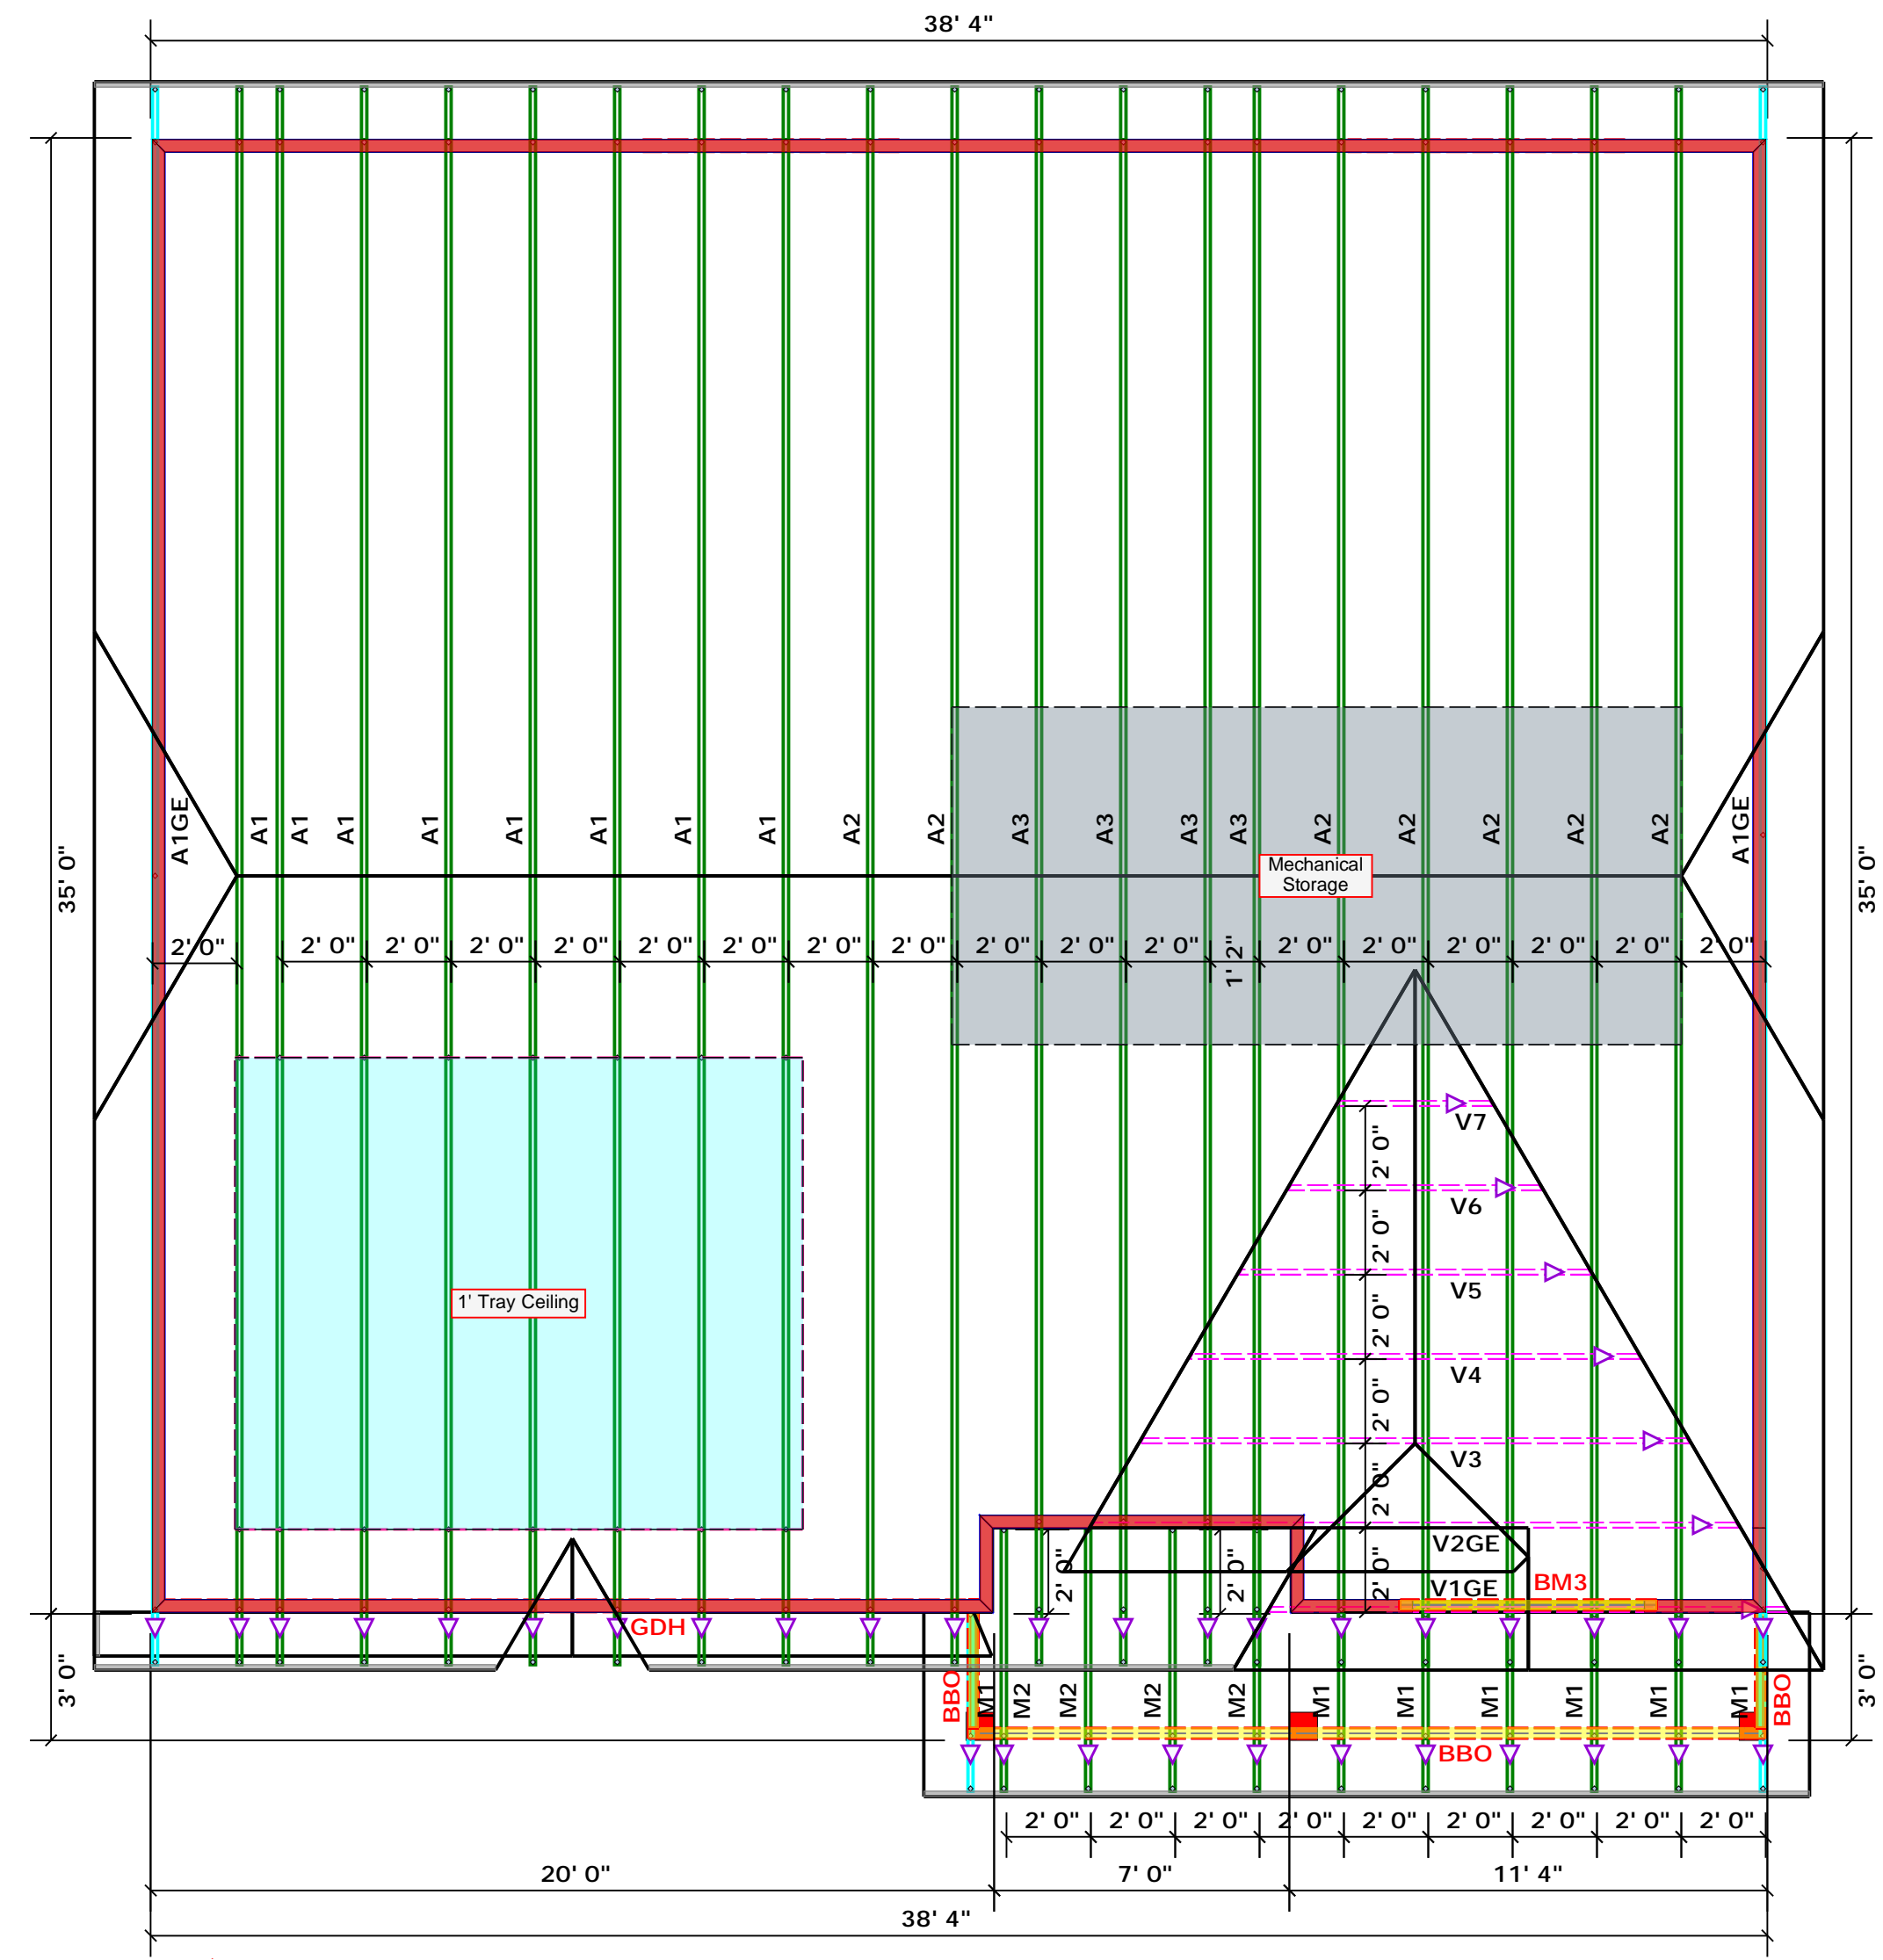

Products				
PlotID	Length	Product	Plies	Net Qty
BM1	4' 0"	1-3/4"x 16" LVL Kerto-S	2	2
BM2	7' 0"	1-3/4"x 9-1/4" LVL Kerto-S	2	4
GDH	20' 0"	1-3/4"x 18" LVL Kerto-S	2	2

Products				
PlotID	Length	Product	Plies	Net Qty
BM3	8' 0"	2x12 SP No.2	2	2

**1 Truss Placement Plan**  
 Scale: 1/4"=1'

**All Walls Shown Are Considered Load Bearing**

**Dimension Notes**

- All exterior wall to wall dimensions are to face of sheathing unless noted otherwise
- All interior wall dimensions are to face of frame wall unless noted otherwise
- All exterior wall to truss dimensions are to face of frame wall unless noted otherwise

Roof Area = 1992.06 sq.ft.  
 Ridge Line = 39.72 ft.  
 Hip Line = 39.94 ft.  
 Horiz. OH = 155.47 ft.  
 Raked OH = 131.47 ft.  
 Decking = 68 sheets

**Hatch Legend**

[Grey Hatch]	Padded HVAC
[Light Blue Hatch]	Tray Ceiling
[Red Hatch]	2nd Floor Walls
[Yellow Hatch]	Drop Beam

▲ = Indicates Left End of Truss  
 (Reference Engineered Truss Drawing)  
 Do NOT Erect Truss Backwards

BUILDER	Benjamin Stout	CITY / CO.	Spring Lake / Cumberland
JOB NAME	Lot 14 Sierra Villas	ADDRESS	10 North Dakota Ct.
PLAN	Cypress	MODEL	Roof
SEAL DATE	N/A	DATE REV.	09/18/20
QUOTE #	Quote #	DRAWN BY	David Landry
JOB #	J0920-4178	SALES REP.	Marshall Naylor

THIS IS A TRUSS PLACEMENT DIAGRAM ONLY. These trusses are designed as individual building components to be incorporated into the building design at the specification of the building designer. See individual design sheets for each truss design identified on the placement drawing. The building designer is responsible for temporary and permanent bracing of the roof and floor system and for the overall structure. The design of the truss support structure including headers, beams, walls, and columns is the responsibility of the building designer. For general guidance regarding bracing, consult BCSI-B1 and BCSI-B3 provided with the truss delivery package or online @ sbcindustry.com.