

RE: J0920-4182
 Lot 9 Sierra Villas

Trenco
 818 Soundside Rd
 Edenton, NC 27932

Site Information:

Customer: Project Name: J0920-4182
 Lot/Block: Model:
 Address: Subdivision:
 City: State:


General Truss Engineering Criteria & Design Loads (Individual Truss Design Drawings Show Special Loading Conditions):

Design Code: IRC2015/TPI2014 Design Program: MiTek 20/20 8.1
 Wind Code: ASCE 7-10 Wind Speed: 130 mph
 Roof Load: 40.0 psf Floor Load: N/A psf

This package includes 17 individual, dated Truss Design Drawings and 0 Additional Drawings.

No.	Seal#	Truss Name	Date
1	E14133403	A1	9/18/2020
2	E14133404	A1GE	9/18/2020
3	E14133405	A1SG	9/18/2020
4	E14133406	B1	9/18/2020
5	E14133407	B1SG	9/18/2020
6	E14133408	B2	9/18/2020
7	E14133409	C1	9/18/2020
8	E14133410	C1GE	9/18/2020
9	E14133411	D1	9/18/2020
10	E14133412	D1GE	9/18/2020
11	E14133413	D2	9/18/2020
12	E14133414	D2-GR	9/18/2020
13	E14133415	D2GE	9/18/2020
14	E14133416	J1	9/18/2020
15	E14133417	J1GE	9/18/2020
16	E14133418	M1	9/18/2020
17	E14133419	M1GE	9/18/2020

The truss drawing(s) referenced above have been prepared by Truss Engineering Co. under my direct supervision based on the parameters provided by Comtech, Inc - Fayetteville. Truss Design Engineer's Name: Gilbert, Eric My license renewal date for the state of North Carolina is December 31, 2020. North Carolina COA: C-0844

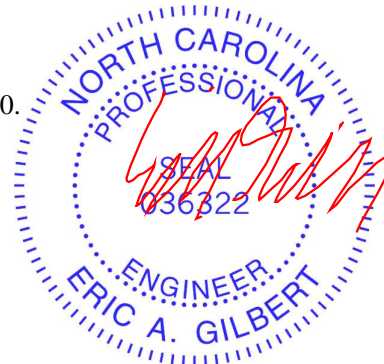

IMPORTANT NOTE: The seal on these truss component designs is a certification that the engineer named is licensed in the jurisdiction(s) identified and that the designs comply with ANSI/TPI 1. These designs are based upon parameters shown (e.g., loads, supports, dimensions, shapes and design codes), which were given to TRENCO. Any project specific information included is for TRENCO customers file reference purpose only, and was not taken into account in the preparation of these designs. TRENCO has not independently verified the applicability of the design parameters or the designs for any particular building. Before use, the building designer should verify applicability of design parameters and properly incorporate these designs into the overall building design per ANSI/TPI 1, Chapter 2.


Job J0920-4182	Truss A1	Truss Type COMMON	Qty 8	Ply 1	Lot 9 Sierra Villas	E14133403
-------------------	-------------	----------------------	----------	----------	---------------------	-----------

Comtech, Inc., Fayetteville, NC - 28314,

8.330 s Feb 13 2020 MiTek Industries, Inc. Tue Mar 3 06:49:23 2020 Page 1
ID: eaaJ9i3ZGlbZ85c5RTUGb9zA_ID-hAX9rTQoYItCqQ_WjOnlb21T4eZu10a8ROXbSGzeig

0-11-0 8-5-8 18-5-8 28-5-8 36-11-0 37-10-0
0-11-0 8-5-8 10-0-0 10-0-0 8-5-8 0-11-0

Scale = 1:69.4

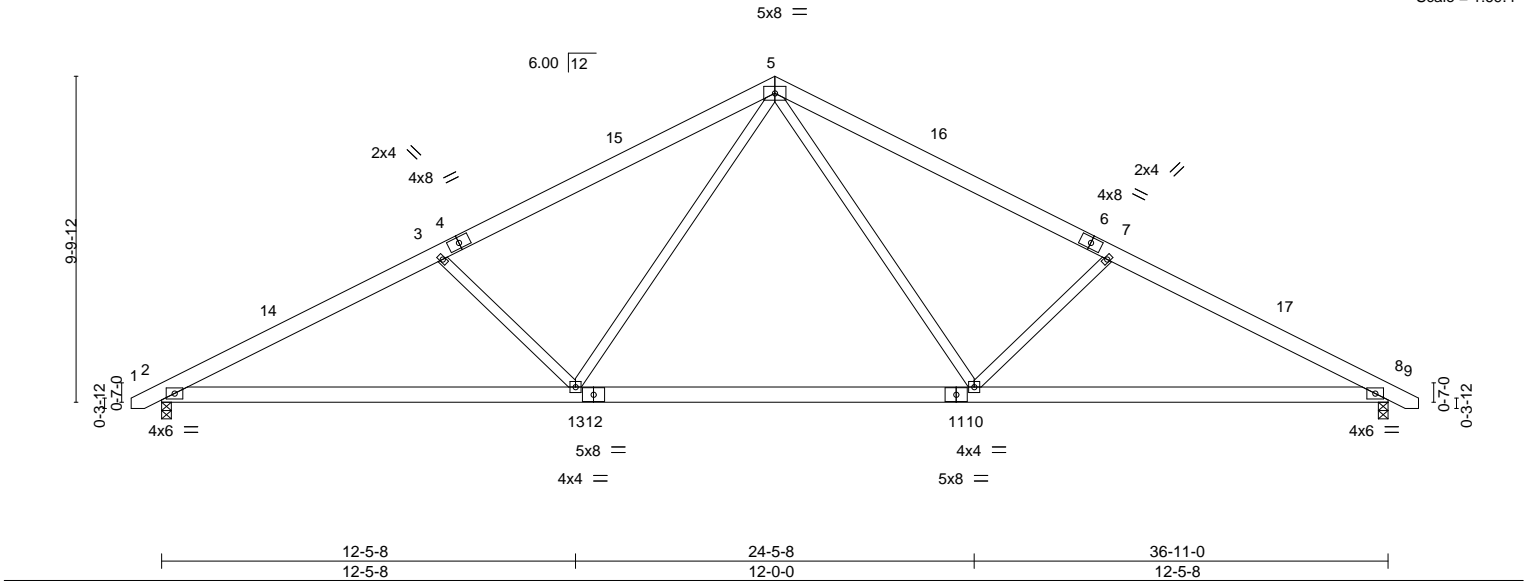

LOADING (psf)	SPACING-	CSL	DEFL.	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.24	in (loc) l/defl L/d	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.42	Vert(LL) -0.40 10-13 >999 360		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.35	Vert(CT) -0.49 10-13 >891 240		
BCDL 10.0	Rep Stress Incr YES	Matrix-S	Horz(CT) 0.06 8 n/a n/a		
	Code IRC2015/TPI2014		Wind(LL) 0.05 13 >999 240	Weight: 237 lb	FT = 20%


LUMBER-
TOP CHORD 2x6 SP 2400F 2.0E
BOT CHORD 2x6 SP 2400F 2.0E
WEBS 2x4 SP No.2

BRACING-
TOP CHORD Structural wood sheathing directly applied or 5-11-12 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (size) 2=0-3-8, 8=0-3-8
Max Horz 2=-125(LC 10)
Max Uplift 2=-100(LC 12), 8=-100(LC 13)
Max Grav 2=1595(LC 2), 8=1595(LC 2)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-2911/591, 3-5=-2610/548, 5-7=-2610/548, 7-8=-2911/591
BOT CHORD 2-13=-406/2584, 10-13=-119/1678, 8-10=-414/2532
WEBS 5-10=-106/1068, 7-10=-577/339, 5-13=-106/1068, 3-13=-577/339

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCCL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) -0-8-10 to 3-8-3, Interior(1) 3-8-3 to 18-5-8, Exterior(2) 18-5-8 to 22-10-5, Interior(1) 22-10-5 to 37-7-10 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas with a clearance greater than 6-0-0 between the bottom chord and any other members, with BCDL = 10.0psf.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint 2 and 100 lb uplift at joint 8.

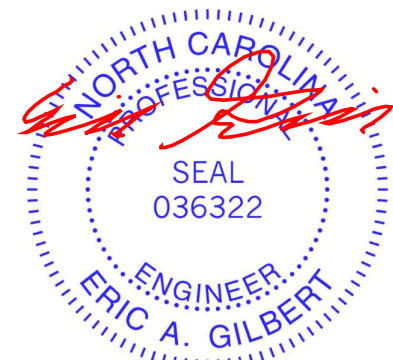


March 3, 2020

Job J0920-4182	Truss A1GE	Truss Type COMMON SUPPORTED GAB	Qty 1	Ply 1	Lot 9 Sierra Villas	E14133404
Comtech, Inc., Fayetteville, NC - 28314,					Job Reference (optional)	

8.330 s Feb 13 2020 MiTek Industries, Inc. Tue Mar 3 06:49:25 2020 Page 1
ID: eaaJ9i3ZGlbZ85c5RTUGb9zA_ID-dYfwG9S24w7w4k8uqppDgT7rXRLcV_IRui0iW8zeiie

0-11-0 18-5-8 36-11-0 37-10-0
0-11-0 18-5-8 18-5-8 0-11-0

Scale = 1:66.4

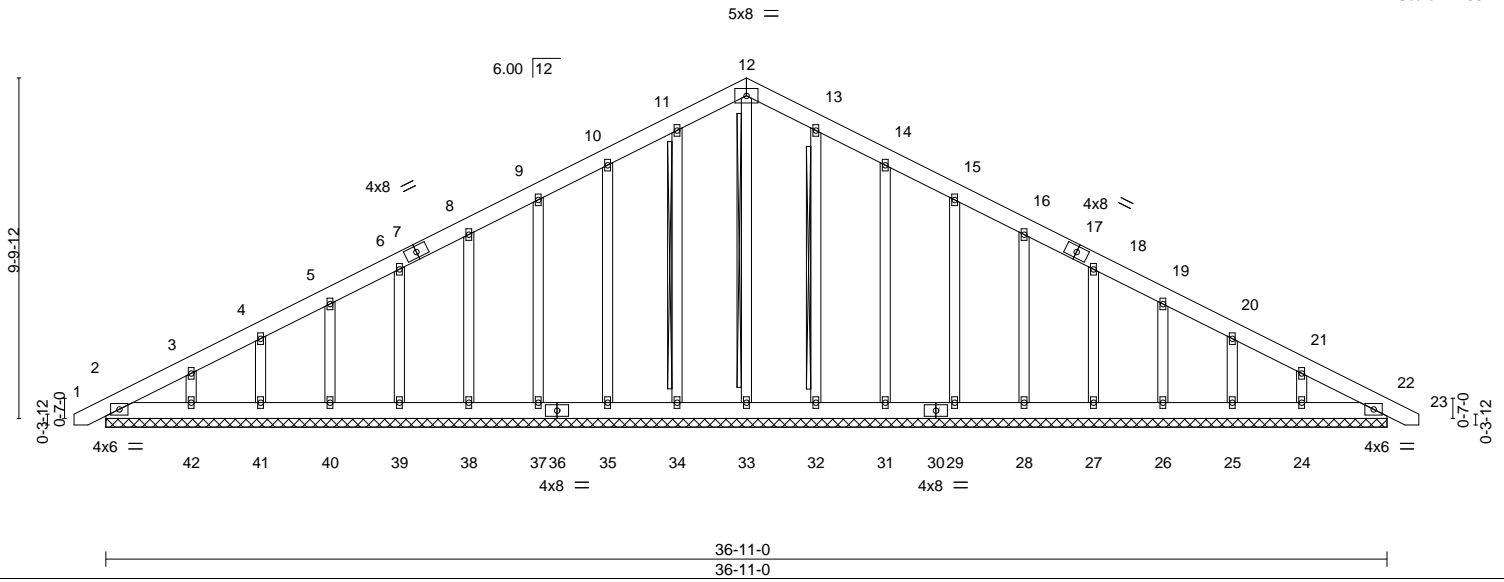

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.05	in (loc) l/defl L/d	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.02	Vert(LL) 0.00 22 n/r 120		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.11	Vert(CT) 0.00 22 n/r 120		
BCDL 10.0	Rep Stress Incr YES	Matrix-S	Horz(CT) 0.01 22 n/a n/a		
	Code IRC2015/TPI2014			Weight: 306 lb	FT = 20%


LUMBER-
TOP CHORD 2x6 SP No.1
BOT CHORD 2x6 SP No.1
OTHERS 2x4 SP No.2

BRACING-
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS T-Brace: 2x4 SPF No.2 - 12-33, 11-34, 13-32
Fasten (2X) T and I braces to narrow edge of web with 10d (0.131"x3") nails, 6in o.c., with 3in minimum end distance.
Brace must cover 90% of web length.

REACTIONS. All bearings 36-11-0.
(lb) - Max Horz 2=194(LC 17)
Max Uplift All uplift 100 lb or less at joint(s) 2, 34, 35, 37, 38, 39, 40, 41, 42, 32, 31, 29, 28, 27, 26, 25, 24
Max Grav All reactions 250 lb or less at joint(s) 2, 34, 35, 37, 38, 39, 40, 41, 42, 32, 31, 29, 28, 27, 26, 25, 24, 22 except 33=280(LC 22)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=254/87, 10-11=112/281, 11-12=126/322, 12-13=126/322, 13-14=112/281

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TC DL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
 - All plates are 2x4 MT20 unless otherwise indicated.
 - Gable requires continuous bottom chord bearing.
 - Gable studs spaced at 2-0-0 oc.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas with a clearance greater than 6-0-0 between the bottom chord and any other members, with BCDL = 10.0psf.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 34, 35, 37, 38, 39, 40, 41, 42, 32, 31, 29, 28, 27, 26, 25, 24.
 - Warning: Additional permanent and stability bracing for truss system (not part of this component design) is always required.

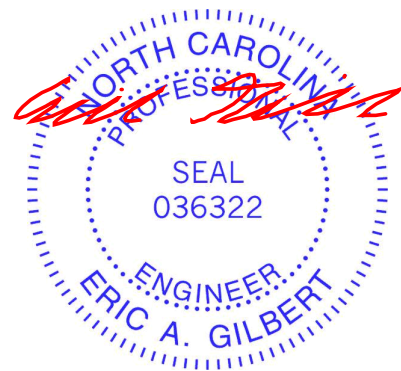

Job J0920-4182	Truss A1SG	Truss Type GABLE	Qty 1	Ply 1	Lot 9 Sierra Villas	E14133405
Comtech, Inc., Fayetteville, NC - 28314,					Job Reference (optional)	

8.330 s Feb 13 2020 MiTek Industries, Inc. Tue Mar 3 06:49:26 2020 Page 1
ID: eaaJ9i3ZGlbZ85c5RTUGb9zA_ID-5iDITVgrDFnhti5OWLSDhfurbREHka7MmF2bzeiid

0-11-0 8-5-8 18-5-8 28-5-8 36-11-0 37-10-0
0-11-0 8-5-8 10-0-0 10-0-0 8-5-8 0-11-0

Scale = 1:66.4

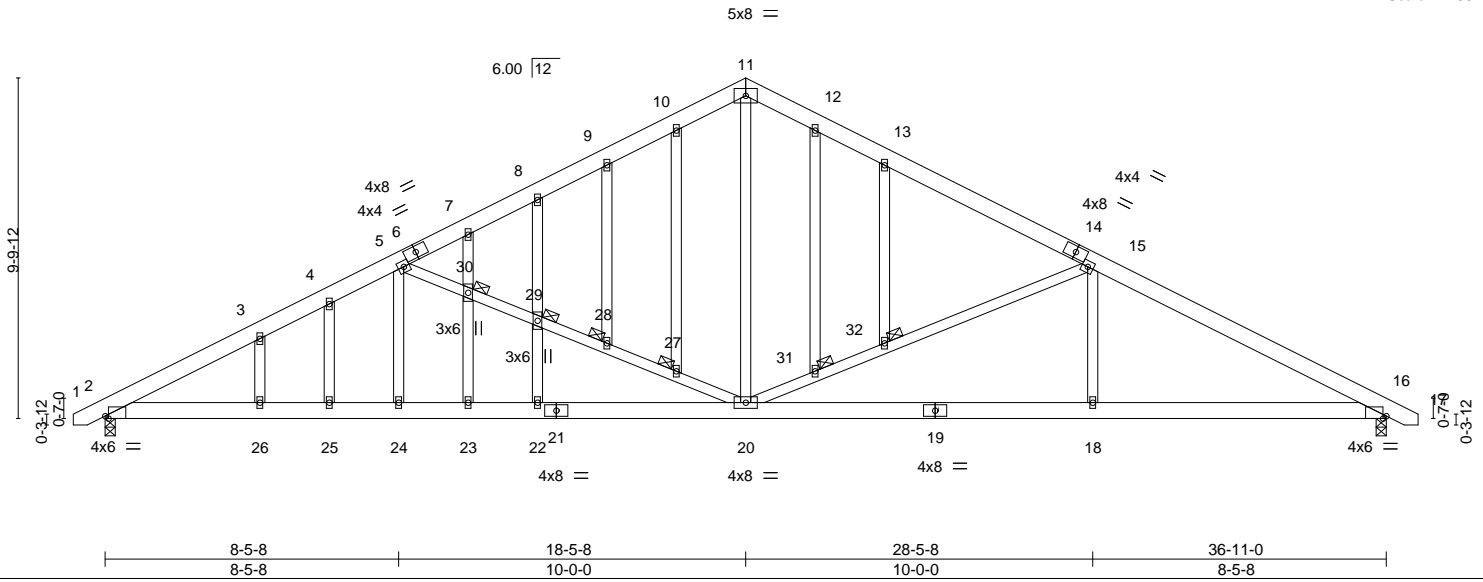


Plate Offsets (X,Y)-- [2:0-1-2,Edge], [16:0-1-2,Edge]

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.33	in (loc) l/defl L/d	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.43	Vert(LL) -0.12 20-22 >999 360		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.77	Vert(CT) -0.24 20-22 >999 240		
BCDL 10.0	Rep Stress Incr YES	Matrix-S	Horz(CT) 0.08 16 n/a n/a		
	Code IRC2015/TPI2014		Wind(LL) 0.15 20-22 >999 240	Weight: 303 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x6 SP No.1	TOP CHORD Structural wood sheathing directly applied or 4-5-15 oc purlins.
BOT CHORD 2x6 SP No.1	BOT CHORD Rigid ceiling directly applied or 9-3-8 oc bracing.
WEBS 2x4 SP No.2	JOINTS 1 Brace at Jt(s): 27, 28, 29, 30, 31, 32
OTHERS 2x4 SP No.2	

REACTIONS. (size) 2=0-3-8, 16=0-3-8
 Max Horz 2=-194(LC 13)
 Max Uplift 2=-326(LC 12), 16=-326(LC 13)
 Max Grav 2=1517(LC 1), 16=1517(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-3=-2671/887, 3-4=-2566/953, 4-5=-2516/978, 5-7=-1784/644, 7-8=-1719/665,
 8-9=-1698/725, 9-10=-1672/752, 10-11=-1614/763, 11-12=-1613/752, 12-13=-1666/740,
 13-15=-1807/712, 15-16=-2683/929
 BOT CHORD 2-26=-691/2286, 25-26=-691/2286, 24-25=-691/2286, 23-24=-691/2286, 22-23=-691/2286,
 20-22=-691/2286, 18-20=-694/2294, 16-18=-694/2294
 WEBS 11-20=-327/982, 20-31=-920/469, 31-32=-910/468, 15-32=-896/455, 15-18=0/391,
 5-30=-903/465, 29-30=-879/453, 28-29=-881/452, 27-28=-898/465, 20-27=-910/466,
 5-24=-120/324


- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TC DL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
 - All plates are 2x4 MT20 unless otherwise indicated.
 - Gable studs spaced at 2-0-0 oc.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas with a clearance greater than 6-0-0 between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=16) 2=326, 16=326.




Job J0920-4182	Truss B1	Truss Type COMMON	Qty 7	Ply 1	Lot 9 Sierra Villas	E14133406
-------------------	-------------	----------------------	----------	----------	---------------------	-----------

Comtech, Inc, Fayetteville, NC - 28314,

8.330 s Feb 13 2020 MiTek Industries, Inc. Tue Mar 3 06:49:27 2020 Page 1
ID: eaaJ9i3ZGlbZ85c5RTUGb9zA_ID-ZxngnrUlcXNeJ1HHyDshmuC8iFwPzsTJM0Vpb1zeic



Scale = 1:49.1

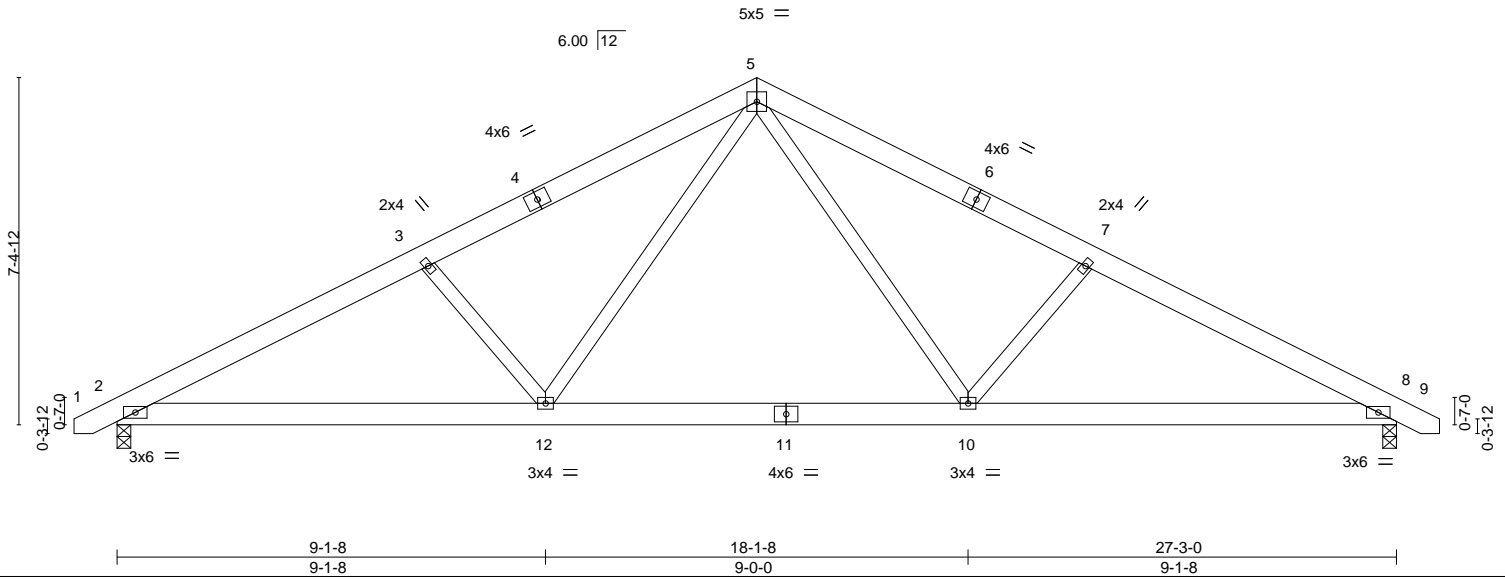

LOADING (psf)	SPACING-	CSL	DEFL.	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.20	in (loc) l/defl L/d	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.45	Vert(LL) -0.17 10-12 >999 360		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.22	Vert(CT) -0.23 10-12 >999 240		
BCDL 10.0	Rep Stress Incr YES	Matrix-S	Horz(CT) 0.04 8 n/a n/a		
	Code IRC2015/TPI2014		Wind(LL) 0.05 12 >999 240	Weight: 175 lb	FT = 20%

LUMBER-
 TOP CHORD 2x6 SP No.1
 BOT CHORD 2x6 SP No.1
 WEBS 2x4 SP No.2

BRACING-
 TOP CHORD Structural wood sheathing directly applied or 5-3-7 oc purlins.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (size) 2=0-3-8, 8=0-3-8
 Max Horz 2=145(LC 12)
 Max Uplift 2=-246(LC 12), 8=-246(LC 13)
 Max Grav 2=1189(LC 2), 8=1189(LC 2)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-3=-2121/698, 3-5=-1916/668, 5-7=-1916/668, 7-8=-2121/698
 BOT CHORD 2-12=-510/1820, 10-12=-194/1217, 8-10=-513/1820
 WEBS 5-10=-192/786, 7-10=-395/345, 5-12=-192/786, 3-12=-395/345

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TC DL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas with a clearance greater than 6-0-0 between the bottom chord and any other members, with BCDL = 10.0psf.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 2=246, 8=246.



March 3, 2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




818 Soundside Road
 Edenton, NC 27932


Job J0920-4182	Truss B1SG	Truss Type GABLE	Qty 1	Ply 1	Lot 9 Sierra Villas Job Reference (optional)	E14133407
-------------------	---------------	---------------------	----------	----------	---	-----------

Comtech, Inc., Fayetteville, NC - 28314,

8.330 s Feb 13 2020 MiTek Industries, Inc. Tue Mar 3 06:49:28 2020 Page 1
ID: eaaJ9i3ZGlbZ85c5RTUGb9zA_ID-27K2uBUwNrVvxBsTWxNwl6LLZfLxiKwtafFM7Tzeiib



Scale = 1:51.3

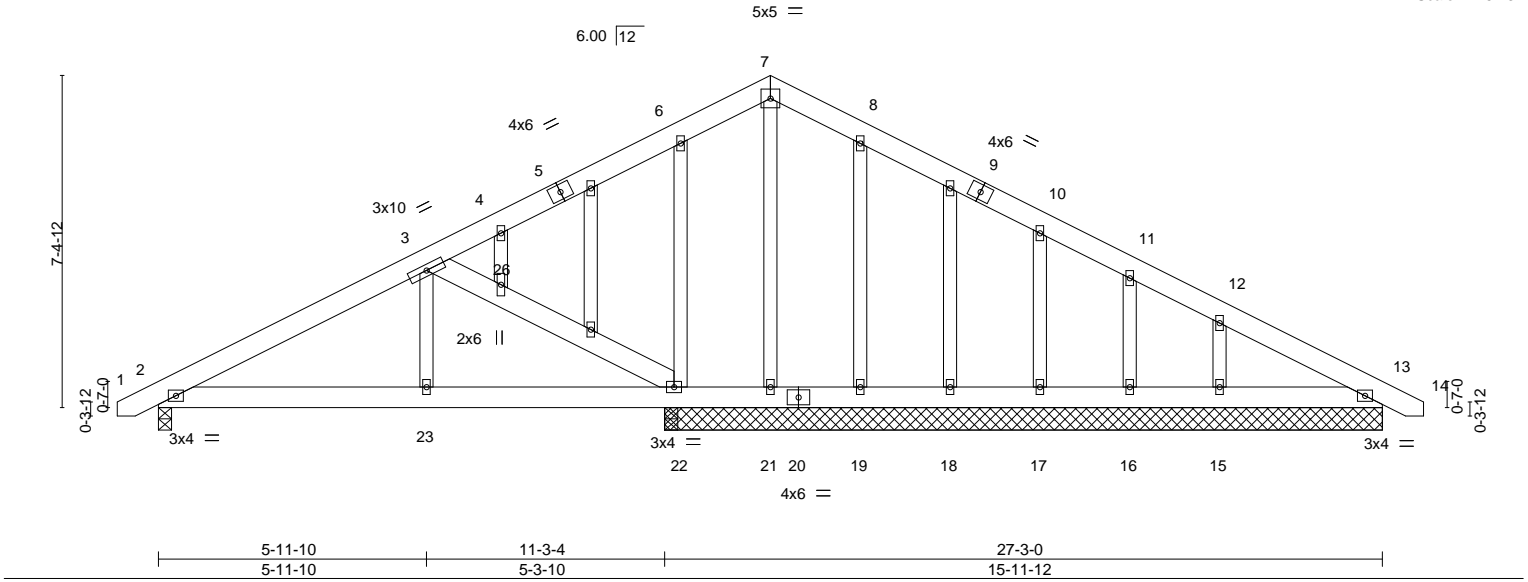


LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.12	in (loc) l/defl L/d	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.11	Vert(LL) -0.01 2-23 >999 360		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.15	Vert(CT) -0.02 2-23 >999 240		
BCDL 10.0	Rep Stress Incr YES	Matrix-S	Horz(CT) 0.00 22 n/a n/a		
	Code IRC2015/TPI2014		Wind(LL) 0.01 2-23 >999 240	Weight: 209 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x6 SP No.1	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD 2x6 SP No.1	BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing. Except:
WEBS 2x6 SP No.1 *Except* 3-23: 2x4 SP No.2	10-0-0 oc bracing: 2-23,22-23.
OTHERS 2x4 SP No.2	

REACTIONS. All bearings 15-11-12 except (jt=length) 2=0-3-8.
 (lb) - Max Horz 2=145(LC 16)
 Max Uplift All uplift 100 lb or less at joint(s) 2, 16 except 22=254(LC 12), 19=115(LC 13), 17=143(LC 13), 15=127(LC 13)
 Max Grav All reactions 250 lb or less at joint(s) 13, 18, 16 except 2=441(LC 1), 22=634(LC 23), 22=633(LC 1), 21=283(LC 22), 19=272(LC 2), 17=255(LC 24), 15=289(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-3=-485/172
 BOT CHORD 2-23=-108/364, 22-23=-108/364
 WEBS 3-26=-528/276, 22-26=-551/295, 3-23=0/253, 6-22=-254/198

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TC DL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
 - 4) All plates are 2x4 MT20 unless otherwise indicated.
 - 5) Gable studs spaced at 2-0-0 oc.
 - 6) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 7) * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas with a clearance greater than 6-0-0 between the bottom chord and any other members, with BCDL = 10.0psf.
 - 8) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 16 except (jt=lb) 22=254, 19=115, 17=143, 15=127.

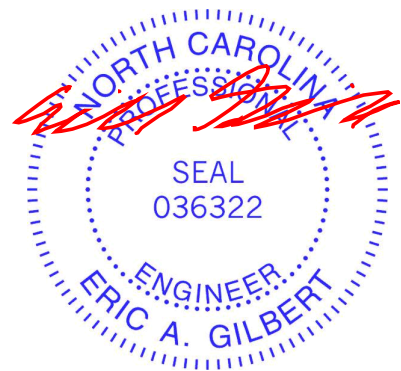


March 3, 2020

Job J0920-4182	Truss B2	Truss Type COMMON	Qty 2	Ply 1	Lot 9 Sierra Villas	E14133408
-------------------	-------------	----------------------	----------	----------	---------------------	-----------

Comtech, Inc., Fayetteville, NC - 28314,

8.330 s Feb 13 2020 MiTek Industries, Inc. Tue Mar 3 06:49:29 2020 Page 1
ID: eaaJ9i3ZGlbZ85c5RTUGb9zA_ID-WKuQ6XVZ88dLYLRg3eu9rJHUA3btRmR0pJ_vfzveiia

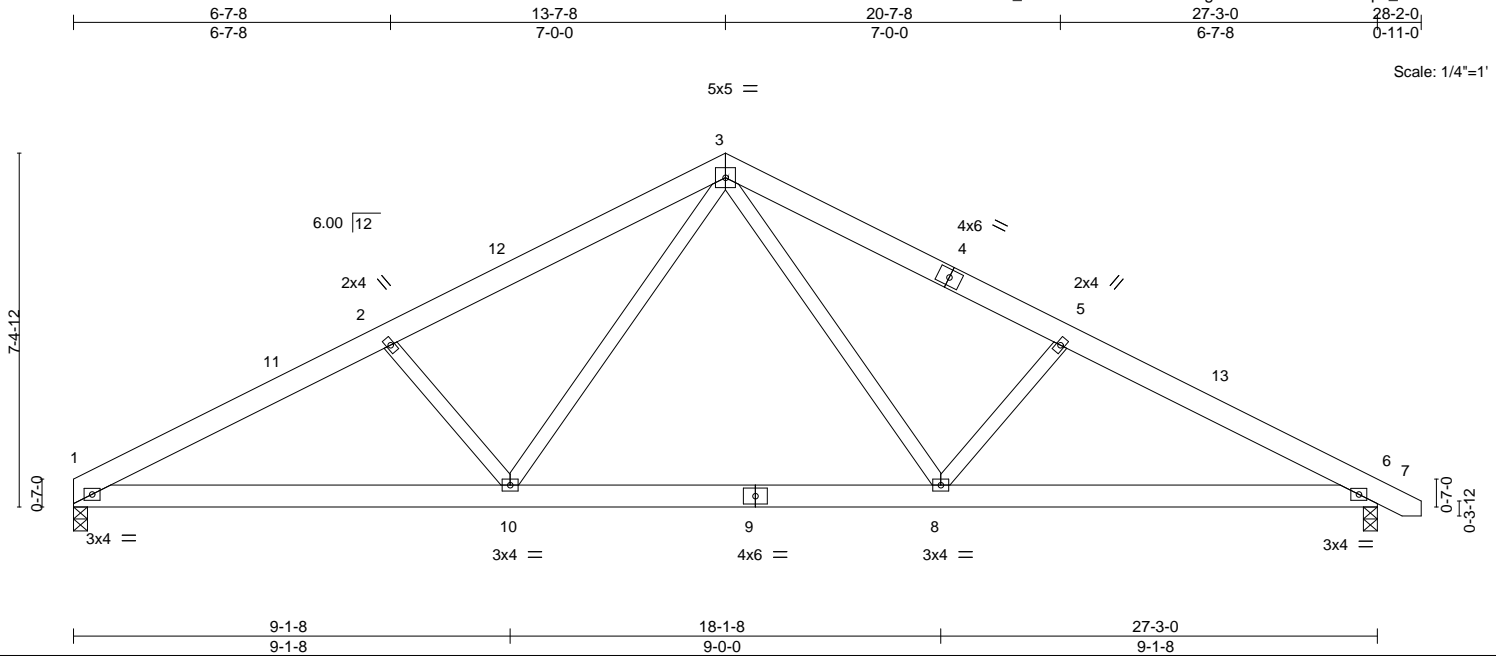

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.20	in (loc) l/defl L/d	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.45	Vert(LL) -0.17 8-10 >999 360		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.19	Vert(CT) -0.23 8-10 >999 240		
BCDL 10.0	Rep Stress Incr YES	Matrix-S	Horz(CT) 0.04 6 n/a n/a		
	Code IRC2015/TPI2014		Wind(LL) 0.03 8-10 >999 240	Weight: 173 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x6 SP No.1	TOP CHORD Structural wood sheathing directly applied or 5-3-6 oc purlins.
BOT CHORD 2x6 SP No.1	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.2	

REACTIONS. (size) 1=0-3-8, 6=0-3-8
 Max Horz 1=-94(LC 8)
 Max Uplift 1=-65(LC 12), 6=-77(LC 13)
 Max Grav 1=1145(LC 2), 6=1190(LC 2)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 1-2=-2110/469, 2-3=-1920/458, 3-5=-1917/437, 5-6=-2122/445
 BOT CHORD 1-10=-314/1863, 8-10=-100/1229, 6-8=-317/1821
 WEBS 3-8=-105/797, 5-8=-395/256, 3-10=-105/800, 2-10=-398/256


- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCCL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) 0-1-12 to 4-6-9, Interior(1) 4-6-9 to 13-7-8, Exterior(2) 13-7-8 to 18-0-5, Interior(1) 18-0-5 to 27-11-10 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas with a clearance greater than 6-0-0 between the bottom chord and any other members, with BCDL = 10.0psf.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 6.




March 3, 2020

Job J0920-4182	Truss C1	Truss Type COMMON	Qty 1	Ply 1	Lot 9 Sierra Villas	E14133409
Comtech, Inc., Fayetteville, NC - 28314,					Job Reference (optional)	

8.330 s Feb 13 2020 MiTek Industries, Inc. Tue Mar 3 06:49:30 2020 Page 1
ID: eaaJ9i3ZGlbZ85c5RTUGb9zA_ID_-_WSpJtWBU SICAV0sdMPONXqgsS19AGIA2zkTCMzeiiZ



Scale = 1:23.3

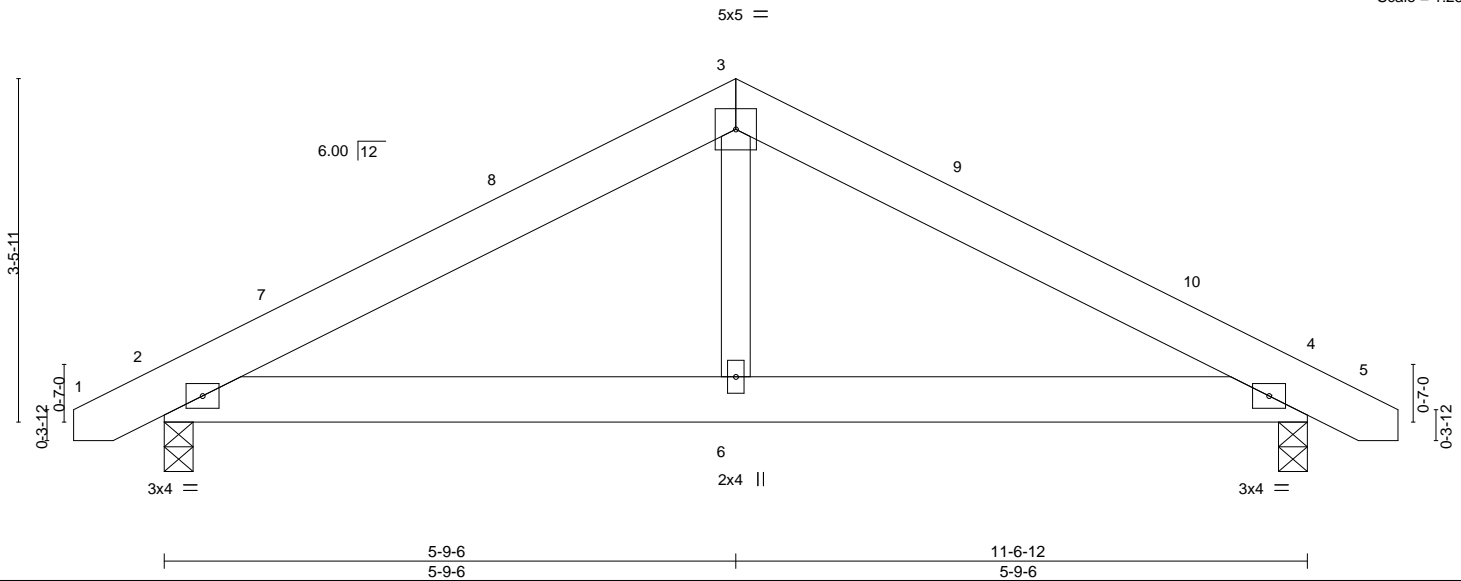

LOADING (psf)	SPACING-	CSL	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.14	Vert(LL) -0.01	2-6	>999	360	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.13	Vert(CT) -0.02	2-6	>999	240		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.06	Horz(CT) 0.00	4	n/a	n/a		
BCDL 10.0	Rep Stress Incr YES	Matrix-S	Wind(LL) 0.01	4-6	>999	240	Weight: 66 lb	FT = 20%
	Code IRC2015/TPI2014							

LUMBER-

TOP CHORD 2x6 SP No.1
BOT CHORD 2x6 SP No.1
WEBS 2x4 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.


(size) 2=0-3-8, 4=0-3-8
Max Horz 2=-42(LC 10)
Max Uplift 2=-39(LC 12), 4=-39(LC 13)
Max Grav 2=503(LC 1), 4=503(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-620/217, 3-4=-620/217
BOT CHORD 2-6=-77/481, 4-6=-77/481
WEBS 3-6=0/268

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCCL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) -0-8-10 to 3-8-3, Interior(1) 3-8-3 to 5-9-6, Exterior(2) 5-9-6 to 10-2-3, Interior(1) 10-2-3 to 12-3-6 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas with a clearance greater than 6-0-0 between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 4.

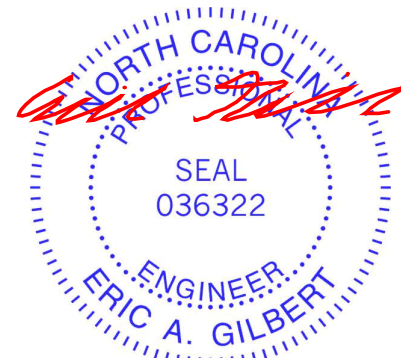

March 3, 2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




818 Soundside Road
Edenton, NC 27932


Job J0920-4182	Truss C1GE	Truss Type COMMON SUPPORTED GAB	Qty 1	Ply 1	Lot 9 Sierra Villas	E14133410
-------------------	---------------	------------------------------------	----------	----------	---------------------	-----------

Comtech, Inc., Fayetteville, NC - 28314,

8.330 s Feb 13 2020 MiTek Industries, Inc. Tue Mar 3 06:49:31 2020 Page 1
ID: eaaJ9i3ZGlbZ85c5RTUGb9zA_ID-Si0BXDXpfmt3ofb2B3wdwkMtUsOCvicJGdT0kozeiiY



Scale = 1:22.7

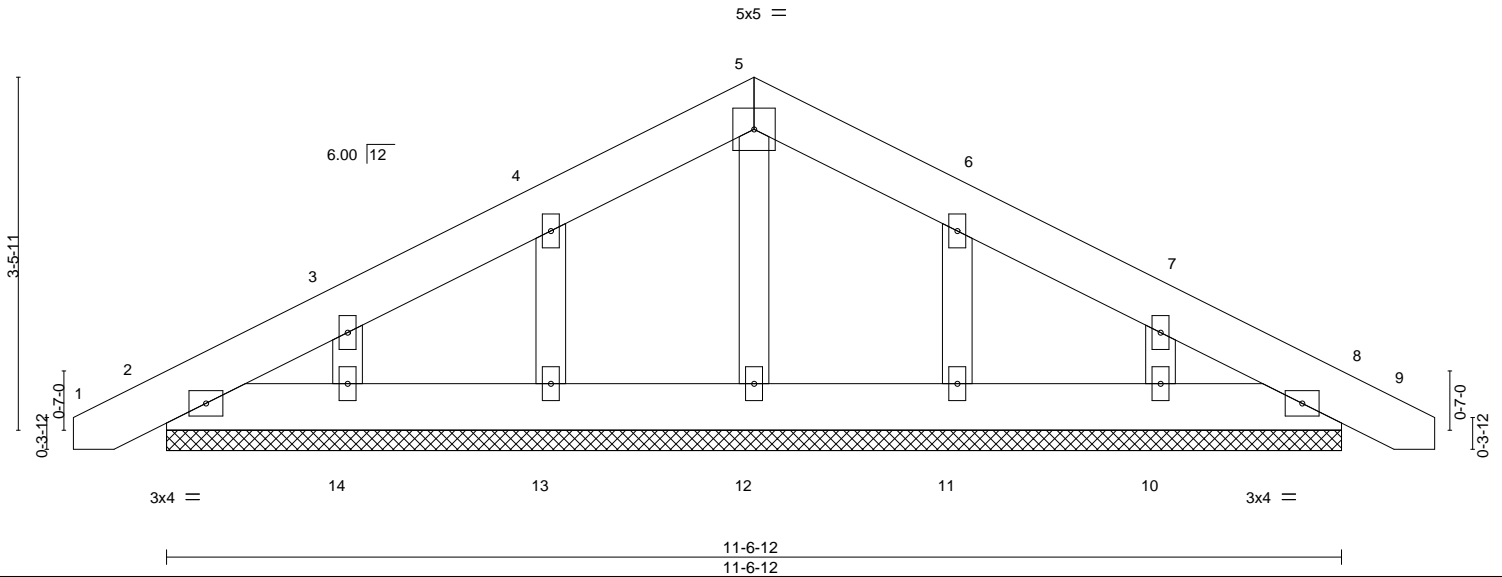

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.15	TC 0.02	Vert(LL)	-0.00	8	n/r	120	MT20	244/190
TCDL 10.0	Lumber DOL	1.15	BC 0.01	Vert(CT)	0.00	8	n/r	120		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.02	Horz(CT)	0.00	8	n/a	n/a		
BCDL 10.0	Code	IRC2015/TPI2014	Matrix-S						Weight: 73 lb	FT = 20%

LUMBER-
TOP CHORD 2x6 SP No.1
BOT CHORD 2x6 SP No.1
OTHERS 2x4 SP No.2


BRACING-
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. All bearings 11-6-12.
(lb) - Max Horz 2=66(LC 17)
Max Uplift All uplift 100 lb or less at joint(s) 2, 8, 13, 14, 11, 10
Max Grav All reactions 250 lb or less at joint(s) 2, 8, 12, 13, 14, 11, 10

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- All plates are 2x4 MT20 unless otherwise indicated.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 2-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas with a clearance greater than 6-0-0 between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 8, 13, 14, 11, 10.
- Beveled plate or shim required to provide full bearing surface with truss chord at joint(s) 8.

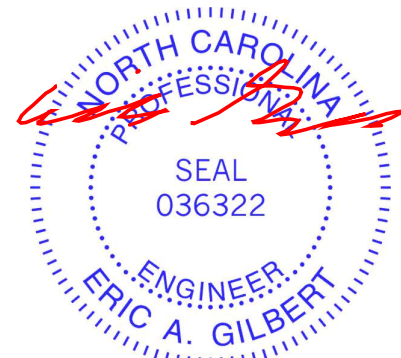

March 3, 2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



818 Soundside Road
Edenton, NC 27932

Job J0920-4182	Truss D1	Truss Type MONOPITCH	Qty 7	Ply 1	Lot 9 Sierra Villas Job Reference (optional)	E14133411
-------------------	-------------	-------------------------	----------	----------	---	-----------

Comtech, Inc., Fayetteville, NC - 28314,

8.330 s Feb 13 2020 MiTek Industries, Inc. Tue Mar 3 06:49:32 2020 Page 1
ID: eaaJ9i3ZGlbZ85c5RTUGb9zA_ID-wvaZkYXRQ30wPoAElnRsTyv1dGiFe4DSVHDaGEzeiiX

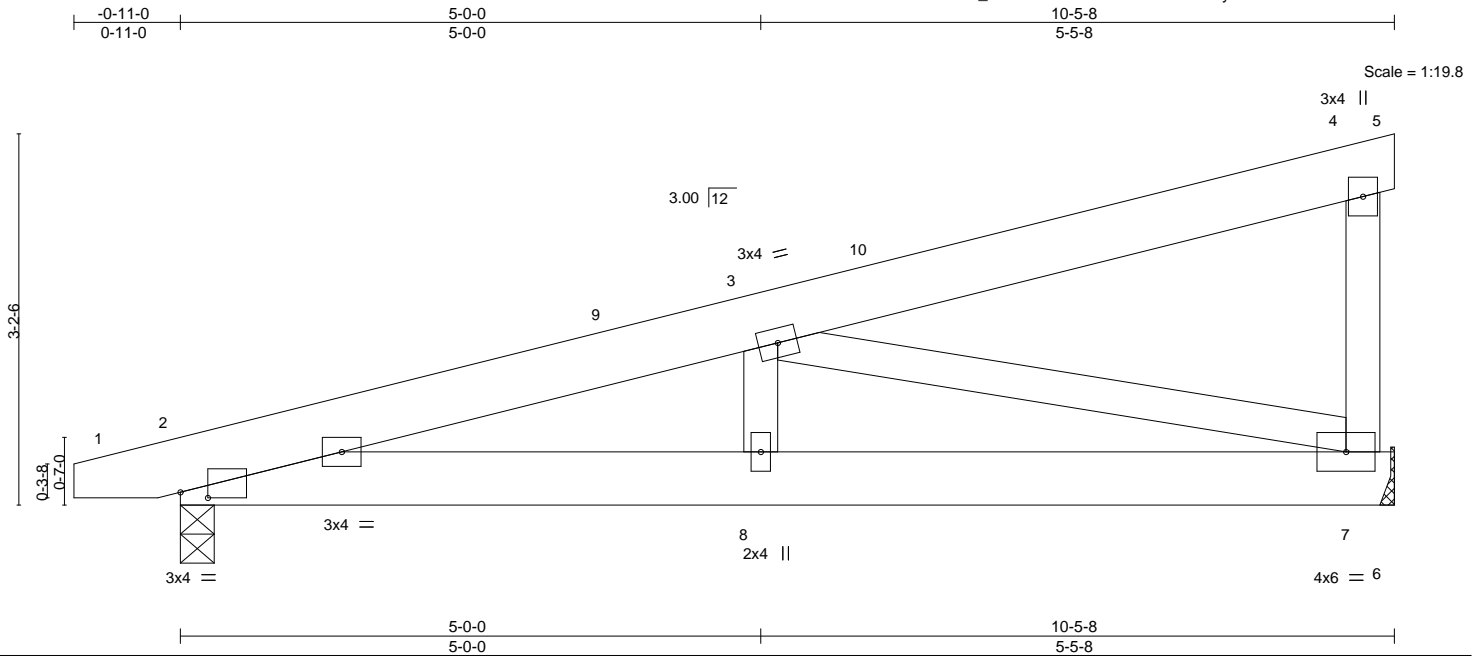


Plate Offsets (X,Y)-- [2:0-2-13,0-0-9]

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.15	TC 0.12	Vert(LL) -0.02	8	>999	360	MT20	244/190
TCDL 10.0	Lumber DOL 1.15	BC 0.15	Vert(CT) -0.03	8	>999	240		
BCLL 0.0 *	Rep Stress Incr YES	WB 0.38	Horz(CT) 0.01	7	n/a	n/a		
BCDL 10.0	Code IRC2015/TPI2014	Matrix-S	Wind(LL) 0.01	8	>999	240		
							Weight: 64 lb	FT = 20%

LUMBER-

TOP CHORD 2x6 SP No.1
BOT CHORD 2x6 SP No.1
WEBS 2x4 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.


(size) 7=Mechanical, 2=0-3-8
Max Horz 2=90(LC 8)
Max Uplift 7=-55(LC 12), 2=-57(LC 8)
Max Grav 7=411(LC 1), 2=445(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-855/165
BOT CHORD 2-8=-254/789, 7-8=-254/789
WEBS 3-7=-787/250

NOTES-

- 1) Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) -0-6-11 to 3-10-2, Interior(1) 3-10-2 to 10-5-8 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas with a clearance greater than 6-0-0 between the bottom chord and any other members.
- 4) Refer to girder(s) for truss to truss connections.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 7, 2.

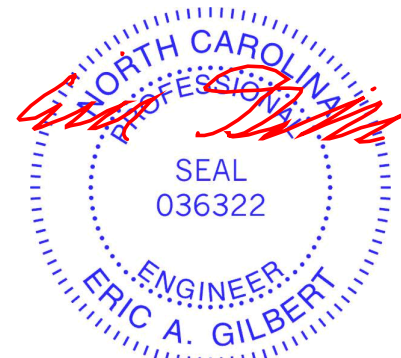

March 3, 2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



818 Soundside Road
Edenton, NC 27932


Job J0920-4182	Truss D1GE	Truss Type MONOPITCH SUPPORTED	Qty 1	Ply 1	Lot 9 Sierra Villas	E14133412
-------------------	---------------	-----------------------------------	----------	----------	---------------------	-----------

Comtech, Inc., Fayetteville, NC - 28314,

8.330 s Feb 13 2020 MiTek Industries, Inc. Tue Mar 3 06:49:33 2020 Page 1
 ID: eaaJ9i3ZGlbZ85c5RTUGb9zA_ID-O58xxuY3BN8n1yIRIUz5?9SDkg4VNc1ckxy7ohzeiiW

0-11-0
0-11-0

10-5-8
10-5-8

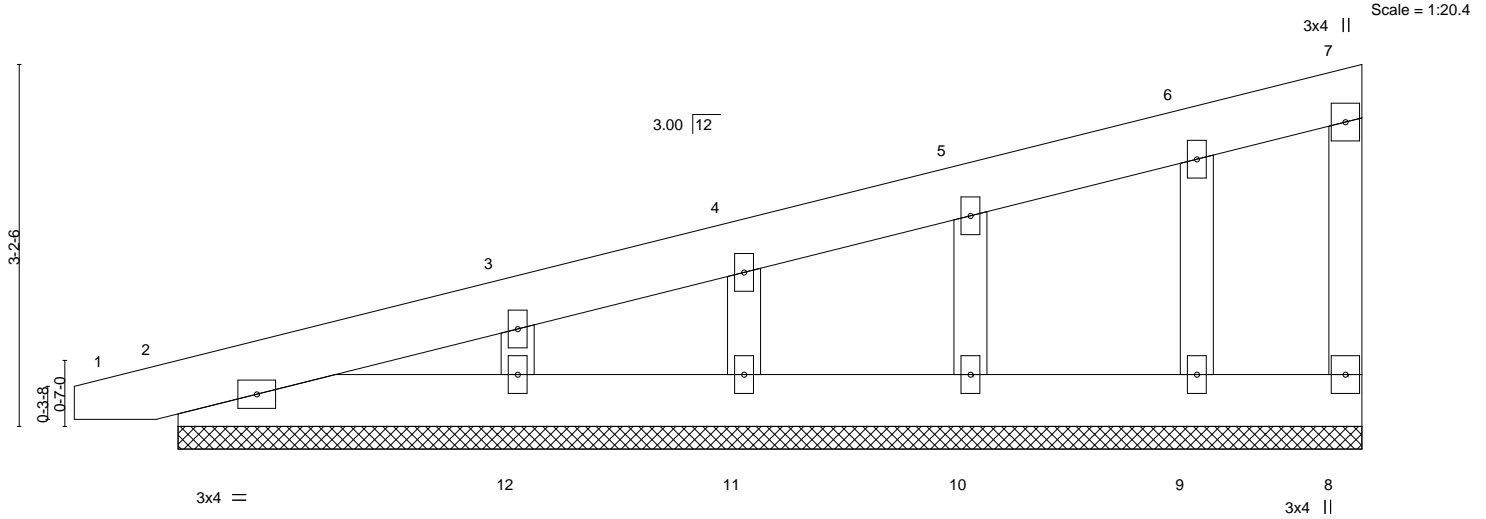

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.15	TC 0.03	Vert(LL) -0.00	1	n/r	120	MT20	244/190
TCDL 10.0	Lumber DOL 1.15	BC 0.02	Vert(CT) 0.00	1	n/r	120		
BCLL 0.0 *	Rep Stress Incr YES	WB 0.03	Horz(CT) -0.00	8	n/a	n/a		
BCDL 10.0	Code IRC2015/TPI2014	Matrix-S					Weight: 62 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x6 SP No.1	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x6 SP No.1	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.2	
OTHERS 2x4 SP No.2	

REACTIONS. All bearings 10-5-8.
 (lb) - Max Horz 2=128(LC 8)
 Max Uplift All uplift 100 lb or less at joint(s) 8, 2, 9, 10, 11, 12
 Max Grav All reactions 250 lb or less at joint(s) 8, 2, 9, 10, 11, 12

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-**
- 1) Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 2) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
 - 3) All plates are 2x4 MT20 unless otherwise indicated.
 - 4) Gable requires continuous bottom chord bearing.
 - 5) Gable studs spaced at 2-0-0 oc.
 - 6) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 7) * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas with a clearance greater than 6-0-0 between the bottom chord and any other members.
 - 8) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 8, 2, 9, 10, 11, 12.
 - 9) Beveled plate or shim required to provide full bearing surface with truss chord at joint(s) 2.



March 3, 2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



818 Soundside Road
Edenton, NC 27932

Job J0920-4182	Truss D2	Truss Type HALF HIP	Qty 5	Ply 1	Lot 9 Sierra Villas	E14133413
Comtech, Inc., Fayetteville, NC - 28314,					Job Reference (optional)	

8.330 s Feb 13 2020 MiTek Industries, Inc. Tue Mar 3 06:49:34 2020 Page 1
ID: eaaJ9i3ZGlbZ85c5RTUGb9zA_ID-sHiJ9EZhyhGef6KdsCUKYN_Jq4KO605IzbigL7zeiIV



Scale = 1:19.5

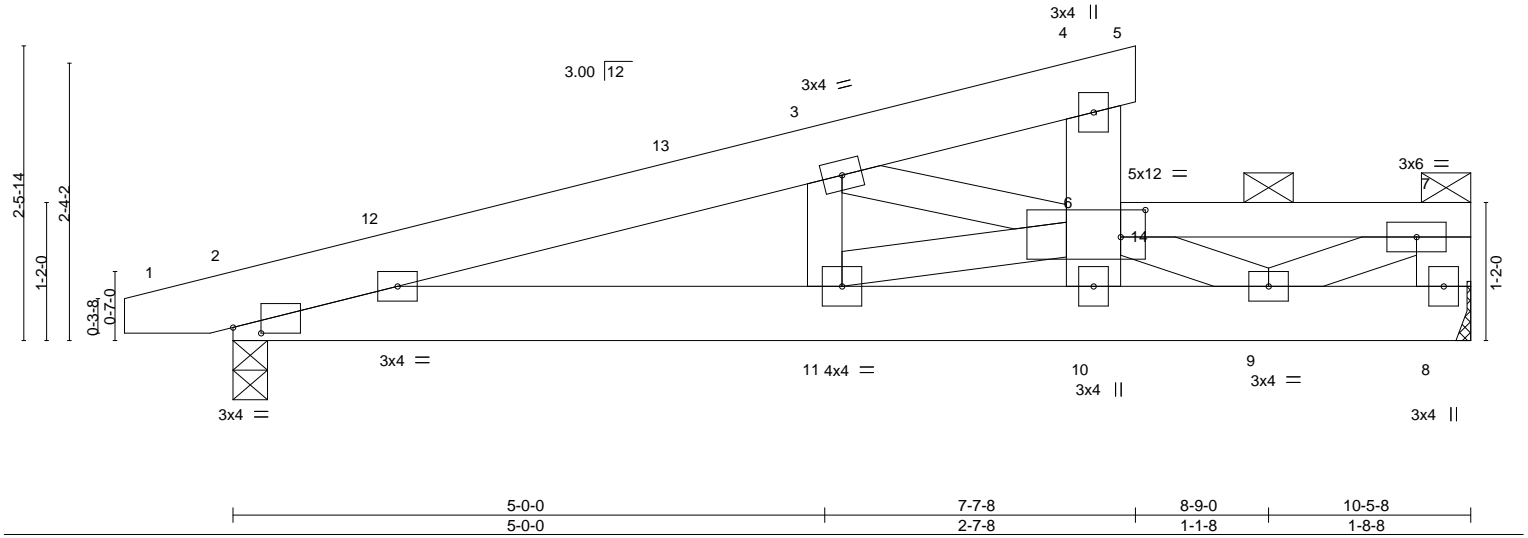


Plate Offsets (X,Y)--	[2:0-2-13,0-0-9], [6:0-2-8,0-2-12]				
LOADING (psf)	SPACING- 2-0-0	CSI.	DEFL. in (loc) l/defl L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.15	TC 0.33	Vert(LL) -0.02 10-11 >999 360	MT20	244/190
TCDL 10.0	Lumber DOL 1.15	BC 0.36	Vert(CT) -0.05 10-11 >999 240		
BCLL 0.0 *	Rep Stress Incr NO	WB 0.23	Horz(CT) 0.01 8 n/a n/a		
BCDL 10.0	Code IRC2015/TPI2014	Matrix-S	Wind(LL) 0.03 10-11 >999 240	Weight: 65 lb	FT = 20%


LUMBER-	BRACING-
TOP CHORD 2x6 SP No.1 *Except* 6-7: 2x4 SP No.1	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals, and 2-0-0 oc purlins (5-7-12 max.): 4-10, 6-7.
BOT CHORD 2x6 SP No.1	Except: 6-0-0 oc bracing: 4-6
WEBS 2x4 SP No.2 *Except* 4-10,7-8: 2x6 SP No.1	BOT CHORD Rigid ceiling directly applied or 8-6-11 oc bracing.

REACTIONS. (size) 8=Mechanical, 2=0-3-8
Max Horz 2=11(LC 12)
Max Uplift 8=-17(LC 9), 2=-62(LC 8)
Max Grav 8=846(LC 19), 2=554(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-1230/434, 3-4=-307/81, 6-7=-1087/428, 7-8=-715/258
BOT CHORD 2-11=-548/1145, 10-11=-662/1504, 9-10=-839/1992
WEBS 3-11=-25/328, 3-6=-886/408, 6-11=-476/133, 6-9=-1027/466, 7-9=-394/960

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) -0-6-11 to 3-10-2, Interior(1) 3-10-2 to 10-2-12 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Provide adequate drainage to prevent water ponding.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas with a clearance greater than 6-0-0 between the bottom chord and any other members.
 - Refer to girder(s) for truss to truss connections.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 8, 2.
 - Load case(s) 1, 2, 3, 4, 5, 6, 7, 8, 9, 10, 11, 12, 13, 14, 15, 16, 17, 18, 19, 20, 21, 22, 23, 24, 25, 26 has/have been modified. Building designer must review loads to verify that they are correct for the intended use of this truss.
 - Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
 - Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s). The design/selection of such connection device(s) is the responsibility of others.
 - In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard
1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (plf)
Vert: 1-4=-60, 4-5=-60, 6-14=-40(F=-20), 7-14=-80(F=-20), 2-8=-20

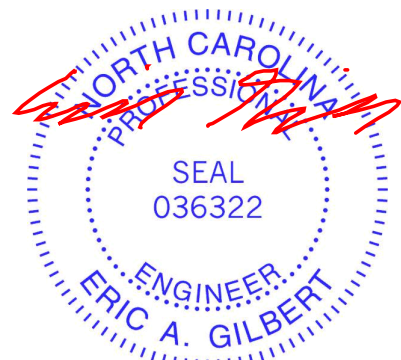

March 3, 2020

Job	Truss	Truss Type	Qty	Ply	Lot 9 Sierra Villas	E14133413
J0920-4182	D2	HALF HIP	5	1	Job Reference (optional)	

Comtech, Inc., Fayetteville, NC - 28314,

8.330 s Feb 13 2020 MiTek Industries, Inc. Tue Mar 3 06:49:34 2020 Page 2
ID: eaaJ9i3ZGlbZ85c5RTUGb9zA_ID-sHiJ9EZhyhGef6KdsCUKYN_Jq4KO605IzbigL7zeiV

LOAD CASE(S) Standard

- Concentrated Loads (lb)
Vert: 14=-400
- 2) Dead + 0.75 Roof Live (balanced) + 0.75 Attic Floor: Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (plf)
Vert: 1-4=-50, 4-5=-50, 6-14=-100(F=-80), 7-14=-130(F=-80), 2-8=-20
Concentrated Loads (lb)
Vert: 14=-350
- 3) Dead + Uninhabitable Attic Without Storage: Lumber Increase=1.25, Plate Increase=1.25
Uniform Loads (plf)
Vert: 1-4=-20, 4-5=-20, 6-7=-40(F=-20), 2-8=-40
Concentrated Loads (lb)
Vert: 14=-300
- 4) Dead + 0.6 C-C Wind (Pos. Internal) Case 1: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=70, 2-13=48, 4-13=26, 4-5=153, 6-7=10(F=-20), 2-8=-12
Horz: 1-2=-82, 2-13=-60, 4-13=-38, 4-5=-165, 4-6=-51
Concentrated Loads (lb)
Vert: 14=180
- 5) Dead + 0.6 C-C Wind (Pos. Internal) Case 2: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=20, 2-12=26, 4-12=48, 4-5=41, 6-7=27(F=-20), 2-8=-12
Horz: 1-2=-32, 2-12=-38, 4-12=-60, 4-5=-53, 4-6=-51
Concentrated Loads (lb)
Vert: 14=180
- 6) Dead + 0.6 C-C Wind (Neg. Internal) Case 1: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-5, 2-4=-41, 4-5=9, 6-7=-56(F=-20), 2-8=-20
Horz: 1-2=-15, 2-4=21, 4-5=-29, 4-6=47
Concentrated Loads (lb)
Vert: 14=-402
- 7) Dead + 0.6 C-C Wind (Neg. Internal) Case 2: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-35, 2-4=-41, 4-5=-35, 6-7=-56(F=-20), 2-8=-20
Horz: 1-2=15, 2-4=21, 4-5=15, 4-6=47
Concentrated Loads (lb)
Vert: 14=-402
- 8) Dead + 0.6 MWFRS Wind (Pos. Internal) Left: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=36, 2-4=21, 4-5=14, 6-7=-11(F=-20), 2-8=-12
Horz: 1-2=-48, 2-4=-33, 4-5=-26, 4-6=7
Concentrated Loads (lb)
Vert: 14=43
- 9) Dead + 0.6 MWFRS Wind (Pos. Internal) Right: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=4, 2-4=11, 4-5=27, 6-7=1(F=-20), 2-8=-12
Horz: 1-2=-16, 2-4=-23, 4-5=-39, 4-6=-27
Concentrated Loads (lb)
Vert: 14=43
- 10) Dead + 0.6 MWFRS Wind (Neg. Internal) Left: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=6, 2-4=-1, 4-5=6, 6-7=-33(F=-20), 2-8=-20
Horz: 1-2=-26, 2-4=-19, 4-5=-26, 4-6=34
Concentrated Loads (lb)
Vert: 14=-339
- 11) Dead + 0.6 MWFRS Wind (Neg. Internal) Right: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-4, 2-4=-10, 4-5=-4, 6-7=-21(F=-20), 2-8=-20
Horz: 1-2=-16, 2-4=-10, 4-5=-16, 4-6=0
Concentrated Loads (lb)
Vert: 14=-234
- 12) Dead + 0.6 MWFRS Wind (Pos. Internal) 1st Parallel: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=14, 2-4=21, 4-5=14, 6-7=-11(F=-20), 2-8=-12
Horz: 1-2=-26, 2-4=-33, 4-5=-26, 4-6=-39
Concentrated Loads (lb)
Vert: 14=43
- 13) Dead + 0.6 MWFRS Wind (Pos. Internal) 2nd Parallel: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=2, 2-4=9, 4-5=2, 6-7=1(F=-20), 2-8=-12
Horz: 1-2=-14, 2-4=-21, 4-5=-14, 4-6=-27
Concentrated Loads (lb)
Vert: 14=43
- 14) Dead + 0.6 MWFRS Wind (Pos. Internal) 3rd Parallel: Lumber Increase=1.60, Plate Increase=1.60

Continued on page 3

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



818 Soundside Road
Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	Lot 9 Sierra Villas	E14133413
J0920-4182	D2	HALF HIP	5	1	Job Reference (optional)	

Comtech, Inc., Fayetteville, NC - 28314,

8.330 s Feb 13 2020 MiTek Industries, Inc. Tue Mar 3 06:49:34 2020 Page 3
ID: eaaJ9i3ZGlbZ85c5RTUGb9za_ID-sHiJ9EZhyhGef6KdsCUKYN_Jq4KO605IzbigL7zeiV

LOAD CASE(S) Standard

- Uniform Loads (plf)
Vert: 1-2=14, 2-4=21, 4-5=14, 6-7=11(F=-20), 2-8=-12
Horz: 1-2=-26, 2-4=-33, 4-5=-26, 4-6=-39
- Concentrated Loads (lb)
Vert: 14=43
- 15) Dead + 0.6 MWFRS Wind (Pos. Internal) 4th Parallel: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=2, 2-4=9, 4-5=2, 6-7=1(F=-20), 2-8=-12
Horz: 1-2=-14, 2-4=-21, 4-5=-14, 4-6=-27
Concentrated Loads (lb)
Vert: 14=43
- 16) Dead + 0.6 MWFRS Wind (Neg. Internal) 1st Parallel: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=6, 2-4=-1, 4-5=6, 6-7=-33(F=-20), 2-8=-20
Horz: 1-2=-26, 2-4=-19, 4-5=-26, 4-6=-12
Concentrated Loads (lb)
Vert: 14=-234
- 17) Dead + 0.6 MWFRS Wind (Neg. Internal) 2nd Parallel: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-6, 2-4=-13, 4-5=-6, 6-7=-21(F=-20), 2-8=-20
Horz: 1-2=-14, 2-4=-7, 4-5=-14, 4-6=-0
Concentrated Loads (lb)
Vert: 14=-234
- 18) Dead: Lumber Increase=0.90, Plate Increase=0.90 Plt. metal=0.90
Uniform Loads (plf)
Vert: 1-4=-20, 4-5=-20, 6-7=-120(F=-100), 2-8=-20
Concentrated Loads (lb)
Vert: 14=-200
- 19) Dead + 0.75 Roof Live (bal.) + 0.75 Attic Floor + 0.75(0.6 MWFRS Wind (Neg. Int) Left): Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-31, 2-4=-36, 4-5=-31, 6-14=-95(F=80), 7-14=-125(F=-80), 2-8=-20
Horz: 1-2=-19, 2-4=-14, 4-5=-19, 4-6=26
Concentrated Loads (lb)
Vert: 14=-454
- 20) Dead + 0.75 Roof Live (bal.) + 0.75 Attic Floor + 0.75(0.6 MWFRS Wind (Neg. Int) Right): Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-38, 2-4=-43, 4-5=-38, 6-14=-86(F=80), 7-14=-116(F=-80), 2-8=-20
Horz: 1-2=-12, 2-4=-7, 4-5=-12, 4-6=-0
Concentrated Loads (lb)
Vert: 14=-375
- 21) Dead + 0.75 Roof Live (bal.) + 0.75 Attic Floor + 0.75(0.6 MWFRS Wind (Neg. Int) 1st Parallel): Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-31, 2-4=-36, 4-5=-31, 6-14=-95(F=80), 7-14=-125(F=-80), 2-8=-20
Horz: 1-2=-19, 2-4=-14, 4-5=-19, 4-6=-9
Concentrated Loads (lb)
Vert: 14=-375
- 22) Dead + 0.75 Roof Live (bal.) + 0.75 Attic Floor + 0.75(0.6 MWFRS Wind (Neg. Int) 2nd Parallel): Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-40, 2-4=-45, 4-5=-40, 6-14=-86(F=80), 7-14=-116(F=-80), 2-8=-20
Horz: 1-2=-10, 2-4=-5, 4-5=-10, 4-6=-0
Concentrated Loads (lb)
Vert: 14=-375
- 23) 1st Dead + Roof Live (unbalanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (plf)
Vert: 1-4=-60, 4-5=-60, 6-7=-40(F=-20), 2-8=-20
Concentrated Loads (lb)
Vert: 14=-400
- 24) 2nd Dead + Roof Live (unbalanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (plf)
Vert: 1-4=-20, 4-5=-20, 6-14=-40(F=-20), 7-14=-80(F=-20), 2-8=-20
Concentrated Loads (lb)
Vert: 14=-400
- 25) 3rd Dead + 0.75 Roof Live (unbalanced) + 0.75 Attic Floor: Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (plf)
Vert: 1-4=-50, 4-5=-50, 6-7=-100(F=-80), 2-8=-20
Concentrated Loads (lb)
Vert: 14=-350
- 26) 4th Dead + 0.75 Roof Live (unbalanced) + 0.75 Attic Floor: Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (plf)
Vert: 1-4=-20, 4-5=-20, 6-14=-100(F=-80), 7-14=-130(F=-80), 2-8=-20
Concentrated Loads (lb)
Vert: 14=-350

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




818 Soundside Road
Edenton, NC 27932


Job J0920-4182	Truss D2-GR	Truss Type HALF HIP	Qty 1	Ply 2	Lot 9 Sierra Villas	E14133414
-------------------	----------------	------------------------	----------	----------	---------------------	-----------

Comtech, Inc., Fayetteville, NC - 28314,

8.330 s Feb 13 2020 MiTek Industries, Inc. Tue Mar 3 06:49:36 2020 Page 1
ID: eaaJ9i3ZGlbZ85c5RTUGb9zA_ID-pgp4awbyUIWMuQT0_cWodo4g4t2gaxx2QvBnP?zeiT



Scale = 1:19.5

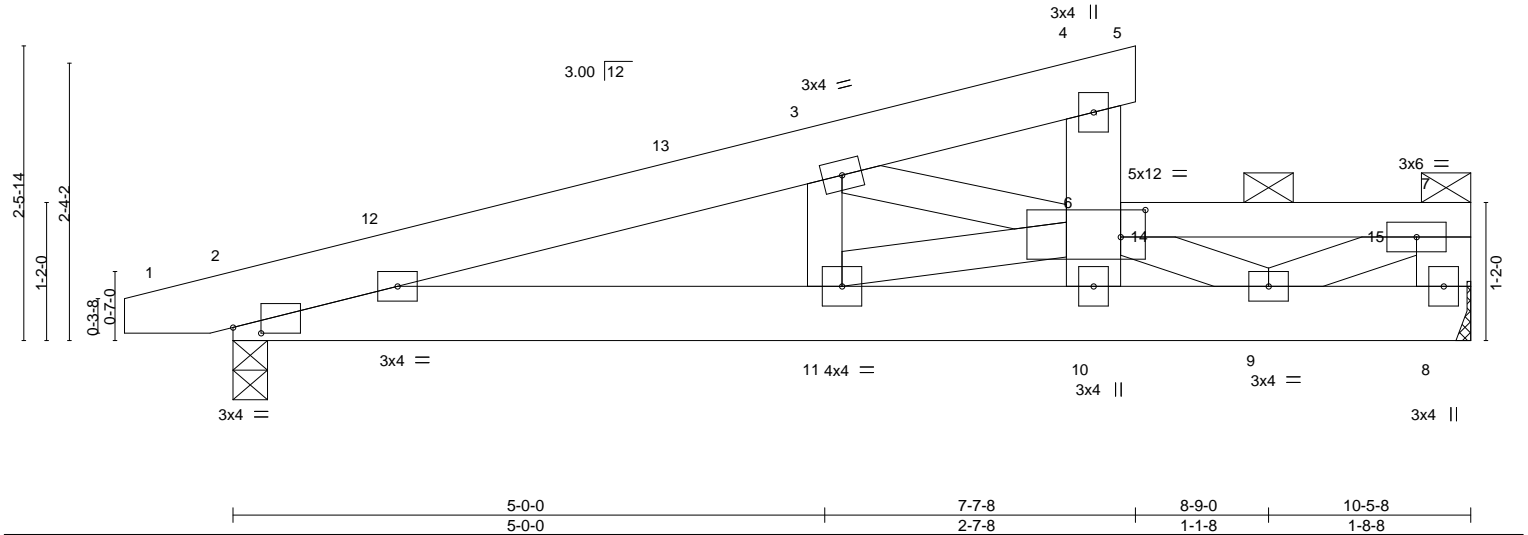

LOADING (psf)	SPACING-	CSL	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.15	TC 0.28	Vert(LL) -0.01	11	>999	360	MT20	244/190
TCDL 10.0	Lumber DOL 1.15	BC 0.25	Vert(CT) -0.03	10-11	>999	240		
BCLL 0.0 *	Rep Stress Incr NO	WB 0.14	Horz(CT) 0.01	8	n/a	n/a		
BCDL 10.0	Code IRC2015/TPI2014	Matrix-S	Wind(LL) 0.01	11	>999	240		
							Weight: 130 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x6 SP No.1 *Except* 6-7: 2x4 SP No.1	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 4-10, 6-7. Except:
BOT CHORD 2x6 SP No.1	6-0-0 oc bracing: 4-6
WEBS 2x4 SP No.2 *Except* 4-10,7-8: 2x6 SP No.1	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (size) 8=Mechanical, 2=0-3-8
 Max Horz 2=11(LC 12)
 Max Uplift 2=-12(LC 8)
 Max Grav 8=1690(LC 19), 2=628(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-3=-1495/95, 3-4=-385/0, 6-7=-1536/0, 7-8=-1506/0
 BOT CHORD 2-11=-222/1399, 10-11=-48/2011, 9-10=0/2731, 8-9=0/481
 WEBS 3-11=0/449, 3-6=-1067/184, 6-11=-732/0, 6-9=-1356/31, 7-9=-13/1196

- NOTES-**
- 2-ply truss to be connected together with 10d (0.131"x3") nails as follows:
 Top chords connected as follows: 2x6 - 2 rows staggered at 0-9-0 oc, 2x4 - 1 row at 0-8-0 oc.
 Bottom chords connected as follows: 2x6 - 2 rows staggered at 0-9-0 oc.
 Webs connected as follows: 2x4 - 1 row at 0-9-0 oc.
 - All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
 - Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) -0-6-11 to 3-10-2, Interior(1) 3-10-2 to 10-2-12 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Provide adequate drainage to prevent water ponding.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas with a clearance greater than 6-0-0 between the bottom chord and any other members.
 - Refer to girder(s) for truss to truss connections.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2.
 - Load case(s) 1, 2, 3, 4, 5, 6, 7, 8, 9, 10, 11, 12, 13, 14, 15, 16, 17, 18, 19, 20, 21, 22, 23, 24, 25, 26 has/have been modified.
 Building designer must review loads to verify that they are correct for the intended use of this truss.
 - Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
 - Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) . The design/selection of such connection device(s) is the responsibility of others.

LOAD CASE(S) Standard
 Continued on page 2



March 3, 2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ENGINEERING BY
TRENCO
 A MiTek Affiliate

818 Soundside Road
 Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	Lot 9 Sierra Villas	E14133414
J0920-4182	D2-GR	HALF HIP	1	2	Job Reference (optional)	

Comtech, Inc., Fayetteville, NC - 28314,

8.330 s Feb 13 2020 MiTek Industries, Inc. Tue Mar 3 06:49:36 2020 Page 2
ID: eaaJ9i3ZGlbZ85c5RTUGb9zA_ID-pgp4awbyUIWMuQT0_cWodo4g4t2gaxx2QvBnP?zeiT

LOAD CASE(S) Standard

- 1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (plf)
Vert: 1-4=-60, 4-5=-60, 6-14=-160(F=-140), 7-14=-200(F=-140), 2-8=-20
Concentrated Loads (lb)
Vert: 14=-400 15=-500
- 2) Dead + 0.75 Roof Live (balanced) + 0.75 Attic Floor: Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (plf)
Vert: 1-4=-50, 4-5=-50, 6-14=-220(F=-200), 7-14=-250(F=-200), 2-8=-20
Concentrated Loads (lb)
Vert: 14=-350 15=-438
- 3) Dead + Uninhabitable Attic Without Storage: Lumber Increase=1.25, Plate Increase=1.25
Uniform Loads (plf)
Vert: 1-4=-20, 4-5=-20, 6-7=-160(F=-140), 2-8=-40
Concentrated Loads (lb)
Vert: 14=-300 15=-375
- 4) Dead + 0.6 C-C Wind (Pos. Internal) Case 1: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=70, 2-13=48, 4-13=26, 4-5=153, 6-7=-110(F=-140), 2-8=-12
Horz: 1-2=-82, 2-13=-60, 4-13=-38, 4-5=-165, 4-6=-51
- 5) Dead + 0.6 C-C Wind (Pos. Internal) Case 2: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=20, 2-12=26, 4-12=48, 4-5=41, 6-7=-93(F=-140), 2-8=-12
Horz: 1-2=-32, 2-12=-38, 4-12=-60, 4-5=-53, 4-6=-51
- 6) Dead + 0.6 C-C Wind (Neg. Internal) Case 1: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-5, 2-4=-41, 4-5=9, 6-7=-176(F=-140), 2-8=-20
Horz: 1-2=-15, 2-4=21, 4-5=-29, 4-6=47
- 7) Dead + 0.6 C-C Wind (Neg. Internal) Case 2: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-35, 2-4=-41, 4-5=-35, 6-7=-176(F=-140), 2-8=-20
Horz: 1-2=15, 2-4=21, 4-5=15, 4-6=47
- 8) Dead + 0.6 MWFRS Wind (Pos. Internal) Left: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=36, 2-4=21, 4-5=14, 6-7=-131(F=-140), 2-8=-12
Horz: 1-2=-48, 2-4=-33, 4-5=-26, 4-6=7
Concentrated Loads (lb)
Vert: 14=43 15=54
- 9) Dead + 0.6 MWFRS Wind (Pos. Internal) Right: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=4, 2-4=11, 4-5=27, 6-7=-119(F=-140), 2-8=-12
Horz: 1-2=-16, 2-4=-23, 4-5=-39, 4-6=-27
Concentrated Loads (lb)
Vert: 14=43 15=54
- 10) Dead + 0.6 MWFRS Wind (Neg. Internal) Left: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=6, 2-4=-1, 4-5=6, 6-7=-153(F=-140), 2-8=-20
Horz: 1-2=-26, 2-4=-19, 4-5=-26, 4-6=34
Concentrated Loads (lb)
Vert: 14=-339 15=-423
- 11) Dead + 0.6 MWFRS Wind (Neg. Internal) Right: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-4, 2-4=-10, 4-5=-4, 6-7=-141(F=-140), 2-8=-20
Horz: 1-2=-16, 2-4=-10, 4-5=-16, 4-6=-0
Concentrated Loads (lb)
Vert: 14=-234 15=-292
- 12) Dead + 0.6 MWFRS Wind (Pos. Internal) 1st Parallel: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=14, 2-4=21, 4-5=14, 6-7=-131(F=-140), 2-8=-12
Horz: 1-2=-26, 2-4=-33, 4-5=-26, 4-6=-39
Concentrated Loads (lb)
Vert: 14=43 15=54
- 13) Dead + 0.6 MWFRS Wind (Pos. Internal) 2nd Parallel: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=2, 2-4=9, 4-5=2, 6-7=-119(F=-140), 2-8=-12
Horz: 1-2=-14, 2-4=-21, 4-5=-14, 4-6=-27
Concentrated Loads (lb)
Vert: 14=43 15=54
- 14) Dead + 0.6 MWFRS Wind (Pos. Internal) 3rd Parallel: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=14, 2-4=21, 4-5=14, 6-7=-131(F=-140), 2-8=-12
Horz: 1-2=-26, 2-4=-33, 4-5=-26, 4-6=-39
Concentrated Loads (lb)
Vert: 14=43 15=54
- 15) Dead + 0.6 MWFRS Wind (Pos. Internal) 4th Parallel: Lumber Increase=1.60, Plate Increase=1.60

Continued on page 3

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



818 Soundside Road
Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	Lot 9 Sierra Villas	E14133414
J0920-4182	D2-GR	HALF HIP	1	2	Job Reference (optional)	

Comtech, Inc., Fayetteville, NC - 28314,

8.330 s Feb 13 2020 MiTek Industries, Inc. Tue Mar 3 06:49:36 2020 Page 3
ID: eaaJ9i3ZGlbZ85c5RTUGb9zA_ID-pgp4awbyUIWMuQT0_cWodo4g4t2gaxx2QvBnP?zeiT

LOAD CASE(S) Standard

- Uniform Loads (plf)
Vert: 1-2=2, 2-4=9, 4-5=2, 6-7=-119(F=-140), 2-8=-12
Horz: 1-2=-14, 2-4=-21, 4-5=-14, 4-6=-27
- Concentrated Loads (lb)
Vert: 14=43 15=54
- 16) Dead + 0.6 MWFRS Wind (Neg. Internal) 1st Parallel: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=6, 2-4=-1, 4-5=6, 6-7=-153(F=-140), 2-8=-20
Horz: 1-2=-26, 2-4=-19, 4-5=-26, 4-6=-12
Concentrated Loads (lb)
Vert: 14=-234 15=-292
- 17) Dead + 0.6 MWFRS Wind (Neg. Internal) 2nd Parallel: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-6, 2-4=-13, 4-5=-6, 6-7=-141(F=-140), 2-8=-20
Horz: 1-2=-14, 2-4=-7, 4-5=-14, 4-6=0
Concentrated Loads (lb)
Vert: 14=-234 15=-292
- 18) Dead: Lumber Increase=0.90, Plate Increase=0.90 Plt. metal=0.90
Uniform Loads (plf)
Vert: 1-4=-20, 4-5=-20, 6-7=-240(F=-220), 2-8=-20
Concentrated Loads (lb)
Vert: 14=-200 15=-250
- 19) Dead + 0.75 Roof Live (bal.) + 0.75 Attic Floor + 0.75(0.6 MWFRS Wind (Neg. Int) Left): Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-31, 2-4=-36, 4-5=-31, 6-14=-215(F=-200), 7-14=-245(F=-200), 2-8=-20
Horz: 1-2=-19, 2-4=-14, 4-5=-19, 4-6=26
Concentrated Loads (lb)
Vert: 14=-454 15=-567
- 20) Dead + 0.75 Roof Live (bal.) + 0.75 Attic Floor + 0.75(0.6 MWFRS Wind (Neg. Int) Right): Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-38, 2-4=-43, 4-5=-38, 6-14=-206(F=-200), 7-14=-236(F=-200), 2-8=-20
Horz: 1-2=-12, 2-4=-7, 4-5=-12, 4-6=0
Concentrated Loads (lb)
Vert: 14=-375 15=-469
- 21) Dead + 0.75 Roof Live (bal.) + 0.75 Attic Floor + 0.75(0.6 MWFRS Wind (Neg. Int) 1st Parallel): Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-31, 2-4=-36, 4-5=-31, 6-14=-215(F=-200), 7-14=-245(F=-200), 2-8=-20
Horz: 1-2=-19, 2-4=-14, 4-5=-19, 4-6=-9
Concentrated Loads (lb)
Vert: 14=-375 15=-469
- 22) Dead + 0.75 Roof Live (bal.) + 0.75 Attic Floor + 0.75(0.6 MWFRS Wind (Neg. Int) 2nd Parallel): Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-40, 2-4=-45, 4-5=-40, 6-14=-206(F=-200), 7-14=-236(F=-200), 2-8=-20
Horz: 1-2=-10, 2-4=-5, 4-5=-10, 4-6=0
Concentrated Loads (lb)
Vert: 14=-375 15=-469
- 23) 1st Dead + Roof Live (unbalanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (plf)
Vert: 1-4=-60, 4-5=-60, 6-7=-160(F=-140), 2-8=-20
Concentrated Loads (lb)
Vert: 14=400 15=500
- 24) 2nd Dead + Roof Live (unbalanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (plf)
Vert: 1-4=-20, 4-5=-20, 6-14=-160(F=-140), 7-14=-200(F=-140), 2-8=-20
Concentrated Loads (lb)
Vert: 14=400 15=500
- 25) 3rd Dead + 0.75 Roof Live (unbalanced) + 0.75 Attic Floor: Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (plf)
Vert: 1-4=-50, 4-5=-50, 6-7=-220(F=-200), 2-8=-20
Concentrated Loads (lb)
Vert: 14=-350 15=-438
- 26) 4th Dead + 0.75 Roof Live (unbalanced) + 0.75 Attic Floor: Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (plf)
Vert: 1-4=-20, 4-5=-20, 6-14=-220(F=-200), 7-14=-250(F=-200), 2-8=-20
Concentrated Loads (lb)
Vert: 14=-350 15=-438

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




818 Soundside Road
Edenton, NC 27932

Job J0920-4182	Truss D2GE	Truss Type GABLE COMMON	Qty 1	Ply 1	Lot 9 Sierra Villas	E14133415
Comtech, Inc., Fayetteville, NC - 28314,					Job Reference (optional)	

8.330 s Feb 13 2020 MiTek Industries, Inc. Tue Mar 3 06:49:35 2020 Page 1
 ID: eaaJ9i3ZGlbZ85c5RTUGb9zA_ID-KTFiMaaJj_OVGgUpQv?Z4aXZITlrWYvBFREIZzeiiU



Scale = 1:20.1

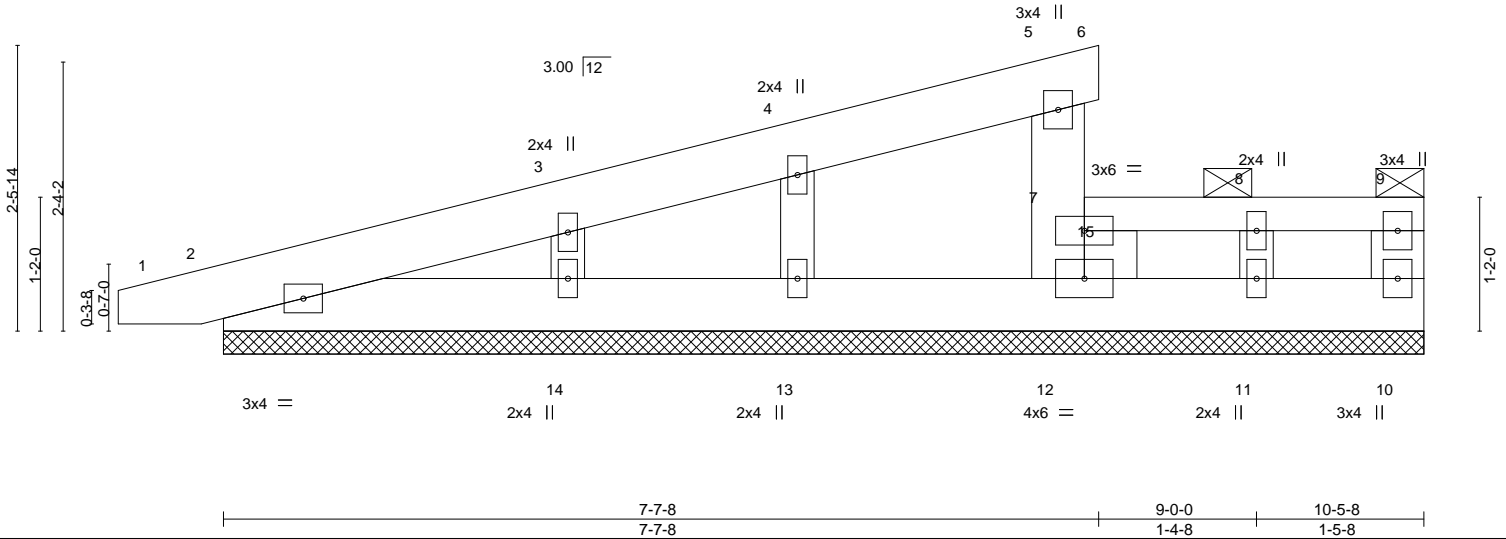

LOADING (psf)	SPACING-	CSL.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.03	Vert(LL) 0.00	5	n/r	120	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.02	Vert(CT) 0.00	5	n/r	120		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.03	Horz(CT) -0.00	10	n/a	n/a		
BCDL 10.0	Rep Stress Incr YES	Matrix-S					Weight: 58 lb	FT = 20%
	Code IRC2015/TPI2014							

LUMBER-
 TOP CHORD 2x6 SP No.1 *Except*
 7-9: 2x4 SP No.1
 BOT CHORD 2x6 SP No.1
 WEBS 2x6 SP No.1 *Except*
 8-11: 2x4 SP No.2
 OTHERS 2x4 SP No.2


BRACING-
 TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 5-12, 7-9. Except: 6-0-0 oc bracing: 5-7
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. All bearings 10-5-8.
 (lb) - Max Horz 2=149(LC 12)
 Max Uplift All uplift 100 lb or less at joint(s) 12, 10, 2, 14, 13, 11
 Max Grav All reactions 250 lb or less at joint(s) 12, 10, 2, 14, 13, 11

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) -0-6-11 to 10-2-12 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- Provide adequate drainage to prevent water ponding.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 2-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas with a clearance greater than 6-0-0 between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 12, 10, 2, 14, 13, 11.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

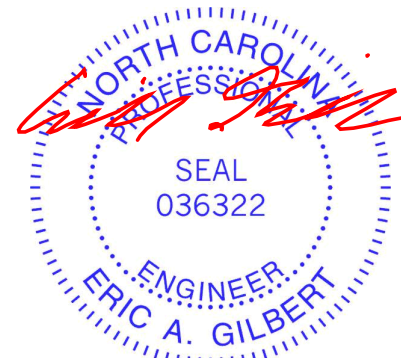

March 3, 2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




818 Soundside Road
 Edenton, NC 27932

Job J0920-4182	Truss J1	Truss Type MONOPITCH	Qty 8	Ply 1	Lot 9 Sierra Villas	E14133416
-------------------	-------------	-------------------------	----------	----------	---------------------	-----------

Comtech, Inc., Fayetteville, NC - 28314,

8.330 s Feb 13 2020 MiTek Industries, Inc. Tue Mar 3 06:49:36 2020 Page 1
ID: eaaJ9i3ZGlbZ85c5RTUGb9zA_ID-pgp4awbyUIWMuQT0_cWodo4jSt44azA2QvBnP?zeiT

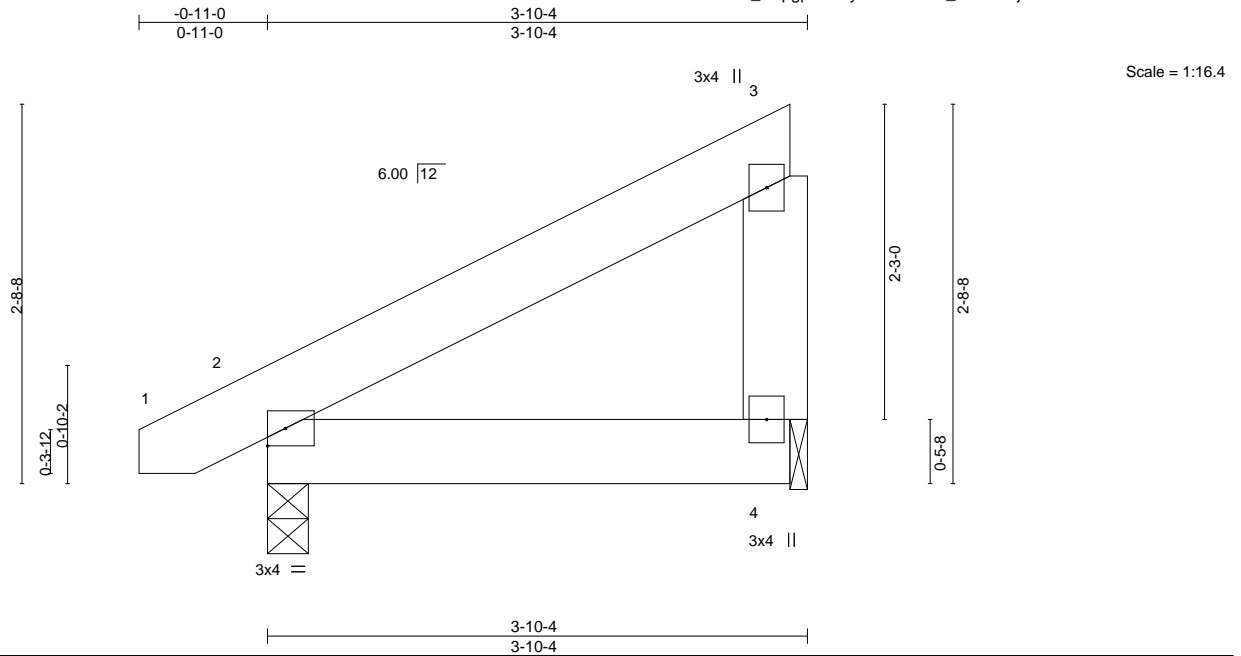

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.15	TC 0.07	Vert(LL)	-0.00	2-4	>999	MT20	244/190
TCDL 10.0	Lumber DOL	1.15	BC 0.09	Vert(CT)	-0.00	2-4	>999		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.00	Horz(CT)	0.00		n/a		
BCDL 10.0	Code	IRC2015/TPI2014	Matrix-P	Wind(LL)	0.00	2	****	Weight: 25 lb	FT = 20%

LUMBER-

TOP CHORD 2x6 SP No.1
BOT CHORD 2x6 SP No.1
WEBS 2x6 SP No.1

BRACING-

TOP CHORD Structural wood sheathing directly applied or 3-10-4 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.


REACTIONS.

(size) 2=0-3-8, 4=0-1-8
Max Horz 2=71(LC 12)
Max Uplift 2=-6(LC 12), 4=-36(LC 12)
Max Grav 2=197(LC 1), 4=133(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TC DL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas with a clearance greater than 6'-0" between the bottom chord and any other members.
- 4) Bearing at joint(s) 4 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- 5) Provide mechanical connection (by others) of truss to bearing plate at joint(s) 4.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 4.

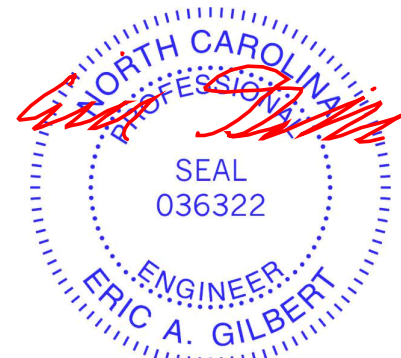

March 3, 2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.


Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



818 Soundside Road
Edenton, NC 27932

Job J0920-4182	Truss J1GE	Truss Type GABLE	Qty 2	Ply 1	Lot 9 Sierra Villas	E14133417
Comtech, Inc., Fayetteville, NC - 28314,					Job Reference (optional)	

8.330 s Feb 13 2020 MiTek Industries, Inc. Tue Mar 3 06:49:37 2020 Page 1
 ID: eaaJ9i3ZGlbZ85c5RTUGb9zA_ID-HsNsnGbaFceDwa2CXK11A?cviIHR?JQ9CfZwKxSzeiiS

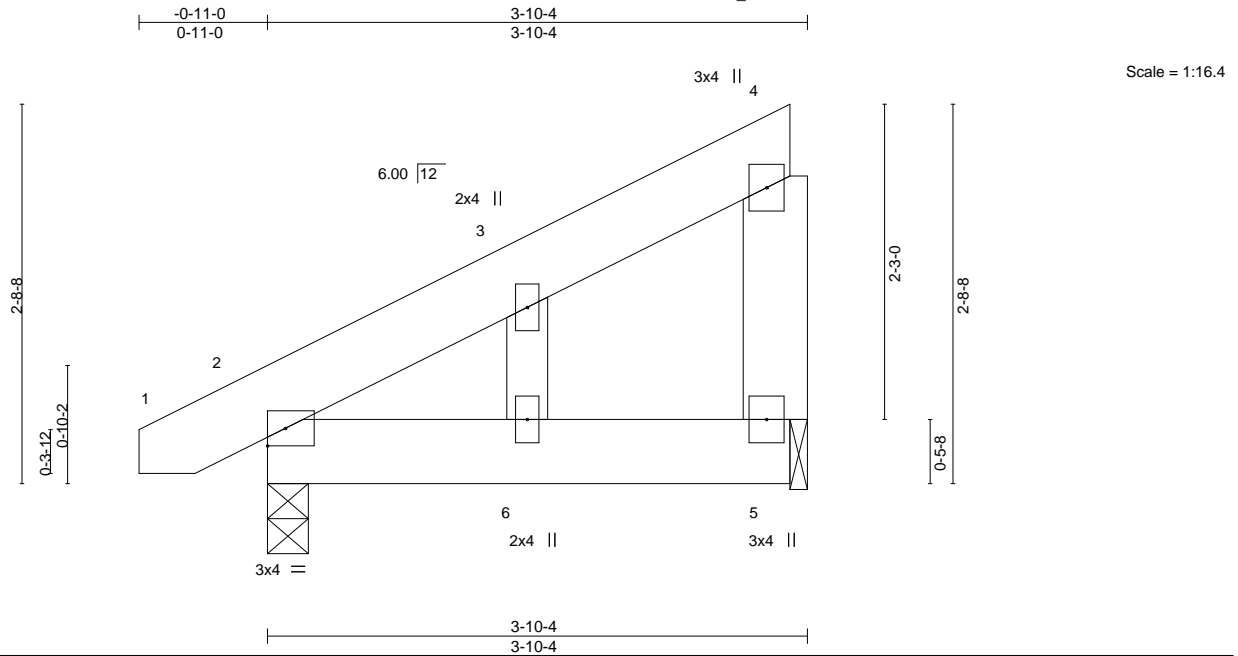

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP	
TCLL 20.0	Plate Grip DOL	1.15	TC 0.03	Vert(LL)	-0.00	6	>999	360	MT20	244/190
TCDL 10.0	Lumber DOL	1.15	BC 0.05	Vert(CT)	-0.00	6	>999	240		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.02	Horz(CT)	0.00	5	n/a	n/a		
BCDL 10.0	Code	IRC2015/TPI2014	Matrix-S	Wind(LL)	0.00	6	>999	240		
									Weight: 27 lb	FT = 20%

LUMBER-
 TOP CHORD 2x6 SP No.1
 BOT CHORD 2x6 SP No.1
 WEBS 2x6 SP No.1
 OTHERS 2x4 SP No.2

BRACING-
 TOP CHORD Structural wood sheathing directly applied or 3-10-4 oc purlins, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (size) 2=0-3-8, 5=0-1-8
 Max Horz 2=102(LC 12)
 Max Uplift 2=-35(LC 12), 5=-68(LC 12)
 Max Grav 2=197(LC 1), 5=133(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- 3) Gable studs spaced at 2-0-0 oc.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas with a clearance greater than 6-0-0 between the bottom chord and any other members.
- 6) Bearing at joint(s) 5 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- 7) Provide mechanical connection (by others) of truss to bearing plate at joint(s) 5.
- 8) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 5.



March 3, 2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




818 Soundside Road
 Edenton, NC 27932


Job J0920-4182	Truss M1	Truss Type MONOPITCH	Qty 4	Ply 1	Lot 9 Sierra Villas	E14133418
-------------------	-------------	-------------------------	----------	----------	---------------------	-----------

Comtech, Inc., Fayetteville, NC - 28314,

8.330 s Feb 13 2020 MiTek Industries, Inc. Tue Mar 3 06:49:38 2020 Page 1
ID: eaaJ9i3ZGlbZ85c5RTUGb9zA_ID-l2xq?ccC0vm47jdO51YGid90lhjW2tglTDguUuzeiR



Scale = 1:28.1

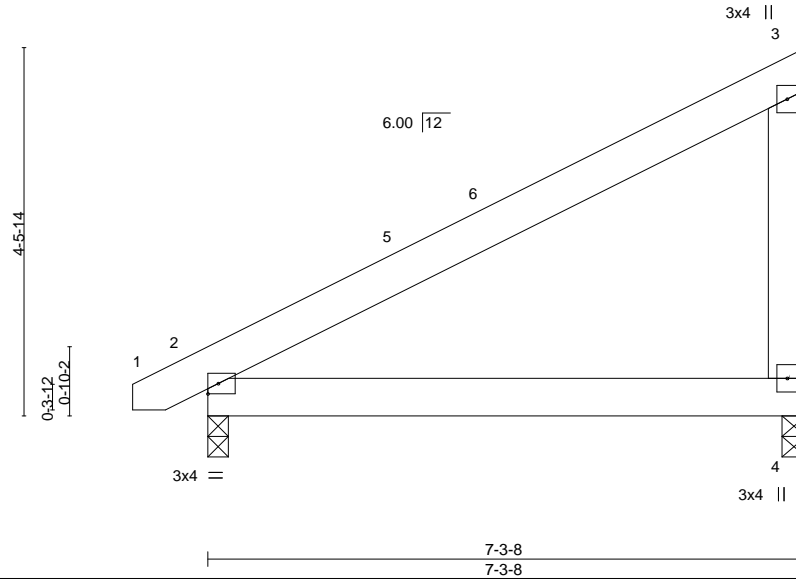

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.30	Vert(LL) -0.03	2-4	>999	360	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.29	Vert(CT) -0.06	2-4	>999	240		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.00	Horz(CT) 0.00		n/a	n/a		
BCDL 10.0	Rep Stress Incr YES	Matrix-P	Wind(LL) 0.07	2-4	>999	240	Weight: 47 lb	FT = 20%
	Code IRC2015/TPI2014							

LUMBER-

TOP CHORD 2x6 SP No.1
BOT CHORD 2x6 SP No.1
WEBS 2x6 SP No.1

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.


REACTIONS.

(size) 4=0-3-8, 2=0-3-0
Max Horz 2=127(LC 12)
Max Uplift 4=-65(LC 12), 2=-31(LC 8)
Max Grav 4=274(LC 1), 2=331(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TC DL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) -0-8-10 to 3-8-3, Interior(1) 3-8-3 to 7-0-12 zone; porch left exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas with a clearance greater than 6-0-0 between the bottom chord and any other members.
- 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 4, 2.

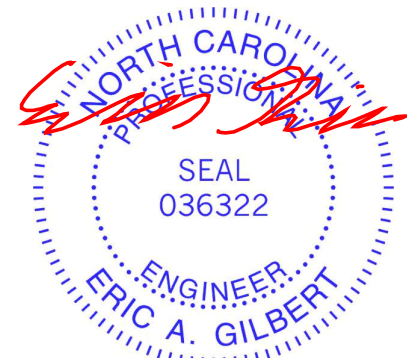

March 3, 2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




818 Soundside Road
Edenton, NC 27932


Job J0920-4182	Truss M1GE	Truss Type MONOPITCH SUPPORTED	Qty 1	Ply 1	Lot 9 Sierra Villas	E14133419
-------------------	---------------	-----------------------------------	----------	----------	---------------------	-----------

Comtech, Inc., Fayetteville, NC - 28314,

8.330 s Feb 13 2020 MiTek Industries, Inc. Tue Mar 3 06:49:38 2020 Page 1
ID: eaaJ9i3ZGlbZ85c5RTUGb9zA_ID-I2xq?ccC0vm47jdO51YGiD94ihnr2tBLtDguUuzeiR



Scale = 1:28.3

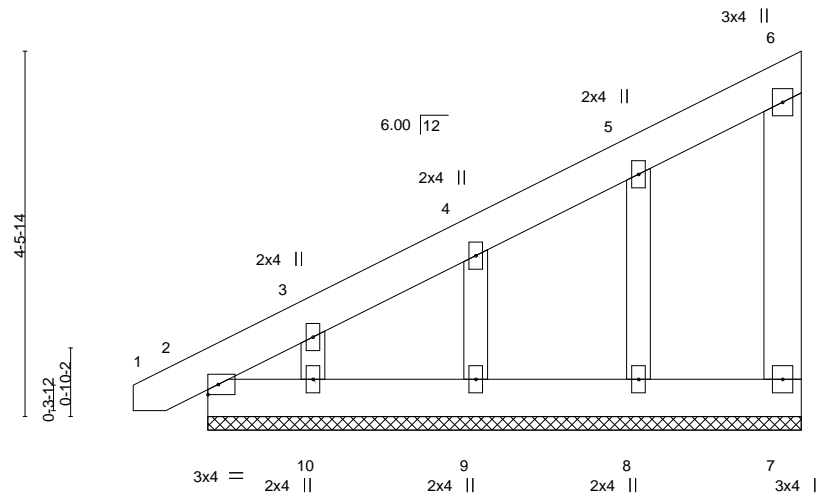

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.15	TC 0.02	Vert(LL)	0.00	1	n/r	MT20	244/190
TCDL 10.0	Lumber DOL	1.15	BC 0.01	Vert(CT)	-0.00	1	n/r		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.03	Horz(CT)	0.00		n/a		
BCDL 10.0	Code	IRC2015/TPI2014	Matrix-P					Weight: 54 lb	FT = 20%


LUMBER-
TOP CHORD 2x6 SP No.1
BOT CHORD 2x6 SP No.1
WEBS 2x6 SP No.1
OTHERS 2x4 SP No.2

BRACING-
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. All bearings 7-3-8.
(lb) - Max Horz 2=182(LC 12)
Max Uplift All uplift 100 lb or less at joint(s) 7, 8, 9 except 10=-101(LC 12)
Max Grav All reactions 250 lb or less at joint(s) 7, 2, 8, 9, 10

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-288/115

- NOTES-**
- 1) Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; porch left exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 2) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
 - 3) Gable requires continuous bottom chord bearing.
 - 4) Gable studs spaced at 2-0-0 oc.
 - 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 6) * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas with a clearance greater than 6-0-0 between the bottom chord and any other members.
 - 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 7, 8, 9 except (jt=lb) 10=101.
 - 8) Beveled plate or shim required to provide full bearing surface with truss chord at joint(s) 2.

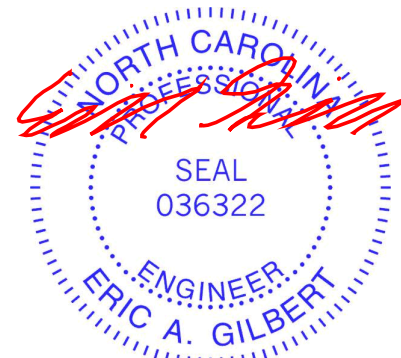

March 3, 2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.


Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ENGINEERING BY
TRENCO
A MiTek Affiliate


818 Soundside Road
Edenton, NC 27932

Symbols

PLATE LOCATION AND ORIENTATION



Center plate on joint unless x, y offsets are indicated. Dimensions are in ft-in-sixteenths. Apply plates to both sides of truss and fully embed teeth.

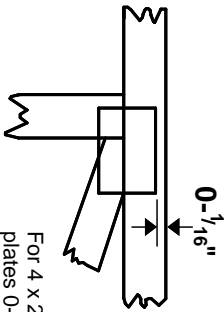

For 4 x 2 orientation, locate plates 0- 1/16" from outside edge of truss.



This symbol indicates the required direction of slots in connector plates.

* Plate location details available in **MITek 20/20 software or upon request.**

PLATE SIZE

4 X 4


The first dimension is the plate width measured perpendicular to slots. Second dimension is the length parallel to slots.

LATERAL BRACING LOCATION



Indicated by symbol shown and/or by text in the bracing section of the output. Use T or I bracing if indicated.

BEARING




Indicates location where bearings (supports) occur. Icons vary but reaction section indicates joint number where bearings occur. Min size shown is for crushing only.

Industry Standards:

ANSI/TP1: National Design Specification for Metal Plate Connected Wood Truss Construction.
DSB-89: Design Standard for Bracing, Building Component Safety Information, Guide to Good Practice for Handling, Installing & Bracing of Metal Plate
BCSI: Connected Wood Trusses.

Numbering System

6-4-8
dimensions shown in ft-in-sixteenths
(Drawings not to scale)

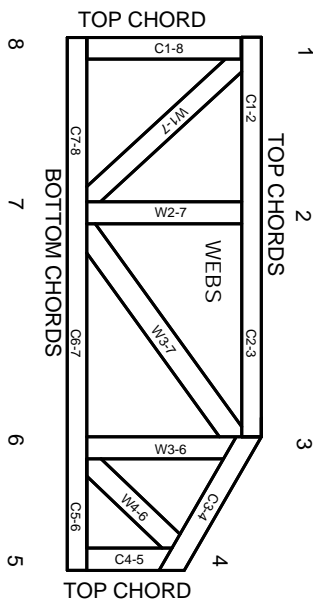

JOINTS ARE GENERALLY NUMBERED/LETTERED CLOCKWISE AROUND THE TRUSS STARTING AT THE JOINT FARTHEST TO THE LEFT.

CHORDS AND WEBS ARE IDENTIFIED BY END JOINT NUMBERS/LETTERS.

PRODUCT CODE APPROVALS

ICC-ES Reports:

ESR-1311, ESR-1352, ESR1988
ER-3907, ESR-2362, ESR-1397, ESR-3282

Trusses are designed for wind loads in the plane of the truss unless otherwise shown.

Lumber design values are in accordance with ANSI/TP1 section 6.3 These truss designs rely on lumber values established by others.

© 2012 MITteK® All Rights Reserved



MITek Engineering Reference Sheet: Mill-7473 rev. 5/19/2020



General Safety Notes

Failure to Follow Could Cause Property Damage or Personal Injury

1. Additional stability bracing for truss system, e.g. diagonal or X-bracing, is always required. See BCSI.
2. Truss bracing must be designed by an engineer. For wide truss spacing, individual lateral braces themselves may require bracing, or alternative T or I bracing should be considered.
3. Never exceed the design loading shown and never stack materials on inadequately braced trusses.
4. Provide copies of this truss design to the building designer, erection supervisor, property owner and all other interested parties.
5. Cut members to bear tightly against each other.
6. Place plates on each face of truss at each joint and embed fully. Knots and wane at joint locations are regulated by ANSI/TP1 1.
7. Design assumes trusses will be suitably protected from the environment in accord with ANSI/TP1 1.
8. Unless otherwise noted, moisture content of lumber shall not exceed 19% at time of fabrication.
9. Unless expressly noted, this design is not applicable for use with fire retardant, preservative treated, or green lumber.
10. Camber is a non-structural consideration and is the responsibility of truss fabricator. General practice is to camber for dead load deflection.
11. Plate type, size, orientation and location dimensions indicated are minimum plating requirements.
12. Lumber used shall be of the species and size, and in all respects, equal to or better than that specified.
13. Top chords must be sheathed or purlins provided at spacing indicated on design.
14. Bottom chords require lateral bracing at 10 ft. spacing, or less, if no ceiling is installed, unless otherwise noted.
15. Connections not shown are the responsibility of others.
16. Do not cut or alter truss member or plate without prior approval of an engineer.
17. Install and load vertically unless indicated otherwise.
18. Use of green or treated lumber may pose unacceptable environmental, health or performance risks. Consult with project engineer before use.
19. Review all portions of this design (front, back, words and pictures) before use. Reviewing pictures alone is not sufficient.
20. Design assumes manufacture in accordance with ANSI/TP1 1 Quality Criteria.
21. The design does not take into account any dynamic or other loads other than those expressly stated.