

Harnett County Department of Public Health

Operation Permit

PERMIT # SI-02010-0004

New Installation Septic Tank Nitrification Line Repair Expansion

PROPERTY LOCATION: 5191 OLD STAGE RD N. (SR 1006)

Name: (owner) BALFOOT BUDG CO. LLC SUBDIVISION _____ LOT # 5

System Installer: KIRBY JOHNSON

Basement with plumbing: Garage Number of Bedrooms 3


Type of Water Supply: Community Public Well Distance from well NA feet

System Type: 25% REDUCTION SIS. IIIg Types V and VI Systems expire in 5 years.

(In accordance with Table V a)

Owner must contact Health Department 6 months prior to expiration for permit renewal.

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

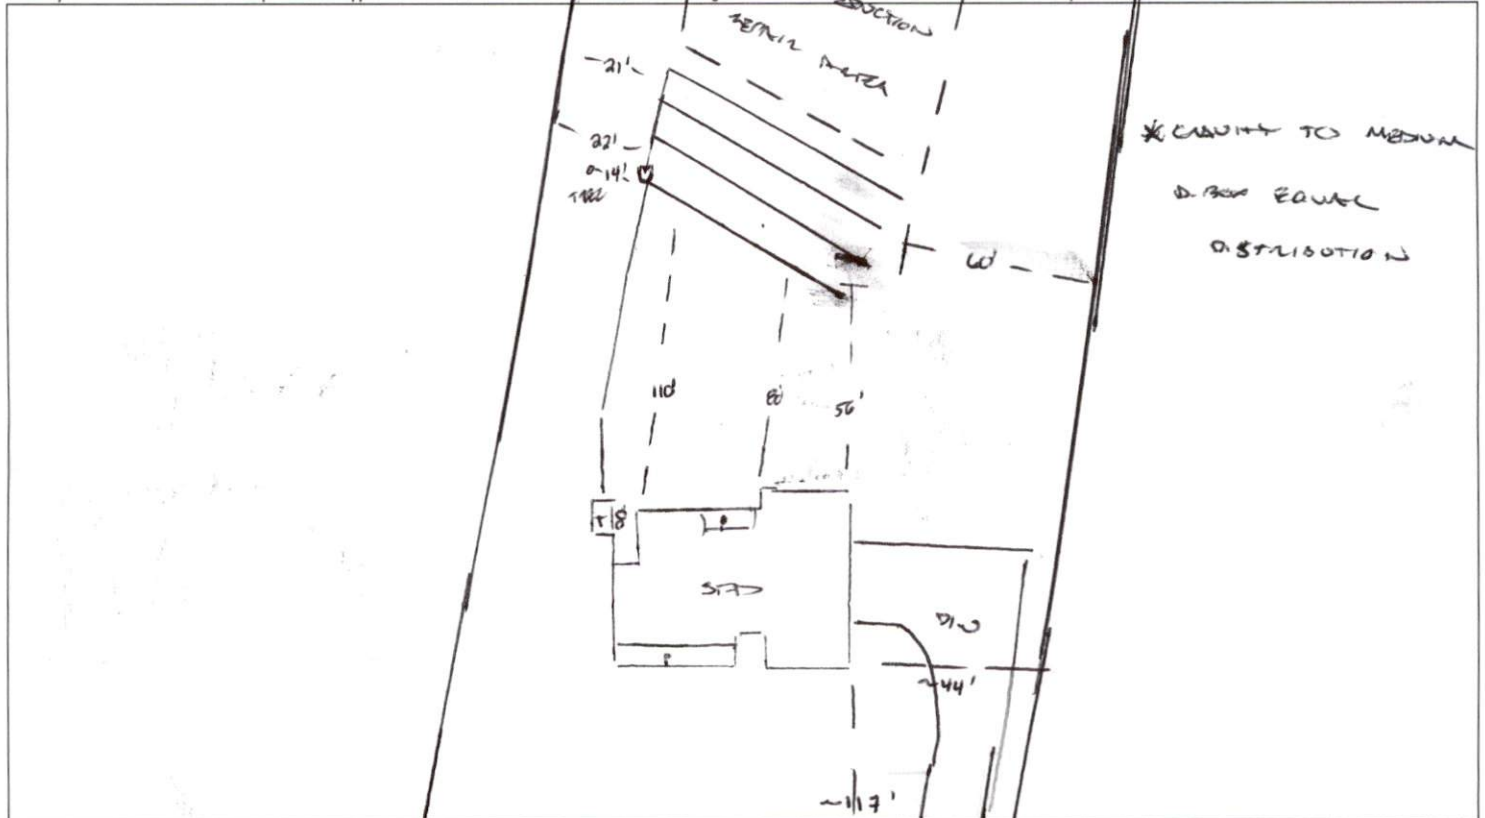

PERMIT CONDITIONS:

I. Performance: System shall perform in accordance with Rule .1961.

II. Monitoring: As required by Rule .1961.

III. Maintenance: As required by Rule .1961. Other: _____

Subsurface system operator required? Yes No

If yes, see attached sheet for additional operation conditions, maintenance and reporting.

IV. Operation: ← OLD STAGE RD. N. (SR 1006)

V. Other: _____

D-Box Pump Alarm H2O Line PWR Line

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system: Conventional Other 4 CHAMBER IIIg Septic Tank: 1250 gallons Pump Tank: _____ gallons

Subsurface No. of exact length width of depth of
Drainage Field ditches 4 of each ditch 78 feet ditches 3 feet ditches 20 inches

French Drain Required: _____ Linear feet

Authorized State Agent [Signature] Date 05/11/2021