

RE: J0520-2117
 Weaver / 27 Mitchell Manor / Harnett

Trenco
 818 Soundside Rd
 Edenton, NC 27932

Site Information:

Customer: Project Name: J0520-2117
 Lot/Block: Model:
 Address: Subdivision:
 City: State:


General Truss Engineering Criteria & Design Loads (Individual Truss Design Drawings Show Special Loading Conditions):

Design Code: IRC2009/TPI2007 Design Program: MiTek 20/20 8.3
 Wind Code: ASCE 7-05 Wind Speed: 100 mph
 Roof Load: 40.0 psf Floor Load: N/A psf

This package includes 21 individual, dated Truss Design Drawings and 0 Additional Drawings.

No.	Seal#	Truss Name	Date	No.	Seal#	Truss Name	Date
1	E14244372	A1	5/25/2020	21	E14244392	PBGE	5/25/2020
2	E14244373	A1SE	5/25/2020				
3	E14244374	A2	5/25/2020				
4	E14244375	A3	5/25/2020				
5	E14244376	A4	5/25/2020				
6	E14244377	A5	5/25/2020				
7	E14244378	A6	5/25/2020				
8	E14244379	A7	5/25/2020				
9	E14244380	A8	5/25/2020				
10	E14244381	A9	5/25/2020				
11	E14244382	A9GE	5/25/2020				
12	E14244383	B1	5/25/2020				
13	E14244384	B1GE	5/25/2020				
14	E14244385	C1	5/25/2020				
15	E14244386	C2	5/25/2020				
16	E14244387	C3	5/25/2020				
17	E14244388	G1	5/25/2020				
18	E14244389	G1GE	5/25/2020				
19	E14244390	G2	5/25/2020				
20	E14244391	PB	5/25/2020				

The truss drawing(s) referenced above have been prepared by Truss Engineering Co. under my direct supervision based on the parameters provided by Comtech, Inc - Fayetteville. Truss Design Engineer's Name: Gilbert, Eric My license renewal date for the state of North Carolina is December 31, 2020. North Carolina COA: C-0844

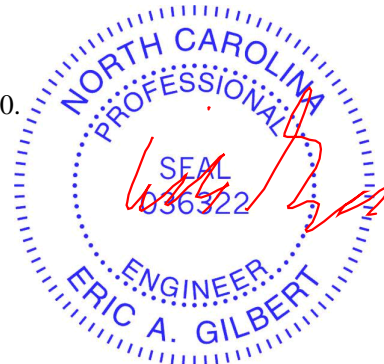

IMPORTANT NOTE: The seal on these truss component designs is a certification that the engineer named is licensed in the jurisdiction(s) identified and that the designs comply with ANSI/TPI 1. These designs are based upon parameters shown (e.g., loads, supports, dimensions, shapes and design codes), which were given to TRENCO. Any project specific information included is for TRENCO customers file reference purpose only, and was not taken into account in the preparation of these designs. TRENCO has not independently verified the applicability of the design parameters or the designs for any particular building. Before use, the building designer should verify applicability of design parameters and properly incorporate these designs into the overall building design per ANSI/TPI 1, Chapter 2.

Job J0520-2117	Truss A1	Truss Type PIGGYBACK BASE	Qty 1	Ply 1	Weaver / 27 Mitchell Manor / Harnett	E14244372
-------------------	-------------	------------------------------	----------	----------	--------------------------------------	-----------

Comtech, Inc., Fayetteville, NC - 28314,


8.330 s Mar 23 2020 MiTek Industries, Inc. Tue Mar 31 08:25:35 2020 Page 1

ID:FKRF2G2VvSGFSXRUG_ubJqzaK1d-j08QoHQI3K6xhDBhrXXV3SxfcPLgai7v35mzPszVTYk

Job Reference (optional)

-0-10-8 9-7-8 19-3-0 24-9-0 34-4-8 44-0-0 44-10-8
0-10-8 9-7-8 9-7-8 5-5-15 9-7-8 9-7-8 0-10-8

Scale = 1:82.8

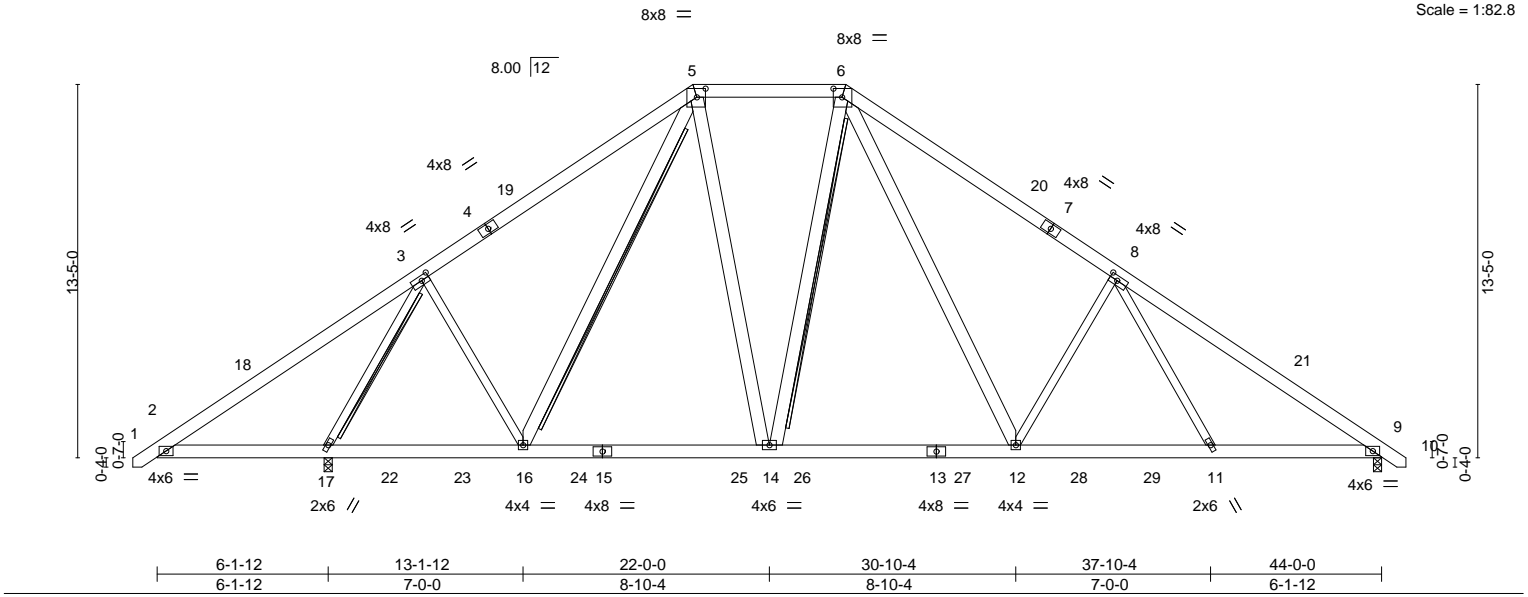

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.15	TC 0.48	Vert(LL)	-0.10 12-14	>999	360	MT20	244/190
TCDL 10.0	Lumber DOL	1.15	BC 0.45	Vert(CT)	-0.17 12-14	>999	240		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.68	Horz(CT)	0.05 9	n/a	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-S	Wind(LL)	0.04 12	>999	240		
								Weight: 395 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x6 SP No.1	TOP CHORD Structural wood sheathing directly applied or 4-7-3 oc purlins, except 2-0-0 oc purlins (6-0-0 max.): 5-6.
BOT CHORD 2x6 SP No.1	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing, Except: 6-0-0 oc bracing: 2-17.
WEBS 2x6 SP No.1 *Except* 3-17,3-16,8-12,8-11: 2x4 SP No.2	WEBS T-Brace: 2x4 SPF No.2 - 3-17 2x6 SPF No.2 - 5-16, 6-14 Fasten (2X) T and I braces to narrow edge of web with 10d (0.131"x3") nails, 6in o.c., with 3in minimum end distance. Brace must cover 90% of web length.

REACTIONS. (size) 17=0-3-8, 9=0-3-8
Max Horz 17=-320(LC 10)
Max Uplift 17=-108(LC 12), 9=-94(LC 13)
Max Grav 17=2255(LC 2), 9=1725(LC 20)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-405/688, 3-5=-1444/385, 5-6=-1256/435, 6-8=-2202/565, 8-9=-2628/426
BOT CHORD 2-17=-458/455, 16-17=-181/968, 14-16=-6/1238, 12-14=0/1314, 11-12=-218/1927,
9-11=-190/2042
WEBS 3-17=-2295/704, 3-16=-19/655, 8-12=-744/366, 8-11=0/310, 5-16=-278/131,
6-14=-283/186, 5-14=-75/684, 6-12=-236/1034

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TC DL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) 0-8-9 to 3-8-4, Interior(1) 3-8-4 to 19-3-14, Exterior(2) 19-3-14 to 30-10-13, Interior(1) 30-10-13 to 44-8-9 zone; cantilever left exposed ;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Provide adequate drainage to prevent water ponding.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 108 lb uplift at joint 17 and 94 lb uplift at joint 9.
 - Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
 - Warning: Additional permanent and stability bracing for truss system (not part of this component design) is always required.



March 31, 2020

Job J0520-2117	Truss A1SE	Truss Type GABLE	Qty 1	Ply 1	Weaver / 27 Mitchell Manor / Harnett	E14244373
-------------------	---------------	---------------------	----------	----------	--------------------------------------	-----------

Comtech, Inc., Fayetteville, NC - 28314,

8.330 s Mar 23 2020 MiTek Industries, Inc. Tue Mar 31 08:25:37 2020 Page 1

ID:FKRF2G2VvSGFSXRUG_ubJqzaK1d-fPGAdzSYbxMfwXL3zyaz8t00BC0z2bRCXPf3UilzVTYi

0-10-8 0-10-8	9-7-8 9-7-8	19-3-0 9-7-8	24-9-0 5-5-15	34-4-8 9-7-8	44-0-0 9-7-8	44-10-8 0-10-8
------------------	----------------	-----------------	------------------	-----------------	-----------------	-------------------

Scale = 1:84.3

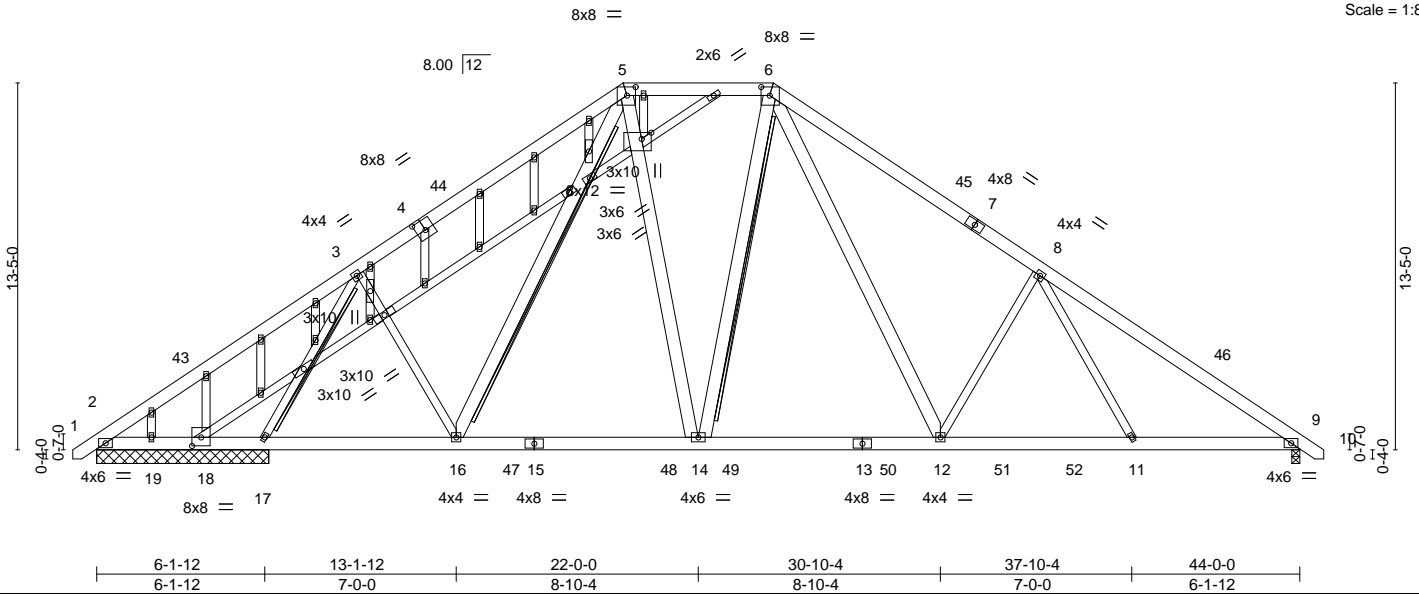


Plate Offsets (X,Y)--	[4:0-4-0,0-4-8], [5:0-3-12,0-3-12], [6:0-3-12,0-3-12], [18:0-4-0,0-3-12], [21:0-4-4,0-2-12]
-----------------------	---

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.15	TC 0.42	Vert(LL)	-0.10 12-14	>999	360	MT20	244/190
TCDL 10.0	Lumber DOL	1.15	BC 0.46	Vert(CT)	-0.17 12-14	>999	240		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.69	Horz(CT)	0.05 9	n/a	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-S	Wind(LL)	0.05 12	>999	240		
								Weight: 455 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x6 SP No.1	TOP CHORD Structural wood sheathing directly applied or 4-6-15 oc purlins, except
BOT CHORD 2x6 SP No.1	2-0-0 oc purlins (6-0-0 max.): 5-6.
WEBS 2x4 SP No.2 *Except*	BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.
6-14,5-14,5-16,6-12: 2x6 SP No.1	WEBS T-Brace: 2x4 SPF No.2 - 3-17
OTHERS 2x4 SP No.2	2x6 SPF No.2 - 6-14, 5-16
	Fasten (2X) T and I braces to narrow edge of web with 10d (0.131"x3") nails, 6in o.c., with 3in minimum end distance.
	Brace must cover 90% of web length.

REACTIONS. All bearings 6-3-8 except (jt=length) 9=0-3-8.
 (lb) - Max Horz 2=400(LC 10)
 Max Uplift All uplift 100 lb or less at joint(s) 2 except 17=365(LC 12), 9=324(LC 13), 18=120(LC 1), 19=200(LC 12)
 Max Grav All reactions 250 lb or less at joint(s) 2, 18 except 17=1945(LC 19), 9=1735(LC 20), 19=350(LC 19)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-3=-170/365, 3-5=-1480/491, 5-6=-1288/476, 6-8=-2209/608, 8-9=-2635/468
 BOT CHORD 2-19=-272/297, 18-19=-272/297, 17-18=-272/297, 16-17=-226/1062, 14-16=-76/1251, 12-14=0/1309, 11-12=-266/1937, 9-11=-238/2046
 WEBS 3-17=-2059/467, 3-16=-25/580, 8-12=-743/486, 8-11=0/309, 6-14=-272/221, 5-16=-258/131, 5-14=-110/687, 6-12=-350/1055

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TC DL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) -0-8-9 to 3-8-4, Interior(1) 3-8-4 to 19-3-14, Exterior(2) 19-3-14 to 30-10-13, Interior(1) 30-10-13 to 44-8-9 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
 - 4) Provide adequate drainage to prevent water ponding.
 - 5) All plates are 2x4 MT20 unless otherwise indicated.
 - 6) Gable studs spaced at 2-0-0 oc.
 - 7) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 8) * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - 9) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2 except (jt=lb) 17=365, 9=324, 18=120, 19=200.
 - 10) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
 - 11) Warning: Additional permanent and stability bracing for truss system (not part of this component design) is always required.



WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 10/03/2015 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 218 N. Lee Street, Suite 312, Alexandria, VA 22314.


ENGINEERING BY
TRENCO
 A MiTek Affiliate

818 Soundside Road
 Edenton, NC 27932

Job J0520-2117	Truss A2	Truss Type PIGGYBACK BASE	Qty 5	Ply 1	Weaver / 27 Mitchell Manor / Harnett	E14244374
Comtech, Inc., Fayetteville, NC - 28314,					8.330 s Mar 23 2020 MiTek Industries, Inc. Tue Mar 31 08:25:38 2020 Page 1	
ID:FKRF2G2VvSGFSXRUG_ubJqzaK1d-8bqZQJTAMFUWYhwGXg5Ch5ZAUcQDn63Lm2?d0BzVTYh					Job Reference (optional)	

0-10-8 0-10-8	9-7-8 9-7-8	19-3-0 9-7-8	24-9-0 5-5-15	34-4-8 9-7-8	44-0-0 9-7-8	44-10-8 0-10-8
------------------	----------------	-----------------	------------------	-----------------	-----------------	-------------------

Scale = 1:84.5

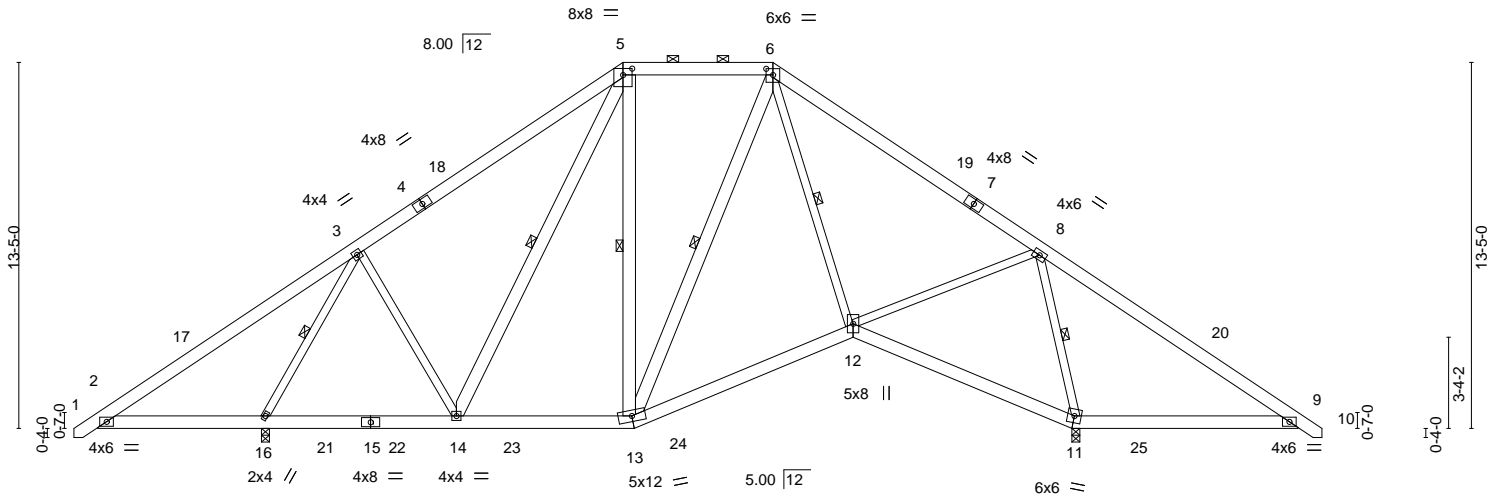

6-0-0	6-1-12	13-1-12	19-3-0	19-8-0	27-8-4	35-8-8	35-10-4	44-0-0
6-0-0	0-1-12	7-0-0	6-1-4	0-5-0	8-0-4	8-0-4	0-1-12	8-1-12

Plate Offsets (X,Y)-- [5:0-4-0,0-2-13], [6:0-3-0,0-2-12]


LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.15	TC 0.51	Vert(LL)	-0.04 13-14	>999	360	MT20	244/190
TCDL 10.0	Lumber DOL	1.15	BC 0.21	Vert(CT)	-0.09 12-13	>999	240		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.41	Horz(CT)	0.03 11	n/a	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-S	Wind(LL)	0.02 13-14	>999	240		
								Weight: 381 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x6 SP No.1	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except
BOT CHORD 2x6 SP No.1	2-0-0 oc purlins (6-0-0 max.): 5-6.
WEBS 2x4 SP No.2 *Except*	BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.
5-13,5-14,6-13: 2x6 SP No.1	WEBS 1 Row at midpt 3-16, 5-13, 6-12, 8-11, 5-14, 6-13

REACTIONS. (size) 11=0-3-8, 16=0-3-8
 Max Horz 16=-320(LC 10)
 Max Uplift 11=-118(LC 13), 16=-112(LC 12)
 Max Grav 11=1938(LC 1), 16=1673(LC 2)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-3=-408/688, 3-5=-889/255, 5-6=-703/289, 6-8=-853/102, 8-9=-484/769
 BOT CHORD 2-16=-459/457, 14-16=-211/657, 13-14=-60/673, 12-13=-29/726, 11-12=-306/483,
 9-11=-511/519
 WEBS 3-16=-1650/574, 8-12=-6/825, 6-12=-53/432, 3-14=-37/358, 8-11=-1687/540

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TC DL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) 0-8-9 to 3-8-4, Interior(1) 3-8-4 to 19-3-0, Exterior(2) 19-3-0 to 30-11-10, Interior(1) 30-11-10 to 44-8-9 zone; cantilever left and right exposed ;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Provide adequate drainage to prevent water ponding.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 11=118, 16=112.
 - Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

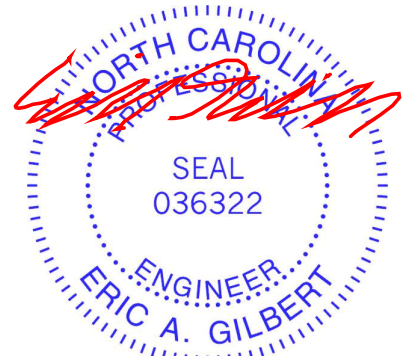

March 31, 2020


WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 10/03/2015 BEFORE USE.
 Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 218 N. Lee Street, Suite 312, Alexandria, VA 22314.

ENGINEERING BY
TRENCO
 A MITEK AFFILIATE
 818 Soundside Road
 Edenton, NC 27932

Job J0520-2117	Truss A3	Truss Type PIGGYBACK BASE	Qty 2	Ply 1	Weaver / 27 Mitchell Manor / Harnett	E14244375
Comtech, Inc., Fayetteville, NC - 28314,					8,330 s Mar 23 2020 MiTek Industries, Inc. Tue Mar 31 08:25:40 2020 Page 1	
ID:FKRF2G2VvSGFSXRUG_ubJzkaK1d-4_xJr_UQuskEn_4ee47gmWeWyQ6kFbeDMUK54zVTYf					Job Reference (optional)	

0-10-8 9-7-8 19-3-0 24-9-0 34-4-8 44-0-0 44-10-8
0-10-8 9-7-8 9-7-8 5-5-15 9-7-8 9-7-8 0-10-8

Scale = 1:84.5

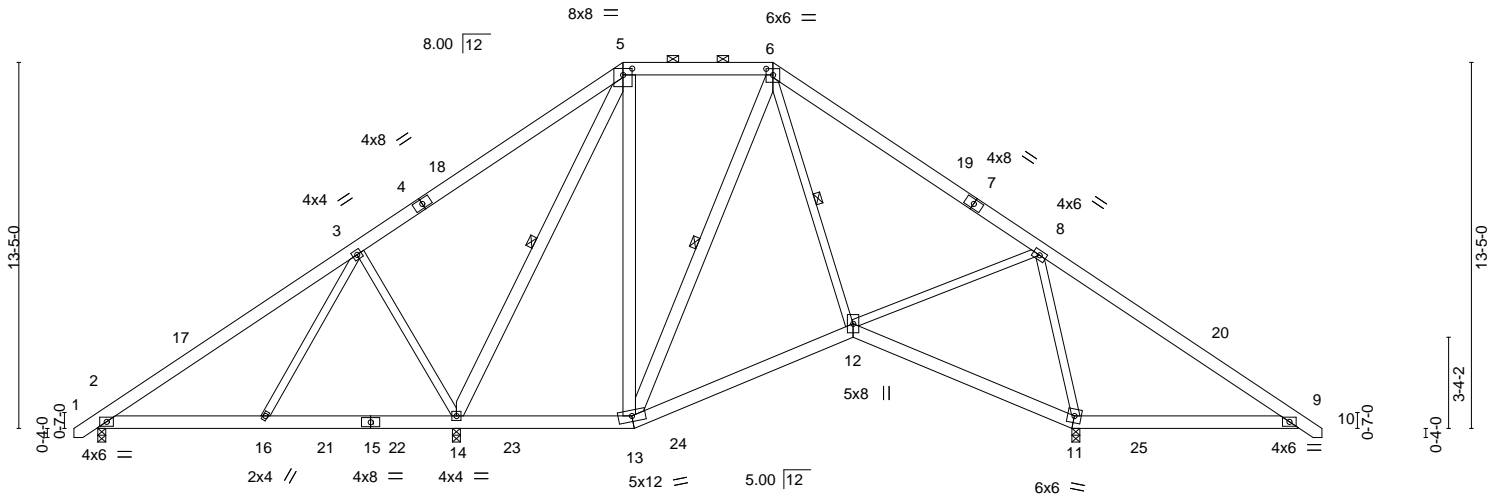

6-1-12 13-0-0 13-1-12 19-3-0 19-8-0 27-8-4 35-8-8 35-10-4 44-0-0
6-1-12 6-10-4 0-1-12 6-1-4 0-5-0 8-0-4 8-0-4 0-1-12 8-1-12

Plate Offsets (X,Y)-- [5:0-4-0,0-2-13], [6:0-3-0,0-2-12]

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.15	TC 0.51	Vert(LL)	-0.04 12-13	>999	360	MT20	244/190
TCDL 10.0	Lumber DOL	1.15	BC 0.20	Vert(CT)	-0.08 12-13	>999	240		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.99	Horz(CT)	0.01 11	n/a	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-S	Wind(LL)	0.02 2-16	>999	240		
								Weight: 381 lb	FT = 20%

LUMBER-
TOP CHORD 2x6 SP No.1
BOT CHORD 2x6 SP No.1
WEBS 2x4 SP No.2 *Except*
5-13,5-14,6-13: 2x6 SP No.1

BRACING-
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except 2-0-0 oc purlins (6-0-0 max.): 5-6.
BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.
WEBS 1 Row at midpt 6-12, 5-14, 6-13

REACTIONS. (size) 2=0-3-8, 11=0-3-8, 14=0-3-8
Max Horz 14=-320(LC 10)
Max Uplift 2=-56(LC 9), 11=-121(LC 13), 14=-141(LC 9)
Max Grav 2=483(LC 23), 11=1674(LC 1), 14=1546(LC 2)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-455/240, 3-5=-59/369, 5-6=-384/210, 6-8=-493/69, 8-9=-484/769
BOT CHORD 2-16=-71/274, 13-14=-121/314, 12-13=-125/434, 11-12=-361/496, 9-11=-511/519
WEBS 3-16=-292/330, 8-12=0/547, 5-13=-30/367, 6-12=-87/438, 3-14=-745/533,
8-11=-1400/466, 5-14=-859/143, 6-13=-255/25

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TC DL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) -0-8-9 to 3-8-4, Interior(1) 3-8-4 to 19-3-0, Exterior(2) 19-3-0 to 30-11-10, Interior(1) 30-11-10 to 44-8-9 zone; cantilever right exposed; porch left exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Provide adequate drainage to prevent water ponding.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2 except (jt=lb) 11=121, 14=141.
 - Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



March 31, 2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 10/03/2015 BEFORE USE.
Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 218 N. Lee Street, Suite 312, Alexandria, VA 22314.


ENGINEERING BY
TRENCO
A MiTek Affiliate
818 Soundside Road
Edenton, NC 27932

Job J0520-2117	Truss A4	Truss Type ROOF SPECIAL	Qty 2	Ply 1	Weaver / 27 Mitchell Manor / Harnett	E14244376
-------------------	-------------	----------------------------	----------	----------	--------------------------------------	-----------

Comtech, Inc., Fayetteville, NC - 28314,

8,330 s Mar 23 2020 MiTek Industries, Inc. Tue Mar 31 08:25:41 2020 Page 1

ID:FKRF2G2VvSGFSXRUG_ubJqzaK1d-YAVh2KV2fAs5P8erCoevJbKcPnR_SB0S0DhdWzVTYe

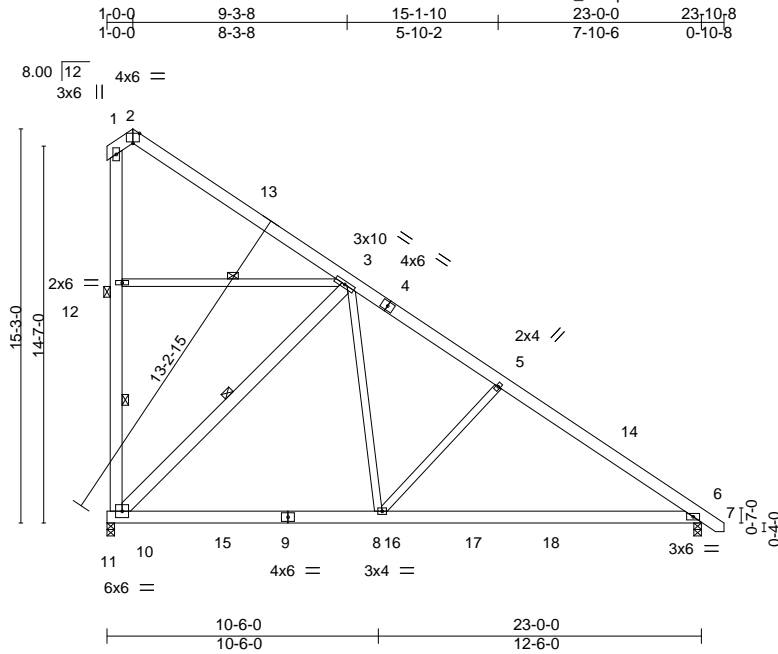

Scale = 1:89.2

Plate Offsets (X,Y)-- [2:0-3-0,Edge]

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.29	Vert(LL)	-0.13	6-8	>999	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.56	Vert(CT)	-0.28	6-8	>970		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.45	Horz(CT)	0.02	6	n/a		
BCDL 10.0	Rep Stress Incr YES	Matrix-S	Wind(LL)	0.03	6-8	>999		
	Code IRC2015/TPI2014						Weight: 219 lb	FT = 20%

LUMBER-

TOP CHORD 2x6 SP No.1
 BOT CHORD 2x6 SP No.1
 WEBS 2x4 SP No.2 *Except*
 1-10,3-10: 2x6 SP No.1

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
 WEBS 1 Row at midpt 10-12, 3-10, 3-12
 JOINTS 1 Brace at Jt(s): 12

REACTIONS.


(size) 10=0-3-8, 6=0-3-8
 Max Horz 10=-482(LC 13)
 Max Uplift 10=-236(LC 13)
 Max Grav 10=1177(LC 20), 6=1071(LC 20)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 3-5=-1052/0, 5-6=-1298/0, 10-12=-259/166, 1-12=-259/166
 BOT CHORD 8-10=0/743, 6-8=0/987
 WEBS 5-8=-424/234, 3-10=-1116/335, 3-8=-26/850

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TC DL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) 0-4-4 to 5-4-13, Interior(1) 5-4-13 to 23-8-9 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 10=236.

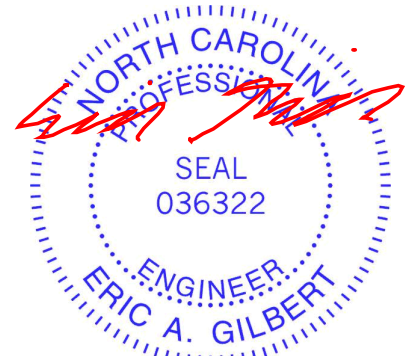

March 31, 2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 10/03/2015 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 218 N. Lee Street, Suite 312, Alexandria, VA 22314.



818 Soundside Road
 Edenton, NC 27932

Job J0520-2117	Truss A5	Truss Type ROOF SPECIAL	Qty 1	Ply 1	Weaver / 27 Mitchell Manor / Harnett	E14244377
-------------------	-------------	----------------------------	----------	----------	--------------------------------------	-----------

Comtech, Inc., Fayetteville, NC - 28314,

8,330 s Mar 23 2020 MiTek Industries, Inc. Tue Mar 31 08:25:42 2020 Page 1

ID:FKRF2G2VvSGFSXRUG_ubJqzaK1d-0M33GgWhQT_y1ID1mV98rxjtcDkgjvVxggzq9yZVTYd

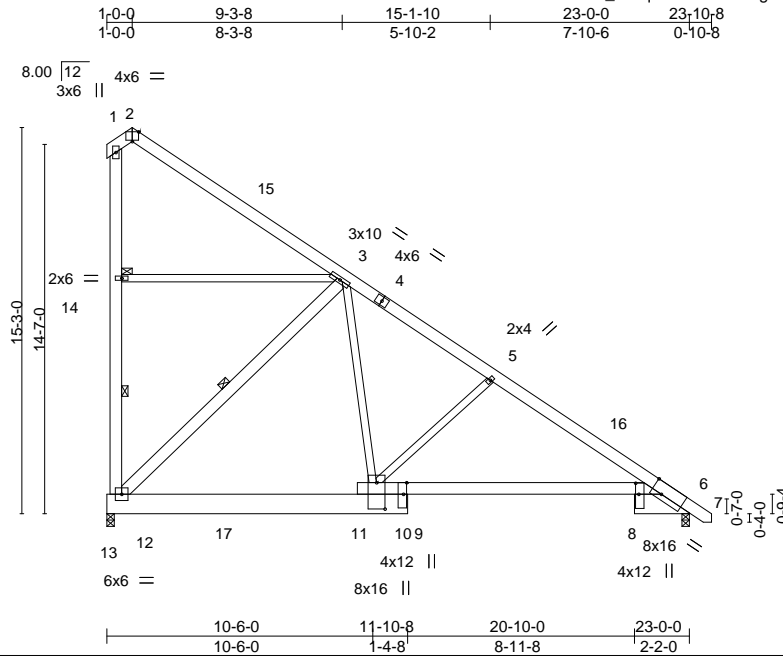


Plate Offsets (X,Y)-- [2:0-3-0,Edge], [6:0-5-0,Edge], [8:0-5-4,0-1-8], [9:0-5-8,Edge], [10:1-0-8,0-4-0]

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.15	TC 0.37	Vert(LL)	-0.12	6-10	>999	MT20	244/190
TCDL 10.0	Lumber DOL	1.15	BC 0.49	Vert(CT)	-0.30	6-10	>887		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.45	Horz(CT)	0.08	6	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-S	Wind(LL)	0.05	6-10	>999		
								Weight: 245 lb	FT = 20%

LUMBER-

TOP CHORD 2x6 SP No.1
 BOT CHORD 2x10 SP No.1 *Except*
 6-11: 2x6 SP No.1
 WEBS 2x4 SP No.2 *Except*
 1-12,3-12: 2x6 SP No.1

BRACING-

TOP CHORD Structural wood sheathing directly applied or 5-11-14 oc purlins, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
 WEBS 1 Row at midpt 12-14, 3-12
 JOINTS 1 Brace at Jt(s): 14

REACTIONS.


(size) 6=0-3-8, 12=0-3-8
 Max Horz 12=-481(LC 13)
 Max Uplift 12=-233(LC 13)
 Max Grav 6=979(LC 20), 12=1127(LC 20)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 3-5=-1079/0, 5-6=-1350/0, 12-14=-256/166, 1-14=-257/166
 BOT CHORD 10-12=0/827, 6-10=0/1044
 WEBS 5-10=-432/206, 3-12=-1146/302, 3-10=0/874

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) 0-4-4 to 5-4-13, Interior(1) 5-4-13 to 23-8-9 zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 12=233.

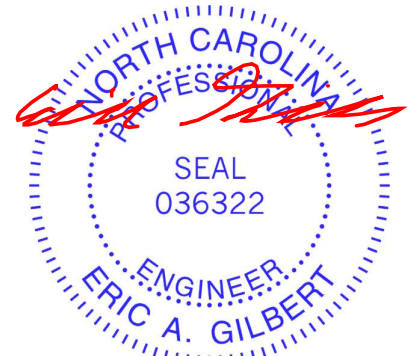

March 31, 2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 10/03/2015 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 218 N. Lee Street, Suite 312, Alexandria, VA 22314.




818 Soundside Road
 Edenton, NC 27932

Job J0520-2117	Truss A6	Truss Type ROOF SPECIAL	Qty 1	Ply 2	Weaver / 27 Mitchell Manor / Harnett	E14244378
-------------------	-------------	----------------------------	----------	----------	--------------------------------------	-----------

Comtech, Inc., Fayetteville, NC - 28314,

8.330 s Mar 23 2020 MiTek Industries, Inc. Tue Mar 31 08:25:43 2020 Page 1

ID:FKRF2G2VvSGFSXRUG_ubJqzaK1d-UYdST0XJbN6pfSoDJdGNO8G2Jd3BSJe4vKiOhPzVTYc

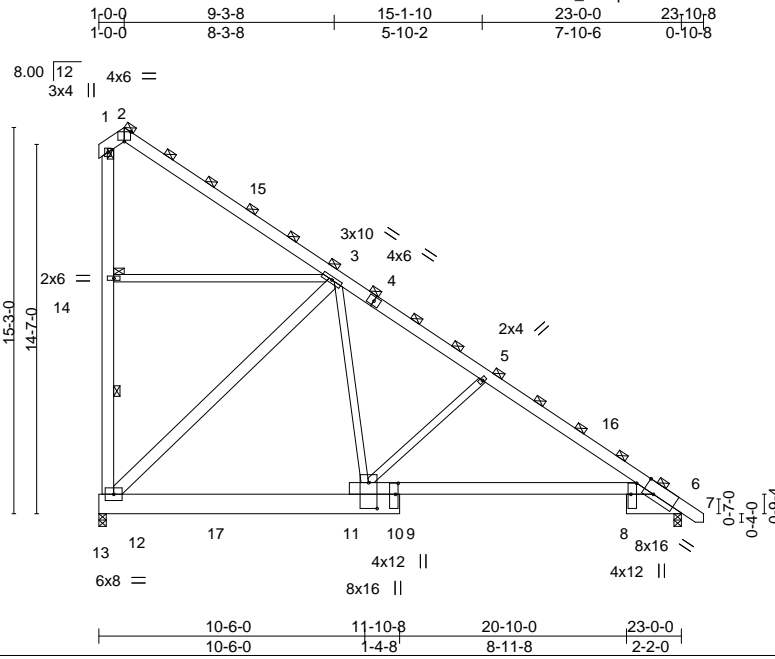

Scale = 1:91.0

Plate Offsets (X,Y)-- [2:0-3-0,Edge], [6:0-5-0,Edge], [8:0-5-4,Edge], [9:0-5-4,0-1-4], [10:1-0-4,0-4-0]

LOADING (psf)	SPACING-	3-6-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.15	TC 0.37	Vert(LL)	-0.11	6-10	>999	MT20	244/190
TCDL 10.0	Lumber DOL	1.15	BC 0.47	Vert(CT)	-0.27	6-10	>999		
BCLL 0.0 *	Rep Stress Incr	NO	WB 0.65	Horz(CT)	0.07	6	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-S	Wind(LL)	0.05	6-10	>999		
								Weight: 490 lb	FT = 20%

LUMBER-

TOP CHORD 2x6 SP No.1
 BOT CHORD 2x10 SP No.1 *Except*
 6-11: 2x6 SP No.1
 WEBS 2x4 SP No.2 *Except*
 1-12,3-12: 2x6 SP No.1

BRACING-

TOP CHORD 2-0-0 oc purlins (6-0-0 max.), except end verticals
 (Switched from sheeted: Spacing > 2-8-0).
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
 WEBS 1 Row at midpt 12-14
 JOINTS 1 Brace at Jt(s): 2, 1, 14

REACTIONS.


(size) 6=0-3-8, 12=0-3-8
 Max Horz 12=-842(LC 13)
 Max Uplift 12=-407(LC 13)
 Max Grav 6=1713(LC 20), 12=1971(LC 20)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-2=-333/223, 2-3=-379/107, 3-5=-1889/0, 5-6=-2362/0, 12-14=-448/290,
 1-14=-449/291
 BOT CHORD 10-12=0/1448, 6-10=0/1827
 WEBS 5-10=-757/361, 3-12=-2006/528, 3-10=0/1529

NOTES-

- 2-ply truss to be connected together with 10d (0.131"x3") nails as follows:
 Top chords connected as follows: 2x6 - 2 rows staggered at 0-9-0 oc.
 Bottom chords connected as follows: 2x10 - 2 rows staggered at 0-9-0 oc, 2x6 - 2 rows staggered at 0-9-0 oc.
 Webs connected as follows: 2x4 - 1 row at 0-9-0 oc, 2x6 - 2 rows staggered at 0-9-0 oc.
- All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TC DL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) 0-4-4 to 5-4-13, Interior(1) 5-4-13 to 23-8-9 zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 12=407.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

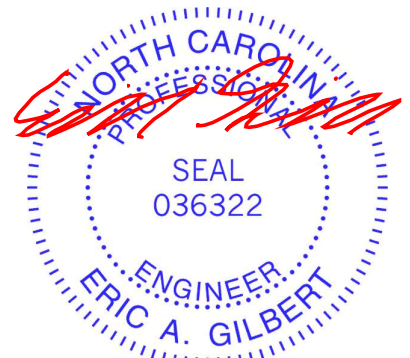

March 31, 2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 10/03/2015 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 218 N. Lee Street, Suite 312, Alexandria, VA 22314.



818 Soundside Road
 Edenton, NC 27932


Job J0520-2117	Truss A7	Truss Type ROOF SPECIAL	Qty 1	Ply 2	Weaver / 27 Mitchell Manor / Harnett	E14244379
-------------------	-------------	----------------------------	----------	----------	--------------------------------------	-----------

Comtech, Inc., Fayetteville, NC - 28314,

8,330 s Mar 23 2020 MiTek Industries, Inc. Tue Mar 31 08:25:44 2020 Page 1

ID:FKRF2G2VvSGFSXRUG_ubJqzaK1d-yIBqhMXxy5EgGcNQtwCcwMpD31PQBmuE8_SxErzVTYb

1-0-0 9-3-8 15-1-10 23-0-0 23-10-8
1-0-0 8-3-8 5-10-2 7-10-6 0-10-8

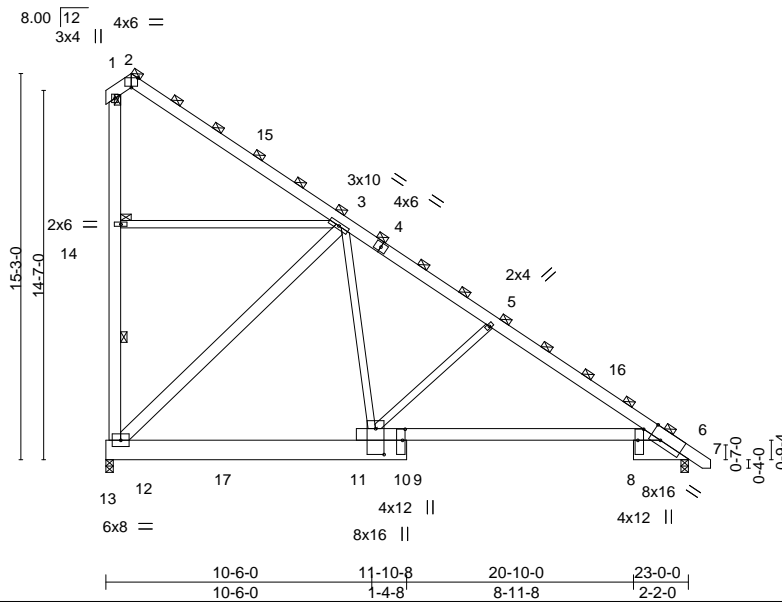

Scale = 1:91.0

Plate Offsets (X,Y)-- [2:0-3-0,Edge], [6:0-5-0,Edge], [8:0-5-4,Edge], [9:0-5-4,0-1-4], [10:1-0-4,0-4-0]

LOADING (psf)	SPACING-	3-6-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.15	TC 0.37	Vert(LL)	-0.11 6-10	>999	360	MT20	244/190
TCDL 10.0	Lumber DOL	1.15	BC 0.47	Vert(CT)	-0.27 6-10	>999	240		
BCLL 0.0 *	Rep Stress Incr	NO	WB 0.65	Horz(CT)	0.07 6	n/a	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-S	Wind(LL)	0.05 6-10	>999	240	Weight: 490 lb	FT = 20%

LUMBER-

TOP CHORD 2x6 SP No.1
 BOT CHORD 2x10 SP No.1 *Except*
 6-11: 2x6 SP No.1
 WEBS 2x4 SP No.2 *Except*
 1-12,3-12: 2x6 SP No.1

BRACING-

TOP CHORD 2-0-0 oc purlins (6-0-0 max.), except end verticals
 (Switched from sheeted: Spacing > 2-8-0).
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
 WEBS 1 Row at midpt 12-14
 JOINTS 1 Brace at Jt(s): 2, 1, 14

REACTIONS.

(size) 6=0-3-8, 12=0-3-8
 Max Horz 12=-842(LC 13)
 Max Uplift 12=-407(LC 13)
 Max Grav 6=1713(LC 20), 12=1971(LC 20)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-2=-333/223, 2-3=-379/107, 3-5=-1889/0, 5-6=-2362/0, 12-14=-448/290,
 1-14=-449/291
 BOT CHORD 10-12=0/1448, 6-10=0/1827
 WEBS 5-10=-757/361, 3-12=-2006/528, 3-10=0/1529

NOTES-

- 2-ply truss to be connected together with 10d (0.131"x3") nails as follows:
 Top chords connected as follows: 2x6 - 2 rows staggered at 0-9-0 oc.
 Bottom chords connected as follows: 2x10 - 2 rows staggered at 0-9-0 oc, 2x6 - 2 rows staggered at 0-9-0 oc.
 Webs connected as follows: 2x4 - 1 row at 0-9-0 oc, 2x6 - 2 rows staggered at 0-9-0 oc.
- All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TC DL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) 0-4-4 to 5-4-13, Interior(1) 5-4-13 to 23-8-9 zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 12=407.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



March 31, 2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 10/03/2015 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 218 N. Lee Street, Suite 312, Alexandria, VA 22314.



818 Soundside Road
 Edenton, NC 27932

Job J0520-2117	Truss A8	Truss Type ROOF TRUSS	Qty 1	Ply 2	Weaver / 27 Mitchell Manor / Harnett	E14244380
-------------------	-------------	--------------------------	----------	----------	--------------------------------------	-----------

Comtech, Inc., Fayetteville, NC - 28314,

8.330 s Mar 23 2020 MiTek Industries, Inc. Tue Mar 31 08:25:45 2020 Page 1

ID:FKRF2G2VvsSGFSXRUG_ubJqzak1d-QxlCuiYZIOMXumycRejrTZLIDRnzwGmNNeBvmHzVTYa



Scale = 1:87.9

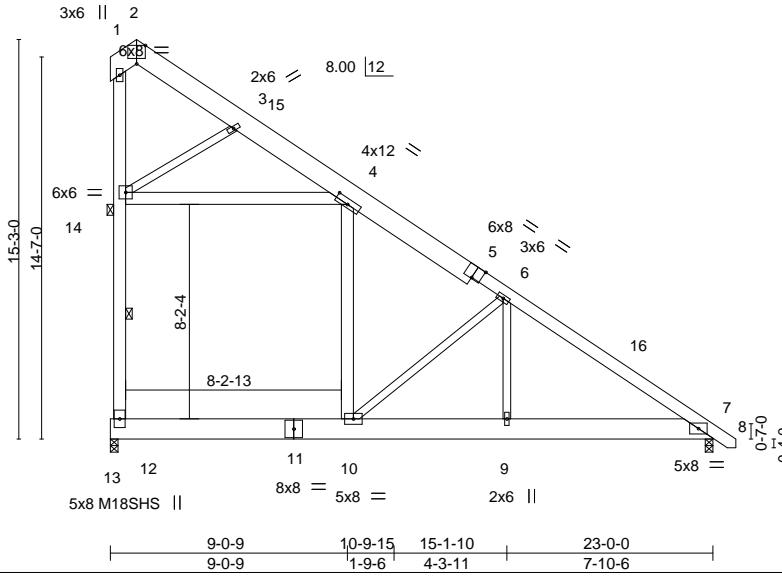


Plate Offsets (X,Y)-- [2:0-4-0,Edge], [4:0-6-0,0-2-8], [5:0-4-0,Edge]

LOADING (psf)	SPACING-	2-8-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.15	TC 0.73	Vert(LL)	-0.21	10	>999	MT20	244/190
TCDL 10.0	Lumber DOL	1.15	BC 0.33	Vert(CT)	-0.46	10	>587	M18SHS	244/190
BCLL 0.0 *	Rep Stress Incr	NO	WB 0.48	Horz(CT)	0.01	7	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-S	Wind(LL)	0.17	10	>999		
								Weight: 563 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x10 SP No.1 *Except* 5-8: 2x6 SP No.1	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x10 SP 2400F 2.0E	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x6 SP No.1 *Except* 6-9,6-10,3-14: 2x4 SP No.2	WEBS 1 Row at midpt 12-14
	JOINTS 1 Brace at Jt(s): 14

REACTIONS. (size) 12=0-3-8, 7=0-3-8
 Max Horz 12=-633(LC 13)
 Max Uplift 12=-7(LC 13)
 Max Grav 12=2288(LC 21), 7=1482(LC 21)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 3-4=-808/104, 4-6=-829/128, 6-7=-2233/92, 12-14=-1091/133
 BOT CHORD 10-12=-119/629, 9-10=0/1720, 7-9=0/1720
 WEBS 4-14=-184/957, 6-9=0/1086, 4-10=0/833, 6-10=-2198/295, 3-14=-1790/225

- NOTES-**
- 2-ply truss to be connected together with 10d (0.131"x3") nails as follows:
 Top chords connected as follows: 2x10 - 2 rows staggered at 0-9-0 oc, 2x6 - 2 rows staggered at 0-9-0 oc.
 Bottom chords connected as follows: 2x10 - 2 rows staggered at 0-9-0 oc.
 Webs connected as follows: 2x6 - 2 rows staggered at 0-9-0 oc, 2x4 - 1 row at 0-9-0 oc.
 - All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
 - Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) 0-4-4 to 5-4-13, Interior(1) 5-4-13 to 23-8-9 zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - All plates are MT20 plates unless otherwise indicated.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - Ceiling dead load (10.0 psf) on member(s). 4-14; Wall dead load (5.0psf) on member(s).4-10
 - Bottom chord live load (40.0 psf) and additional bottom chord dead load (10.0 psf) applied only to room. 10-12
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 12.
 - Attic room checked for L/360 deflection.



March 31, 2020

Job J0520-2117	Truss A9	Truss Type ROOF TRUSS	Qty 3	Ply 1	Weaver / 27 Mitchell Manor / Harnett	E14244381
-------------------	-------------	--------------------------	----------	----------	--------------------------------------	-----------

Comtech, Inc., Fayetteville, NC - 28314,

8.330 s Mar 23 2020 MiTek Industries, Inc. Tue Mar 31 08:25:46 2020 Page 1

ID:FKRF2G2VvSGFSXRUG_ubJqzaK1d-v7Ja52ZBTiUOWvXo?LE4?nuQTq6LfAXblx2IkzVTYZ



Scale = 1:90.4

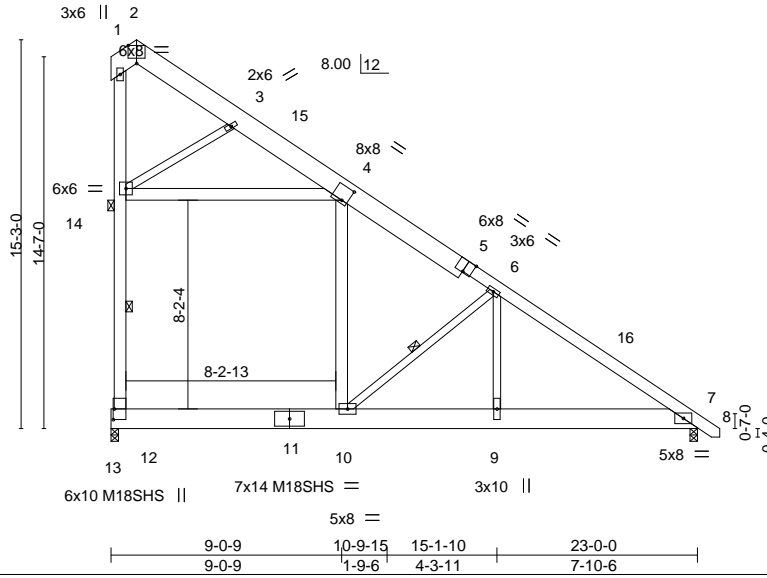


Plate Offsets (X,Y)-- [2:0-4-0,Edge], [4:0-2-12,0-6-8], [5:0-4-0,Edge], [12:0-5-0,0-0-8]

LOADING (psf)	SPACING-	CSL	DEFL.	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.96	in (loc) l/defl L/d	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.45	Vert(LL) -0.32 10 >844 360	M18SHS	244/190
BCLL 0.0 *	Lumber DOL 1.15	WB 0.60	Vert(CT) -0.69 10 >392 240		
BCDL 10.0	Rep Stress Incr YES	Matrix-S	Horz(CT) 0.01 7 n/a n/a		
	Code IRC2015/TPI2014		Wind(LL) 0.26 10 >999 240		
				Weight: 282 lb	FT = 20%

LUMBER-

TOP CHORD 2x10 SP No.1 *Except*
5-8: 2x6 SP No.1
BOT CHORD 2x10 SP 2400F 2.0E
WEBS 2x6 SP No.1 *Except*
6-9,6-10,3-14: 2x4 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied, except end verticals.
BOT CHORD Rigid ceiling directly applied or 8-6-0 oc bracing.
WEBS 1 Row at midpt 12-14, 6-10
JOINTS 1 Brace at Jt(s): 14

REACTIONS.

(size) 12=0-3-8, 7=0-3-8
Max Horz 12=-475(LC 13)
Max Uplift 12=-5(LC 13)
Max Grav 12=1716(LC 21), 7=1111(LC 21)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 3-4=-606/78, 4-6=-622/96, 6-7=-1675/69, 12-14=-818/100
BOT CHORD 10-12=-89/471, 9-10=0/1290, 7-9=0/1290
WEBS 4-14=-138/718, 6-9=0/815, 4-10=0/624, 6-10=-1648/221, 3-14=-1342/169

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCCL=6.0psf; BCCL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) 0-4-4 to 5-4-13, Interior(1) 5-4-13 to 23-8-9 zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- All plates are MT20 plates unless otherwise indicated.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Ceiling dead load (10.0 psf) on member(s). 4-14; Wall dead load (5.0psf) on member(s).4-10
- Bottom chord live load (40.0 psf) and additional bottom chord dead load (10.0 psf) applied only to room. 10-12
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 12.
- Attic room checked for L/360 deflection.



March 31, 2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 10/03/2015 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 218 N. Lee Street, Suite 312, Alexandria, VA 22314.




818 Soundside Road
Edenton, NC 27932

Job J0520-2117	Truss A9GE	Truss Type COMMON SUPPORTED GAB	Qty 1	Ply 1	Weaver / 27 Mitchell Manor / Harnett	E14244382
					Job Reference (optional)	

Comtech, Inc., Fayetteville, NC - 28314,

8.330 s Mar 23 2020 MiTek Industries, Inc. Tue Mar 31 08:25:47 2020 Page 1

ID:FKRF2G2VvSGFSXRUG_ubJqzaK1d-NKsyJOapE0de736_Y3IJY_RpAEYaOFHqygbqAzVTYY

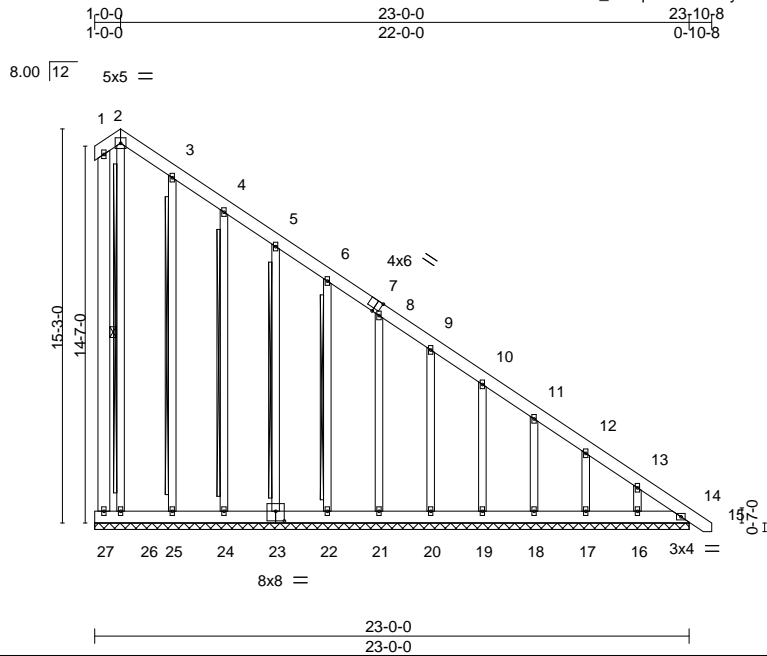

Scale = 1:89.2

Plate Offsets (X,Y)-- [7:0-2-9,Edge], [23:0-4-0,0-4-8]

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.15	TC 0.06	Vert(LL) 0.00	14	n/r	120	MT20	244/190
TCDL 10.0	Lumber DOL 1.15	BC 0.06	Vert(CT) 0.00	14	n/r	120		
BCLL 0.0 *	Rep Stress Incr YES	WB 0.16	Horz(CT) 0.01	14	n/a	n/a		
BCDL 10.0	Code IRC2015/TPI2014	Matrix-S						
							Weight: 280 lb	FT = 20%

LUMBER-
 TOP CHORD 2x6 SP No.1
 BOT CHORD 2x6 SP No.1
 WEBS 2x6 SP No.1
 OTHERS 2x4 SP No.2

BRACING-
 TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
 WEBS 1 Row at midpt 1-27
 T-Brace: 2x4 SPF No.2 - 3-25, 4-24, 5-23, 6-22
 2x6 SPF No.2 - 2-26
 Fasten (2X) T and I braces to narrow edge of web with 10d (0.131"x3") nails, 6in o.c., with 3in minimum end distance.
 Brace must cover 90% of web length.

REACTIONS. All bearings 23-0-0.
 (lb) - Max Horz 27=-695(LC 13)
 Max Uplift All uplift 100 lb or less at joint(s) 27, 26, 25, 24, 23, 22, 21, 20, 19, 18, 17 except 16=-116(LC 13), 14=-100(LC 11)
 Max Grav All reactions 250 lb or less at joint(s) 27, 26, 25, 24, 23, 22, 21, 20, 19, 18, 17, 16 except 14=414(LC 13)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 5-6=-254/197, 6-8=-329/256, 8-9=-404/314, 9-10=-479/373, 10-11=-554/432, 11-12=-629/491, 12-13=-705/550, 13-14=-794/626
 BOT CHORD 26-27=-536/694, 25-26=-536/694, 24-25=-536/694, 23-24=-536/694, 22-23=-536/694, 21-22=-536/694, 20-21=-536/694, 19-20=-536/694, 18-19=-536/694, 17-18=-536/694, 16-17=-536/694, 14-16=-536/694

NOTES-

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TC DL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Corner(3) 0-4-4 to 5-4-13, Exterior(2) 5-4-13 to 23-8-9 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- 4) All plates are 2x4 MT20 unless otherwise indicated.
- 5) Gable requires continuous bottom chord bearing.
- 6) Gable studs spaced at 2-0-0 oc.
- 7) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 8) * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 9) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 27, 26, 25, 24, 23, 22, 21, 20, 19, 18, 17 except (jt=lb) 16=116, 14=100.
- 10) Warning: Additional permanent and stability bracing for truss system (not part of this component design) is always required.



March 31, 2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 10/03/2015 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 218 N. Lee Street, Suite 312, Alexandria, VA 22314.




818 Soundside Road
 Edenton, NC 27932

Job J0520-2117	Truss B1	Truss Type COMMON SUPPORTED GAB	Qty 5	Ply 1	Weaver / 27 Mitchell Manor / Harnett	E14244383
-------------------	-------------	------------------------------------	----------	----------	--------------------------------------	-----------

Comtech, Inc., Fayetteville, NC - 28314,

8.330 s Mar 23 2020 MiTek Industries, Inc. Tue Mar 31 08:25:49 2020 Page 1

ID:FKRF2G2VvSGFSXRUG_ubJqzaK1d-Ji_jk3b4mdtyNNGNgTndPW6m20cs0hzHG9iv2zVTYW



Scale = 1:87.8

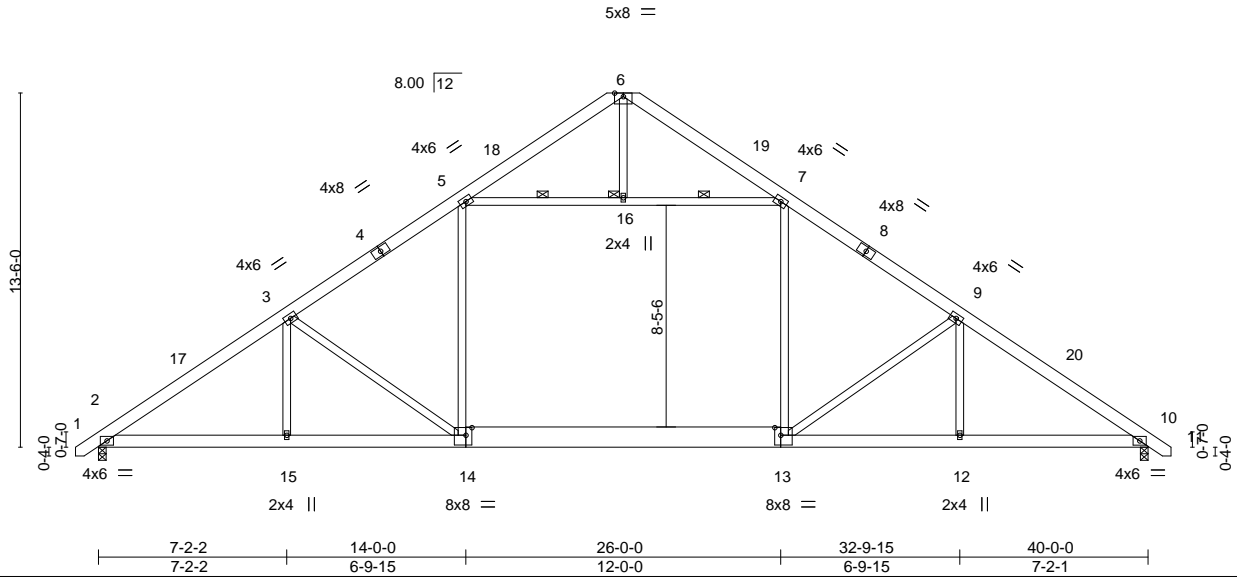


Plate Offsets (X,Y)-- [8:0-0-0,0-0-0], [13:0-2-12,0-3-8], [14:0-2-12,0-3-8]

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.15	TC 0.25	Vert(LL)	-0.38 14-15	>999	360	MT20	244/190
TCDL 10.0	Lumber DOL	1.15	BC 0.86	Vert(CT)	-0.44 12-13	>999	240		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.74	Horz(CT)	0.06 10	n/a	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-S	Wind(LL)	0.33 14-15	>999	240		
								Weight: 316 lb	FT = 20%

LUMBER-

TOP CHORD 2x6 SP No.1
 BOT CHORD 2x6 SP No.1 *Except*
 13-14: 2x10 SP No.1
 WEBS 2x4 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 4-7-8 oc purlins.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
 WEBS 1 Row at midpt 5-16, 7-16
 JOINTS 1 Brace at Jt(s): 16

REACTIONS.


(size) 2=0-3-8, 10=0-3-8
 Max Horz 2=331(LC 11)
 Max Uplift 2=-96(LC 12), 10=-96(LC 13)
 Max Grav 2=1796(LC 19), 10=1796(LC 20)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-2750/460, 3-5=-2355/477, 5-6=-484/192, 6-7=-484/192, 7-9=-2357/477,
 9-10=-2751/460
 BOT CHORD 2-15=-245/2414, 14-15=-245/2414, 13-14=-82/1966, 12-13=-247/2167, 10-12=-247/2167
 WEBS 5-14=-6/763, 7-13=-6/764, 5-16=-1571/395, 7-16=-1571/395, 3-15=-43/260,
 3-14=-642/238, 9-12=-48/260, 9-13=-642/240

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TC DL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) -0-8-9 to 3-8-4, Interior(1) 3-8-4 to 20-0-0, Exterior(2) 20-0-0 to 24-4-13, Interior(1) 24-4-13 to 40-8-9 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 10.

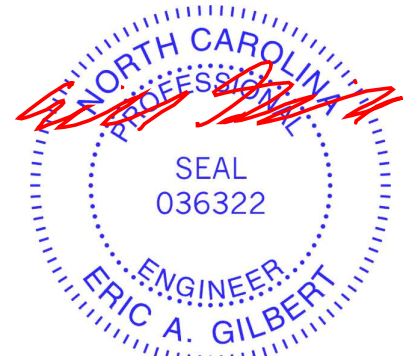

March 31, 2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 10/03/2015 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 218 N. Lee Street, Suite 312, Alexandria, VA 22314.



818 Soundside Road
 Edenton, NC 27932

Job J0520-2117	Truss B1GE	Truss Type COMMON SUPPORTED GAB	Qty 1	Ply 1	Weaver / 27 Mitchell Manor / Harnett	E14244384
Comtech, Inc., Fayetteville, NC - 28314,					8.330 s Mar 23 2020 MiTek Industries, Inc. Tue Mar 31 08:25:51 2020 Page 1	
-0-10-8 0-10-8					40-0-0 20-0-0	
20-0-0 20-0-0					40-10-8 0-10-8	
5x8 =					Scale = 1:85.8	

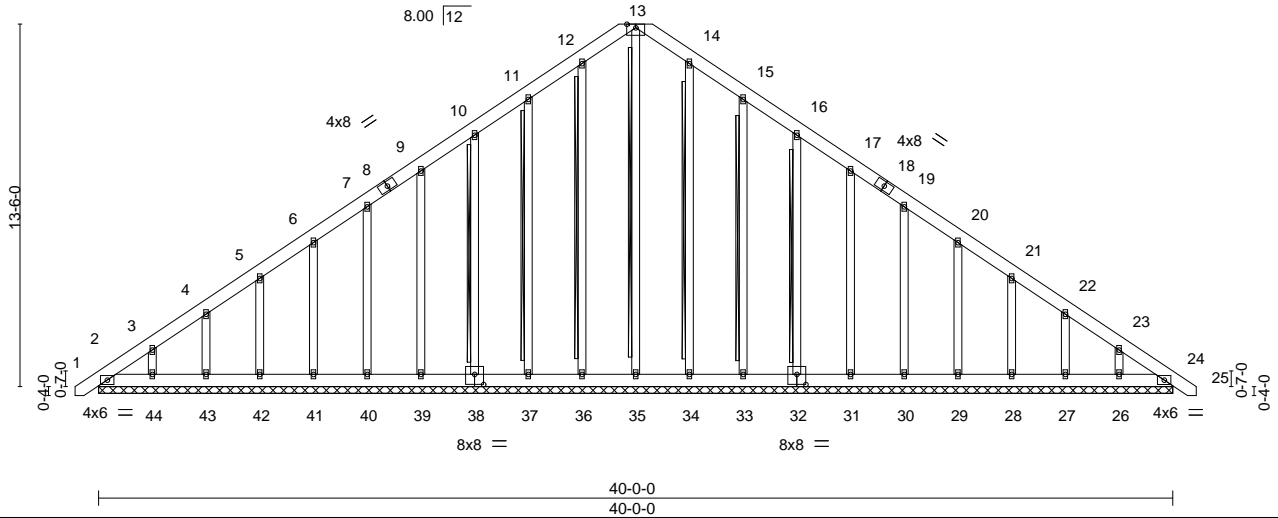


Plate Offsets (X,Y)--	[32:0-4-0,0-4-8], [38:0-4-0,0-4-8]				
LOADING (psf)	SPACING- 2-0-0	CSI.	DEFL. in (loc) l/defl L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.15	TC 0.06	Vert(LL) 0.00 24 n/r 120	MT20	244/190
TCDL 10.0	Lumber DOL 1.15	BC 0.03	Vert(CT) 0.00 24 n/r 120		
BCLL 0.0 *	Rep Stress Incr YES	WB 0.25	Horz(CT) 0.01 24 n/a n/a		
BCDL 10.0	Code IRC2015/TPI2014	Matrix-S		Weight: 399 lb	FT = 20%


LUMBER-
TOP CHORD 2x6 SP No.1
BOT CHORD 2x6 SP No.1
OTHERS 2x4 SP No.2

BRACING-
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS T-Brace: 2x4 SPF No.2 - 13-35, 12-36, 11-37, 10-38, 14-34, 15-33, 16-32
Fasten (2X) T and I braces to narrow edge of web with 10d (0.131"x3") nails, 6in o.c., with 3in minimum end distance.
Brace must cover 90% of web length.

REACTIONS. All bearings 40-0-0.
(lb) - Max Horz 2=414(LC 11)
Max Uplift All uplift 100 lb or less at joint(s) 35, 36, 38, 39, 40, 41, 42, 43, 34, 32, 31, 30, 29, 28, 27, 24 except 2=110(LC 8), 37=102(LC 12), 44=105(LC 12), 33=106(LC 13), 26=102(LC 13)
Max Grav All reactions 250 lb or less at joint(s) 2, 36, 37, 38, 39, 40, 41, 42, 43, 44, 34, 33, 32, 31, 30, 29, 28, 27, 26, 24 except 35=277(LC 13)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-441/318, 3-4=-357/284, 4-5=-292/257, 10-11=-216/283, 11-12=-284/333, 12-13=-310/354, 13-14=-310/354, 14-15=-284/319, 22-23=-263/167, 23-24=-346/238
BOT CHORD 2-44=-212/326, 43-44=-212/326, 42-43=-212/326, 41-42=-212/326, 40-41=-212/326, 39-40=-212/326, 38-39=-212/326, 37-38=-212/326, 36-37=-212/326, 35-36=-212/326, 34-35=-212/326, 33-34=-212/326, 32-33=-212/326, 31-32=-212/326, 30-31=-212/326, 29-30=-212/326, 28-29=-212/326, 27-28=-212/326, 26-27=-212/326, 24-26=-212/326
WEBS 13-35=-256/167

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TC DL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Corner(3) 0-8-9 to 3-8-4, Exterior(2) 3-8-4 to 20-0-0, Corner(3) 20-0-0 to 24-4-13, Exterior(2) 24-4-13 to 40-8-9 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
 - All plates are 2x4 MT20 unless otherwise indicated.
 - Gable requires continuous bottom chord bearing.
 - Gable studs spaced at 2-0-0 oc.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 35, 36, 38, 39, 40, 41, 42, 43, 34, 32, 31, 30, 29, 28, 27, 24 except (jt=lb) 2=110, 37=102, 44=105, 33=106, 26=102.
 - Warning: Additional permanent and stability bracing for truss system (not part of this component design) is always required.

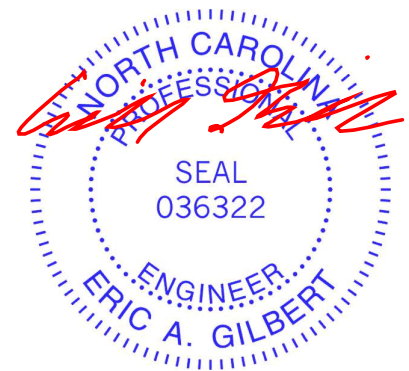


Job J0520-2117	Truss C1	Truss Type ATTIC	Qty 1	Ply 1	Weaver / 27 Mitchell Manor / Harnett	E14244385
-------------------	-------------	---------------------	----------	----------	--------------------------------------	-----------

Comtech, Inc., Fayetteville, NC - 28314,

8.330 s Mar 23 2020 MiTek Industries, Inc. Tue Mar 31 08:25:53 2020 Page 1

ID:FKRF2G2VvSGFSXRUG_ubJqzaK1d-BUEEZReaqsNOR_Z8vJsoFhmTFTxoxQZCu7w2qzVTYS



6x8 =

Scale = 1:81.1

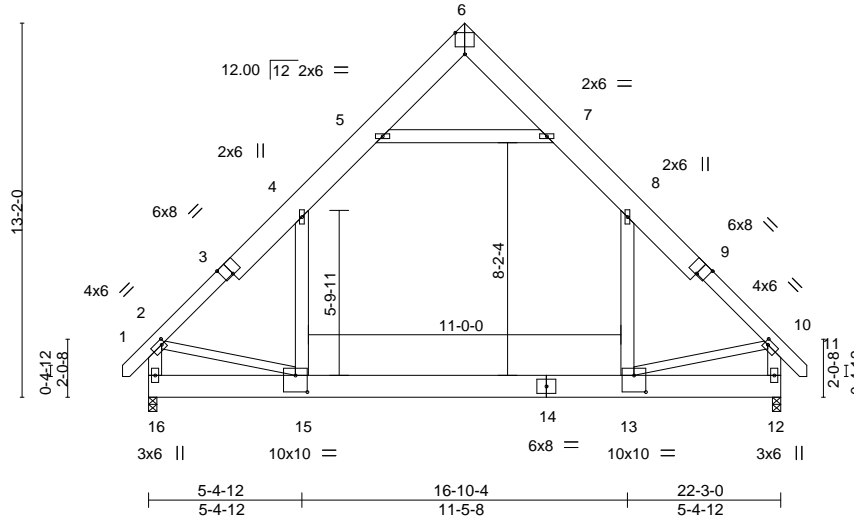


Plate Offsets (X,Y)-- [2:0-1-8,0-2-0], [3:0-4-0,Edge], [6:0-4-0,Edge], [9:0-4-0,Edge], [10:0-1-8,0-2-0], [13:0-5-0,0-7-0], [15:0-5-0,0-7-0]

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.15	TC 0.33	Vert(LL)	-0.12	13-15	>999	MT20	244/190
TCDL 10.0	Lumber DOL	1.15	BC 0.58	Vert(CT)	-0.19	13-15	>999		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.31	Horz(CT)	0.01	12	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-S	Wind(LL)	0.05	15	>999	Weight: 268 lb	FT = 20%

LUMBER-

TOP CHORD 2x10 SP No.1 *Except*
1-3,9-11: 2x6 SP No.1
BOT CHORD 2x10 SP No.1
WEBS 2x6 SP No.1 *Except*
2-15,10-13: 2x4 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 5-9-8 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 16=0-3-8, 12=0-3-8
Max Horz 16=-419(LC 10)
Max Grav 16=1469(LC 21), 12=1469(LC 20)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-4=-1675/22, 4-5=-1045/187, 7-8=-1045/187, 8-10=-1675/21, 2-16=-1615/65,
10-12=-1616/65
BOT CHORD 15-16=-425/555, 13-15=0/1123
WEBS 5-7=-1194/265, 4-15=0/744, 8-13=0/744, 2-15=-1/1037, 10-13=-10/1044

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCCL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Corner(3) 0-9-0 to 3-7-13, Exterior(2) 3-7-13 to 11-2-0, Corner(3) 11-2-0 to 15-6-13, Exterior(2) 15-6-13 to 23-1-0 zone; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Ceiling dead load (10.0 psf) on member(s). 4-5, 7-8, 5-7; Wall dead load (5.0psf) on member(s).4-15, 8-13
- Bottom chord live load (40.0 psf) and additional bottom chord dead load (10.0 psf) applied only to room. 13-15
- Attic room checked for L/360 deflection.



March 31, 2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 10/03/2015 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 218 N. Lee Street, Suite 312, Alexandria, VA 22314.




818 Soundside Road
Edenton, NC 27932

Job J0520-2117	Truss C2	Truss Type ATTIC	Qty 8	Ply 1	Weaver / 27 Mitchell Manor / Harnett	E14244386
-------------------	-------------	---------------------	----------	----------	--------------------------------------	-----------

Comtech, Inc., Fayetteville, NC - 28314,

8.330 s Mar 23 2020 MiTek Industries, Inc. Tue Mar 31 08:25:54 2020 Page 1
ID:FKRF2G2VvSGFSXRUG_ubJqzaK1d-ggocnnfCb9VFT88LT1NyKTDx03o8WOaiRYtTaGzVTYR



6x8 =

Scale = 1:81.1


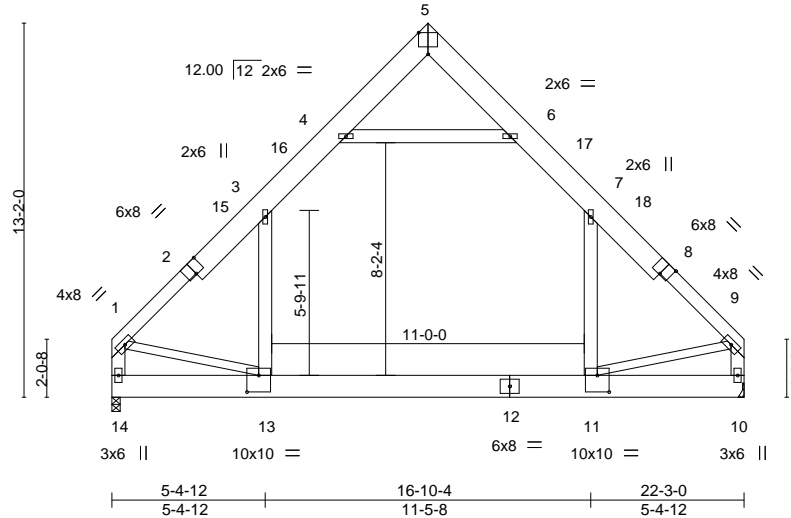


Plate Offsets (X,Y)-- [2:0-4-0,Edge], [5:0-4-0,Edge], [8:0-4-0,Edge], [11:0-5-0,0-7-0], [13:0-5-0,0-7-0]

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.15	TC 0.34	Vert(LL)	-0.12 11-13	>999	360	MT20	244/190
TCDL 10.0	Lumber DOL	1.15	BC 0.58	Vert(CT)	-0.20 11-13	>999	240		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.31	Horz(CT)	0.01 10	n/a	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-S	Wind(LL)	0.04 13	>999	240		
								Weight: 262 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x10 SP No.1 *Except* 1-2,8-9: 2x6 SP No.1	TOP CHORD Structural wood sheathing directly applied or 5-8-7 oc purlins, except end verticals.
BOT CHORD 2x10 SP No.1	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x6 SP No.1 *Except* 1-13,9-11: 2x4 SP No.2	

REACTIONS. (size) 14=0-3-8, 10=Mechanical
Max Horz 14=-256(LC 8)
Max Grav 14=1434(LC 21), 10=1434(LC 20)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 1-3=-1657/0, 3-4=-1042/150, 6-7=-1042/150, 7-9=-1657/0, 1-14=-1567/0, 9-10=-1568/0
BOT CHORD 13-14=-284/368, 11-13=0/1079
WEBS 4-6=-1225/195, 3-13=0/728, 7-11=0/728, 1-13=0/1036, 9-11=0/1039

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCCL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) 0-3-4 to 4-8-1, Interior(1) 4-8-1 to 11-2-0, Exterior(2) 11-2-0 to 15-6-13, Interior(1) 15-6-13 to 22-0-12 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - Ceiling dead load (10.0 psf) on member(s). 3-4, 6-7, 4-6; Wall dead load (5.0psf) on member(s).3-13, 7-11
 - Bottom chord live load (40.0 psf) and additional bottom chord dead load (10.0 psf) applied only to room. 11-13
 - Refer to girder(s) for truss to truss connections.
 - Attic room checked for L/360 deflection.




March 31, 2020

Job J0520-2117	Truss C3	Truss Type ATTIC	Qty 1	Ply 2	Weaver / 27 Mitchell Manor / Harnett	E14244387
-------------------	-------------	---------------------	----------	----------	--------------------------------------	-----------

Comtech, Inc., Fayetteville, NC - 28314,

8,330 s Mar 23 2020 MiTek Industries, Inc. Tue Mar 31 08:25:55 2020 Page 1

ID:FKRF2G2VvSGFSXRUG_ubJqzaK1d-8sl__7gqMTd65jX0kuBtgm5FT6WFr1sgCc07izVTYQ



6x8 =

Scale = 1:81.1

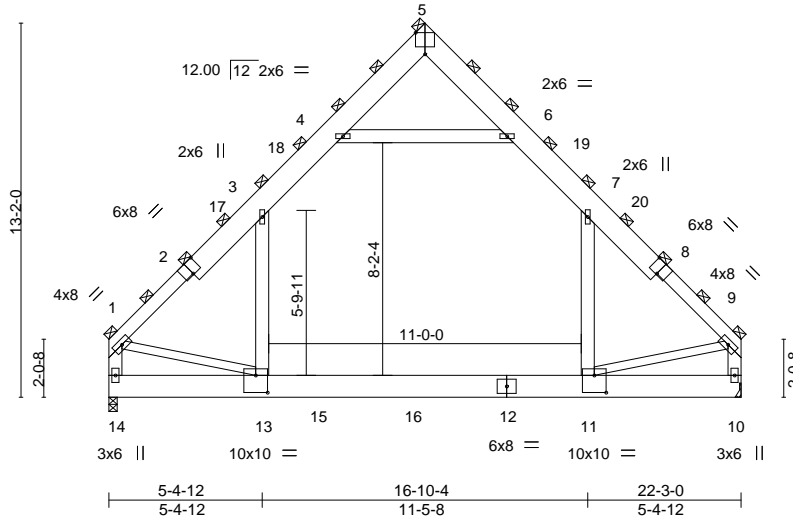


Plate Offsets (X,Y)-- [2:0-4-0,Edge], [5:0-4-0,Edge], [8:0-4-0,Edge], [11:0-5-0,0-7-4], [13:0-5-0,0-7-4]

LOADING (psf)	SPACING-	3-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.15	TC 0.44	Vert(LL)	-0.14 11-13	>999	360	MT20	244/190
TCDL 10.0	Lumber DOL	1.15	BC 0.76	Vert(CT)	-0.22 11-13	>999	240		
BCLL 0.0 *	Rep Stress Incr	NO	WB 0.24	Horz(CT)	0.01 10	n/a	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-S	Wind(LL)	0.04 11-13	>999	240		
								Weight: 525 lb	FT = 20%

LUMBER-

TOP CHORD 2x10 SP No.1 *Except*
1-2,8-9: 2x6 SP No.1
BOT CHORD 2x10 SP No.1
WEBS 2x6 SP No.1 *Except*
1-13,9-11: 2x4 SP No.2

BRACING-

TOP CHORD 2-0-0 oc purlins (6-0-0 max.), except end verticals
(Switched from sheeted: Spacing > 2-8-0).
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 14=0-3-8, 10=Mechanical
Max Horz 14=-384(LC 8)
Max Grav 14=2783(LC 21), 10=2577(LC 20)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.


TOP CHORD 1-3=-3251/46, 3-4=-1860/268, 4-5=-57/484, 5-6=-61/417, 6-7=-1926/277, 7-9=-3167/41,
1-14=-3094/67, 9-10=-3003/54
BOT CHORD 13-14=-426/576, 11-13=0/2085
WEBS 4-6=-2511/389, 3-13=0/1662, 7-11=0/1480, 1-13=0/1970, 9-11=0/2076

NOTES-

- 2-ply truss to be connected together with 10d (0.131"x3") nails as follows:
Top chords connected as follows: 2x6 - 2 rows staggered at 0-9-0 oc, 2x10 - 2 rows staggered at 0-9-0 oc.
Bottom chords connected as follows: 2x10 - 2 rows staggered at 0-9-0 oc.
Webs connected as follows: 2x6 - 2 rows staggered at 0-9-0 oc, 2x4 - 1 row at 0-9-0 oc.
- All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TC DL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) 0-3-4 to 4-8-1, Interior(1) 4-8-1 to 11-2-0, Exterior(2) 11-2-0 to 15-6-13, Interior(1) 15-6-13 to 22-0-12 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Ceiling dead load (10.0 psf) on member(s). 3-4, 6-7, 4-6; Wall dead load (5.0psf) on member(s).3-13, 7-11
- Bottom chord live load (40.0 psf) and additional bottom chord dead load (10.0 psf) applied only to room. 11-13
- Refer to girder(s) for truss to truss connections.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
- Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 529 lb down and 76 lb up at 7-4-8, and 529 lb down and 76 lb up at 10-8-8 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.
- Attic room checked for L/360 deflection.

LOAD CASE(S) Standard

Continued on page 2

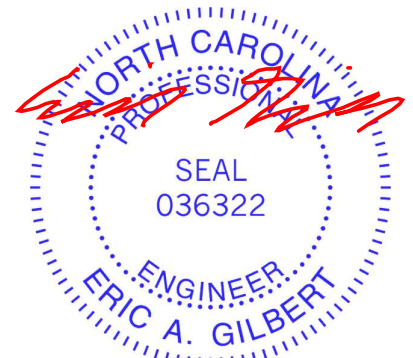

March 31, 2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 10/03/2015 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 218 N. Lee Street, Suite 312, Alexandria, VA 22314.



818 Soundside Road
Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	Weaver / 27 Mitchell Manor / Harnett	E14244387
J0520-2117	C3	ATTIC	1	2	Job Reference (optional)	

Comtech, Inc. Fayetteville, NC - 28314,

8.330 s Mar 23 2020 MiTek Industries, Inc. Tue Mar 31 08:25:56 2020 Page 2
 ID:FKRF2G2VvSGFSXRUG_ubJqzak1d-c3vMCThT7nlziSljaRPQPuJG?sRL_IG?usMaf8zVTYP

LOAD CASE(S) Standard

1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15

Uniform Loads (plf)

Vert: 13-14=-30, 11-13=-60, 10-11=-30, 1-3=-90, 3-4=-120, 4-5=-90, 5-6=-90, 6-7=-120, 7-9=-90, 4-6=-30

Drag: 3-13=-15, 7-11=-15

Concentrated Loads (lb)

Vert: 15=-300(B) 16=-300(B)

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 10/03/2015 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 218 N. Lee Street, Suite 312, Alexandria, VA 22314.




818 Soundside Road
 Edenton, NC 27932

Job J0520-2117	Truss G1	Truss Type FINK	Qty 6	Ply 1	Weaver / 27 Mitchell Manor / Harnett	E14244388
-------------------	-------------	--------------------	----------	----------	--------------------------------------	-----------

Comtech, Inc., Fayetteville, NC - 28314,

8,330 s Mar 23 2020 MiTek Industries, Inc. Tue Mar 31 08:25:57 2020 Page 1

ID:FKRF2G2VvSGFSXRUG_ubJqzaK1d-4FTkPoh5u4tqKctv89xfy5rOUGsPjkb87W57BbzVTYO



Scale = 1:53.7

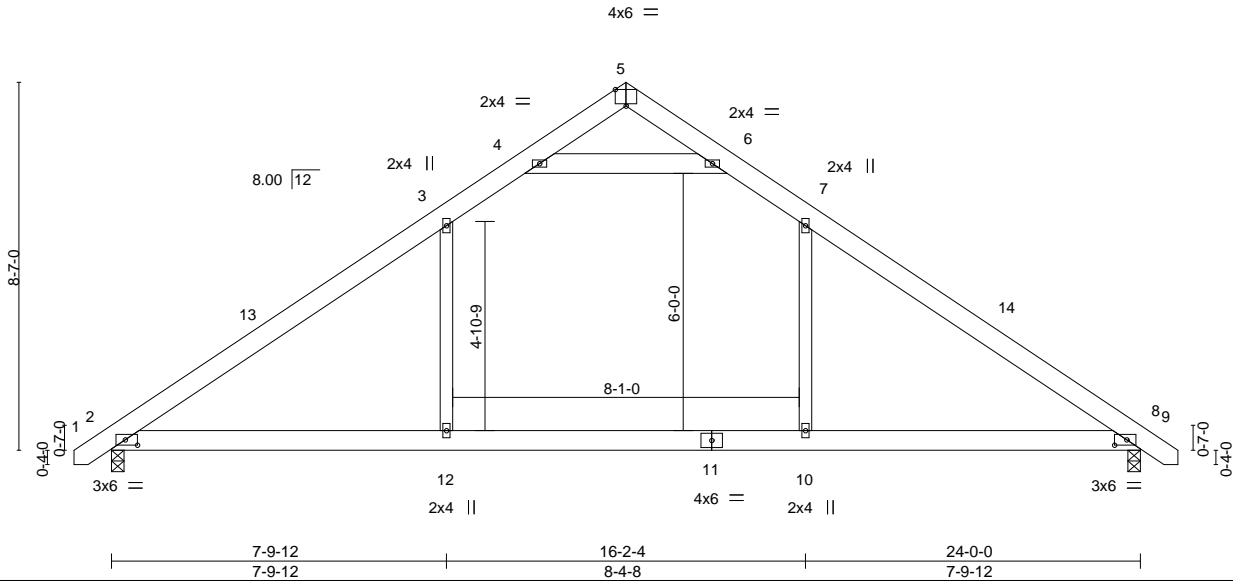


Plate Offsets (X,Y)-- [2:0-3-6,0-1-8], [5:0-3-0,Edge], [8:0-3-6,0-1-8]

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.59	Vert(LL)	-0.17	10-12	>999	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.41	Vert(CT)	-0.24	10-12	>999		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.30	Horz(CT)	0.02	8	n/a		
BCDL 10.0	Rep Stress Incr YES	Matrix-S	Wind(LL)	0.15	2-12	>999		
	Code IRC2015/TPI2014						Weight: 155 lb	FT = 20%

LUMBER-
 TOP CHORD 2x6 SP No.1
 BOT CHORD 2x6 SP No.1
 WEBS 2x4 SP No.2 *Except*
 4-6: 2x6 SP No.1

BRACING-
 TOP CHORD Structural wood sheathing directly applied or 5-8-12 oc purlins.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (size) 2=0-3-8, 8=0-3-8
 Max Horz 2=-203(LC 10)
 Max Uplift 2=-62(LC 12), 8=-62(LC 13)
 Max Grav 2=1118(LC 19), 8=1118(LC 20)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-3=-1548/251, 3-4=-1077/310, 4-5=-98/433, 5-6=-98/433, 6-7=-1077/310,
 7-8=-1548/251
 BOT CHORD 2-12=-54/1187, 10-12=-54/1187, 8-10=-54/1187
 WEBS 3-12=0/469, 7-10=0/469, 4-6=-1618/472

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) -0-8-9 to 3-8-4, Interior(1) 3-8-4 to 12-0-0, Exterior(2) 12-0-0 to 16-2-4, Interior(1) 16-2-4 to 24-8-9 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 8.



March 31, 2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 10/03/2015 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 218 N. Lee Street, Suite 312, Alexandria, VA 22314.




818 Soundside Road
 Edenton, NC 27932

Job J0520-2117	Truss G1GE	Truss Type GABLE	Qty 1	Ply 1	Weaver / 27 Mitchell Manor / Harnett Job Reference (optional)	E14244389
-------------------	---------------	---------------------	----------	----------	--	-----------

Comtech, Inc., Fayetteville, NC - 28314,

8,330 s Mar 23 2020 MiTek Industries, Inc. Tue Mar 31 08:25:58 2020 Page 1
ID:FKRF2G2VvSGFSXRUG_ubJqzaK1d-YR17d8jifO?hylS6isSuVJOhrglSD2IMArhj1zVTYN



Scale = 1:54.1

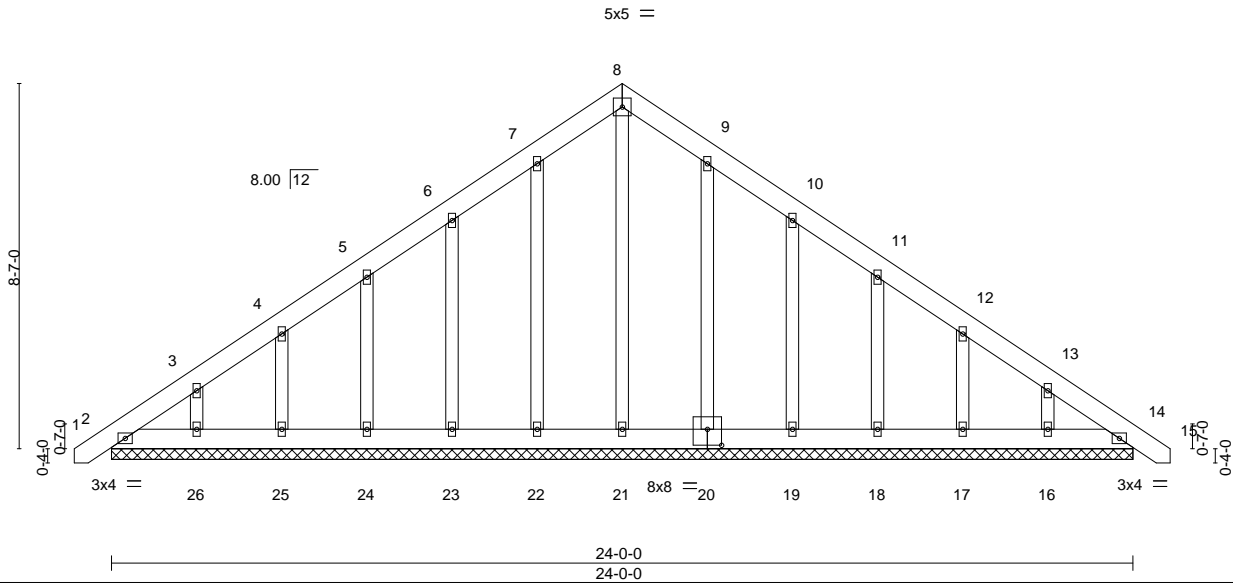



Plate Offsets (X,Y)-- [20:0-4-0,0-4-8]					
LOADING (psf)	SPACING- 2-0-0	CSI.	DEFL. in (loc) l/defl L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.15	TC 0.03	Vert(LL) 0.00 14 n/r 120	MT20	244/190
TCDL 10.0	Lumber DOL 1.15	BC 0.02	Vert(CT) 0.00 14 n/r 120		
BCLL 0.0 *	Rep Stress Incr YES	WB 0.16	Horz(CT) 0.00 14 n/a n/a		
BCDL 10.0	Code IRC2015/TPI2014	Matrix-S		Weight: 195 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x6 SP No.1	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD 2x6 SP No.1	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
OTHERS 2x4 SP No.2	

REACTIONS. All bearings 24-0-0.
 (lb) - Max Horz 2=-254(LC 20)
 Max Uplift All uplift 100 lb or less at joint(s) 2, 14, 22, 23, 24, 25, 26, 20, 19, 18, 17, 16
 Max Grav All reactions 250 lb or less at joint(s) 2, 14, 21, 22, 23, 24, 25, 26, 20, 19, 18, 17, 16

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TC DL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Corner(3) -0-8-9 to 3-8-4, Exterior(2) 3-8-4 to 12-0-0, Corner(3) 12-0-0 to 16-4-13, Exterior(2) 16-4-13 to 24-8-9 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
 - All plates are 2x4 MT20 unless otherwise indicated.
 - Gable requires continuous bottom chord bearing.
 - Gable studs spaced at 2-0-0 oc.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 14, 22, 23, 24, 25, 26, 20, 19, 18, 17, 16.

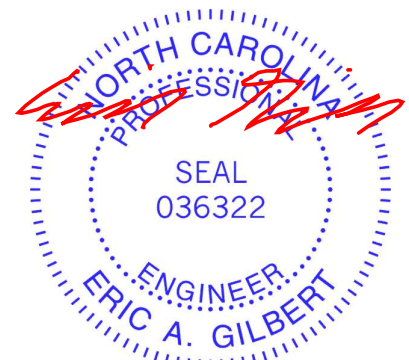


March 31, 2020

Job J0520-2117	Truss G2	Truss Type FINK	Qty 1	Ply 2	Weaver / 27 Mitchell Manor / Harnett	E14244390
-------------------	-------------	--------------------	----------	----------	--------------------------------------	-----------

Comtech, Inc., Fayetteville, NC - 28314,

8,330 s Mar 23 2020 MiTek Industries, Inc. Tue Mar 31 08:26:00 2020 Page 1

ID:FKRF2G2VvSGFSXRUG_ubJqzaK1d-Uq9t1qkzA?FOB3bUpHUMakTxzUsFwyNbpUKnowzVTYL



Scale = 1:53.0

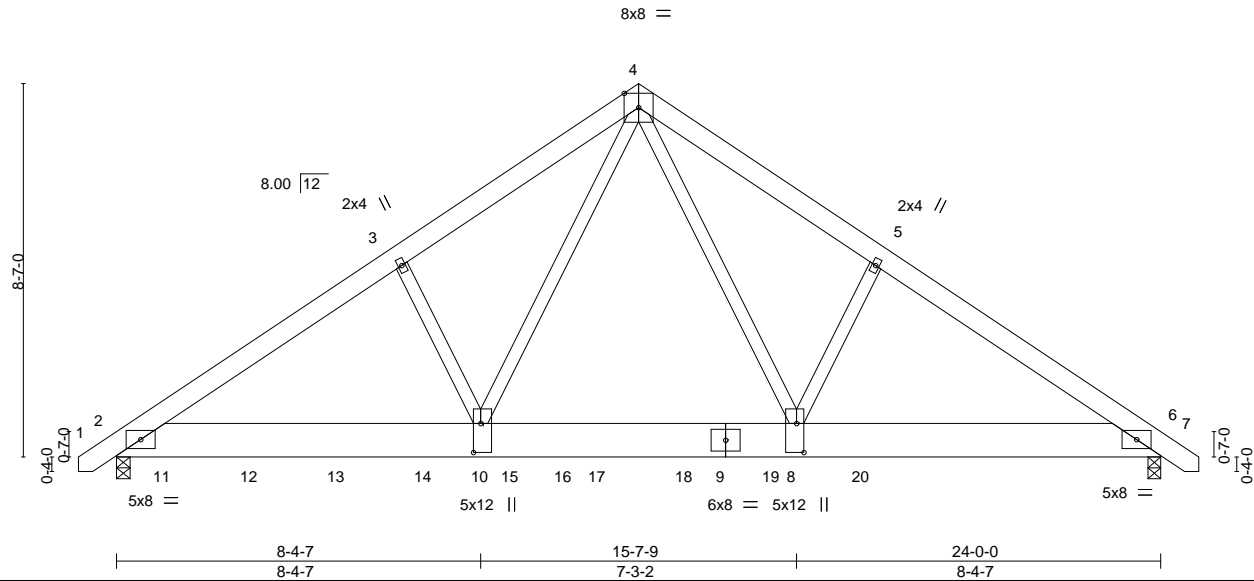


Plate Offsets (X,Y)-- [8:0-8-0,0-2-0], [10:0-8-0,0-2-0]

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.15	TC 0.44	Vert(LL)	-0.12	8-10	>999	MT20	244/190
TCDL 10.0	Lumber DOL	1.15	BC 0.53	Vert(CT)	-0.24	8-10	>999		
BCLL 0.0 *	Rep Stress Incr	NO	WB 0.87	Horz(CT)	0.04	6	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-S	Wind(LL)	-0.01	10	>999		
								Weight: 407 lb	FT = 20%

LUMBER-

TOP CHORD 2x6 SP No.1
 BOT CHORD 2x10 SP 2400F 2.0E
 WEBS 2x4 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 4-6-6 oc purlins.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 2=0-3-12, 6=0-3-8
 Max Horz 2=203(LC 7)
 Max Grav 2=9019(LC 2), 6=6408(LC 2)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.


TOP CHORD 2-3=-11364/0, 3-4=-11231/0, 4-5=-10548/0, 5-6=-10714/0
 BOT CHORD 2-10=0/9409, 8-10=0/6355, 6-8=0/8815
 WEBS 3-10=-342/199, 4-10=0/7095, 4-8=0/5752, 5-8=-315/247

NOTES-

- 2-ply truss to be connected together with 10d (0.131"x3") nails as follows:
 Top chords connected as follows: 2x6 - 2 rows staggered at 0-9-0 oc.
 Bottom chords connected as follows: 2x10 - 2 rows staggered at 0-3-0 oc.
 Webs connected as follows: 2x4 - 1 row at 0-9-0 oc.
- All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TC DL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope); Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 1382 lb down at 1-0-12, 1381 lb down at 3-0-12, 1381 lb down at 5-0-12, 1381 lb down at 7-0-12, 1381 lb down at 9-0-12, 1381 lb down at 11-0-12, 1381 lb down at 13-0-12, and 1381 lb down at 15-0-12, and 2464 lb down at 17-1-8 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.

LOAD CASE(S) Standard

- Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
 Uniform Loads (plf)
 Vert: 2-6=-20, 1-4=-60, 4-7=-60
 Concentrated Loads (lb)
 Vert: 11=-1147(B) 12=-1146(B) 13=-1146(B) 14=-1146(B) 15=-1146(B) 17=-1146(B) 18=-1146(B) 19=-1146(B) 20=-1961(B)

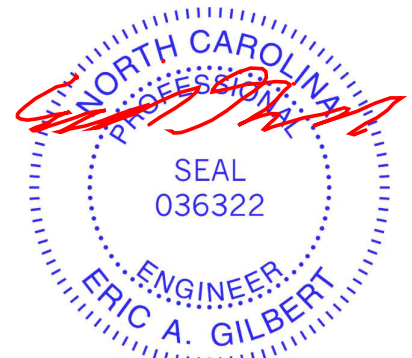

March 31, 2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-743 rev. 10/03/2015 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 218 N. Lee Street, Suite 312, Alexandria, VA 22314.



818 Soundside Road
 Edenton, NC 27932

Job J0520-2117	Truss PB	Truss Type PIGGYBACK	Qty 8	Ply 1	Weaver / 27 Mitchell Manor / Harnett	E14244391
-------------------	-------------	-------------------------	----------	----------	--------------------------------------	-----------

Comtech, Inc., Fayetteville, NC - 28314,

8,330 s Mar 23 2020 MiTek Industries, Inc. Tue Mar 31 08:26:01 2020 Page 1
ID:FKRF2G2VvSGFSXRUG_ubJqzaK1d-y0JFFAkxbxJNFpDAhN??b6x0CrtIafCdk273LKMzVTYK

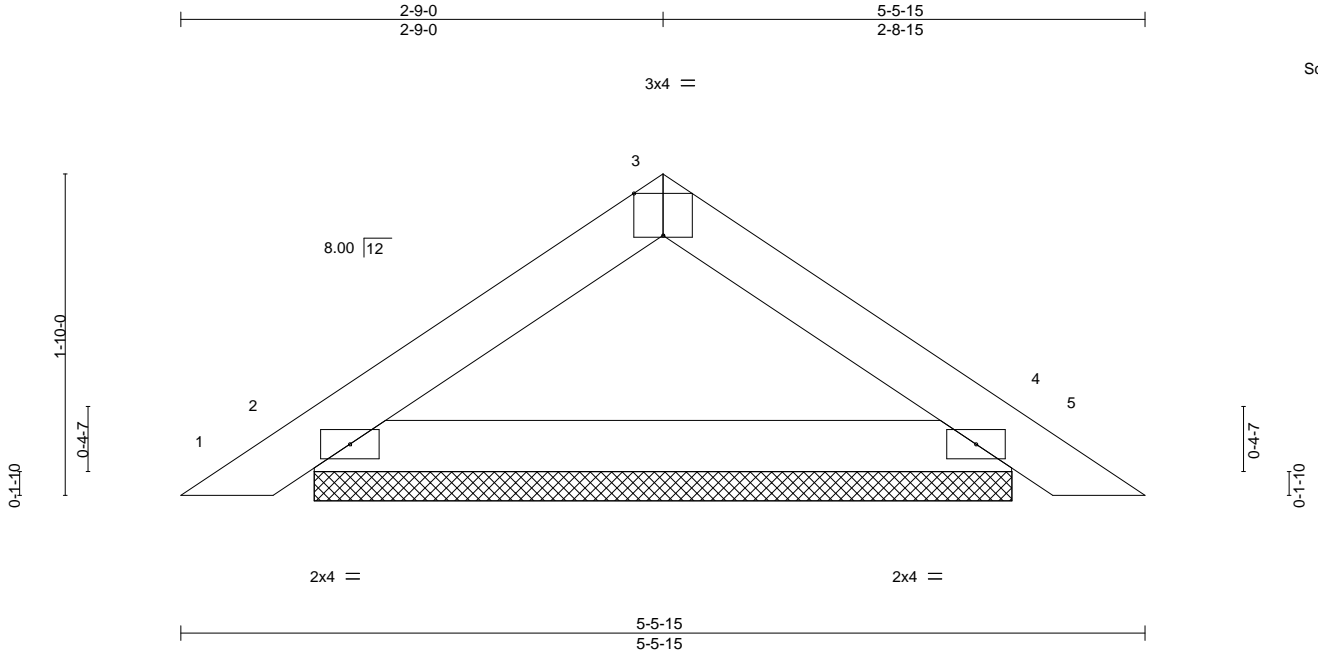


Plate Offsets (X,Y)--		[3:0-2-0,Edge]							
LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.15	TC 0.05	Vert(LL)	0.00	4	n/r	MT20	244/190
TCDL 10.0	Lumber DOL	1.15	BC 0.14	Vert(CT)	0.00	5	n/r		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.00	Horz(CT)	0.00	4	n/a		
BCDL 10.0	Code	IRC2015/TPI2014	Matrix-P					Weight: 16 lb	FT = 20%

LUMBER-
TOP CHORD 2x4 SP No.1
BOT CHORD 2x4 SP No.1


BRACING-
TOP CHORD Structural wood sheathing directly applied or 5-5-15 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (size) 2=3-11-11, 4=3-11-11
Max Horz 2=40(LC 10)
Max Uplift 2=-16(LC 12), 4=-16(LC 13)
Max Grav 2=189(LC 1), 4=189(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TC DL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Gable requires continuous bottom chord bearing.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 4.
- See Standard Industry Piggyback Truss Connection Detail for Connection to base truss as applicable, or consult qualified building designer.

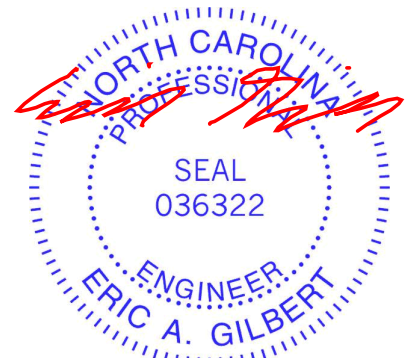

March 31, 2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 10/03/2015 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 218 N. Lee Street, Suite 312, Alexandria, VA 22314.




818 Soundside Road
Edenton, NC 27932

Job J0520-2117	Truss PBGE	Truss Type GABLE	Qty 1	Ply 1	Weaver / 27 Mitchell Manor / Harnett	E14244392
					Job Reference (optional)	


Comtech, Inc., Fayetteville, NC - 28314,

8,330 s Mar 23 2020 MiTek Industries, Inc. Tue Mar 31 08:26:01 2020 Page 1
ID:FKRF2G2VvSGFSXRUG_ubJqzaK1d-y0jFFAkBxJNFpDAhN??b6x0CrKlfc3k273LKMzVYTK



4x4 =

Scale = 1:13.4

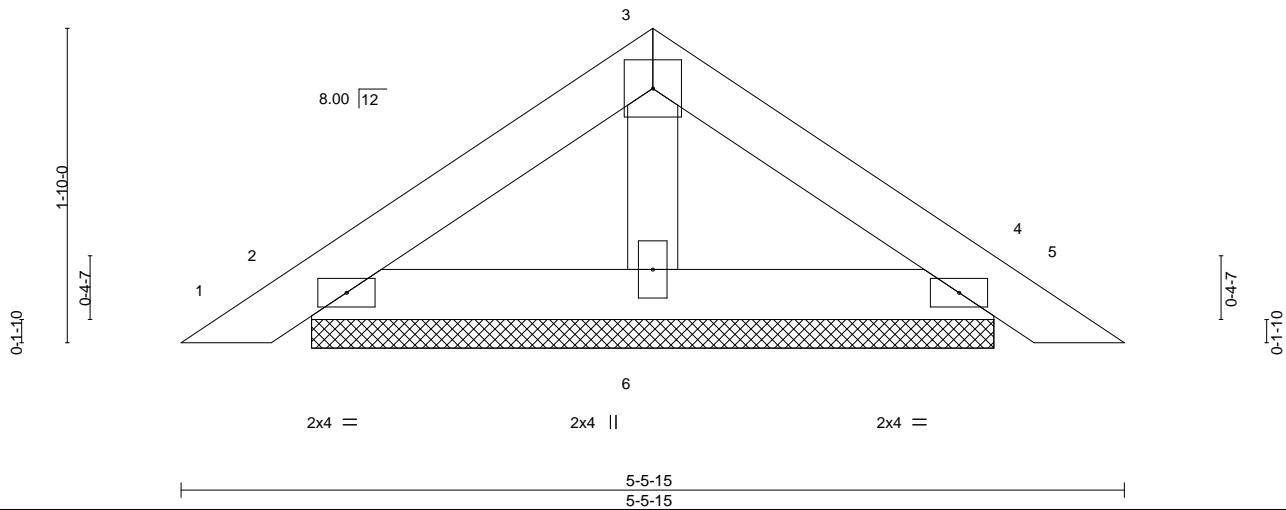

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.15	TC 0.05	Vert(LL)	0.00	4	n/r	120	MT20	244/190
TCDL 10.0	Lumber DOL	1.15	BC 0.03	Vert(CT)	0.00	5	n/r	120		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.01	Horz(CT)	0.00	4	n/a	n/a		
BCDL 10.0	Code	IRC2015/TPI2014	Matrix-P						Weight: 17 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.1
BOT CHORD 2x4 SP No.1
OTHERS 2x4 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 5-5-15 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 2=3-11-11, 4=3-11-11, 6=3-11-11
Max Horz 2=50(LC 11)
Max Uplift 2=-45(LC 12), 4=-52(LC 13)
Max Grav 2=119(LC 1), 4=119(LC 1), 6=139(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TC DL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Corner(3) zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 2-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 4.
- See Standard Industry Piggyback Truss Connection Detail for Connection to base truss as applicable, or consult qualified building designer.



March 31, 2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 10/03/2015 BEFORE USE.


Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 218 N. Lee Street, Suite 312, Alexandria, VA 22314.

ENGINEERING BY
TRENCO
A MiTek Affiliate


818 Soundside Road
Edenton, NC 27932

Symbols

PLATE LOCATION AND ORIENTATION

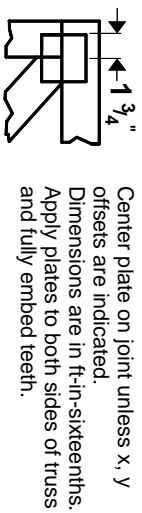

For 4 x 2 orientation, locate plates 0- $\frac{1}{16}$ " from outside edge of truss.



* Plate location details available in **MITrak 20/20 software or upon request.**

PLATE SIZE

4 X 4


The first dimension is the plate width measured perpendicular to slots. Second dimension is the length parallel to slots.

LATERAL BRACING LOCATION



Indicated by symbol shown and/or by text in the bracing section of the output. Use T or I bracing if indicated.

BEARING




Indicates location where bearings (supports) occur. Icons vary but reaction section indicates joint number where bearings occur. Min size shown is for crushing only.

Industry Standards:

ANSI/TPI 1: National Design Specification for Metal Plate Connected Wood Truss Construction.
DSB-89: Design Standard for Bracing.
BCSI: Building Component Safety Information, Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses.

Numbering System

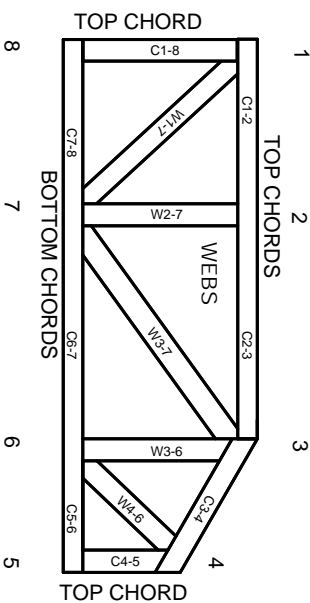

JOINTS ARE GENERALLY NUMBERED/LETTERED CLOCKWISE AROUND THE TRUSS STARTING AT THE JOINT FARTHEST TO THE LEFT.

CHORDS AND WEBS ARE IDENTIFIED BY END JOINT NUMBERS/LETTERS.

PRODUCT CODE APPROVALS

ICC-ES Reports:

ESR-1311, ESR-1352, ESR1988
ER-3907, ESR-2362, ESR-1397, ESR-3282

Trusses are designed for wind loads in the plane of the truss unless otherwise shown.

Lumber design values are in accordance with ANSI/TPI 1 section 6.3 These truss designs rely on lumber values established by others.

© 2012 MITTEK® All Rights Reserved



MITek Engineering Reference Sheet: MII-7473 rev. 10/03/2015



General Safety Notes

Failure to Follow Could Cause Property Damage or Personal Injury

1. Additional stability bracing for truss system, e.g. diagonal or X-bracing, is always required. See BCSI.
2. Truss bracing must be designed by an engineer. For wide truss spacing, individual lateral braces themselves may require bracing, or alternative Tor I bracing should be considered.
3. Never exceed the design loading shown and never stack materials on inadequately braced trusses.
4. Provide copies of this truss design to the building designer, erection supervisor, property owner and all other interested parties.
5. Cut members to bear tightly against each other.
6. Place plates on each face of truss at each joint and embed fully. Knots and wane at joint locations are regulated by ANSI/TPI 1.
7. Design assumes trusses will be suitably protected from the environment in accord with ANSI/TPI 1.
8. Unless otherwise noted, moisture content of lumber shall not exceed 19% at time of fabrication.
9. Unless expressly noted, this design is not applicable for use with fire retardant, preservative treated, or green lumber.
10. Camber is a non-structural consideration and is the responsibility of truss fabricator. General practice is to camber for dead load deflection.
11. Plate type, size, orientation and location dimensions indicated are minimum plating requirements.
12. Lumber used shall be of the species and size, and in all respects, equal to or better than that specified.
13. Top chords must be sheathed or purlins provided at spacing indicated on design.
14. Bottom chords require lateral bracing at 10 ft. spacing, or less, if no ceiling is installed, unless otherwise noted.
15. Connections not shown are the responsibility of others.
16. Do not cut or alter truss member or plate without prior approval of an engineer.
17. Install and load vertically unless indicated otherwise.
18. Use of green or treated lumber may pose unacceptable environmental, health or performance risks. Consult with project engineer before use.
19. Review all portions of this design (front, back, words and pictures) before use. Reviewing pictures alone is not sufficient.
20. Design assumes manufacture in accordance with ANSI/TPI 1 Quality Criteria.