


Job	Truss	Truss Type	Qty	Ply	GARY ROBINSON-LOT 73 SOUTH CREEK WOODLAKE MODEL ROOF
20-6466-A	AT01	Attic	10	1	Job Reference (optional)

Riverside Roof Truss, LLC, Danville, VA. 24541

Run: 8.330 s Feb 24 2020 Print: 8.330 s Feb 24 2020 MiTek Industries, Inc. Wed Dec 16 12:08:49 2020 Page 1
 ID:riFrQwqzJQyesEOjBg_H7VyKEle-fmp23kBDs_LZWcMbWuOG60HzxMRZQexUZQrMVy8PXs



Scale = 1:82.8

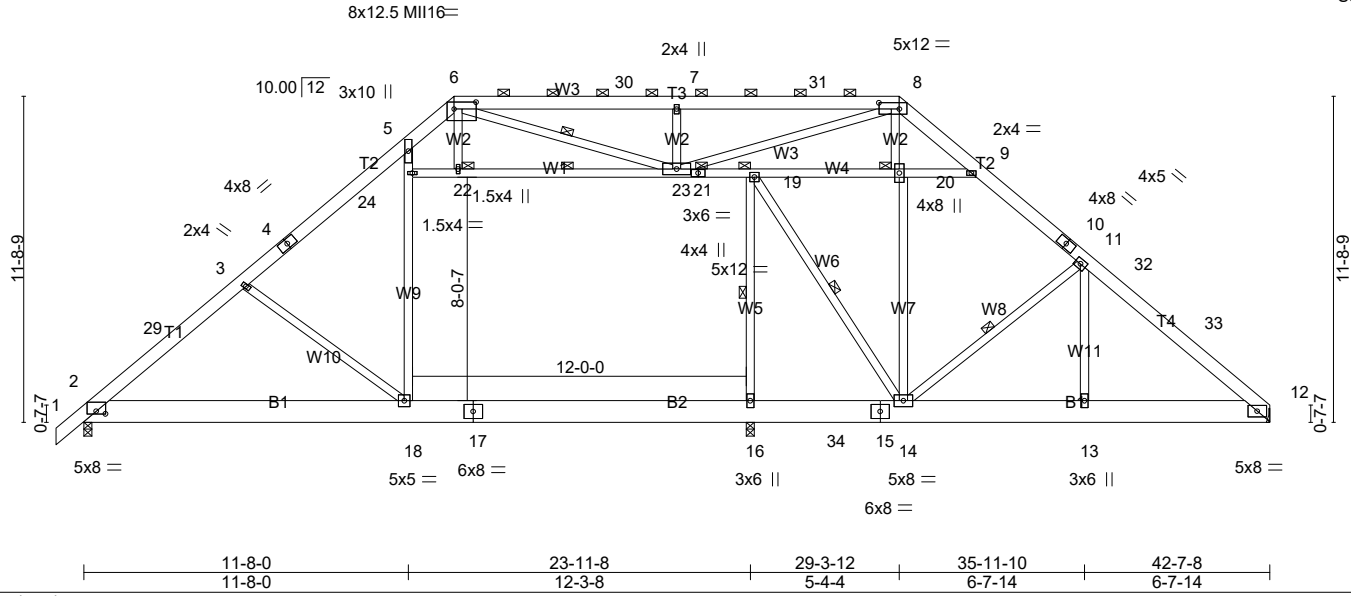


Plate Offsets (X,Y)-- [2:0-4-0,0-1-3], [6:0-9-8,0-3-0], [8:0-8-12,0-2-12]

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	I/defl	L/d	PLATES	GRIP
TCLL (roof) 30.0	2-0-0	TC 0.72	Vert(LL) -0.26	16-18	>999	360	MT20	244/190
Snow (Pf/Pg) 23.1/30.0	Plate Grip DOL 1.15	BC 0.81	Vert(CT) -0.42	16-18	>691	240	MI16	174/126
TCDL 10.0	Lumber DOL 1.15	WB 0.87	Horz(CT) 0.05	12	n/a	n/a		
BCLL 0.0 *	Rep Stress Incr YES	Matrix-MS	Attic -0.14	16-18	1061	360		
BCDL 10.0	Code IRC2015/TPI2014						Weight: 435 lb	FT = 20%

LUMBER-
 TOP CHORD 2x6 SP No.2 *Except*
 T2: 2x6 SP 2400F 2.0E
 BOT CHORD 2x10 SP No.2 *Except*
 B2: 2x10 SP No.1
 WEBS 2x4 SP No.3 *Except*
 W9,W5,W4,W1: 2x4 SP No.2

BRACING-
 TOP CHORD Structural wood sheathing directly applied or 3-10-7 oc purlins, except 2-0-0 oc purlins (3-2-2 max.): 6-8.
 BOT CHORD Rigid ceiling directly applied or 9-10-2 oc bracing.
 WEBS 1 Row at midpt 16-19, 11-14, 22-23, 14-19, 6-23
 JOINTS 1 Brace at Jt(s): 19, 20, 22, 23

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

REACTIONS. (lb/size) 2=1868/0-3-8 (min. 0-2-9), 16=695/0-3-8 (min. 0-1-8), 12=1671/Mechanical
 Max Horz 2=290(LC 13)
 Max Uplift 2=-136(LC 16), 16=-5(LC 17), 12=-56(LC 16)
 Max Grav 2=2161(LC 40), 16=1200(LC 58), 12=1954(LC 40)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-29=-2951/187, 3-29=-2753/208, 3-4=-2607/168, 4-5=-2452/202, 5-6=-2023/295,
 6-30=-2964/488, 7-30=-2964/488, 7-31=-2964/488, 8-31=-2964/488, 8-9=-1761/194,
 9-10=-2060/294, 10-11=-2156/268, 11-32=-2466/271, 32-33=-2587/249, 12-33=-2757/244
 BOT CHORD 2-18=-220/2395, 17-18=-119/1900, 16-17=-119/1900, 16-34=-119/1900, 15-34=-119/1900,
 14-15=-119/1900, 13-14=-79/1987, 12-13=-79/1987
 WEBS 3-18=-826/264, 18-24=0/1062, 5-24=0/921, 16-19=-400/408, 14-20=-19/503,
 11-14=-621/207, 11-13=0/335, 21-23=-905/133, 19-21=-905/133, 19-20=-656/163,
 9-20=-662/162, 14-19=-797/210, 8-20=0/504, 7-23=-1068/262, 6-23=-527/1287,
 8-23=-318/1731

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCCL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - TCCL: ASCE 7-10; Pr=30.0 psf (roof live load: Lumber DOL=1.15 Plate DOL=1.15); Pg=30.0 psf (ground snow); Pf=23.1 psf (flat roof snow: Lumber DOL=1.15 Plate DOL=1.15); Category II; Exp B; Partially Exp.; Ct=1.10, Lu=50-0-0
 - Unbalanced snow loads have been considered for this design.
 - This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 23.1 psf on overhangs non-concurrent with other live loads.
 - Provide adequate drainage to prevent water ponding.
 - All plates are MT20 plates unless otherwise indicated.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - Ceiling dead load (5.0 psf) on member(s). 22-24, 22-23, 19-23, 19-20, 9-20; Wall dead load (5.0psf) on member(s).18-24, 16-19
 - Bottom chord live load (40.0 psf) and additional bottom chord dead load (5.0 psf) applied only to room. 16-18
 - Refer to girder(s) for truss to truss connections.

Continued on page 2

Job	Truss	Truss Type	Qty	Ply	GARY ROBINSON-LOT 73 SOUTH CREEK WOODLAKE MODEL ROOF
20-6466-A	AT01	Attic	10	1	Job Reference (optional)

Riverside Roof Truss, LLC, Danville, VA. 24541

Run: 8.330 s Feb 24 2020 Print: 8.330 s Feb 24 2020 MiTek Industries, Inc. Wed Dec 16 12:08:49 2020 Page 2
 ID:riFrQwqzJQyesEOjBg_H7VyKEle-fmp23kBDs_LZWcMbWuOG60HzyxMRZQexUZQrMVy8PXS

NOTES-


- 13) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 136 lb uplift at joint 2, 5 lb uplift at joint 16 and 56 lb uplift at joint 12.
- 14) This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 15) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
- 16) Attic room checked for L/360 deflection.

LOAD CASE(S) Standard

Job 20-6466-A	Truss AT02	Truss Type Attic	Qty 3	Ply 1	GARY ROBINSON-LOT 73 SOUTH CREEK WOODLAKE MODEL ROOF Job Reference (optional)
------------------	---------------	---------------------	----------	----------	--

Riverside Roof Truss, LLC, Danville, VA. 24541

Run: 8.330 s Feb 24 2020 Print: 8.330 s Feb 24 2020 MiTek Industries, Inc. Wed Dec 16 12:08:50 2020 Page 1
ID:riFrQwqzJQyEsEOjBg_H7VYkELe-7yMQH4CrdITQ7lxn4bvVfEp99LgvlR4iDAPuyy8PXr



Scale = 1:77.6


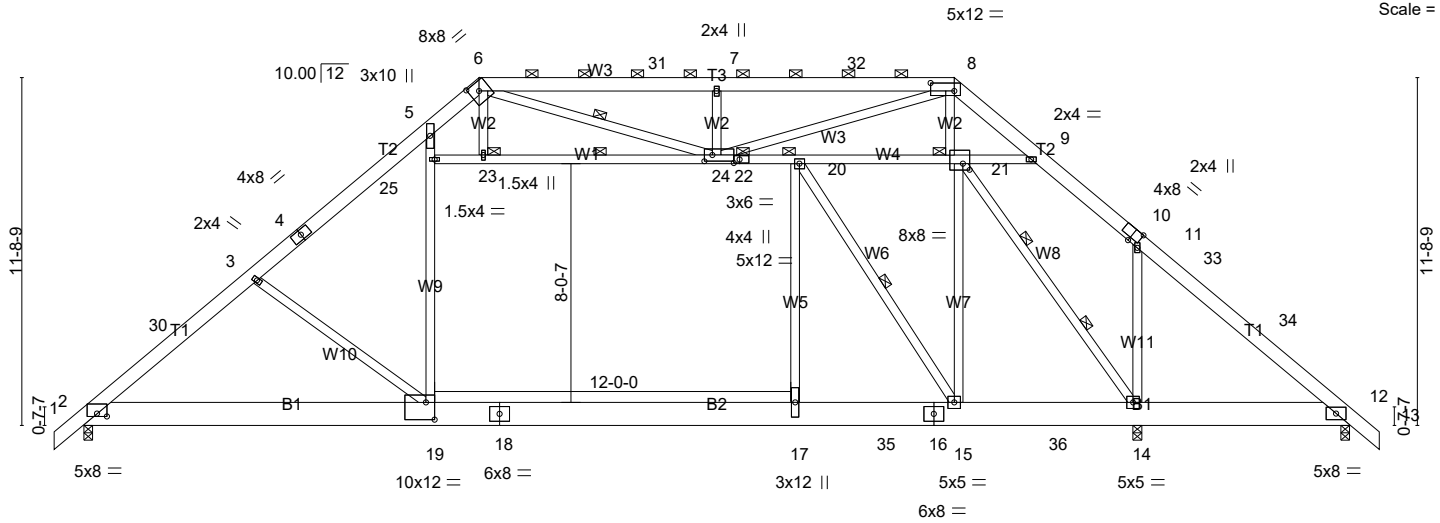


Plate Offsets (X,Y)-- [2:0-4-0,0-1-3], [6:0-3-12,0-3-8], [8:0-9-8,0-3-4], [10:0-3-10,Edge], [19:0-3-8,0-7-0], [21:0-2-12,0-2-8], [22:0-2-4,0-1-8], [24:0-3-4,0-2-8]

LOADING (psf)		SPACING-		CSI.		DEFL.		PLATES	GRIP
TCLL (roof)	30.0	2-0-0	TC	0.69	in (loc)	l/defl	L/d	MT20	244/190
Snow (Pf/Pg)	23.1/30.0	Plate Grip DOL	1.15	BC	0.92	Vert(LL)	-0.27 17-19 >999		
TCDL	10.0	Lumber DOL	1.15	WB	0.90	Vert(CT)	-0.42 17-19 >999		
BCLL	0.0 *	Rep Stress Incr	YES	Matrix-MS		Horz(CT)	0.05 12 n/a n/a		
BCDL	10.0	Code IRC2015/TPI2014				Attic	-0.15 17-19 969	Weight: 442 lb	FT = 20%

LUMBER-

TOP CHORD 2x6 SP No.2 *Except*
T2: 2x6 SP 2400F 2.0E
BOT CHORD 2x10 SP No.2
WEBS 2x4 SP No.3 *Except*
W9: 2x4 SP DSS, W5,W4,W1: 2x4 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 3-8-13 oc purlins, except 2-0-0 oc purlins (3-5-6 max.): 6-8.
BOT CHORD Rigid ceiling directly applied or 2-2-0 oc bracing.
WEBS 1 Row at midpt 23-24, 15-20, 6-24
2 Rows at 1/3 pts 14-21
JOINTS 1 Brace at Jt(s): 20, 21, 23, 24

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

REACTIONS. (lb/size) 2=1873/0-3-8 (min. 0-2-10), 14=1796/0-3-8 (min. 0-3-0), 12=637/0-3-8 (min. 0-1-8)
Max Horz 2=-297(LC 14)
Max Uplift 2=-70(LC 16), 14=-87(LC 17), 12=-167(LC 16)
Max Grav 2=2243(LC 46), 14=2540(LC 58), 12=787(LC 40)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-30=-3178/101, 3-30=-2987/123, 3-4=-2827/74, 4-5=-2681/116, 5-6=-1940/249,
6-31=-2697/388, 7-31=-2697/388, 7-32=-2697/388, 8-32=-2697/388, 8-9=-741/99,
9-10=-917/298, 10-11=-931/273, 11-33=-649/267, 33-34=-717/255, 12-34=-883/240
BOT CHORD 2-19=-108/2550, 18-19=-6/2086, 17-18=-6/2086, 17-35=-6/2086, 16-35=-6/2086,
15-16=-6/2086, 15-36=-74/1421, 14-36=-74/1421, 12-14=-174/551
WEBS 3-19=-805/270, 19-25=0/1209, 5-25=0/1075, 17-20=0/1020, 15-21=0/954, 23-25=-389/0,
23-24=-376/0, 22-24=-1450/124, 20-22=-1450/124, 20-21=-859/181, 9-21=-236/548,
15-20=-1335/0, 11-14=-876/277, 14-21=-1978/0, 8-21=-829/236, 7-24=-1051/263,
6-24=-580/1053, 8-24=-300/2172

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCCL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- TCCL: ASCE 7-10; Pr=30.0 psf (roof live load: Lumber DOL=1.15 Plate DOL=1.15); Pg=30.0 psf (ground snow); Pf=23.1 psf (flat roof snow: Lumber DOL=1.15 Plate DOL=1.15); Category II; Exp B; Partially Exp.; Ct=1.10, Lu=50-0-0
- Unbalanced snow loads have been considered for this design.
- This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 23.1 psf on overhangs non-concurrent with other live loads.
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Ceiling dead load (5.0 psf) on member(s). 23-25, 23-24, 20-24, 20-21, 9-21; Wall dead load (5.0psf) on member(s).19-25, 17-20
- Bottom chord live load (40.0 psf) and additional bottom chord dead load (5.0 psf) applied only to room. 17-19

Job	Truss	Truss Type	Qty	Ply	GARY ROBINSON-LOT 73 SOUTH CREEK WOODLAKE MODEL ROOF
20-6466-A	AT02	Attic	3	1	Job Reference (optional)

Riverside Roof Truss, LLC, Danville, VA. 24541

Run: 8.330 s Feb 24 2020 Print: 8.330 s Feb 24 2020 MiTek Industries, Inc. Wed Dec 16 12:08:50 2020 Page 2
 ID:riFrQwqzJQyesEOjBg_H7VyKEle-7yMQH4CrdITQ7lxn4bvVfEp99LgvlR4iDAPuyy8PXR

NOTES-

- 11) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 70 lb uplift at joint 2, 87 lb uplift at joint 14 and 167 lb uplift at joint 12.
- 12) This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 13) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
- 14) Attic room checked for L/360 deflection.

LOAD CASE(S) Standard

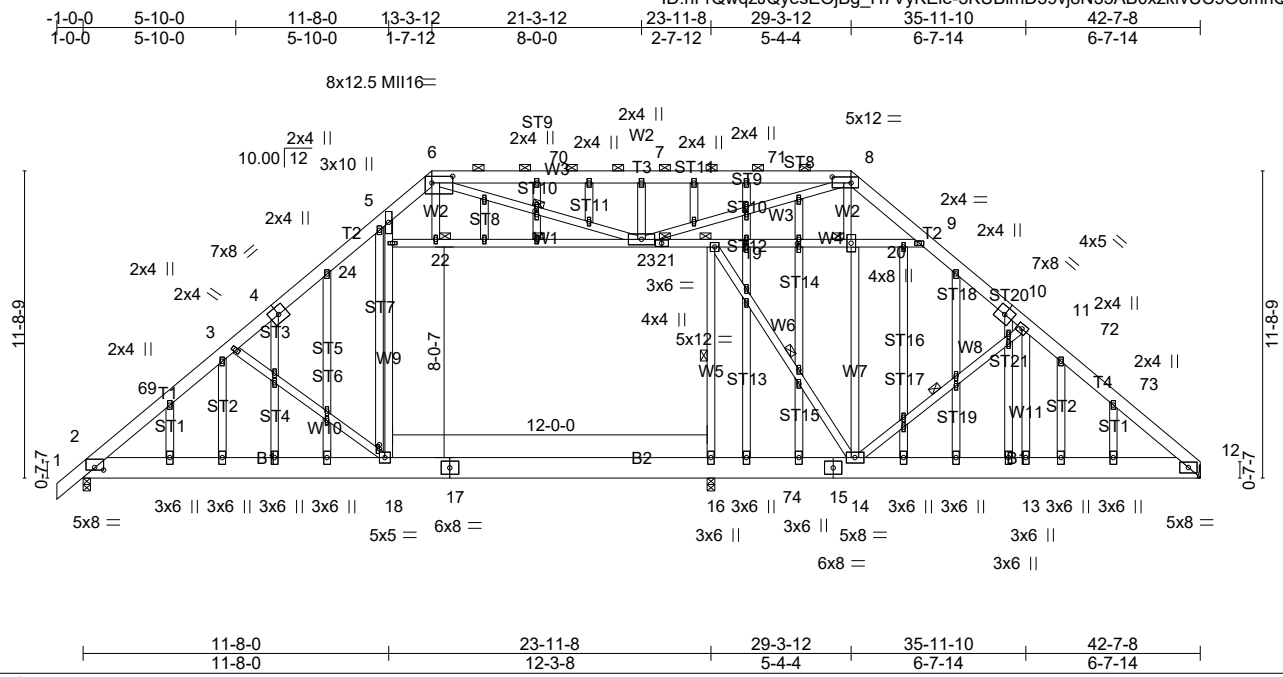


Plate Offsets (X,Y)-- [2:0-4-0,0-1-3], [4:0-2-5,0-0-0], [4:0-0-0,0-2-12], [6:0-9-8,0-3-0], [8:0-8-12,0-2-12], [10:0-2-5,0-0-0], [10:0-0-0,0-2-12], [18:0-2-0,0-0-0], [26:0-1-8,0-0-12], [30:0-1-10,0-0-12], [31:0-1-8,0-0-12], [38:0-1-10,0-0-12]

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL (roof) 30.0	2-0-0	TC 0.72	in (loc) l/defl L/d	MT20	244/190
Snow (Pf/Pg) 23.1/30.0	Plate Grip DOL 1.15	BC 0.81	Vert(LL) -0.26 16-18 >999 360	MII16	174/126
TCDL 10.0	Lumber DOL 1.15	WB 0.87	Vert(CT) -0.42 16-18 >691 240		
BCLL 0.0 *	Rep Stress Incr YES	Matrix-MS	Horz(CT) 0.05 12 n/a n/a		
BCDL 10.0	Code IRC2015/TPI2014		Attic -0.14 16-18 1061 360	Weight: 552 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x6 SP No.2 *Except* T2: 2x6 SP 2400F 2.0E	TOP CHORD Structural wood sheathing directly applied or 3-10-7 oc purlins, except 2-0-0 oc purlins (3-2-2 max.): 6-8.
BOT CHORD 2x10 SP No.2 *Except* B2: 2x10 SP No.1	BOT CHORD Rigid ceiling directly applied or 9-10-2 oc bracing.
WEBS 2x4 SP No.3 *Except* W9,W5,W4,W1: 2x4 SP No.2	WEBS 1 Row at midpt 16-19, 11-14, 22-23, 14-19, 6-23
OTHERS 2x4 SP No.3	JOINTS 1 Brace at Jt(s): 19, 20, 22, 23

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

REACTIONS. (lb/size) 2=1868/0-3-8 (min. 0-2-9), 16=695/0-3-8 (min. 0-1-8), 12=1671/Mechanical
 Max Horz 2=290(LC 13)
 Max Uplift 2=-48(LC 16)
 Max Grav 2=2161(LC 40), 16=1200(LC 58), 12=1954(LC 40)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-69=-2951/187, 3-69=-2753/208, 3-4=-2607/168, 4-5=-2452/202, 5-6=-2023/295,
 6-70=-2964/488, 7-70=-2964/488, 7-71=-2964/488, 8-71=-2964/488, 8-9=-1761/194,
 9-10=-2060/294, 10-11=-2156/268, 11-72=-2466/271, 72-73=-2587/249, 12-73=-2757/244
 BOT CHORD 2-18=-193/2395, 17-18=-119/1922, 16-17=-119/1922, 16-74=-119/1922, 15-74=-119/1922,
 14-15=-119/1922, 13-14=-79/1987, 12-13=-79/1987
 WEBS 3-18=-826/270, 18-24=0/1062, 5-24=0/921, 16-19=-400/408, 14-20=0/503, 11-14=-621/207,
 11-13=0/335, 21-23=-905/85, 19-21=-905/85, 19-20=-656/163, 9-20=-662/162,
 14-19=-797/210, 8-20=0/504, 7-23=-1068/262, 6-23=-527/1287, 8-23=-318/1731

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TC DL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
 - TCLL: ASCE 7-10; Pr=30.0 psf (roof live load: Lumber DOL=1.15 Plate DOL=1.15); Pg=30.0 psf (ground snow); Pf=23.1 psf (flat roof snow: Lumber DOL=1.15 Plate DOL=1.15); Category II; Exp B; Partially Exp.; Ct=1.10, Lu=50-0-0
 - Unbalanced snow loads have been considered for this design.
 - This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 23.1 psf on overhangs non-concurrent with other live loads.
 - Provide adequate drainage to prevent water ponding.
 - All plates are MT20 plates unless otherwise indicated.
 - All plates are 1.5x4 MT20 unless otherwise indicated.
 - Gable studs spaced at 2-0-0 oc.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.

Job	Truss	Truss Type	Qty	Ply	GARY ROBINSON-LOT 73 SOUTH CREEK WOODLAKE MODEL ROOF
20-6466-A	ATGE01	GABLE	1	1	Job Reference (optional)

Riverside Roof Truss, LLC, Danville, VA. 24541

Run: 8.330 s Feb 24 2020 Print: 8.330 s Feb 24 2020 MiTek Industries, Inc. Wed Dec 16 12:08:52 2020 Page 2
ID:riFrQwqzJQyesEOjBg_H7VyKEle-3KUBimD59vj8N35AB0xzkvUC9O8mnQNAXfWzqy8PXP

NOTES-


- 12) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- 13) Ceiling dead load (5.0 psf) on member(s). 22-24, 22-23, 19-23, 19-20, 9-20; Wall dead load (5.0psf) on member(s).18-24, 16-19
- 14) Bottom chord live load (40.0 psf) and additional bottom chord dead load (5.0 psf) applied only to room. 16-18
- 15) Refer to girder(s) for truss to truss connections.
- 16) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 48 lb uplift at joint 2.
- 17) This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 18) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
- 19) Attic room checked for L/360 deflection.

LOAD CASE(S) Standard

Job	Truss	Truss Type	Qty	Ply	GARY ROBINSON-LOT 73 SOUTH CREEK WOODLAKE MODEL ROOF
20-6466-A	ATGE02	GABLE	1	1	Job Reference (optional)

Riverside Roof Truss, LLC, Danville, VA. 24541

Run: 8.330 s Feb 24 2020 Print: 8.330 s Feb 24 2020 MiTek Industries, Inc. Wed Dec 16 12:08:54 2020 Page 1
 ID:riFrQwqzJQyesEOjBg_H7VyKEle-?jcx7RFMhX_scNFYJR_Sp4_r8y1qEgRgdr8c1jy8PXN



Scale = 1:86.2

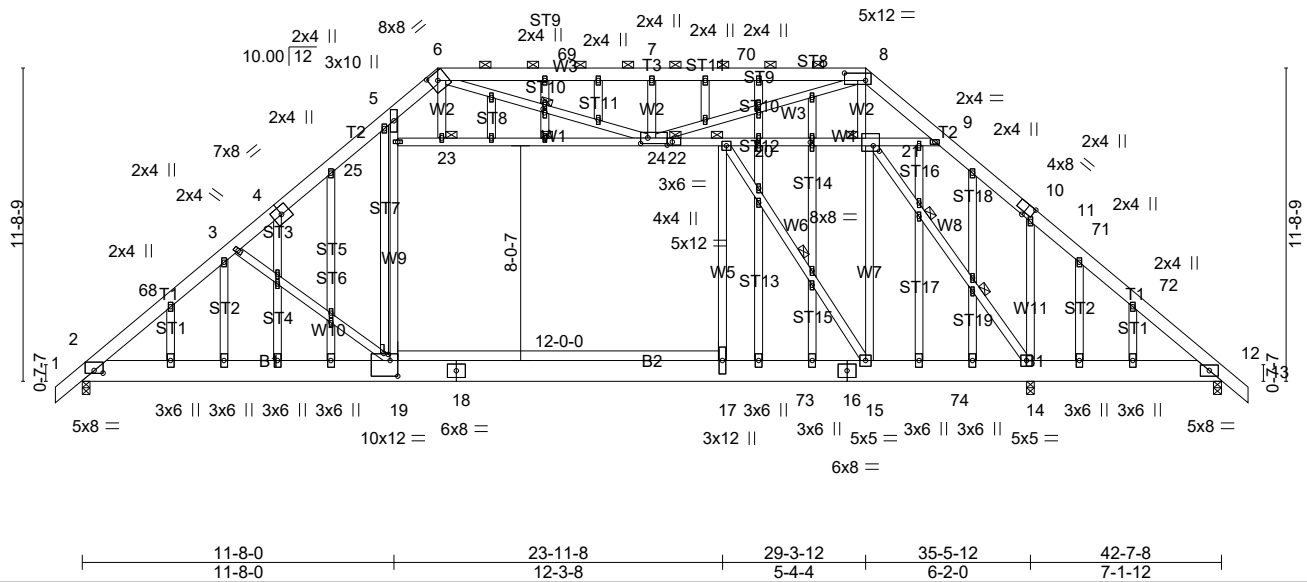


Plate Offsets (X,Y)-- [2:0-4-0,0-1-3], [4:0-2-5,0-0-0], [4:0-0-0,0-2-12], [6:0-3-12,0-3-8], [8:0-9-8,0-3-4], [10:0-3-10,Edge], [19:0-3-8,0-7-0], [19:0-0-8,0-2-0], [21:0-2-12,0-2-8], [22:0-2-4,0-1-8], [24:0-3-4,0-2-8], [27:0-1-8,0-0-12], [31:0-1-10,0-0-12], [32:0-1-8,0-0-12], [39:0-1-10,0-0-12]

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL (roof) 30.0	2-0-0	TC 0.69	in (loc) l/defl L/d	MT20	244/190
Snow (Pf/Pg) 23.1/30.0	Plate Grip DOL 1.15	BC 0.92	Vert(LL) -0.27 17-19 >999 360		
TCDL 10.0	Lumber DOL 1.15	WB 0.90	Vert(CT) -0.42 17-19 >999 240		
BCLL 0.0 *	Rep Stress Incr YES	Matrix-MS	Horz(CT) 0.05 12 n/a n/a		
BCDL 10.0	Code IRC2015/TPI2014		Attic -0.15 17-19 969 360	Weight: 551 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x6 SP No.2 *Except* T2: 2x6 SP 2400F 2.0E	TOP CHORD Structural wood sheathing directly applied or 3-8-13 oc purlins, except 2-0-0 oc purlins (3-5-6 max.): 6-8.
BOT CHORD 2x10 SP No.2	BOT CHORD Rigid ceiling directly applied or 2-2-0 oc bracing.
WEBS 2x4 SP No.3 *Except* W9: 2x4 SP DSS, W5,W4,W1: 2x4 SP No.2	WEBS 1 Row at midpt 23-24, 15-20, 6-24 2 Rows at 1/3 pts 14-21 1 Brace at Jt(s): 20, 21, 23, 24
OTHERS 2x4 SP No.3	JOINTS

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

REACTIONS. (lb/size) 2=1873/0-3-8 (min. 0-2-10), 14=1796/0-3-8 (min. 0-3-0), 12=637/0-3-8 (min. 0-1-8)
 Max Horz 2=-297(LC 14)
 Max Uplift 12=-121(LC 16)
 Max Grav 2=2243(LC 46), 14=2540(LC 58), 12=787(LC 40)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-68=-3178/101, 3-68=-2987/123, 3-4=-2827/74, 4-5=-2681/116, 5-6=-1940/249,
 6-69=-2697/388, 7-69=-2697/388, 7-70=-2697/388, 8-70=-2697/388, 8-9=-741/99,
 9-10=-917/290, 10-11=-931/265, 11-71=-649/265, 71-72=-717/253, 12-72=-883/229
 BOT CHORD 2-19=-90/2550, 18-19=-6/2120, 17-18=-6/2120, 17-73=-6/2120, 16-73=-6/2120,
 15-16=-6/2120, 15-74=-74/1458, 14-74=-74/1458, 12-14=-174/551
 WEBS 3-19=-805/274, 19-25=0/1209, 5-25=0/1075, 17-20=0/1020, 15-21=0/954, 23-25=-389/0,
 23-24=-376/0, 22-24=-1450/104, 20-22=-1450/104, 20-21=-859/181, 9-21=-236/518,
 15-20=-1335/0, 11-14=-876/258, 14-21=-1978/0, 8-21=-829/236, 7-24=-1051/263,
 6-24=-580/1053, 8-24=-300/2172

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TC DL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
 - TCLL: ASCE 7-10; Pr=30.0 psf (roof live load: Lumber DOL=1.15 Plate DOL=1.15); Pg=30.0 psf (ground snow); Pf=23.1 psf (flat roof snow: Lumber DOL=1.15 Plate DOL=1.15); Category II; Exp B; Partially Exp.; Ct=1.10, Lu=50-0-0
 - Unbalanced snow loads have been considered for this design.
 - This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 23.1 psf on overhangs non-concurrent with other live loads.
 - Provide adequate drainage to prevent water ponding.
 - All plates are 1.5x4 MT20 unless otherwise indicated.
 - Gable studs spaced at 2-0-0 oc.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.

Continued on page 2

Job	Truss	Truss Type	Qty	Ply	GARY ROBINSON-LOT 73 SOUTH CREEK WOODLAKE MODEL ROOF
20-6466-A	ATGE02	GABLE	1	1	Job Reference (optional)

Riverside Roof Truss, LLC, Danville, VA. 24541

Run: 8.330 s Feb 24 2020 Print: 8.330 s Feb 24 2020 MiTek Industries, Inc. Wed Dec 16 12:08:54 2020 Page 2
ID:riFrQwqzJQyesEOjBg_H7VyKEle-?jcx7RFMhX_scNFYJR_Sp4_r8y1qEgRgdr8c1jy8PXN

NOTES-

- 11) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- 12) Ceiling dead load (5.0 psf) on member(s). 23-25, 23-24, 20-24, 20-21, 9-21; Wall dead load (5.0psf) on member(s).19-25, 17-20
- 13) Bottom chord live load (40.0 psf) and additional bottom chord dead load (5.0 psf) applied only to room. 17-19
- 14) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 121 lb uplift at joint 12.
- 15) This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 16) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
- 17) Attic room checked for L/360 deflection.

LOAD CASE(S) Standard

Job 20-6466-A	Truss G01	Truss Type Common Girder	Qty 1	Ply 3	GARY ROBINSON-LOT 73 SOUTH CREEK WOODLAKE MODEL ROOF
------------------	--------------	-----------------------------	----------	----------	--

Riverside Roof Truss, LLC, Danville, VA. 24541

Run: 8.330 s Feb 24 2020 Print: 8.330 s Feb 24 2020 MiTek Industries, Inc. Wed Dec 16 12:08:56 2020 Page 1
ID:riFrQwqzJQyesEOjBg_H7VyKEle-y6khX7GcD8EasgOxQs0wuV38ImpQia3y59dj6by8PXk

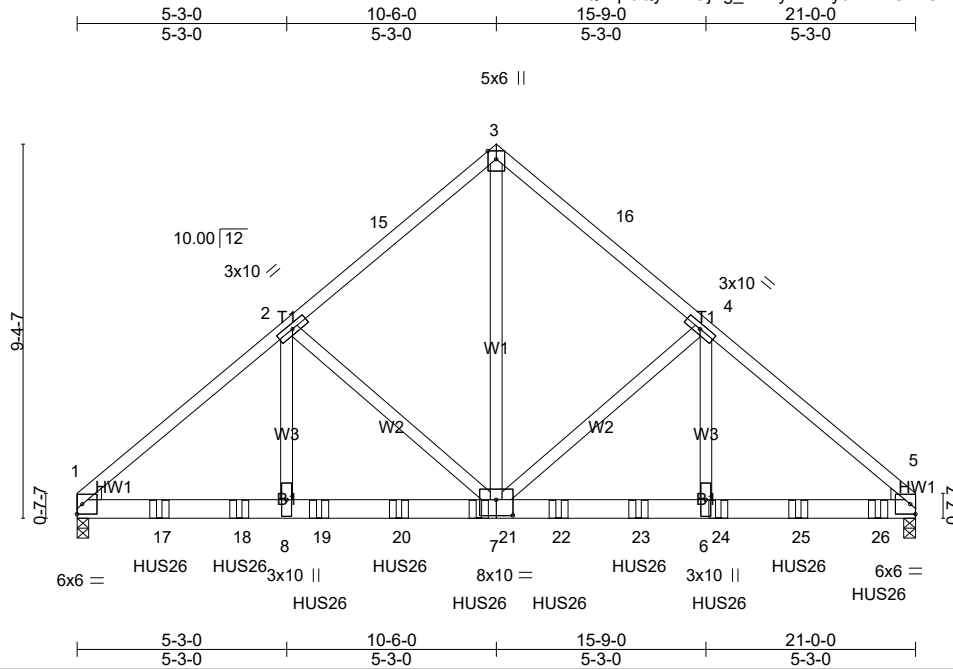


Plate Offsets (X,Y)-- [7:0-5-0,0-4-12]

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof) 30.0	2-0-0	TC 0.81	Vert(LL) -0.13	7-8	>999	360	MT20	244/190
Snow (Pf/Pg) 23.1/30.0	Plate Grip DOL 1.15	BC 0.53	Vert(CT) -0.23	7-8	>999	240		
TCDL 10.0	Lumber DOL 1.15	WB 0.89	Horz(CT) 0.04	5	n/a	n/a		
BCLL 0.0 *	Rep Stress Incr NO	Matrix-MS						
BCDL 10.0	Code IRC2015/TPI2014						Weight: 409 lb	FT = 20%

LUMBER-
 TOP CHORD 2x4 SP No.2
 BOT CHORD 2x6 SP 2400F 2.0E
 WEBS 2x4 SP No.3 *Except*
 W1: 2x4 SP No.2
 WEDGE
 Left: 2x4 SP No.3 , Right: 2x4 SP No.3

BRACING-
 TOP CHORD Structural wood sheathing directly applied or 5-6-2 oc purlins.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (lb/size) 1=10056/0-3-8 (min. 0-2-13), 5=11094/0-3-8 (min. 0-3-1)
 Max Horz 1=-216(LC 43)
 Max Uplift 1=-399(LC 16), 5=-435(LC 17)
 Max Grav 1=10078(LC 2), 5=11102(LC 2)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 1-2=-12962/613, 2-15=-8922/503, 3-15=-8783/523, 3-16=-8785/523, 4-16=-8924/503,
 4-5=-13067/617
 BOT CHORD 1-17=-456/9856, 17-18=-456/9856, 8-18=-456/9856, 8-19=-456/9856, 19-20=-456/9856,
 20-21=-456/9856, 7-21=-456/9856, 7-22=-381/9944, 22-23=-381/9944, 6-23=-381/9944,
 6-24=-381/9944, 24-25=-381/9944, 25-26=-381/9944, 5-26=-381/9944
 WEBS 3-7=-529/10883, 4-7=-4246/343, 4-6=-136/5092, 2-7=-4130/338, 2-8=-131/4958

- NOTES-**
- 3-ply truss to be connected together with 10d (0.131"x3") nails as follows:
 Top chords connected as follows: 2x4 - 1 row at 0-9-0 oc.
 Bottom chords connected as follows: 2x6 - 3 rows staggered at 0-5-0 oc.
 Webs connected as follows: 2x4 - 1 row at 0-9-0 oc.
 - All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
 - Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCCL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - TCCL: ASCE 7-10; Pr=30.0 psf (roof live load: Lumber DOL=1.15 Plate DOL=1.15); Pg=30.0 psf (ground snow); Pf=23.1 psf (flat roof snow: Lumber DOL=1.15 Plate DOL=1.15); Category II; Exp B; Partially Exp.; Ct=1.10
 - Unbalanced snow loads have been considered for this design.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 399 lb uplift at joint 1 and 435 lb uplift at joint 5.
 - This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

Job 20-6466-A	Truss G01	Truss Type Common Girder	Qty 1	Ply 3	GARY ROBINSON-LOT 73 SOUTH CREEK WOODLAKE MODEL ROOF Job Reference (optional)
------------------	--------------	-----------------------------	----------	----------	--

Riverside Roof Truss, LLC, Danville, VA. 24541

Run: 8.330 s Feb 24 2020 Print: 8.330 s Feb 24 2020 MiTek Industries, Inc. Wed Dec 16 12:08:56 2020 Page 2
ID:riFrQwqzJQyesEOjBg_H7VyKEle-y6khX7GcD8EasgOxQs0wuV38ImpQia3y59dj6by8PXL

NOTES-

- 11) Use Simpson Strong-Tie HUS26 (14-10d Girder, 6-10d Truss, Single Ply Girder) or equivalent spaced at 2-0-0 oc max. starting at 2-0-12 from the left end to 20-0-12 to connect truss(es) AT01 (1 ply 2x10 SP) to back face of bottom chord.
- 12) Fill all nail holes where hanger is in contact with lumber.

LOAD CASE(S) Standard

1) Dead + Snow (balanced): Lumber Increase=1.15, Plate Increase=1.15

Uniform Loads (plf)

Vert: 1-3=-66, 3-5=-66, 9-12=-20

Concentrated Loads (lb)

Vert: 17=-1934(B) 18=-1934(B) 19=-1934(B) 20=-1934(B) 21=-1934(B) 22=-1934(B) 23=-1934(B) 24=-1934(B) 25=-1934(B) 26=-1935(B)

Job	Truss	Truss Type	Qty	Ply	GARY ROBINSON-LOT 73 SOUTH CREEK WOODLAKE MODEL ROOF
20-6466-A	PB01	GABLE	2	1	Job Reference (optional)

Riverside Roof Truss, LLC, Danville, VA. 24541

Run: 8.330 s Feb 24 2020 Print: 8.330 s Feb 24 2020 MiTek Industries, Inc. Wed Dec 16 12:08:57 2020 Page 1
ID:riFrQwqzJQyesEOjBg_H7VyKEle-QIH3ITHE_SMRTqz7_ZX9RicVBAHTRDg6JpNGe2y8PXK

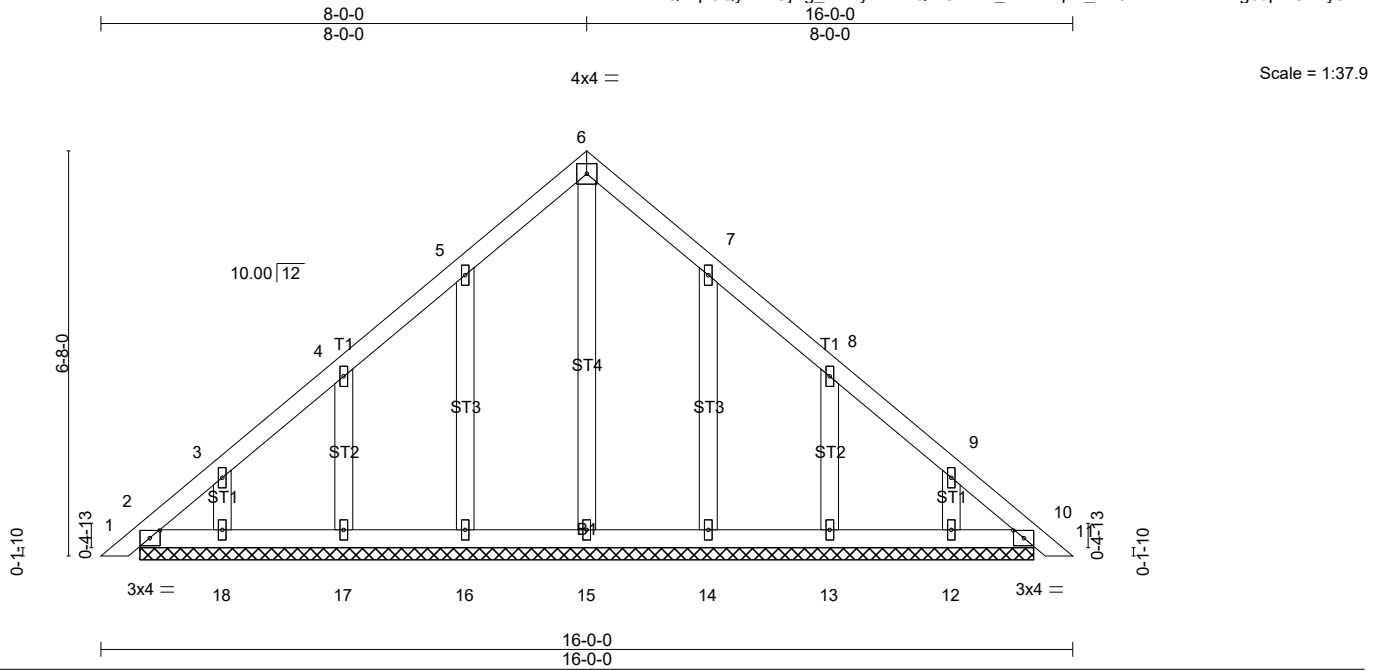


Plate Offsets (X,Y)-- [2:0-2-1,0-1-8], [10:0-2-1,0-1-8]

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof) 30.0	2-0-0	TC 0.06	Vert(LL)	0.00	10	n/r	MT20	244/190
Snow (Pf/Pg) 23.1/30.0	Plate Grip DOL 1.15	BC 0.03	Vert(CT)	0.00	10	n/r		
TCDL 10.0	Lumber DOL 1.15	WB 0.10	Horz(CT)	0.00	10	n/a		
BCLL 0.0 *	Rep Stress Incr YES	Matrix-S						
BCDL 10.0	Code IRC2015/TPI2014						Weight: 85 lb	FT = 20%

LUMBER-
 TOP CHORD 2x4 SP No.2
 BOT CHORD 2x4 SP No.2
 OTHERS 2x4 SP No.3

BRACING-
 TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

REACTIONS. All bearings 14-8-9.
 (lb) - Max Horz 2=-160(LC 14)
 Max Uplift All uplift 100 lb or less at joint(s) 2, 10, 16, 17, 18, 14, 13, 12
 Max Grav All reactions 250 lb or less at joint(s) 2, 10, 15, 16, 17, 18, 14, 13, 12

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCCL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
 - TCCL: ASCE 7-10; Pr=30.0 psf (roof live load: Lumber DOL=1.15 Plate DOL=1.15); Pg=30.0 psf (ground snow); Pf=23.1 psf (flat roof snow: Lumber DOL=1.15 Plate DOL=1.15); Category II; Exp B; Partially Exp.; Ct=1.10
 - Unbalanced snow loads have been considered for this design.
 - This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 23.1 psf on overhangs non-concurrent with other live loads.
 - All plates are 1.5x4 MT20 unless otherwise indicated.
 - Gable requires continuous bottom chord bearing.
 - Gable studs spaced at 2-0-0 oc.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 10, 16, 17, 18, 14, 13, 12.
 - This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - See Standard Industry Piggyback Truss Connection Detail for Connection to base truss as applicable, or consult qualified building designer.

LOAD CASE(S) Standard

Job	Truss	Truss Type	Qty	Ply	GARY ROBINSON-LOT 73 SOUTH CREEK WOODLAKE MODEL ROOF
20-6466-A	PB02	Piggyback	13	1	Job Reference (optional)

Riverside Roof Truss, LLC, Danville, VA. 24541

Run: 8.330 s Feb 24 2020 Print: 8.330 s Feb 24 2020 MiTek Industries, Inc. Wed Dec 16 12:08:57 2020 Page 1
ID:riFrQwqzJQyesEOjBg_H7VyKEle-QIH3ITHE_SMRTqz7_ZX9RicS9AFFRCq6JpNGe2y8PXK

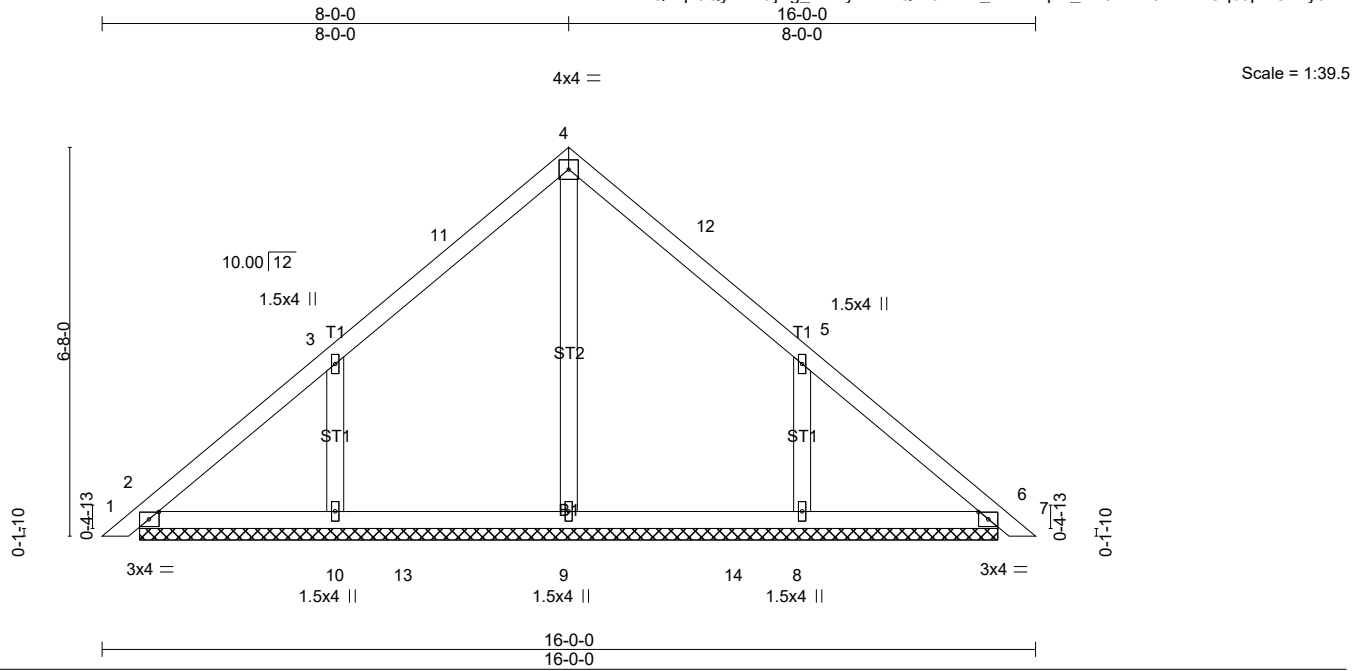


Plate Offsets (X,Y)-- [2:0-2-1,0-1-8], [6:0-2-1,0-1-8]

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof) 30.0	2-0-0	TC 0.25	Vert(LL)	0.00	7	n/r	MT20	244/190
Snow (Pf/Pg) 23.1/30.0	Plate Grip DOL 1.15	BC 0.17	Vert(CT)	0.00	7	n/r		
TCDL 10.0	Lumber DOL 1.15	WB 0.15	Horz(CT)	0.00	6	n/a		
BCLL 0.0 *	Rep Stress Incr YES	Matrix-S					Weight: 69 lb	FT = 20%
BCDL 10.0	Code IRC2015/TPI2014							

LUMBER-
 TOP CHORD 2x4 SP No.2
 BOT CHORD 2x4 SP No.2
 OTHERS 2x4 SP No.3

BRACING-
 TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

REACTIONS. All bearings 14-8-9.
 (lb) - Max Horz 2=160(LC 15)
 Max Uplift All uplift 100 lb or less at joint(s) 2 except 10=188(LC 16), 8=188(LC 17)
 Max Grav All reactions 250 lb or less at joint(s) 2, 6 except 9=395(LC 33), 10=470(LC 30), 8=469(LC 31)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 WEBS 3-10=-352/229, 5-8=-352/228


- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCCL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - TCCL: ASCE 7-10; Pr=30.0 psf (roof live load: Lumber DOL=1.15 Plate DOL=1.15); Pg=30.0 psf (ground snow); Pf=23.1 psf (flat roof snow: Lumber DOL=1.15 Plate DOL=1.15); Category II; Exp B; Partially Exp.; Ct=1.10
 - Unbalanced snow loads have been considered for this design.
 - This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 23.1 psf on overhangs non-concurrent with other live loads.
 - Gable requires continuous bottom chord bearing.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2 except (jt=lb) 10=188, 8=188.
 - This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - See Standard Industry Piggyback Truss Connection Detail for Connection to base truss as applicable, or consult qualified building designer.

LOAD CASE(S) Standard

Job	Truss	Truss Type	Qty	Ply	GARY ROBINSON-LOT 73 SOUTH CREEK WOODLAKE MODEL ROOF
20-6466-A	PB03	PIGGYBACK	2	2	Job Reference (optional)

Riverside Roof Truss, LLC, Danville, VA. 24541

Run: 8.330 s Feb 24 2020 Print: 8.330 s Feb 24 2020 MiTek Industries, Inc. Wed Dec 16 12:08:58 2020 Page 1
ID:riFrQwqzJQyesEOjBg_H7VyKEle-uUrSyplslUH5_YJYH2O_w9fcZcGAhmFYt6qAUy8PXJ

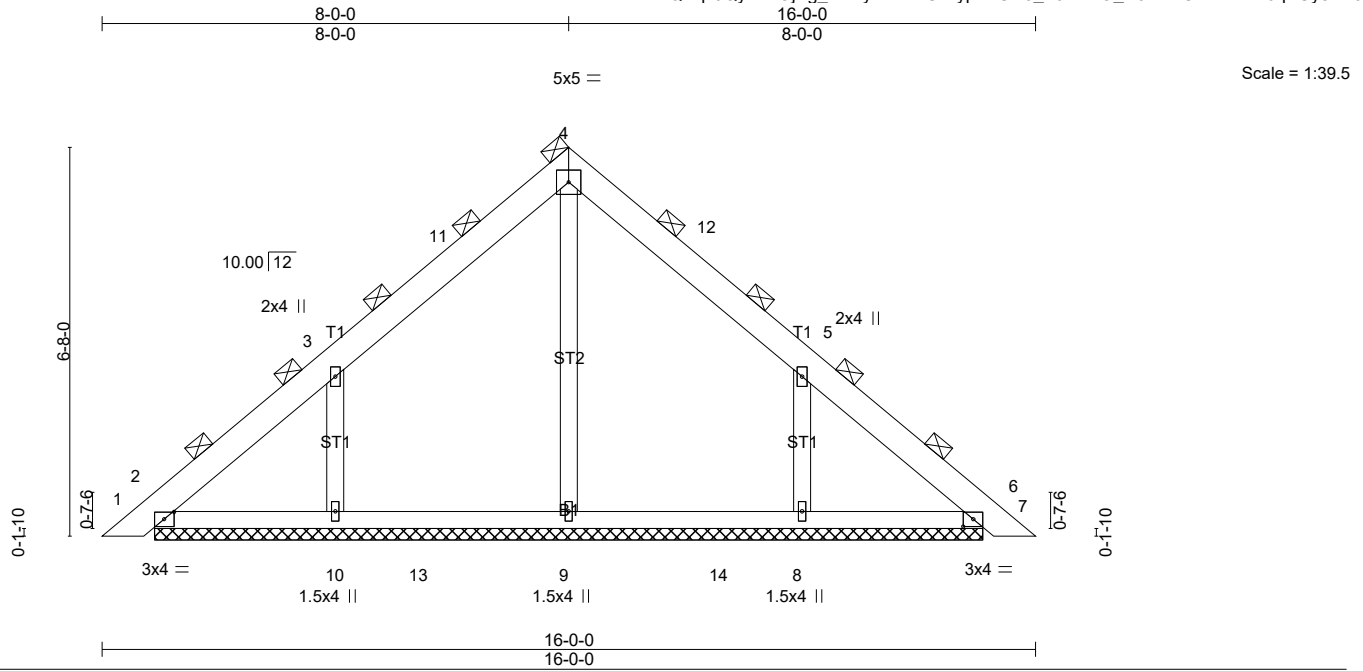

Scale = 1:39.5

Plate Offsets (X,Y)-- [2:0-2-1,0-1-8], [6:0-2-1,0-1-8]

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof) 30.0	2-8-0	TC 0.08	Vert(LL)	0.00	6	n/r	MT20	244/190
Snow (Pf/Pg) 23.1/30.0	Plate Grip DOL 1.15	BC 0.12	Vert(CT)	0.00	6	n/r		
TCDL 10.0	Lumber DOL 1.15	WB 0.05	Horz(CT)	0.00	6	n/a		
BCLL 0.0 *	Rep Stress Incr NO	Matrix-S						
BCDL 10.0	Code IRC2015/TPI2014						Weight: 171 lb	FT = 20%

LUMBER-
TOP CHORD 2x6 SP No.2
BOT CHORD 2x4 SP No.2
OTHERS 2x4 SP No.3

BRACING-
TOP CHORD 2-0-0 oc purlins (6-0-0 max.)
(Switched from sheeted: Spacing > 2-0-0).
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. All bearings 14-2-5.
(lb) - Max Horz 2=210(LC 15)
Max Uplift All uplift 100 lb or less at joint(s) 2 except 10=-245(LC 16), 8=-242(LC 17)
Max Grav All reactions 250 lb or less at joint(s) except 2=288(LC 2), 6=288(LC 2), 9=510(LC 33), 10=594(LC 30), 8=590(LC 31)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-270/160, 3-11=-264/167, 5-12=-259/162
WEBS 4-9=-251/0, 3-10=-459/302, 5-8=-455/299

- NOTES-**
- 2-ply truss to be connected together with 10d (0.131"x3") nails as follows:
Top chords connected as follows: 2x6 - 2 rows staggered at 0-9-0 oc.
Bottom chords connected as follows: 2x4 - 1 row at 0-9-0 oc.
 - All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
 - Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCCL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - TCCL: ASCE 7-10; Pr=30.0 psf (roof live load: Lumber DOL=1.15 Plate DOL=1.15); Pg=30.0 psf (ground snow); Pf=23.1 psf (flat roof snow: Lumber DOL=1.15 Plate DOL=1.15); Category II; Exp B; Partially Exp.; Ct=1.10
 - Unbalanced snow loads have been considered for this design.
 - This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 23.1 psf on overhangs non-concurrent with other live loads.
 - Gable requires continuous bottom chord bearing.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2 except (jt=lb) 10=245, 8=242.
 - This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - See Standard Industry Piggyback Truss Connection Detail for Connection to base truss as applicable, or consult qualified building designer.
 - Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

LOAD CASE(S) Standard

Job 20-6466-A	Truss PB04	Truss Type PIGGYBACK	Qty 2	Ply 3	GARY ROBINSON-LOT 73 SOUTH CREEK WOODLAKE MODEL ROOF
------------------	---------------	-------------------------	----------	----------	--

Riverside Roof Truss, LLC, Danville, VA. 24541

Run: 8.330 s Feb 24 2020 Print: 8.330 s Feb 24 2020 MiTek Industries, Inc. Wed Dec 16 12:08:59 2020 Page 1
ID:riFrQwqzJQyesEOjBg_H7VyKEle-MhPqA9JUW3c8j87W5_ZdW7hgyzvwv8pPn7sNjwy8PXI

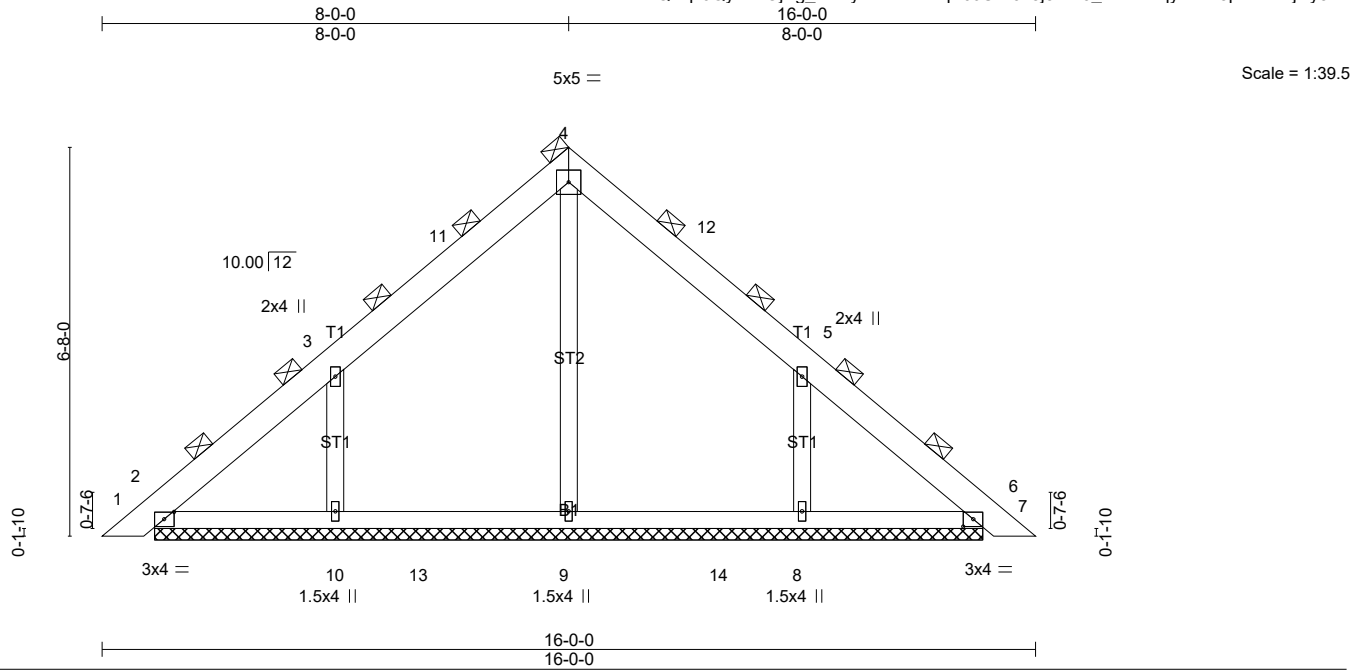


Plate Offsets (X,Y)-- [2:0-2-1,0-1-8], [6:0-2-1,0-1-8]

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof) 30.0	5-3-0	TC 0.11	Vert(LL)	0.00	6	n/r	MT20	244/190
Snow (Pf/Pg) 23.1/30.0	Plate Grip DOL 1.15	BC 0.16	Vert(CT)	0.00	6	n/r		
TCDL 10.0	Lumber DOL 1.15	WB 0.06	Horz(CT)	0.00	6	n/a		
BCLL 0.0 *	Rep Stress Incr NO	Matrix-S						
BCDL 10.0	Code IRC2015/TPI2014						Weight: 256 lb	FT = 20%

LUMBER-
TOP CHORD 2x6 SP No.2
BOT CHORD 2x4 SP No.2
OTHERS 2x4 SP No.3

BRACING-
TOP CHORD 2-0-0 oc purlins (6-0-0 max.)
(Switched from sheeted: Spacing > 2-0-0).
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. All bearings 14-2-5.
(lb) - Max Horz 2=-413(LC 14)
Max Uplift All uplift 100 lb or less at joint(s) 2 except 10=-482(LC 16), 8=-476(LC 17)
Max Grav All reactions 250 lb or less at joint(s) except 2=566(LC 2), 6=566(LC 2), 9=1004(LC 33), 10=1169(LC 30), 8=1162(LC 31)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-532/316, 3-11=-520/329, 4-11=-339/370, 4-12=-339/354, 5-12=-509/316, 5-6=-420/166
BOT CHORD 2-10=-123/295, 10-13=-124/295, 9-13=-124/295, 9-14=-124/295, 8-14=-124/295, 6-8=-123/295
WEBS 4-9=-493/0, 3-10=-903/594, 5-8=-896/588

- NOTES-**
- 3-ply truss to be connected together with 10d (0.131"x3") nails as follows:
Top chords connected as follows: 2x6 - 2 rows staggered at 0-9-0 oc.
Bottom chords connected as follows: 2x4 - 1 row at 0-9-0 oc.
 - All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
 - Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCCL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - TCCL: ASCE 7-10; Pr=30.0 psf (roof live load: Lumber DOL=1.15 Plate DOL=1.15); Pg=30.0 psf (ground snow); Pf=23.1 psf (flat roof snow: Lumber DOL=1.15 Plate DOL=1.15); Category II; Exp B; Partially Exp.; Ct=1.10
 - Unbalanced snow loads have been considered for this design.
 - This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 23.1 psf on overhangs non-concurrent with other live loads.
 - Gable requires continuous bottom chord bearing.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2 except (jt=lb) 10=482, 8=476.
 - This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - See Standard Industry Piggyback Truss Connection Detail for Connection to base truss as applicable, or consult qualified building designer.

Continued on page 2

Job	Truss	Truss Type	Qty	Ply	GARY ROBINSON-LOT 73 SOUTH CREEK WOODLAKE MODEL ROOF
20-6466-A	PB04	PIGGYBACK	2	3	Job Reference (optional)

Riverside Roof Truss, LLC, Danville, VA. 24541

Run: 8.330 s Feb 24 2020 Print: 8.330 s Feb 24 2020 MiTek Industries, Inc. Wed Dec 16 12:08:59 2020 Page 2
ID:riFrQwqzJQyesEOjBg_H7VyKEle-MhPqA9JUW3c8j87W5_ZdW7hqyzwv8pPn7sNjwy8PXl

LOAD CASE(S) Standard

Job 20-6466-A	Truss T01	Truss Type Common	Qty 1	Ply 1	GARY ROBINSON-LOT 73 SOUTH CREEK WOODLAKE MODEL ROOF
Riverside Roof Truss, LLC, Danville, VA. 24541					Job Reference (optional)

Run: 8.330 s Feb 24 2020 Print: 8.330 s Feb 24 2020 MiTek Industries, Inc. Wed Dec 16 12:09:00 2020 Page 1
 ID:riFrQwqzJQyesEOjBg_H7VyKEle-qtzCNVJ6HNk?Kliifi5s3LEv2NAQeXGY?nbxFNy8PXH

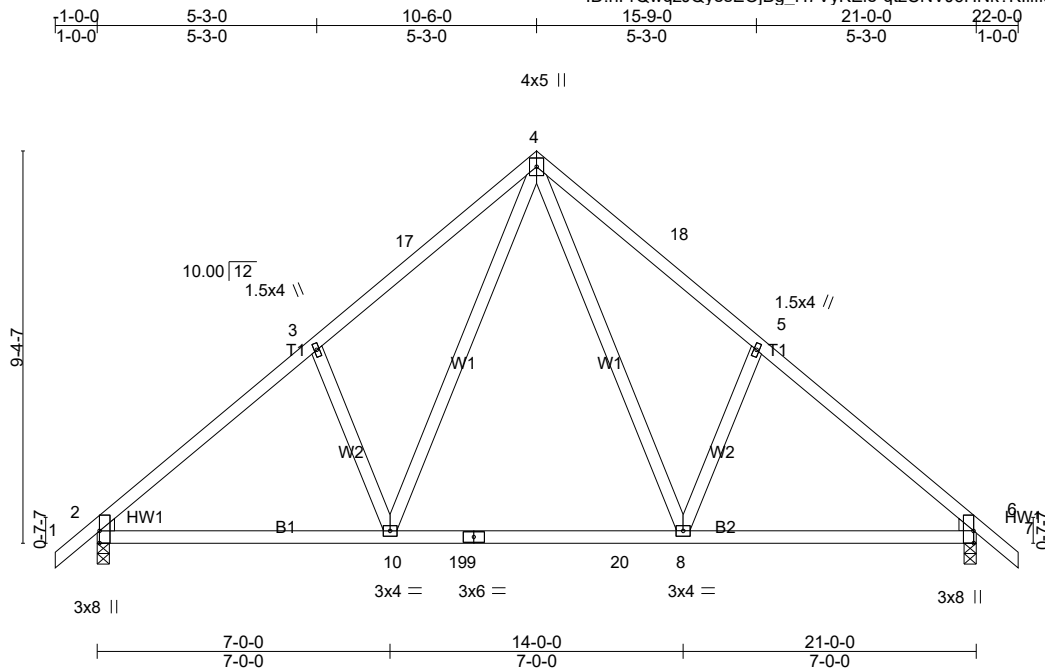


Plate Offsets (X,Y)-- [2:0-0-5,0,0-6], [2:0-0-10,0,3-9], [2:0-3-8,Edge], [6:0-0-5,0,0-6], [6:0-0-10,0,3-9], [6:0-3-8,Edge]

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL (roof) 30.0	2-0-0	TC 0.47	in (loc) l/defl L/d	MT20	244/190
Snow (Pf/Pg) 23.1/30.0	Plate Grip DOL 1.15	BC 0.52	Vert(LL) -0.13 8-10 >999 360		
TCDL 10.0	Lumber DOL 1.15	WB 0.30	Vert(CT) -0.18 8-10 >999 240		
BCLL 0.0 *	Rep Stress Incr YES	Matrix-MS	Horz(CT) 0.02 6 n/a n/a		
BCDL 10.0	Code IRC2015/TPI2014			Weight: 119 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 4-9-4 oc purlins.
BOT CHORD 2x4 SP No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.3	
WEDGE	
Left: 2x4 SP No.3 , Right: 2x4 SP No.3	MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

REACTIONS. (lb/size) 2=971/0-3-8 (min. 0-1-8), 6=971/0-3-8 (min. 0-1-8)
 Max Horz 2=-237(LC 14)
 Max Uplift 2=-99(LC 16), 6=-99(LC 17)
 Max Grav 2=1130(LC 2), 6=1130(LC 2)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-3=-1310/201, 3-17=-1176/291, 4-17=-1031/312, 4-18=-1031/312, 5-18=-1176/291, 5-6=-1310/201
 BOT CHORD 2-10=-128/1012, 10-19=0/665, 9-19=0/665, 9-20=0/665, 8-20=0/665, 6-8=-36/919
 WEBS 4-8=-167/590, 5-8=-366/249, 4-10=-167/590, 3-10=-366/249


- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCCL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - TCCL: ASCE 7-10; Pr=30.0 psf (roof live load: Lumber DOL=1.15 Plate DOL=1.15); Pg=30.0 psf (ground snow); Pf=23.1 psf (flat roof snow: Lumber DOL=1.15 Plate DOL=1.15); Category II; Exp B; Partially Exp.; Ct=1.10
 - Unbalanced snow loads have been considered for this design.
 - This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 23.1 psf on overhangs non-concurrent with other live loads.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 6.
 - This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard

Job	Truss	Truss Type	Qty	Ply	GARY ROBINSON-LOT 73 SOUTH CREEK WOODLAKE MODEL ROOF
20-6466-A	T01GE	GABLE	1	1	Job Reference (optional)

Riverside Roof Truss, LLC, Danville, VA. 24541

Run: 8.330 s Feb 24 2020 Print: 8.330 s Feb 24 2020 MiTek Industries, Inc. Wed Dec 16 12:09:01 2020 Page 1
ID:riFrQwqzJQyesEOjBg_H7VyKEle-I3XabrKl2gssySHuDpc5bYmAhndFN?ciERLUnpy8PXG

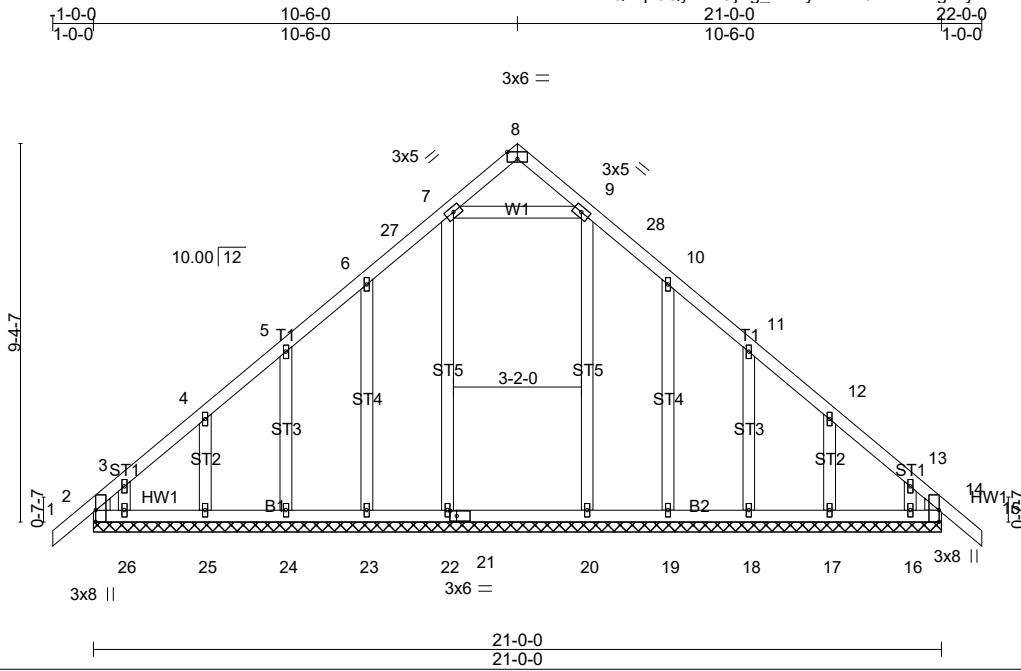

Scale = 1:57.0

Plate Offsets (X,Y)-- [2:0-3-8,Edge], [2:0-0-10,0-3-9], [2:0-0-5,0-0-6], [8:0-3-0,Edge], [14:0-3-8,Edge], [14:0-0-10,0-3-9], [14:0-0-5,0-0-6], [21:0-2-0,0-1-8]

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof) 30.0	2-0-0	TC 0.09	Vert(LL)	-0.00	15	n/r	MT20	244/190
Snow (Pf/Pg) 23.1/30.0	Plate Grip DOL 1.15	BC 0.10	Vert(CT)	-0.00	15	n/r		
TCDL 10.0	Lumber DOL 1.15	WB 0.23	Horz(CT)	0.01	14	n/a		
BCLL 0.0 *	Rep Stress Incr YES	Matrix-S						
BCDL 10.0	Code IRC2015/TPI2014						Weight: 142 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
 BOT CHORD 2x4 SP No.2
 WEBS 2x4 SP No.3
 OTHERS 2x4 SP No.3
 WEDGE
 Left: 2x4 SP No.3 , Right: 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6'-0" oc purlins.
 BOT CHORD Rigid ceiling directly applied or 10'-0" oc bracing.
 MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

REACTIONS.

All bearings 21-0-0.
 (lb) - Max Horz 2=-237(LC 14)
 Max Uplift All uplift 100 lb or less at joint(s) 23, 24, 25, 19, 18, 17, 14, 16 except 2=-128(LC 12), 26=-107(LC 16)
 Max Grav All reactions 250 lb or less at joint(s) 23, 24, 25, 26, 19, 18, 17, 14, 16 except 2=257(LC 31), 22=319(LC 30), 20=294(LC 6)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-262/208


NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCCL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- TCCL: ASCE 7-10; Pr=30.0 psf (roof live load: Lumber DOL=1.15 Plate DOL=1.15); Pg=30.0 psf (ground snow); Pf=23.1 psf (flat roof snow: Lumber DOL=1.15 Plate DOL=1.15); Category II; Exp B; Partially Exp.; Ct=1.10
- Unbalanced snow loads have been considered for this design.
- This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 23.1 psf on overhangs non-concurrent with other live loads.
- All plates are 1.5x4 MT20 unless otherwise indicated.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 2'-0" oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3'-6" tall by 2'-0" wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 23, 24, 25, 19, 18, 17, 14, 16 except (jt=lb) 2=128, 26=107.
- This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard

Job 20-6466-A	Truss T02	Truss Type Common	Qty 5	Ply 1	GARY ROBINSON-LOT 73 SOUTH CREEK WOODLAKE MODEL ROOF
Riverside Roof Truss, LLC, Danville, VA. 24541					Job Reference (optional)

Run: 8.330 s Feb 24 2020 Print: 8.330 s Feb 24 2020 MiTek Industries, Inc. Wed Dec 16 12:09:02 2020 Page 1
ID:pf8dE?WmwuyAciWE6W7qSHy8h3?-mG5yoBLNo_jacs5n67K8mJGIBtz6SurT541JFy8PXF



4x5 ||

Scale = 1:51.0

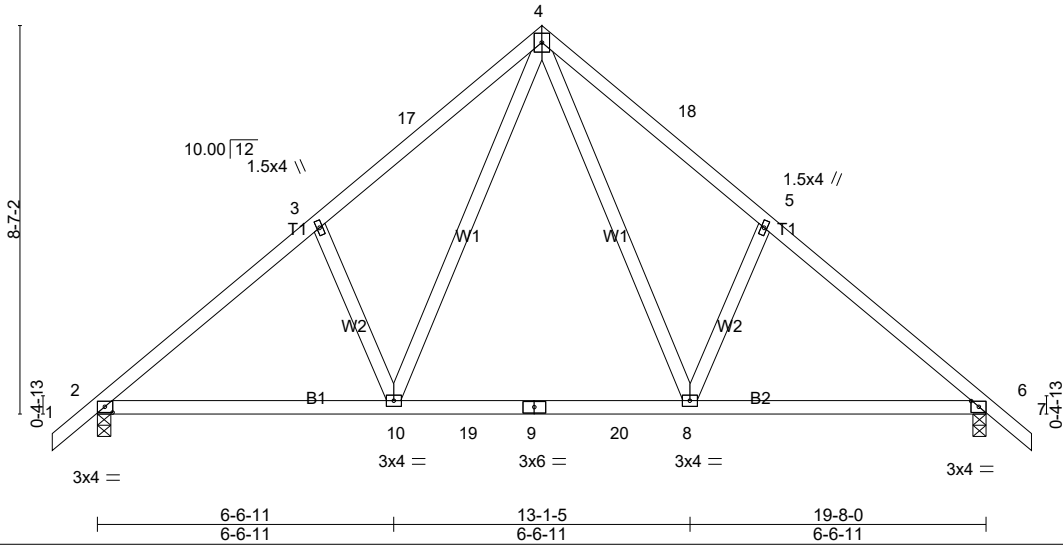


Plate Offsets (X,Y)-- [2:0-2-1,0-1-8], [6:0-2-1,0-1-8]

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof) 30.0	2-0-0	TC 0.42	Vert(LL)	-0.09 8-10	>999	360	MT20	244/190
Snow (Pf/Pg) 23.1/30.0	Plate Grip DOL 1.15	BC 0.46	Vert(CT)	-0.13 8-10	>999	240		
TCDL 10.0	Lumber DOL 1.15	WB 0.23	Horz(CT)	0.02 6	n/a	n/a		
BCLL 0.0 *	Rep Stress Incr YES	Matrix-MS						
BCDL 10.0	Code IRC2015/TPI2014						Weight: 110 lb	FT = 20%

LUMBER-
TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.3

BRACING-
TOP CHORD Structural wood sheathing directly applied or 4-10-10 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

REACTIONS. (lb/size) 2=914/0-3-8 (min. 0-1-8), 6=914/0-3-8 (min. 0-1-8)
Max Horz 2=-223(LC 14)
Max Uplift 2=-96(LC 16), 6=-96(LC 17)
Max Grav 2=1063(LC 2), 6=1063(LC 2)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-1273/188, 3-17=-1144/269, 4-17=-1005/289, 4-18=-1005/289, 5-18=-1144/269, 5-6=-1273/188
BOT CHORD 2-10=-119/985, 10-19=0/634, 9-19=0/634, 9-20=0/634, 8-20=0/634, 6-8=-33/904
WEBS 4-8=-151/578, 5-8=-361/231, 4-10=-151/578, 3-10=-361/231


- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCCL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - TCCL: ASCE 7-10; Pr=30.0 psf (roof live load); Lumber DOL=1.15 Plate DOL=1.15; Pg=30.0 psf (ground snow); Pf=23.1 psf (flat roof snow); Lumber DOL=1.15 Plate DOL=1.15; Category II; Exp B; Partially Exp.; Ct=1.10
 - Unbalanced snow loads have been considered for this design.
 - This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 23.1 psf on overhangs non-concurrent with other live loads.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 6.
 - This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard

Job	Truss	Truss Type	Qty	Ply	GARY ROBINSON-LOT 73 SOUTH CREEK WOODLAKE MODEL ROOF
20-6466-A	T02GE	Common Supported Gable	1	1	Job Reference (optional)

Riverside Roof Truss, LLC, Danville, VA. 24541

Run: 8.330 s Feb 24 2020 Print: 8.330 s Feb 24 2020 MiTek Industries, Inc. Wed Dec 16 12:09:02 2020 Page 1
ID: pf8dE?WmwuyAcIWE6W7qSHy8h3?-mG5yoBLNo_jacs5n67K8mJLCB_96TqrT541JFy8PXF



3x6 =

Scale = 1:51.5

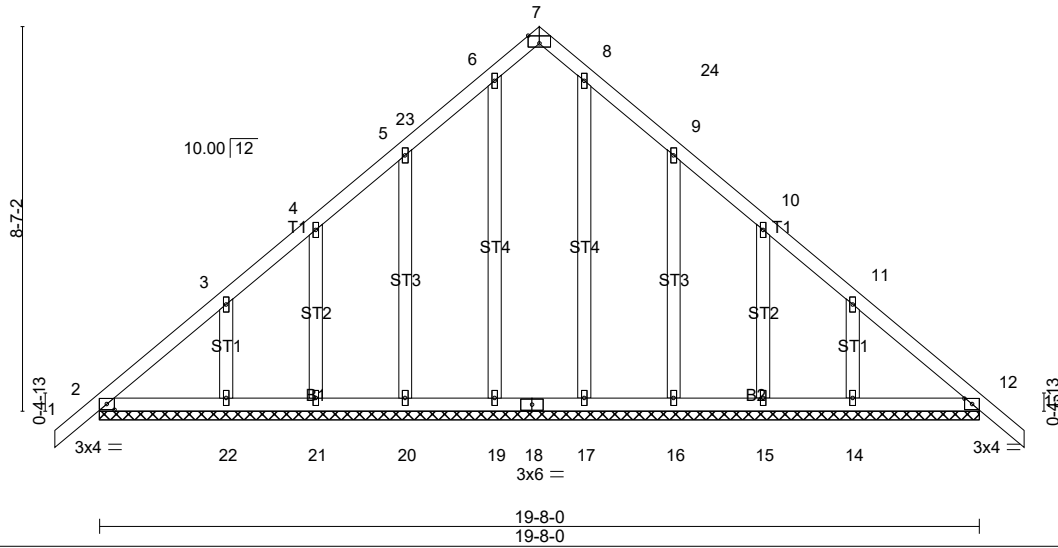


Plate Offsets (X,Y)-- [2:0-2-1,0-1-8], [7:0-3-0,Edge], [12:0-2-1,0-1-8]

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof) 30.0	2-0-0	TC 0.11	Vert(LL) 0.00	12	n/r	180	MT20	244/190
Snow (Pf/Pg) 23.1/30.0	Plate Grip DOL 1.15	BC 0.06	Vert(CT) 0.00	13	n/r	120		
TCDL 10.0	Lumber DOL 1.15	WB 0.17	Horz(CT) 0.01	12	n/a	n/a		
BCLL 0.0 *	Rep Stress Incr YES	Matrix-S						
BCDL 10.0	Code IRC2015/TPI2014						Weight: 128 lb	FT = 20%

LUMBER-
TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
OTHERS 2x4 SP No.3

BRACING-
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

REACTIONS. All bearings 19-8-0.
(lb) - Max Horz 2=223(LC 15)
Max Uplift All uplift 100 lb or less at joint(s) 2, 19, 21, 15 except 20=-103(LC 16), 22=-115(LC 16), 16=-107(LC 17), 14=-115(LC 17)
Max Grav All reactions 250 lb or less at joint(s) 2, 19, 20, 21, 17, 16, 15, 12 except 22=279(LC 30), 14=278(LC 31)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-271/183
BOT CHORD 2-22=-174/250, 21-22=-174/250, 20-21=-174/250, 19-20=-174/250, 18-19=-174/250, 17-18=-174/250, 16-17=-174/250, 15-16=-174/250, 14-15=-174/250, 12-14=-174/250


- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCCL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
 - TCCL: ASCE 7-10; Pr=30.0 psf (roof live load: Lumber DOL=1.15 Plate DOL=1.15); Pg=30.0 psf (ground snow); Pf=23.1 psf (flat roof snow: Lumber DOL=1.15 Plate DOL=1.15); Category II; Exp B; Partially Exp.; Ct=1.10
 - Unbalanced snow loads have been considered for this design.
 - This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 23.1 psf on overhangs non-concurrent with other live loads.
 - All plates are 1.5x4 MT20 unless otherwise indicated.
 - Gable requires continuous bottom chord bearing.
 - Gable studs spaced at 2-0-0 oc.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 19, 21, 15 except (jt=lb) 20=103, 22=115, 16=107, 14=115.
 - This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard

Job 20-6466-A	Truss TG01	Truss Type ATTIC GIRDER	Qty 1	Ply 2	GARY ROBINSON-LOT 73 SOUTH CREEK WOODLAKE MODEL ROOF
------------------	---------------	----------------------------	----------	----------	--

Riverside Roof Truss, LLC, Danville, VA. 24541

Run: 8.330 s Feb 24 2020 Print: 8.330 s Feb 24 2020 MiTek Industries, Inc. Wed Dec 16 12:09:04 2020 Page 1
ID:riFrQwqzJQyesEOjBg_H7VyKEle-jeDjDsMdkbERpv0TuX9oDBOVu_VkaGW8wPZ8O8y8PX



Scale = 1:79.7

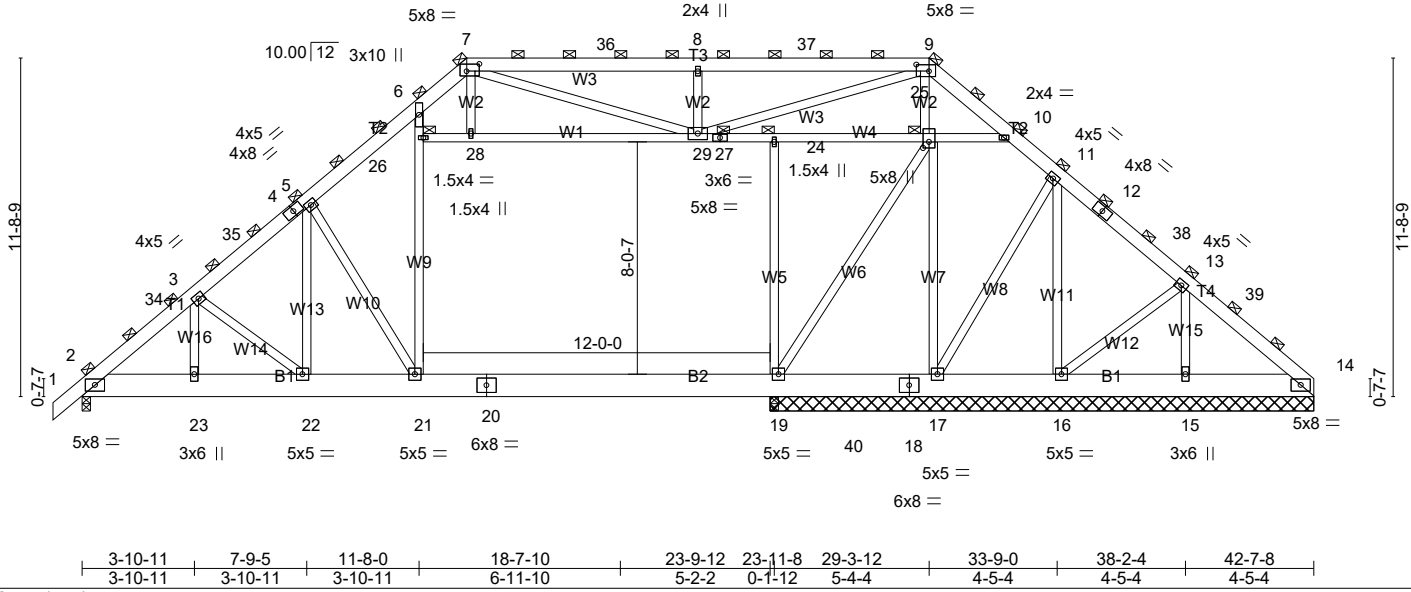


Plate Offsets (X,Y)--	[7:0-5-4,0-3-0], [9:0-5-4,0-2-12], [25:0-2-8,0-2-8]
-----------------------	---

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof) 30.0	Plate Grip DOL 2-8-0	TC 0.86	Vert(LL) -0.18	19-21	>999	360	MT20	244/190
Snow (Pf/Pg) 23.1/30.0	Lumber DOL 1.15	BC 0.76	Vert(CT) -0.28	19-21	>999	240		
TCDL 10.0	Rep Stress Incr NO	WB 0.60	Horz(CT) 0.03	14	n/a	n/a		
BCLL 0.0 *	Code IRC2015/TPI2014	Matrix-MS	Attic -0.10	19-21	1538	360		
BCDL 10.0							Weight: 938 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x6 SP No.2	TOP CHORD 2-0-0 oc purlins (5-8-12 max.)
BOT CHORD 2x10 SP No.2	(Switched from sheeted: Spacing > 2-0-0).
WEBS 2x4 SP No.3 *Except*	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
W9,W5,W1,W4: 2x4 SP No.2	JOINTS 1 Brace at Jt(s): 7, 9, 24, 25, 26, 29

REACTIONS. All bearings 18-9-12 except (jt=length) 2=0-3-8.
 (lb) - Max Horz 2=386(LC 13)
 Max Uplift All uplift 100 lb or less at joint(s) 16, 15, 14 except 2=-182(LC 16), 17=-270(LC 12)
 Max Grav All reactions 250 lb or less at joint(s) except 2=2834(LC 46), 19=1138(LC 23), 19=251(LC 1), 17=735(LC 39), 16=790(LC 50), 15=1308(LC 40), 14=1079(LC 2)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-34=-4009/228, 3-34=-3923/246, 3-35=-3725/272, 4-35=-3503/289, 4-5=-3498/293,
 5-6=-3436/303, 6-7=-2565/388, 7-36=-3661/649, 8-36=-3661/649, 8-37=-3661/649,
 9-37=-3661/649, 9-10=-1569/191, 10-11=-2073/282, 11-12=-1857/192, 12-38=-1881/171,
 13-38=-2010/151, 13-39=-1294/89, 14-39=-1466/67
 BOT CHORD 2-23=-309/3215, 22-23=-309/3215, 21-22=-209/2975, 20-21=-159/2493, 19-20=-159/2493,
 19-40=-122/1790, 18-40=-122/1790, 17-18=-122/1790, 16-17=-86/1468, 15-16=-42/1079,
 14-15=-42/1079
 WEBS 3-22=-321/154, 5-22=-129/597, 5-21=-1387/351, 21-26=-14/1746, 6-26=0/1568,
 19-24=-438/0, 19-25=-100/1376, 17-25=-1414/154, 11-17=-71/638, 11-16=-722/97,
 13-16=-57/562, 13-15=-1131/149, 26-28=-290/14, 28-29=-272/16, 27-29=-1383/177,
 24-27=-1383/177, 24-25=-1383/177, 10-25=-695/159, 9-25=-524/429, 7-28=0/313,
 8-29=-1438/350, 7-29=-752/1525, 9-29=-458/2645

- NOTES-**
- 2-ply truss to be connected together with 10d (0.131"x3") nails as follows:
 Top chords connected as follows: 2x6 - 2 rows staggered at 0-9-0 oc.
 Bottom chords connected as follows: 2x10 - 2 rows staggered at 0-9-0 oc.
 Webs connected as follows: 2x4 - 1 row at 0-9-0 oc.
 - All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
 - Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCCL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - TCCL: ASCE 7-10; Pr=30.0 psf (roof live load: Lumber DOL=1.15 Plate DOL=1.15); Pg=30.0 psf (ground snow); Pf=23.1 psf (flat roof snow: Lumber DOL=1.15 Plate DOL=1.15); Category II; Exp B; Partially Exp.; Ct=1.10, Lu=50-0-0
 - Unbalanced snow loads have been considered for this design.
 - This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 23.1 psf on overhangs non-concurrent with other live loads.
 - Provide adequate drainage to prevent water ponding.

Continued on page 2

Job	Truss	Truss Type	Qty	Ply	GARY ROBINSON-LOT 73 SOUTH CREEK WOODLAKE MODEL ROOF
20-6466-A	TG01	ATTIC GIRDER	1	2	Job Reference (optional)

Riverside Roof Truss, LLC, Danville, VA. 24541

Run: 8.330 s Feb 24 2020 Print: 8.330 s Feb 24 2020 MiTek Industries, Inc. Wed Dec 16 12:09:04 2020 Page 2
ID:riFrQwqzJQyesEOjBg_H7VyKEle-jeDjDsMdKbERpv0TuX9oDBOVu_VkaGW8wPZ8O8y8PXD

NOTES-


- 9) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 10) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- 11) Ceiling dead load (5.0 psf) on member(s). 26-28, 28-29, 24-29, 24-25, 10-25; Wall dead load (5.0psf) on member(s).21-26, 19-24
- 12) Bottom chord live load (40.0 psf) and additional bottom chord dead load (5.0 psf) applied only to room. 19-21
- 13) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 16, 15, 14 except (jt=lb) 2=182, 17=270.
- 14) This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 15) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
- 16) Attic room checked for L/360 deflection.

LOAD CASE(S) Standard

Job	Truss	Truss Type	Qty	Ply	GARY ROBINSON-LOT 73 SOUTH CREEK WOODLAKE MODEL ROOF
20-6466-A	TG02	ATTIC GIRDER	1	2	Job Reference (optional)

Riverside Roof Truss, LLC, Danville, VA. 24541

Run: 8.330 s Feb 24 2020 Print: 8.330 s Feb 24 2020 MiTek Industries, Inc. Wed Dec 16 12:09:05 2020 Page 1
 ID:riFrQwqzJQyesEOjBg_H7VyKEle-Brm5QCNF5vMIR3afSFg1mOxgJOTqJhAH92Jiway8PXc



Scale = 1:77.9


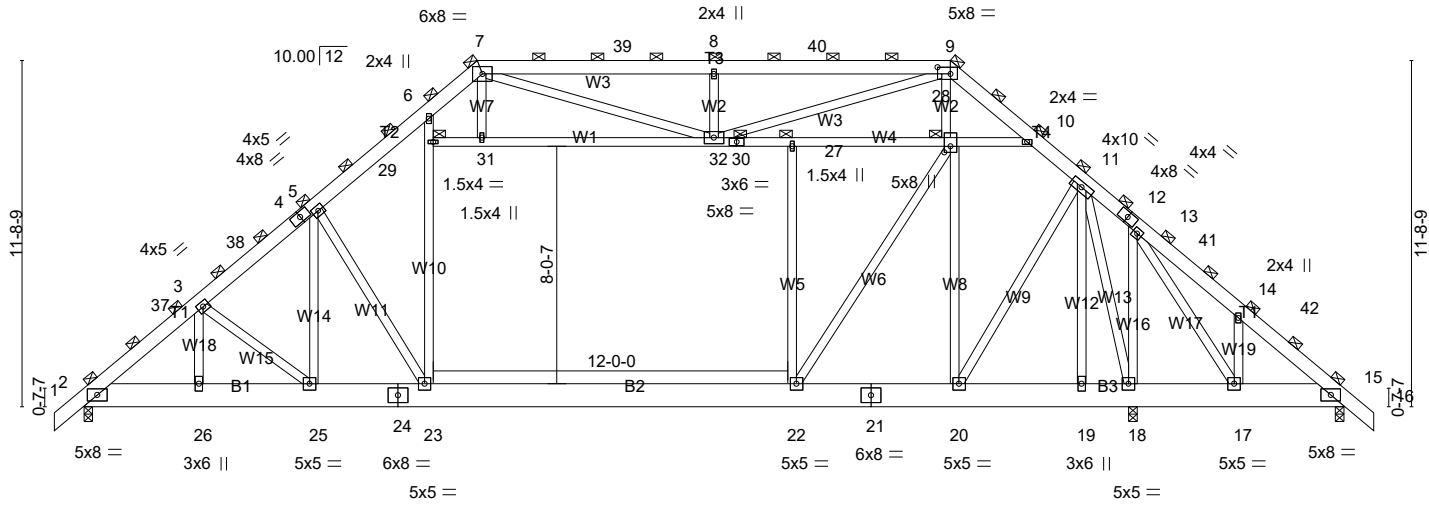


Plate Offsets (X,Y)-- [9:0-5-4,0-2-12], [28:0-2-8,0-2-8]

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof) 30.0	2-8-0	TC 0.88	Vert(LL)	-0.18 22-23	>999	360	MT20	244/190
Snow (Pf/Pg) 23.1/30.0	Plate Grip DOL 1.15	BC 0.64	Vert(CT)	-0.28 22-23	>999	240		
TCDL 10.0	Lumber DOL 1.15	WB 0.71	Horz(CT)	0.03 15	n/a	n/a		
BCLL 0.0 *	Rep Stress Incr NO	Matrix-MS	Attic	-0.09 22-23	1730	360		
BCDL 10.0	Code IRC2015/TPI2014						Weight: 980 lb	FT = 20%

LUMBER-
 TOP CHORD 2x6 SP No.2
 BOT CHORD 2x10 SP No.2
 WEBS 2x4 SP No.3 *Except*
 W10,W5,W1,W4: 2x4 SP No.2

BRACING-
 TOP CHORD 2-0-0 oc purlins (5-3-13 max.)
 (Switched from sheeted: Spacing > 2-0-0).
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing, Except:
 6-0-0 oc bracing: 17-18,15-17.

JOINTS
 1 Brace at Jt(s): 7, 9, 27, 28, 29, 32

REACTIONS. (lb/size) 2=2509/0-3-8 (min. 0-1-12), 15=906/0-3-8 (min. 0-1-8), 18=2327/0-3-8 (min. 0-1-14)
 Max Horz 2=-396(LC 14)
 Max Uplift 2=-109(LC 16), 15=-304(LC 16), 18=-89(LC 17)
 Max Grav 2=2979(LC 46), 15=1091(LC 2), 18=3199(LC 58)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-37=-4239/159, 3-37=-4149/177, 3-38=-3940/208, 4-38=-3716/208, 4-5=-3711/230,
 5-6=-3734/220, 6-7=-2692/338, 7-39=-3880/541, 8-39=-3880/541, 8-40=-3880/541,
 9-40=-3880/541, 9-10=-2094/44, 10-11=-2205/294, 11-12=-1247/639, 12-13=-1250/623,
 13-41=-986/576, 14-41=-1243/563, 14-42=-1023/470, 15-42=-1119/454
 BOT CHORD 2-26=-203/3378, 25-26=-203/3378, 24-25=-118/3131, 23-24=-118/3131, 22-23=-42/2738,
 21-22=-178/1773, 20-21=-178/1773, 19-20=-274/1067, 18-19=-274/1067, 17-18=-384/849,
 15-17=-333/830
 WEBS 3-25=-325/148, 5-25=-201/528, 5-23=-1331/397, 23-29=0/1857, 6-29=0/1671, 22-27=-387/0,
 22-28=0/1930, 20-28=-1462/4, 11-20=0/1577, 11-19=-534/20, 29-31=-338/0, 31-32=-330/0,
 30-32=-1321/283, 27-30=-1321/283, 27-28=-1321/283, 10-28=-591/403, 9-28=-326/591,
 7-31=0/317, 8-32=-1423/352, 7-32=-624/1648, 9-32=-473/2583, 13-18=-718/302,
 14-17=-447/249, 11-18=-1929/0, 13-17=-262/201

- NOTES-**
- 2-ply truss to be connected together with 10d (0.131"x3") nails as follows:
 Top chords connected as follows: 2x6 - 2 rows staggered at 0-9-0 oc.
 Bottom chords connected as follows: 2x10 - 2 rows staggered at 0-9-0 oc.
 Webs connected as follows: 2x4 - 1 row at 0-9-0 oc.
 - All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
 - Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCCL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - TCCL: ASCE 7-10; Pr=30.0 psf (roof live load: Lumber DOL=1.15 Plate DOL=1.15); Pg=30.0 psf (ground snow); Pf=23.1 psf (flat roof snow: Lumber DOL=1.15 Plate DOL=1.15); Category II; Exp B; Partially Exp.; Ct=1.10, Lu=50-0-0
 - Unbalanced snow loads have been considered for this design.
 - This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 23.1 psf on overhangs non-concurrent with other live loads.
 - Provide adequate drainage to prevent water ponding.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.

Continued on page 2

Job	Truss	Truss Type	Qty	Ply	GARY ROBINSON-LOT 73 SOUTH CREEK WOODLAKE MODEL ROOF
20-6466-A	TG02	ATTIC GIRDER	1	2	Job Reference (optional)

Riverside Roof Truss, LLC, Danville, VA. 24541

Run: 8.330 s Feb 24 2020 Print: 8.330 s Feb 24 2020 MiTek Industries, Inc. Wed Dec 16 12:09:06 2020 Page 2
ID:riFrQwqzJQyesEOjBg_H7VyKEle-f1KTeY0tsDU92D9s0yBGlcUr3oC328QROi2FT0y8PXb

NOTES-


- 10) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- 11) Ceiling dead load (5.0 psf) on member(s). 29-31, 31-32, 27-32, 27-28, 10-28; Wall dead load (5.0psf) on member(s).23-29, 22-27
- 12) Bottom chord live load (40.0 psf) and additional bottom chord dead load (5.0 psf) applied only to room. 22-23
- 13) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 18 except (jt=lb) 2=109, 15=304.
- 14) This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 15) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
- 16) Attic room checked for L/360 deflection.

LOAD CASE(S) Standard

Job 20-6466-A	Truss TG03	Truss Type ATTIC GIRDER	Qty 2	Ply 3	GARY ROBINSON-LOT 73 SOUTH CREEK WOODLAKE MODEL ROOF
------------------	---------------	----------------------------	----------	----------	--

Riverside Roof Truss, LLC, Danville, VA. 24541

Run: 8.330 s Feb 24 2020 Print: 8.330 s Feb 24 2020 MiTek Industries, Inc. Wed Dec 16 12:09:07 2020 Page 1
ID:riFrQwqzJQyesEOjBg_H7VyKEle-7DurrupVdWc0gNk2ZgVrp01QCWPnbdacMoo?Ty8PXa



Scale = 1:77.9

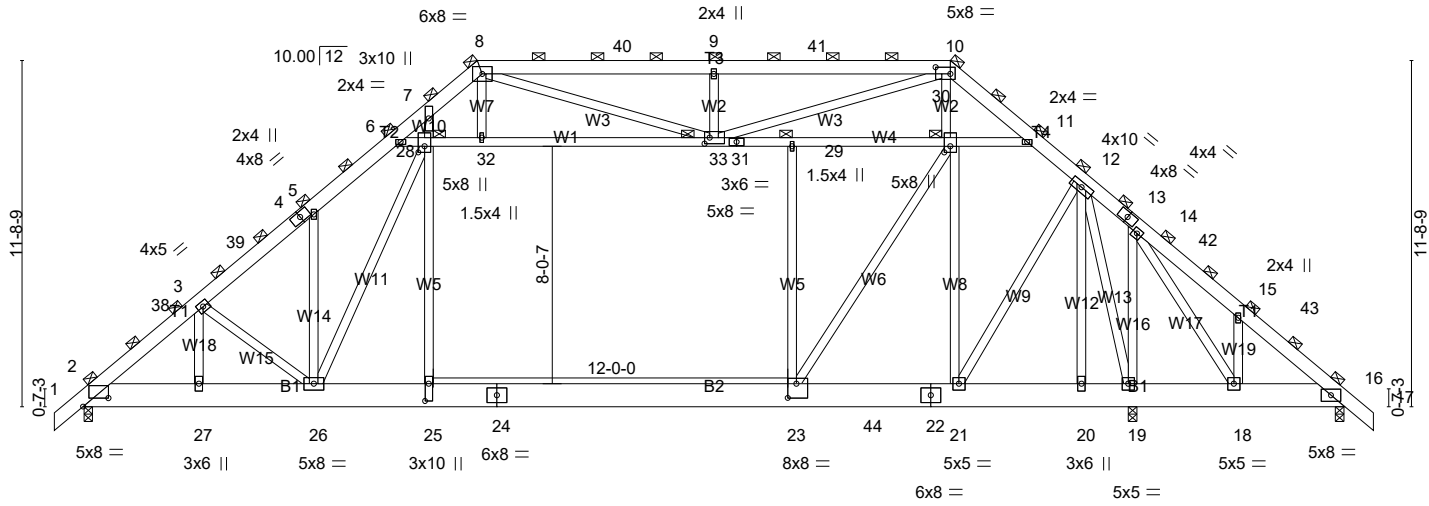


Plate Offsets (X,Y)--	[2:0-10-5,0-3-7], [10:0-6,0-2-12], [23:0-3-8,0-5-12], [25:0-7-0,0-1-8], [28:0-2-8,0-2-8], [30:0-2-8,0-2-8], [33:0-2-0,0-2-8]
-----------------------	--

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL (roof) 30.0	5-3-0	TC 0.78	in (loc) l/defl L/d	MT20	244/190
Snow (Pf/Pg) 23.1/30.0	Plate Grip DOL 1.15	BC 0.76	Vert(LL) -0.14 23-25 >999 360		
TCDL 10.0	Lumber DOL 1.15	WB 0.71	Vert(CT) -0.29 23-25 >999 240		
BCLL 0.0 *	Rep Stress Incr NO	Matrix-MS	Horz(CT) 0.05 16 n/a n/a		
BCDL 10.0	Code IRC2015/TPI2014		Attic -0.09 23-25 1694 360	Weight: 1484 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x6 SP No.2	TOP CHORD 2-0-0 oc purlins (6-0-0 max.)
BOT CHORD 2x10 SP DSS *Except* B2: 2x10 SP No.1	(Switched from sheeted: Spacing > 2-0-0).
WEBS 2x4 SP No.3 *Except* W5,W1,W4: 2x4 SP No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
	JOINTS 1 Brace at Jt(s): 8, 10, 28, 29, 30, 33

REACTIONS. (lb/size) 2=8182/0-3-8 (min. 0-3-2), 19=3173/0-3-8 (min. 0-1-8), 16=3405/0-3-8 (min. 0-1-8)
Max Horz 2=-779(LC 14)
Max Uplift 19=-1077(LC 17)
Max Grav 2=9211(LC 46), 19=4655(LC 58), 16=3996(LC 40)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-38=-12522/0, 3-38=-12164/0, 3-39=-11194/0, 4-39=-10734/0, 4-5=-10539/0,
5-6=-10715/0, 6-7=-7349/0, 7-8=-5666/42, 8-40=-7743/872, 9-40=-7743/872,
9-41=-7743/872, 10-41=-7743/872, 10-11=-4432/0, 11-12=-5773/0, 12-13=-5323/0,
13-14=-5358/0, 14-42=-4789/0, 15-42=-5206/0, 15-43=-4709/0, 16-43=-4972/0
BOT CHORD 2-27=0/9943, 26-27=0/9943, 25-26=0/7299, 24-25=0/7299, 23-24=0/7299, 23-44=0/4931,
22-44=0/4931, 21-22=0/4931, 20-21=0/3996, 19-20=0/3996, 18-19=0/3790, 16-18=0/3755
WEBS 3-27=0/1169, 3-26=-1869/0, 5-26=-715/595, 25-28=0/2571, 23-29=934/0, 23-30=0/4444,
21-30=-2905/0, 12-21=-69/2643, 12-20=-506/523, 6-28=-4936/0, 28-32=-3604/0,
32-33=-3582/0, 31-33=-4787/0, 29-31=-4787/0, 29-30=-4787/0, 11-30=-2685/0,
10-30=-266/1628, 8-32=0/920, 9-33=-2835/664, 8-33=-1407/2956, 10-33=-906/5043,
14-19=-1659/391, 15-18=-863/511, 12-19=-2242/733, 14-18=-654/227, 7-28=0/3685,
26-28=0/3902

- NOTES-**
- 3-ply truss to be connected together with 10d (0.131"x3") nails as follows:
Top chords connected as follows: 2x6 - 2 rows staggered at 0-9-0 oc.
Bottom chords connected as follows: 2x10 - 2 rows staggered at 0-9-0 oc.
Webs connected as follows: 2x4 - 1 row at 0-9-0 oc.
 - All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
 - Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCCL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; cantilever left and right exposed ; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - TCCL: ASCE 7-10; Pr=30.0 psf (roof live load: Lumber DOL=1.15 Plate DOL=1.15); Pg=30.0 psf (ground snow); Pf=23.1 psf (flat roof snow: Lumber DOL=1.15 Plate DOL=1.15); Category II; Exp B; Partially Exp.; Ct=1.10, Lu=50-0-0
 - Unbalanced snow loads have been considered for this design.
 - This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 23.1 psf on overhangs non-concurrent with other live loads.
 - Provide adequate drainage to prevent water ponding.

Continued on page 2

Job	Truss	Truss Type	Qty	Ply	GARY ROBINSON-LOT 73 SOUTH CREEK WOODLAKE MODEL ROOF
20-6466-A	TG03	ATTIC GIRDER	2	3	Job Reference (optional)

Riverside Roof Truss, LLC, Danville, VA. 24541

Run: 8.330 s Feb 24 2020 Print: 8.330 s Feb 24 2020 MiTek Industries, Inc. Wed Dec 16 12:09:07 2020 Page 2
ID:riFrQwqzJQyesEOjBg_H7VyKEle-7DurrUPVdWc0gNk2ZgjVrp01QCWPnbdacMoo?Ty8PXA

NOTES-

- 9) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 10) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- 11) Ceiling dead load (5.0 psf) on member(s). 6-28, 28-32, 32-33, 29-33, 29-30, 11-30; Wall dead load (5.0psf) on member(s).25-28, 23-29
- 12) Bottom chord live load (40.0 psf) and additional bottom chord dead load (5.0 psf) applied only to room. 23-25
- 13) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 19=1077.
- 14) This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 15) Load case(s) 1, 2, 3, 4, 5, 6, 7, 8, 9, 10, 11, 12, 13, 14, 15, 16, 17, 18, 19, 20, 21, 22, 23, 24, 25, 26, 27, 28, 29, 30, 31, 32, 33, 34, 35, 36, 37, 38, 39, 40, 41, 42, 43, 44, 45, 46, 47, 48, 49, 50, 51, 52, 53, 54, 55, 56, 57, 58, 59, 60, 61, 62, 63, 64, 65, 66, 67, 68, 69, 70, 71, 72, 73, 74, 75, 76, 77, 78, 79, 80, 81, 82, 83, 84, 85, 86, 87, 88 has/have been modified. Building designer must review loads to verify that they are correct for the intended use of this truss.
- 16) Attic room checked for L/360 deflection.

LOAD CASE(S) Standard

- 1) Dead + Snow (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (plf)
Vert: 8-10=-174, 10-17=-174, 6-11=-26, 2-25=-289(F=-237), 23-25=-79, 16-23=-53
Drag: 25-28=-26, 23-29=-26
Trapezoidal Loads (plf)
Vert: 1=-264-to-8=-174
- 2) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (plf)
Vert: 8-10=-210, 10-17=-210, 6-11=-26, 2-25=-289(F=-237), 23-25=-79, 16-23=-53
Drag: 25-28=-26, 23-29=-26
Trapezoidal Loads (plf)
Vert: 1=-300-to-8=-210
- 3) Dead + 0.75 Roof Live (balanced) + 0.75 Uninhab. Attic Storage + 0.75 Attic Floor: Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (plf)
Vert: 8-10=-171, 10-17=-171, 6-11=-26, 2-25=-289(F=-237), 23-25=-236, 23-44=-53, 21-44=-131, 16-21=-53
Drag: 25-28=-26, 23-29=-26
Trapezoidal Loads (plf)
Vert: 1=-261-to-8=-171
- 4) Dead + 0.75 Snow (balanced) + 0.75 Uninhab. Attic Storage + 0.75 Attic Floor: Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (plf)
Vert: 8-10=-143, 10-17=-143, 6-11=-26, 2-25=-289(F=-237), 23-25=-236, 23-44=-53, 21-44=-131, 16-21=-53
Drag: 25-28=-26, 23-29=-26
Trapezoidal Loads (plf)
Vert: 1=-233-to-8=-143
- 5) Dead + 0.75 Snow (Unbal. Left) + 0.75 Uninhab. Attic Storage + 0.75 Attic Floor: Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (plf)
Vert: 8-41=-143, 10-41=-195, 10-17=-80, 6-11=-26, 2-25=-289(F=-237), 23-25=-236, 23-44=-53, 21-44=-131, 16-21=-53
Drag: 25-28=-26, 23-29=-26
Trapezoidal Loads (plf)
Vert: 1=-233-to-8=-143
- 6) Dead + 0.75 Snow (Unbal. Right) + 0.75 Uninhab. Attic Storage + 0.75 Attic Floor: Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (plf)
Vert: 8-40=-195, 10-40=-143, 10-17=-143, 6-11=-26, 2-25=-289(F=-237), 23-25=-236, 23-44=-53, 21-44=-131, 16-21=-53
Drag: 25-28=-26, 23-29=-26
Trapezoidal Loads (plf)
Vert: 1=-170-to-8=-80
- 7) Dead + Uninhabitable Attic Without Storage: Lumber Increase=1.25, Plate Increase=1.25
Uniform Loads (plf)
Vert: 8-10=-53, 10-17=-52, 6-11=-26, 2-35=-342(F=-237), 25-35=-342(F=-237), 23-25=-79, 23-37=-105, 16-37=-105
Drag: 25-28=-26, 23-29=-26
Trapezoidal Loads (plf)
Vert: 1=-143-to-8=-53
- 8) Dead + 0.6 C-C Wind (Pos. Internal) Case 1: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 8-10=72, 10-16=64, 16-17=50, 6-11=-16, 2-25=-268(F=-237), 23-25=-47, 16-23=-32
Horz: 1-2=-146, 2-8=-96, 10-16=96, 16-17=81
Drag: 25-28=-26, 23-29=-26
Trapezoidal Loads (plf)
Vert: 1=25-to-2=31, 2=-20-to-8=64
- 9) Dead + 0.6 C-C Wind (Pos. Internal) Case 2: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 8-10=72, 10-16=64, 16-17=115, 6-11=-16, 2-25=-268(F=-237), 23-25=-47, 16-23=-32
Horz: 1-2=-81, 2-8=-96, 10-16=96, 16-17=146
Drag: 25-28=-26, 23-29=-26
Trapezoidal Loads (plf)
Vert: 1=40-to-2=-34, 2=-20-to-8=64
- 10) Dead + 0.6 C-C Wind (Neg. Internal) Case 1: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 8-10=-83, 10-16=-132, 16-17=-117, 6-11=-26, 2-25=-289(F=-237), 23-25=-79, 16-23=-53
Horz: 1-2=-65, 2-8=80, 10-16=-80, 16-17=-65
Drag: 25-28=-26, 23-29=-26
Trapezoidal Loads (plf)
Vert: 1=-78-to-2=-71, 2=-216-to-8=-132
- 11) Dead + 0.6 C-C Wind (Neg. Internal) Case 2: Lumber Increase=1.60, Plate Increase=1.60

Job	Truss	Truss Type	Qty	Ply	GARY ROBINSON-LOT 73 SOUTH CREEK WOODLAKE MODEL ROOF
20-6466-A	TG03	ATTIC GIRDER	2	3	Job Reference (optional)

Riverside Roof Truss, LLC, Danville, VA. 24541

Run: 8.330 s Feb 24 2020 Print: 8.330 s Feb 24 2020 MiTek Industries, Inc. Wed Dec 16 12:09:07 2020 Page 3
ID:riFrQwqzJQyesEOjBg_H7VyKEle-7DurrupVwC0gNk2ZgJVrp01QCWPnbdacMoo?Ty8PXA

LOAD CASE(S) Standard

Uniform Loads (plf)

Vert: 8-10=-83, 10-16=-132, 16-17=12, 6-11=-26, 2-25=-289(F=-237), 23-25=-79, 16-23=-53
 Horz: 1-2=65, 2-8=80, 10-16=-80, 16-17=65
 Drag: 25-28=-26, 23-29=-26

Trapezoidal Loads (plf)

Vert: 1=-207-to-2=-201, 2=-216-to-8=-132

12) Dead + 0.6 MWFRS Wind (Pos. Internal) Left: Lumber Increase=1.60, Plate Increase=1.60

Uniform Loads (plf)

Vert: 8-10=70, 10-16=26, 16-17=12, 6-11=-16, 2-25=-268(F=-237), 23-25=-47, 16-23=-32
 Horz: 1-2=-26, 2-8=7, 10-16=58, 16-17=43
 Drag: 25-28=-26, 23-29=-26

Trapezoidal Loads (plf)

Vert: 1=-95-to-2=-89, 2=-123-to-8=-39

13) Dead + 0.6 MWFRS Wind (Pos. Internal) Right: Lumber Increase=1.60, Plate Increase=1.60

Uniform Loads (plf)

Vert: 8-10=70, 10-16=-39, 16-17=-5, 6-11=-16, 2-25=-268(F=-237), 23-25=-47, 16-23=-32
 Horz: 1-2=-43, 2-8=-58, 10-16=-7, 16-17=26
 Drag: 25-28=-26, 23-29=-26

Trapezoidal Loads (plf)

Vert: 1=-78-to-2=-72, 2=-58-to-8=26

14) Dead + 0.6 MWFRS Wind (Neg. Internal) Left: Lumber Increase=1.60, Plate Increase=1.60

Uniform Loads (plf)

Vert: 8-10=20, 10-16=-24, 16-17=-9, 6-11=-26, 2-25=-289(F=-237), 23-25=-79, 16-23=-53
 Horz: 1-2=22, 2-8=37, 10-16=28, 16-17=43
 Drag: 25-28=-26, 23-29=-26

Trapezoidal Loads (plf)

Vert: 1=-164-to-2=-158, 2=-173-to-8=-89

15) Dead + 0.6 MWFRS Wind (Neg. Internal) Right: Lumber Increase=1.60, Plate Increase=1.60

Uniform Loads (plf)

Vert: 8-10=20, 10-16=-89, 16-17=-74, 6-11=-26, 2-25=-289(F=-237), 23-25=-79, 16-23=-53
 Horz: 1-2=-43, 2-8=-28, 10-16=-37, 16-17=-22
 Drag: 25-28=-26, 23-29=-26

Trapezoidal Loads (plf)

Vert: 1=-99-to-2=-93, 2=-108-to-8=-24

16) Dead + 0.6 MWFRS Wind (Pos. Internal) 1st Parallel: Lumber Increase=1.60, Plate Increase=1.60

Uniform Loads (plf)

Vert: 8-9=70, 9-10=26, 10-16=26, 16-17=12, 6-11=-16, 2-25=-268(F=-237), 23-25=-47, 16-23=-32
 Horz: 1-2=-87, 2-8=-101, 10-16=58, 16-17=43
 Drag: 25-28=-26, 23-29=-26

Trapezoidal Loads (plf)

Vert: 1=-35-to-2=-29, 2=-14-to-8=70

17) Dead + 0.6 MWFRS Wind (Pos. Internal) 2nd Parallel: Lumber Increase=1.60, Plate Increase=1.60

Uniform Loads (plf)

Vert: 8-9=26, 9-10=70, 10-16=70, 16-17=55, 6-11=-16, 2-25=-268(F=-237), 23-25=-47, 16-23=-32
 Horz: 1-2=-43, 2-8=-58, 10-16=101, 16-17=87
 Drag: 25-28=-26, 23-29=-26

Trapezoidal Loads (plf)

Vert: 1=-78-to-2=-72, 2=-58-to-8=26

18) Dead + 0.6 MWFRS Wind (Pos. Internal) 3rd Parallel: Lumber Increase=1.60, Plate Increase=1.60

Uniform Loads (plf)

Vert: 8-9=39, 9-10=13, 10-16=13, 16-17=-1, 6-11=-16, 2-25=-268(F=-237), 23-25=-47, 16-23=-32
 Horz: 1-2=-56, 2-8=-71, 10-16=45, 16-17=30
 Drag: 25-28=-26, 23-29=-26

Trapezoidal Loads (plf)

Vert: 1=-66-to-2=-59, 2=-45-to-8=39

19) Dead + 0.6 MWFRS Wind (Pos. Internal) 4th Parallel: Lumber Increase=1.60, Plate Increase=1.60

Uniform Loads (plf)

Vert: 8-9=13, 9-10=39, 10-16=39, 16-17=24, 6-11=-16, 2-25=-268(F=-237), 23-25=-47, 16-23=-32
 Horz: 1-2=-30, 2-8=-45, 10-16=71, 16-17=56
 Drag: 25-28=-26, 23-29=-26

Trapezoidal Loads (plf)

Vert: 1=-91-to-2=-85, 2=-71-to-8=13

20) Dead + 0.6 MWFRS Wind (Neg. Internal) 1st Parallel: Lumber Increase=1.60, Plate Increase=1.60

Uniform Loads (plf)

Vert: 8-9=20, 9-10=-24, 10-16=-24, 16-17=-9, 6-11=-26, 2-25=-289(F=-237), 23-25=-79, 16-23=-53
 Horz: 1-2=-87, 2-8=-72, 10-16=28, 16-17=43
 Drag: 25-28=-26, 23-29=-26

Trapezoidal Loads (plf)

Vert: 1=-56-to-2=-50, 2=-64-to-8=20

21) Dead + 0.6 MWFRS Wind (Neg. Internal) 2nd Parallel: Lumber Increase=1.60, Plate Increase=1.60

Uniform Loads (plf)

Vert: 8-9=-24, 9-10=20, 10-16=20, 16-17=34, 6-11=-26, 2-25=-289(F=-237), 23-25=-79, 16-23=-53
 Horz: 1-2=-43, 2-8=-28, 10-16=72, 16-17=87
 Drag: 25-28=-26, 23-29=-26

Trapezoidal Loads (plf)

Vert: 1=-99-to-2=-93, 2=-108-to-8=-24

22) Dead + Snow on Overhangs: Lumber Increase=1.15, Plate Increase=1.15

Job	Truss	Truss Type	Qty	Ply	GARY ROBINSON-LOT 73 SOUTH CREEK WOODLAKE MODEL ROOF
20-6466-A	TG03	ATTIC GIRDER	2	3	Job Reference (optional)

Riverside Roof Truss, LLC, Danville, VA. 24541

Run: 8.330 s Feb 24 2020 Print: 8.330 s Feb 24 2020 MiTek Industries, Inc. Wed Dec 16 12:09:07 2020 Page 4
ID:riFrQwqzJQyesEOjBg_H7VyKEle-7DurrUPVdWc0gNk2ZgVrp01QCWPnbdacMoo?Ty8PXA

LOAD CASE(S) Standard

Uniform Loads (plf)

Vert: 8-10=-53, 10-16=-52, 16-17=-174, 2-25=-289(F=-237), 23-25=-79, 16-23=-53

Trapezoidal Loads (plf)

Vert: 1=-264-to-2=-258, 2=-136-to-8=-53

23) Dead + Uninhab. Attic Storage + Attic Floor: Lumber Increase=1.00, Plate Increase=1.00

Uniform Loads (plf)

Vert: 8-10=-53, 10-17=-52, 6-11=-26, 2-25=-289(F=-237), 23-25=-289, 23-44=-53, 21-44=-158, 16-21=-53

Drag: 25-28=-26, 23-29=-26

Trapezoidal Loads (plf)

Vert: 1=-143-to-8=-53

24) Dead + Snow (Unbal. Left): Lumber Increase=1.15, Plate Increase=1.15

Uniform Loads (plf)

Vert: 8-41=-174, 10-41=-242, 10-17=-89, 6-11=-26, 2-25=-289(F=-237), 23-25=-79, 16-23=-53

Drag: 25-28=-26, 23-29=-26

Trapezoidal Loads (plf)

Vert: 1=-264-to-8=-174

25) Dead + Snow (Unbal. Right): Lumber Increase=1.15, Plate Increase=1.15

Uniform Loads (plf)

Vert: 8-40=-242, 10-40=-174, 10-17=-174, 6-11=-26, 2-25=-289(F=-237), 23-25=-79, 16-23=-53

Drag: 25-28=-26, 23-29=-26

Trapezoidal Loads (plf)

Vert: 1=-179-to-8=-89

26) Dead + Uninhabitable Attic Storage: Lumber Increase=1.00, Plate Increase=1.00

Uniform Loads (plf)

Vert: 8-10=-53, 10-17=-52, 6-11=-26, 2-25=-289(F=-237), 23-25=-289, 23-44=-53, 21-44=-158, 16-21=-53

Drag: 25-28=-26, 23-29=-26

Trapezoidal Loads (plf)

Vert: 1=-143-to-8=-53

27) Dead + 0.75 Snow (bal.) + 0.75 Uninhab. Attic Storage + 0.75 Attic Floor + 0.75(0.6 MWFRS Wind (Neg. Int) Left): Lumber Increase=1.60, Plate Increase=1.60

Uniform Loads (plf)

Vert: 8-10=-89, 10-16=-122, 16-17=-111, 6-11=-26, 2-25=-289(F=-237), 23-25=-236, 23-44=-53, 21-44=-131, 16-21=-53

Horz: 1-2=16, 2-8=27, 10-16=21, 16-17=32

Drag: 25-28=-26, 23-29=-26

Trapezoidal Loads (plf)

Vert: 1=-250-to-2=-244, 2=-255-to-8=-171

28) Dead + 0.75 Snow (bal.) + 0.75 Uninhab. Attic Storage + 0.75 Attic Floor + 0.75(0.6 MWFRS Wind (Neg. Int) Right): Lumber Increase=1.60, Plate Increase=1.60

Uniform Loads (plf)

Vert: 8-10=-89, 10-16=-171, 16-17=-160, 6-11=-26, 2-25=-289(F=-237), 23-25=-236, 23-44=-53, 21-44=-131, 16-21=-53

Horz: 1-2=-32, 2-8=-21, 10-16=-27, 16-17=-16

Drag: 25-28=-26, 23-29=-26

Trapezoidal Loads (plf)

Vert: 1=-201-to-2=-195, 2=-206-to-8=-122

29) Dead + 0.75 Snow (bal.) + 0.75 Uninhab. Attic Storage + 0.75 Attic Floor + 0.75(0.6 MWFRS Wind (Neg. Int) 1st Parallel): Lumber Increase=1.60, Plate Increase=1.60

Uniform Loads (plf)

Vert: 8-9=-89, 9-10=-122, 10-16=-122, 16-17=-111, 6-11=-26, 2-25=-289(F=-237), 23-25=-236, 23-44=-53, 21-44=-131, 16-21=-53

Horz: 1-2=-65, 2-8=-54, 10-16=21, 16-17=32

Drag: 25-28=-26, 23-29=-26

Trapezoidal Loads (plf)

Vert: 1=-168-to-2=-162, 2=-173-to-8=-89

30) Dead + 0.75 Snow (bal.) + 0.75 Uninhab. Attic Storage + 0.75 Attic Floor + 0.75(0.6 MWFRS Wind (Neg. Int) 2nd Parallel): Lumber Increase=1.60, Plate Increase=1.60

Uniform Loads (plf)

Vert: 8-9=-122, 9-10=-89, 10-16=-89, 16-17=-78, 6-11=-26, 2-25=-289(F=-237), 23-25=-236, 23-44=-53, 21-44=-131, 16-21=-53

Horz: 1-2=-32, 2-8=-21, 10-16=54, 16-17=65

Drag: 25-28=-26, 23-29=-26

Trapezoidal Loads (plf)

Vert: 1=-201-to-2=-195, 2=-206-to-8=-122

31) Dead + 0.75 Roof Live (bal.) + 0.75 Uninhab. Attic Storage + 0.75 Attic Floor + 0.75(0.6 MWFRS Wind (Neg. Int) Left): Lumber Increase=1.60, Plate Increase=1.60

Uniform Loads (plf)

Vert: 8-10=-116, 10-16=-149, 16-17=-138, 6-11=-26, 2-25=-289(F=-237), 23-25=-236, 23-44=-53, 21-44=-131, 16-21=-53

Horz: 1-2=16, 2-8=27, 10-16=21, 16-17=32

Drag: 25-28=-26, 23-29=-26

Trapezoidal Loads (plf)

Vert: 1=-277-to-2=-271, 2=-282-to-8=-198

32) Dead + 0.75 Roof Live (bal.) + 0.75 Uninhab. Attic Storage + 0.75 Attic Floor + 0.75(0.6 MWFRS Wind (Neg. Int) Right): Lumber Increase=1.60, Plate Increase=1.60

Uniform Loads (plf)

Vert: 8-10=-116, 10-16=-198, 16-17=-187, 6-11=-26, 2-25=-289(F=-237), 23-25=-236, 23-44=-53, 21-44=-131, 16-21=-53

Horz: 1-2=-32, 2-8=-21, 10-16=-27, 16-17=-16

Drag: 25-28=-26, 23-29=-26

Trapezoidal Loads (plf)

Vert: 1=-228-to-2=-222, 2=-233-to-8=-149

33) Dead + 0.75 Roof Live (bal.) + 0.75 Uninhab. Attic Storage + 0.75 Attic Floor + 0.75(0.6 MWFRS Wind (Neg. Int) 1st Parallel): Lumber Increase=1.60, Plate Increase=1.60

Uniform Loads (plf)

Vert: 8-10=-116, 10-16=-198, 16-17=-187, 6-11=-26, 2-25=-289(F=-237), 23-25=-236, 23-44=-53, 21-44=-131, 16-21=-53

Horz: 1-2=-32, 2-8=-21, 10-16=-27, 16-17=-16

Drag: 25-28=-26, 23-29=-26

Trapezoidal Loads (plf)

Vert: 1=-228-to-2=-222, 2=-233-to-8=-149

33) Dead + 0.75 Roof Live (bal.) + 0.75 Uninhab. Attic Storage + 0.75 Attic Floor + 0.75(0.6 MWFRS Wind (Neg. Int) 1st Parallel): Lumber Increase=1.60, Plate Increase=1.60

Job	Truss	Truss Type	Qty	Ply	GARY ROBINSON-LOT 73 SOUTH CREEK WOODLAKE MODEL ROOF
20-6466-A	TG03	ATTIC GIRDER	2	3	Job Reference (optional)

Riverside Roof Truss, LLC, Danville, VA. 24541

Run: 8.330 s Feb 24 2020 Print: 8.330 s Feb 24 2020 MiTek Industries, Inc. Wed Dec 16 12:09:07 2020 Page 5
ID:riFrQwqzJQyesEOjBg_H7VyKEle-7DurrPVVc0gNk2ZgVrp01QCWPnbdacMoo?Ty8PXA

LOAD CASE(S) Standard

Uniform Loads (plf)

Vert: 8-9=-116, 9-10=-149, 10-16=-149, 16-17=-138, 6-11=-26, 2-25=-289(F=-237), 23-25=-236, 23-44=-53, 21-44=-131, 16-21=-53
 Horz: 1-2=-65, 2-8=-54, 10-16=21, 16-17=32
 Drag: 25-28=-26, 23-29=-26

Trapezoidal Loads (plf)

Vert: 1=-195-to-2=-189, 2=-200-to-8=-116

34) Dead + 0.75 Roof Live (bal.) + 0.75 Uninhab. Attic Storage + 0.75 Attic Floor + 0.75(0.6 MWFRS Wind (Neg. Int) 2nd Parallel): Lumber Increase=1.60, Plate Increase=1.60

Uniform Loads (plf)

Vert: 8-9=-149, 9-10=-116, 10-16=-116, 16-17=-105, 6-11=-26, 2-25=-289(F=-237), 23-25=-236, 23-44=-53, 21-44=-131, 16-21=-53
 Horz: 1-2=-32, 2-8=-21, 10-16=54, 16-17=65
 Drag: 25-28=-26, 23-29=-26

Trapezoidal Loads (plf)

Vert: 1=-228-to-2=-222, 2=-233-to-8=-149

35) 3rd Dead + 0.75 Snow (Unbal. Left) + 0.75 Uninhab. Attic Storage + 0.75 Attic Floor: Lumber Increase=1.15, Plate Increase=1.15

Uniform Loads (plf)

Vert: 8-41=-143, 10-41=-195, 10-17=-80, 6-11=-26, 2-25=-289(F=-237), 23-25=-236, 23-44=-53, 21-44=-131, 16-21=-53
 Drag: 25-28=-26, 23-29=-26

Trapezoidal Loads (plf)

Vert: 1=-170-to-8=-80

36) 4th Dead + 0.75 Snow (Unbal. Left) + 0.75 Uninhab. Attic Storage + 0.75 Attic Floor: Lumber Increase=1.15, Plate Increase=1.15

Uniform Loads (plf)

Vert: 8-10=-80, 10-17=-80, 6-11=-26, 2-25=-289(F=-237), 23-25=-236, 23-44=-53, 21-44=-131, 16-21=-53
 Drag: 25-28=-26, 23-29=-26

Trapezoidal Loads (plf)

Vert: 1=-233-to-39=-192, 39=-277-to-8=-228

37) 5th Dead + 0.75 Snow (Unbal. Right) + 0.75 Uninhab. Attic Storage + 0.75 Attic Floor: Lumber Increase=1.15, Plate Increase=1.15

Uniform Loads (plf)

Vert: 8-40=-195, 10-40=-143, 10-17=-80, 6-11=-26, 2-25=-289(F=-237), 23-25=-236, 23-44=-53, 21-44=-131, 16-21=-53
 Drag: 25-28=-26, 23-29=-26

Trapezoidal Loads (plf)

Vert: 1=-170-to-8=-80

38) 6th Dead + 0.75 Snow (Unbal. Right) + 0.75 Uninhab. Attic Storage + 0.75 Attic Floor: Lumber Increase=1.15, Plate Increase=1.15

Uniform Loads (plf)

Vert: 8-10=-80, 10-42=-229, 17-42=-143, 6-11=-26, 2-25=-289(F=-237), 23-25=-236, 23-44=-53, 21-44=-131, 16-21=-53
 Drag: 25-28=-26, 23-29=-26

Trapezoidal Loads (plf)

Vert: 1=-170-to-8=-80

39) 7th Unbal. Dead + Snow (balanced) + Parallel: Lumber Increase=1.15, Plate Increase=1.15

Uniform Loads (plf)

Vert: 8-10=-324, 10-17=-89, 6-11=-26, 2-25=-289(F=-237), 23-25=-79, 16-23=-53
 Drag: 25-28=-26, 23-29=-26

Trapezoidal Loads (plf)

Vert: 1=-179-to-8=-89

40) 8th Unbal. Dead + Snow (balanced) + Parallel: Lumber Increase=1.15, Plate Increase=1.15

Uniform Loads (plf)

Vert: 8-10=-89, 10-43=-324, 17-43=-174, 6-11=-26, 2-25=-289(F=-237), 23-25=-79, 16-23=-53
 Drag: 25-28=-26, 23-29=-26

Trapezoidal Loads (plf)

Vert: 1=-264-to-38=-238, 38=-389-to-8=-324

41) 9th Unbal. Dead + Snow (Unbal. Left) + Parallel: Lumber Increase=1.15, Plate Increase=1.15

Uniform Loads (plf)

Vert: 8-41=-174, 10-41=-242, 10-17=-89, 6-11=-26, 2-25=-289(F=-237), 23-25=-79, 16-23=-53
 Drag: 25-28=-26, 23-29=-26

Trapezoidal Loads (plf)

Vert: 1=-179-to-8=-89

42) 10th Unbal. Dead + Snow (Unbal. Left) + Parallel: Lumber Increase=1.15, Plate Increase=1.15

Uniform Loads (plf)

Vert: 8-10=-89, 10-17=-89, 6-11=-26, 2-25=-289(F=-237), 23-25=-79, 16-23=-53
 Drag: 25-28=-26, 23-29=-26

Trapezoidal Loads (plf)

Vert: 1=-264-to-39=-222, 39=-335-to-8=-287

43) 11th Unbal. Dead + Snow (Unbal. Right) + Parallel: Lumber Increase=1.15, Plate Increase=1.15

Uniform Loads (plf)

Vert: 8-40=-242, 10-40=-174, 10-17=-89, 6-11=-26, 2-25=-289(F=-237), 23-25=-79, 16-23=-53
 Drag: 25-28=-26, 23-29=-26

Trapezoidal Loads (plf)

Vert: 1=-179-to-8=-89

44) 12th Unbal. Dead + Snow (Unbal. Right) + Parallel: Lumber Increase=1.15, Plate Increase=1.15

Uniform Loads (plf)

Vert: 8-10=-89, 10-42=-287, 17-42=-174, 6-11=-26, 2-25=-289(F=-237), 23-25=-79, 16-23=-53
 Drag: 25-28=-26, 23-29=-26

Trapezoidal Loads (plf)

Vert: 1=-179-to-8=-89

45) 13th Unbal. Dead + 0.75 Snow (balanced) + 0.75 Uninhab. Attic Storage + 0.75 Attic Floor + Parallel: Lumber Increase=1.15, Plate Increase=1.15

Job	Truss	Truss Type	Qty	Ply	GARY ROBINSON-LOT 73 SOUTH CREEK WOODLAKE MODEL ROOF
20-6466-A	TG03	ATTIC GIRDER	2	3	Job Reference (optional)

Riverside Roof Truss, LLC, Danville, VA. 24541

Run: 8.330 s Feb 24 2020 Print: 8.330 s Feb 24 2020 MiTek Industries, Inc. Wed Dec 16 12:09:07 2020 Page 6
ID:riFrQwqzJQyesEOjBg_H7VyKEle-7DurrupVdWc0gNk2ZgVrp01QCWPnbdacMoo?Ty8PXa

LOAD CASE(S) Standard

Uniform Loads (plf)

Vert: 8-10=-256, 10-17=-80, 6-11=-26, 2-25=-289(F=-237), 23-25=-236, 23-44=-53, 21-44=-131, 16-21=-53

Drag: 25-28=-26, 23-29=-26

Trapezoidal Loads (plf)

Vert: 1=-170-to-8=-80

46) 14th Unbal.Death + 0.75 Snow (balanced) + 0.75 Uninhab. Attic Storage + 0.75 Attic Floor + Parallel: Lumber Increase=1.15, Plate Increase=1.15

Uniform Loads (plf)

Vert: 8-10=-80, 10-43=-256, 17-43=-143, 6-11=-26, 2-25=-289(F=-237), 23-25=-236, 23-44=-53, 21-44=-131, 16-21=-53

Drag: 25-28=-26, 23-29=-26

Trapezoidal Loads (plf)

Vert: 1=-233-to-38=-208, 38=-321-to-8=-256

47) 15th Unbal.Death + 0.75 Snow (unbal.) + 0.75 Uninhab. Attic Storage + 0.75 Attic Floor + 0.75(0.6 MWFRS Wind (Neg. Int) Left) + Parallel: Lumber Increase=1.60, Plate Increase=1.60

Uniform Loads (plf)

Vert: 8-10=-202, 10-16=-58, 16-17=-48, 6-11=-26, 2-25=-289(F=-237), 23-25=-236, 23-44=-53, 21-44=-131, 16-21=-53

Horz: 1-2=16, 2-8=27, 10-16=21, 16-17=32

Drag: 25-28=-26, 23-29=-26

Trapezoidal Loads (plf)

Vert: 1=-186-to-2=-180, 2=-191-to-8=-107

48) 16th Unbal.Death + 0.75 Snow (unbal.) + 0.75 Uninhab. Attic Storage + 0.75 Attic Floor + 0.75(0.6 MWFRS Wind (Neg. Int) Left) + Parallel: Lumber Increase=1.60, Plate Increase=1.60

Uniform Loads (plf)

Vert: 8-10=-26, 10-43=-235, 16-43=-122, 16-17=-111, 6-11=-26, 2-25=-289(F=-237), 23-25=-236, 23-44=-53, 21-44=-131, 16-21=-53

Horz: 1-2=16, 2-8=27, 10-16=21, 16-17=32

Drag: 25-28=-26, 23-29=-26

Trapezoidal Loads (plf)

Vert: 1=-250-to-2=-244, 2=-255-to-38=-235, 38=-348-to-8=-284

49) 17th Unbal.Death + 0.75 Snow (unbal.) + 0.75 Uninhab. Attic Storage + 0.75 Attic Floor + 0.75(0.6 MWFRS Wind (Neg. Int) Right) + Parallel: Lumber Increase=1.60, Plate Increase=1.60

Uniform Loads (plf)

Vert: 8-10=-202, 10-16=-107, 16-17=-96, 6-11=-26, 2-25=-289(F=-237), 23-25=-236, 23-44=-53, 21-44=-131, 16-21=-53

Horz: 1-2=-32, 2-8=-21, 10-16=-27, 16-17=-16

Drag: 25-28=-26, 23-29=-26

Trapezoidal Loads (plf)

Vert: 1=-138-to-2=-131, 2=-142-to-8=-58

50) 18th Unbal.Death + 0.75 Snow (unbal.) + 0.75 Uninhab. Attic Storage + 0.75 Attic Floor + 0.75(0.6 MWFRS Wind (Neg. Int) Right) + Parallel: Lumber Increase=1.60, Plate Increase=1.60

Uniform Loads (plf)

Vert: 8-10=-26, 10-43=-284, 16-43=-171, 16-17=-160, 6-11=-26, 2-25=-289(F=-237), 23-25=-236, 23-44=-53, 21-44=-131, 16-21=-53

Horz: 1-2=-32, 2-8=-21, 10-16=-27, 16-17=-16

Drag: 25-28=-26, 23-29=-26

Trapezoidal Loads (plf)

Vert: 1=-201-to-2=-195, 2=-206-to-38=-186, 38=-299-to-8=-235

51) 19th Unbal.Death + 0.75 Snow (unbal.) + 0.75 Uninhab. Attic Storage + 0.75 Attic Floor + 0.75(0.6 MWFRS Wind (Neg. Int) 1st Parallel): Lumber Increase=1.60, Plate Increase=1.60

Uniform Loads (plf)

Vert: 8-9=-202, 9-10=-235, 10-16=-58, 16-17=-48, 6-11=-26, 2-25=-289(F=-237), 23-25=-236, 23-44=-53, 21-44=-131, 16-21=-53

Horz: 1-2=-65, 2-8=-54, 10-16=21, 16-17=32

Drag: 25-28=-26, 23-29=-26

Trapezoidal Loads (plf)

Vert: 1=-105-to-2=-99, 2=-110-to-8=-26

52) 20th Unbal.Death + 0.75 Snow (unbal.) + 0.75 Uninhab. Attic Storage + 0.75 Attic Floor + 0.75(0.6 MWFRS Wind (Neg. Int) 1st Parallel): Lumber Increase=1.60, Plate Increase=1.60

Uniform Loads (plf)

Vert: 8-9=-26, 9-10=-58, 10-43=-235, 16-43=-122, 16-17=-111, 6-11=-26, 2-25=-289(F=-237), 23-25=-236, 23-44=-53, 21-44=-131, 16-21=-53

Horz: 1-2=-65, 2-8=-54, 10-16=21, 16-17=32

Drag: 25-28=-26, 23-29=-26

Trapezoidal Loads (plf)

Vert: 1=-168-to-2=-162, 2=-173-to-38=-153, 38=-266-to-8=-202

53) 21st Unbal.Death + 0.75 Snow (unbal.) + 0.75 Uninhab. Attic Storage + 0.75 Attic Floor + 0.75(0.6 MWFRS Wind (Neg. Int) 2nd Parallel): Lumber Increase=1.60, Plate Increase=1.60

Uniform Loads (plf)

Vert: 8-9=-235, 9-10=-202, 10-16=-26, 16-17=-15, 6-11=-26, 2-25=-289(F=-237), 23-25=-236, 23-44=-53, 21-44=-131, 16-21=-53

Horz: 1-2=-32, 2-8=-21, 10-16=54, 16-17=65

Drag: 25-28=-26, 23-29=-26

Trapezoidal Loads (plf)

Vert: 1=-138-to-2=-131, 2=-142-to-8=-58

54) 22nd Unbal.Death + 0.75 Snow (unbal.) + 0.75 Uninhab. Attic Storage + 0.75 Attic Floor + 0.75(0.6 MWFRS Wind (Neg. Int) 2nd Parallel): Lumber Increase=1.60, Plate Increase=1.60

Job	Truss	Truss Type	Qty	Ply	GARY ROBINSON-LOT 73 SOUTH CREEK WOODLAKE MODEL ROOF
20-6466-A	TG03	ATTIC GIRDER	2	3	Job Reference (optional)

Riverside Roof Truss, LLC, Danville, VA. 24541

Run: 8.330 s Feb 24 2020 Print: 8.330 s Feb 24 2020 MiTek Industries, Inc. Wed Dec 16 12:09:07 2020 Page 7
ID:riFrQwqzJQyesEOjBg_H7VyKEle-7DurrupVdWc0gNk2ZgVrp01QCWPnbdacMoo?Ty8PXA

LOAD CASE(S) Standard

Uniform Loads (plf)

Vert: 8-9=-58, 9-10=-26, 10-43=-202, 16-43=-89, 16-17=-78, 6-11=-26, 2-25=-289(F=-237), 23-25=-236, 23-44=-53, 21-44=-131, 16-21=-53
 Horz: 1-2=-32, 2-8=-21, 10-16=54, 16-17=65
 Drag: 25-28=-26, 23-29=-26

Trapezoidal Loads (plf)

Vert: 1=-201-to-2=-195, 2=-206-to-38=-186, 38=-299-to-8=-235

55) 1st Dead + Roof Live (unbalanced): Lumber Increase=1.15, Plate Increase=1.15

Uniform Loads (plf)

Vert: 8-10=-210, 10-17=-52, 6-11=-26, 2-25=-289(F=-237), 23-25=-79, 16-23=-53
 Drag: 25-28=-26, 23-29=-26

Trapezoidal Loads (plf)

Vert: 1=-300-to-8=-210

56) 2nd Dead + Roof Live (unbalanced): Lumber Increase=1.15, Plate Increase=1.15

Uniform Loads (plf)

Vert: 8-10=-210, 10-17=-210, 6-11=-26, 2-25=-289(F=-237), 23-25=-79, 16-23=-53
 Drag: 25-28=-26, 23-29=-26

Trapezoidal Loads (plf)

Vert: 1=-143-to-8=-53

57) 3rd Dead + 0.75 Roof Live (unbalanced) + 0.75 Uninhab. Attic Storage + 0.75 Attic Floor: Lumber Increase=1.15, Plate Increase=1.15

Uniform Loads (plf)

Vert: 8-10=-171, 10-17=-52, 6-11=-26, 2-25=-289(F=-237), 23-25=-236, 23-44=-53, 21-44=-131, 16-21=-53
 Drag: 25-28=-26, 23-29=-26

Trapezoidal Loads (plf)

Vert: 1=-261-to-8=-171

58) 4th Dead + 0.75 Roof Live (unbalanced) + 0.75 Uninhab. Attic Storage + 0.75 Attic Floor: Lumber Increase=1.15, Plate Increase=1.15

Uniform Loads (plf)

Vert: 8-10=-171, 10-17=-171, 6-11=-26, 2-25=-289(F=-237), 23-25=-236, 23-44=-53, 21-44=-131, 16-21=-53
 Drag: 25-28=-26, 23-29=-26

Trapezoidal Loads (plf)

Vert: 1=-143-to-8=-53

59) Reversal: Dead + 0.6 C-C Wind (Pos. Internal) Case 1: Lumber Increase=1.60, Plate Increase=1.60

Uniform Loads (plf)

Vert: 8-10=72, 10-16=64, 16-17=50, 6-11=-16, 2-25=-268(F=-237), 23-25=-47, 16-23=-32
 Horz: 1-2=-146, 2-8=-96, 10-16=96, 16-17=81
 Drag: 25-28=-26, 23-29=-26

Trapezoidal Loads (plf)

Vert: 1=25-to-2=31, 2=-20-to-8=64

60) Reversal: Dead + 0.6 C-C Wind (Pos. Internal) Case 2: Lumber Increase=1.60, Plate Increase=1.60

Uniform Loads (plf)

Vert: 8-10=72, 10-16=64, 16-17=115, 6-11=-16, 2-25=-268(F=-237), 23-25=-47, 16-23=-32
 Horz: 1-2=-81, 2-8=-96, 10-16=96, 16-17=146
 Drag: 25-28=-26, 23-29=-26

Trapezoidal Loads (plf)

Vert: 1=-40-to-2=-34, 2=-20-to-8=64

61) Reversal: Dead + 0.6 C-C Wind (Neg. Internal) Case 1: Lumber Increase=1.60, Plate Increase=1.60

Uniform Loads (plf)

Vert: 8-10=-83, 10-16=-132, 16-17=-117, 6-11=-26, 2-25=-289(F=-237), 23-25=-79, 16-23=-53
 Horz: 1-2=-65, 2-8=80, 10-16=-80, 16-17=-65
 Drag: 25-28=-26, 23-29=-26

Trapezoidal Loads (plf)

Vert: 1=-78-to-2=-71, 2=-216-to-8=-132

62) Reversal: Dead + 0.6 C-C Wind (Neg. Internal) Case 2: Lumber Increase=1.60, Plate Increase=1.60

Uniform Loads (plf)

Vert: 8-10=-83, 10-16=-132, 16-17=12, 6-11=-26, 2-25=-289(F=-237), 23-25=-79, 16-23=-53
 Horz: 1-2=65, 2-8=80, 10-16=-80, 16-17=65
 Drag: 25-28=-26, 23-29=-26

Trapezoidal Loads (plf)

Vert: 1=-207-to-2=-201, 2=-216-to-8=-132

63) Reversal: Dead + 0.6 MWFRS Wind (Pos. Internal) Left: Lumber Increase=1.60, Plate Increase=1.60

Uniform Loads (plf)

Vert: 8-10=70, 10-16=26, 16-17=12, 6-11=-16, 2-25=-268(F=-237), 23-25=-47, 16-23=-32
 Horz: 1-2=-26, 2-8=7, 10-16=58, 16-17=43
 Drag: 25-28=-26, 23-29=-26

Trapezoidal Loads (plf)

Vert: 1=-95-to-2=-89, 2=-123-to-8=-39

64) Reversal: Dead + 0.6 MWFRS Wind (Pos. Internal) Right: Lumber Increase=1.60, Plate Increase=1.60

Uniform Loads (plf)

Vert: 8-10=70, 10-16=-39, 16-17=-5, 6-11=-16, 2-25=-268(F=-237), 23-25=-47, 16-23=-32
 Horz: 1-2=43, 2-8=-58, 10-16=-7, 16-17=26
 Drag: 25-28=-26, 23-29=-26

Trapezoidal Loads (plf)

Vert: 1=-78-to-2=-72, 2=-58-to-8=26

65) Reversal: Dead + 0.6 MWFRS Wind (Neg. Internal) Left: Lumber Increase=1.60, Plate Increase=1.60

Job	Truss	Truss Type	Qty	Ply	GARY ROBINSON-LOT 73 SOUTH CREEK WOODLAKE MODEL ROOF
20-6466-A	TG03	ATTIC GIRDER	2	3	Job Reference (optional)

Riverside Roof Truss, LLC, Danville, VA. 24541

Run: 8.330 s Feb 24 2020 Print: 8.330 s Feb 24 2020 MiTek Industries, Inc. Wed Dec 16 12:09:07 2020 Page 8
ID:riFrQwqzJQyesEOjBg_H7VyKEle-7DurruPVdWc0gNk2ZgjVrp01QCWPnbdacMoo?Ty8PXA

LOAD CASE(S) Standard

Uniform Loads (plf)

Vert: 8-10=20, 10-16=-24, 16-17=-9, 6-11=-26, 2-25=-289(F=-237), 23-25=-79, 16-23=-53
Horz: 1-2=22, 2-8=37, 10-16=28, 16-17=43
Drag: 25-28=-26, 23-29=-26

Trapezoidal Loads (plf)

Vert: 1=-164-to-2=-158, 2=-173-to-8=-89

66) Reversal: Dead + 0.6 MWFRS Wind (Neg. Internal) Right: Lumber Increase=1.60, Plate Increase=1.60

Uniform Loads (plf)

Vert: 8-10=20, 10-16=-89, 16-17=-74, 6-11=-26, 2-25=-289(F=-237), 23-25=-79, 16-23=-53
Horz: 1-2=-43, 2-8=-28, 10-16=-37, 16-17=-22
Drag: 25-28=-26, 23-29=-26

Trapezoidal Loads (plf)

Vert: 1=-99-to-2=-93, 2=-108-to-8=-24

67) Reversal: Dead + 0.6 MWFRS Wind (Pos. Internal) 1st Parallel: Lumber Increase=1.60, Plate Increase=1.60

Uniform Loads (plf)

Vert: 8-9=70, 9-10=26, 10-16=26, 16-17=12, 6-11=-16, 2-25=-268(F=-237), 23-25=-47, 16-23=-32
Horz: 1-2=-87, 2-8=-101, 10-16=58, 16-17=43
Drag: 25-28=-26, 23-29=-26

Trapezoidal Loads (plf)

Vert: 1=-35-to-2=-29, 2=-14-to-8=70

68) Reversal: Dead + 0.6 MWFRS Wind (Pos. Internal) 2nd Parallel: Lumber Increase=1.60, Plate Increase=1.60

Uniform Loads (plf)

Vert: 8-9=26, 9-10=70, 10-16=70, 16-17=55, 6-11=-16, 2-25=-268(F=-237), 23-25=-47, 16-23=-32
Horz: 1-2=-43, 2-8=-58, 10-16=101, 16-17=87
Drag: 25-28=-26, 23-29=-26

Trapezoidal Loads (plf)

Vert: 1=-78-to-2=-72, 2=-58-to-8=26

69) Reversal: Dead + 0.6 MWFRS Wind (Pos. Internal) 3rd Parallel: Lumber Increase=1.60, Plate Increase=1.60

Uniform Loads (plf)

Vert: 8-9=39, 9-10=13, 10-16=13, 16-17=-1, 6-11=-16, 2-25=-268(F=-237), 23-25=-47, 16-23=-32
Horz: 1-2=-56, 2-8=-71, 10-16=45, 16-17=30
Drag: 25-28=-26, 23-29=-26

Trapezoidal Loads (plf)

Vert: 1=-66-to-2=-59, 2=-45-to-8=39

70) Reversal: Dead + 0.6 MWFRS Wind (Pos. Internal) 4th Parallel: Lumber Increase=1.60, Plate Increase=1.60

Uniform Loads (plf)

Vert: 8-9=13, 9-10=39, 10-16=39, 16-17=24, 6-11=-16, 2-25=-268(F=-237), 23-25=-47, 16-23=-32
Horz: 1-2=-30, 2-8=-45, 10-16=71, 16-17=56
Drag: 25-28=-26, 23-29=-26

Trapezoidal Loads (plf)

Vert: 1=-91-to-2=-85, 2=-71-to-8=13

71) Reversal: Dead + 0.6 MWFRS Wind (Neg. Internal) 1st Parallel: Lumber Increase=1.60, Plate Increase=1.60

Uniform Loads (plf)

Vert: 8-9=20, 9-10=-24, 10-16=-24, 16-17=-9, 6-11=-26, 2-25=-289(F=-237), 23-25=-79, 16-23=-53
Horz: 1-2=-87, 2-8=-72, 10-16=28, 16-17=43
Drag: 25-28=-26, 23-29=-26

Trapezoidal Loads (plf)

Vert: 1=-56-to-2=-50, 2=-64-to-8=20

72) Reversal: Dead + 0.6 MWFRS Wind (Neg. Internal) 2nd Parallel: Lumber Increase=1.60, Plate Increase=1.60

Uniform Loads (plf)

Vert: 8-9=-24, 9-10=20, 10-16=20, 16-17=34, 6-11=-26, 2-25=-289(F=-237), 23-25=-79, 16-23=-53
Horz: 1-2=-43, 2-8=-28, 10-16=72, 16-17=87
Drag: 25-28=-26, 23-29=-26

Trapezoidal Loads (plf)

Vert: 1=-99-to-2=-93, 2=-108-to-8=-24

73) Reversal: Dead + 0.75 Snow (bal.) + 0.75 Uninhab. Attic Storage + 0.75 Attic Floor + 0.75(0.6 MWFRS Wind (Neg. Int) Left): Lumber Increase=1.60, Plate Increase=1.60

Uniform Loads (plf)

Vert: 8-10=-89, 10-16=-122, 16-17=-111, 6-11=-26, 2-25=-289(F=-237), 23-25=-236, 23-44=-53, 21-44=-131, 16-21=-53
Horz: 1-2=16, 2-8=27, 10-16=21, 16-17=32
Drag: 25-28=-26, 23-29=-26

Trapezoidal Loads (plf)

Vert: 1=-250-to-2=-244, 2=-255-to-8=-171

74) Reversal: Dead + 0.75 Snow (bal.) + 0.75 Uninhab. Attic Storage + 0.75 Attic Floor + 0.75(0.6 MWFRS Wind (Neg. Int) Right): Lumber Increase=1.60, Plate Increase=1.60

Uniform Loads (plf)

Vert: 8-10=-89, 10-16=-171, 16-17=-160, 6-11=-26, 2-25=-289(F=-237), 23-25=-236, 23-44=-53, 21-44=-131, 16-21=-53
Horz: 1-2=-32, 2-8=-21, 10-16=-27, 16-17=-16
Drag: 25-28=-26, 23-29=-26

Trapezoidal Loads (plf)

Vert: 1=-201-to-2=-195, 2=-206-to-8=-122

75) Reversal: Dead + 0.75 Snow (bal.) + 0.75 Uninhab. Attic Storage + 0.75 Attic Floor + 0.75(0.6 MWFRS Wind (Neg. Int) 1st Parallel): Lumber Increase=1.60, Plate Increase=1.60

Job	Truss	Truss Type	Qty	Ply	GARY ROBINSON-LOT 73 SOUTH CREEK WOODLAKE MODEL ROOF
20-6466-A	TG03	ATTIC GIRDER	2	3	Job Reference (optional)

Riverside Roof Truss, LLC, Danville, VA. 24541

Run: 8.330 s Feb 24 2020 Print: 8.330 s Feb 24 2020 MiTek Industries, Inc. Wed Dec 16 12:09:07 2020 Page 9
ID:riFrQwqzJQyesEOjBg_H7VyKEle-7DurruPVdWc0gNk2ZgVrp01QCWPNbdacMoo?Ty8PXA

LOAD CASE(S) Standard

Uniform Loads (plf)

Vert: 8-9=-89, 9-10=-122, 10-16=-122, 16-17=-111, 6-11=-26, 2-25=-289(F=-237), 23-25=-236, 23-44=-53, 21-44=-131, 16-21=-53
Horz: 1-2=-65, 2-8=-54, 10-16=21, 16-17=32
Drag: 25-28=-26, 23-29=-26

Trapezoidal Loads (plf)

Vert: 1=-168-to-2=-162, 2=-173-to-8=-89

76) Reversal: Dead + 0.75 Snow (bal.) + 0.75 Uninhab. Attic Storage + 0.75 Attic Floor + 0.75(0.6 MWFRS Wind (Neg. Int) 2nd Parallel): Lumber Increase=1.60, Plate Increase=1.60

Uniform Loads (plf)

Vert: 8-9=-122, 9-10=-89, 10-16=-89, 16-17=-78, 6-11=-26, 2-25=-289(F=-237), 23-25=-236, 23-44=-53, 21-44=-131, 16-21=-53
Horz: 1-2=-32, 2-8=-21, 10-16=54, 16-17=65
Drag: 25-28=-26, 23-29=-26

Trapezoidal Loads (plf)

Vert: 1=-201-to-2=-195, 2=-206-to-8=-122

77) Reversal: Dead + 0.75 Roof Live (bal.) + 0.75 Uninhab. Attic Storage + 0.75 Attic Floor + 0.75(0.6 MWFRS Wind (Neg. Int) Left): Lumber Increase=1.60, Plate Increase=1.60

Uniform Loads (plf)

Vert: 8-10=-116, 10-16=-149, 16-17=-138, 6-11=-26, 2-25=-289(F=-237), 23-25=-236, 23-44=-53, 21-44=-131, 16-21=-53
Horz: 1-2=16, 2-8=27, 10-16=21, 16-17=32
Drag: 25-28=-26, 23-29=-26

Trapezoidal Loads (plf)

Vert: 1=-277-to-2=-271, 2=-282-to-8=-198

78) Reversal: Dead + 0.75 Roof Live (bal.) + 0.75 Uninhab. Attic Storage + 0.75 Attic Floor + 0.75(0.6 MWFRS Wind (Neg. Int) Right): Lumber Increase=1.60, Plate Increase=1.60

Uniform Loads (plf)

Vert: 8-10=-116, 10-16=-198, 16-17=-187, 6-11=-26, 2-25=-289(F=-237), 23-25=-236, 23-44=-53, 21-44=-131, 16-21=-53
Horz: 1-2=-32, 2-8=-21, 10-16=-27, 16-17=-16
Drag: 25-28=-26, 23-29=-26

Trapezoidal Loads (plf)

Vert: 1=-228-to-2=-222, 2=-233-to-8=-149

79) Reversal: Dead + 0.75 Roof Live (bal.) + 0.75 Uninhab. Attic Storage + 0.75 Attic Floor + 0.75(0.6 MWFRS Wind (Neg. Int) 1st Parallel): Lumber Increase=1.60, Plate Increase=1.60

Uniform Loads (plf)

Vert: 8-9=-116, 9-10=-149, 10-16=-149, 16-17=-138, 6-11=-26, 2-25=-289(F=-237), 23-25=-236, 23-44=-53, 21-44=-131, 16-21=-53
Horz: 1-2=-65, 2-8=-54, 10-16=21, 16-17=32
Drag: 25-28=-26, 23-29=-26

Trapezoidal Loads (plf)

Vert: 1=-195-to-2=-189, 2=-200-to-8=-116

80) Reversal: Dead + 0.75 Roof Live (bal.) + 0.75 Uninhab. Attic Storage + 0.75 Attic Floor + 0.75(0.6 MWFRS Wind (Neg. Int) 2nd Parallel): Lumber Increase=1.60, Plate Increase=1.60

Uniform Loads (plf)

Vert: 8-9=-149, 9-10=-116, 10-16=-116, 16-17=-105, 6-11=-26, 2-25=-289(F=-237), 23-25=-236, 23-44=-53, 21-44=-131, 16-21=-53
Horz: 1-2=-32, 2-8=-21, 10-16=54, 16-17=65
Drag: 25-28=-26, 23-29=-26

Trapezoidal Loads (plf)

Vert: 1=-228-to-2=-222, 2=-233-to-8=-149

81) Reversal: 15th Unbal.Death + 0.75 Snow (unbal.) + 0.75 Uninhab. Attic Storage + 0.75 Attic Floor + 0.75(0.6 MWFRS Wind (Neg. Int) Left) + Parallel: Lumber Increase=1.60, Plate Increase=1.60

Uniform Loads (plf)

Vert: 8-10=-202, 10-16=-58, 16-17=-48, 6-11=-26, 2-25=-289(F=-237), 23-25=-236, 23-44=-53, 21-44=-131, 16-21=-53
Horz: 1-2=16, 2-8=27, 10-16=21, 16-17=32
Drag: 25-28=-26, 23-29=-26

Trapezoidal Loads (plf)

Vert: 1=-186-to-2=-180, 2=-191-to-8=-107

82) Reversal: 16th Unbal.Death + 0.75 Snow (unbal.) + 0.75 Uninhab. Attic Storage + 0.75 Attic Floor + 0.75(0.6 MWFRS Wind (Neg. Int) Left) + Parallel: Lumber Increase=1.60, Plate Increase=1.60

Uniform Loads (plf)

Vert: 8-10=-26, 10-43=-235, 16-43=-122, 16-17=-111, 6-11=-26, 2-25=-289(F=-237), 23-25=-236, 23-44=-53, 21-44=-131, 16-21=-53
Horz: 1-2=16, 2-8=27, 10-16=21, 16-17=32
Drag: 25-28=-26, 23-29=-26

Trapezoidal Loads (plf)

Vert: 1=-250-to-2=-244, 2=-255-to-38=-235, 38=-348-to-8=-284

83) Reversal: 17th Unbal.Death + 0.75 Snow (unbal.) + 0.75 Uninhab. Attic Storage + 0.75 Attic Floor + 0.75(0.6 MWFRS Wind (Neg. Int) Right) + Parallel: Lumber Increase=1.60, Plate Increase=1.60

Uniform Loads (plf)

Vert: 8-10=-202, 10-16=-107, 16-17=-96, 6-11=-26, 2-25=-289(F=-237), 23-25=-236, 23-44=-53, 21-44=-131, 16-21=-53
Horz: 1-2=-32, 2-8=-21, 10-16=-27, 16-17=-16
Drag: 25-28=-26, 23-29=-26

Trapezoidal Loads (plf)

Vert: 1=-138-to-2=-131, 2=-142-to-8=-58

84) Reversal: 18th Unbal.Death + 0.75 Snow (unbal.) + 0.75 Uninhab. Attic Storage + 0.75 Attic Floor + 0.75(0.6 MWFRS Wind (Neg. Int) Right) + Parallel: Lumber Increase=1.60, Plate Increase=1.60

Job	Truss	Truss Type	Qty	Ply	GARY ROBINSON-LOT 73 SOUTH CREEK WOODLAKE MODEL ROOF
20-6466-A	TG03	ATTIC GIRDER	2	3	Job Reference (optional)

Riverside Roof Truss, LLC, Danville, VA. 24541

Run: 8.330 s Feb 24 2020 Print: 8.330 s Feb 24 2020 MiTek Industries, Inc. Wed Dec 16 12:09:07 2020 Page 10
ID:riFrQwqzJQyesEOjBg_H7VyKEle-7DurrPVdWc0gNk2ZgjVrp01QCWPnbdacMoo?Ty8PXA

LOAD CASE(S) Standard

Uniform Loads (plf)

Vert: 8-10=-26, 10-43=-284, 16-43=-171, 16-17=-160, 6-11=-26, 2-25=-289(F=-237), 23-25=-236, 23-44=-53, 21-44=-131, 16-21=-53
 Horz: 1-2=-32, 2-8=-21, 10-16=-27, 16-17=-16
 Drag: 25-28=-26, 23-29=-26

Trapezoidal Loads (plf)

Vert: 1=-201-to-2=-195, 2=-206-to-38=-186, 38=-299-to-8=-235

85) Reversal: 19th Unbal.Dead + 0.75 Snow (unbal.) + 0.75 Uninhab. Attic Storage + 0.75 Attic Floor + 0.75(0.6 MWFRS Wind (Neg. Int) 1st Parallel): Lumber Increase=1.60, Plate Increase=1.60

Uniform Loads (plf)

Vert: 8-9=-202, 9-10=-235, 10-16=-58, 16-17=-48, 6-11=-26, 2-25=-289(F=-237), 23-25=-236, 23-44=-53, 21-44=-131, 16-21=-53
 Horz: 1-2=-65, 2-8=-54, 10-16=21, 16-17=32
 Drag: 25-28=-26, 23-29=-26

Trapezoidal Loads (plf)

Vert: 1=-105-to-2=-99, 2=-110-to-8=-26

86) Reversal: 20th Unbal.Dead + 0.75 Snow (unbal.) + 0.75 Uninhab. Attic Storage + 0.75 Attic Floor + 0.75(0.6 MWFRS Wind (Neg. Int) 1st Parallel): Lumber Increase=1.60, Plate Increase=1.60

Uniform Loads (plf)

Vert: 8-9=-26, 9-10=-58, 10-43=-235, 16-43=-122, 16-17=-111, 6-11=-26, 2-25=-289(F=-237), 23-25=-236, 23-44=-53, 21-44=-131, 16-21=-53
 Horz: 1-2=-65, 2-8=-54, 10-16=21, 16-17=32
 Drag: 25-28=-26, 23-29=-26

Trapezoidal Loads (plf)

Vert: 1=-168-to-2=-162, 2=-173-to-38=-153, 38=-266-to-8=-202

87) Reversal: 21st Unbal.Dead + 0.75 Snow (unbal.) + 0.75 Uninhab. Attic Storage + 0.75 Attic Floor + 0.75(0.6 MWFRS Wind (Neg. Int) 2nd Parallel): Lumber Increase=1.60, Plate Increase=1.60

Uniform Loads (plf)

Vert: 8-9=-235, 9-10=-202, 10-16=-26, 16-17=-15, 6-11=-26, 2-25=-289(F=-237), 23-25=-236, 23-44=-53, 21-44=-131, 16-21=-53
 Horz: 1-2=-32, 2-8=-21, 10-16=54, 16-17=65
 Drag: 25-28=-26, 23-29=-26

Trapezoidal Loads (plf)

Vert: 1=-138-to-2=-131, 2=-142-to-8=-58

88) Reversal: 22nd Unbal.Dead + 0.75 Snow (unbal.) + 0.75 Uninhab. Attic Storage + 0.75 Attic Floor + 0.75(0.6 MWFRS Wind (Neg. Int) 2nd Parallel): Lumber Increase=1.60, Plate Increase=1.60

Uniform Loads (plf)

Vert: 8-9=-58, 9-10=-26, 10-43=-202, 16-43=-89, 16-17=-78, 6-11=-26, 2-25=-289(F=-237), 23-25=-236, 23-44=-53, 21-44=-131, 16-21=-53
 Horz: 1-2=-32, 2-8=-21, 10-16=54, 16-17=65
 Drag: 25-28=-26, 23-29=-26


Trapezoidal Loads (plf)

Vert: 1=-201-to-2=-195, 2=-206-to-38=-186, 38=-299-to-8=-235

Job	Truss	Truss Type	Qty	Ply	GARY ROBINSON-LOT 73 SOUTH CREEK WOODLAKE MODEL ROOF
20-6466-A	V01	Valley	1	1	Job Reference (optional)

Riverside Roof Truss, LLC, Danville, VA. 24541

Run: 8.330 s Feb 24 2020 Print: 8.330 s Feb 24 2020 MiTek Industries, Inc. Wed Dec 16 12:09:08 2020 Page 1
ID:riFrQwqzJQyesEOjBg_H7VyKEle-bPSE3EP8OqktIXJE7NEkO1ZJ0b?iWB7kr0XMVxy8PX9

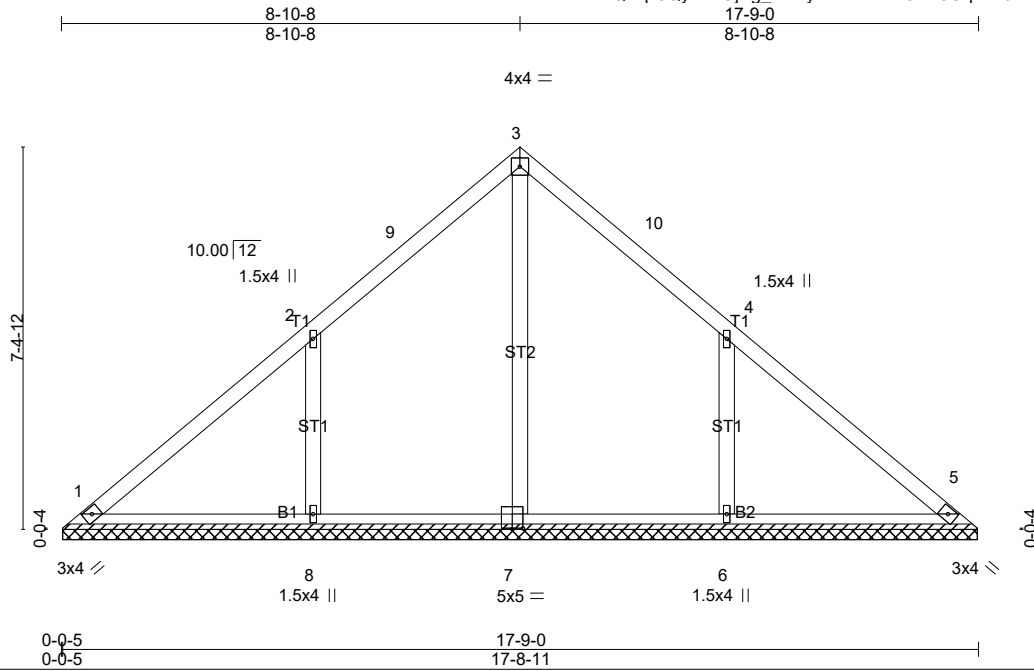

Scale = 1:44.6

Plate Offsets (X,Y)-- [7:0-2-8,0-0-4]

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof) 30.0	2-0-0	TC 0.34	Vert(LL)	n/a	-	n/a	MT20	244/190
Snow (Pf/Pg) 23.1/30.0	Plate Grip DOL 1.15	BC 0.18	Vert(CT)	n/a	-	n/a		
TCDL 10.0	Lumber DOL 1.15	WB 0.18	Horz(CT)	0.00	5	n/a		
BCLL 0.0 *	Rep Stress Incr YES	Matrix-S					Weight: 80 lb	FT = 20%
BCDL 10.0	Code IRC2015/TPI2014							

LUMBER-
 TOP CHORD 2x4 SP No.2
 BOT CHORD 2x4 SP No.2
 OTHERS 2x4 SP No.3

BRACING-
 TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

REACTIONS. All bearings 17-8-6.
 (lb) - Max Horz 1=-175(LC 12)
 Max Uplift All uplift 100 lb or less at joint(s) 1 except 8=-218(LC 16), 6=-215(LC 17)
 Max Grav All reactions 250 lb or less at joint(s) 1, 5 except 7=395(LC 32), 8=574(LC 29), 6=585(LC 30)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 WEBS 2-8=-412/263, 4-6=-412/263


- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCCL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) TCCL: ASCE 7-10; Pr=30.0 psf (roof live load); Lumber DOL=1.15 Plate DOL=1.15; Pg=30.0 psf (ground snow); Pf=23.1 psf (flat roof snow); Lumber DOL=1.15 Plate DOL=1.15; Category II; Exp B; Partially Exp.; Ct=1.10
 - 4) Unbalanced snow loads have been considered for this design.
 - 5) Gable requires continuous bottom chord bearing.
 - 6) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 7) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - 8) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1 except (jt=lb) 8=218, 6=215.
 - 9) This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard

Job	Truss	Truss Type	Qty	Ply	GARY ROBINSON-LOT 73 SOUTH CREEK WOODLAKE MODEL ROOF
20-6466-A	V02	Valley	1	1	Job Reference (optional)

Riverside Roof Truss, LLC, Danville, VA. 24541

Run: 8.330 s Feb 24 2020 Print: 8.330 s Feb 24 2020 MiTek Industries, Inc. Wed Dec 16 12:09:08 2020 Page 1
ID:riFrQwqzJQyesEOjBg_H7VyKEle-bPSE3EP8OqktlXJE7NEkO1ZLdb0dWC2kr0XMXvy8PX9

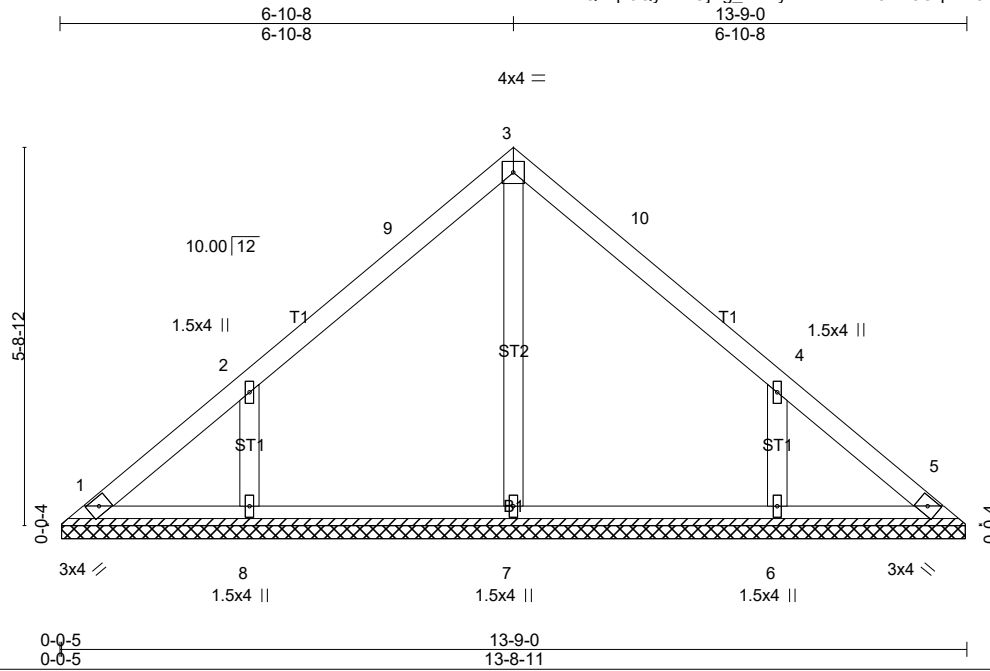

Scale = 1:34.9

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL (roof) 30.0	2-0-0	TC 0.24	in (loc) l/defl L/d	MT20	244/190
Snow (Pf/Pg) 23.1/30.0	Plate Grip DOL 1.15	BC 0.12	Vert(LL) n/a - n/a 999		
TCDL 10.0	Lumber DOL 1.15	WB 0.12	Vert(CT) n/a - n/a 999		
BCDL 0.0 *	Rep Stress Incr YES	Matrix-S	Horz(CT) 0.00 5 n/a n/a		
BCLL 0.0	Code IRC2015/TPI2014			Weight: 59 lb	FT = 20%
BCDL 10.0					

LUMBER-
TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
OTHERS 2x4 SP No.3

BRACING-
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

REACTIONS. All bearings 13-8-6.
(lb) - Max Horz 1=-133(LC 12)
Max Uplift All uplift 100 lb or less at joint(s) 1, 5 except 8=-169(LC 16), 6=-169(LC 17)
Max Grav All reactions 250 lb or less at joint(s) 1, 5 except 7=296(LC 2), 8=398(LC 29), 6=398(LC 30)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
WEBS 2-8=-325/210, 4-6=-325/210


- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TC DL=6.0psf; BC DL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - TCLL: ASCE 7-10; Pr=30.0 psf (roof live load: Lumber DOL=1.15 Plate DOL=1.15); Pg=30.0 psf (ground snow); Pf=23.1 psf (flat roof snow: Lumber DOL=1.15 Plate DOL=1.15); Category II; Exp B; Partially Exp.; Ct=1.10
 - Unbalanced snow loads have been considered for this design.
 - Gable requires continuous bottom chord bearing.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 5 except (jt=lb) 8=169, 6=169.
 - This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard

Job 20-6466-A	Truss V03	Truss Type Valley	Qty 1	Ply 1	GARY ROBINSON-LOT 73 SOUTH CREEK WOODLAKE MODEL ROOF Job Reference (optional)
------------------	--------------	----------------------	----------	----------	--

Riverside Roof Truss, LLC, Danville, VA. 24541

Run: 8.330 s Feb 24 2020 Print: 8.330 s Feb 24 2020 MiTek Industries, Inc. Wed Dec 16 12:09:09 2020 Page 1
ID:riFrQwqzJQyesEOjBg_H7VyKEle-3c0cGaQm98tkvGuRh5lzwE6U8?KZFft4gHv3Ly8PX8

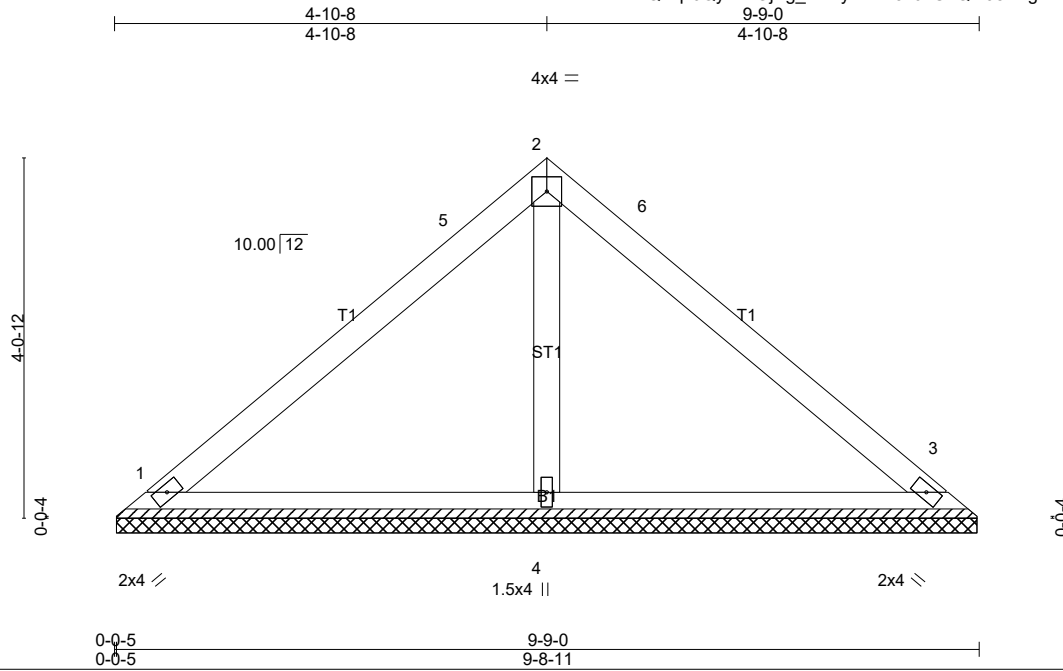

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL (roof) 30.0	2-0-0	TC 0.38	in (loc) l/defl L/d	MT20	244/190
Snow (Pf/Pg) 23.1/30.0	Plate Grip DOL 1.15	BC 0.20	Vert(LL) n/a - n/a 999		
TCDL 10.0	Lumber DOL 1.15	WB 0.08	Vert(CT) n/a - n/a 999		
BCLL 0.0 *	Rep Stress Incr YES	Matrix-S	Horz(CT) 0.00 3 n/a n/a		
BCDL 10.0	Code IRC2015/TPI2014			Weight: 37 lb	FT = 20%

LUMBER-
TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
OTHERS 2x4 SP No.3

BRACING-
TOP CHORD
BOT CHORD

Structural wood sheathing directly applied or 6-0-0 oc purlins.
Rigid ceiling directly applied or 10-0-0 oc bracing.

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

REACTIONS. (lb/size) 1=205/9-8-6 (min. 0-1-8), 3=205/9-8-6 (min. 0-1-8), 4=360/9-8-6 (min. 0-1-8)
Max Horz 1=92(LC 13)
Max Uplift 1=-31(LC 17), 3=-42(LC 17), 4=-6(LC 16)
Max Grav 1=241(LC 2), 3=241(LC 2), 4=413(LC 2)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
WEBS 2-4=-271/68


- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TC DL=6.0psf; BC DL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - TCLL: ASCE 7-10; Pr=30.0 psf (roof live load: Lumber DOL=1.15 Plate DOL=1.15); Pg=30.0 psf (ground snow); Pf=23.1 psf (flat roof snow: Lumber DOL=1.15 Plate DOL=1.15); Category II; Exp B; Partially Exp.; Ct=1.10
 - Unbalanced snow loads have been considered for this design.
 - Gable requires continuous bottom chord bearing.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 3, 4.
 - This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard

Job	Truss	Truss Type	Qty	Ply	GARY ROBINSON-LOT 73 SOUTH CREEK WOODLAKE MODEL ROOF
20-6466-A	V04	Valley	1	1	Job Reference (optional)

Riverside Roof Truss, LLC, Danville, VA. 24541

Run: 8.330 s Feb 24 2020 Print: 8.330 s Feb 24 2020 MiTek Industries, Inc. Wed Dec 16 12:09:10 2020 Page 1
 ID:riFrQwqzJQyesEOjBg_H7VyKEle-Xoa_TwR0wR?aXqTdFoGCTSeiYPj_7_0JK0Tcny8PX7

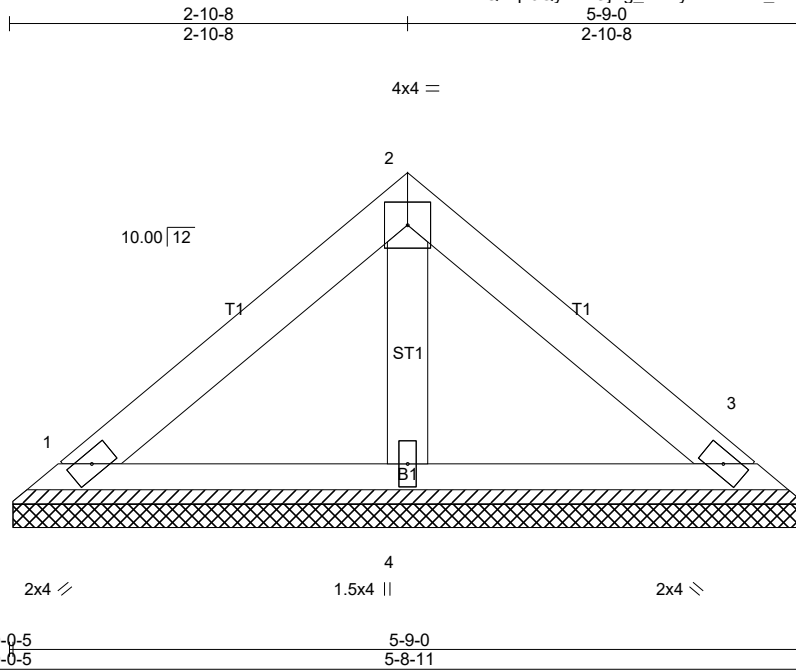

Scale = 1:16.6

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL (roof) 30.0	2-0-0	TC 0.15	in (loc) l/defl L/d	MT20	244/190
Snow (Pf/Pg) 23.1/30.0	Plate Grip DOL 1.15	BC 0.06	Vert(LL) n/a - n/a 999		
TCDL 10.0	Lumber DOL 1.15	WB 0.03	Vert(CT) n/a - n/a 999		
BCLL 0.0 *	Rep Stress Incr YES	Matrix-P	Horz(CT) 0.00 3 n/a n/a		
BCDL 10.0	Code IRC2015/TPI2014			Weight: 21 lb	FT = 20%

LUMBER-
 TOP CHORD 2x4 SP No.2
 BOT CHORD 2x4 SP No.2
 OTHERS 2x4 SP No.3

BRACING-
 TOP CHORD
 BOT CHORD

Structural wood sheathing directly applied or 5-9-0 oc purlins.
 Rigid ceiling directly applied or 10-0-0 oc bracing.

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

REACTIONS. (lb/size) 1=123/5-8-6 (min. 0-1-8), 3=123/5-8-6 (min. 0-1-8), 4=180/5-8-6 (min. 0-1-8)
 Max Horz 1=-51(LC 12)
 Max Uplift 1=-24(LC 17), 3=-30(LC 17)
 Max Grav 1=145(LC 2), 3=145(LC 2), 4=204(LC 2)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCCL=6.0psf; BCCL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- TCLL: ASCE 7-10; Pr=30.0 psf (roof live load: Lumber DOL=1.15 Plate DOL=1.15); Pg=30.0 psf (ground snow); Pf=23.1 psf (flat roof snow: Lumber DOL=1.15 Plate DOL=1.15); Category II; Exp B; Partially Exp.; Ct=1.10
- Unbalanced snow loads have been considered for this design.
- Gable requires continuous bottom chord bearing.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 3.
- This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard