REVISION LOG

REVISION:001

DATE: 10/09/2020

- ADD DELUXE KITCHEN OPTION
 RELOCATE NICHE IN L-SHAPED SHOWER IN OWNER'S BATH.
 CHANGE WAINCOL TURNING CORNER AT PORCH TO OPTIONAL.
 REMOVED TOWER INS IN BATH 3
 VERIFY OPT. WET BARS IS 81"
 MOVE WET BAT BUNDER COUNTER REFRIG. TO RIGHT SIDE OF SINK.
 REMOVE DIMENSIONS FROM HVAC PLATFORM.





LOT 1009 - CARRIAGE GLEN 11.30.2020

Portico 2020 LH

'BUNGALOW'

ARCHITECTURAL DRAWINGS							
Sheet No.	Sheet Description	Sheet No.	Sheet Description				
0.0	Cover Sheet						
2.1	First Floor Plan	+					
2.2	Second Floor Plan						
2.4	Sitting Room Plan & Elevations						
2.5	Screen Patio Plan & Elevations						
3.1	Front & Rear Elevations (Slab)						
3.2	Side Elevations (Slab)						
3.3	Roof Plan						
4.0	Building Sections (Slab)						
5.1	First Floor Electrical						
5.2	Second Floor Electrical						
8.1	First Floor Flooring Plan						
8.2	Second Floor Flooring Plan						

DESIGN CRITERIA:

THIS PLAN IS TO BE BUILT IN CONFORMANCE WITH THE 2018 NORTH CAROLINA STATE BUILDING CODE: RESIDENTIAL CODE

DIMENSIONS SHALL GOVERN OVER SCALE, AND CODE SHALL GOVERN OVER DIMENSIONS.

SQUARE FOOTAGE						
	'BUNGALOW'					
	UNHEATED	HEATED				
FIRST FLOOR	0	1802				
SECOND FLOOR	0	683				
COVERED PORCH	145	0				
PATIO	265	0				
FRONT PORCH	195	0				
2 CAR GARAGE	488	0				
SUBTOTALS	1093	2485				
TOTAL UNDER ROOF	35	78				
0	PTIONS					
	UNHEATED S.F.	HEATED S.F.				
OPT SITTING ROOM	0	+117				
OPT SCREEN PATIO	117	0				








	DRAWN	BY:
PLOTS	ORIGINA	IL RELEASE DATE:
	CURREN	IT RELEASE DATE:
SCALE		
	REV #	DATE / DESCRIPTION
ARE 1/2	$ \Delta $	
	Δ	
SHEETS	_	
봀	$ \Delta $	
11×17	Ē	
, X		

Cover Sheet 'Bungalow' Portico 2020 LH

General Floor Plan Notes


General Floor Plan Notes shall apply unless noted otherwise on plan.

- Wall Heights: Typically 9'-1 1/2" at first floor and second floor, and 9'-1 1/2" at attics U.N.O. All walls are constructed using a double top plate. Splices at Double Top Plate do not need to occur at Vertical Studs but must be at least 24" apart from Joint in other Top Plate layer. Special wall heights are noted on plans where they occur.
- Wall Thickness is typically 3 1/2". 2x6 frame shall be used at walls that back up to plumbing fixtures.
 Walls greater than 10' high shall be framed with 2x6 framing or greater and will be noted as a special condition where it occurs on plan.
- 3. Typical header height shall be 7'-8" AFF at First Floor, and 7'-4" AFF at Second Floor U.N.O.
- Jacks: Openings up to 3'-4" wide shall have (1) 2x4
 jack stud SPF on each side. Openings greater than
 3'-4" wide shall have (2) 2x4 jack studs SPF on each
- Soffits, Coffered Ceilings, Trey Ceilings and other significant ceiling plan elements are shown on the floor plans and are denoted as single dashed lines. Unless specifically call out as included, Kitchens do not include soffits over wall cabinetry.
- Door & Window Frames, where occurring near corners, shall be a minimum of 4 1/2" from corner. Except for walk-in closets with doors near a corner, doors at closets shall be centered on closet.
- Windows: Shall have at least (1) window in each sleeping room, that meets egress. Shall be provided with tempered glass at hazardous glazing areas. False windows shall be installed with obscure glazing.
- Closets for clothing or coat storage shall be equipped with 1 rod/shelf. Closets for linen shall have 4 open equal shelves. Closets for pantries shall have 4 equal wood shelves, painted.
- Stair treads shall be a min of 9" deep, risers shall be a maximum of 8 1/4", unless noted otherwise, per the current North Carolina Residential Code
- 10. Handrails and Guards at stairs shall be 34" above the finished surface of the ramp surface of the stair. Handrails at landings and overlooks of multilevel spaces shall be 36" above finished floor. Guards (pickets or balisters) shall be spaced with no more than 4" between quards.
- 11. Attic Access shall be provided at all attic area with a height greater than 30". Minimum clear attic access shall be 20" x 30". Pull down stairs and access doors in knee walls meeting minimum criteria are also acceptable.
- 12. Garage Door to Living Space shall be 2'-8" x 6'-8" minimum size and shall be 20 minute fire rated and
- 13. Garage Walls, as a minimum, shall be separated from living space by installing 1/2" gypsum board on the garage side of the wall. With habitable space above, the inside of all garage walls require 1/2" GWB supporting 5/8" type X GWB on ceiling.




TYP. ARCHED OPENING

SCALE: 3/8"=1'-0" ON 11x17, 3/4"=1'-0" ON 22x34



SHIPLAP DETAIL


SCALE: 3/8"=1'-0" ON 11x17, 3/4"=1'-0" ON 22x34



-SHAPED SHOWER

SEE DETAIL BELOW

OPT. L-SHAPED SHOWER
SCALE: 1/8"=1'-0" ON 11x17, 1/4"=1'-0" ON 22x34

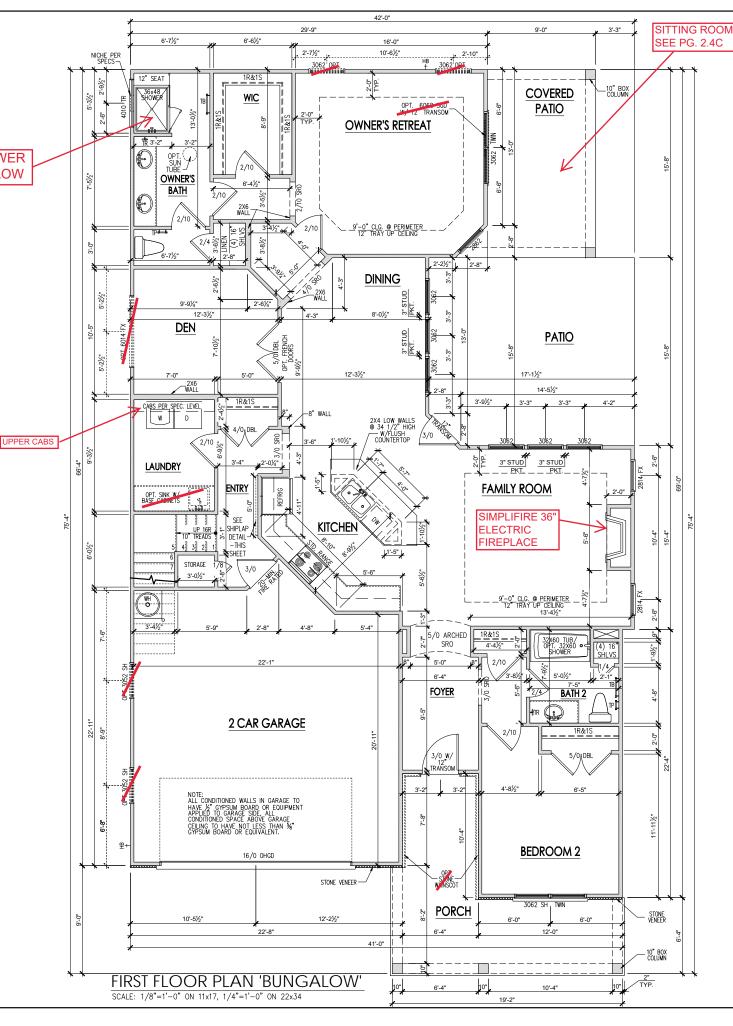



This plan is the property of South Designs, Inc. and may not be reproduced without the expressed written consent of South Designs, Inc. These drawings are offered to the named client for a conditional one time use. The conditional use is limited to the lot or property as specified herein, and only for said location.

(F) 919-556-2228

www.southdesigns.com

and only for said location.

South Designs, Inc. assumes no liability
for any home constructed from these
plans. Contractor or Bulder shall verify
all dimensions and conditions prior to
construction. Coultion must be
coverised when making changes to
these drawings. If changes are made
to these drawings. Contact South
Designs, Inc.






Portico 2020 LH
First Floor Plan 'Bungalow'

2.1c

General Floor Plan Notes

General Floor Plan Notes shall apply unless noted otherwise on plan.

- Wall Heights: Typically 9'-1 1/2" at first floor and second floor, and 9'-1 1/2" at attics U.N.O. All walls are constructed using a double top plate. Splices at Double Top Plate do not need to occur at Vertical Studs but must be at least 24" apart from Joint in other Top Plate layer. Special wall heights are noted on plans where they occur.
- Wall Thickness is typically 3 1/2". 2x6 frame shall be used at walls that back up to plumbing fixtures.
 Walls greater than 10' high shall be framed with 2x6 framing or greater and will be noted as a special condition where it occurs on plan.
- Typical header height shall be 7'-8" AFF at First Floor, and 7'-4" AFF at Second Floor U.N.O.
- Jacks: Openings up to 3'-4" wide shall have (1) 2x4
 jack stud SPF on each side. Openings greater than
 3'-4" wide shall have (2) 2x4 jack studs SPF on each
- Soffits, Coffered Ceilings, Trey Ceilings and other significant ceiling plan elements are shown on the floor plans and are denoted as single dashed lines. Unless specifically call out as included, Kitchens do not include soffits over wall cabinetry.
- Door & Window Frames, where occurring near corners, shall be a minimum of 4 1/2" from corner. Except for walk-in closets with doors near a corner, doors at closets shall be centered on closet.
- Windows: Shall have at least (1) window in each sleeping room, that meets egress. Shall be provided with tempered glass at hazardous glazing areas. False windows shall be installed with obscure glazing.
- Closets for clothing or coat storage shall be equipped with 1 rod/shelf. Closets for linen shall have 4 open equal shelves. Closets for pantries shall have 4 equal wood shelves, painted.
- Stair treads shall be a min of 9" deep, risers shall be a maximum of 8 1/4", unless noted otherwise, per the current North Carolina Residential Code
- 10. Handralls and Guards at stairs shall be 34" above the finished surface of the ramp surface of the stair. Handralls at landings and overlooks of multilevel spaces shall be 36" above finished floor. Guards (pickets or ballsters) shall be spaced with no more than 4" between guards.
- 11. Attic Access shall be provided at all attic area with a height greater than 30". Minimum clear attic access shall be 20" x 30". Pull down stairs and access doors in knee walls meeting minimum criteria are also acceptable.
- 12. Garage Door to Living Space shall be 2'-8" x 6'-8" minimum size and shall be 20 minute fire rated and weather sealed.
- 13. Garage Walls, as a minimum, shall be separated from living space by installing 1/2" gypsum board on the garage side of the wall. With habitable space above, the inside of all garage walls require 1/2" GWB supporting 5/8" type X GWB on ceiling.

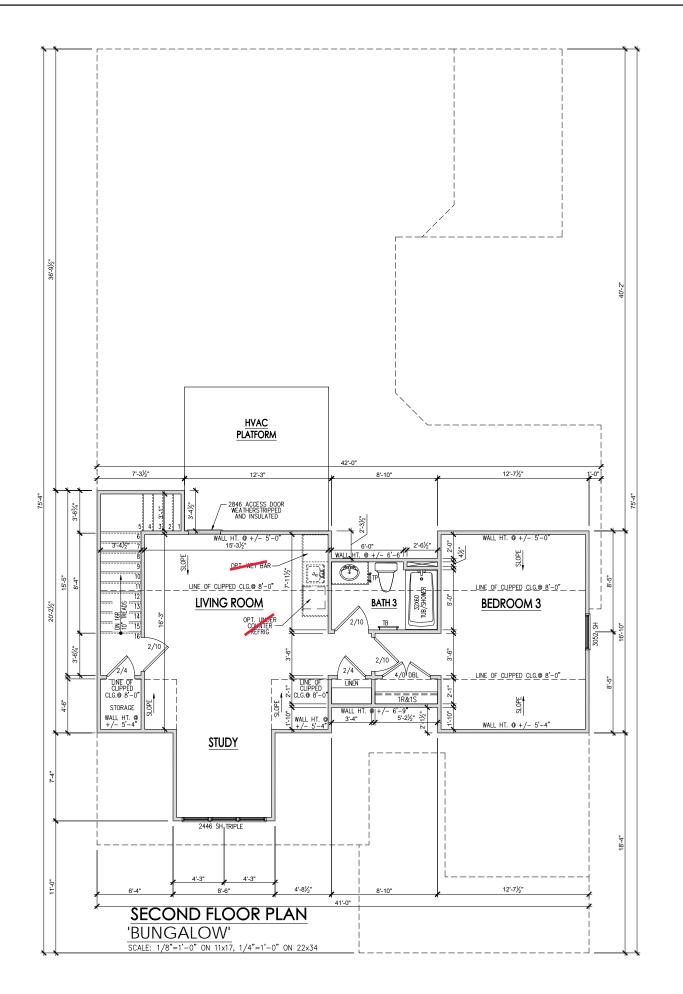



DESIGNS
P.O. Box 688
Wake Forest, NC 27588
(O) 919-556-2226
(F) 919-556-2228
www.southdesigns.com

This plan is the property of South Designs, Inc. and may not be reproduced without the expressed written consent of South Designs, Inc. These devinings or offered to the normed client for a conditional one time use. The conditional uses is limited to the lot or property as specified herein, and only for said location.

South Designs, Inc. assumes no liability

and only for said location.
South Designs, inc. assumes no liability
for any home constructed from these
plans. Contractor or Builder shall verify
all dimensions and conditions prior to
construction. Caution must be
exercised when miking changes to
these drawings. If changes are made
to these drawings, contact South
Designs, inc.


CLIENT:







	DRAWN BY:
OTS	ORIGINAL RELEASE DATE:
ARE 1/2 SCALE PLOTS	CURRENT RELEASE DATE:
ALE	
S	REV # DATE / DESCRIPTION
1/2	Δ
RE	
SHEETS	\
11×17	l l
+	

Portico 2020 LH
Second Floor Plan 'Bungalow'

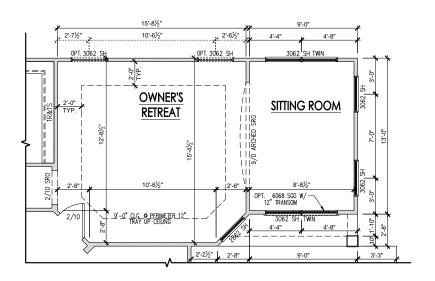

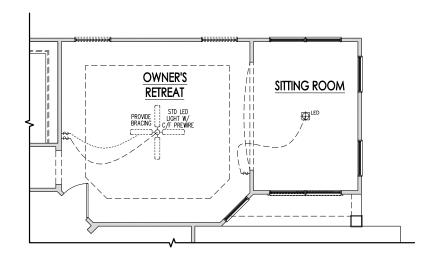

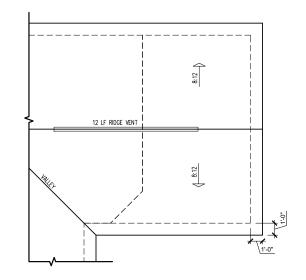

SITTING ROOM FLOOR PLAN
SCALE: 1/8"=1'-0" ON 11x17, 1/4"=1'-0" ON 22x34

SITTING ROOM ELECTRICAL
SCALE: 1/8"=1'-0" ON 11x17, 1/4"=1'-0" ON 22x34

SITTING ROOM ROOF PLAN
SCALE: 1/8"=1'-0" ON 11x17, 1/4"=1'-0" ON 22x34

SHINGLES PER
SPECS

8:12

8:12

8:12

8:12

8:12

8:12

8:12

8:12

8:12

10" BOX


COLUMN, TYP.

1ST FLR FF

1ST FLR FF

SCALE: 1/4" = 1'-0" ON 22x34, 1/8" = 1'-0" ON 11x17

PARTIAL RIGHT ELEVATION W/ SITTING ROOM (SLAB)

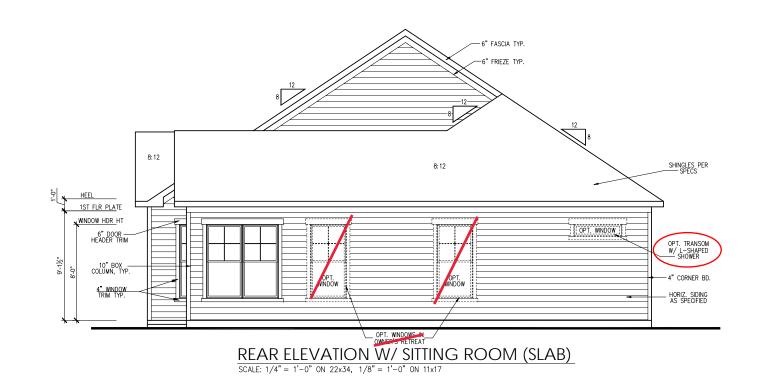

SOUTH
DESIGNS
P.O. Box 688
Wake Rorest, NC 27588
((0) 919-556-2226
(F) 919-556-2228
WWW.southdesigns.com

This plan is the property of South
Designs, Inc. and may not be
written consent of South Designs, Inc.
These drowings are offered to the
named client for a conditional one time
use. The conditional use is limited to
the lot or property as specified herein,
and only for soid locotion.
South Designs, Inc. assumes no licitity
or any home constructed from these
plans. Contractor or Builder shall verify
all dimensions and conditions prior to
construction. Caution must be
exercised when making changes to
these drowings. If changes are made
to these drowings, contact South
Designs, Inc.

CLEMT:

MCKee



11x17 SHEETS ARE 1/2 SCALE PLOTS	DRAWN BY: ORIGINAL RELI CURRENT REL REV # DATE	 N
S - 11×17 S		low'

Portico 2020 LH
Sitting Room Plans & Elev 'Bungalow'

2.4c

General Elevation Notes


General Elevation Notes shall apply unless

- 1. Roof shall be finished with architectural composition
- Ridge Vent shall be provided and installed on all ridges greater than 6' in length per manufacturer's specifications.
- 3. Soffit Vent shall be continuous soffit vent
- House Wrap, "tyvek" or approved equal shall be installed over entire exterior wall per manufacturer's specifications and recommendations.
- Flashing shall be provided above all door and window openings, above finish wall material changes and at wall surfaces where lower roof areas abut vertical wall surfaces.
- Porch Railings shall be provided at all porch walking surfaces greater than 30" above adjacent finished grade. It shall be 36" high with guards spaced no more than 4" apart. Consult community specifications for material.
- Finish Wall Material shall be as noted on elevation drawings.
- 8. Brick Veneer, if included on elevation shall be tied to wall surface with galvanized corrugated metal ties at a rate of 24" oc horizontally and 16" oc vertically so that no more than 2.67sf of brick is supported by (1) tie. Space between face of wall and back face of brick shall be limited to a maximum of 1". Flashing shall be provided behind brick above all wall openings and at base of brick wall. Flashing shall be a minimum of 6-mil poly or other corrosion resistant material and shall be installed so that it laps under the house wrap material a minimum of 2". Weepholes shall be provided at a rate of 48" oc and shall not be less than 3/16" in diameter and shall be located immediately above flashing. located immediately above flashing.
- Brick Veneer Support Lintels shall be provided if brick veneer is included on elevation. Lintels shall be provided as listed in the following schedule and shall have a minimum bearing length of 6". Masonry Lintels shall be provided so that deflection is limited to L/600.

Masonry Opening Lintel Schedule

Opening Size Angle

up to 4	'-0"	3-1/2" x 3-1/2" x 5/16
4'-1" to	5'-6"	4" x 3-1/2" x 5/16" LL\
5'-7" to	o 6'-6"	5" x 3-1/2" x 5/16" LL\
6'-7" to	8'-4"	6" x 3-1/2" x 5/16" LL\
8'-5" to	16'-4"	7" x 4" x 3/8" LLV

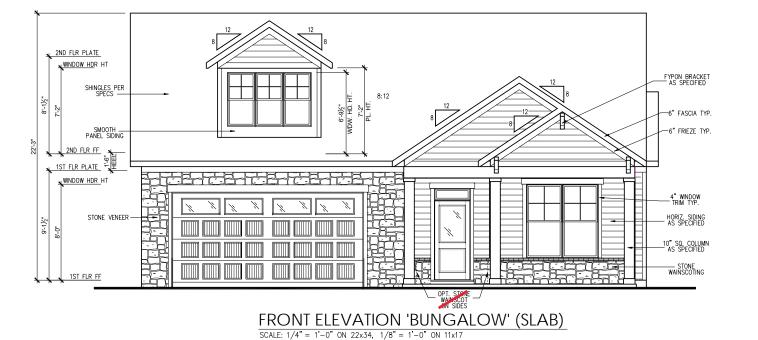

REAR ELEVATION W/ SITTING ROOM SEE PG. 2.4C



This plan is the property of South Designs, Inc. and may not be reproduced without the expressed written consent of South Designs, Inc. These drawings are offered to the named client for a conditional one time. The conditional use is limited to the lot or property as specified herein, and only for soid location. South Designs, Inc. assumes no liability for any home constructed from these plans. Contractor or Builder shall verify all dimensions and conditions prior to construction. Caution must be exercised when making changes are made to these drawings. If changes are made to these drawings, contact South Designs, Inc.





	DRAWN BY:	
OTS	ORIGINAL RELEASE DATE:	
۲.	CURRENT RELEASE DATE:	
SCALE PLOTS	REV # DATE / DESCRIPTION	
ARE 1/2	^	
П 1	4	
	Δ	_
ETS		
SHEETS		
11×17		
- 1	-	

Front & Rear Elevations 'Bungalow Portico 2020 LH

3.1c


General Elevation Notes

General Elevation Notes shall apply unless noted otherwise on plan.


- Roof shall be finished with architectural composition shingles with slopes as noted on plan.
- Ridge Vent shall be provided and installed on all ridges greater than 6' in length per manufacturer's specifications.
- 3. Soffit Vent shall be continuous soffit vent
- House Wrap, "tyvek" or approved equal shall be installed over entire exterior wall per manufacturer's specifications and recommendations.
- 5. Flashing shall be provided above all door and window openings, above finish wall material changes and at wall surfaces where lower roof areas abut vertical wall surfaces.
- 6. Porch Railings shall be provided at all porch walking surfaces greater than 30" above adjacent finished grade. It shall be 36" high with guards spaced no more than 4" apart. Consult community specifications for material.
- Finish Wall Material shall be as noted on elevation
- Brick Veneer, if included on elevation shall be tied to wall surface with galvanized corrugated metal ties at a rate of 24" oc horizontally and 16" oc vertically so a rate of 24" oc horizontally and 16" oc vertically so that no more than 2.67s of brick is supported by (1) tie. Space between face of wall and back face of brick shall be limited to a maximum of 1". Flashing shall be provided behind brick above all wall openings and at base of brick wall. Flashing shall be a minimum of 6-mil poly or other corrosion resistant material and shall be installed so that it laps under the house wrap material a minimum of 2". Weepholes shall be provided at a rate of 48" oc and shall not be less than 3/16" in diameter and shall be located immediately above flashing.
- Brick Veneer Support Lintels shall be provided if brick veneer is included on elevation. Lintels shall be provided as listed in the following schedule and shall have a minimum bearing length of 6". Masonry Lintels shall be provided so that deflection is limited

Masonry Opening Lintel Schedule

Opening size		.e	Aligie
up to	4'-0"		3-1/2" x 3-1/2" x 5/16
4'-1"	to	5'-6"	4" x 3-1/2" x 5/16" LLV
5'-7"	to	6'-6"	5" x 3-1/2" x 5/16" LLV
6'-7"	to	8'-4"	6" x 3-1/2" x 5/16" LLV
8'-5"	to	16'-4"	7" x 4" x 3/8" LLV

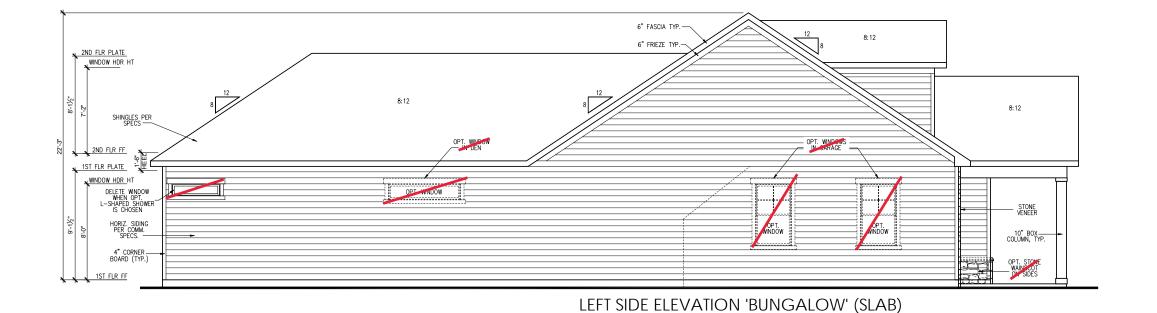

SCALE: 1/4" = 1'-0" ON 22x34, 1/8" = 1'-0" ON 11x17

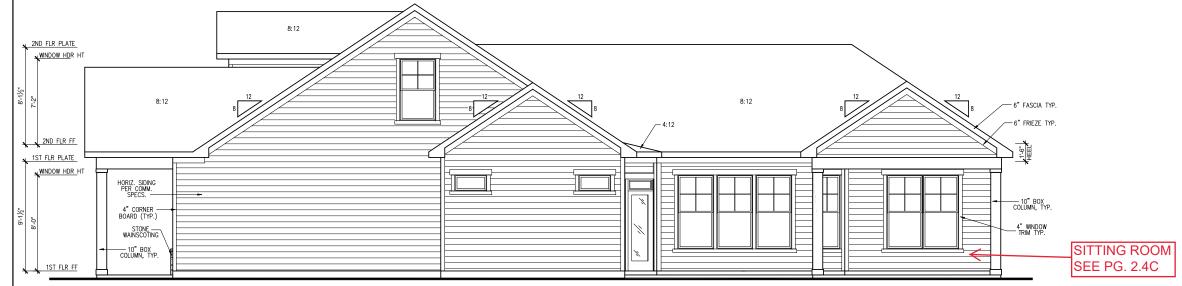

RIGHT SIDE ELEVATION 'BUNGALOW' (SLAB)

SCALE: 1/4" = 1'-0" ON 22x34, 1/8" = 1'-0" ON 11x17

This plan is the property of South Designs, Inc. and may not be reproduced without the expressed written consent of South Designs, Inc. These drainings are offered to the named client for a conditional one Is limited to the lot or property as specified herein, and only for said location. South Designs, Inc. assumes no liability or any home constructed from these plans. Contractor or Builder shall verify all dimensions and conditions prior to construction. Caution must be exercised when making changes or emade to these drainings. If changes are made to these drainings, contact South Designs, Inc.

(F) 919-556-2228


www.southdesigns.com





11x17 SHEETS ARE 1/2 SCALE PLOTS	DRAIN BY: ORIGINAL RELEASE DATE: CURRENT RELEASE DATE: REV # DATE / DESCRIPTION	
ETS - 11x17_SH		

Side Elevations 'Bungalow' Portico 2020 LH

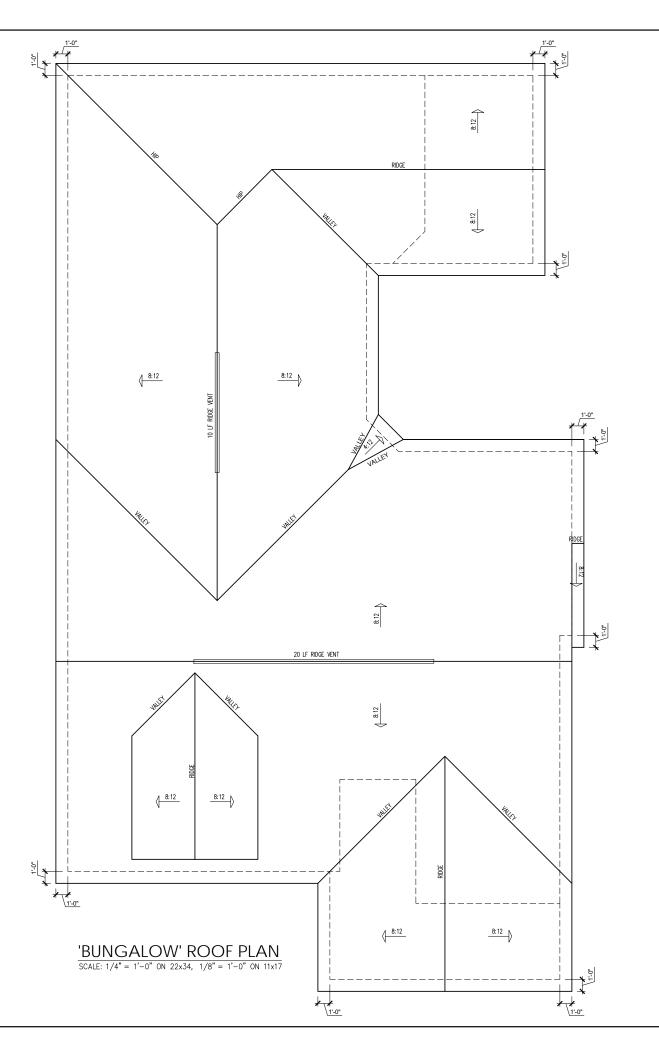

ATTIC VENT SCHEDULE									
	'BUNGALOW'								
MAIN HOUSE SQ FTG 2290 AT / NEAR RIDGE AT / NEAR					AR EAVE				
VENT TYPE	VENT TYPE SQ. FT. REQUIRED RANGE		SQ. FT.	PERCENT OF TOTAL	POT LARGE (SQ. FT. EACH)	POT SMALL (SQ. FT. EACH)	RIDGE VENT (SQ. FT. PER LF)	EAVE VENT (SQ. IN. EACH)	CONT. VENT (SQ. IN. PERLF)
VEIVITE				SUPPLIED	0.4236	0.2778	0.125	0.1944	0.0625
RIDGE VENT	3.05	3.82	3.75	49.18	0	0	30.00		
SOFFIT VENTS	4.58	3.82	3.88	50.82				0	62.00
TOTAL (MIN)	7.63	7.63	7.63	100.00	POT VENTS MAY BE	REQUIRED IF THERE	IS INSUFFICIENT RIDG	GE AVAILABLE	

* SCHEDULE HAS BEEN CALCULATED ASSUMING EAVE VENTILATION AT 50-60% OF TOTAL AND RIDGE AT 40-50% OF TOTAL REQUIRED VENTILATION

SOUTH DESIGNS P.O. Box 688 Wake Forest, NC 27588 (0) 919-556-2226 (F) 919-556-2228 www.southdesigns.com

This plan is the property of South Designs, Inc. and may not be reproduced without the expressed written consent of South Designs, Inc. These drawings are offered to the named client for a conditional one time use. The conditional use is limited to the lot or property as specified herein, and only for said location, and only for said location.

South Designs, Inc. assumes no liability for only home constructed from these plans. Contractor or Builder shall verify all dimensions and conditions prior to construction. Coution must be exercised when making changes to these drawings. If changes are made to these drawings, contact South


McKee Homes, Inc.



	DRAWN B	Y:			
STO.	ORIGINAL RELEASE DATE:				
4	CURRENT	RELEASE (ATE:		
11x17 SHEETS ARE 1/2 SCALE PLOTS	REV # ID	ATE / DES	CRIPTION		
7					
Æ 1	=				
ω ¥	ᅡ				
EET					
표					
1×1		l l	- 1		
1					
ETS					
941		11	- 11		

Portico 2020 LH Roof Plan 'Bungalow'


3.3c



RISER HEIGHTS PER STAIR CONFIGURATION							
PLATE HEIGHT	10" FLOOR SYSTEM	14" FLOOR SYSTEM	16" FLOOR SYSTEM				
8'-1 1/2"	14 RISERS @ 7 11/16"	15 RISERS @ 7 1/2"	15 RISERS @ 7 5/8"				
9'-1 1/2"	16 RISERS @ 7 1/2"	16 RISERS @ 7 3/4"	17 RISERS @ 7 7/16"				
10'-1 1/2"	17 RISERS @ 7 3/4"	18 RISERS @ 7 9/16"	18 RISERS @ 7 11/16"				

TYPICAL STAIR DETAIL


SCALE: 1" = 1'-0" ON 22x34, 1/2" = 1'-0" ON 11x17

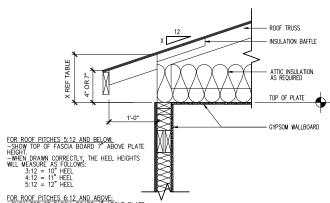

FOR ROOF PITCHES 6:12 AND ABOVE:
-SHOW TOP OF FASCIA BOARD 4" ABOVE PLATE
HEIGHT.
-WHEN DRAWN CORRECTLY, THE HEEL HEIGHTS
WILL MEASURE AS FOLLOWS:

IMPORTANT REMINDER: THE LOWEST PITCH ROOF ALWAYS MANDATES THE CONDITION. FOR EXAMPLE, A ROOF WITH A 4:12 PITCH AND A 6:12 PITCH, WOULD FOLLOW THE 7" ABOVE PLATE HEIGHT RULE. THE HEEL FOR THE 6:12 ROOF IN THIS CONDITION WILL DIFFER FROM WHAT IS LISTED HERE.

ENERGY HEEL DETAIL: CZ 2 & 3 SCALE: 1'' = 1'-0'' ON 22x34, 1/2'' = 1'-0'' ON 11x17

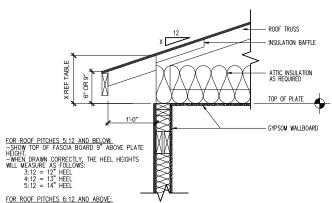

FOR ROOF PITCHES 6:12 AND ABOVE:

—SHOW TOP OF FASCIA BOARD 6" ABOVE PLATE
HEIGHT.

—WHEN DRAWN CORRECTLY, THE HEEL HEIGHTS
WILL MEASURE AS FOLLOWS.

6:12 = 12" HEEL.

7:12 = 13" HEEL.

8:12 = 14" HEEL.

9:12 = 15" HEEL.

10:12 = 15" HEEL.


10:12 = 16" HEEL.

6:12 ROOF IN

IMPORTANT REMINDER: THE LOWEST PITCH ROOF ALWAYS MANDATES THE CONDITION. FOR EXAMPLE, A ROOF WITH A 4:12 PITCH AND A 6:12 PITCH, WOULD FOLOW THE 9" ABOVE PLATE HEIGHT RULE. THE HEEL FOR THE 6:12 ROOF IN THIS CONDITION WILL DIFFER FROM WHAT IS LISTED HERE.

ENERGY HEEL DETAIL: CZ 4 & 5

SCALE: 1'' = 1'-0'' ON 22x34, 1/2'' = 1'-0'' ON 11x17

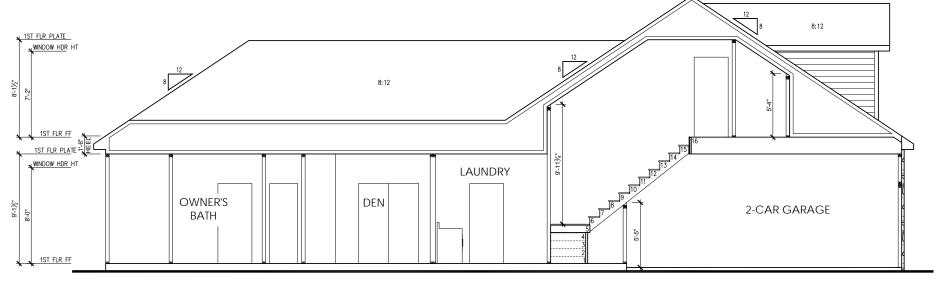

BUILDING SECTION 1 - 'BUNGALOW' (SLAB) SCALE: 1/4" = 1'-0" ON 22x34, 1/8" = 1'-0" ON 11x17

SOUTH **DESIGNS** P.O. Box 688 Wake Forest, NC 27588

(O) 919-556-2226 (F) 919-556-2228

This plan is the property of South Designs, Inc. and may not be reproduced without the expressed written consent of South Designs, Inc. these drainings ore offered to the named client for a conditional one time. The conditional use is limited to the lot or property as specified herein, and only for said location. South Designs, Inc. assumes no liability or any home constructed from these plans. Contractor or Builder shall verify or any home construction. Coultion must be exercised when making changes for these drainings. If changes are made to these drainings, contact South Designs, Inc.





	DRAWN BY:		
OTS	ORIGINAL RE	LEASE DATE:	
립	CURRENT RE	LEASE DATE:	
11x17 SHEETS ARE 1/2 SCALE PLOTS			
/2 S	REV # IDAIL	/ DESCRIPTION	
RE 1,	4		
S AF	△ ─		
TEET			
15 L			
l S			
SHEETS			
2 S			

Portico 2020 LH **Building Sections**

ELECTRICAL SYMBOL KEY LIGHT FIXTURES CEILING SURFACE MOUNT LIGHT RECESSED CAN LIGHT LED PUCK LIGHT WP RECESSED CAN LIGHT WATERPROOF RECESSED CAN - EYEBALL ● PENDANT LIGHTING ₩ MALL SCONCE HALL MOUNT LIGHT FLOOD LIGHT OUTLETS DUPLEX OUTLET GFI OUTLET GFI-NP WATERPROOF GFI OUTLET SWITCHED 1/2 HOT DUPLEX OUTLET 220V OUTLET TELEPHONE OUTLET CATV (TELEVISION) OUTLET UNDER-COUNTER OR CONCEALED OUTLETS Ø CEILING MOUNTED DUP. OUTLET #LOOR MOUNTED DUP. OUTLET SWITCHES SINGLE POLE SMITCH \$3 THREE-MAY SMITCH \$4 FOUR-MAY SMITCH ELECTRICAL DISCONNECT MISC FIXTURES EXHAUST FAN UNCTION BOX DINCTION BOX 220V CARBON MONOXIDE DETECTOR OR SMOKE CARBON MONOXIDE DETECTOR AND SMOKE DETECTOR ELECTRIC METER Elec Panel ELECTRICAL PANEL DOOR BELL CHIME DOOR BELL PUSH BUTTON CEILING FAN PREMIRE [8] FLUORESCENT LIGHT


General Power and Lighting:

General Power and Lighting Notes shall apply unless noted otherwise on plans.


All work shall be installed per the current NC Residential Building Code, and the National Electric Code. Alarm devices shall meet NFPA 72.

- Smoke Alarms Shall be provided as a minimum of (1) per floor, including basements (if applicable), (1) in each sleep room, and (1) outside each sleeping area, within the immediate vicinity of sleeping rooms. When more than one alarm is required, the alarm devices shall be interconnected in such a manner that the activation of one alarm will activate all of the alarms. Smoke alarms shall be hard wired to permanent power and shall have
- Switches For lighting, fans, etc. shall be installed at heights illustrated on this page and shall be located a minimum of 4 1/2" from door openings to allow for the proper installation of door casings. Switches, thermostats, security pads, and other similar devices shall be grouped together and installed thoughtfully for convenience of use and to avoid placement within centers of wall areas.

Note: This plan is a diagram showing approximate locations of convenience outlets based on requirements found in the NC Residential Code and N.E.C. Actual positions may vary from

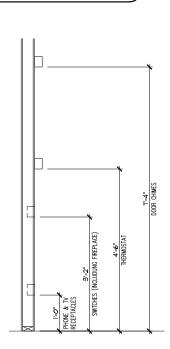

ELECTRICAL BOX HEIGHTS

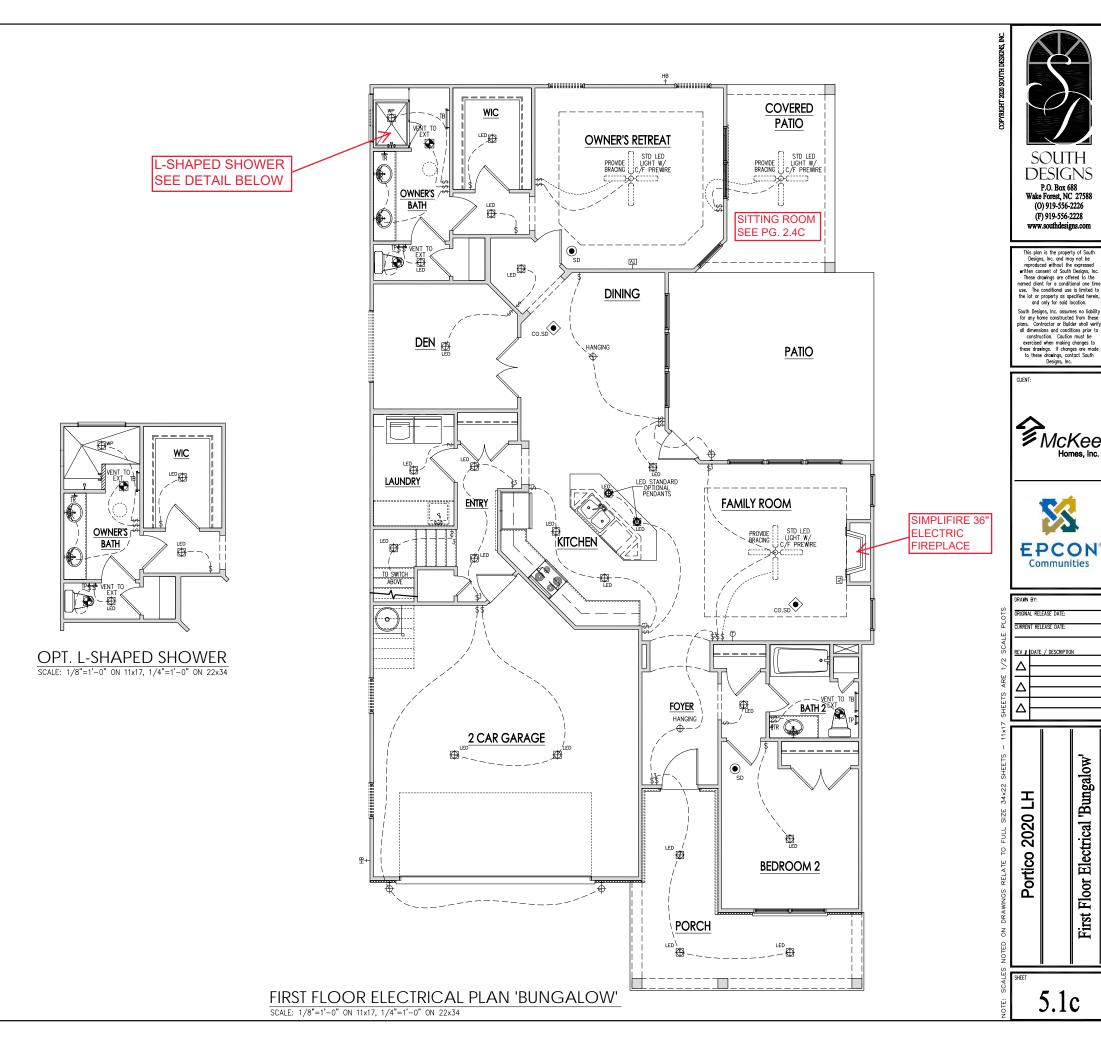

First Floor Electrical 'Bungalow'

ELECTRICAL SYMBOL KEY LIGHT FIXTURES CEILING SURFACE MOUNT LIGHT RECESSED CAN LIGHT LED PUCK LIGHT WP RECESSED CAN LIGHT WATERPROOF RECESSED CAN - EYEBALL PENDANT LIGHTING ₩ MALL SCONCE MALL MOUNT LIGHT FLOOD LIGHT OUTLETS DUPLEX OUTLET SFI OUTLET GFI-NP WATERPROOF GFI OUTLET SWITCHED 1/2 HOT DUPLEX OUTLET 220V OUTLET ✓ TELEPHONE OUTLET CATV (TELEVISION) OUTLET ⊕ = UNDER-COUNTER OR CONCEALED OUTLETS Ø CEILING MOUNTED DUP. OUTLET ØFLOOR FLOOR MOUNTED DUP. OUTLET SWITCHES \$ SINGLE POLE SMITCH \$3 THREE-MAY SMITCH \$4 FOUR-WAY SMITCH DISJ ELECTRICAL DISCONNECT MISC FIXTURES EXHAUST FAN UNCTION BOX Q_{220V} JUNCTION BOX 220V CARBON MONOXIDE DETECTOR OR SMOKE DETECTOR CO.SD DETECTOR AND SMOKE ELECTRIC METER ELECTRICAL PANEL DOOR BELL CHIME DOOR BELL PUSH BUTTON CEILING FAN PREMIRE FLUORESCENT LIGHT


General Power and Lighting:

General Power and Lighting Notes shall apply unless noted otherwise on plans.


All work shall be installed per the current NC Residential Building Code, and the National Electric Code. Alarm devices shall meet NFPA 72.

- Smoke Alarms Shall be provided as a minimum of (1) per floor, including basements (if applicable), (1) in each sleep room, and (1) outside each sleeping area, within the immediate vicinity of sleeping rooms. When more than one alarm is required, the alarm devices shall be interconnected in such a manner that the activation of one alarm will activate all of the alarms. Smoke alarms shall be hard wired to permanent power and shall have batter back-ups.
- Switches For lighting, fans, etc. shall be installed at heights illustrated on this page and shall be located a minimum of 4 1/2° from door openings to allow for the proper installation of door casings. Switches, thermostats, security pads, and other similar devices shall be grouped together and installed thoughtfully for convenience of use and to avoid placement within centers of wall areas.

Note: This plan is a diagram showing approximate locations of convenience outlets based on requirements found in the NC Residential Code and N.E.C. Actual positions may vary from

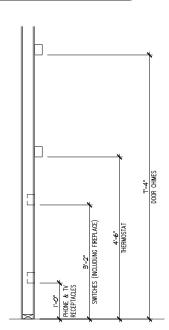

ELECTRICAL BOX HEIGHTS

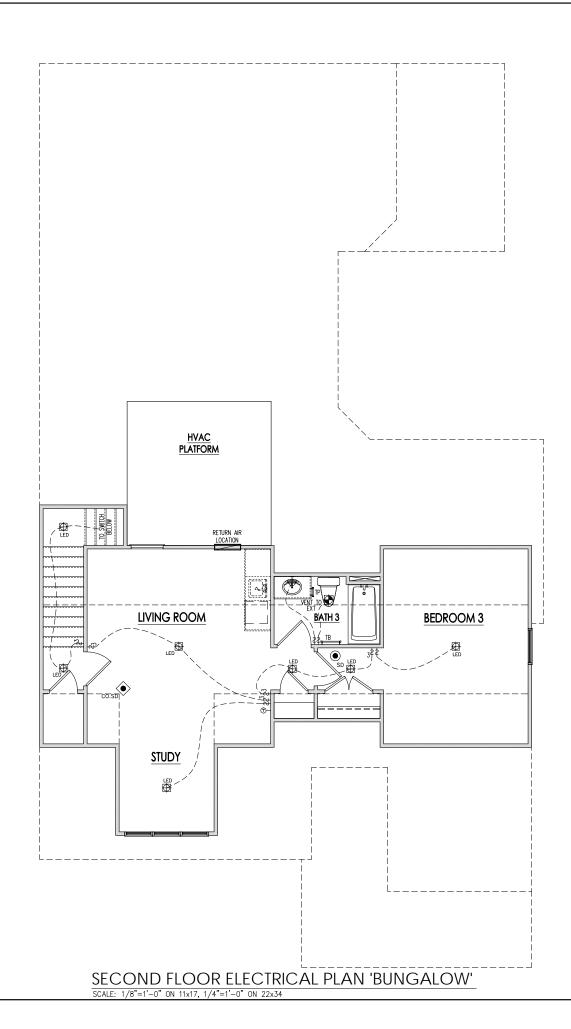



This plan is the property of South Designs, Inc. and may not be reproduced without the expressed written consent of South Designs, Inc. These drainings are offered to the named client for a conditional one Is limited to the lot or property as specified herein, and only for said location. South Designs, Inc. assumes no liability or any home constructed from these plans. Contractor or Builder shall verify all dimensions and conditions prior to construction. Caution must be exercised when making changes or emade to these drainings. If changes are made to these drainings, contact South Designs, Inc.

(O) 919-556-2226

(F) 919-556-2228


www.southdesigns.com






	DRAWN	BY:			
STS	ORIGINA	L REL	EASE DATE:		
7	CURREN	IT REL	EASE DATE:		
11x17 SHEETS ARE 1/2 SCALE PLOTS	REV #	I DATE	/ DESCRIP	TION	
/5	\ \ !		/ DEGGE		
₹ 1	_	L			
S A	Δ	\vdash			
EET					
R.	_				
1×1			1	I	
1					
SHEETS -	l				galow'
SHE	l				zal Zal
	ı		ı	ш	ربب

Second Floor Electrical 'Bun 2020 LH Portico

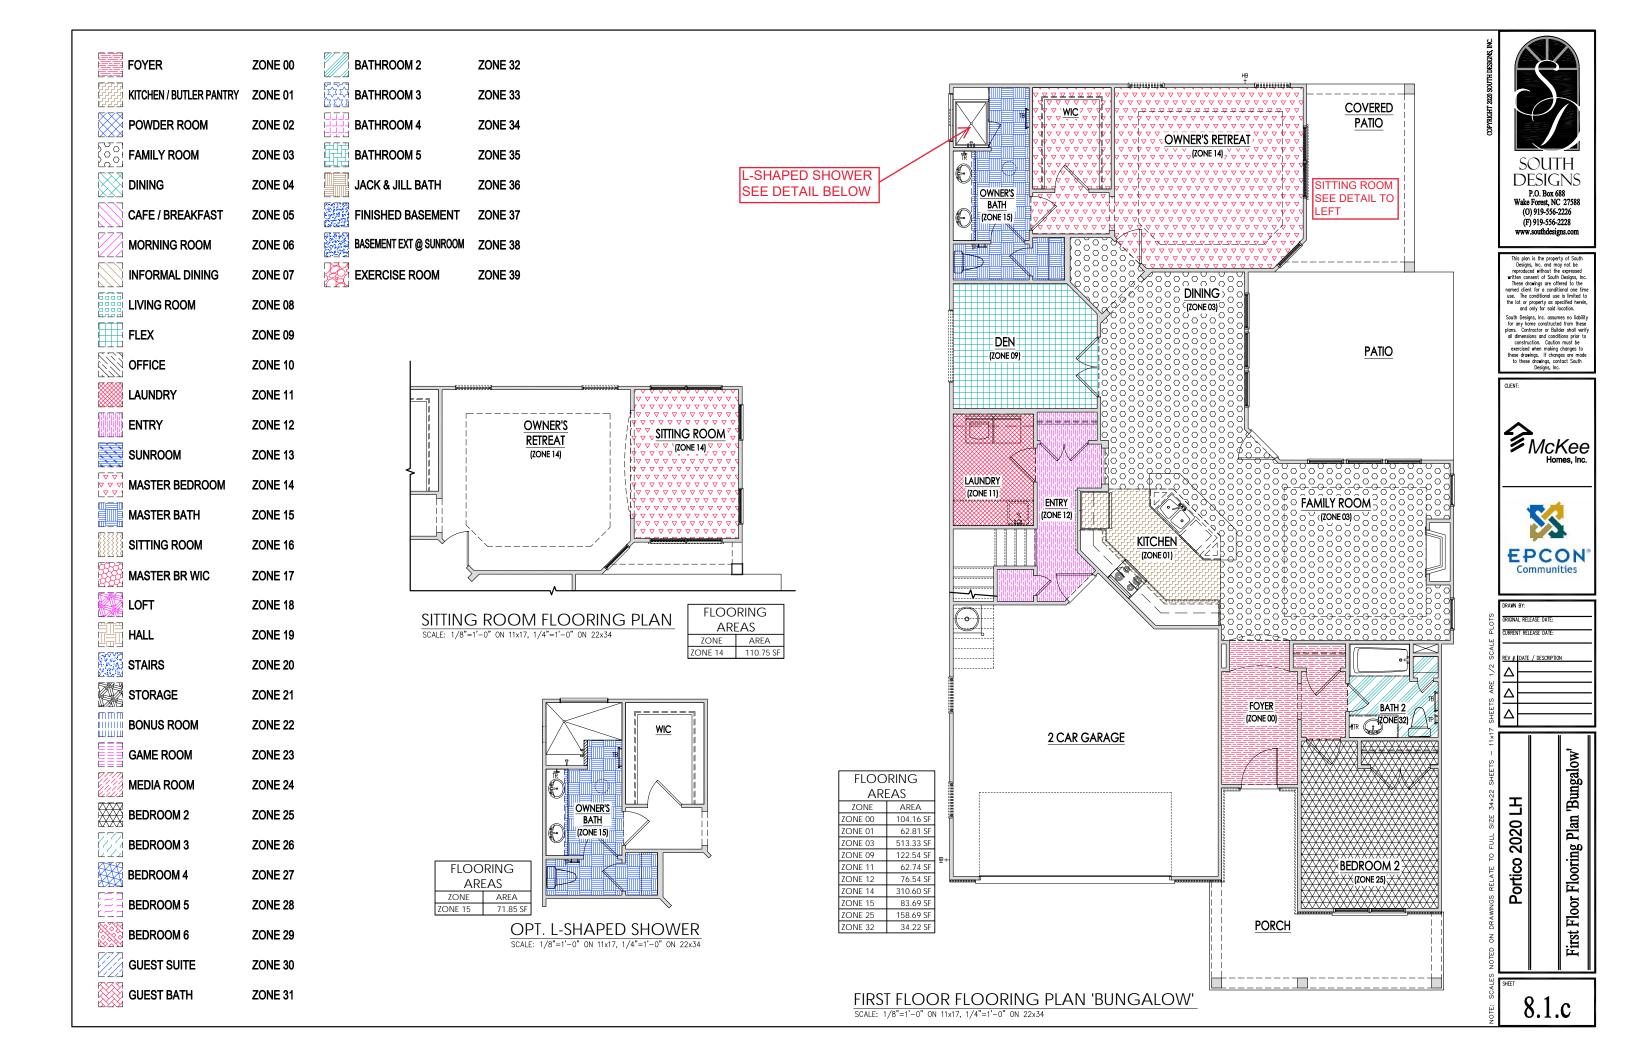



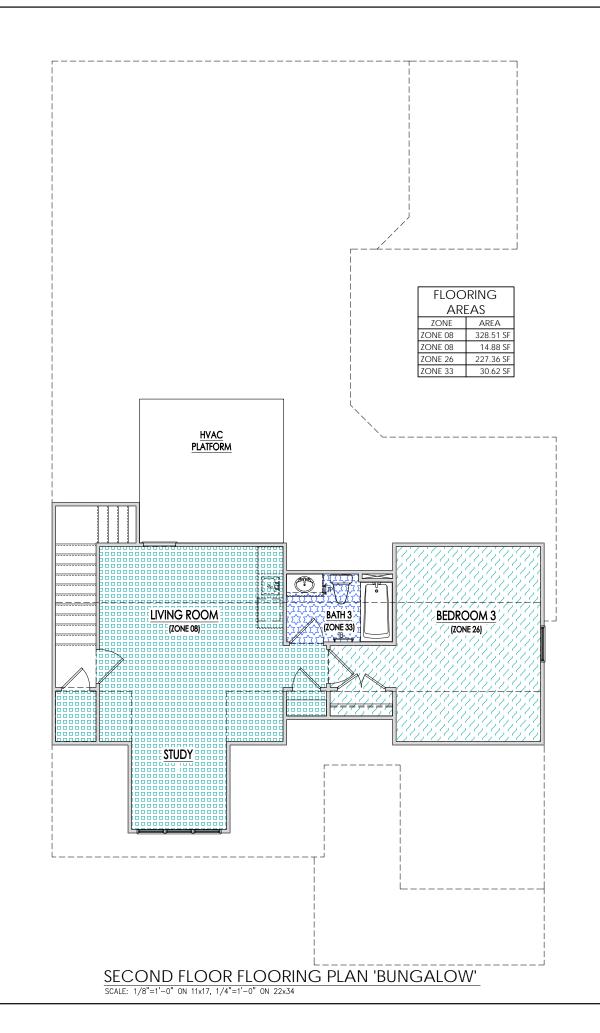



(O) 919-556-2226 (F) 919-556-2228 www.southdesigns.com

This plan is the property of South Designs, Inc. and may not be reproduced without the expressed written consent of South Designs, Inc. These drawings are offered to the named client for a conditional one time. The conditional use is limited to the lot or property as specified herein, and only for said location.

South Designs, Inc. assumes no liability or any home constructed from these plans. Contractor or Builder shall warf old dimensions and conditions prior to construction. Coulton must be exercised when making changes or these drawings. If changes are made to these drawings. If changes are made to these drawings, linc. South Designs, Inc.

McKee Inc.



	DRAWN BY:	_
OTS	ORIGINAL RELEASE DATE:	_
4	CURRENT RELEASE DATE:	_
11x17 SHEETS ARE 1/2 SCALE PLOTS	REV # DATE / DESCRIPTION	
1/2	Δ	_
ARE	_	_
ETS	4	_
SHE		-
7	·	_
1,		

Second Floor Flooring Plan 'Bungalo Portico 2020 LH

STRUCTURAL PLANS FOR:

PORTICO 2020 - LEFT HAND

INDEX OF SHEETS		REVISION		
SHEET	TITLE	DATE	REVISED BY	REVISION
Т	TITLE SHEET: PROJECT INFORMATION AND NOTES	11/12/2020	AWC	REVISED ALL MASONRY EXTENDED FOOTINGS
GN1.0	GENERAL NOTES			
GN1.1	GENERAL NOTES			
S0.1	SLAB FOUNDATION PLAN			
S0.9	CRAWLSPACE FOUNDATION PLAN			
S1.0	FIRST FLOOR CEILING FRAMING PLAN			
S2.0	SECOND FLOOR CEILING FRAMING PLAN			
S3.0	FIRST FLOOR WALL BRACING PLAN			
S4.0	ROOF FRAMING PLAN			
D1.0 - D9.0	DETAILS			

NOTES

- 1. ENGINEER'S SEAL APPLIES TO STRUCTURAL COMPONENTS ONLY. ENGINEER'S SEAL DOES NOT CERTIFY DIMENSIONAL ACCURACY OR ARCHITECTURAL LAYOUT, INCLUDING ROOF GEOMETRY. JDSfaulkner, PLLC ASSUMES NO LIABILITY FOR CHANGES MADE TO THESE PLANS BY OTHERS, OR FOR CONSTRUCTION METHODS, OR FOR ANY DEVIATION FROM THE PLANS. ENGINEER TO BE NOTIFIED PRIOR TO CONSTRUCTION IF ANY DISCREPANCIES ARE NOTED ON THE PI ANS
- 2. DIMENSIONS SHALL GOVERN OVER SCALE, AND CODE SHALL GOVERN OVER DIMENSIONS.
- 3. PLANS MUST HAVE SIGNED SEAL TO BE VALID AND ARE LIMITED TO THE FOLLOWING USES:
 - A. IF THESE PLANS ARE ISSUED AS A MASTER-PLAN SET, THE SET IS VALID FOR 18 MONTHS FROM THE DATE ON THE SEAL, UNLESS ANY CODE-REQUIRED UPDATES ARE PLACED IN EFFECT BY THE MUNICIPALITY.
 - B. IF THESE PLANS ARE NOT ISSUED AS A MASTER-PLAN SET, THE SET IS VALID FOR A CONDITIONAL, ONE-TIME USE FOR THE LOT OR ADDRESS SPECIFIED ON THE TITLE BLOCK

CODE

ALL CONSTRUCTION, WORKMANSHIP, AND MATERIAL QUALITY AND SELECTION SHALL BE PER:

2018 NORTH CAROLINA STATE BUILDING CODE: RESIDENTIAL CODE

ENGINEER OF RECORD

JDSfaulkner, PLLC
ENGINEERING, BUILDING DESIGN, & CONSTRUCTION
CONSULTING SERVICES
8600 'D' JERSEY COURT
RALEIGH, NC 27617
FIRM LIC. NO: P-0961
PROJECT REFERENCE: 20902057



P-0961



T HAND

» ORTH CAROLINA

DIECT NO.: 20902057

TE: DRAWN BY: AWC

11/16/2020

TITLE SHEET

T

NOTE: ALL CHAPTERS, SECTIONS, TABLES, AND FIGURES CITED WITHOUT A PUBLICATION TITLE ARE FROM THE APPLICABLE RESIDENTIAL CODE (SEE TITLE SHEET).

GENERAL

- IT IS THE CONTRACTOR'S RESPONSIBILITY TO VERIFY ALL DIMENSIONS PRIOR TO CONSTRUCTION. FURTHERMORE, CONTRACTOR IS ULTIMATELY RESPONSIBLE FOR CONSTRUCTION MEANS, METHODS, AND SAFETY ON SITE. NOTIFY JDSfaulkner, PLLC IMMEDIATELY IF DISCREPANCIES ON PLAN EXIST.
- 2. BRACED-WALL DESIGN IS BASED ON SECTION R602.10 WALL BRACING. PRIMARY PRESCRIPTIVE METHOD TO BE CS-WSP. SEE WALL BRACING PLANS AND DETAILS FOR ADDITIONAL INFORMATION.
 - ALL NON-PRESCRIPTIVE SOLUTIONS ARE BASED ON GUIDELINES ESTABLISHED IN THE AMERICAN SOCIETY OF CIVIL ENGINEERS PUBLICATION ASCE 7 AND THE NATIONAL DESIGN SPECIFICATION FOR WOOD CONSTRUCTION SPECIAL DESIGN PROVISIONS FOR WIND AND SEISMIC.
- 3. SEISMIC DESIGN SHALL BE PER SECTION R301.2.2 SEISMIC PROVISIONS, INCLUDING ASSOCIATED TABLES AND FIGURES, BASED ON LOCAL SEISMIC DESIGN CATEGORY.

DESIGN LOADS

ASSUMED SOIL BEARING-CAPACITY 2.000 PSF

	LIVE LOAD
ULTIMATE DESIGN WIND SPEED	115 MPH, EXPOSURE B
GROUND SNOW	15 PSF
ROOF	20 PSF
RESIDENTIAL CODE TABLE R301.5	LIVE LOAD (PSF)
DWELLING UNITS	40
SLEEPING ROOMS	30
ATTICS WITH STORAGE	20
ATTICS WITHOUT STORAGE	10
STAIRS	40
DECKS	40
EXTERIOR BALCONIES	60
PASSENGER VEHICLE GARAGES	50
FIRE ESCAPES	40
GUARDS AND HANDRAILS	200 (pounds, concentrated

COMPONENT AND CLADDING LOADS, INCLUDING THOSE FOR DOORS AND WINDOWS, SHALL BE DERIVED FROM TABLES R301.2(2) AND R301.2(3) FOR A BUILDING WITH A MEAN ROOF HEIGHT OF 35 FEET, LOCATED IN FXPOSURE B.

	ABBR	EVIATIONS	KS	KING STUD COLUMN
<u></u>		EVIATIONS	LVL	LAMINATED VENEER
	ABV	ABOVE		LUMBER
		ABOVE FINISHED FLOOR	MAX	MAXIMUM
		ALTERNATE	MECH	MECHANICAL
		BEARING	MFTR	MANUFACTURER
		BASEMENT	MIN	MINIMUM
		CANTILEVER	NTS	NOT TO SCALE
	CJ	CEILING JOIST	OA	OVERALL
	CLG	CEILING	ос	ON CENTER
	CMU	CONCRETE MASONRY UNIT	PT	PRESSURE TREATED
	CO	CASED OPENING	R	RISER
	COL	COLUMN	REF	REFRIGERATOR
	CONC	CONCRETE	RFG	ROOFING
		CONTINUOUS	RO	ROUGH OPENING
	D	CLOTHES DRYER	RS	ROOF SUPPORT
	DBL	DOUBLE	SC	STUD COLUMN
	DIAM	DIAMETER	SF	SQUARE FOOT (FEET)
	DJ	DOUBLE JOIST	SH	SHELF / SHELVES
	DN	DOWN	SHTG	SHEATHING
	DP	DEEP	SHW	SHOWER
	DR	DOUBLE RAFTER	SIM	SIMILAR
	DSP	DOUBLE STUD POCKET	SJ	
	EA	EACH	SP	
	EE	EACH END		SPECIFIED
	EQ	EQUAL	SQ	SQUARE
	EX	EXTERIOR	T	TREAD
	FAU	FORCED-AIR UNIT	TEMP	TEMPERED GLASS
	FDN	FOUNDATION	THK	THICK(NESS)
	FF	FINISHED FLOOR	TJ	TRIPLE JOIST
	FLR	FLOOR(ING)	TOC	TOP OF CURB / CONCRETE
	FP	FIREPLACE	TR	TRIPLE RAFTER
	FTG	FOOTING	TYP	TYPICAL
	HB	HOSE BIBB	UNO	UNLESS NOTED OTHERWIS
	HDR	HEADER	W	CLOTHES WASHER
	HGR	HANGER	WH	WATER HEATER
	JS	JACK STUD COLUMN		WELDED WIRE FABRIC
			ΧJ	EXTRA JOIST

MATERIALS

 INTERIOR / TRIMMED FRAMING LUMBER SHALL BE #2 SPRUCE PINE FIR (SPF) WITH THE FOLLOWING DESIGN PROPERTIES (#2 SOUTHERN YELLOW PINE MAY BE SUBSTITUTED):

Fb = 875 PSI Fv = 70 PSI E = 1.4E6 PSI

 FRAMING LUMBER EXPOSED TO WEATHER OR IN CONTACT WITH THE GROUND, CONCRETE, OR MASONRY SHALL BE PRESSURE TREATED #2 SOUTHERN YELLOW PINE (SYP) WITH THE FOLLOWING DESIGN PROPERTIES:

Fb = 975 PSI Fv = 95 PSI E = 1.6E6 PSI

3. LVL STRUCTURAL MEMBERS TO BE LAMINATED VENEER LUMBER WITH THE FOLLOWING MINIMUM DESIGN PROPERTIES:

Fb = 2600 PSI Fv = 285 PSI E = 1.9E6 PSI

4. PSL STRUCTURAL MEMBERS TO BE PARALLEL STRAND LUMBER WITH THE FOLLOWING MINIMUM DESIGN PROPERTIES:

5. LSL STRUCTURAL MEMBERS TO BE LAMINATED STRAND LUMBER WITH THE FOLLOWING MINIMUM DESIGN PROPERTIES:

Fb = 2250 PSI Fv = 400 PSI E = 1.55E6 PSI

- STRUCTURAL STEEL WIDE-FLANGE BEAMS SHALL CONFORM TO ASTM A992. Fy = 50 KSI
- REBAR SHALL BE DEFORMED STEEL CONFORMING TO ASTM A615, GRADE 60.
- POURED CONCRETE COMPRESSIVE STRENGTH TO BE A MINIMUM 3,000 PSI AT 28 DAYS. MATERIALS USED TO PRODUCE CONCRETE SHALL COMPLY WITH THE APPLICABLE STANDARDS LISTED IN AMERICAN CONCRETE INSTITUTE STANDARD ACI 318 OR ASTM C1157
- CONCRETE SUBJECT TO MODERATE OR SEVERE WEATHERING PROBABILITY PER TABLE R301.2(1) SHALL BE AIR-ENTRAINED WHEN REQUIRED BY TABLE R402.2.
- 10. CONCRETE MASONRY UNITS (CMU) SHALL CONFORM TO AMERICAN CONCRETE INSTITUTE PUBLICATION 530: BUILDING CODE REQUIREMENTS AND SPECIFICATIONS FOR MASONRY STRUCTURES AND COMPANION COMMENTARIES AND THE MASONRY SOCIETY PUBLICATION TMS 402/602: BUILDING CODE REQUIREMENTS AND SPECIFICATIONS FOR MASONRY STRUCTURES.
- 11. MORTAR SHALL COMPLY WITH ASTM INTERNATIONAL STANDARD C270
- INDICATED MODEL NUMBERS FOR ALL METAL HANGERS, STRAPS, FRAMING CONNECTORS, AND HOLD-DOWNS ARE SIMPSON STRONG-TIE BRAND. EQUIVALENT USP BRAND PRODUCTS ARE ACCEPTABLE.
- 13. REFER TO I-JOIST EQUIVALENCE CHART ON I-JOIST DETAIL SHEET FOR SUBSTITUTION OF MANUFACTURER SERIES.

FOUNDATION

- MINIMUM ALLOWABLE SOIL BEARING CAPACITY IS ASSUMED TO BE 2,000 PSF. IT IS THE CONTRACTOR'S RESPONSIBILITY TO VERIFY SOIL BEARING CAPACITY IF UNSATISFACTORY CONDITIONS FXIST
- 2. CONCRETE FOUNDATION WALLS TO BE SELECTED AND CONSTRUCTED PER SECTION R404 OR AMERICAN CONCRETE INSTITUTE STANDARD ACI 318.
- 3. MASONRY FOUNDATION WALLS TO BE SELECTED AND CONSTRUCTED PER SECTION R404 AND/OR AMERICAN CONCRETE INSTITUTE PUBLICATION 530: BUILDING CODE REQUIREMENTS AND SPECIFICATIONS FOR MASONRY STRUCTURES AND COMPANION COMMENTARIES AND/OR THE MASONRY SOCIETY PUBLICATION TMS 402/602: BUILDING CODE REQUIREMENTS AND SPECIFICATIONS FOR MASONRY STRUCTURES.
- 4. CONCRETE WALL HORIZONTAL REINFORCEMENT TO BE PER TABLE R404.1.2(1) OR AS NOTED OR DETAILED. CONCRETE WALL VERTICAL REINFORCEMENT TO BE PER TABLES R404.1.2(3 AND 4) OR AS NOTED OR DETAILED. ALL CONCRETE WALLS SHALL COMPLY WITH APPLICABLE PROVISIONS OF CHAPTER 6.
 - A. TABLES ASSUME THAT WALLS HAVE PERMANENT LATERAL SUPPORT AT THE TOP AND BOTTOM.
 - B. FOUNDATION DRAINS ARE ASSUMED AT ALL WALLS PER SECTION R405.
- 5. PLAIN-MASONRY WALL DESIGN TO BE PER TABLE R404.1.1(1) OR AS NOTED OR DETAILED. MASONRY WALLS WITH VERTICAL REINFORCEMENT TO BE PER TABLES R404.1.1 (2 THROUGH 4) OR AS NOTED OR DETAILED. ALL MASONRY WALLS SHALL COMPLY WITH APPLICABLE PROVISIONS OF CHAPTER 6.
 - A. TABLES ASSUME THAT WALLS HAVE PERMANENT LATERAL SUPPORT AT THE TOP AND BOTTOM.
 - B. WALL REINFORCING SHALL BE PLACED ACCORDING TO FOOTNOTE (c) OF THE TABLES (REINFORCING IS NOT CENTERED IN WALL).
 - C. FOUNDATION DRAINS ARE ASSUMED AT ALL WALLS PER SECTION R405.
- 6. WOOD SILL PLATES TO BE ANCHORED TO THE FOUNDATION WITH 1/2" DIAMETER ANCHOR BOLTS WITH MINIMUM 7" EMBEDMENT, SPACED A MAXIMUM OF 6'-0" OC AND WITHIN 12" FROM THE ENDS OF EACH PLATE SECTION. INSTALL MINIMUM (2) ANCHOR BOLTS PER SECTION. SEE <u>SECTION R403.1.6</u> FOR SPECIFIC CONDITIONS.
- 7. THE UNSUPPORTED HEIGHT OF SOLID MASONRY PIERS SHALL NOT EXCEED TEN TIMES THEIR LEAST DIMENSION. UNFILLED, HOLLOW PIERS MAY BE USED IF THE UNSUPPORTED HEIGHT IS NOT MORE THAN FOUR TIMES THEIR LEAST DIMENSION.
- 8. CENTERS OF PIERS TO BEAR IN THE MIDDLE THIRD OF THE FOOTINGS, AND GIRDERS SHALL CENTER IN THE MIDDLE THIRD OF THE PIERS.
- 9. ALL FOOTINGS TO HAVE MINIMUM 2" PROJECTION ON EACH SIDE OF FOUNDATION WALLS (SEE DETAILS).
- 10. ALL REBAR NOTED IN CONCRETE TO HAVE AT LEAST 2" COVER FROM EDGE OF CONCRETE TO EDGE OF REBAR.
- 11. FRAMING TO BE FLUSH WITH FOUNDATION WALLS.
- 12. WITH CLASS 1 SOILS, VAPOR BARRIER AND CRUSHED STONE MAY BE OMITTED.

FRAMING

- ALL BEARING HEADERS TO BE (2) 2x6 SUPPORTED W/ MIN (1) JACK STUD AND (1) KING STUD EACH END, UNO.
- 2. ALL NON-BEARING HEADERS TO BE (2) 2x4, UNO.
- NON-BEARING INTERIOR WALLS NOT MORE THAN 10' NOMINAL HEIGHT AND NOT SHOWN AS BRACED WALLS MAY BE FRAMED WITH 2x4 STUDS @ 24" OC.
- 4. SOLID BLOCKING TO BE PROVIDED AT ALL POINT LOADS THROUGH FLOOR LEVELS TO THE FOUNDATION OR TO OTHER STRUCTURAL COMPONENTS.
- ALL BEAMS SPECIFIED ARE MINIMUM SIZES ONLY. LARGER MEMBERS MAY SUBSTITUTED AS NEEDED FOR EASE OF CONSTRUCTION.
- 6. ALL EXTERIOR WALLS TO BE FULLY SHEATHED WITH 7/16" OSB.
- PORCH / PATIO COLUMNS TO BE 4x4 MINIMUM PRESSURE-TREATED LUMBER.
- A. ATTACH PORCH COLUMNS TO SLAB / FDN WALL USING ABA, ABU, ABW, OR CPT SIMPSON POST BASES TO FIT COLUMN SIZES NOTED ON PLAN -OR- ANY OTHER COLUMN CONNECTION WITH 500# UPLIFT CAPACITY.
- B. ATTACH PORCH COLUMNS TO PORCH BEAMS USING AC OR BC SIMPSON POST CAPS TO FIT COLUMN SIZES NOTED ON PLAN -OR- ANY OTHER COLUMN CONNECTION WITH 500# UPLIFT CAPACITY.
- C. TRIM OUT COLUMN(S) AND BEAM(S) PER BUILDER AND DETAILS.
- ALL ENGINEERED WOOD PRODUCTS (LVL, PSL, LSL, ETC.) SHALL BE INSTALLED WITH CONNECTIONS PER MANUFACTURER SPECIFICATIONS.
- ENGINEERED WOOD FLOOR SYSTEMS AND ROOF TRUSS SYSTEMS:
 A. SHOP DRAWINGS FOR THE SYSTEMS SHALL BE PROVIDED TO THE ENGINEER OF RECORD FOR REVIEW AND COORDINATION BEFORE CONSTRUCTION.
 - B. TRUSS PROFILES SHALL BE SEALED BY THE TRUSS MANUFACTURER.
 - C. INSTALLATION OF THE SYSTEMS SHALL BE PER MANUFACTURER'S INSTRUCTIONS.
 - D. TRUSS LAYOUT AND PLACEMENT BY MANUFACTURER TO COINCIDE WITH THE SUPPORT LOCATIONS SHOWN IN THESE DRAWINGS.
- 10. ALL BEAMS TO BE CONTINUOUSLY SUPPORTED LATERALLY AND SHALL BEAR FULL WIDTH ON THE SUPPORTING WALLS OR COLUMNS INDICATED, WITH A MINIMUM OF THREE STUDS, UNO.
- 11. ALL STEEL BEAMS TO BE SUPPORTED AT EACH END WITH A MIN BEARING LENGTH OF 3 1/2" AND FULL FLANGE WIDTH. BEAMS MUST BE ATTACHED AT EACH END WITH A MINIMUM OF FOUR 16d NAILS OR TWO 1/2" x 4" LAG SCREWS, UNO.
- 12. STEEL FLITCH BEAMS TO BE BOLTED TOGETHER USING (2) ROWS OF 1/2" DIAMETER BOLTS (ASTM 307) WITH WASHERS PLACED UNDER THE THREADED END OF THE BOLT. BOLTS TO BE SPACED AT 24" OC (MAX) AND STAGGERED TOP AND BOTTOM OF BEAM (2" EDGE DISTANCE), WITH TWO BOLTS TO BE LOCATED AT 6" FROM EACH END OF FLITCH BEAM.
- 13. WHEN A 4-PLY LVL BEAM IS USED, ATTACH WITH (1) 1/2" DIAMETER BOLT, 12" OC, STAGGERED TOP AND BOTTOM, 1 1/2" MIN FROM ENDS. ALTERNATE EQUIVALENT ATTACHMENT METHOD MAY BE USED, SUCH AS SDS, SDW, OR TRUSSLOK SCREWS (SEE MANUFACTURER SPECIFICATIONS).
- 14. FOR STUD COLUMNS OF 4-OR-MORE STUDS, INSTALL SIMPSON STRONG-TIE CS16 STRAPS ACROSS STUDS @ 30" OC, 6" MAX FROM PLATES, ON INSIDE FACE OF COLUMN (EXTERIOR WALL), ON BOTH FACES OF COLUMN (INTERIOR WALL).
- 15. FLOOR JOISTS ADJACENT AND PARALLEL TO THE EXTERIOR FOUNDATION WALL SHALL BE PROVIDED WITH FULL-DEPTH SOLID BLOCKING, NOT LESS THAN TWO (2) INCHES NOMINAL IN THICKNESS, PLACED PERPENDICULAR TO THE JOIST AT SPACING NOT MORE THAN FOUR (4) FEET. THE BLOCKING SHALL BE NAILED TO THE FLOOR SHEATHING, THE SILL PLATE, THE JOIST, AND THE EXTERIOR RIM JOIST / BOARD.
- 16. BRACED WALL PANELS SHALL BE FASTENED TO MEET THE UPLIFT-RESISTANCE REQUIREMENTS IN CHAPTERS 6 AND 8 OF THE APPLICABLE CODE (SEE TITLE SHEET). REQUIREMENTS OF THE STRUCTURAL DRAWINGS THAT EXCEED THE CODE MINIMUM SHALL BE MET.



P-0961

JINEGETING + GESIGN + CONSULIN, 88000 'D JERSEY CT, RALEIGH, NC 27617 919-480.1075 s.JDSfalkner, COM.

OT LIABLE FOR CHANGES MADE TO PLANS DUI GOT LIABLE FOR CHANGES MADE TO PLANS MADE BY OTHERS. DRAWINGS AT PROVISED TO CLIENT PRYONES ARE PROVISED TO CLIENT OPERITY, OR AS A MASTER PLAN AS SPECHEDO DY TO PRESS.

R AS NOTED

HAND

- LEFT

PORTICO 2020

CAROLINA

NORTH CA

AWC

o.: 20902057

2090205

DATE: 11/16/2020

HOMES

MCKEE

GENERAL NOTES

GN1.0

FASTENER SCHEDULE				
CONNECTION	3" x 0.131" NAIL	3" x 0.120" NAIL		
JOIST TO SILL PLATE	(4) TOE NAILS	(4) TOE NAILS		
SOLE PLATE TO JOIST / BLOCKING	NAILS @ 8" OC (typical) (4) PER 16" SPACE (at braced panels)	NAILS @ 8" OC (typical) (4) PER 16" SPACE (at braced panels)		
STUD TO SOLE PLATE	(4) TOE NAILS	(4) TOE NAILS		
TOP OR SOLE PLATE TO STUD	(3) FACE NAILS	(4) FACE NAILS		
RIM JOIST OR BAND JOIST TO TOP PLATE OR SILL PLATE	TOE NAILS @ 6" OC	TOE NAILS @ 4" OC		
BLOCKING BETWEEN JOISTS TO TOP PLATE OR SILL PLATE	(4) TOE NAILS	(4) TOE NAILS		
DOUBLE STUD	NAILS @ 8" OC	NAILS @ 8" OC		
DOUBLE TOP PLATES	NAILS @ 12" OC	NAILS @ 12" OC		
DOUBLE TOP PLATES LAP (24" MIN LAP LENGTH)	(12) NAILS IN LAPPED AREA, EA SIDE OF JOINT	(12) NAILS IN LAPPED AREA, EA SIDE OF JOINT		
TOP PLATE LAP AT CORNERS AND INTERSECTING WALLS	(3) FACE NAILS	(3) FACE NAILS		
OPEN-WEB TRUSS BOTTOM CHORD TO TOP PLATES OR SILL PLATE (PARALLEL TO WALL)	NAILS @ 6" OC	NAILS @ 4" OC		
BOTTOM CHORD OF TRUSS TO TOP PLATES OR SILL PLATE (PERPENDICULAR TO WALL)	(3) TOE NAILS	(3) TOE NAILS		

SEE TABLE R602.3(1) FOR ADDITIONAL STRUCTURAL-MEMBER

DETAILS AND NOTES ON DRAWINGS GOVERN.

BALLOON WALL FRAMING SCHEDULE (USE THESE STANDARDS UNLESS NOTED OTHERWISE ON THE FRAMING PLAN SHEETS)

	•
FRAMING MEMBER SIZE	MAX HEIGHT (PLATE TO PLATE) 115 MPH ULTIMATE DESIGN WIND SPEED
2x4 @ 16" OC	10'-0"
2x4 @ 12" OC	12'-0"
2x6 @ 16" OC	15'-0"
2x6 @ 12" OC	17'-9"
2x8 @ 16" OC	19'-0"
2x8 @ 12" OC	22'-0"
(2) 2x4 @ 16" OC	14'-6"
(2) 2x4 @ 12" OC	17'-0"
(2) 2x6 @ 16" OC	21'-6"
(2) 2x6 @ 12" OC	25'-0"
(2) 2x8 @ 16" OC	27'-0"
(2) 2x8 @ 12" OC	31'-0"

- a. ALL HEIGHTS ARE MEASURED SUBFLOOR TO TOP OF WALL PLATE.
- b. WHEN SPLIT-FRAMED WALLS ARE USED FOR HEIGHTS OVER 12', THE CONTRACTOR SHALL ADD 6' MINIMUM OF CS16 COIL STRAPPING (FULLY NAILED), CENTERED OVER THE WALL BREAK.
- c. FINGER-JOINTED MEMBERS MAY BE USED FOR CONTINUOUS HEIGHTS WHERE TRADITIONALLY MILLED LUMBER LENGTHS ARE
- d. FOR GREATER WIND SPEED, SEE ENGINEERED SOLUTION FOR CONDITION IN DRAWINGS.

ROOF SYSTEMS

TRUSSED ROOF - STRUCTURAL NOTES

- 1. PROVIDE CONTINUOUS BLOCKING THROUGH STRUCTURE FOR ALL POINT LOADS.

DENOTES OVER-FRAMED AREA

- 3. MINIMUM 7/16" OSB ROOF SHEATHING
- TRUSS LAYOUT AND PLACEMENT BY MANUFACTURER TO COINCIDE WITH THE SUPPORT LOCATIONS SHOWN. TRUSS PROFILES SHALL BE SEALED BY THE TRUSS MANUFACTURER. TRUSS PLANS TO BE COORDINATED WITH THE SEALED STRUCTURAL DRAWINGS. INSTALLATION SHALL BE IN ACCORDANCE WITH THE MANUFACTURER'S INSTRUCTIONS.
- MANUFACTURER TO PROVIDE REQUIRED UPLIFT CONNECTION.
- PROVIDE H2.5A (MINIMUM) OR EQUIVALENT AT EACH TRUSS-TO-TOP PLATE CONNECTION AT OVER-FRAMED AREAS, UNLESS NOTED OTHERWISE.
- 7. UPLIFT CONNECTION TO BE CARRIED THROUGH TO FLOOR SYSTEM.

STICK-FRAMED ROOF - STRUCTURAL NOTES

- PROVIDE 2x4 COLLAR TIES AT 48" OC AT UPPER THIRD OF RAFTERS. UNLESS NOTED OTHERWISE.
- 2. FUR RIDGES FOR FULL RAFTER CONTACT.
- 3. PROVIDE CONTINUOUS BLOCKING THROUGH STRUCTURE FOR ALL POINT LOADS.



DENOTES OVER-FRAMED AREA

- 5. MINIMUM 7/16" OSB ROOF SHEATHING
- 6. PROVIDE 2x4 RAFTER TIES AT 16" OC AT 45° BETWEEN RAFTERS AND CEILING JOISTS. USE (4) 16d NAILS AT EACH CONNECTION. RAFTER TIES MAY BE SPACED AT 48" OC AT LOCATIONS WHERE NO KNEE WALLS ARE INSTALLED.
- PROVIDE H2.5A (MINIMUM) OR EQUIVALENT AT EACH RAFTER-TO-TOP PLATE CONNECTION AT OVER-FRAMED AREAS, UNLESS NOTED OTHERWISE.
- 8. UPLIFT CONNECTION TO BE CARRIED THROUGH TO FLOOR

BRICK VENEER LINTEL SCHEDULE				
SPAN	STEEL ANGLE SIZE	END BEARING LENGTH		
UP TO 42"	L3-1/2"x3-1/2"x1/4"	8" (MIN. @ EACH END)		
UP TO 72"	L6"x4"x5/16"* (LLV)	8" (MIN. @ EACH END)		
OVER 72"	L6"x4"x5/16"* (LLV) ATTACH LINTEL w/ 1/2" THRU BOLT @ 12" OC, 3" FROM EACH END			

* FOR QUEEN BRICK: LINTELS AT THIS CONDITION MAY BE 5"x3-1/2"x5/16"

NOTE: BRICK LINTELS AT SLOPED AREAS TO BE 4"x3-1/2"x1/4" STEEL ANGLE WITH 16D NAILS IN 3/16" HOLES IN 4" ANGLE LEG AT 12" OC TO TRIPLE RAFTER. WHEN THE SLOPE EXCEEDS 4:12 A MINIMUM OF 3"x3"x1/4" PLATES SHALL BE WELDED AT 24" OC ALONG THE STEEL ANGLE.





CAROLIN

HAND

- LEFT

PORTICO 2020


20902057


11/16/2020

MCKEE HOMES

GENERAL NOTES

AWC

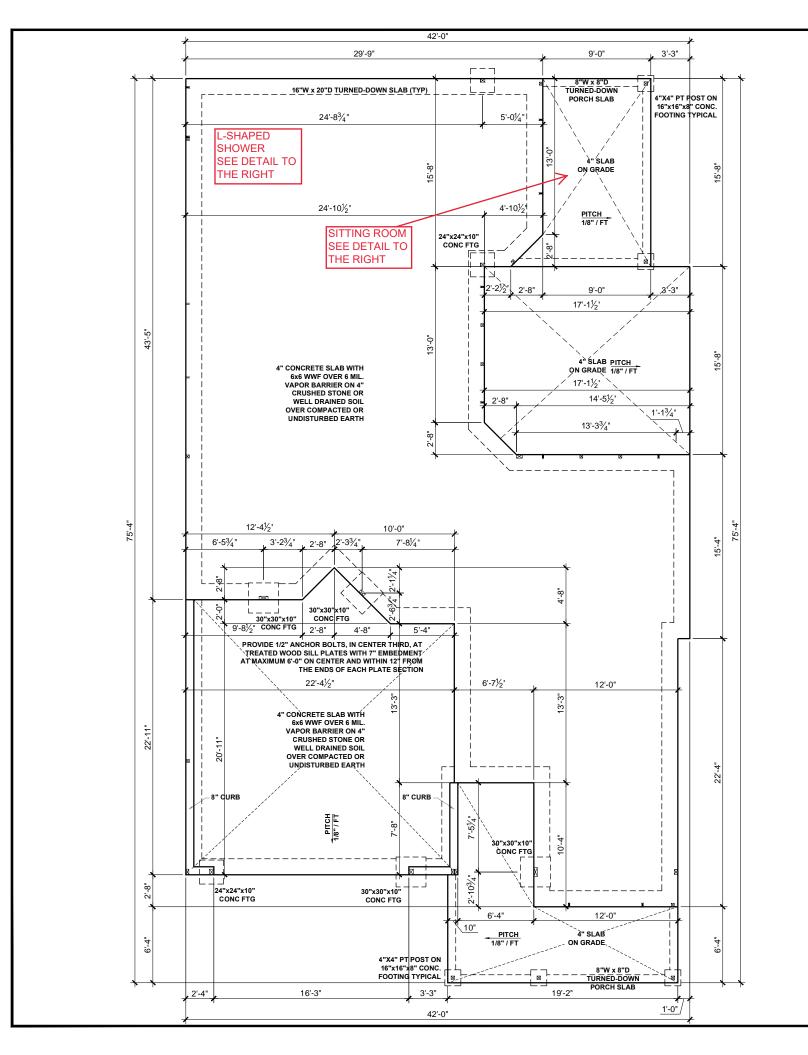

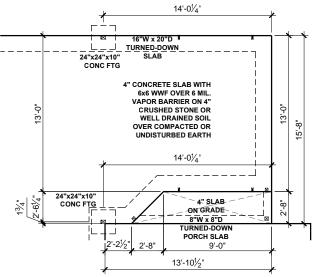


INTERIOR LOAD BEARING WALL **BEARING ON BEAM / GIRDER**

FOR WIND ZONES OF 120 MPH AND 130 MPH


(3) #4 OR (2) #5 REBAR @ 3" ABOVE THE BOTTOM OF THE FTG. THE BARS SHALL BE CONT. OR LAPPED 25" @ ALL SPLICES. (TYP)

FOR WIND ZONES OF 120 MPH or ABOVE
.USE.
1/2" ANCHOR BOLT AT 72" O.C. REFER TO R4504.2 FOR
ADDITIONAL REQUIREMENTS AND SPACING

SITTING ROOM OPT



OPT L-SHAPED SHOWER

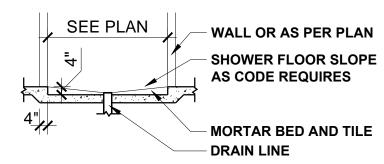

TYPICAL RECESSED **SHOWER FLOOR IN SLAB FOUNDATION**

REFER TO PLAN FOR ADDITIONAL INFORMATION

SLAB FOUNDATION PLAN - BUNGALOW

SCALE: 1/8" = 1'-0"




P-0961




HAND - LEFT PORTICO 2020

20902057 **AWC** 11/16/2020

FOUNDATION PLAN

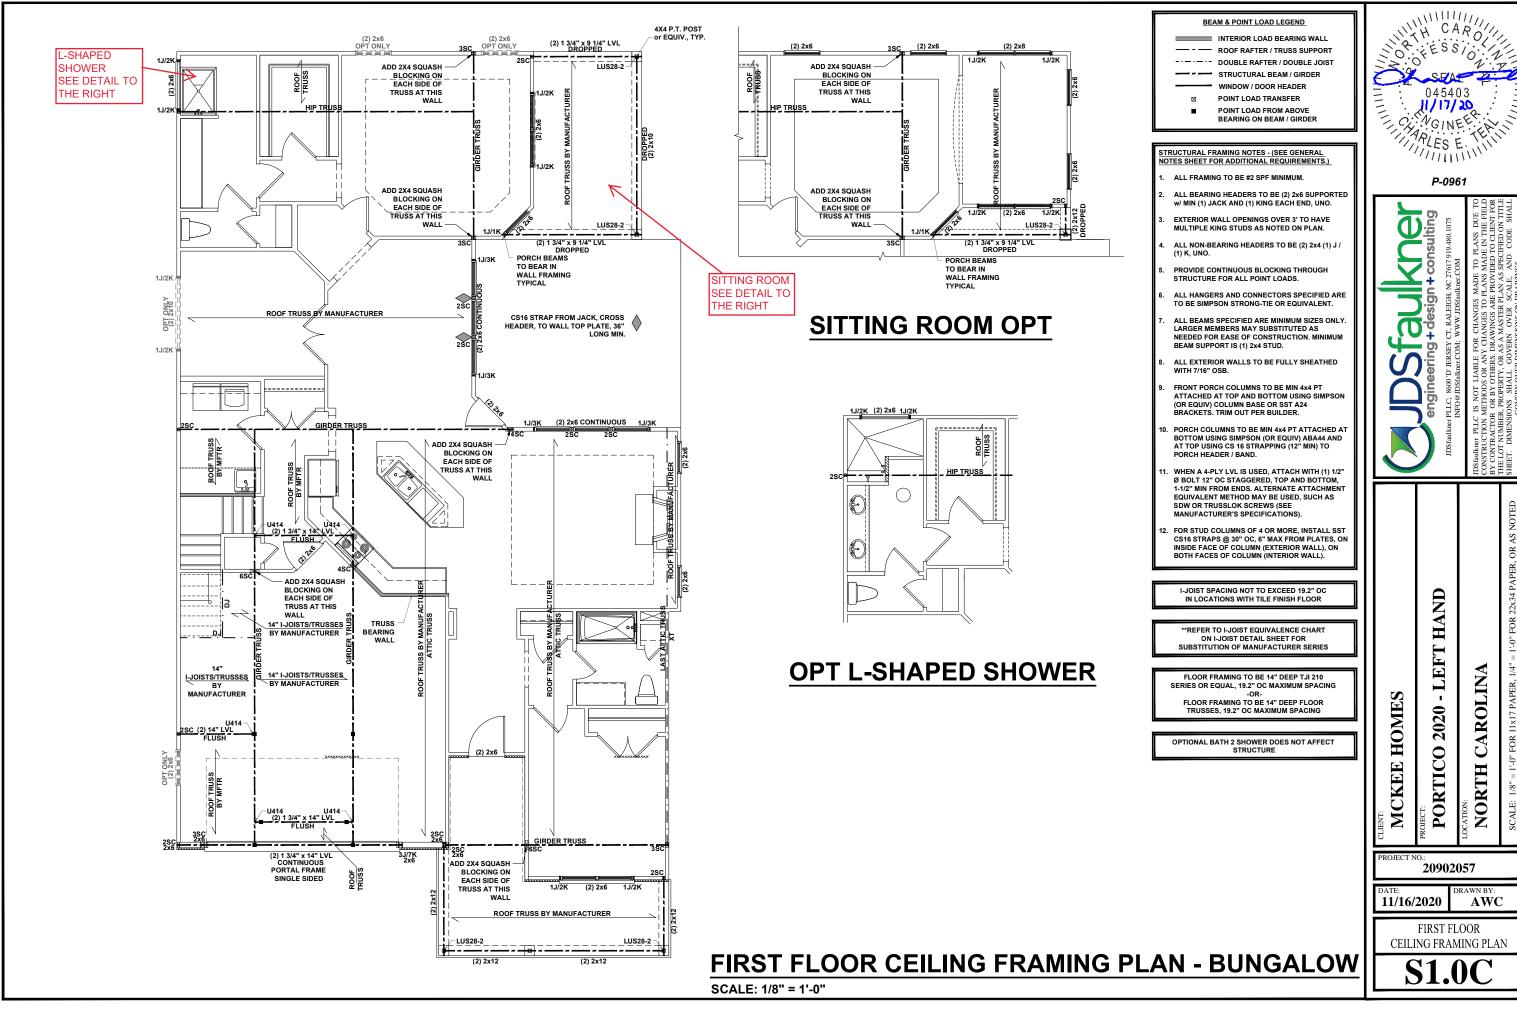

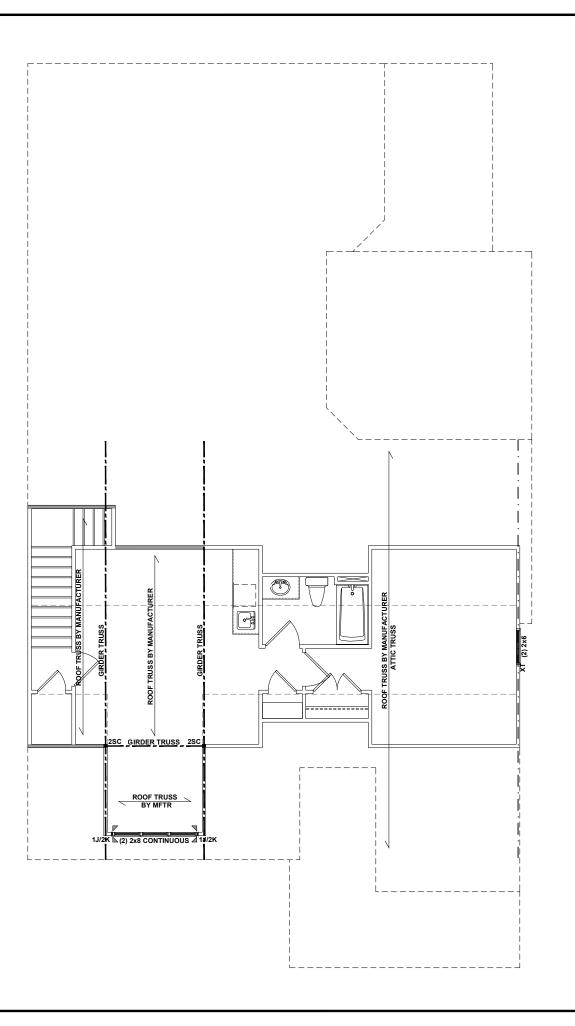




LCE4 BRACING CON.

■ LCE4 CLIP TO HEADER JACK
■ CONNECTION AND KBS1Z CLIP AT
THE JACK BOTTOM PLATE
CONNECTION

CS16 STRAP FROM JACK, CROSS HEADER, TO WALL TOP PLATE, 36" LONG MIN.

SIMPSON HTT4 HOLD DOWN FOR ATTACHMENT TO CONCRETE OR MSTA18 STRAP FOR WOOD CONNECTIONS



KBS1Z BRACING CON.

SCALE: 1/8" = 1'-0"

BEAM & POINT LOAD LEGEND

INTERIOR LOAD BEARING WALL
ROOF RAFTER / TRUSS SUPPOR

DOUBLE RAFTER / DOUBLE JOIST

STRUCTURAL BEAM / GIRDER
WINDOW / DOOR HEADER

☑ POINT LOAD TRANSFER

BEARING ON BEAM / GIRDER

STRUCTURAL FRAMING NOTES - (SEE GENERAL NOTES SHEET FOR ADDITIONAL REQUIREMENTS.)

ALL FRAMING TO BE #2 SPF MINIMUM.

- 2. ALL BEARING HEADERS TO BE (2) 2x6 SUPPORTED w/ MIN (1) JACK AND (1) KING EACH END, UNO.
- MULTIPLE KING STUDS AS NOTED ON PLAN.

 4. ALL NON-BEARING HEADERS TO BE (2) 2x4 (1) J /
- i. PROVIDE CONTINUOUS BLOCKING THROUGH

STRUCTURE FOR ALL POINT LOADS.

- 6. ALL HANGERS AND CONNECTORS SPECIFIED ARE TO BE SIMPSON STRONG-TIE OR EQUIVALENT.
- 7. ALL BEAMS SPECIFIED ARE MINIMUM SIZES ONLY. LARGER MEMBERS MAY SUBSTITUTED AS NEEDED FOR EASE OF CONSTRUCTION. MINIMUM BEAM SUPPORT IS (1) 2x4 STUD.
- ALL EXTERIOR WALLS TO BE FULLY SHEATHED
 WITH 7/16" OSB.
- 9. FRONT PORCH COLUMNS TO BE MIN 4x4 PT
 ATTACHED AT TOP AND BOTTOM USING SIMPSON
 (OR EQUIV) COLUMN BASE OR SST A24
 BBACKETS TRIM OUT PER BUILDER
- PORCH COLUMNS TO BE MIN 4x4 PT ATTACHED AT BOTTOM USING SIMPSON (OR EQUIV) ABA44 AND AT TOP USING CS 16 STRAPPING (12" MIN) TO PORCH HEADER / BAND.
- 11. WHEN A 4-PLY LVL IS USED, ATTACH WITH (1) 1/2" Ø BOLT 12" OC STAGGERED, TOP AND BOTTOM, 1-1/2" MIN FROM BODS. ALTERNATE ATTACHMENT EQUIVALENT METHOD MAY BE USED, SUCH AS SDW OR TRUSSLOK SCREWS (SEE MANUFACTURER'S SPECIFICATIONS).
- 12. FOR STUD COLUMNS OF 4 OR MORE, INSTALL SST CS16 STRAPS @ 30" OC, 6" MAX FROM PLATES, ON INSIDE FACE OF COLUMN (EXTERIOR WALL), ON BOTH FACES OF COLUMN (INTERIOR WALL).


I-JOIST SPACING NOT TO EXCEED 19.2" OC IN LOCATIONS WITH TILE FINISH FLOOR

**REFER TO I-JOIST EQUIVALENCE CHART ON I-JOIST DETAIL SHEET FOR SUBSTITUTION OF MANUFACTURER SERIES

FLOOR FRAMING TO BE 14" DEEP TJI 210 SERIES OR EQUAL, 19.2" OC MAXIMUM SPACING -OR-

FLOOR FRAMING TO BE 14" DEEP FLOOR TRUSSES, 19.2" OC MAXIMUM SPACING

DELUXE OWNER'S BATH OPTION DOES NOT AFFECT STRUCTURE



P-0961

ring + design + consulting
JERSEY CT, RALEIGH, NC 27617 919-480.1075
er.COM; WWW.JDSfaulkner.COM
ANY CHANGES MADE TO PLANS DUE TY
ANY CHANGES TO PLANS MADE IN THE FIELL
SES, DRAWINGS ARE PROVIDED TO CLIENT FOR
ORR AS A MASTER PLAN AS SPECIFIED ON TITLI.

INFO@IDStalkner.COM.

IDStaulkner PLLC IS NOT LIABLE FOI CONSTRUCTION METHODS OR ANY C BY CONTRACTOR OR BY OTHERS. DR THE LOT NUMBER, PROPERTY. OR ASSET: DIMENSIONS SHALL GOVER

OTED SHEET.

4 PAPER, OR AS NO

[A

HAND

H CAROLINA

LOCATION:
NORTH

NO.: 20902057

PORTICO 2020


DATE: **11/16/2020**


SECOND FLOOR

AWC


S2.0C

SECOND FLOOR CEILING FRAMING PLAN - BUNGALOW

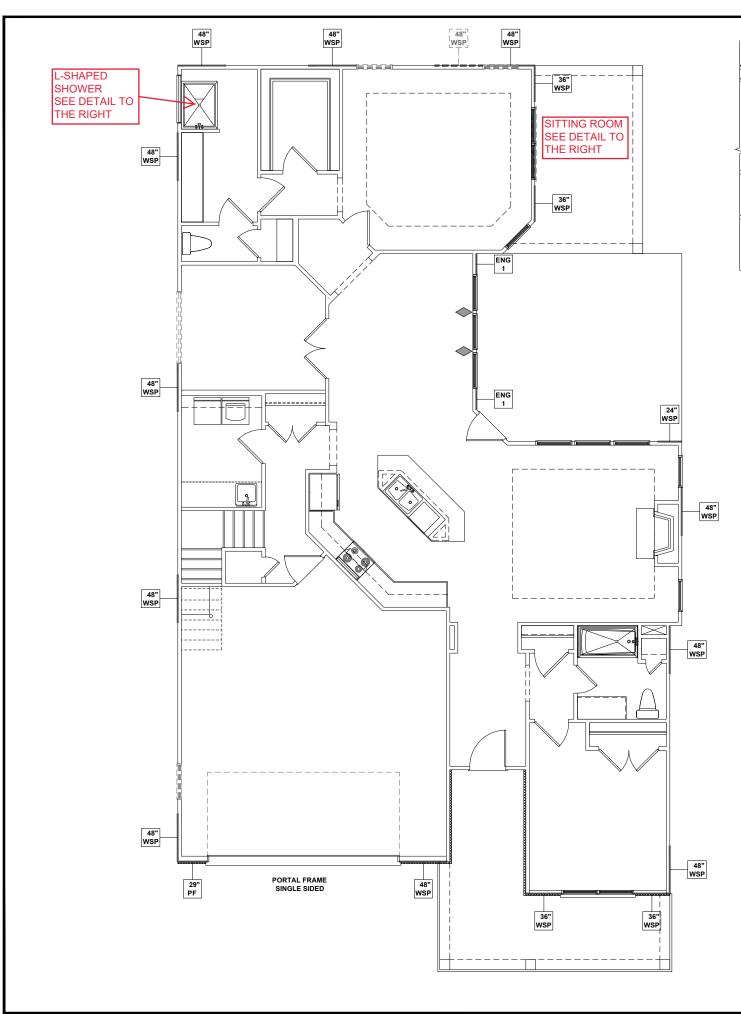

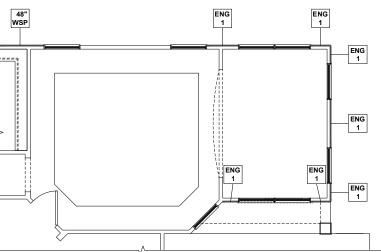

SITTING ROOM OPT



OPT L-SHAPED SHOWER

WALL BRACING REQUIREMENTS

- MINIMUM PANEL WIDTH IS 24"
 FIGURES BASED ON THE CONTINUOUS SHEATHING
 METHOD USING THE RECTANGLE CIRCUMSCRIBED
 AROUND THE FLOOR PLAN OR PORTION OF THE
 FLOOR PLAN. IF NO RECTANGLE IS NOTED, THE
 STRUCTURE HAS BEEN FIGURED ALL WITHIN ONE
- PANELS MAY SHIFT UP TO 36" EITHER DIRECTION FOR EASE OF CONSTRUCTION (NAILING & BLOCK REQUIREMENTS STILL APPLY).
- FOR ADDITIONAL WALL BRACING INFORMATION, REFER TO WALL BRACING DETAIL SHEET(S). SCHEMATIC BELOW INDICATES HOW SIDES OF RECTANGLE ARE TO BE INTERPRETED IN BRACING CHART WHEN APPLIED TO STRUCTURE:



CS16 STRAP FROM STUD, CROSS HEADER, TO WALL TOP PLATE, 36" LONG MINIMUM

SIMPSON MSTA15 HOLD DOWN CAPACITY OF 970 POUNDS PER ANCHOR WITH (12) 10d NAILS. STRAP TO BE LOCATED AT EDGE OF BRACED WALL PANEL. (CS16 STRAPPING MAY BE SUBSTITUTED W/ SIMILAR LENGTH AND NAILING PATTERN.) USE HTT4 FOR ATTACHMENT TO CONCRETE.

SCALED LENGTH
OF WALL PANEL
AT LOCATION

SCALED LENGTH
OF PANEL
PANEL TYPE

ENGINEERED WALL SCHEDULE

ENG1: CONTINUOUSLY SHEATH WITH 7/16" OSB ATTACHED WITH 8d NAILS @ 6" OC EDGE AND 12" OC FIELD. FULLY BLOCKED AT ALL PANEL EDGES

ENG2: CONTINUOUSLY SHEATH WITH 7/16" OSB WITH 10d NAILS @ 3" OC EDGE AND 3" OC FIELD. FULLY BLOCKED AT ALL PANEL EDGES

ENG3: CONTINUOUSLY SHEATH 7/16" OSB ATTACHED

BOTH SIDES WITH 8d NAILS @ 4" OC EDGE

AND 8" OC FIELD. FULLY BLOCKED AT ALL

PANEL EDGES.

ENG4: CONTINUOUSLY SHEATH 7/16" OSB ATTACHED WITH 8d NAILS @ 4" OC EDGE AND 8" OC FIELD. FULLY BLOCKED AT ALL PANEL EDGES.

WALL BRACING NOTE:

WALLS WITH REQUIRED LENGTH LISTED AS "N/A" DO NOT MEET THE REQUIREMENTS OF PRESCRIPTIVE WALL BRACING FOUND IN THE NCRC. THESE WALLS HAVE BEEN ENGINEERED BASED ON DESIGN GUIDELINES ESTABLISHED IN ASCE-07 AND THE NDS: WIND & SEISMIC PROVISIONS SUPPLEMENT.

WALL BRACING: RECTANGLE 1

SIDE	REQUIRED LENGTH	PROVIDED LENGTH		
FRONT	11.5 FT.	14.5 FT.		
RIGHT	7.5 FT.	18.0 FT.		
REAR	11.5 FT.	14.0 FT.		
LEFT	7.5 FT.	16.0 FT.		
•				


HIGH-SPEED WIND ZONES

FOR LOCATIONS OF 130 MPH OR MORE
ULTIMATE DESIGN WIND SPEED WALLS SHALL
BE BRACED PER THE LATEST ADOPTED
EDITION OF THE AMERICAN SOCIETY OF CIVIL
ENGINEERS PUBLICATION ASCE 7 OR
STANDARD FOR RESIDENTIAL CONSTRUCTION
IN HIGH-WIND REGIONS (ICC 600).

FIRST FLOOR WALL BRACING PLAN - BUNGALOW

SCALE: 1/8" = 1'-0"

LAYOUTS AND SPECIFICATIONS FOR NON-HIGH WINDS LOCATIONS ONLY



P-0961



JDSfaulkner PLLC; 8600 'D' JERSEY CT, RAI INFO@JDSfalkner COM; WWW.
DSfaulkner PLLC IS NOT LIABLE FOR CHAN-CONSTRUCTION METHODS OR ANY CHANGES BY CONTRACTOR OR BY OTHERS. DRAWINGS THE TOTN VIMBER PROPERTY OR AS A MACT.

HAND

ORTH CAROLINA

AWC


ROJECT NO.: **20902057**

PORTICO 2020

DATE: 11/16/2020

FIRST FLOOR WALL BRACING PLAN

S3.00

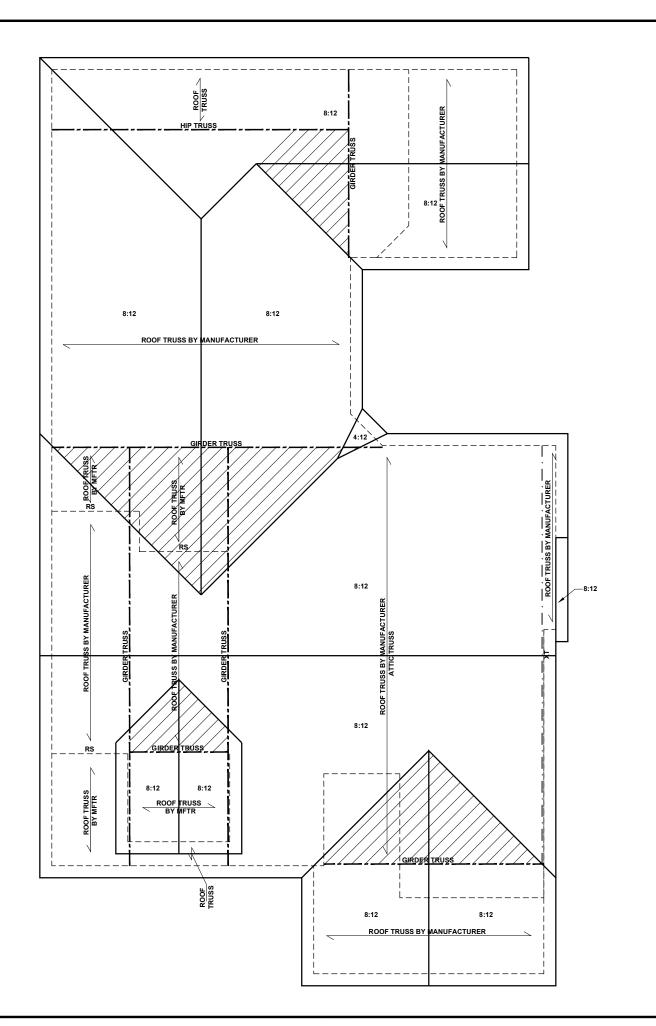

BEAM & POINT LOAD LEGEND

INTERIOR LOAD BEARING WALL

······ DOUBLE RAFTER / DOUBLE JOIST

--- STRUCTURAL BEAM / GIRDER WINDOW / DOOR HEADER

POINT LOAD TRANSFER **BEARING ON BEAM / GIRDER**

TRUSSED ROOF - STRUCTURAL NOTES

PROVIDE CONTINUOUS BLOCKING THROUGH STRUCTURE FOR ALL POINT LOADS.

DENOTES OVER-FRAMED AREA

- 4. TRUSS LAYOUT AND PLACEMENT BY MANUFACTURER TO COINCIDE WITH THE SUPPORT LOCATIONS SHOWN. TRUSS PROFILES SHALL BE SEALED BY THE TRUSS MANUFACTURER. TRUSS PLANS TO BE COORDINATED WITH THE SEALED STRUCTURAL ACCORDANCE WITH THE MANUFACTURER'S
- MANUFACTURER TO PROVIDE REQUIRED UPLIFT
- PROVIDE H2.5A (MINIMUM) OR EQUIVALENT AT EACH TRUSS-TO-TOP PLATE CONNECTION AT OVER-FRAMED AREAS, UNLESS NOTED
- UPLIFT CONNECTION TO BE CARRIED THROUGH TO FLOOR SYSTEM.

ATTIC VENTILATION - SIDE LOAD

THE TOTAL NET-FREE VENTILATION AREA SHALL NOT BE LESS THAN 1/150 OF THE AREA OF THE ATTIC SPACE TO BE VENTILATED. THE TOTAL VENTILATION MAY BE REDUCED TO 1/300 PROVIDED AT LEAST 50% BUT NOT MORE THAN 80% OF THE REQUIRED **VENTILATION BE LOCATED IN THE UPPER PORTION OF** THE AREA TO BE VENTILATED, OR AT LEAST 3'
ABOVE THE SOFFIT VENTILATION INTAKE.

2819 SQUARE FEET OF TOTAL ATTIC / 150 =

18.8 SQUARE FEET OF NET-FREE VENTILATION REQUIRED

TRUSSES SHALL BE ATTACHED TO SUPPORT WALL FOR UPLIFT RESISTANCE. CONTINUOUS OSB WALL SHEATHING BELOW PROVIDES CONTINUOUS UPLIFT RESISTANCE TO FOUNDATION. ALL TRUSSES SUPPORTED BY INTERMEDIATE SUPPORT WALLS, KNEEWALLS, OR BEAMS SHALL BE ATTACHED TO

ROOF SPAN IS MEASURED HORIZONTALLY BETWEEN FURTHEST SUPPORT POINTS.

OVER 28'

CONNECTOR NAILING PER TABLE 602.3(1)


NCRBC 2018 EDITION

(1) SIMPSON H2.5A HURRICANE

CLIP TO DBL TOP PLATE OR BEAM

OR (1) SIMPSON H3 CLIP TO SINGLE 2x4 PLATE

SEE HIGH WINDS DETAILS FOR ADDITIONAL FORMATION IF CONSTRUCTED IN HIGH WINDS AREA



P-0961



AWC

20902057

PORTICO 2020


HAND


11/16/2020


ROOF FRAMING PLAN


ROOF FRAMING PLAN - BUNGALOW


SCALE: 1/8" = 1'-0"

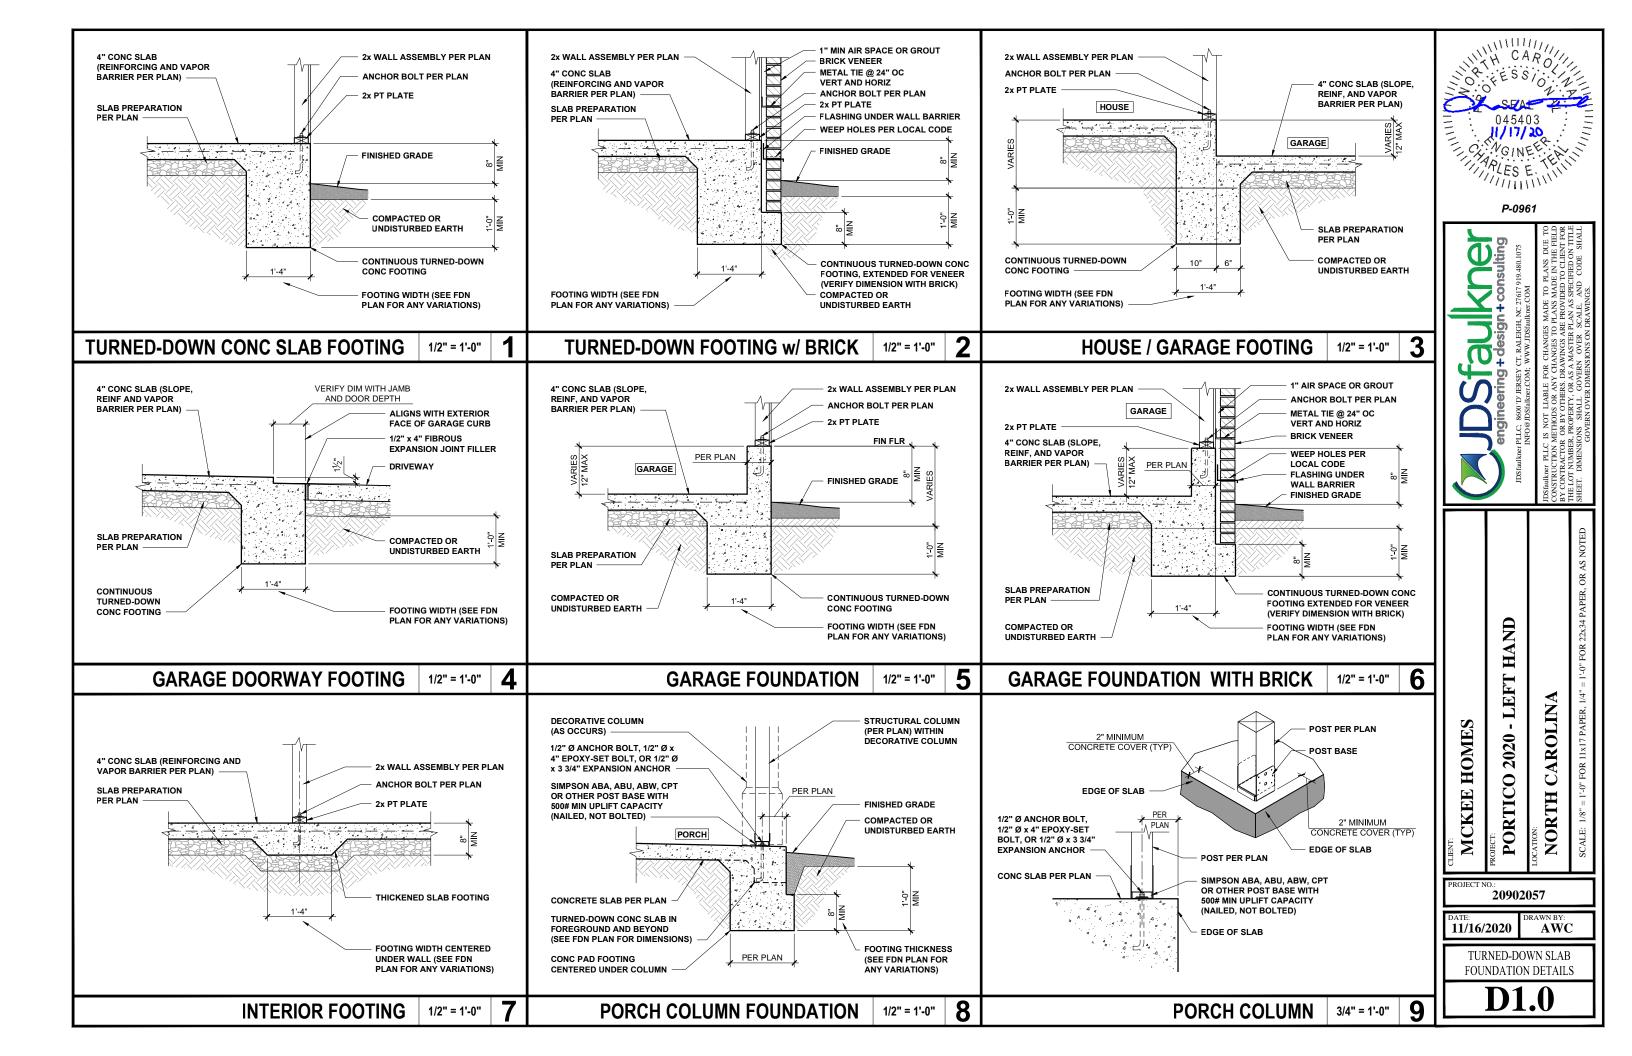


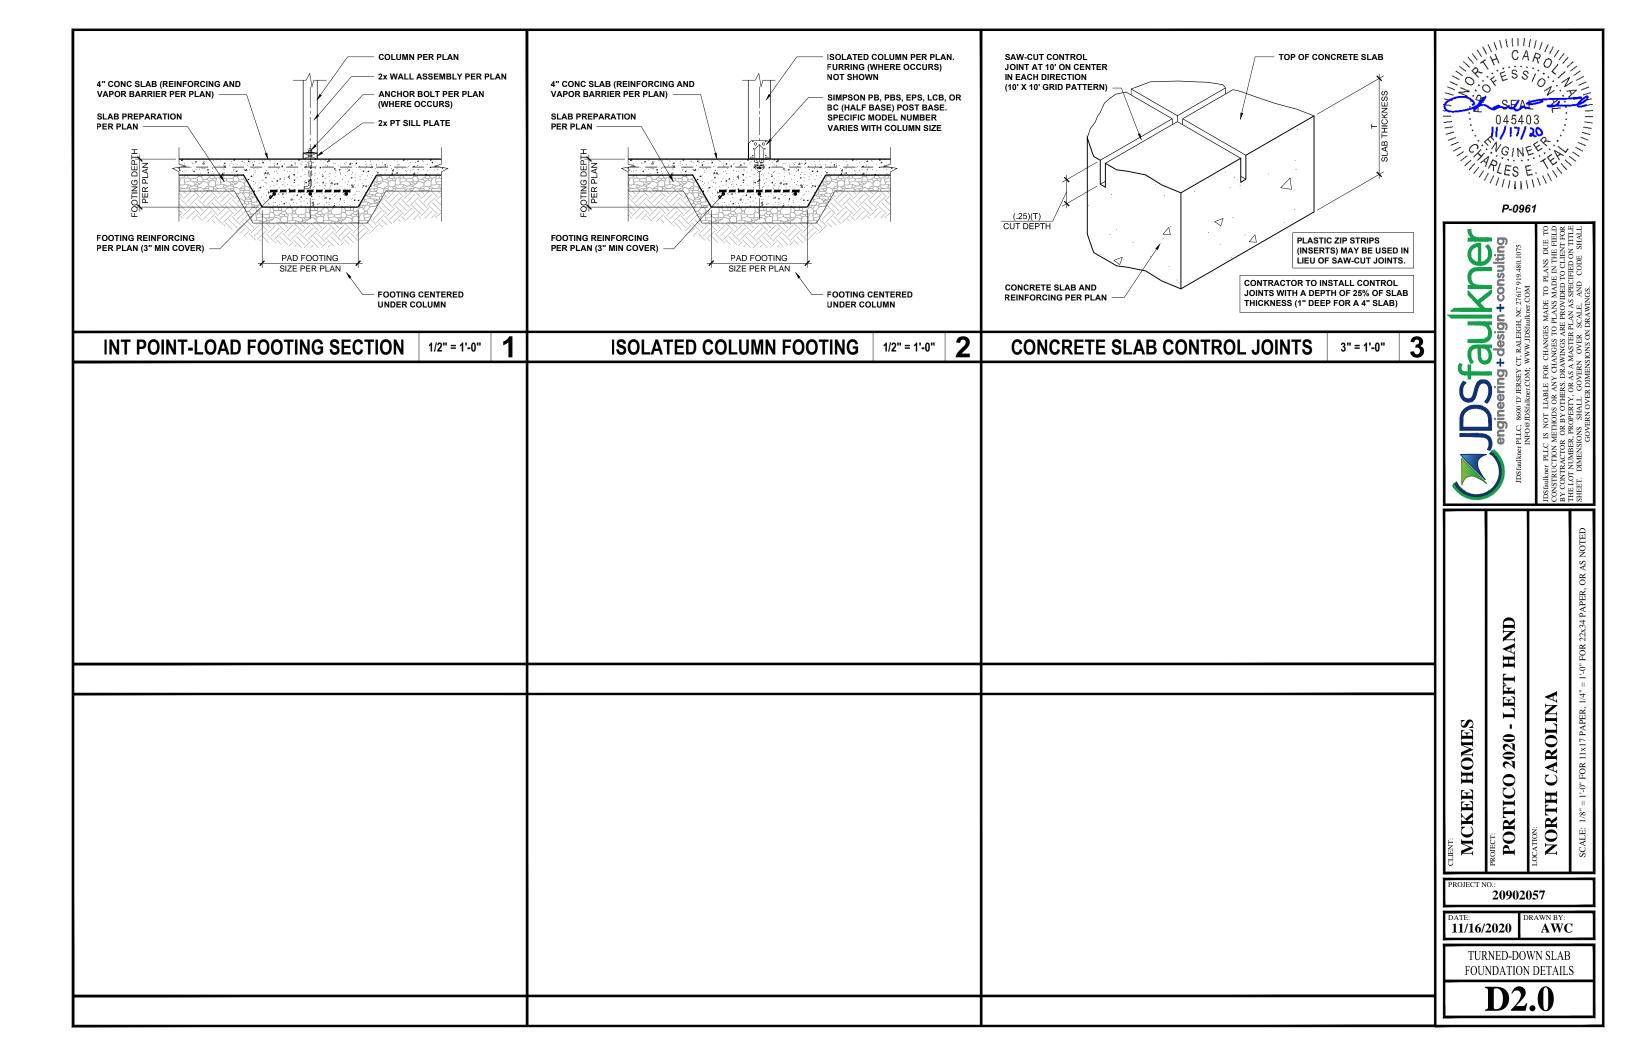


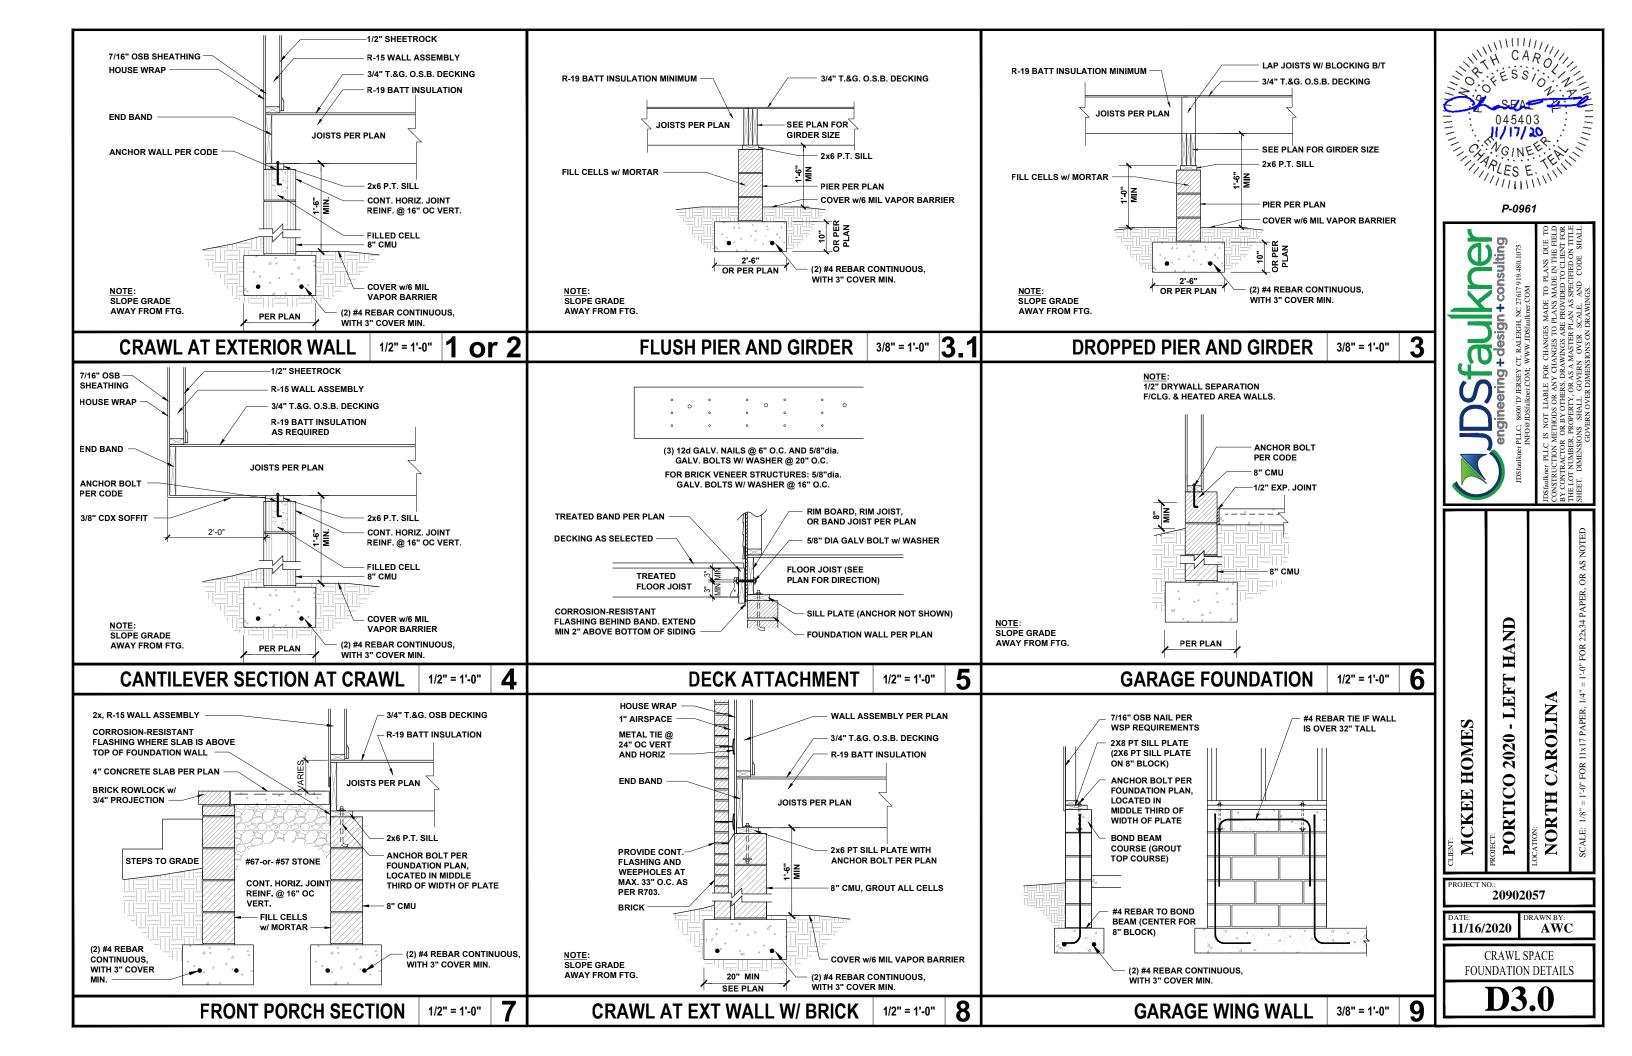


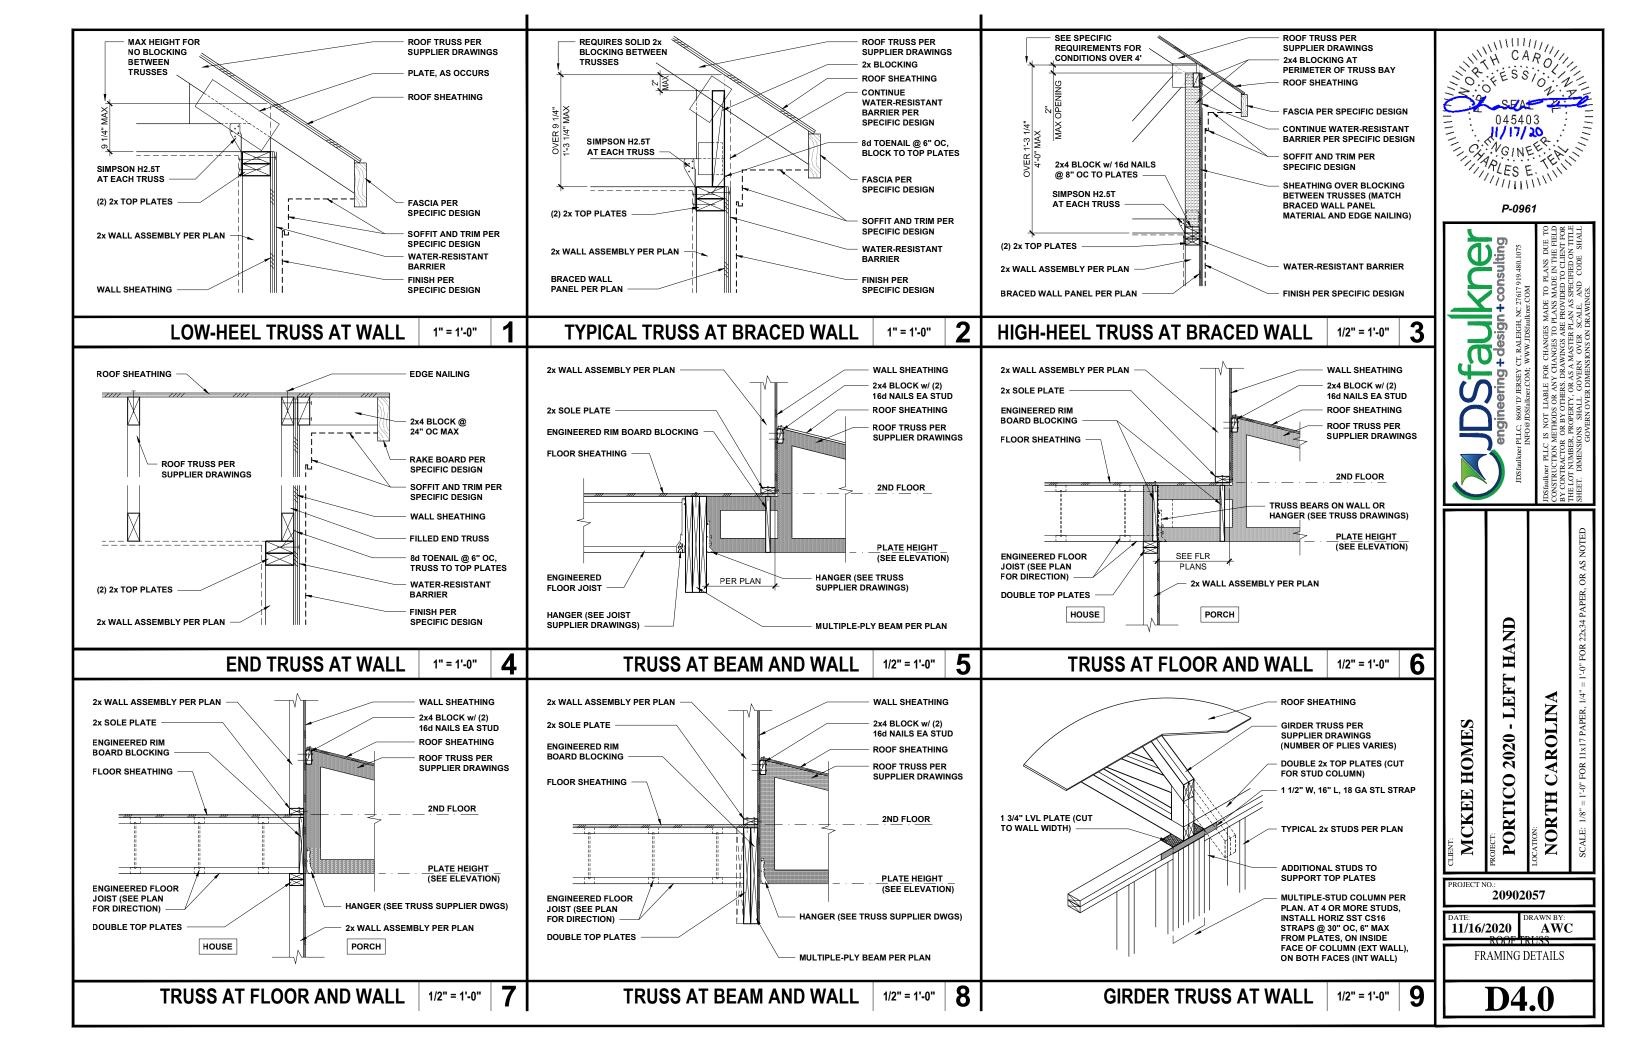


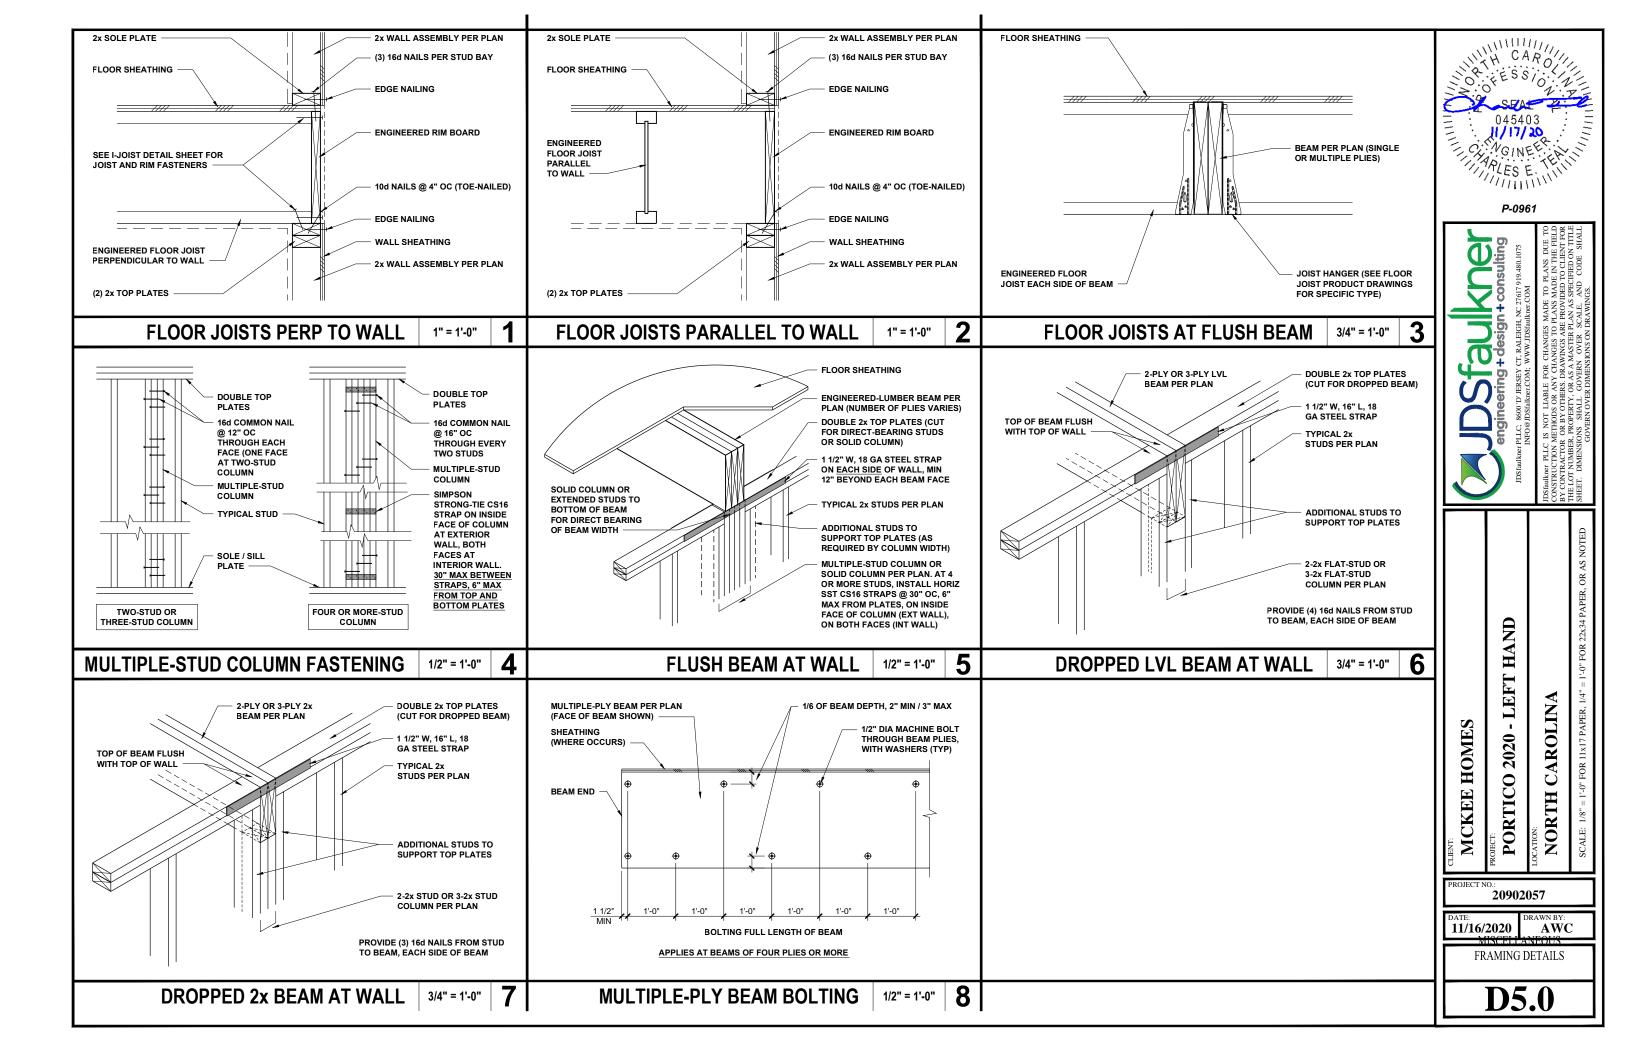

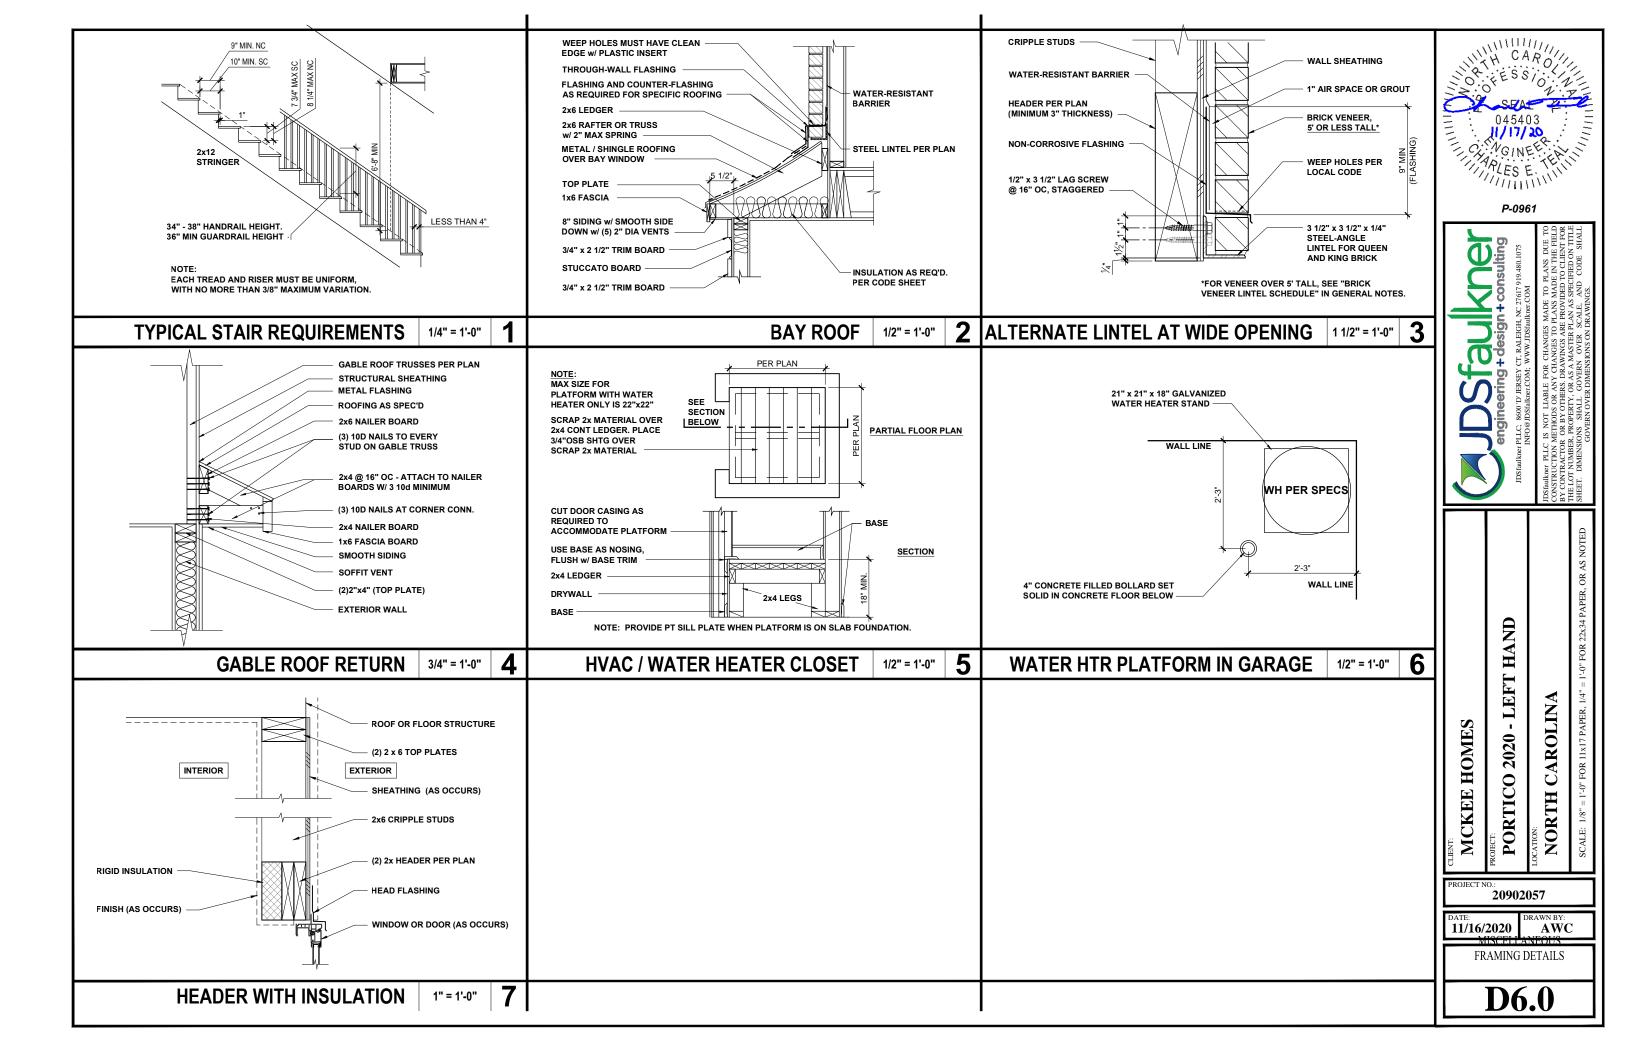


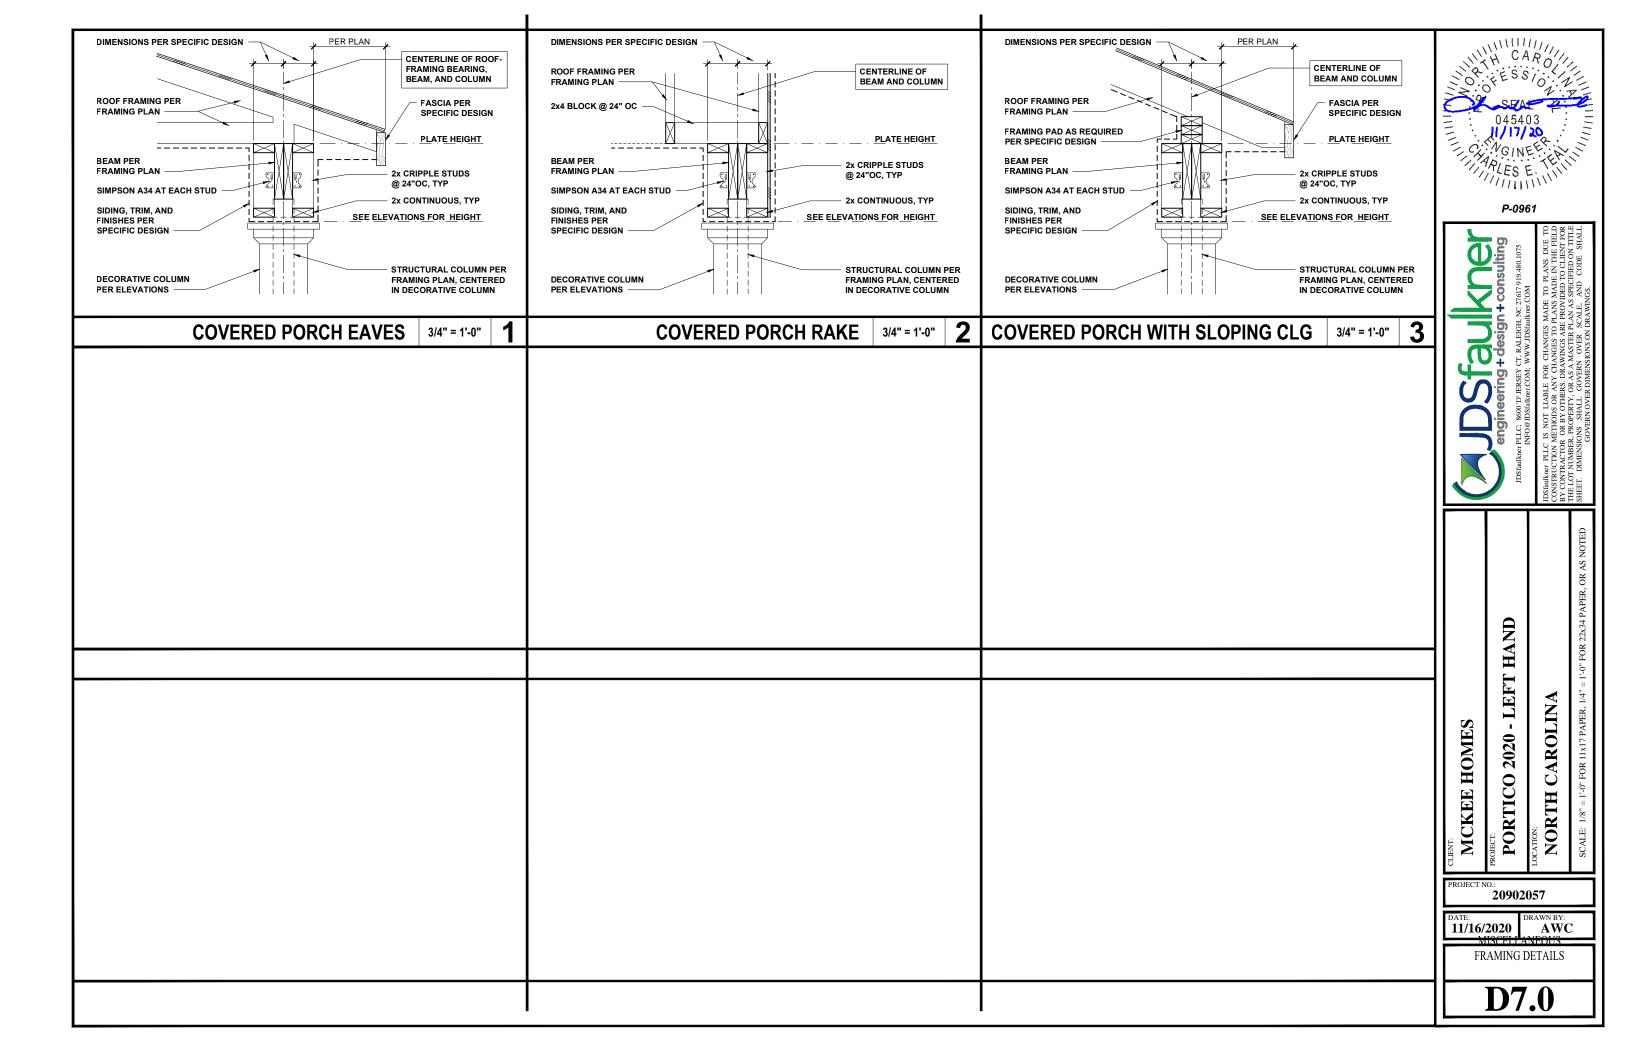


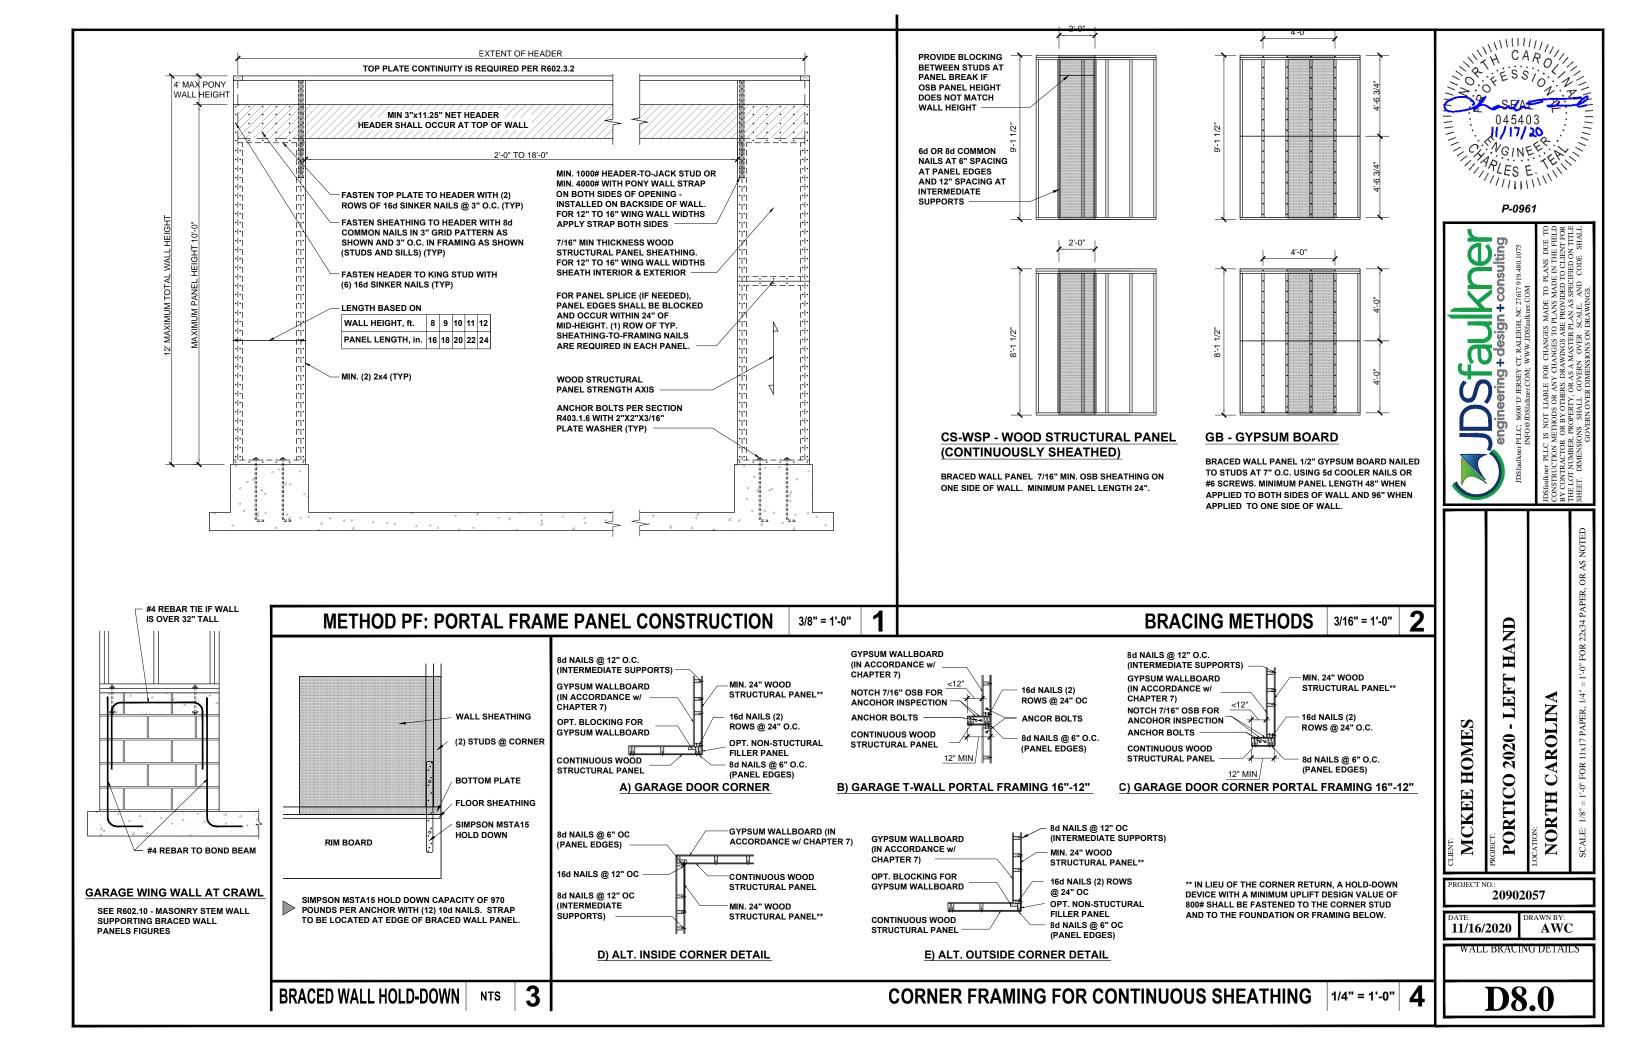

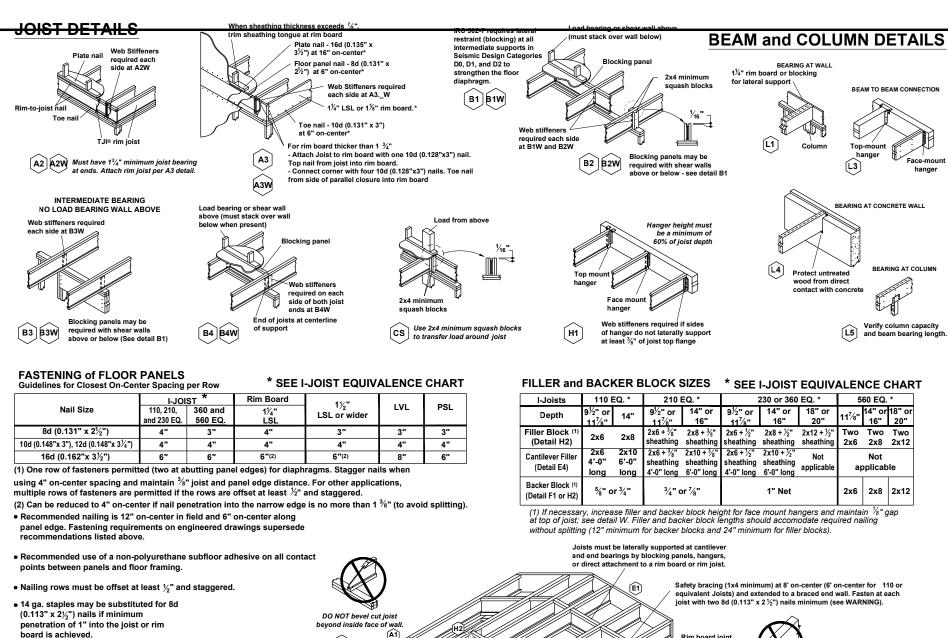

• Maximum spacing of nails is 18" on-center for joists.

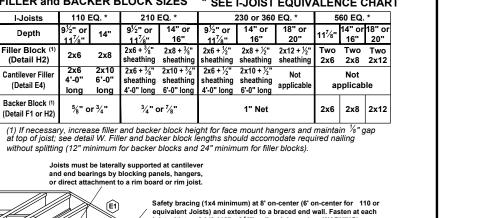

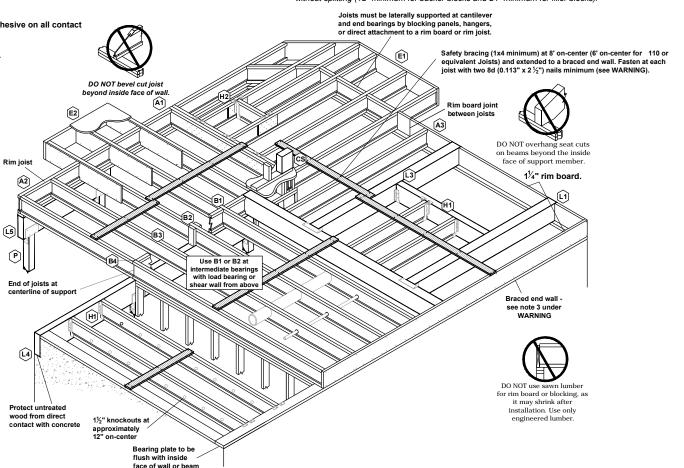


INSTALLATION TIPS

Subfloor adhesive will improve floor performance, but may not be required.

Squash blocks and blocking panels carry stacked vertical loads (details B1 and B2). Packing out the web of a joist (with web stiffeners) is not a substitute for squash blocks or blocking panels.

When joists are doubled at non-load bearing parallel partitions, space joists apart the width of the wall for plumbing or HVAC.


Additional joist at plumbing drop (see detail).



* I-JOIST EQUIVALENCY CHART

	EQUIVALENT IN SPAN AND SPACING			
Depth	Mftr & Series	Mftr & Series	Mftr & Series	
	TJI - 110	BCI 4500		
9 1 "	TJI - 210	BCI 5000		
•	TJI - 230	BCI 6000	EverEdge 20	
		BCI 6500		
	TJI - 110	BCI 4500		
	TJI - 210	BCI 5000		
11 ⁷ 8"	TJI - 230	BCI 6000	EverEdge 20	
8		BCI 6500		
	TJI - 360	BCI 60'S	EverEdge 30	
	TJI - 560	BCI 90'S	EverEdge 50/60	
	TJI - 110	BCI 4500		
	TJI - 210	BCI 5000		
14"	TJI - 230	BCI 6000	EverEdge 20	
'		BCI 6500		
	TJI - 360	BCI 60'S	EverEdge 30	
	TJI - 560	BCI 90'S	EverEdge 50/60	
	TJI - 110	BCI 4500		
	TJI - 210	BCI 5000		
16"	TJI - 230	BCI 6000	EverEdge 20	
.		BCI 6500		
	TJI - 360	BCI 60'S	EverEdge 30	
	TJI - 560	BCI 90'S	EverEdge 50/60	

JOIST NAILING REQUIREMENTS at BEARING

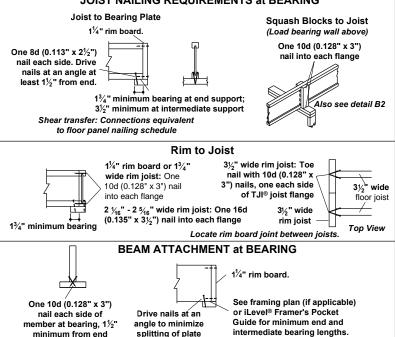



P-0961



HA - LEFT

AR じ

PORTICO

2020

20902057

CKEE

11/16/2020 **AWC**

DETAILS

