



Purchaser must verify all dimensions and conditions before beginning construction.

MidTown Designs Inc. assumes no liability for contractors practices and procedures

These drawings are instruments of service and as such shall remain property of the designer

© Copyright 2020

MidTown Designs Inc. All Rights Reserved




**FRONT ELEVATION**

SCALE 1/4" = 1'0"

**THIS PLAN DESIGNED UNDER NORTH CAROLINA RESIDENTIAL CODE 2018 EDITION (2015 IRC)**

NC (2018 NCRC) : Wind : 115 - 120 mph

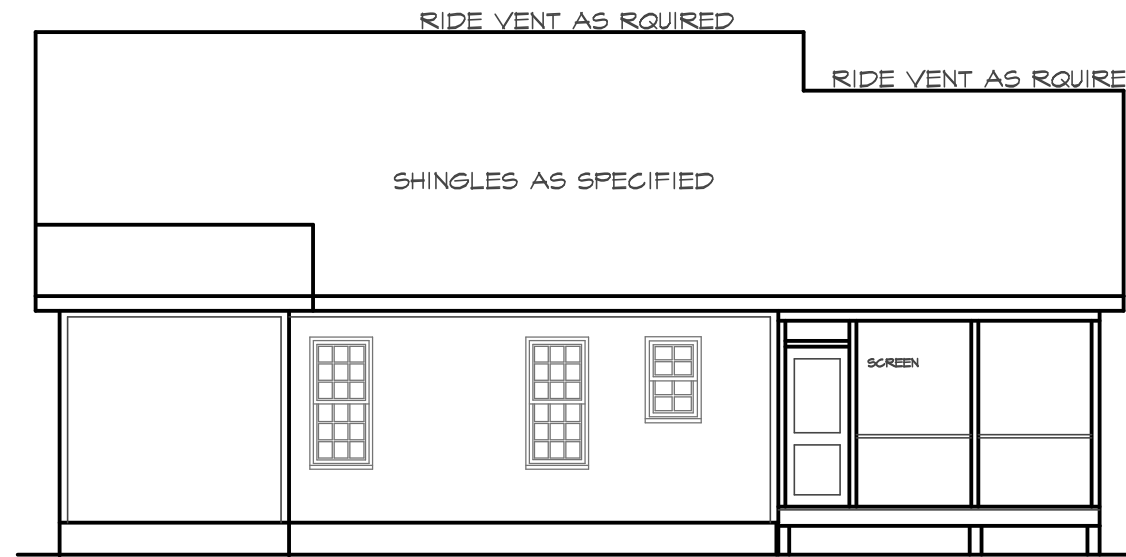

**REAR ELEVATION**

SCALE 1/8" = 1'0"


**ATTIC VENTILATION:**

THE NET FREE VENTILATING AREA SHALL BE NOT LESS THAN 1 TO 150 OF THE AREA OF THE SPACE VENTILATED EXCEPT THAT THE AREA MAY BE 1 TO 300 , PROVIDED AT LEAST 50 PERCENT OF THE REQUIRED VENTILATING AREA IS PROVIDED BY VENTILATORS LOCATED IN THE UPPER PORTION OF THE SPACE TO BE VENTILATED AT LEAST 3 FEET ABOVE EAVE OR CORNICE VENTS WITH THE BALANCE OF THE REQUIRED VENTILATION TO BE PROVIDED BY EAVE OR CORNICE VENTS.

GROSS ATTIC AREA TO BE VENTILATED 1255 SQ.FT.


1255/300 = 4.2 SQ.FT. NET FREE AREA

50% OF VENTING MUST BE 3FT. ABOVE EAVE OR SOFFIT VENTS.

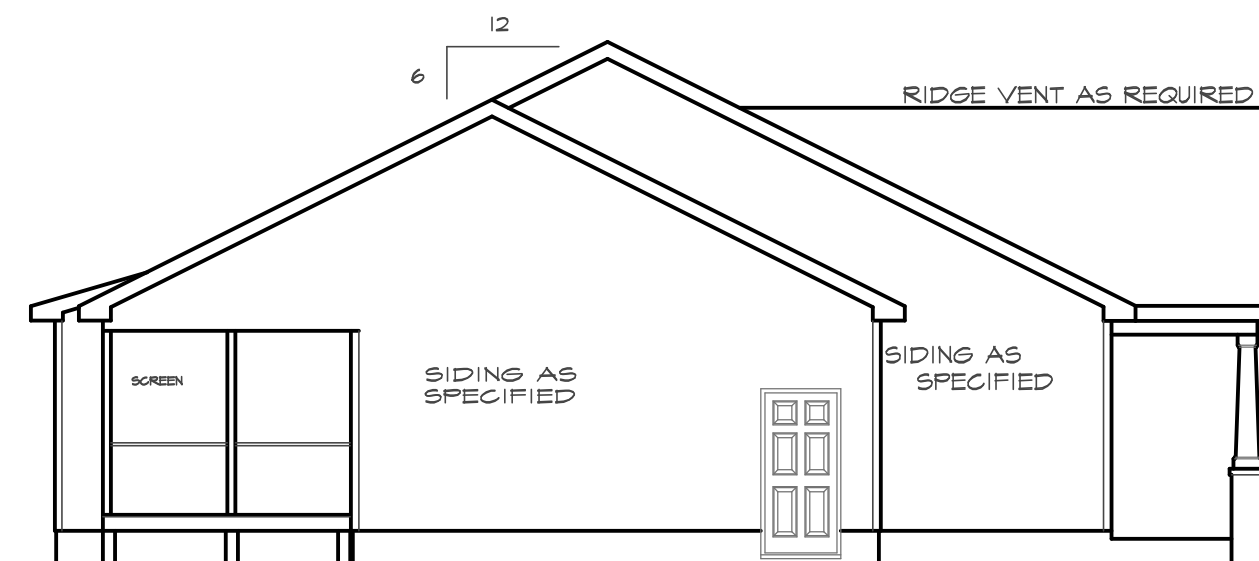

**LEFT SIDE ELEVATION**

SCALE 1/8" = 1'0"

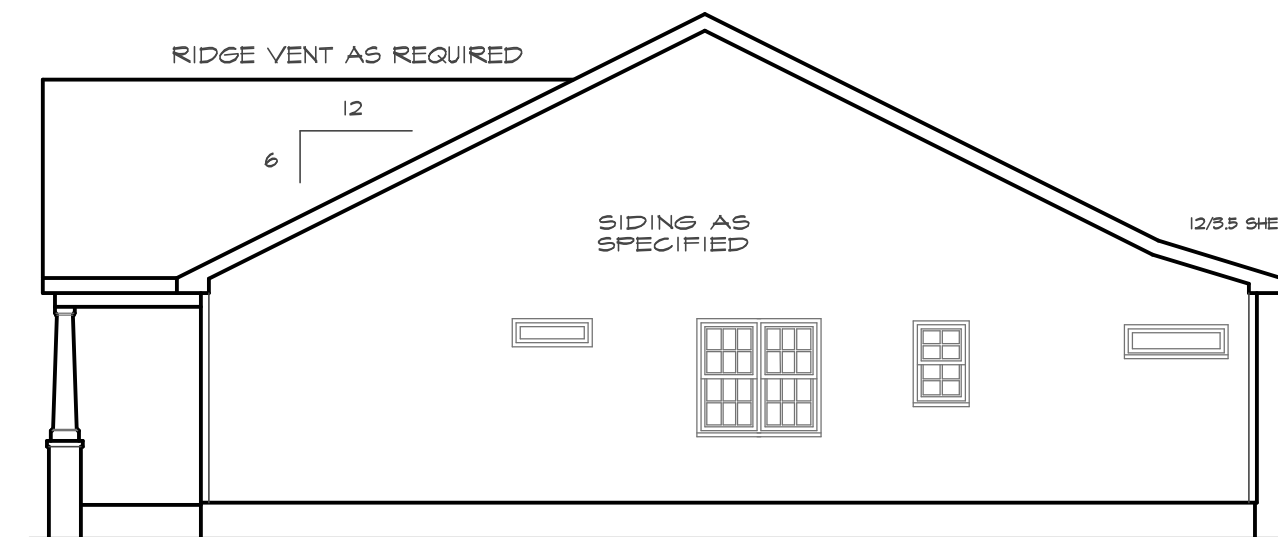

**RIGHT SIDE ELEVATION**

SCALE 1/8" = 1'0"

**The Bella**  
 GARAGE LEFT  
 www.midtowndesigns.com

DATE	REV	DATE	REV

LOT: \_\_\_\_\_ SUB: \_\_\_\_\_  
 DATE: 11/2/2020  
 SCALE: \_\_\_\_\_  
 PROJECT #: 190510

MidTown Designs Inc. 1529 Big Falls Dr. Wendell NC 27591 Phone: 919-783-8626



Purchaser must verify all dimensions and conditions before beginning construction.

MidTown Designs Inc. assumes no liability for contractors practices and procedures

These drawings are instruments of service and as such shall remain property of the designer

© Copyright 2020  
MidTown Designs Inc.  
All Rights Reserved

The Bella  
GARAGE LEFT

DATE	REV	DATE	REV

LOT SUB.

DATE 11/2/2020

SCALE

PROJECT # 190510

MidTown Designs Inc. 1529 Big Falls Dr. Wendell NC 27591 Phone: 919-783-8626 www.midtowndesigns.com

**FOUNDATION VENTING**

**SECTION R408 UNDER FLOOR SPACE**

R408.1 Ventilation. The under-floor space between the bottom of the floor joists and the earth under any building (except space occupied by a basement or cellar) shall be provided with ventilation openings through foundation walls or exterior walls. The minimum net area of ventilation openings shall not be less than 1 square foot for each 150 square feet (0.67 m squared for each 100 m squared) of under-floor space area. One such ventilating opening shall be within 3 feet (914 mm) of each corner of said building.

CRAWL AREA TO BE VENTED: 1211 SQ.FT.  
1211/1500 = .807 NET FREE VENTING AREA REQUIRED

R408.2 Ground Vapor Retarder  
A minimum 6 mil. polyethylene vapor retarder shall be installed to cover all earth in the crawl space with joints lapped not less than 12"

**FOUNDATION STRUCTURAL NOTES:**

- 1 (3) 2 x 10 SPF #2 GIRDER DROPPED TYPICAL UNO.
- 2 CONCRETE BLOCK PIER SIZE SHALL BE:
 


SIZE	HOLLOW MASONRY	SOLID MASONRY
8 x 16	UP TO 32" HIGH	UP TO 5'-0" HIGH
12 x 16	UP TO 48" HIGH	UP TO 9'-0" HIGH
16 x 16	UP TO 64" HIGH	UP TO 12'-0" HIGH
24 x 24	UP TO 96" HIGH	

 WITH 30" x 30" x 10" CONCRETE FOOTING, UNO.
- 3 WALL FOOTING AS FOLLOWS:
 

DEPTH:	8" - UP TO 2-1/2 STORY
10" - 3 STORY	

WIDTH:	SIDING (OR EQUAL)
16" - UP TO 2-1/2 STORY	
18" - 3 STORY	

BRICK VENEER	16" - 1 STORY
20" - 2 STORY	
24" - 3 STORY	
- FOR FOUNDATION WALL HEIGHT AND BACKFILL REQUIREMENTS, REFER TO NORTH CAROLINA RESIDENTIAL CODE TABLE R404.1.1 (1 THRU 4)  
NOTE: ASSUMED SOIL BEARING CAPACITY = 2000 PSF. CONTRACTOR MUST VERIFY SITE CONDITIONS AND CONTACT SOILS ENGINEER IF MARGINAL OR UNSTABLE SOILS ARE ENCOUNTERED.  
ATTACH SILL PLATE WITH 1/2" dia. ANCHOR BOLTS AT 6'-0" CENTERS (7" EMBEDMENT) AND 12" FROM EACH PLATE END. (SECTION R 403.1.6)
- 4 ■ DESIGNATES A SIGNIFICANT POINT LOAD TO HAVE SOLID BLOCKING TO PIER. SOLID BLOCK ALL BEAM BEARING POINTS NOTED TO HAVE THREE OR MORE STUDS TO FND, TYPICAL.
- 5 ABBREVIATIONS:  
"SJ" = SINGLE JOIST  
"DJ" = DOUBLE JOIST  
"TJ" = TRIPLE JOIST
- 6 (4) 2 x 10 SPF #2 GIRDER, TYPICAL UNO.

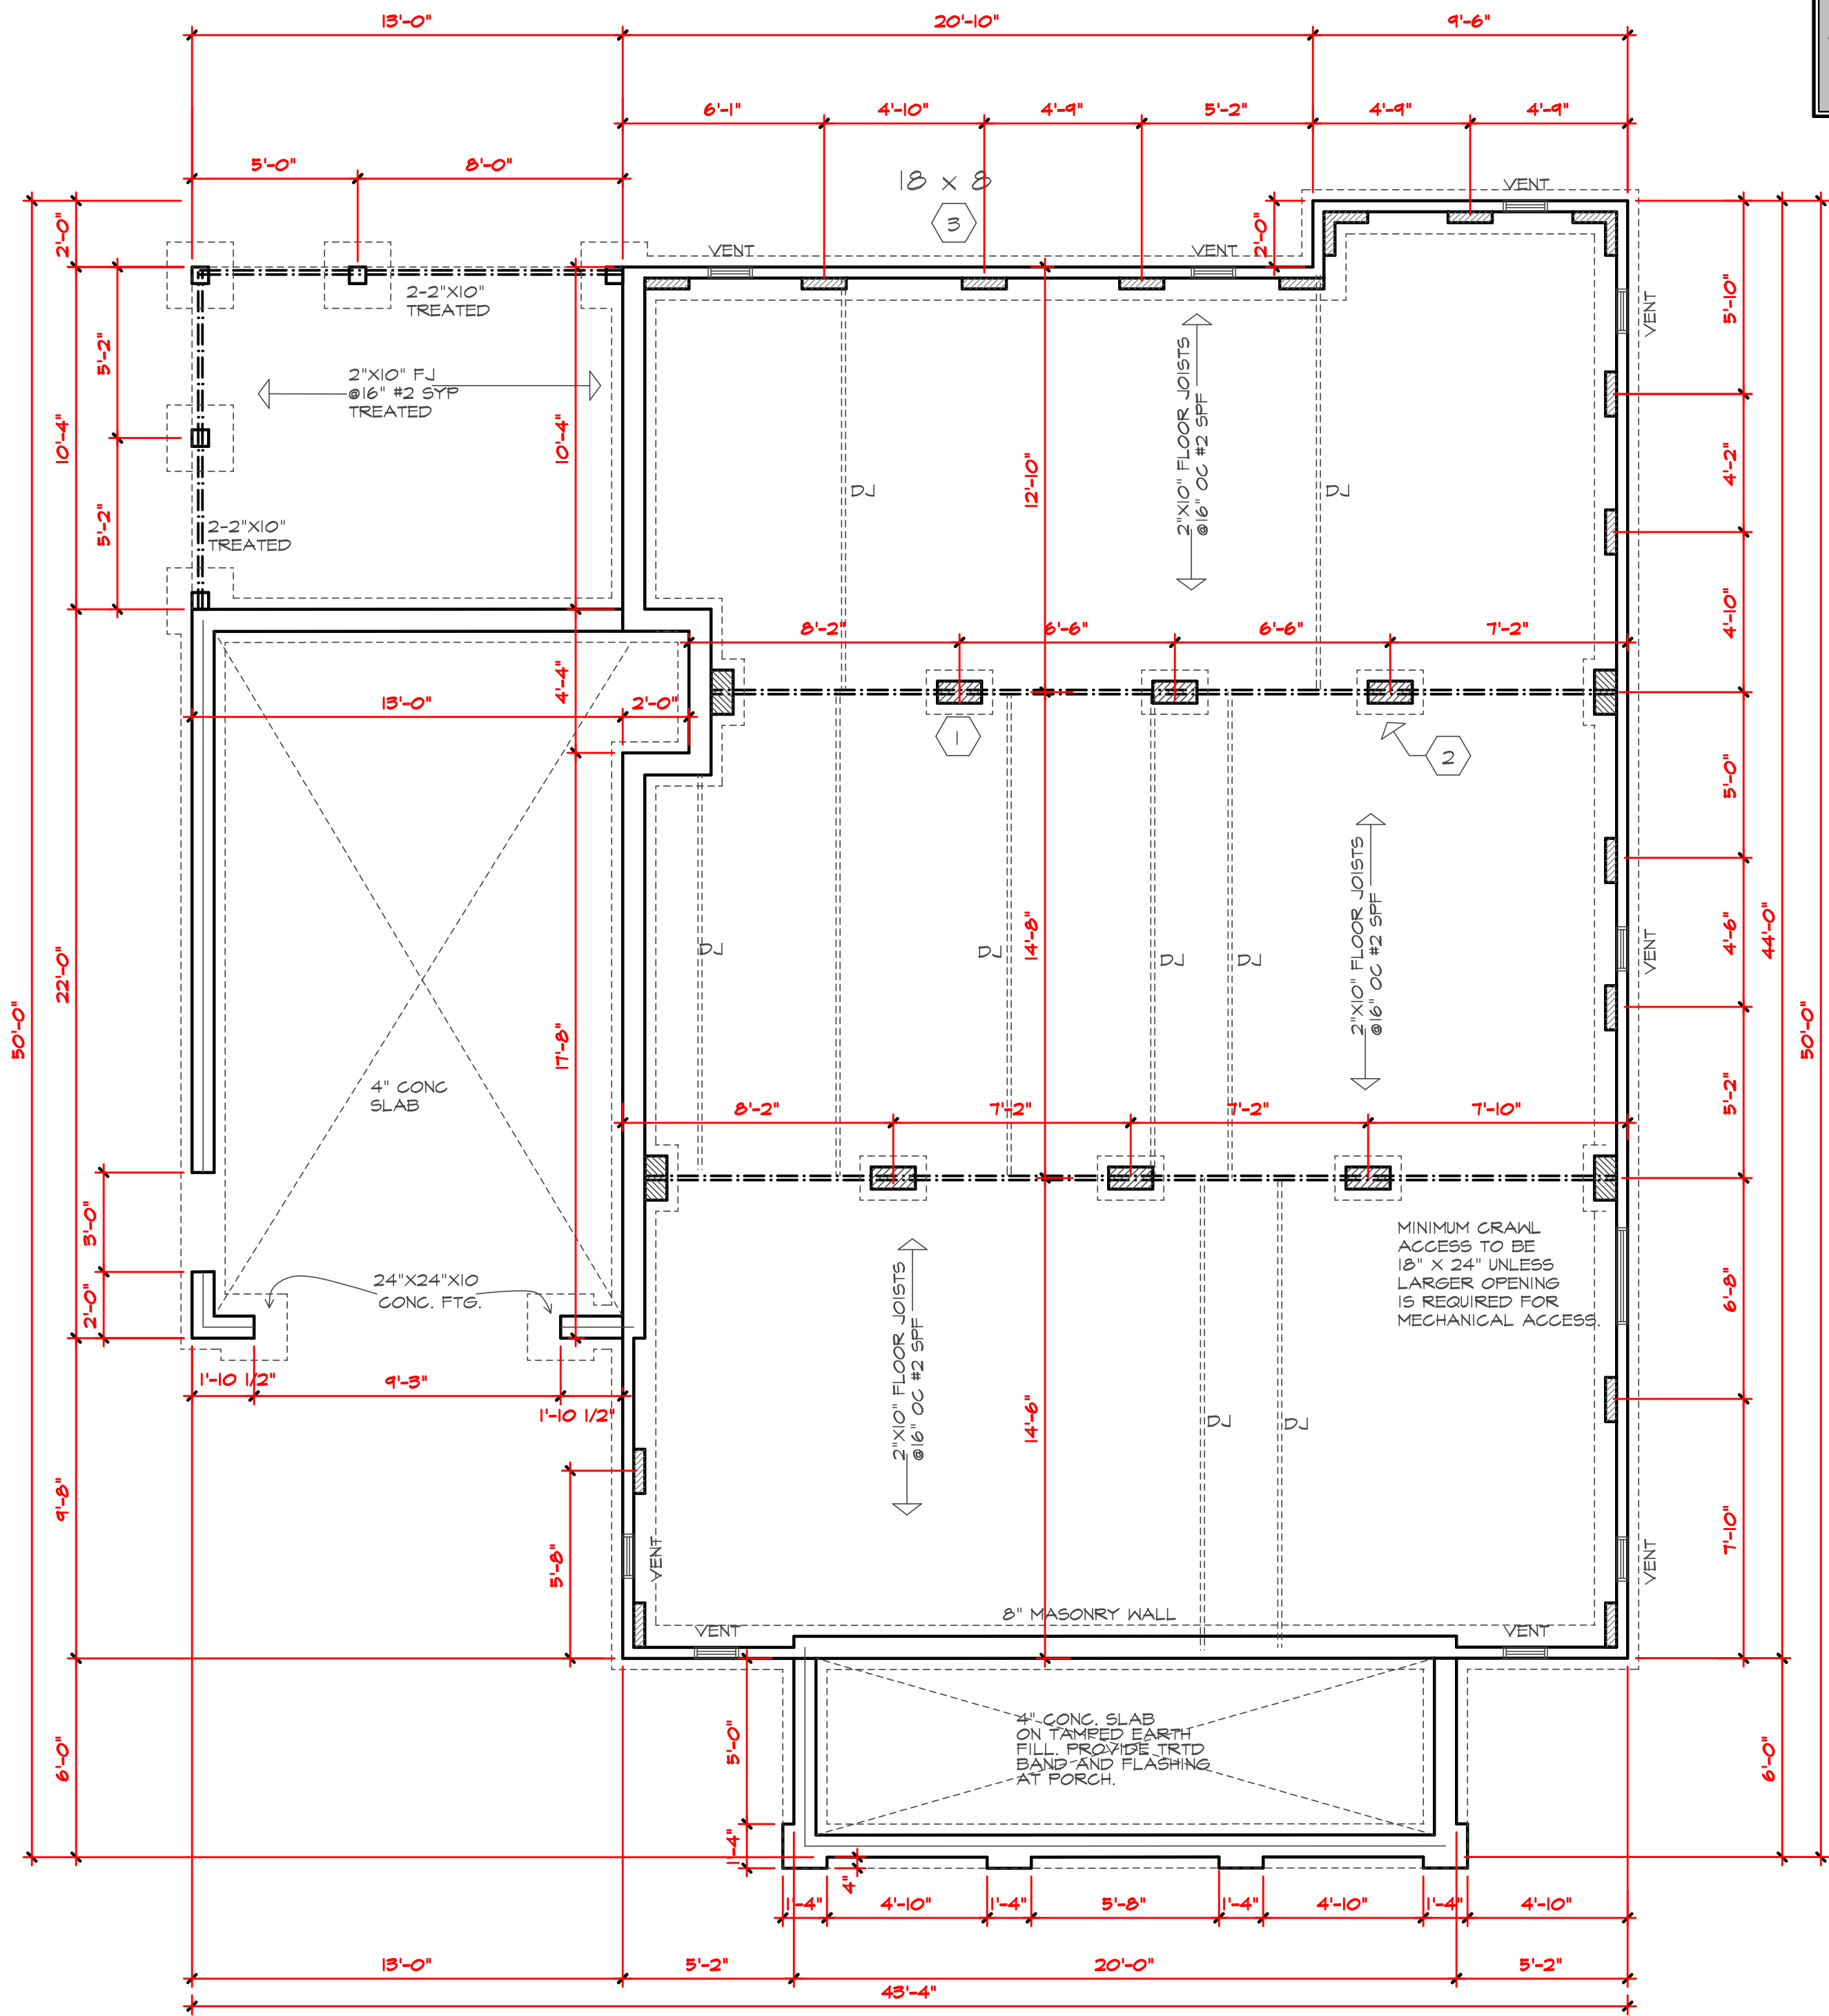

**PIER & CURTAIN FOUNDATION PLAN**  
SCALE 1/4" = 1'-0"

Purchaser must verify all dimensions and conditions before beginning construction.

MidTown Designs Inc. assumes no liability for contractors practices and procedures

These drawings are instruments of service and as such shall remain property of the designer

© Copyright 2020  
MidTown Designs Inc.  
All Rights Reserved

The Bella  
GARAGE LEFT

DATE	REV	DATE	REV


LOT SUB.

DATE 11/2/2020


SCALE

PROJECT # 190510

MidTown Designs Inc. 1529 Big Falls Dr. Wendell NC 27591 Phone: 919-783-8626 www.midtowndesigns.com

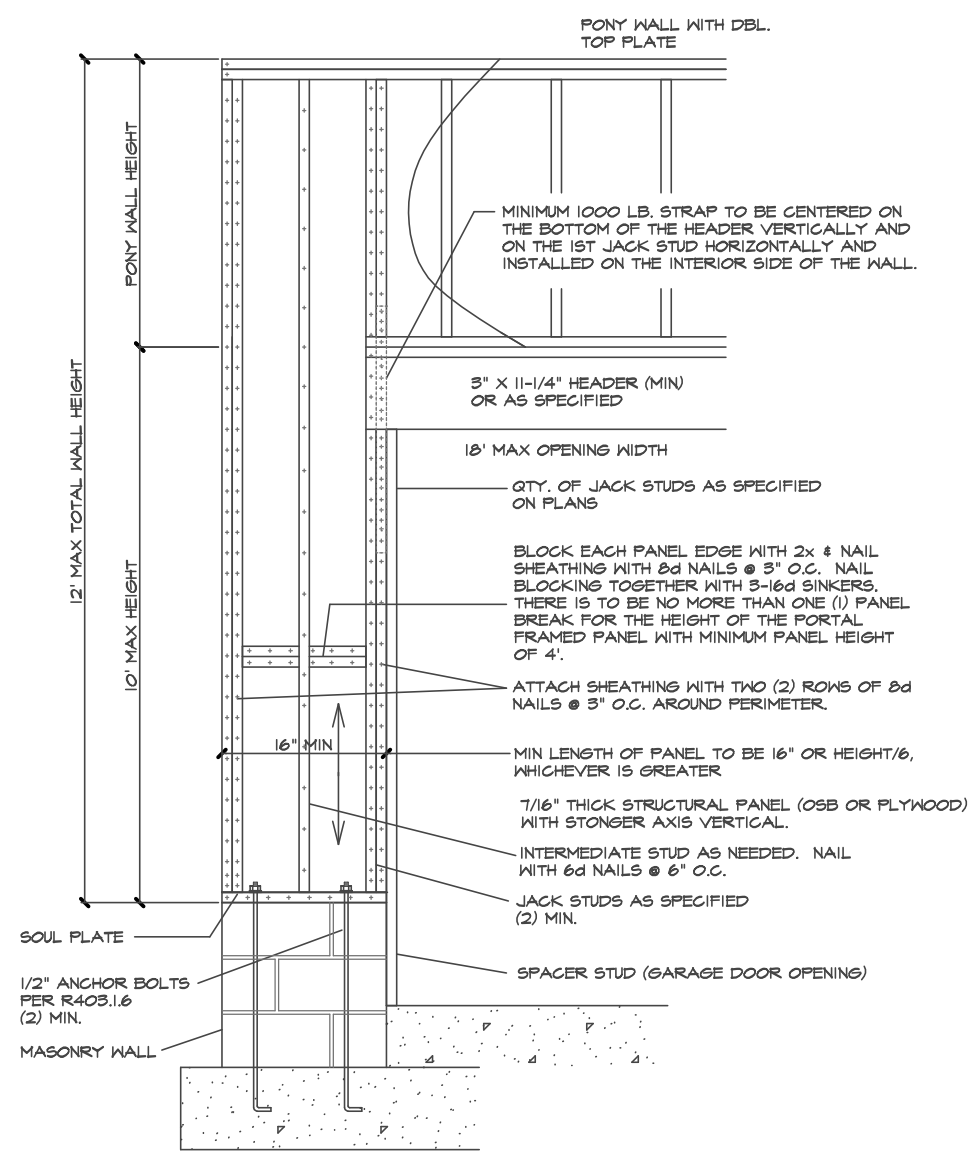

**A** CONTINUOUS PORTAL FRAME PANEL CONSTRUCTION OVER MASONRY OR CONCRETE FOUNDATION.

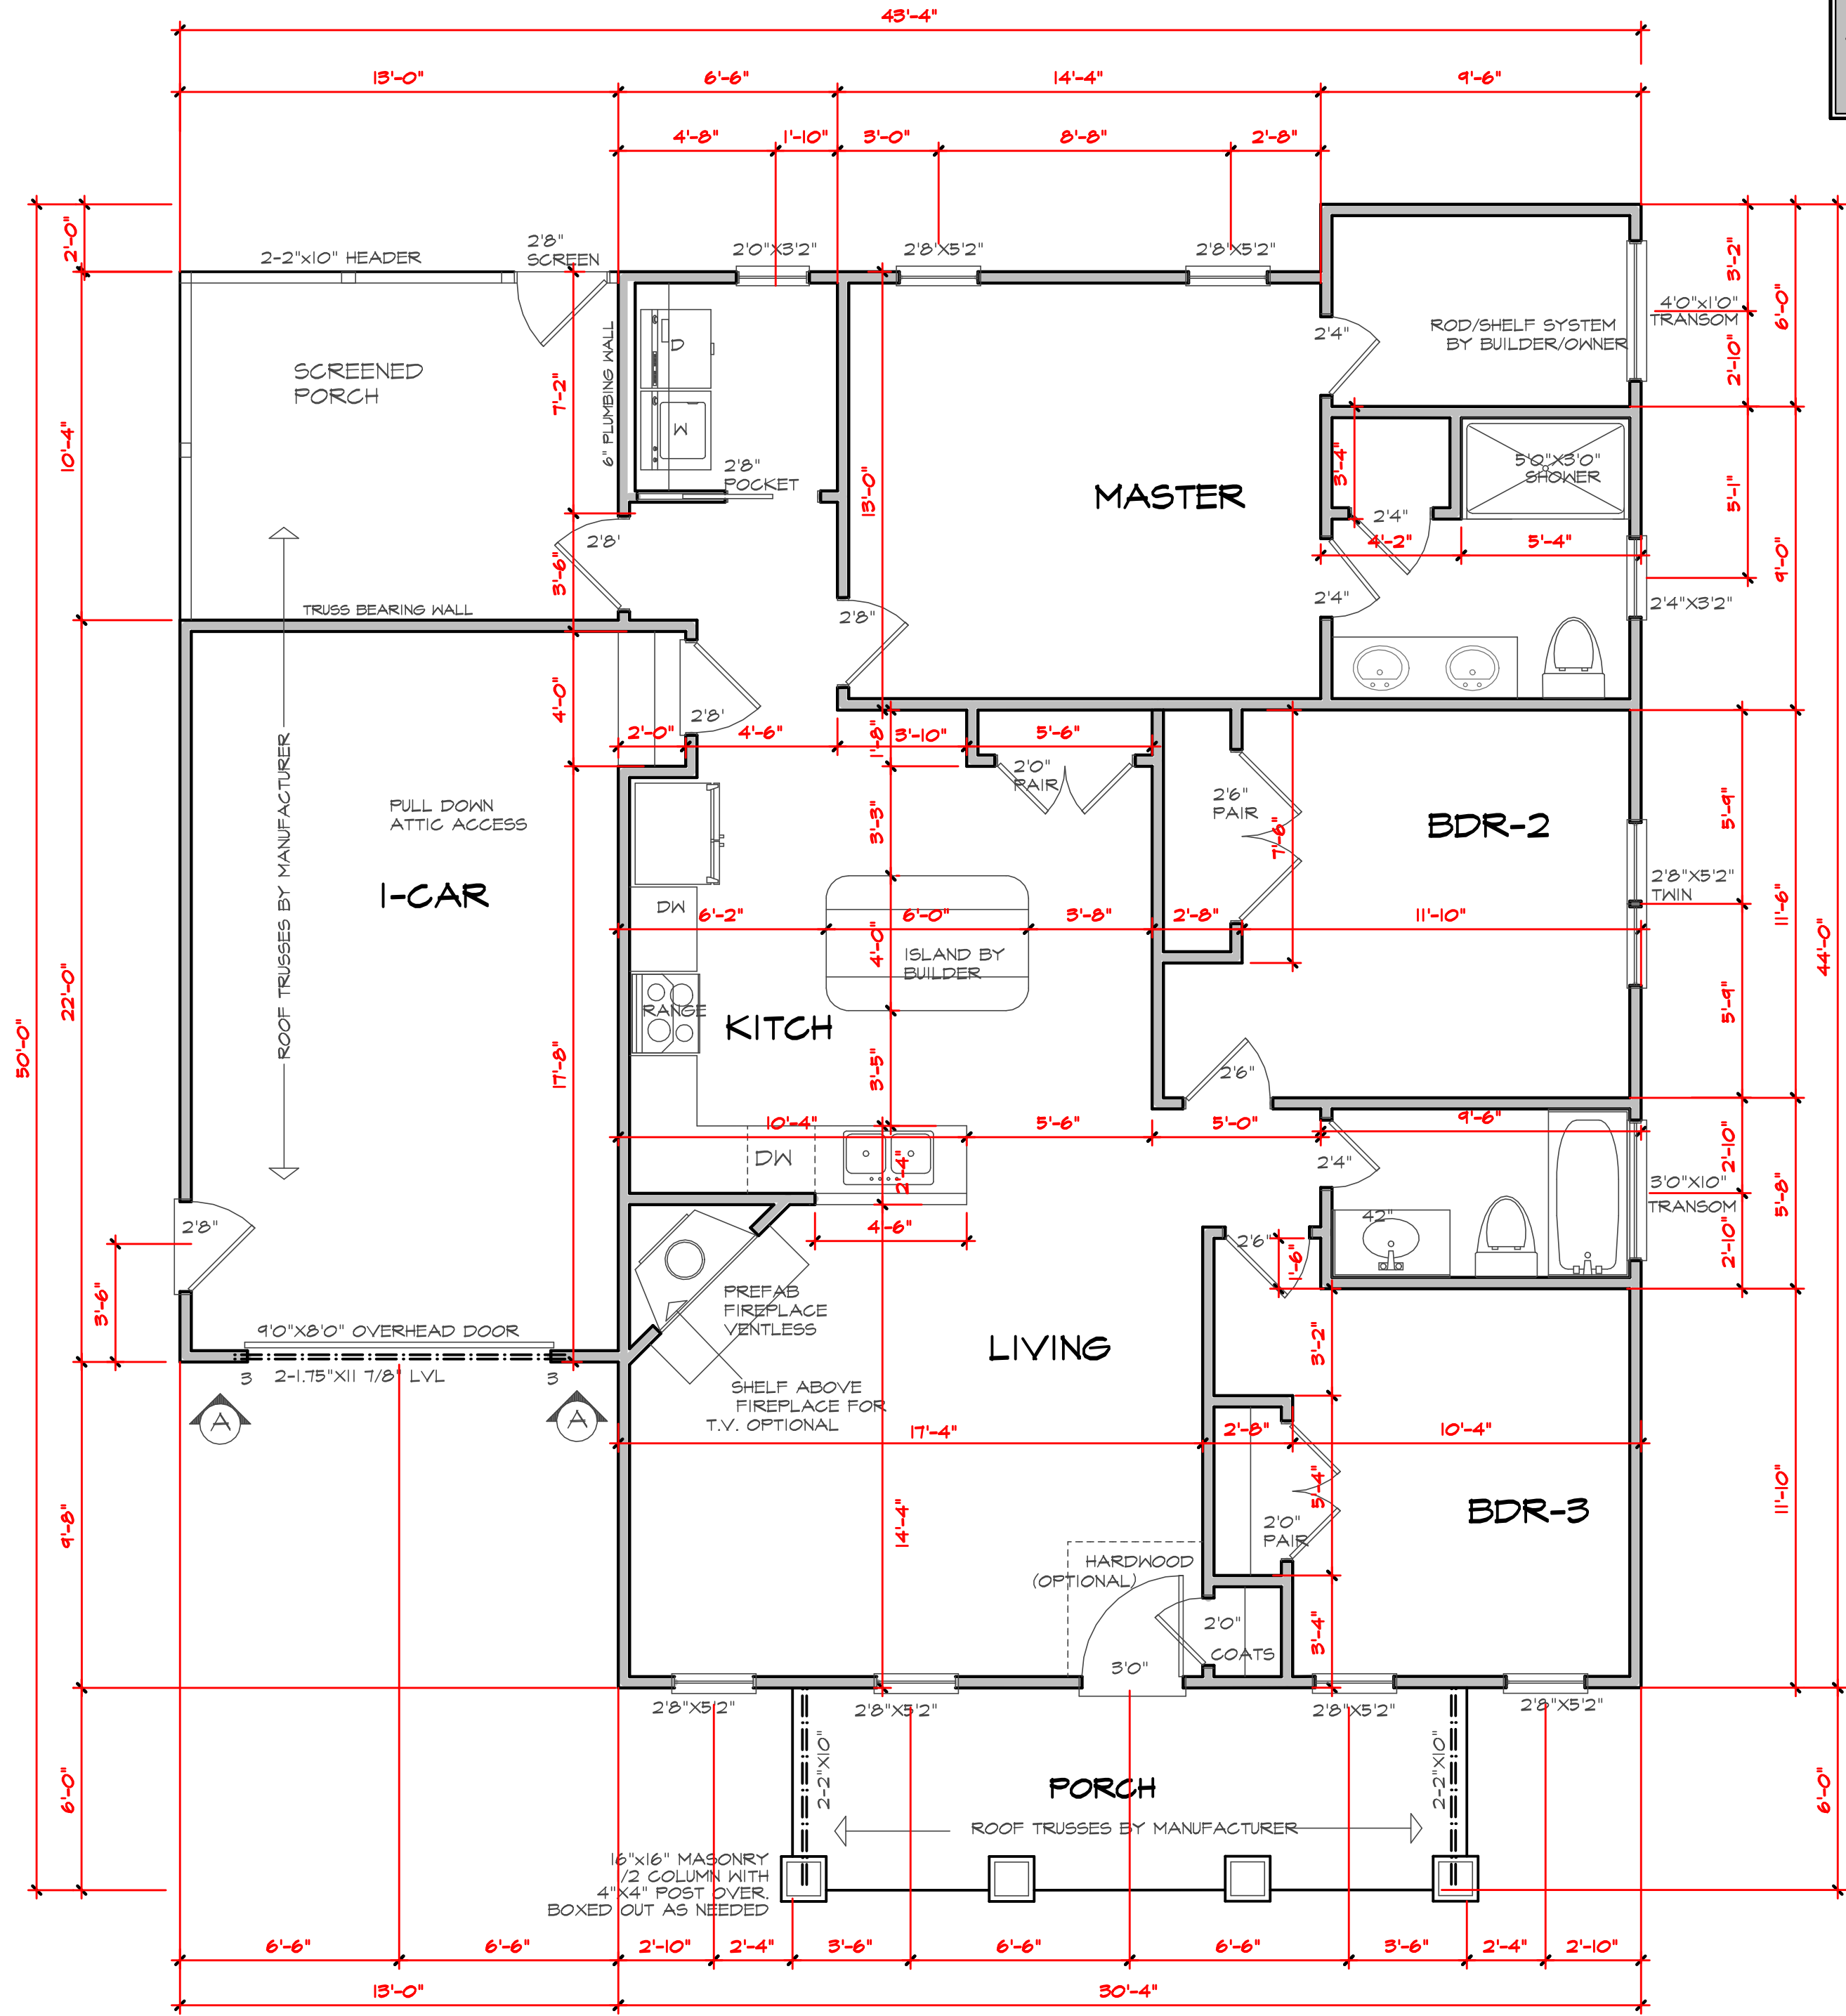

**FLOOR PLAN** SCALE 1/4" = 1'-0"

SQUARE FOOTAGE  
1-FLOOR = 1285  
GARAGE = 239  
SCRN PRCH = 133



Purchaser must verify all dimensions and conditions before beginning construction.


MidTown Designs Inc. assumes no liability for contractors practices and procedures

These drawings are instruments of service and as such shall remain property of the designer


© Copyright 2020  
MidTown Designs Inc.  
All Rights Reserved




MidTown Designs Inc. 1529 Big Falls Dr. Wendell NC 27591 Phone: 919-783-8626 www.midtowndesigns.com

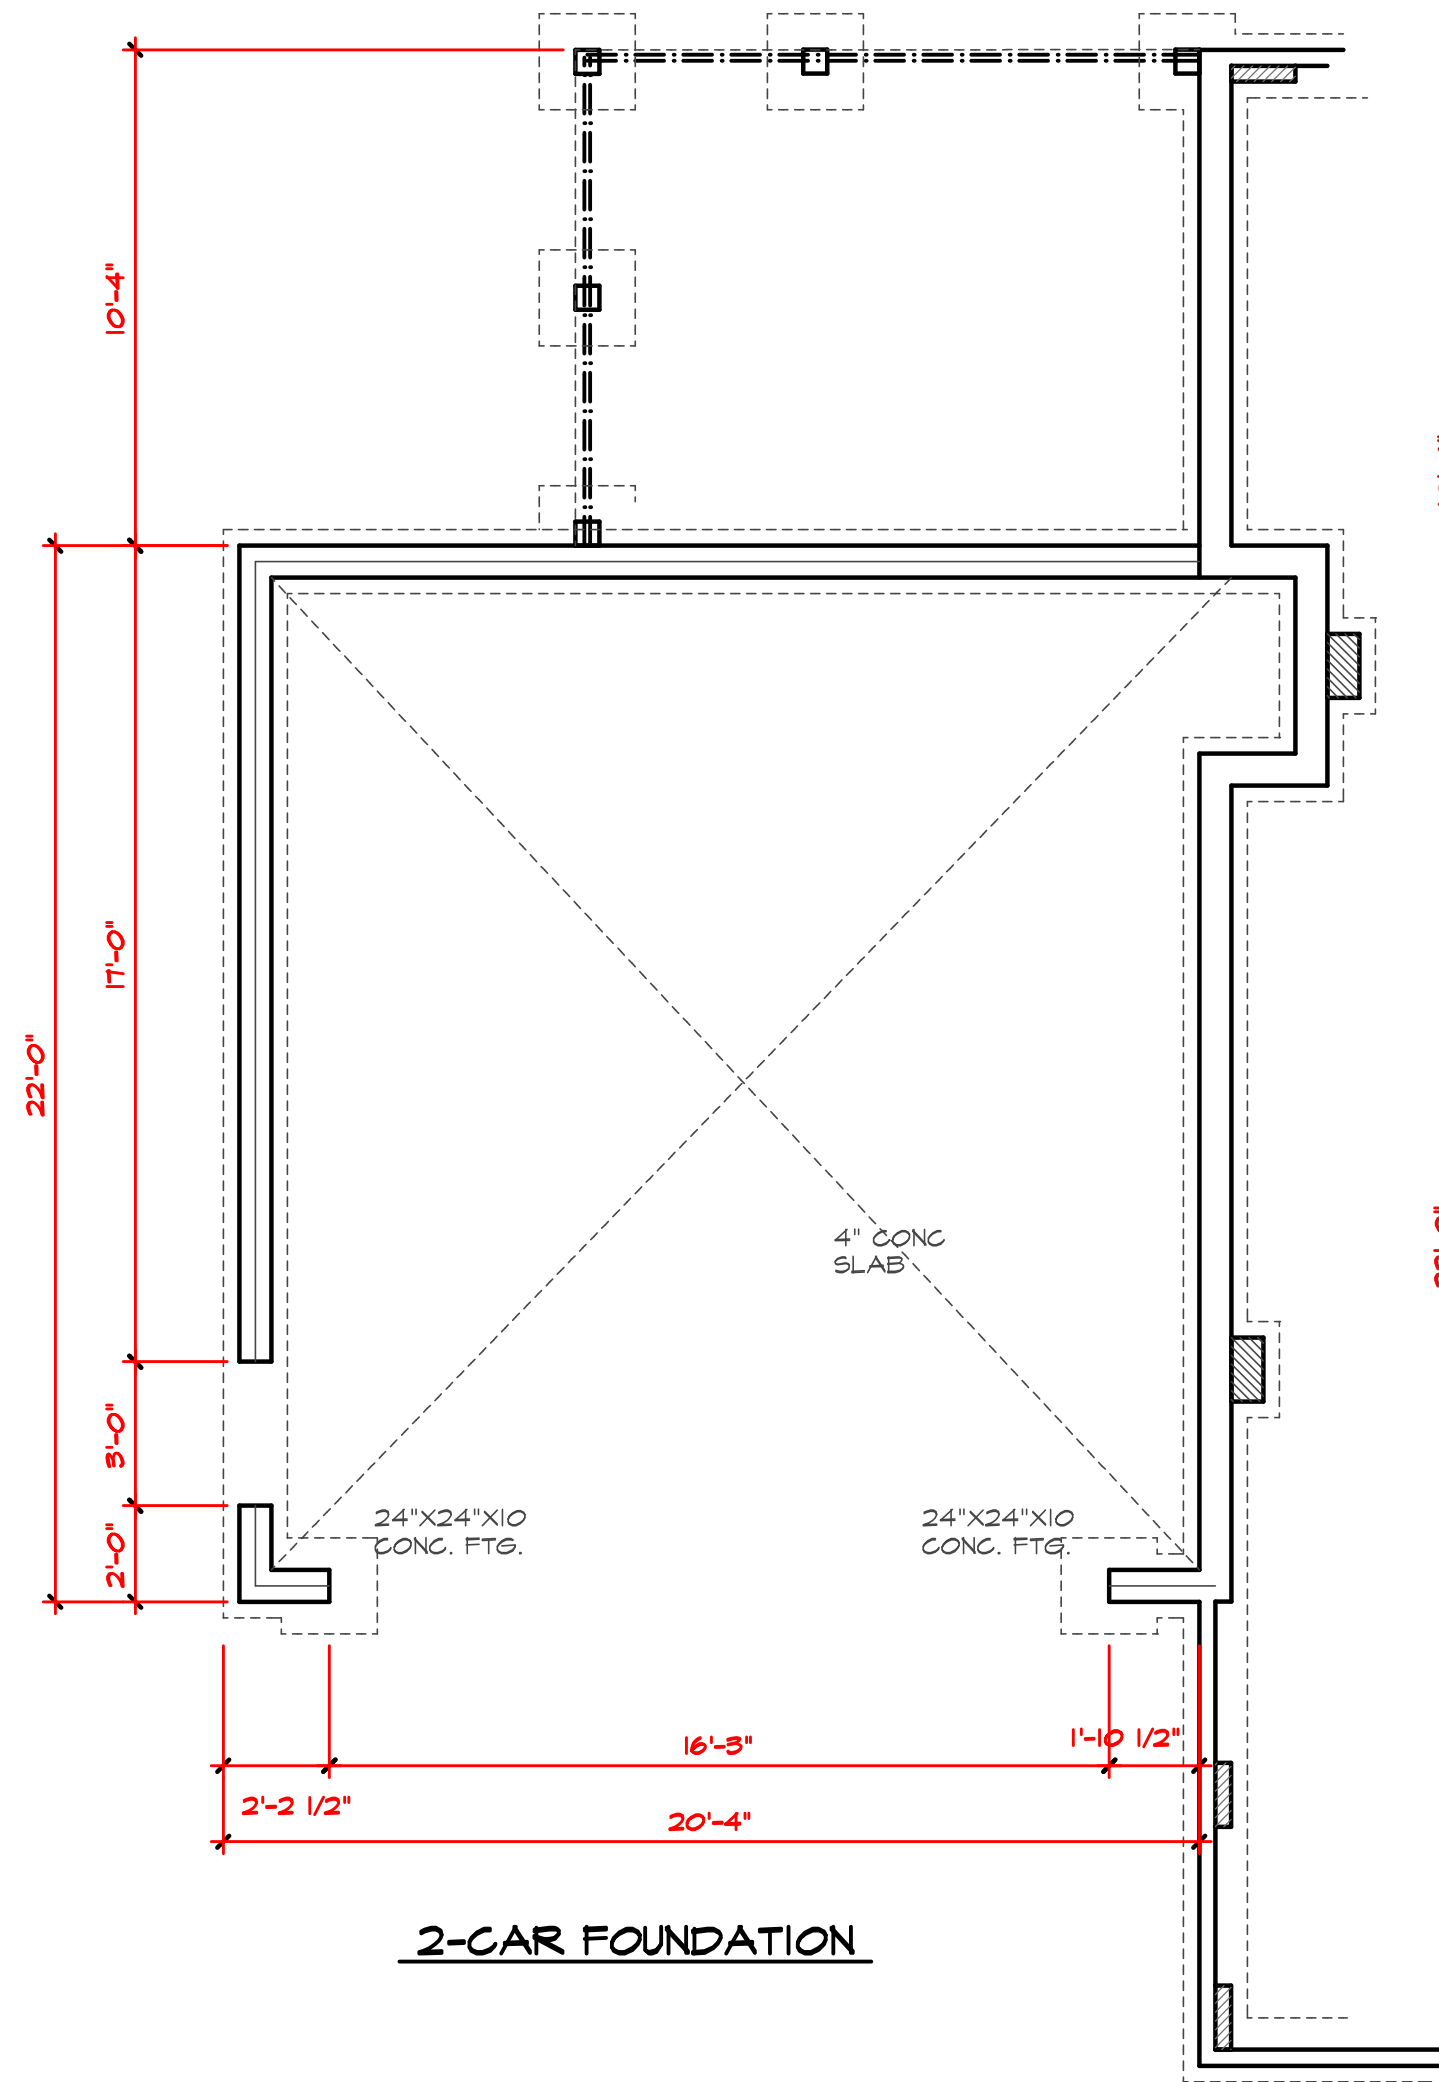

**2-CAR FOUNDATION**

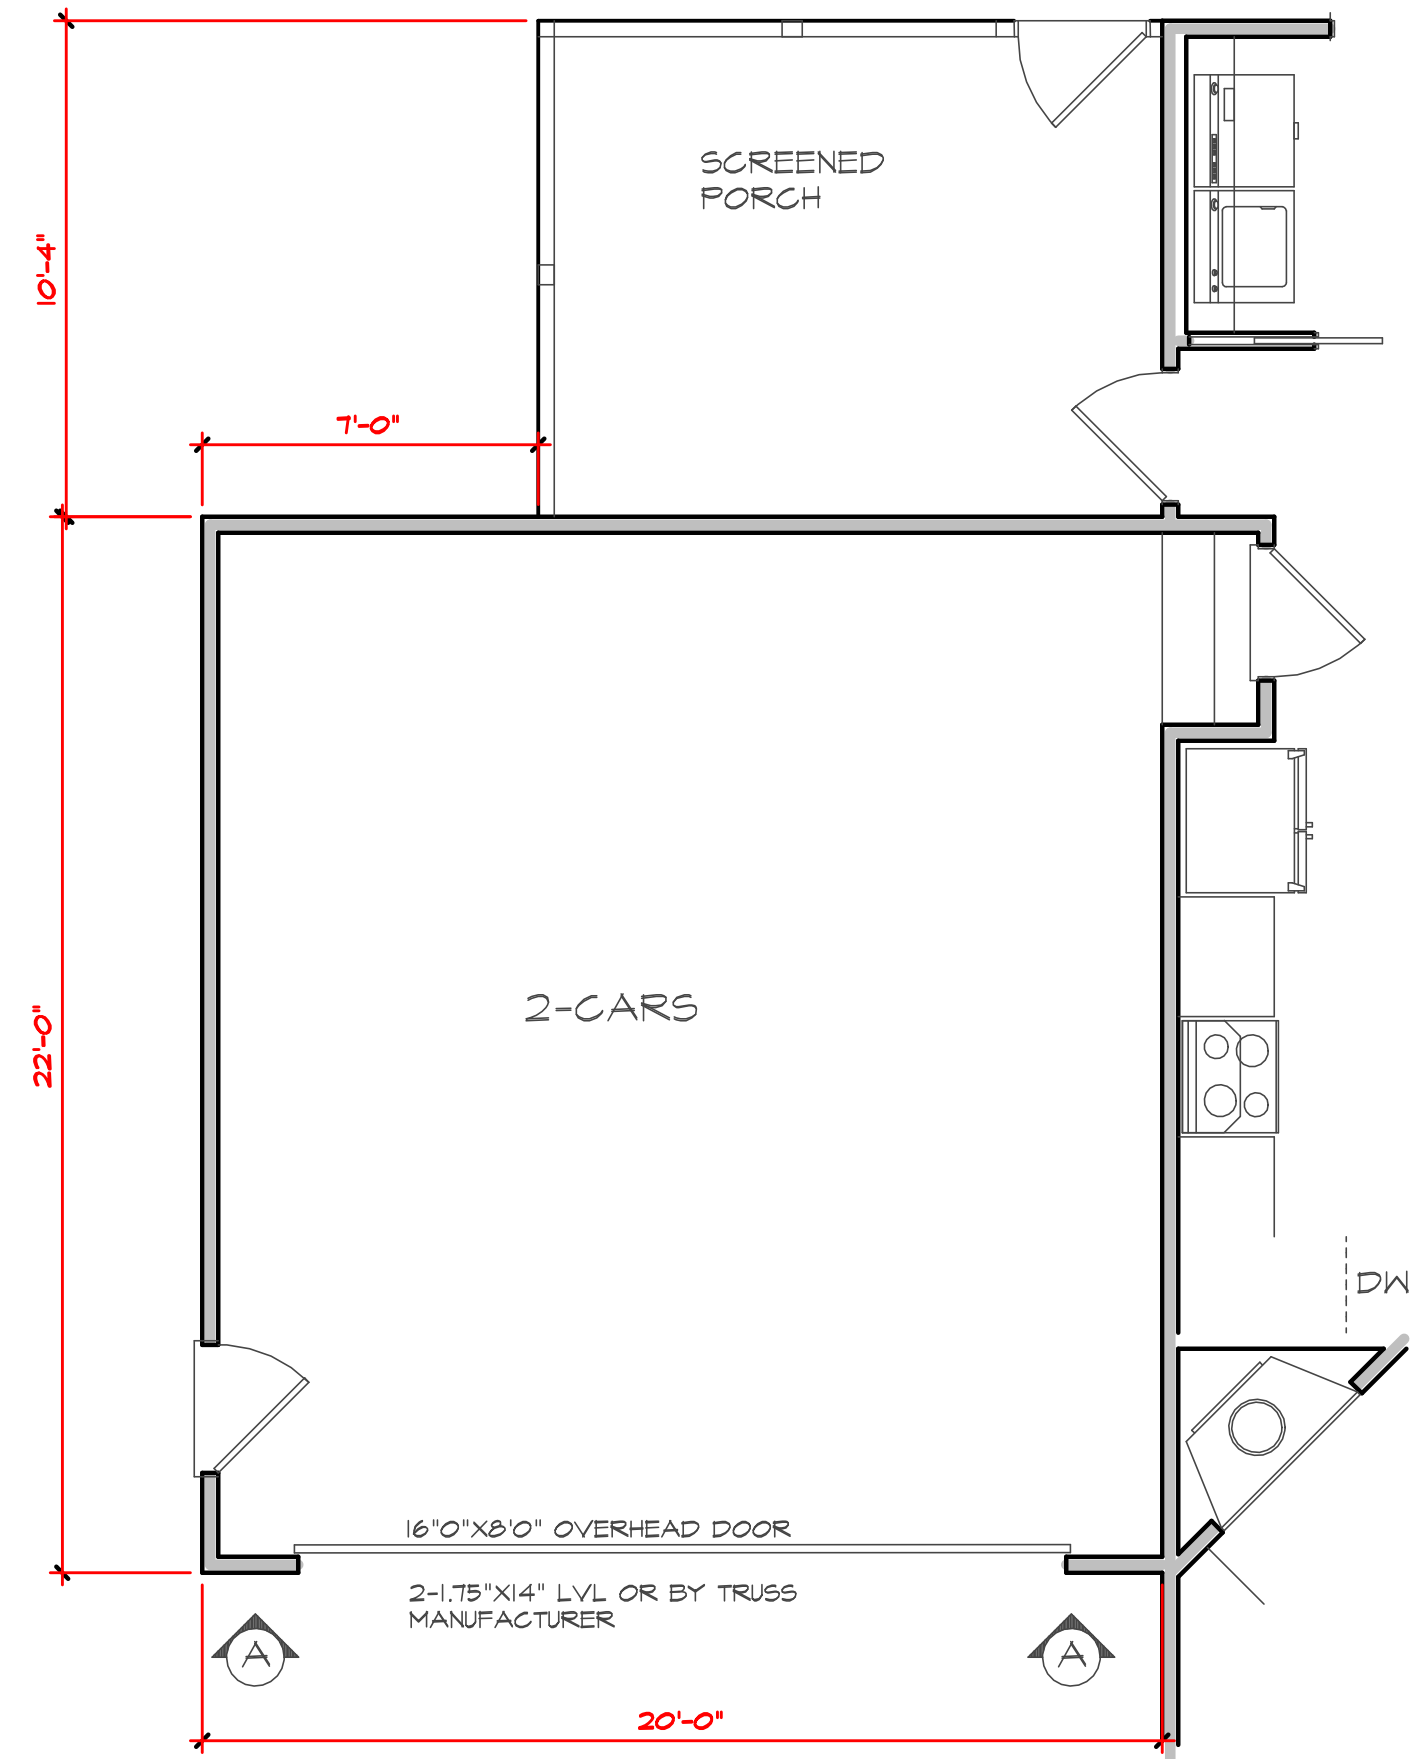

**2-CAR OPTION**

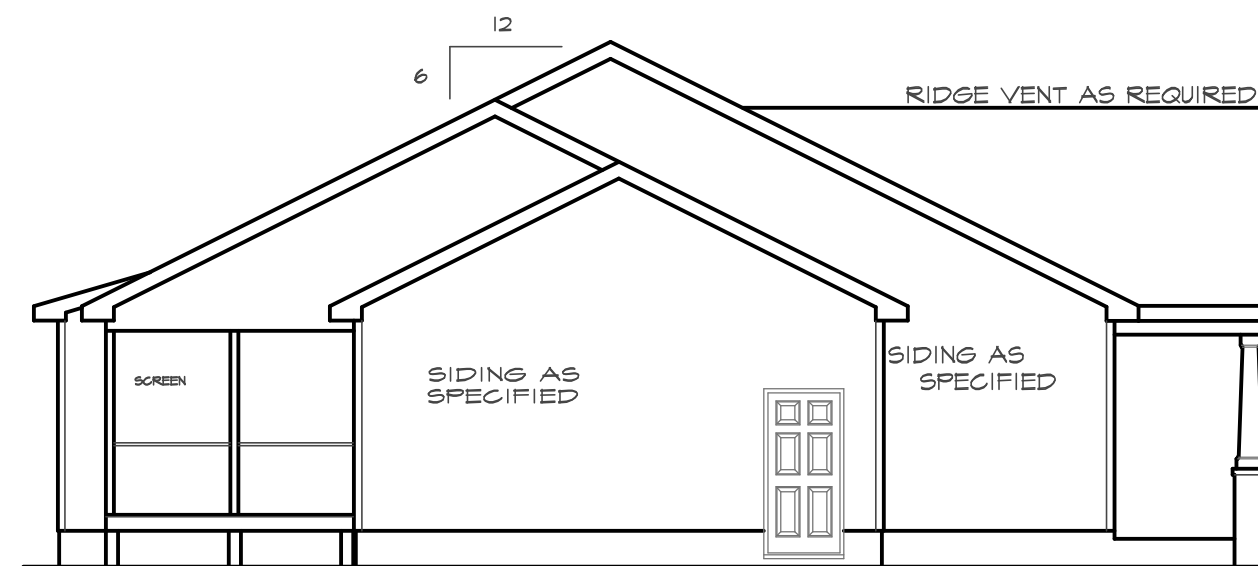

**LEFT SIDE ELEVATION**

SCALE 1/8" = 1'0"



**FRONT ELEVATION 2-CAR OPTION**

DATE	REV	DATE	REV

Copyright MidTown Designs Inc. All Rights Reserved. The Duplication, Reproduction, Copying, Sale, Rental, Licensing, or any other distribution or use of these drawings without the express written authorization of MidTown Designs Inc. is strictly prohibited and is expressly authorized in writing by MidTown Designs Inc.

LOT	SUB.

DATE	11/2/2020
------	-----------

SCALE	
-------	--

PROJECT #	190510
-----------	--------




Purchaser must verify all dimensions and conditions before beginning construction.

MidTown Designs Inc. assumes no liability for contractors practices and procedures

These drawings are instruments of service and as such shall remain property of the designer

© Copyright 2020

MidTown Designs Inc.  
All Rights Reserved

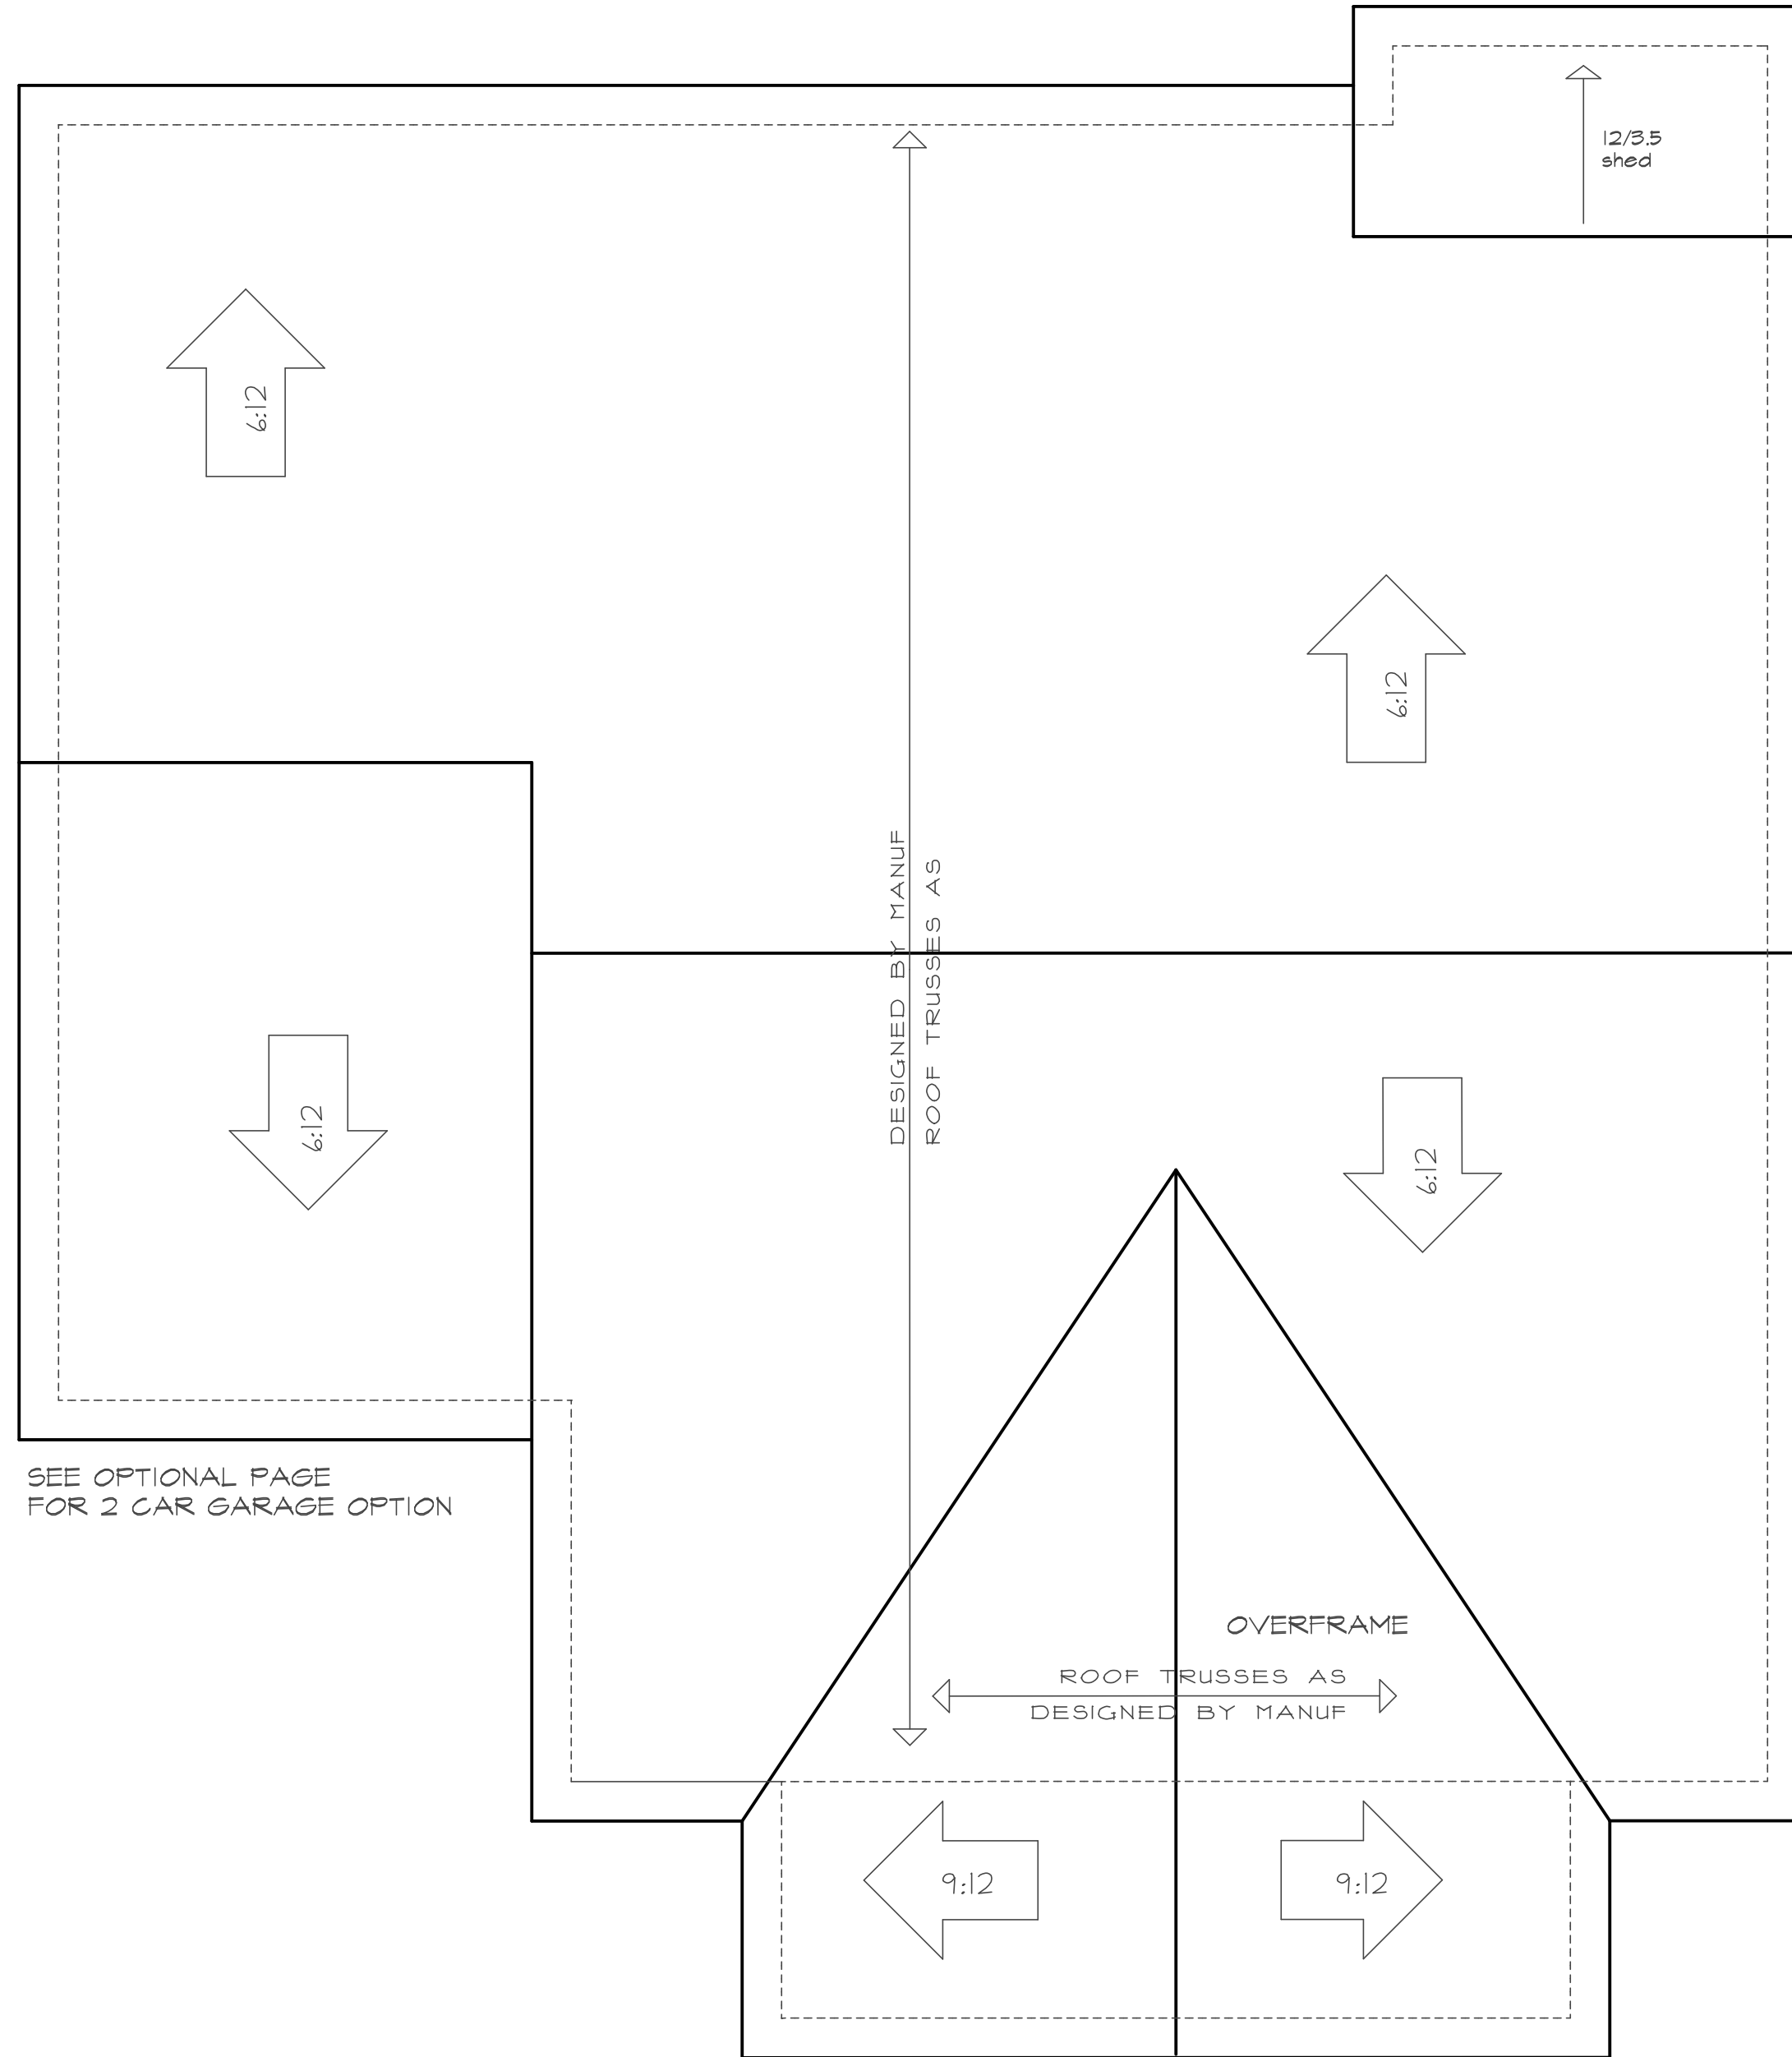

**ROOF PLAN ELEVATION**

SCALE 1/4" = 1'-0"

DATE	REV	DATE	REV

Copyright MidTown Designs Inc. All Rights Reserved. The Duplication, Reproduction, Copying, Sale, Rental, Licensing, or any other distribution or use of this drawing without the express written consent of MidTown Designs Inc. is strictly prohibited unless expressly authorized in writing by MidTown Designs.

LOT	SUB.

DATE	11/2/2020
------	-----------

SCALE	
-------	--

PROJECT #	190510
-----------	--------

**The Bella**  
GARAGE LEFT



**STRUCTURAL NOTES**

- 1) ALL CONSTRUCTION SHALL CONFORM TO THE LATEST REQUIREMENTS OF THE NORTH CAROLINA STATE RESIDENTIAL CODE - 2018 EDITION (2019 IRC), PLUS ALL LOCAL CODES AND REGULATIONS.  
ALL MEMBERS SHALL BE FRAMED, ANCHORED, TIED AND BRACED IN ACCORDANCE WITH GOOD CONSTRUCTION PRACTICE AND THE BUILDING CODE.
- 2) DESIGN LOADS SEE TABLE R301.5
- WIND SPEED: (REFER TO TABLE R301.2.4)  
VERIFY ZONE BEFORE CONSTRUCTION.

3) WALL BRACING: WALLS SHALL BE BRACED ALONG BRACED WALL LINES ACCORDING TO SECTION R602.10. THE AMOUNT, LOCATION, AND CONSTRUCTION OF BRACING SHALL COMPLY WITH R602.10. NOTE THAT THE BRACING SHOWN ON THE PLANS IS BASED ON THE PRESCRIBED BRACING REQUIREMENTS OF THE CODE AND SHALL BE VERIFIED AND/OR APPROVED BY THE CODE OFFICIAL.

4) CONCRETE SHALL HAVE A MINIMUM 28 DAY STRENGTH OF 3000 PSI AND A MAXIMUM SLUMP OF 5 INCHES UNLESS NOTED OTHERWISE (UNO). AIR ENTRAINMENT PER TABLE 402.2. ALL CONCRETE SHALL BE PROPORTIONED, MIXED, HANDLED, SAMPLED, TESTED AND PLACED IN ACCORDANCE WITH ACI STANDARDS. ALL SAMPLES FOR PUMPING SHALL BE TAKEN FROM THE EXIT END OF THE PUMP.

5) ALLOWABLE SOIL BEARING PRESSURE ASSUMED TO BE 2000 PSF. THE CONTRACTOR MUST CONTACT A GEOTECHNICAL ENGINEER AND THE STRUCTURAL ENGINEER IF UNSATISFACTORY SUBSURFACE CONDITIONS ARE ENCOUNTERED. THE SURFACE AREA ADJACENT TO THE FOUNDATION WALL SHALL BE PROVIDED WITH ADEQUATE DRAINAGE, AND SHALL BE GRADED SO AS TO DRAIN SURFACE WATER AWAY FROM FOUNDATION WALLS.

6) ALL FRAMING LUMBER SHALL BE SPF #2 (FB = 875 PSI) UNLESS NOTED OTHERWISE (UNO). ALL TREATED LUMBER SHALL BE SYP #2 (FB=975 PSI). PLATE MATERIAL MAY BE SPF #3 OR SYP #3 (FC/PERP = 425 PSI - MIN).

7) ALL WOODEN BEAMS AND HEADERS SHALL HAVE THE FOLLOWING END SUPPORTS: (1) 2X4 STUD COLUMN FOR 6'-0" MAX. BEAM SPAN (UNO), (2) 2X4 STUDS FOR BEAM SPAN GREATER THAN 6'-0" (UNO).

8) L.V.L SHALL BE LAMINATED VENEER LUMBER: FB=2600 PSI, FV=285 PSI, E=1,900,000 PSI, P.S.L SHALL BE PARALLEL STRAND LUMBER: FB=2900 PSI, FV=290 PSI, E=2,000,000 PSI. L.S.L SHALL BE LAMINATED STRAND LUMBER: FB=2250 PSI, FV=440 PSI, E=1,550,000 PSI. INSTALL ALL CONNECTIONS PER MANUFACTURER'S INSTRUCTIONS.

9) ALL ROOF TRUSS AND I-JOIST LAYOUTS SHALL BE PREPARED IN ACCORDANCE WITH THE SEALED STRUCTURAL DRAWINGS. TRUSSES AND I-JOISTS SHALL BE INSTALLED ACCORDING TO THE MANUFACTURER'S SPECIFICATIONS.

10) ALL STRUCTURAL STEEL SHALL BE ASTM A-36. STEEL BEAMS SHALL BE SUPPORTED AT EACH END WITH A MINIMUM BEARING LENGTH OF 3 1/2" INCHES AND FULL FLANGE WIDTH. PROVIDE SOLID BEARING FROM BEAM SUPPORT TO FOUNDATION. BEAMS SHALL BE ATTACHED TO EACH SUPPORT WITH TWO LAG SCREWS (1/2" DIAMETER X 4" LONG). LATERAL SUPPORT IS CONSIDERED ADEQUATE PROVIDED THE JOIST ARE TOE NAILED TO THE SOLE PLATE, AND SOLE PLATE IS NAILED OR BOLTED TO THE BEAM FLANGE @ 48" O.C. ALL STEEL TUBING SHALL BE ASTM A500.

11) REBAR SHALL BE DEFORMED STEEL. ASTM615, GRADE 60.

12) FLITCH BEAMS SHALL BE BOLTED TOGETHER USING (2) ROWS OF 1/2" DIAMETER BOLTS (ASTM A307) WITH WASHERS PLACED UNDER THE THREADED END OF BOLT. BOLTS SHALL BE SPACED AT 24" O.C. (MAX), AND STAGGERED AT THE TOP AND BOTTOM OF BEAM (2" EDGE DISTANCE), WITH 2 BOLTS LOCATED AT 6" FROM EACH END.

13) BRICK LINTELS SHALL BE 3 1/2"X3 1/2"X1/4" STEEL ANGLE FOR UP TO 6'-0" SPAN AND 6"X4"X5/16" STEEL ANGLE WITH 6" LEG VERTICAL FOR SPANS UP TO 9'-0" (UNO).

14) THE POSITIVE AND NEGATIVE DESIGN PRESSURE FOR DOORS AND WINDOWS SEE R301.2(6)

**DWELLING / GARAGE SEPARATION**

REFER TO SECTIONS R302.3, R302.6, AND R302.7

**WALLS.** A minimum 1/2" gypsum board must be installed on all walls supporting floor/ceiling assemblies used for separation required by this section.

**STAIRS.** A minimum of 1/2" gypsum board must be installed on the underside and exposed sides of all stairways.

**CEILING.** A minimum of 1/2" gypsum must be installed on the garage ceiling if there are no habitable room above the garage. If there are habitable room above the garage a minimum of 5/8" type X gypsum board must be installed on the garage ceiling.

**OPENING PENETRATIONS.** Openings between the garage and residence shall be equipped with solid wood doors not less than 1 3/8 inches (35 mm) in thickness, solid or honeycomb core steel doors not less than 1 3/8 inches (35 mm) thick, or 20-minute fire-rated doors.


**DUCT PENETRATIONS.** Ducts in the garage and ducts penetrating the walls or ceilings separating the dwelling from the garage shall be constructed of a minimum No. 26 gage (0.48 mm) sheet steel or other approved material and shall have no openings into the garage.

**OTHER PENETRATIONS.** Penetrations through the separation required in Section R302.6 shall be protected as required by Section R302.11, Item 4.

**ATTIC ACCESS**

**SECTION R807**  
R807.1 Attic access. An attic access opening shall be provided to attic areas that exceed 400 square feet (37.16 m<sup>2</sup>) and have a vertical height of 60 inches (1524 mm) or greater. The net clear opening shall not be less than 20 inches by 30 inches (508 mm by 762 mm) and shall be located in a hallway or other readily accessible location. A 30-inch (762 mm) minimum unobstructed headroom in the attic space shall be provided at some point above the access opening. See Section M1305.1.3 for access requirements where mechanical equipment is located in attics.

**Exceptions:**  
1. Concealed areas not located over the main structure including porches, areas behind knee walls, dormers, bay windows, etc. are not required to have access.  
2. Pull down stair treads, stringers, handrails, and hardware may protrude into the net clear opening.



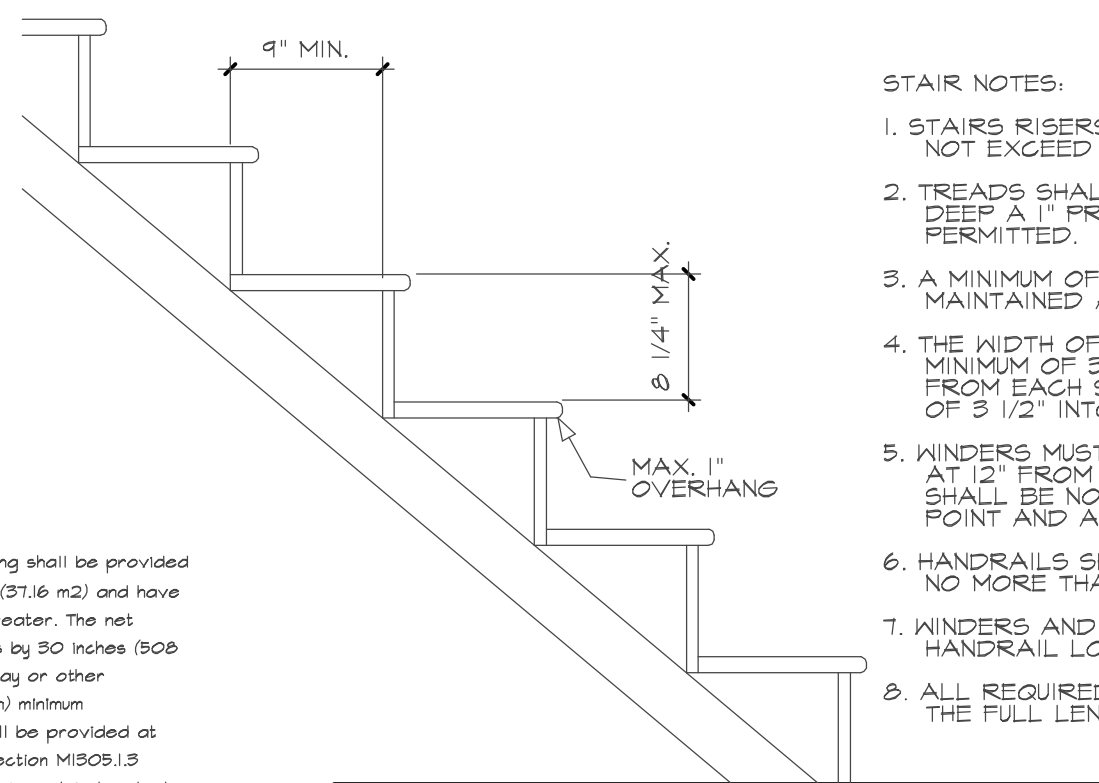


**STAIR DETAIL**


NO SCALE

**STAIR NOTES:**

1. STAIRS RISERS MUST BE UNIFORM AND NOT EXCEED 8 1/4".
2. TREADS SHALL NOT BE LESS THAN 10" DEEP A 1" PROJECTION OVER RISER IS PERMITTED.
3. A MINIMUM OF 6'8" HEADROOM MUST BE MAINTAINED AT ALL PLACES ON STAIR.
4. THE WIDTH OF THE STAIR SHALL BE A MINIMUM OF 3'0". HANDRAIL MAY PROJECT FROM EACH SIDE OF STAIR A DISTANCE OF 3 1/2" INTO THE REQUIRED WIDTH.
5. HANDRAILS SHALL BE A MINIMUM OF 9" IN WIDTH AT 12" FROM THE NARROWEST SIDE. TREAD SHALL BE NO NARROWER THAN 4" AT ANY POINT AND AVERAGE NO LESS THAN 9 INCHES.
6. HANDRAILS SHALL BE NO LESS THAN 34" AND NO MORE THAN 38" ABOVE TREAD NOSING.
7. HANDRAILS AND SPIRAL STAIRS SHALL HAVE THE HANDRAIL LOCATED ON THE OUTSIDE RADIUS.
8. ALL REQUIRED HANDRAILS SHALL BE CONTINUOUS THE FULL LENGTH OF THE STAIRS.

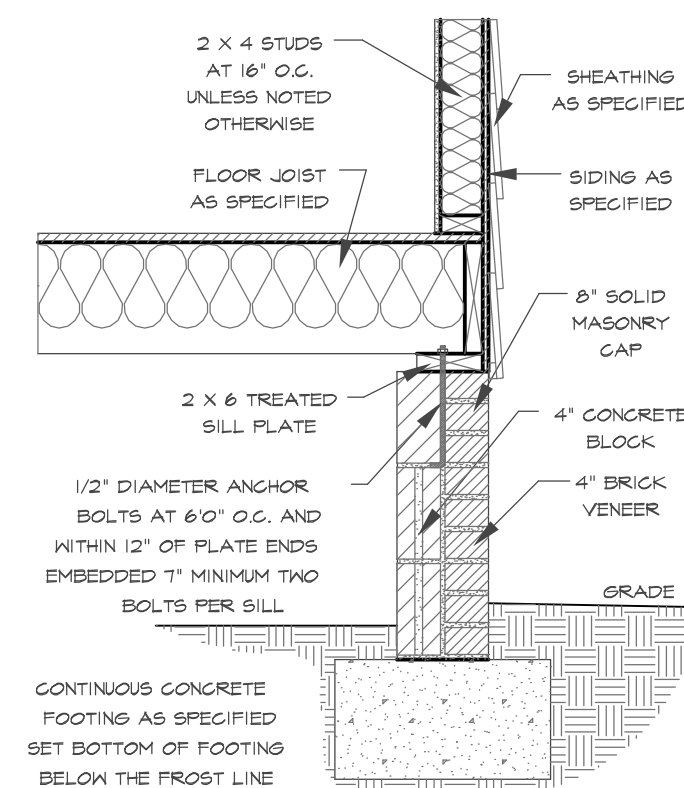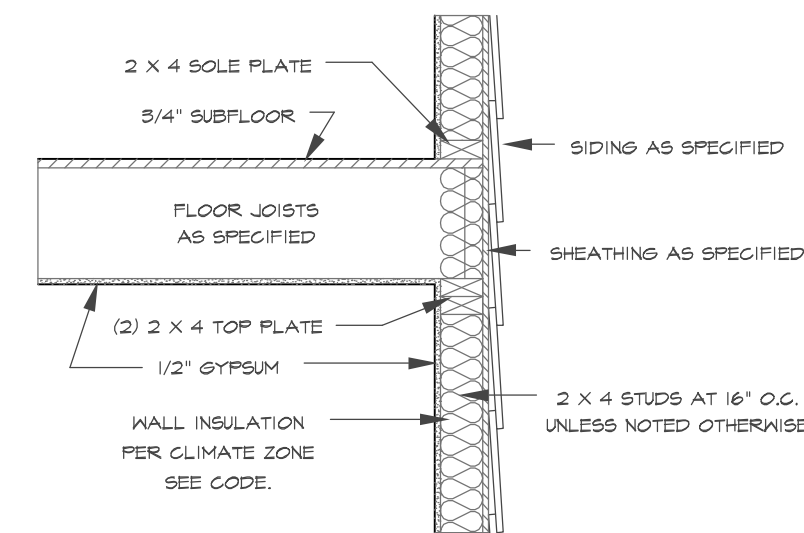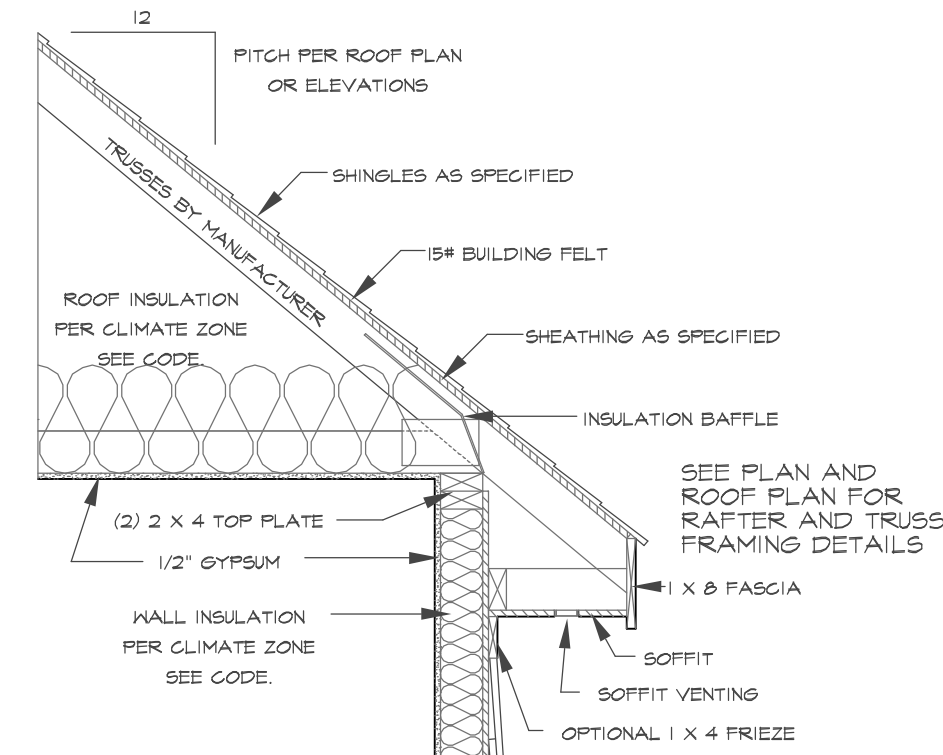


**TYPICAL WALL SECTION**  
SCALE 3/4" = 1'-0"

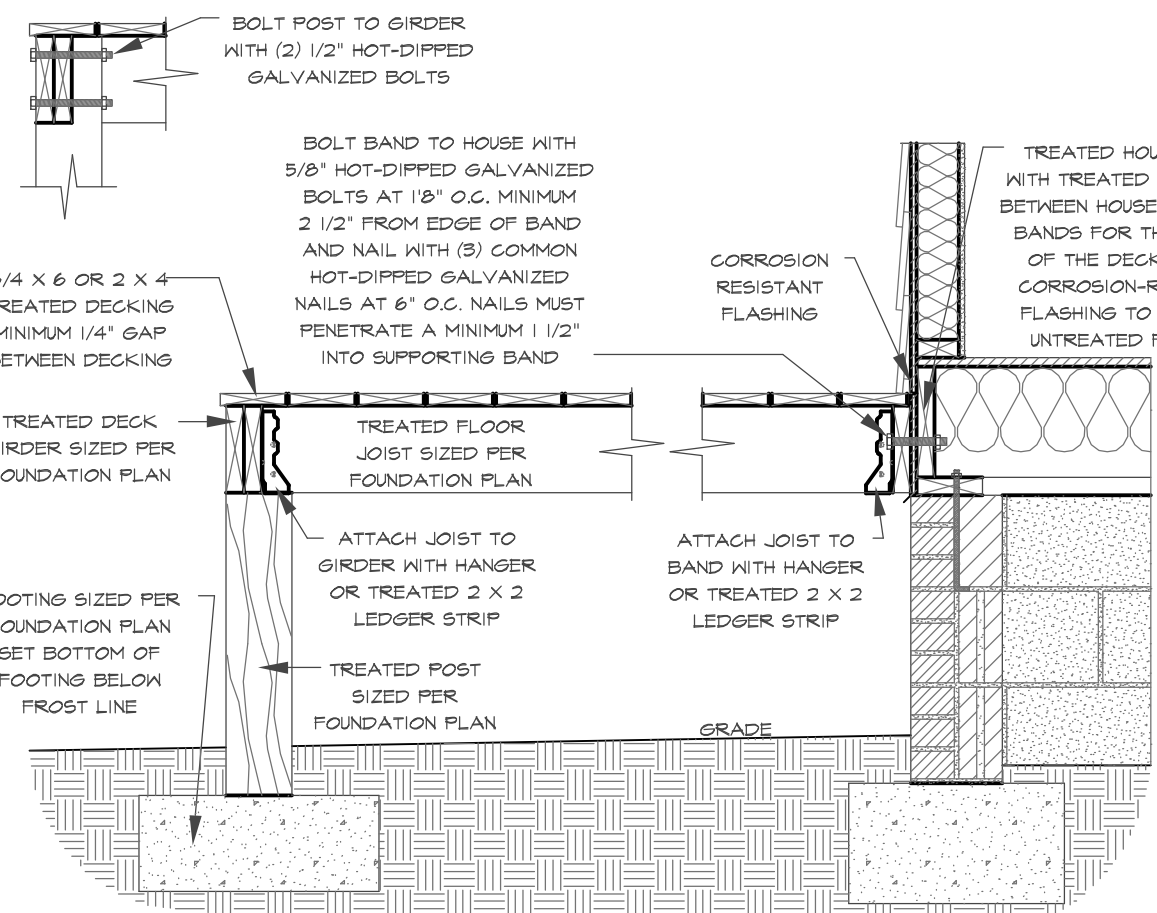


**DECK ATTACHMENT DETAIL TO FRAMED WALL**


SCALE 3/4" TO 1'-0"

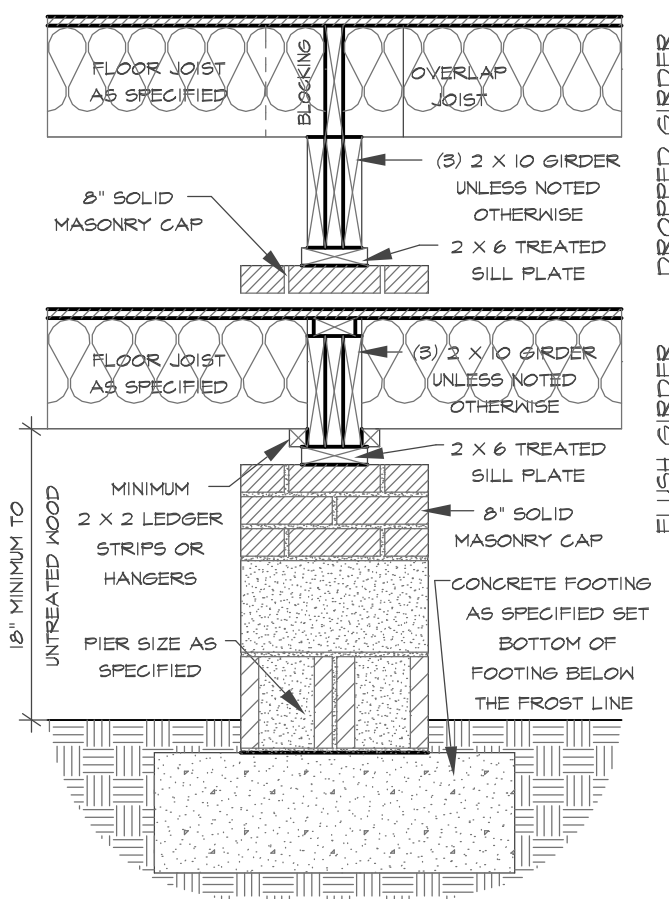

**DROPPED/ FLUSH PIER**  
SCALE 3/4" = 1'-0"

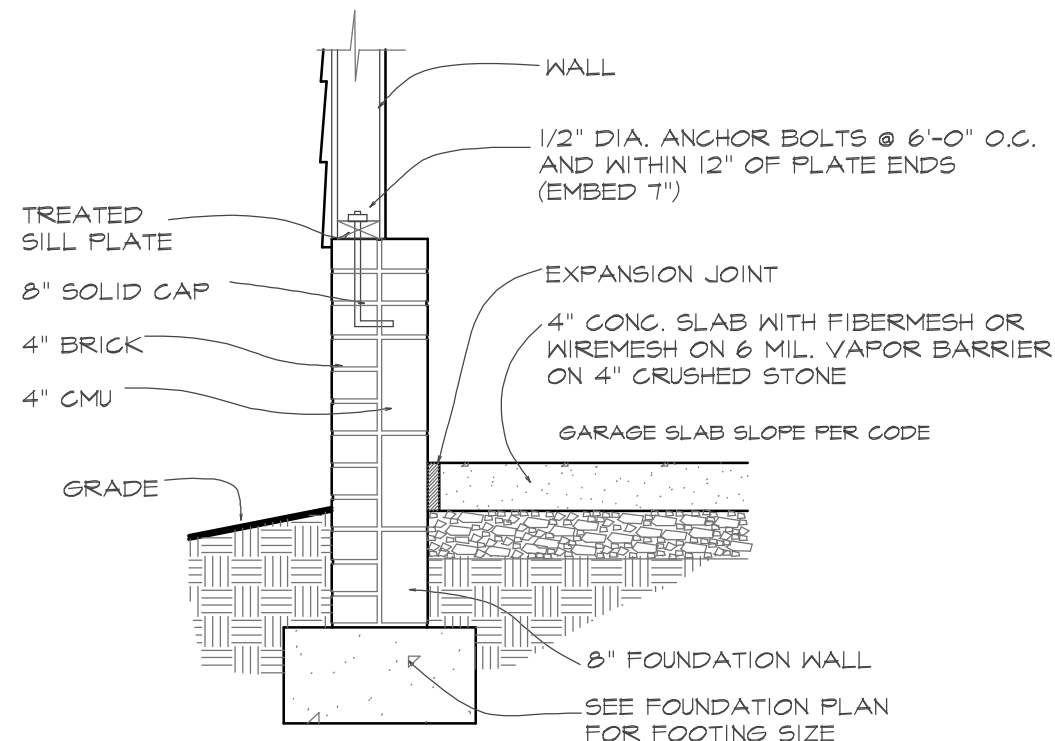

**SECTION AT GARAGE SLAB**

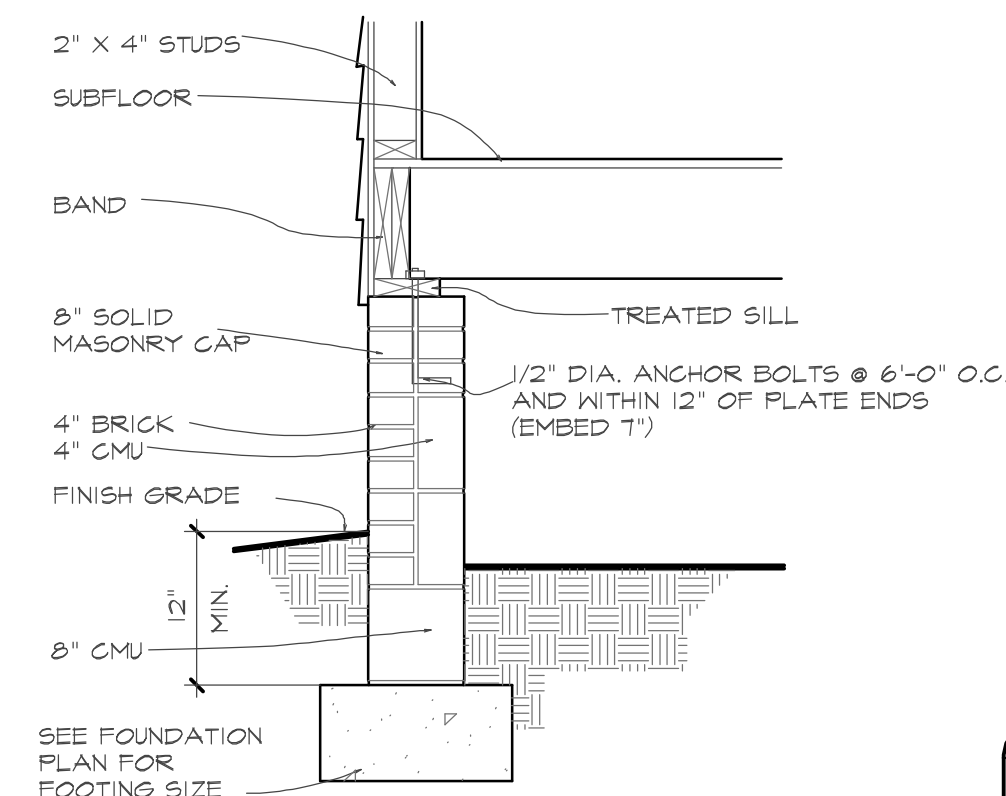

**SECTION AT CRAWL**

**TABLE R402.1.2 INSULATION AND FENESTRATION REQUIREMENTS BY COMPONENT\***

CLIMATE ZONE	FENESTRATION U-FACTOR <sup>a</sup>	SKYLIGHT U-FACTOR <sup>a</sup>	GLAZED FENESTRATION SHGC <sup>b</sup>	CEILING R-VALUE <sup>c</sup>	WOOD FRAME WALL R-VALUE	MASS WALL R-VALUE	FLOOR R-VALUE	BASEMENT WALL R-VALUE	SLAB R-VALUE & DEPTH	CRAWL SPACE WALL R-VALUE
3	0.35	0.55	0.30	38 or 30ci <sup>d</sup>	15 or 13+2.5 <sup>e</sup>	5/13 or 5/10ci	19	5/13 <sup>f</sup>	0	5/13
4	0.35	0.55	0.30	38 or 30ci <sup>d</sup>	15 or 13+2.5 <sup>e</sup>	5/13 or 5/10ci	19	10/15	10	10/15
5	0.35	0.55	NR	38 or 30ci <sup>d</sup>	19 <sup>g</sup> or 13+5 <sup>h</sup> or 15+3 <sup>h</sup>	13/17 or 13/12.5ci	30 <sup>f</sup>	10/15	10	10/15

**TABLE R402.1.4 EQUIVALENT U-FACTORS\***

CLIMATE ZONE	FENESTRATION U-FACTOR <sup>a</sup>	SKYLIGHT U-FACTOR <sup>a</sup>	CEILING U-FACTOR <sup>a</sup>	FRAME WALL U-FACTOR <sup>a</sup>	MASS WALL U-FACTOR <sup>a</sup>	FLOOR U-FACTOR <sup>a</sup>	BASEMENT WALL U-FACTOR <sup>a</sup>	CRAWL SPACE WALL U-FACTOR <sup>a</sup>
3	0.35	0.55	0.030	0.077	0.141	0.047	0.091 <sup>c</sup>	0.136
4	0.35	0.55	0.030	0.077	0.141	0.047	0.059	0.065
5	0.35	0.55	0.030	0.061	0.082	0.033	0.059	0.065

a. Nonfenestration U-factors shall be obtained from measurement, calculation or an approved source.  
b. When more than half the insulation is on the interior, the mass wall U-factors shall be a maximum of 0.07 in Climate Zone 3, 0.07 in Climate Zone 4 and 0.054 in Climate Zone 5.  
c. Basement wall U-factor of 0.360 in warm-humid locations as defined by Figure R301.1 and Table R301.1.  
d. A maximum of two glazed fenestration product assemblies having a U-factor no greater than 0.55 and a SHGC no greater than 0.70 shall be permitted to be substituted for minimum code compliant fenestration product assemblies without penalty. When applying this note and using the REScheck "UA Trade-off" compliance method to allow continued use of the software, the applicable fenestration products shall be modeled as meeting the U-factor of 0.35 and the SHGC of 0.30, as applicable, but the fenestration products actual U-factor and actual SHGC shall be noted in the comments section of the software for documentation of application of this note to the applicable products. Compliance for these substitute products shall be verified compared to the allowed substituted maximum U-value requirement and maximum SHGC requirement, as applicable.

Purchaser must verify all dimensions and conditions before beginning construction.

MidTown Designs Inc. assumes no liability for contractor practices and procedures

These drawings are instruments of service and as such shall remain property of the designer

© Copyright 2019

MidTown Designs Inc. All Rights Reserved

**Detail Sheet**

DATE	REV	DATE	REV

LOT SUB

DATE 1/16/2019

SCALE

Copyright MidTown Designs Inc. All Rights Reserved. This Publication, Reproduction, Copying, Sale, Rental, Lending, or any other distribution or use of this document is strictly prohibited unless expressly authorized in writing by MidTown Designs.