

# Harnett County Department of Public Health

## Operation Permit

PERMIT # SFD 2611-COST 2

New Installation    Septic Tank    Nitrification Line    Repair    Expansion

PROPERTY LOCATION: 133 OLD GUYES CREEK RD - 6A1542

Name: (owner) BALZFOOT BLDG CO   SUBDIVISION C M JOHNSON   LOT # T2-D

System Installer: KIRBY JOHNSON

Basement with plumbing:  Garage  Number of Bedrooms 3


Type of Water Supply:  Community    Public    Well   Distance from well NA feet

System Type: 2 1/2% INJECTION SYS. - III   Types V and VI Systems expire in 5 years.

(In accordance with Table V a)

Owner must contact Health Department 6 months prior to expiration for permit renewal.

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

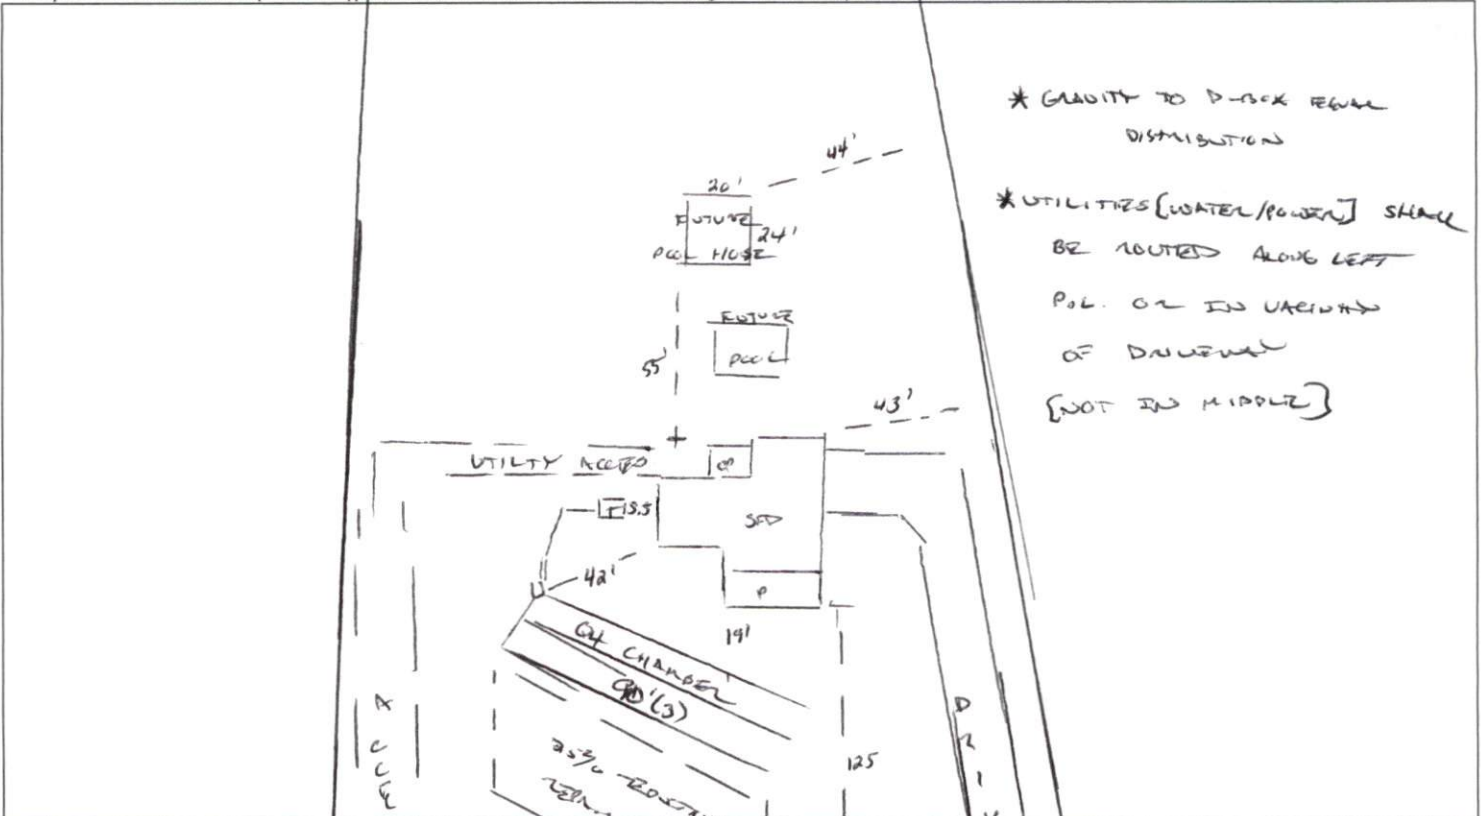

**PERMIT CONDITIONS:**

- I. Performance: System shall perform in accordance with Rule .1961.
- II. Monitoring: As required by Rule .1961.
- III. Maintenance: As required by Rule .1961; Other: \_\_\_\_\_  
 Subsurface system operator required? Yes  No   
 If yes, see attached sheet for additional operation conditions, maintenance and reporting.

- IV. Operation: \_\_\_\_\_
- V. Other: \_\_\_\_\_

D-Box    Pump    Alarm    H2O Line    PWR Line

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system:  Conventional    Other 2 1/2% INJECTION CHAMBER   Septic Tank: 1250 gallons   Pump Tank: \_\_\_\_\_ gallons  
 Subsurface   No. of   exact length   width of   depth of  
 Drainage Field   ditches 3   of each ditch 50 feet   ditches 3 feet   ditches 24 inches  
 French Drain Required: \_\_\_\_\_ Linear feet

Authorized State Agent [Signature]   Date 04/21/2022