



# ROOF & FLOOR TRUSSES & BEAMS

Reilly Road Industrial Park  
Fayetteville, N.C. 28309  
Phone: (910) 864-8787  
Fax: (910) 864-4444


Bearing reactions less than or equal to 3000# are deemed to comply with the prescriptive Code requirements. The contractor shall refer to the attached Tables ( derived from the prescriptive Code requirements ) to determine the minimum foundation size and number of wood studs required to support reactions greater than 3000# but not greater than 15000#. A registered design professional shall be retained to design the support system for any reaction that exceeds those specified in the attached Tables. A registered design professional shall be retained to design the support system for all reactions that exceed 15000#.

Signature David Landry  
David Landry

### LOAD CHART FOR JACK STUDS

(BASED ON TABLES ROU511C & 12)

NUMBER OF JACK STUDS REQUIRED @ EA END OF HEADERS/STROPS		NUMBER OF JACK STUDS REQUIRED @ EA END OF HEADERS/STROPS	
END REACTION (IP TO)	REQ'D STUDS FOR 10' PLACEMENT	END REACTION (IP TO)	REQ'D STUDS FOR 10' PLACEMENT
1700	1	2550	1
3400	2	5100	2
5100	3	7650	3
6800	4	10200	4
8500	5	12750	5
10200	6	15300	6
11900	7		
13600	8		
15300	9		

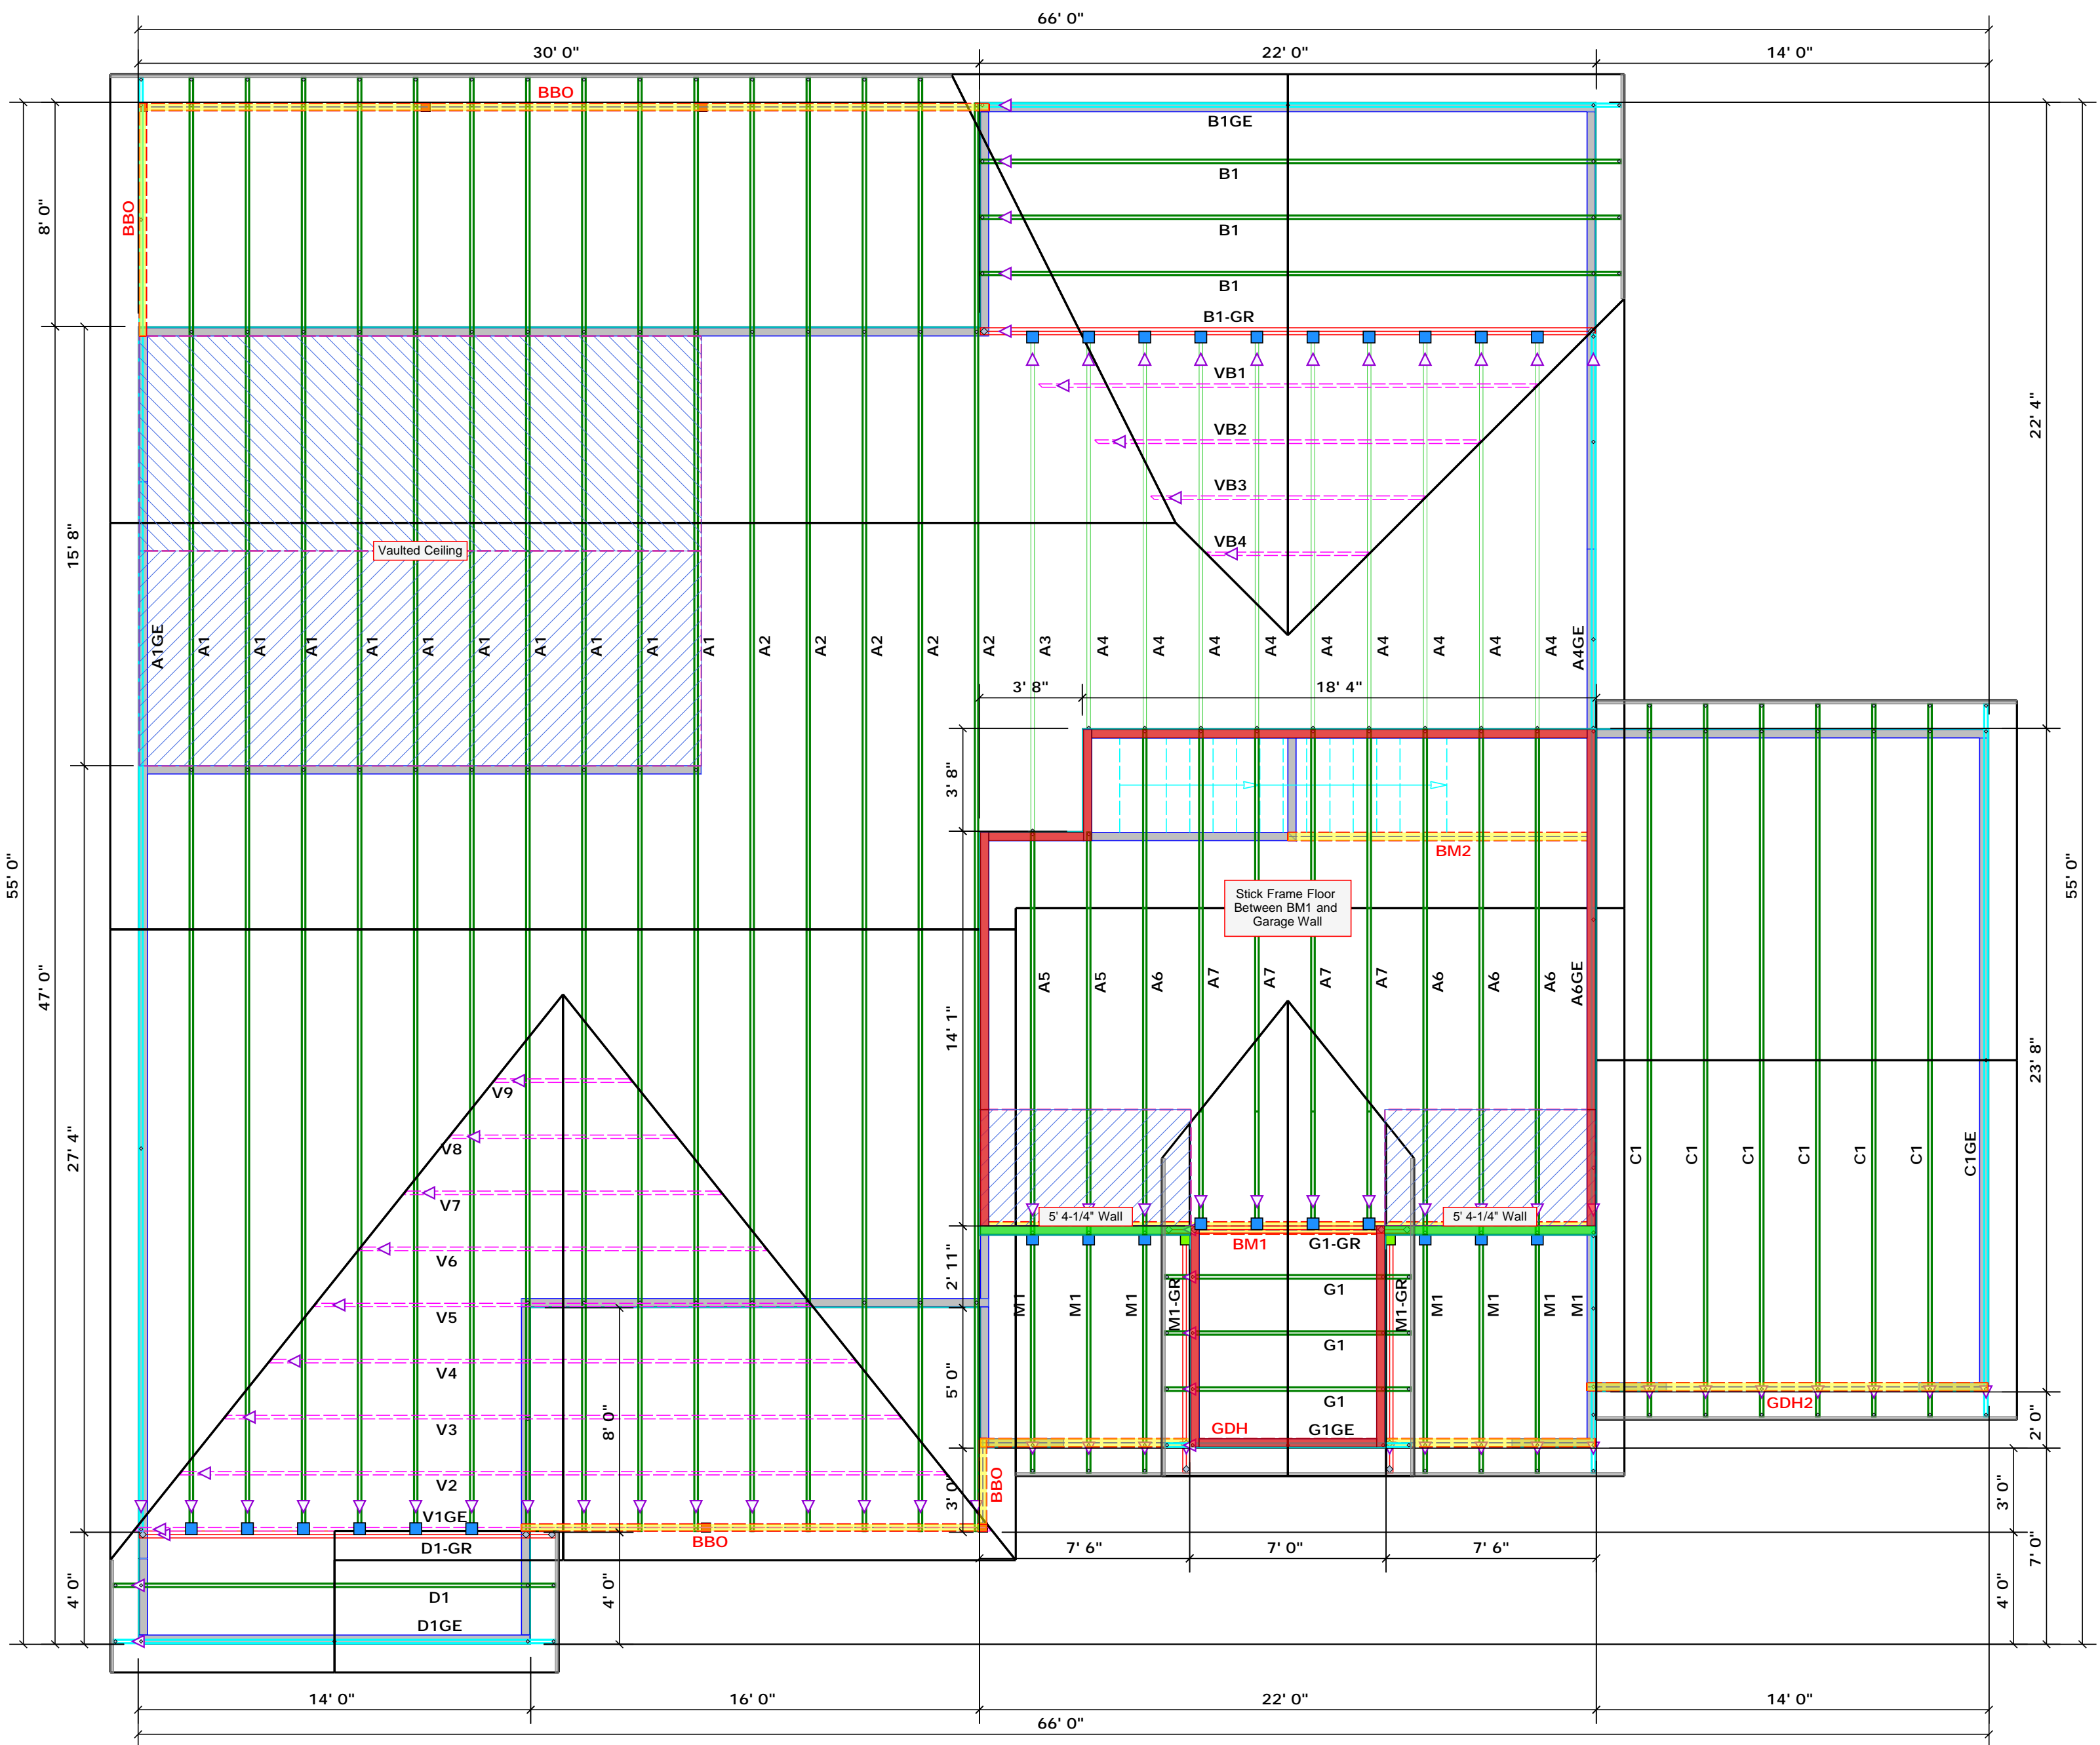

PlotID	Length	Product	Plies	Net Qty
BM1	22' 0"	1.75 X 24 Kerto-S LVL 2.0E	3	3
BM2	11' 0"	1.75 X 9.25 Kerto-S LVL 2.0E	2	2
GDH	22' 0"	1.75 X 14 Kerto-S LVL 2.0E	2	2
GDH2	15' 0"	1.75 X 11.875 Kerto-S LVL 2.0E	2	2

Hatch Legend	
	5' 4-1/4" Walls
	2nd Floor Walls
	Vaulted Ceiling
	Drop Beam

1 Truss Placement Plan  
Scale: 1/4"=1'

All Walls Shown Are Considered Load Bearing

Roof Area = 3920.39 sq.ft.  
Ridge Line = 98.89 ft.  
Hip Line = 20.18 ft.  
Horiz. OH = 164.28 ft.  
Raked OH = 249.56 ft.  
Decking = 135 sheets

Dimension Notes  
1. All exterior wall to wall dimensions are to face of sheathing unless noted otherwise  
2. All interior wall dimensions are to face of frame wall unless noted otherwise  
3. All exterior wall to truss dimensions are to face of frame wall unless noted otherwise

Connector Information					Nail Information	
Sym	Product	Manuf	Qty	Supported Member	Header	Truss
	HUS26	USP	26	NA	16d/3-1/2"	16d/3-1/2"
	THD26-2	USP	2	NA	16d/3-1/2"	10d/3"

= Indicates Left End of Truss  
(Reference Engineered Truss Drawing)  
Do NOT Erect Truss Backwards

BUILDER	J. W. Sealey	CITY / CO.	Harnett County / Harnett
JOB NAME	Lot 77 South Creek	ADDRESS	Lot 77 South Creek
PLAN	Carter III	MODEL	Roof
SEAL DATE	Seal Date	DATE REV.	12/15/20
QUOTE #	Quote #	DRAWN BY	David Landry
JOB #	J1220-5656	SALES REP.	Neil Baggett

THIS IS A TRUSS PLACEMENT DIAGRAM ONLY. These trusses are designed as individual building components to be incorporated into the building design at the specification of the building designer. See individual design sheets for each truss design identified on the placement drawing. The building designer is responsible for temporary and permanent bracing of the roof and floor system and for the overall structure. The design of the truss support structure including headers, beams, walls, and columns is the responsibility of the building designer. For general guidance regarding bracing, consult BCSI-B1 and BCSI-B3 provided with the truss delivery package or online @ sbcindustry.com.