

**PLANS DESIGNED TO THE
2018 NORTH CAROLINA STATE
RESIDENTIAL BUILDING CODE**

MEAN ROOF HEIGHT: 18'-4" HEIGHT TO RIDGE: 24'-8"

CLIMATE ZONE	ZONE 3A	ZONE 4A	ZONE 5A
FENESTRATION U-FACTOR	0.35	0.35	0.35
SKYLIGHT U-FACTOR	0.55	0.55	0.55
GLAZED FENESTRATION SHGC	0.30	0.30	0.30
CEILING R-VALUE	38.0 ^a 30.0 ^b	38.0 ^a 30.0 ^b	38.0 ^a 30.0 ^b
WALL R-VALUE	15	15	19
FLOOR R-VALUE	19	19	30
BASEMENT WALL R-VALUE	5/13	10/15	10/15
** SLAB R-VALUE	0	10	10
* CRAWL SPACE WALL R-VALUE	5/13	10/15	10/19

**10/13 MEANS R-10 SHEATHING INSULATION OR R-13 CAVITY INSULATION
* INSULATION DEPTH WITH MONOLITHIC SLAB 2" OR FROM INSPECTION GAP TO BOTTOM OF FOOTING; INSULATION DEPTH WITH STEEL WALLS 2" OR TO BOTTOM OF FOUNDATION WALL
DESIGNED FOR WIND SPEED OF 130 MPH, 3 SECOND GUST (15 MINUTE WIND EXPOSURE 1")

COMPONENT & CLADDING DESIGNED FOR THE FOLLOWING LOADS

MEAN ROOF	UP TO 30'	30'-1" TO 35'	35'-1" TO 40'	40'-1" TO 45'
ZONE 1	14.2 - 15.0	14.9 - 15.8	15.5 - 16.4	15.9 - 16.8
ZONE 2	14.2 - 18.0	14.9 - 18.9	15.5 - 19.6	15.9 - 20.2
ZONE 3	14.2 - 18.0	14.9 - 18.9	15.5 - 19.6	15.9 - 20.2
ZONE 4	15.5 - 16.0	16.3 - 16.6	16.9 - 17.4	17.4 - 17.9
ZONE 5	15.5 - 20.0	16.3 - 21.0	16.9 - 21.8	17.4 - 22.4

COMPONENT & CLADDING DESIGNED FOR THE FOLLOWING LOADS

MEAN ROOF	UP TO 30'	30'-1" TO 35'	35'-1" TO 40'	40'-1" TO 45'
ZONE 1	16.7 - 18.0	17.5 - 18.9	18.2 - 19.6	18.7 - 20.2
ZONE 2	16.7 - 21.0	17.5 - 22.1	18.2 - 22.9	18.7 - 23.5
ZONE 3	16.7 - 21.0	17.5 - 22.1	18.2 - 22.9	18.7 - 23.5
ZONE 4	18.2 - 19.0	19.1 - 20.0	19.8 - 20.7	20.4 - 21.3
ZONE 5	18.2 - 24.0	19.1 - 25.2	19.8 - 26.2	20.4 - 26.9

ROOF VENTILATION

SECTION R806
R806.1 Ventilation required. Enclosed attics and enclosed rafter spaces formed where ceilings are applied directly to the underside of roof rafters shall have cross ventilation for each separate space by ventilating openings protected against the entrance of rain or snow. Ventilating openings shall have a least dimension of 1/16 inch (1.6 mm) minimum and 1/4 inch (6.4 mm) maximum. Ventilating openings having a least dimension larger than 1/4 inch (6.4 mm) shall be provided with corrosion-resistant wire cloth screening, hardware cloth, or similar material with openings having a least dimension of 1/16 inch (1.6 mm) minimum and 1/4 inch (6.4 mm) maximum. Openings in roof framing members shall conform to the requirements of Section R802.7.

R806.2 Minimum area. The total net free ventilating area shall not be less than 1/150 of the area of the space ventilated except that reduction of the total area to 1/300 is permitted provided that at least 50 percent and not more than 80 percent of the required ventilating area is provided by ventilators located in the upper portion of the space to be ventilated at least 3 feet (914 mm) above the eave or cornice vents with the balance of the required ventilation provided by eave or cornice vents. As an alternative, the net free cross-ventilation area may be reduced to 1/300 when a Class I or II vapor retarder is installed on the warm-in-winter side of the ceiling.

Exceptions:
1. Enclosed attic/rafter spaces requiring less than 1 square foot (0.0929 m²) of ventilation may be vented with continuous soffit ventilation only.
2. Enclosed attic/rafter spaces over unconditioned space may be vented with continuous soffit vent only.

SQUARE FOOTAGE OF ROOF TO BE VENTED = 2,192 SQ.FT.
NET FREE CROSS VENTILATION NEEDED:
WITHOUT 50% TO 80% OF VENTING 3'-0" ABOVE EAVE = 14.61 SQ.FT.
WITH 50% TO 80% OF VENTING 3'-0" ABOVE EAVE, OR WITH CLASS I OR II VAPOR RETARDER ON WARM-IN-WINTER SIDE OF CEILING = 7.31 SQ.FT.

AIR LEAKAGE


Section N1102.4
N1102.4.1 Building thermal envelope. The building thermal envelope shall be durably sealed with an air barrier system to limit infiltration. The sealing methods between dissimilar materials shall allow for differential expansion and contraction. For all homes, where present, the following shall be caulked, gasketed, weather stripped or otherwise sealed with an air barrier material or solid material consistent with Appendix E-2.4 of this code:

1. Blocking and sealing floor/ceiling systems and under knee walls open to unconditioned or exterior space.
2. Capping and sealing shafts or chases, including fire shafts.
3. Capping and sealing soffit or dropped ceiling areas.

NOTICE TO CONTRACTOR
APPROVED
2021/07/2021
HARNETT COUNTY NORTH CAROLINA

X FULL FRONT PORCH X

*BF 3 - MOND
3CAR*

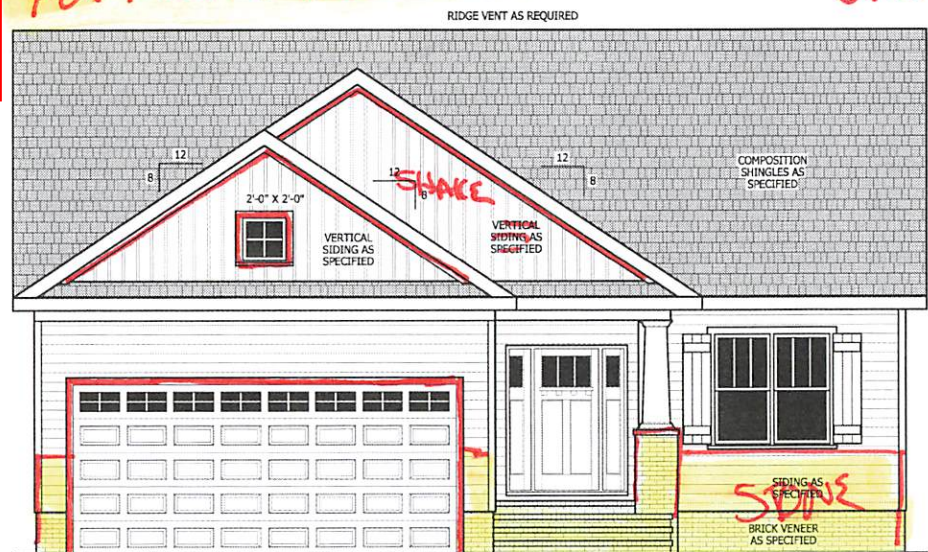

FRONT ELEVATION - B
SCALE 1/4" = 1'-0"


RAIL AS NEEDED PER CODE

GUARD RAIL NOTES

SECTION R312
R312.1 Where required. Guards shall be located along open-sided walking surfaces, including stairs, ramps and landings, that are located more than 30 inches (762 mm) measured vertically to the floor or grade below at any point within 36 inches (914 mm) horizontally to the edge of the open side. Insect screening shall not be considered as a guard.
R312.2 Height. Required guards at open-sided walking surfaces, including stairs, porches, balconies or landings, shall be not less than 36 inches (914 mm) high measured vertically above the adjacent walking surface, adjacent fixed seating or the line connecting the leading edges of the treads.
Exceptions:
1. Guards on the open sides of stairs shall have a height not less than 34 inches (864 mm) measured vertically from a line connecting the leading edges of the treads.
2. Where the top of the guard also serves as a handrail on the open sides of stairs, the top of the guard shall not be less than 34 inches (864 mm) and not more than 38 inches (965 mm) measured vertically from a line connecting the leading edges of the treads.
R312.3 Opening limitations. Required guards shall not have openings from the walking surface to the required guard height which allow passage of a sphere 4 inches (102 mm) in diameter.
Exceptions:
1. The triangular openings at the open side of a stair, formed by the riser, tread and bottom rail of a guard, shall not allow passage of a sphere 6 inches (153 mm) in diameter.
2. Guards on the open sides of stairs shall not have openings which allow passage of a sphere 43/8 inches (111 mm) in diameter.




FRONT - B WITH SIDE LOAD
SCALE 1/8" = 1'-0"

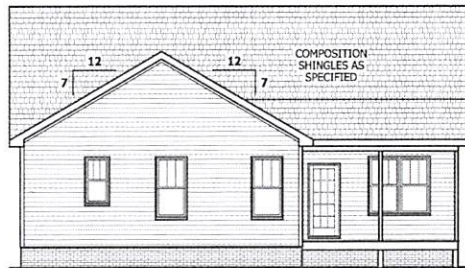

REAR ELEVATION
SCALE 1/8" = 1'-0"

RAIL AS NEEDED PER CODE

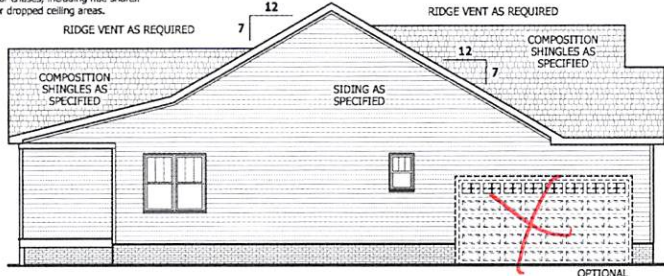

LEFT SIDE ELEVATION
SCALE 1/8" = 1'-0"

RAIL AS NEEDED PER CODE



RIGHT SIDE ELEVATION
SCALE 1/8" = 1'-0"

RAIL AS NEEDED PER CODE

PURCHASER MUST VERIFY ALL DIMENSIONS AND CONDITIONS BEFORE CONSTRUCTION BEGINNING.
HAYNES HOME PLANS, INC. ASSUMES NO LIABILITY FOR CONTRACTOR PRACTICES AND PROCEDURES.
CODES AND CONDITIONS MAY VARY WITH LOCATION. A LOCAL DESIGNER, ARCHITECT OR ENGINEER SHOULD BE CONSULTED BEFORE CONSTRUCTION.
THESE DRAWINGS ARE INSTRUMENTS OF SERVICE AND AS SUCH SHALL REMAIN PROPERTY OF THE DESIGNER.

ELEVATION - B
Lindsay 1553

HAYNES WEAVER HOMES
910.603.2100 • 919.616.6406


HAYNES WEAVER HOME PLANS, INC.
P.O. Box 102, Mine Creek, NC 27688, 919-435-5100, fax 919-435-4810

SQUARE FOOTAGE


HEATED FIRST FLOOR	1553 SQ.FT.
UNHEATED GARAGE	419 SQ.FT.
FRONT PORCH	103 SQ.FT.
FRONT PORCH EXT	66 SQ.FT.
REAR PORCH	117 SQ.FT.
TOTAL	2158 SQ.FT.
UNHEATED OPTIONAL THIRD GARAGE	292 SQ.FT.

© Copyright 2020 Haynes Home Plans, Inc.
9/28/2020
200505B
PAGE 1 OF 6


Z:\Builder\Weaver Development Company, Inc\200825B Lindsay 16161200825B Lindsay 1553 Left.eac




A MONOLITHIC SECTION
SCALE 1/2" = 1'-0"



B LUG FOOTING SECTION
SCALE 1/2" = 1'-0"



C MONOLITHIC AT STEP
SCALE 1/2" = 1'-0"




D MONOLITHIC AT GARAGE
SCALE 1/2" = 1'-0"

FOUNDATION STRUCTURAL

115 to 130 mph wind zone (1 1/2 to 2 1/2 story)
CONTINUOUS FOOTING: 16" wide and 8" thick minimum. 20" wide minimum at brick veneer. Must extend 2" to either side of supported wall.
GERDERS: (3) 2 X 10 girder unless noted otherwise.
PIERS: 16" X 16" piers with 8" solid masonry cap on 30" X 30" X 10" concrete footing with maximum pier height of 64" with hollow masonry and 160" with solid masonry.
POINT LOADS: ■ designates significant point load and should have solid blocking to pier, girder or foundation wall.
115 and 120 MPH ANCHORS BOLTS: 1/2" diameter anchor bolts embedded minimum 7", maximum 6'-0" on center, within 12" of plate ends, and minimum two anchor bolts per plate.
130 MPH ANCHORS BOLTS: 1/2" diameter anchor bolts embedded minimum 15", maximum 4'-0" on center, within 12" of plate ends, and minimum two anchor bolts per plate.
CONCRETE: Concrete shall have a minimum 28 day strength of 3000 psi and a maximum 5" slump. Air entrained per table 402.2. All concrete shall be in accordance with ACI standards. All samples for pumping shall be taken from the ext. end of the pump.
SOILS: Allowable soil bearing pressure assumed to be 2000 PSF. The contractor must contact a geotechnical engineer and a structural engineer if unsatisfactory subsurface conditions are encountered. The surface area adjacent to the foundation wall shall be provided with adequate drainage, and shall be graded so as to drain surface water away from foundation walls.

MONOLITHIC SLAB PLAN

SCALE 1/4" = 1'-0"

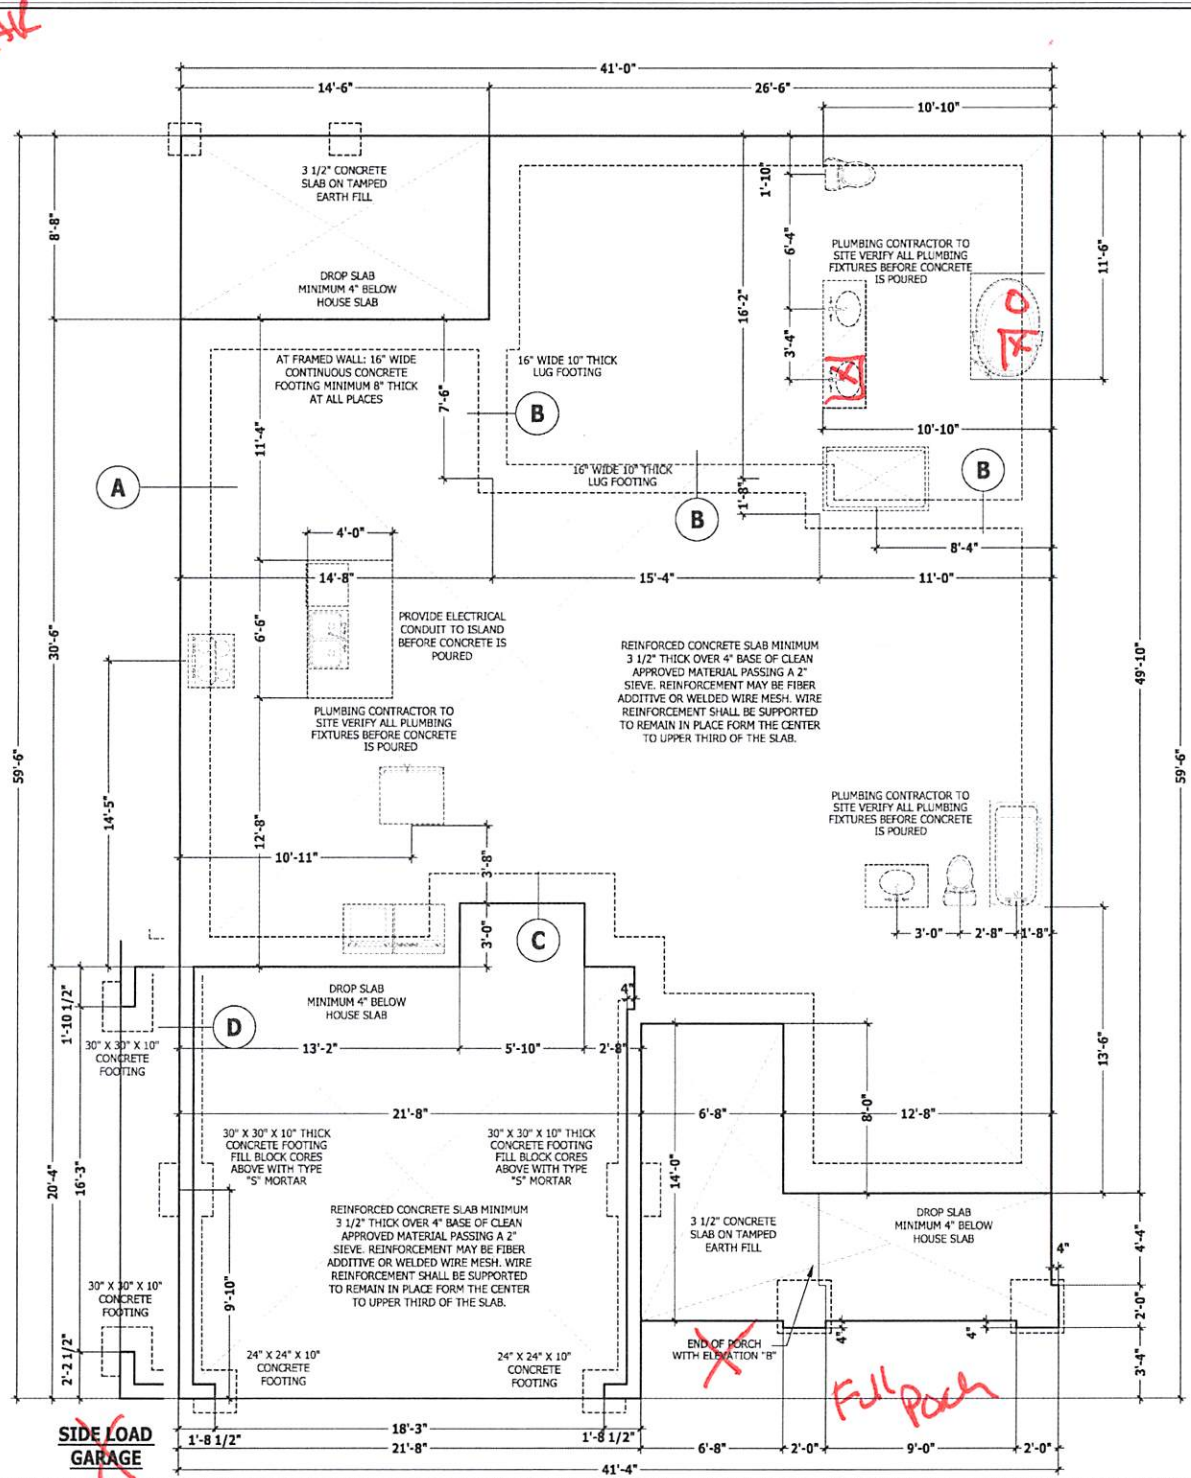

SIDE LOAD GARAGE

PURCHASER MUST VERIFY ALL DIMENSIONS AND CONDITIONS BEFORE CONSTRUCTION BEGINS.
 HAYNES HOME PLANS, INC. ASSUMES NO LIABILITY FOR CONTRACTORS PRACTICES AND PROCEDURES.
 CODES AND CONDITIONS MAY VARY WITH LOCATION. A LOCAL DESIGNER, ARCHITECT OR ENGINEER SHOULD BE CONSULTED BEFORE CONSTRUCTION.
 THESE DRAWINGS ARE INSTRUMENTS OF SERVICE AND AS SUCH SHALL REMAIN PROPERTY OF THE DESIGNER.

MONOLITHIC SLAB PLAN
Lindsay 1553

HAYNES WEAVER HOMES
 HOME PLANS, INC.
 910.630.23100 • 919.006.4096
 P.O. BOX 102, WAKE FOREST, NC 27288 919.485.1180 fax 919.485.9106

SQUARE FOOTAGE

HEATED 1ST FLOOR	1881
UNHEATED 1ST FLOOR	102
HEATED 2ND FLOOR	102
UNHEATED 2ND FLOOR	102
UNHEATED GARAGE	102
TOTAL	3209

© Copyright 2020
 Haynes Home Plans, Inc.
9/28/2020
200505B
PAGE 2 OF 6

PURCHASER MUST VERIFY ALL DIMENSIONS AND CONDITIONS BEFORE CONSTRUCTION BEGINS. HAYNES HOME PLANS, INC. ASSUMES NO LIABILITY FOR CONTRACTOR PRACTICES AND PROCEDURES. CODES AND CONDITIONS MAY VARY WITH LOCATION. A LOCAL DESIGNER, ARCHITECT OR ENGINEER SHOULD BE CONSULTED BEFORE CONSTRUCTION. THESE DRAWINGS ARE INSTRUMENTS OF SERVICE AND AS SUCH SHALL REMAIN PROPERTY OF THE DESIGNER.

FIRST FLOOR PLAN
Lindsay 1553

HAYNES WEAVER
HOME PLANS, INC.
910.630.2100 • 919.016.4036
P.O. BOX 102, WAKE FOREST, NC 27788, 919-455-1891, 1-866-849-4866

ATTIC ACCESS

SECTION R807
R807.1 Attic access. An attic opening shall be provided to attic areas that exceed 400 square feet (37.16 m²) and have a vertical height of 60 inches (1524 mm) or greater. The net clear opening shall not be less than 20 inches by 30 inches (508 mm by 762 mm) and shall be located in a hallway or other readily accessible location. A 20-inch (762 mm) minimum unobstructed headroom in the attic space shall be provided at some point above the access opening. See Section M1305.1.3 for access requirements where mechanical equipment is located in attic.
Exceptions:
1. Concealed areas not located over the main structure including porches, areas behind knee walls, dormers, bay windows, etc. are not required to have access.
2. Pull down stair treads, stringers, handrails, and hardware may protrude into the net clear opening.

DWELLING / GARAGE SEPARATION


REFER TO SECTIONS R302.5, R302.6, AND R302.7
WALLS. A minimum 1/2" gypsum board must be installed on all walls supporting floor/ceiling assemblies used for separation required by this section.
STAIRS. A minimum of 1/2" gypsum board must be installed on the underside and exposed sides of all stairways.
CEILINGS. A minimum of 1/2" gypsum must be installed on the garage ceiling if there are no habitable room above the garage. If there are habitable room above the garage a minimum of 5/8" type X gypsum board must be installed on the garage ceiling.
OPENING PENETRATIONS. Openings between the garage and residence shall be equipped with solid wood doors not less than 1 3/8 inches (35 mm) in thickness, solid or honeycomb core steel doors not less than 1 3/8 inches (35 mm) thick, or 20-minute fire-rated doors.
DUCT PENETRATIONS. Ducts in the garage and ducts penetrating the walls or ceilings separating the dwelling from the garage shall be constructed of a minimum No. 26 gage (0.48 mm) sheet steel or other approved material and shall have no openings into the garage.
OTHER PENETRATIONS. Penetrations through the separation required in Section R302.6 shall be protected as required by Section R302.11, Item 4.

SQUARE FOOTAGE

HEATED	
FIRST FLOOR	1553 SQ.FT.
TOTAL	1553 SQ.FT.
UNHEATED	
GARAGE	419 SQ.FT.
FRONT PORCH	103 SQ.FT.
FRONT PORCH EXT	65 SQ.FT.
REAR PORCH	117 SQ.FT.
TOTAL	705 SQ.FT.
UNHEATED OPTIONAL	
THIRD GARAGE	292 SQ.FT.
TOTAL	292 SQ.FT.

FIRST FLOOR PLAN

SCALE 1/4" = 1'-0"

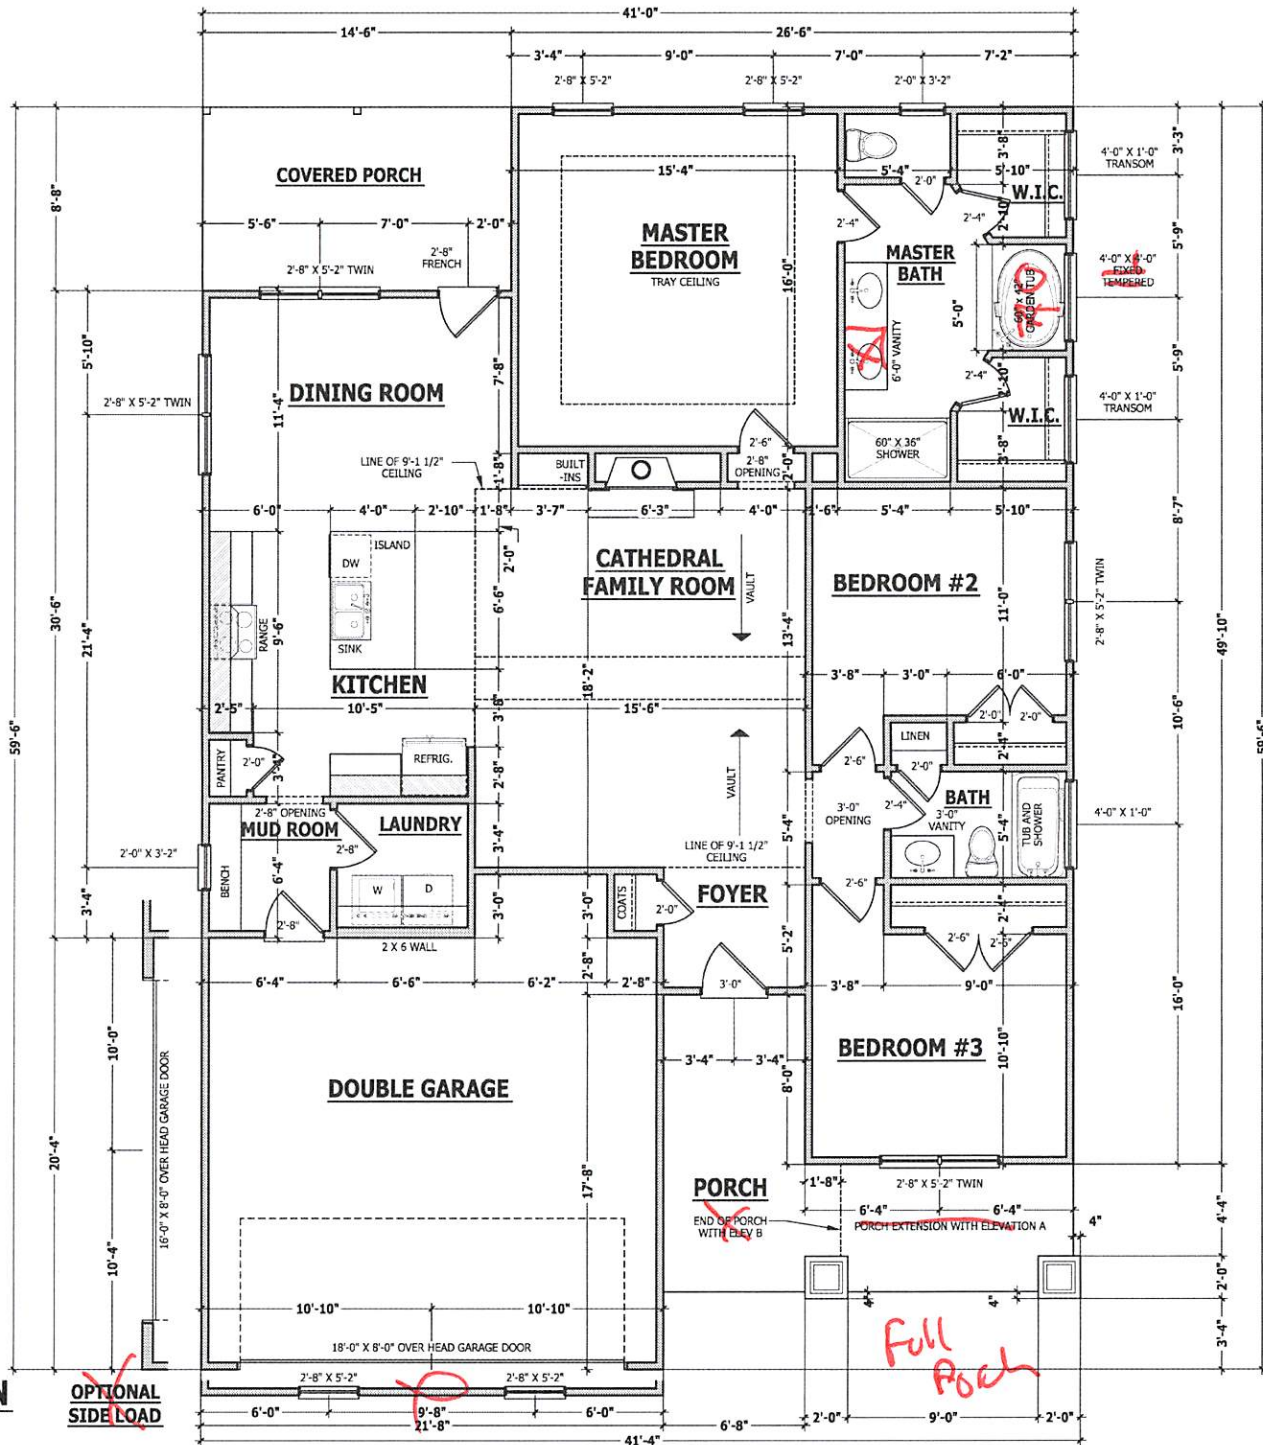

SQUARE FOOTAGE	
HEATED	
FIRST FLOOR	1553 SQ.FT.
TOTAL	1553 SQ.FT.
UNHEATED	
GARAGE	419 SQ.FT.
FRONT PORCH	103 SQ.FT.
FRONT PORCH EXT	65 SQ.FT.
REAR PORCH	117 SQ.FT.
TOTAL	705 SQ.FT.
UNHEATED OPTIONAL	
THIRD GARAGE	292 SQ.FT.
TOTAL	292 SQ.FT.

© Copyright 2020
Haynes Home Plans, Inc.
9/28/2020
200505B
PAGE 3 OF 6

Z:\Builder\Weaver Development Company, Inc\200825B Lindsay 1616\200825B Lindsay 1553 Left.aec

STRUCTURAL NOTES

All construction shall conform to the latest requirements of the 2018 North Carolina Residential Building Code, plus all local codes and regulations. This document in no way shall be construed to supersede the code.
JOB SITE PRACTICES AND SAFETY: Haynes Home Plans, Inc. assumes no liability for contractor practices and procedures or safety program. Haynes Home Plans, Inc. takes no responsibility for the contractor's failure to carry out the construction work in accordance with the contract documents. All members shall be framed, anchored, and braced in accordance with good construction practice and the building code.

DESIGN LOADS	LIVE LOAD (PSF)	DEAD LOAD (PSF)	DEFLECTION (LL)
Attics without storage	10	10	L/240
Attics with limited storage	20	10	L/360
Attics with fixed stairs	40	10	L/360
Balconies and decks	40	10	L/360
Fire escapes	40	10	L/360
Guardrails and handrails	200	-	-
Guardrail in-fill components	50	-	-
Passenger vehicle garages	50	10	L/360
Rooms other than sleeping	40	10	L/360
Sleeping rooms	30	10	L/360
Stairs	40	10	L/360
Snow	20	-	-

FRAMING LUMBER: All non treated framing lumber shall be SPF #2 (Fb = 875 PSI) or SYP #2 (Fb = 750 PSI) and all treated lumber shall be SYP #2 (Fb = 750 PSI) unless noted otherwise.

ENGINEERED WOOD BEAMS:
 Laminated veneer lumber (LVL) = Fb=2600 PSI, Fv=285 PSI, E=1.9x10⁶ PSI
 Parallel strand lumber (PSL) = Fb=2900 PSI, Fv=290 PSI, E=2.0x10⁶ PSI
 Laminated strand lumber (LSL) = Fb=2250 PSI, Fv=400 PSI, E=1.5x10⁶ PSI
 Install all connectors per manufacturer's instructions.

TRUSS AND I-JOIST MEMBERS: All roof truss and I-joint layouts shall be prepared in accordance with this document. Trusses and I-joints shall be installed according to the manufacturer's specifications. Any change in truss or I-joint layout shall be coordinated with Haynes Home Plans, Inc.

LINTELS: Brick lintels shall be 3 1/2" x 3 1/2" x 1/4" steel angle for up to 6'-0" span. 6" x 4" x 5/16" steel angle with 6" leg vertical for spans up to 9'-0" unless noted otherwise. 3 1/2" x 3 1/2" x 1/4" steel angle with 1/2" bolts at 2'-0" on center for spans up to 18'-0" unless noted otherwise.

FLOOR SHEATHING: OSB or CDX floor sheathing minimum 1/2" thick for 16" on center joist spacing, minimum 5/8" thick for 19.2" on center joist spacing, and minimum 3/4" thick for 24" on center joist spacing.

ROOF SHEATHING: OSB or CDX roof sheathing minimum 3/8" thick for 16" on center rafters and 7/16" for 24" on center rafters.

CONCRETE AND SOILS: See foundation notes.

EXTERIOR HEADERS

(2) 2 X 6 WITH 1 JACK STUD EACH END UNLESS NOTED OTHERWISE
 - KING STUDS EACH END PER TABLE BELOW

HEADER SPAN	< 3'	3'-4'	4'-8'	8'-12'	12'-16'
KING STUD(S)	1	2	3	5	6

INTERIOR HEADERS

- LOAD BEARING HEADERS (2) 2 X 6 WITH 1 JACK STUD AND 1 KING STUD EACH END UNLESS NOTED OTHERWISE
 - NON LOAD BEARING HEADERS TO BE LADDER FRAMED

BRACE WALL PANEL NOTES

EXTERIOR WALLS: All exterior walls to be sheathed with CS-WSP or CS-SFB in accordance with section R602.10.3 unless noted otherwise.

GYP/SM: All interior sides of exterior walls and both sides interior walls to have 1/2" gypsum installed. When not using method GB gypsum to be fastened per table R702.3.5. Method GB to be fastened per table R602.10.1.

REQUIRED LENGTH OF BRACING: Required brace wall length for each side of the circumscribed rectangle are interpolated per table R602.10.3. Methods CS-WSP and CS-SFB contribute their actual length. Method GB contributes 0.5 its actual length. Method PF contributes 1.5 times its actual length.

HD: 800 lbs hold down hold down device fastened to the edge of the brace wall panel closest to the corner.

Methods: Per Table R602.10.1

CS-WSP: Shall be minimum 3/8" OSB or CDX nailed at 6" on center at edges and 12" on center at intermediate supports with 6d common nails or 8d (2 1/2" long x 0.113" diameter).

CS-SFB: Shall be minimum 1/2" structural fiber board nailed at 3" on center at edges and 3" on center at intermediate supports with 1 1/2" long x 0.12" diameter galvanized roofing nails.

GB: Interior walls show as GB are to have minimum 1/2" gypsum board on both sides of the wall fastened at 7" on center at edges and 7" on center at intermediate supports with minimum 5d cooler nails or #6 screws.


PF: Portal frame per figure R602.10.1

ROOF TRUSS REQUIREMENTS

TRUSS DESIGN: Trusses to be designed and engineered in accordance with these drawings. Any variation with these drawings must be brought to Haynes Home Plans, Inc. attention before construction begins.

ANCHORAGE: All required anchors for trusses due to uplift or bearing shall meet the requirements as specified on the truss schematics.

BEARING: All trusses shall be designed for bearing on SPF #2 plates or ledgers unless noted otherwise.

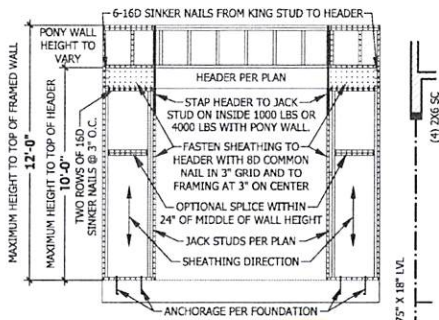

PF PORTAL FRAME AT OPENING


(METHOD PF PER FIGURE AND SECTION R602.10.1)
 SCALE 1/4" = 1'-0"

FIRST FLOOR STRUCTURAL

SCALE 1/4" = 1'-0"

OPTIONAL SIDE LOAD

4 X 4 TREATED POST OR EQUIVALENT TYPICAL. ATTACH RAFTERS TO HEADER WITH HURRICANE CONNECTORS (SIMPSON H2.5 OR EQUIVALENT). ATTACH HEADER TO POST AND POST TO BASE WITH POST CAP, METAL STRAPS, AND/OR POST BASE.

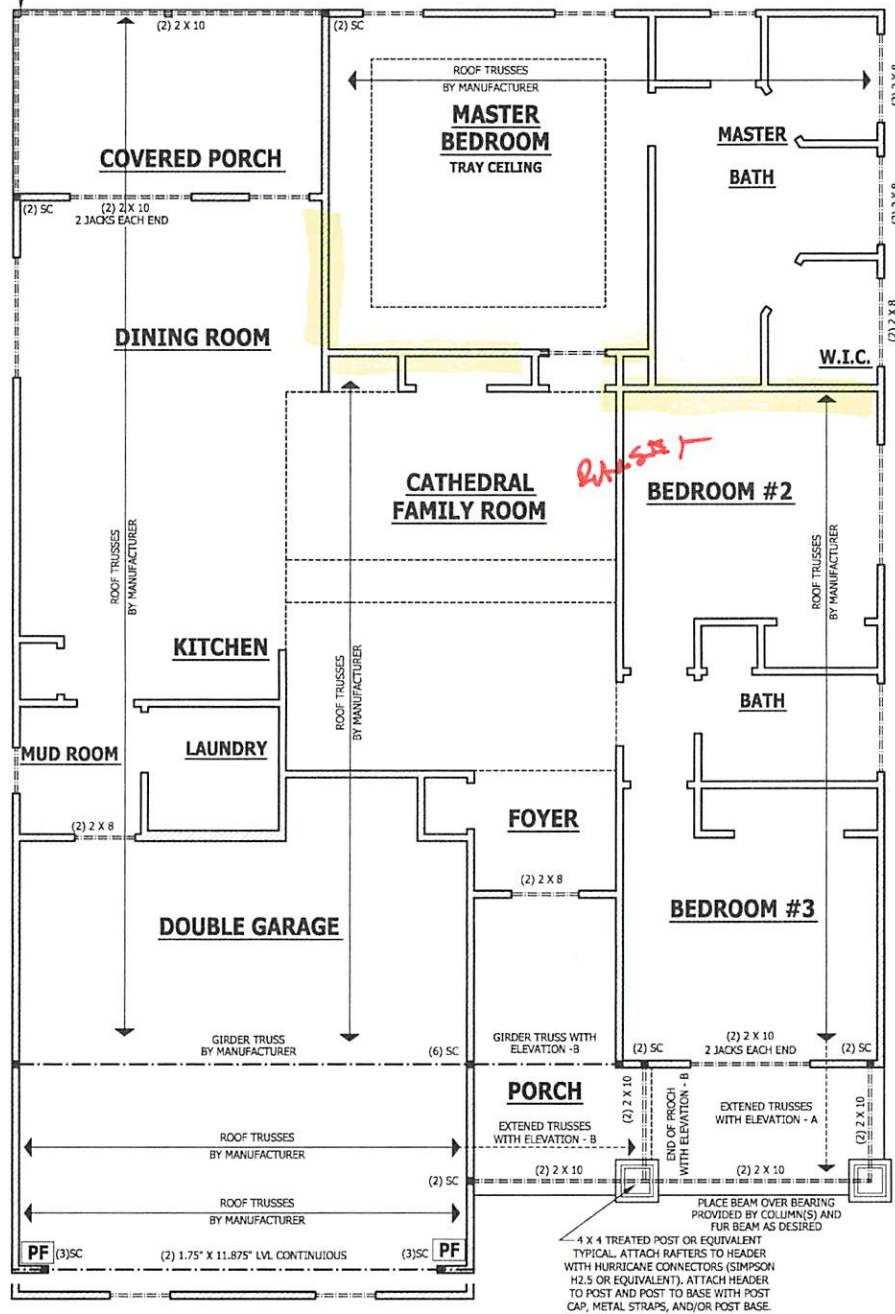

PURCHASER MUST VERIFY ALL DIMENSIONS AND CONDITIONS BEFORE CONSTRUCTION BEGINS.
 HAYNES HOME PLANS, INC. ASSUMES NO LIABILITY FOR CONTRACTOR PRACTICES AND PROCEDURES.
 GOODS AND CONDITIONS MAY VARY WITH LOCATION. A LOCAL DESIGNER, ARCHITECT OR ENGINEER SHOULD BE CONSULTED BEFORE CONSTRUCTION.
 THESE DRAWINGS ARE INSTRUMENTS OF SERVICE AND AS SUCH SHALL REMAIN PROPERTY OF THE DESIGNER.

FIRST FLOOR STRUCTURAL
Lindsay 1553


HAYNES WEAVER HOMES
 HOME PLANS, INC.
 P.O. BOX 702, WISE, VIRGINIA 22991-0702
 910.630.22100 • 919.0016.4096

HAYNES WEAVER HOMES
 HOME PLANS, INC.
 P.O. BOX 702, WISE, VIRGINIA 22991-0702
 910.630.22100 • 919.0016.4096

SQUARE FOOTAGE	HEATED	UNHEATED
FIRST FLOOR	1882 SQ FT	1882 SQ FT
SECOND FLOOR	1882 SQ FT	1882 SQ FT
SCREENED PORCH	600 SQ FT	600 SQ FT
FRONT PORCH	200 SQ FT	200 SQ FT
BACK PORCH	200 SQ FT	200 SQ FT
UNHEATED OPTIONAL	200 SQ FT	200 SQ FT
TOTAL GARAGE	200 SQ FT	200 SQ FT
TOTAL	4564 SQ FT	4564 SQ FT

ROOF TRUSS REQUIREMENTS

TRUSS DESIGN. Trusses to be designed and engineered in accordance with these drawings. Any variation with these drawings must be brought to Haynes Home Plan, Inc. attention before construction begins.
ANCHORAGE. All required anchors for trusses due to uplift or bearing shall meet the requirements as specified on the truss schematics.
BEARING. All trusses shall be designed for bearing on SPF #2 plates or ledgers unless noted otherwise.

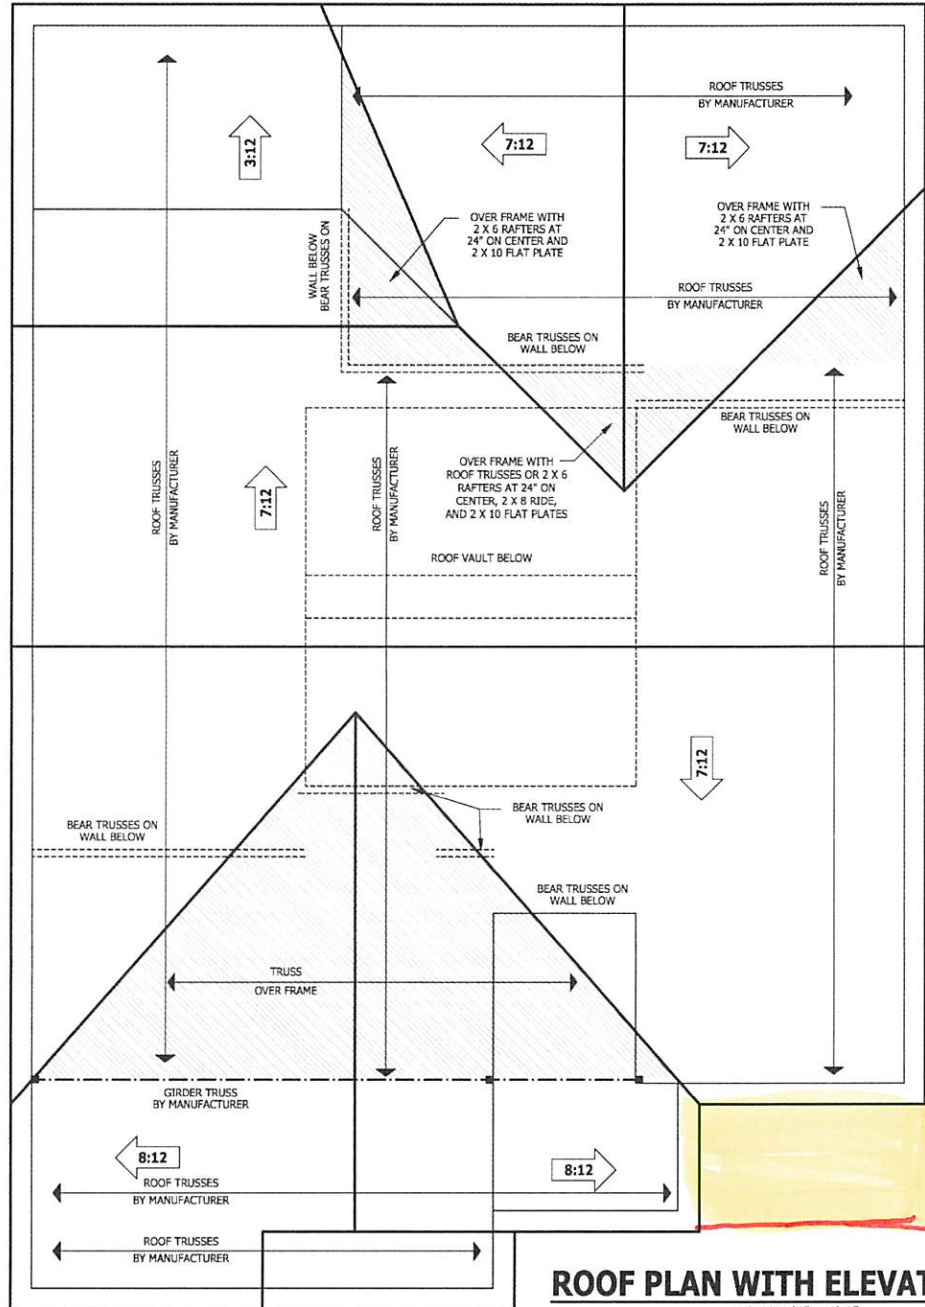

ROOF PLAN WITH ELEVATION -B

SCALE 1/4" = 1'-0"


Full Front Porch

PURCHASER MUST VERIFY ALL DIMENSIONS AND CONDITIONS BEFORE CONSTRUCTION BEGINS. HAYNES HOME PLANS, INC. ASSUMES NO LIABILITY FOR CONTRACTING PRACTICES AND PROCEDURES. CODES AND CONDITIONS MAY VARY WITH LOCATION. A LOCAL DESIGNER, ARCHITECT OR ENGINEER SHOULD BE CONSULTED BEFORE CONSTRUCTION. THESE DRAWINGS ARE INSTRUMENTS OF SERVICE AND AS SUCH SHALL REMAIN PROPERTY OF THE DESIGNER.


ROOF PLAN WITH ELEVATION -B
Lindsay 1553

HAYNES WEAVER HOMES
HOME PLANS, INC.
 910.630.2100 • 919.016.4096
 P.O. BOX 102, WISE FOREST, NC 27888, 919.455.1189, FAX 919.455.1488


SQUARE FOOTAGE	
HEATED FIRST FLOOR	1883 SQ. FT.
UNHEATED GARAGE	1883 SQ. FT.
UNHEATED FRONT PORCH	1883 SQ. FT.
UNHEATED FRONT PORCH DET.	1883 SQ. FT.
UNHEATED SIDE PORCH	1883 SQ. FT.
UNHEATED OPTIONAL FULL GARAGE	1883 SQ. FT.

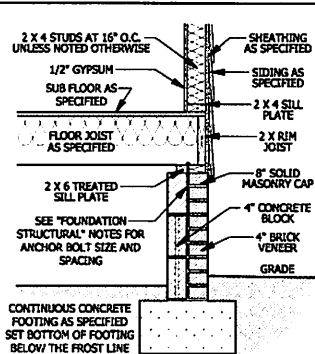


A CRAWL SPACE WALL
SCALE 3/4" = 1'-0"

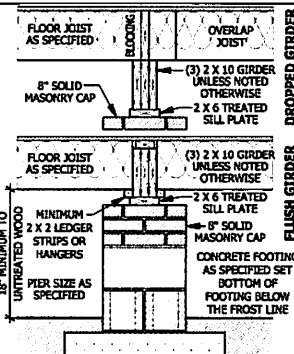

B DROPPED/ FLUSH PIER
SCALE 3/4" = 1'-0"

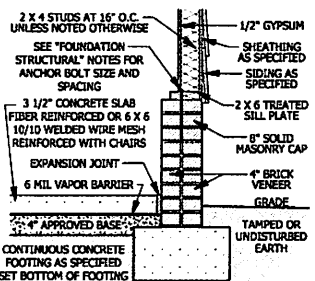


D GARAGE STEM WALL
SCALE 3/4" = 1'-0"



E <48" GARAGE WING WALL
SCALE 3/4" = 1'-0"

DECK STAIR NOTES

SECTION AM110
AM110.1 Stairs shall be constructed per Figure AM110. Stringer spans shall be no greater than 7 foot span between supports. Spacing between stringers shall be based upon decking material used per Figure AM107.1. Each stringer shall have minimum 3 1/2 inches between step cut and back of stringer. If used, suspended headers shall be attached with 3/8 inch galvanized bolts with nuts and washers to securely support stringers at the top.

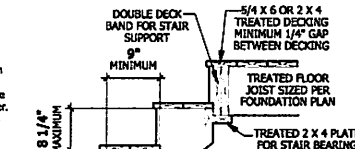

F DECK ATTACHMENT
SCALE 1/2" = 1'-0"


DECK BRACING

SECTION AM109
AM109.1 Deck bracing. Decks shall be braced to provide lateral stability. The following are acceptable means to provide lateral stability.
AM109.1.1 When the deck floor height is less than 4'-0" above finished grade per Figure AM107.1, each stringer shall be attached to the structure in accordance with Section AM104. Lateral bracing is not required.
AM109.1.2, 4 x 4 wood knee braces may be provided on each column in both directions. The knee braces shall attach to each post at a point not less than 1/3 of the post length from the top of the post, and the braces shall be angled between 45 degrees and 60 degrees from the horizontal. Knee braces shall be bolted to the post and the girder/beam with one 5/8 inch nut and washer at both ends of the brace per Figure AM109.1.
AM109.1.3. For freestanding decks without knee braces or diagonal bracing, lateral stability may be provided by enclosing the post in accordance with Figure AM109.2 and the following:


FIGURE AM110 TYPICAL DECK STAIR DETAIL
SCALE 3/4" = 1'-0"

POST SIZE	TREAD AREA	MAX. POST HEIGHT	BRACING DEPTH	CONCRETE DIAMETER
4 X 4	48 SF	4'-0"	3'-6"	1'-0"
6 X 6	120 SF	6'-0"	2'-6"	1'-8"


AM109.1.4. 2 x 6 diagonal vertical cross bracing may be provided in two perpendicular directions for freestanding decks or parallel to the structure at the exterior column line for attached decks. The 2 x 6's shall be attached to the posts with one 5/8 inch hot dipped galvanized bolt with nut and washer at each end of each bracing member per Figure AM109.3.
AM109.1.5. For embankment of piers in Coastal Regions, see Chapter 45.




G WEEP SCREED
SCALE 3/4" = 1'-0"

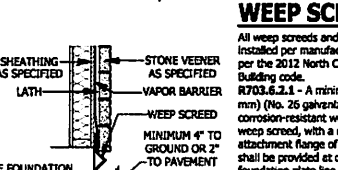


H WEEP SCREED
SCALE 3/4" = 1'-0"

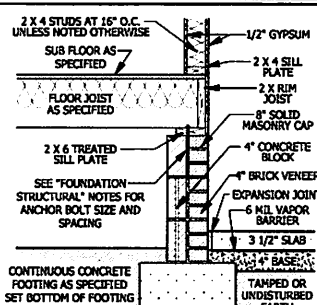


I CRAWL SPACE AT GARAGE
SCALE 3/4" = 1'-0"

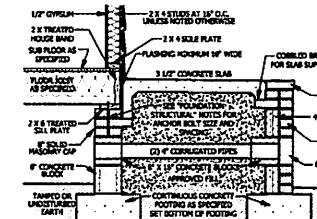


J FILLED PORCH SECTION WITH VENT
SCALE 1/2" = 1'-0"

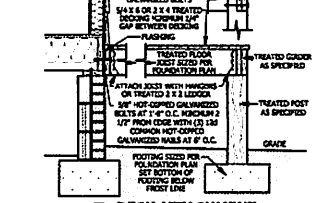


K SMOKE ALARMS
SCALE 1/2" = 1'-0"

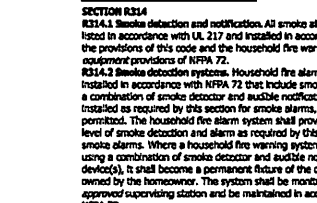


L DECK STAIR NOTES
SCALE 1/2" = 1'-0"

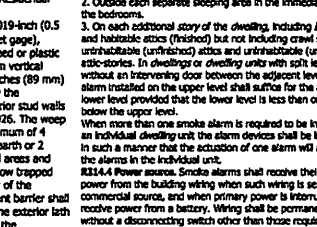


M WEEP SCREED
SCALE 3/4" = 1'-0"

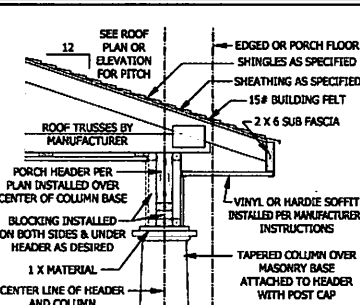


N PORCH HEADER WITH TAPERED COLUMN
SCALE 3/4" = 1'-0"

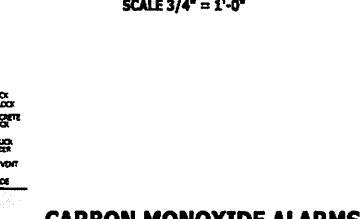


O CARBON MONOXIDE ALARMS
SCALE 3/4" = 1'-0"

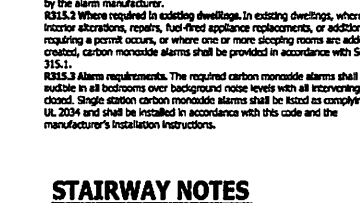


P STAIRWAY NOTES
SCALE 3/4" = 1'-0"

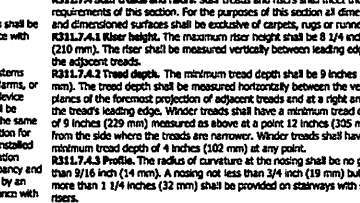


Q TYPICAL WALL DETAIL
SCALE 3/4" = 1'-0"

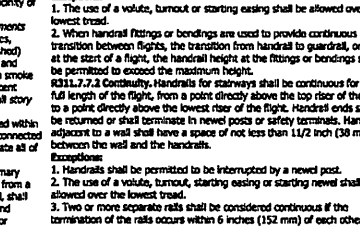


R TYPICAL STAIR DETAIL
SCALE 1/4" = 1'-0"

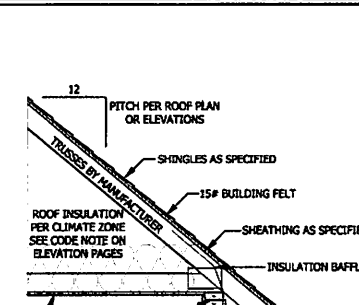


S TYPICAL WALL DETAIL
SCALE 3/4" = 1'-0"

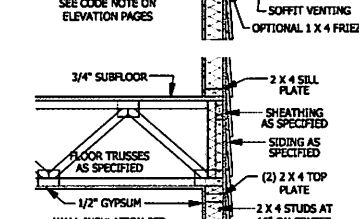


T TYPICAL STAIR DETAIL
SCALE 1/4" = 1'-0"

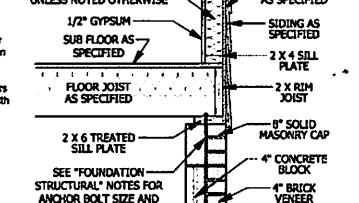

U TYPICAL WALL DETAIL
SCALE 3/4" = 1'-0"

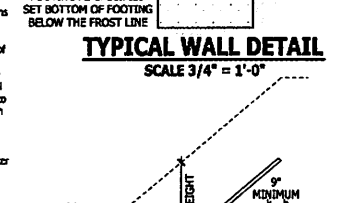

V TYPICAL STAIR DETAIL
SCALE 1/4" = 1'-0"

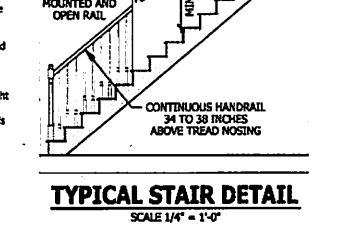

W TYPICAL WALL DETAIL
SCALE 3/4" = 1'-0"

PURCHASER MUST VERIFY ALL CONCRETE AND CONCRETE WORK CONSTRUCTION REQUIRES HOWE PLANS, INC. ASSURES NO LIABILITY FOR CONSTRUCTION PRACTICES AND PROCEDURES.
CODES AND CONVENTIONS MAY VARY WITH LOCALITY. LOCAL CODES, ORDINANCES, DECREE, ARCHITECTS OR ENGINEERS SHOULD BE CONSULTED BEFORE CONSTRUCTION.
THESE DRAWINGS ARE INSTRUMENTS OF SERVICE AND AS SUCH SHALL REMAIN PROPERTY OF THE DESIGNER.

TYPICAL DETAILS
Lindsay 1553

HAYNES WEAVER
HOME PLANS INC.
911.630.2100 • 919.616.4996


HAYNES WEAVER
HOME PLANS INC.
P.O. BOX 102, AUSTIN, TEXAS 78768-0102 • 911.630.2100

SQUARE FOOTAGE

AREA	UNLIMITED	UNLIMITED	UNLIMITED	UNLIMITED	UNLIMITED	UNLIMITED	UNLIMITED	UNLIMITED	UNLIMITED
1ST FLOOR	1000	1200	1400	1600	1800	2000	2200	2400	2600
2ND FLOOR	1000	1200	1400	1600	1800	2000	2200	2400	2600
3RD FLOOR	1000	1200	1400	1600	1800	2000	2200	2400	2600
4TH FLOOR	1000	1200	1400	1600	1800	2000	2200	2400	2600
5TH FLOOR	1000	1200	1400	1600	1800	2000	2200	2400	2600
6TH FLOOR	1000	1200	1400	1600	1800	2000	2200	2400	2600
7TH FLOOR	1000	1200	1400	1600	1800	2000	2200	2400	2600
8TH FLOOR	1000	1200	1400	1600	1800	2000	2200	2400	2600
9TH FLOOR	1000	1200	1400	1600	1800	2000	2200	2400	2600
10TH FLOOR	1000	1200	1400	1600	1800	2000	2200	2400	2600


© Copyright 2020
Haynes Home Plans, Inc.
9/28/2020
200505B
PAGE 6 OF 6

Z:\Builder\Weaver Development Company, Inc\200825B Lindsay 1616\200825B Lindsay 1553 Left.aec

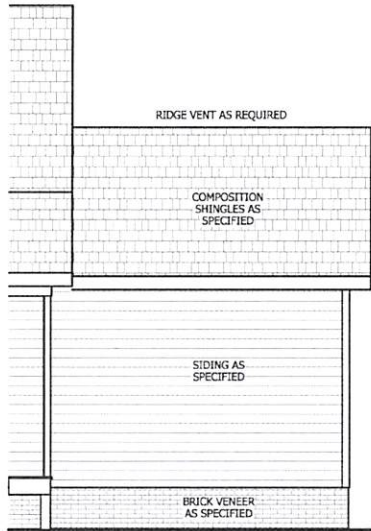


REAR ELEVATION

SCALE 1/8" = 1'-0"

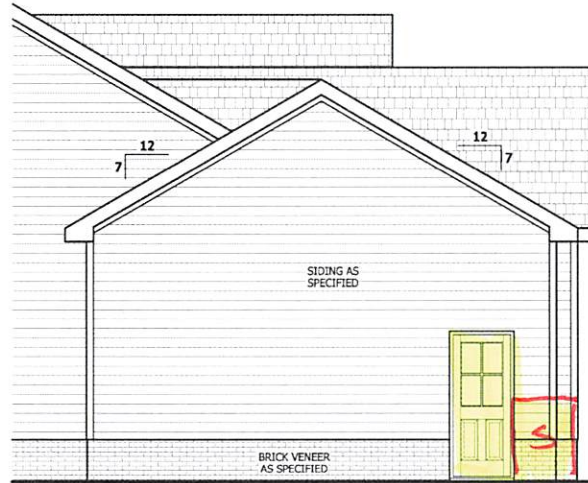

RIGHT SIDE ELEVATION


SCALE 1/4" = 1'-0"

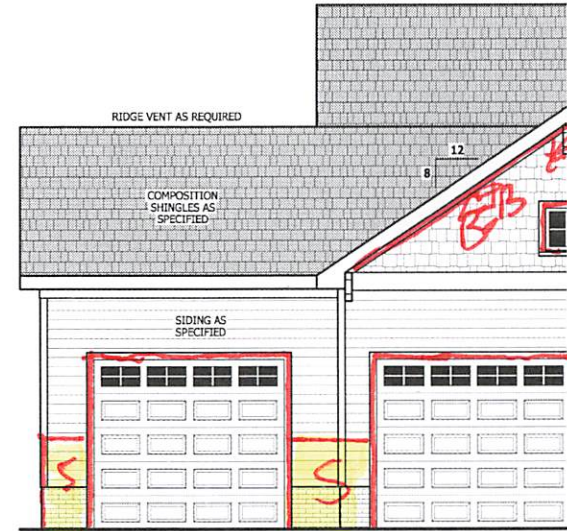

FRONT ELEVATION


SCALE 1/4" = 1'-0"

SEE BASE PLAN FOR NOTES AND DETAILS

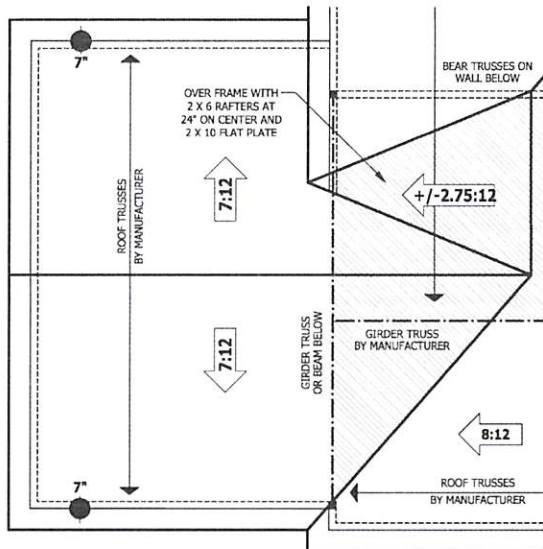


ROOF PLAN

SCALE 1/4" = 1'-0"

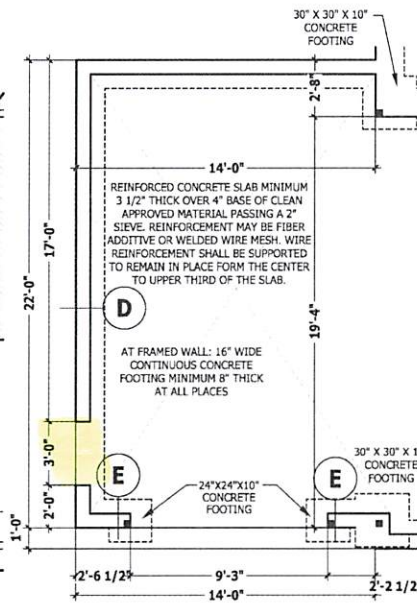


MONOLITHIC SLAB PLAN

SCALE 1/4" = 1'-0"

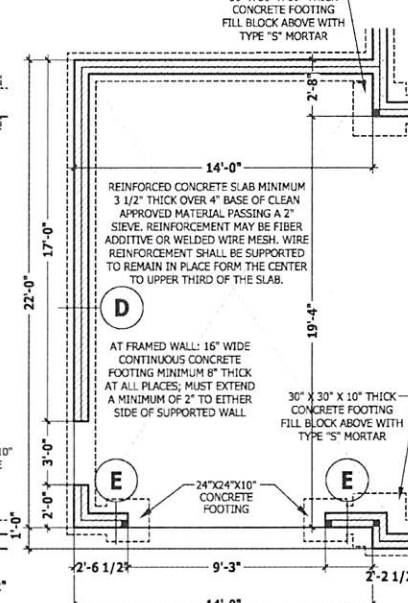

CRAWL SPACE / STEM WALL

SCALE 1/4" = 1'-0"

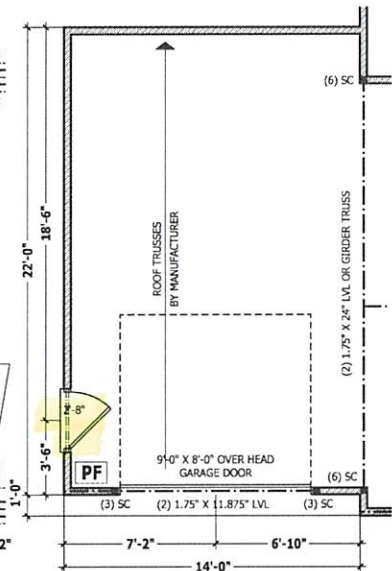

FIRST FLOOR PLAN

SCALE 1/4" = 1'-0"

PURCHASER MUST VERIFY ALL DIMENSIONS AND CONDITIONS BEFORE CONSTRUCTION BEGINS.
HAYNES HOME PLANS, INC. ASSUMES NO LIABILITY FOR CONTRACTORS PRACTICES AND PROCEDURES.
CODES AND CONDITIONS MAY VARY WITH LOCATION. A LOCAL DESIGNER, ARCHITECT OR ENGINEER SHOULD BE CONSULTED BEFORE CONSTRUCTION.
THESE DRAWINGS ARE INSTRUMENTS OF SERVICE AND AS SUCH SHALL REMAIN PROPERTY OF THE DESIGNER.

FRONT LOAD THIRD CAR

Lindsay 1553

HAYNES WEAVER
HOME PLANS, INC.
910.630.2100 • 919.806.4096
P.O. BOX 102, WISE FOREST, NC 27688, 919.455.1891, 1.866.491.0686

SQUARE FOOTAGE	
HEATED FIRST FLOOR	1838
UNHEATED SECOND FLOOR	1838
SCREENED FRONT PORCH	1838
SCREENED REAR PORCH	1838
UNHEATED GARAGE	1838
UNHEATED OPTIONAL	1838

© Copyright 2020
Haynes Home Plans, Inc.
9/28/2020
200505B
ADDENDUM



comtech
ROOF & FLOOR
TRUSSES & BEAMS

Be-ly-wood and Co. a Peak
 Affiliate, Inc. - 282508
 -Phone: 301-351-8262
 -Fax: 301-351-8412

WARNING: This drawing is for the use of the building contractor only. It is not to be used for any other purpose. The contractor is responsible for obtaining all necessary permits and for ensuring that the building is constructed in accordance with all applicable codes and regulations. The contractor is also responsible for ensuring that the building is constructed in accordance with the manufacturer's instructions and specifications. The contractor is also responsible for ensuring that the building is constructed in accordance with the applicable building codes and regulations.

By: **Lenny Norris**
 Lenny Norris


LOAD CHART FOR JOIST STAGES

STAGE	LOAD (PSF)	SPAN (FT)	DEFLECTION (IN)
1	10	12	0.1
2	20	24	0.2
3	30	36	0.3
4	40	48	0.4
5	50	60	0.5
6	60	72	0.6
7	70	84	0.7
8	80	96	0.8
9	90	108	0.9
10	100	120	1.0

CITY / CO.	Harrett Co. / Harnett
ADDRESS	Lot 3 Byrd Farm
MODEL	ROOF
DATE REV.	/ /
DRAWN BY	Lenny Norris
SALES REP.	Lenny Norris

BUILDER	Weaver Development Co. Inc.
JOB NAME	Lot 3 Byrd Farm
PLAN	Lindsey 1553 "B Full Porch" 3-car
SEAL DATE	
QUOTE #	J0221-0875
JOB #	

THIS IS A TRUSS PLACEMENT DIAGRAM ONLY.
 These trusses are designed as individual building components. They are not to be used for any other purpose. The contractor is responsible for obtaining all necessary permits and for ensuring that the building is constructed in accordance with all applicable codes and regulations. The contractor is also responsible for ensuring that the building is constructed in accordance with the manufacturer's instructions and specifications. The contractor is also responsible for ensuring that the building is constructed in accordance with the applicable building codes and regulations.

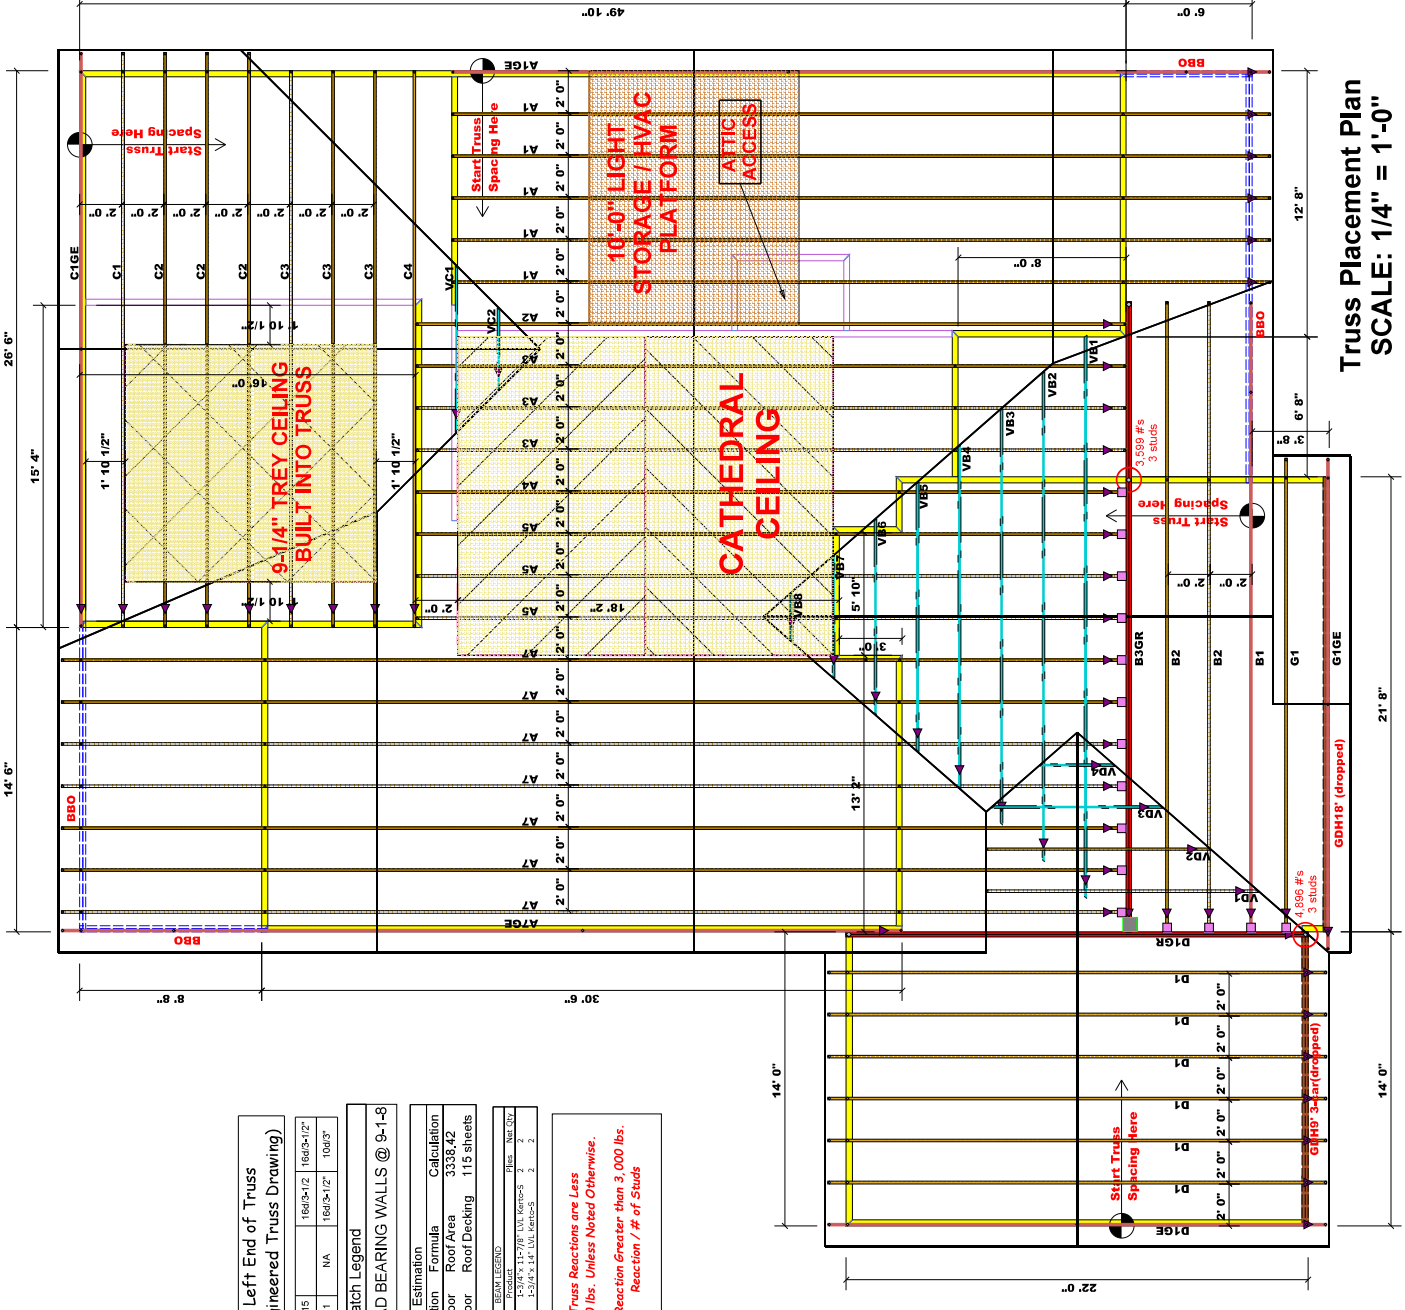

▲ = Denotes Left End of Truss
 (Reference Engineered Truss Drawing)

HUS28	USP	15	16d(3-1/2")
TH02P2	USP	1	16d(3-1/2") 10d(5")

Hatch Legend

■ = MAIN LOAD BEARING WALLS @ 9-1-8

Name	Selection	Formula	Calculation
Roof Area	1st Floor	Roof Area	3338.42
Roof Decking	1st Floor	Roof Decking	115 sheets

BEAM	Length	Product	# of Trusses	Plus	Net Qty
BBO	22' 0"	1-2x14x14 LVL Beams	2	2	0
BGR	22' 0"	1-2x14x14 LVL Beams	2	2	0
B1	22' 0"	1-2x14x14 LVL Beams	2	2	0
B2	22' 0"	1-2x14x14 LVL Beams	2	2	0
B3	22' 0"	1-2x14x14 LVL Beams	2	2	0
G1	22' 0"	1-2x14x14 LVL Beams	2	2	0
G2	22' 0"	1-2x14x14 LVL Beams	2	2	0
G3	22' 0"	1-2x14x14 LVL Beams	2	2	0
G4	22' 0"	1-2x14x14 LVL Beams	2	2	0
D1GR	22' 0"	1-2x14x14 LVL Beams	2	2	0
D2GR	22' 0"	1-2x14x14 LVL Beams	2	2	0
D3GR	22' 0"	1-2x14x14 LVL Beams	2	2	0
D4GR	22' 0"	1-2x14x14 LVL Beams	2	2	0

All Truss Reactions are Less than 3,000 lbs. Unless Noted Otherwise.
 -- Denotes Reaction Greater than 3,000 lbs.
 Reaction / # of Studs

Truss Placement Plan
SCALE: 1/4" = 1'-0"



comtech
ROOF & FLOOR
TRUSSES & BEAMS

Beily Road and Co. a Peak
Affiliate, P.O. Box 25708
Birmingham, AL 35202-0708
Phone: 205-351-8262
Fax: 205-351-8412

Having a truss design for a building that is intended to comply with the provisions of the International Building Code (IBC) and the International Residential Code (IRC) is not a guarantee of performance. The design and construction of a truss system is a complex engineering process that requires the services of a qualified professional engineer. The engineer is responsible for the design and construction of the truss system and for the safety of the building. The engineer is not responsible for the design and construction of the building structure, including the foundation, walls, and roof. The engineer is also not responsible for the design and construction of the building's mechanical, electrical, and plumbing systems. The engineer is only responsible for the truss system itself.

By: **Lenny Norris**
Lenny Norris

LOAD CHART FOR JOIST STATES

JOIST	SPAN	LOAD	REMARKS
16J16	16'-0"	1200	16J16
16J18	18'-0"	1200	16J18
16J20	20'-0"	1200	16J20
16J22	22'-0"	1200	16J22
16J24	24'-0"	1200	16J24
16J26	26'-0"	1200	16J26
16J28	28'-0"	1200	16J28
16J30	30'-0"	1200	16J30
16J32	32'-0"	1200	16J32
16J34	34'-0"	1200	16J34
16J36	36'-0"	1200	16J36
16J38	38'-0"	1200	16J38
16J40	40'-0"	1200	16J40

SALES REP: Lenny Norris
DRAWN BY: Lenny Norris
DATE REV: / /
MODEL: ROOF
ADDRESS: Lot 3 Byrd Farm
CITY / CO: Harrett Co / Harnett

JOB # J0221-0875
QUOTE #
SEAL DATE
PLAN Lindsey 1553 "B Full Porch" 3-car
JOB NAME Lot 3 Byrd Farm
BUILDER Weaver Development Co. Inc.

TRUSS A TRUSS PLACEMENT DIAGRAM ONLY.
These trusses are designed as individual trusses. They are not to be used as a design for the building structure. The design of the building structure is the responsibility of the building engineer. The building engineer is responsible for the design and construction of the building structure, including the foundation, walls, and roof. The building engineer is also responsible for the design and construction of the building's mechanical, electrical, and plumbing systems. The building engineer is only responsible for the building structure itself.

▲ = Denotes Left End of Truss
(Reference Engineered Truss Drawing)


TRUSS	USP	15	1669-112	1669-112	10413
HUS28	USP	1	NA	1669-112 <td>10413</td>	10413
THD28-2	USP	1	NA	1669-112 <td>10413</td>	10413

Hatch Legend
= MAIN LOAD BEARING WALLS @ 9'-1-8"

Name	Selection	Formula	Calculation
Roof Area	1st Floor	Roof Area	3338.42
Roof Decking	1st Floor	Roof Decking	115 sheets

BEAM LEGEND	Beam	Use	Qty
16J16	16J16	16J16	2
16J18	16J18	16J18	2
16J20	16J20	16J20	2
16J22	16J22	16J22	2
16J24	16J24	16J24	2
16J26	16J26	16J26	2
16J28	16J28	16J28	2
16J30	16J30	16J30	2
16J32	16J32	16J32	2
16J34	16J34	16J34	2
16J36	16J36	16J36	2
16J38	16J38	16J38	2
16J40	16J40	16J40	2

All Truss Reactions are Less than 3,000 lbs. Unless Noted Otherwise.
--- Denotes Reaction Greater than 3,000 lbs.
Reaction / # of Studs

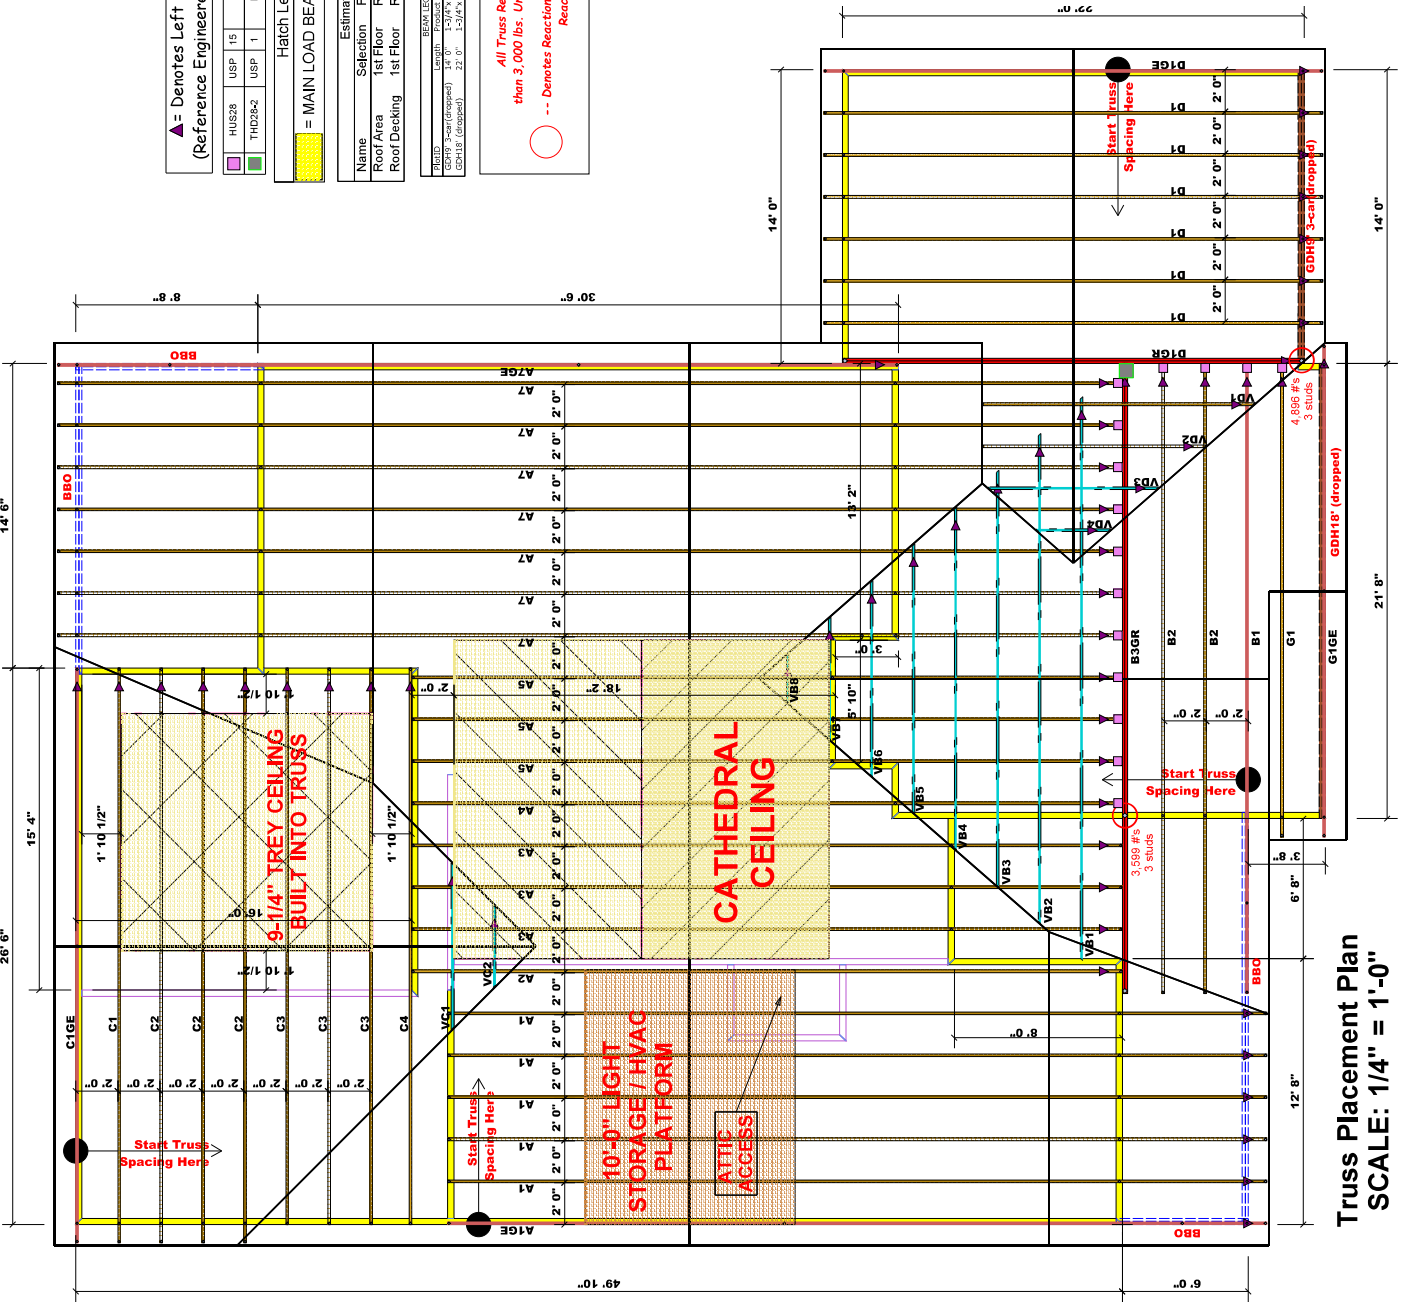

Truss Placement Plan
SCALE: 1/4" = 1'-0"