

Harnett County Department of Public Health

PERMIT # SFD2012-0047

Operation Permit

821415

New Installation Septic Tank Nitrification Line Repair Expansion

PROPERTY LOCATION: 438 MILL BEND DR. (RAW'S CH. 102)

Name: (owner) DAN RYAN BLDG SUBDIVISION OLDE MILL VILLAGE LOT # 46

System Installer: C & M PLUMBING

Basement with plumbing: Garage Number of Bedrooms 4


Type of Water Supply: Community Public Well Distance from well NA feet

System Type: 25% REDUCTION SYSTEM III B Types V and VI Systems expire in 5 years.

(In accordance with Table V a)

Owner must contact Health Department 6 months prior to expiration for permit renewal.

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

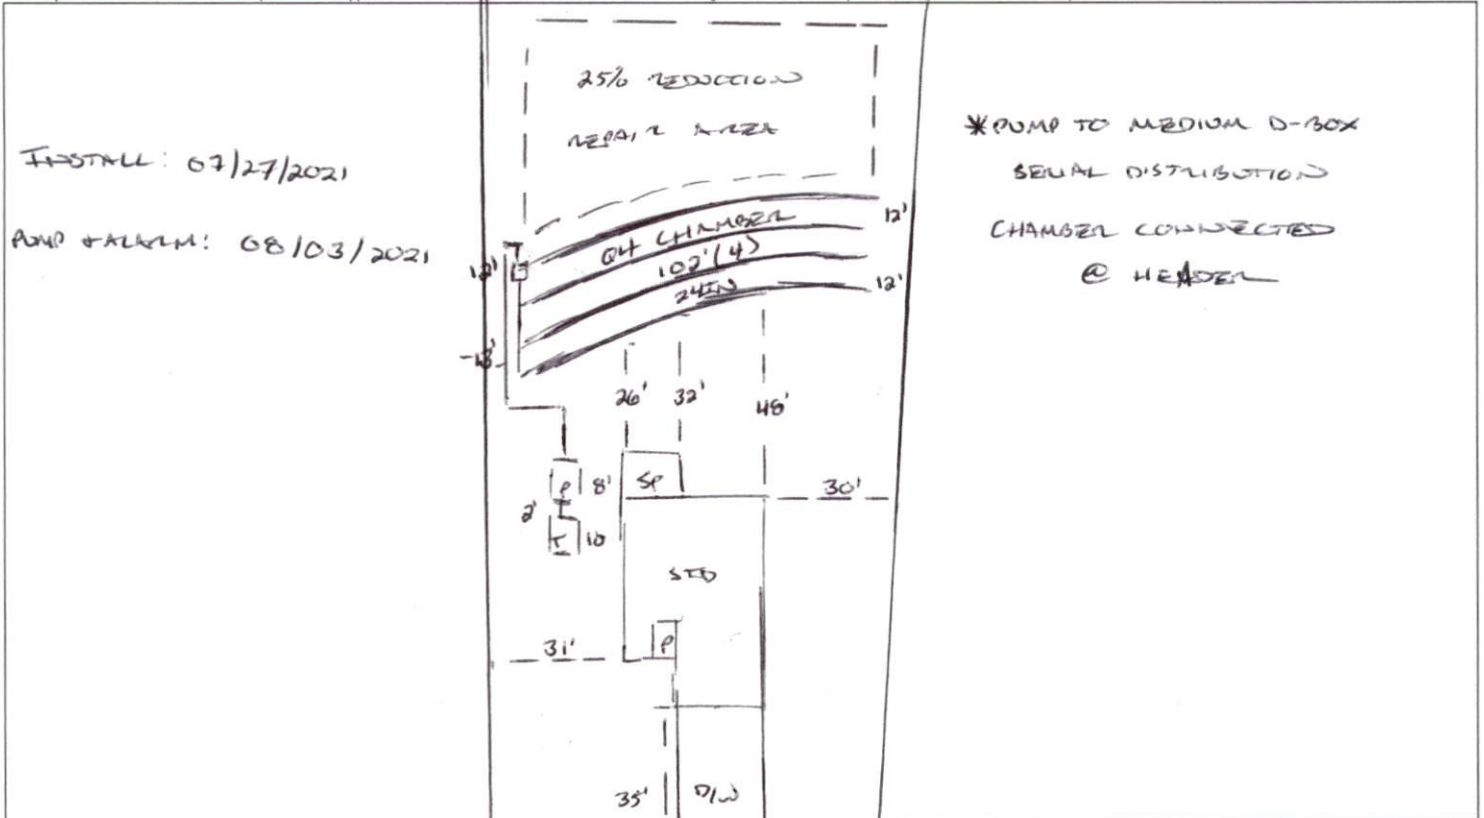

*PUMP TO MEDIUM D-BOX
SEWAL DISTRIBUTION
CHAMBER CONNECTED
@ HEADER

INSTALL: 07/27/2021

AMP + ALLOW: 08/03/2021

PERMIT CONDITIONS:

- I. Performance: System shall perform in accordance with Rule .1961.
- II. Monitoring: As required by Rule .1961.
- III. Maintenance: As required by Rule .1961. Other: MILL BEND DR.
Subsurface system operator required? Yes No
If yes, see attached sheet for additional operation conditions, maintenance and reporting.
- IV. Operation: _____
- V. Other: _____

_____ D-Box _____ Pump _____ Alarm _____ H2O Line _____ PWR Line

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system: Conventional Other 94 CHAMBER III B Septic Tank: 1000 gallons Pump Tank: 1000 gallons
Subsurface No. of exact length width of depth of
Drainage Field ditches 4 of each ditch 102 feet ditches 3 feet ditches 24 inches
French Drain Required: _____ Linear feet

Authorized State Agent [Signature] Date 08/03/2021