



BM1 Kerto-S LVL 1.750" X 16.000" 3-Ply - PASSED

Level: Level

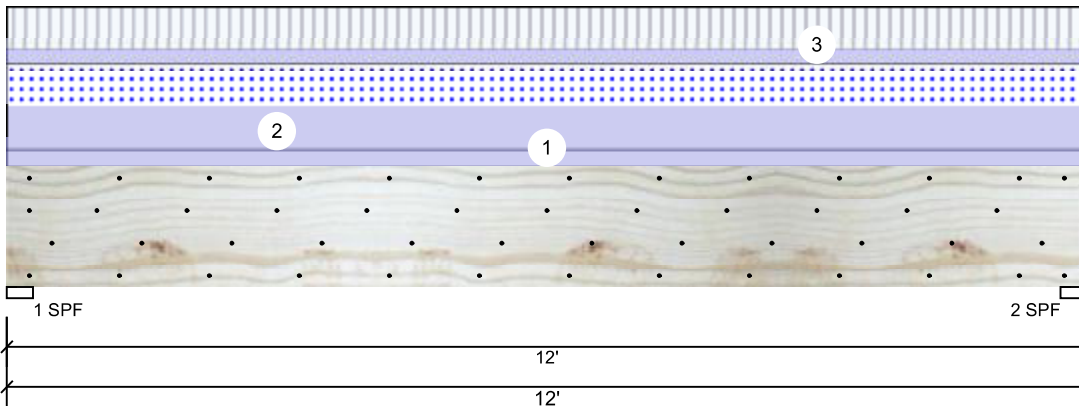

Member Information

| | |
|---------------------|---------------|
| Type: | Girder |
| Plies: | 3 |
| Moisture Condition: | Dry |
| Deflection LL: | 480 |
| Deflection TL: | 360 |
| Importance: | Normal |
| Temperature: | Temp <= 100°F |

| | |
|----------------|--------------|
| Application: | Floor |
| Design Method: | ASD |
| Building Code: | IBC/IRC 2015 |
| Load Sharing: | Yes |
| Deck: | Not Checked |

Reactions UNPATTERNED lb (Uplift)

| Brg | Live | Dead | Snow | Wind | Const |
|-----|------|------|------|------|-------|
| 1 | 1932 | 3454 | 1950 | 0 | 0 |
| 2 | 1932 | 3454 | 1950 | 0 | 0 |

Bearings

| Bearing | Length | Cap. React | D/L lb | Total | Ld. Case | Ld. Comb. |
|---------|--------|------------|-------------|-------|----------|-------------|
| 1 - SPF | 3.500" | 82% | 3454 / 2912 | 6366 | L | D+0.75(L+S) |
| 2 - SPF | 3.500" | 82% | 3454 / 2912 | 6366 | L | D+0.75(L+S) |

Analysis Results

| Analysis | Actual | Location | Allowed | Capacity | Comb. | Case |
|--------------|----------------|----------|---------------|--------------|-------------|------|
| Moment | 17729 ft-lb | 6' | 62010 ft-lb | 0.286 (29%) | D+0.75(L+S) | L |
| Unbraced | 17729 ft-lb | 6' | 17732 ft-lb | 1.000 (100%) | D+0.75(L+S) | L |
| Shear | 4565 lb | 1'6 5/8" | 17920 lb | 0.255 (25%) | D+L | L |
| LL Defl inch | 0.066 (L/2116) | 6' | 0.289 (L/480) | 0.230 (23%) | 0.75(L+S) | L |
| TL Defl inch | 0.143 (L/968) | 6' | 0.385 (L/360) | 0.370 (37%) | D+0.75(L+S) | L |

Design Notes

- 1 Fasten all plies using 4 rows of 10d Box nails (.128x3") at 12" o.c. Maximum end distance not to exceed 6".
- 2 Refer to last page of calculations for fasteners required for specified loads.
- 3 Girders are designed to be supported on the bottom edge only.
- 4 Top loads must be supported equally by all plies.
- 5 Top must be laterally braced at a maximum of 10'4 1/8" o.c.
- 6 Bottom braced at bearings.
- 7 Lateral slenderness ratio based on single ply width.

| ID | Load Type | Location | Trib Width | Side | Dead 0.9 | Live 1 | Snow 1.15 | Wind 1.6 | Const. 1.25 | Comments |
|----|-------------|----------|------------|----------|----------|---------|-----------|----------|-------------|---------------|
| 1 | Uniform | | | Top | 125 PLF | 0 PLF | 0 PLF | 0 PLF | 0 PLF | Exterior Wall |
| 2 | Uniform | | | Top | 325 PLF | 0 PLF | 325 PLF | 0 PLF | 0 PLF | A2 |
| 3 | Uniform | | | Far Face | 107 PLF | 322 PLF | 0 PLF | 0 PLF | 0 PLF | F1 |
| | Self Weight | | | | 19 PLF | | | | | |

Notes

Calculated Structured Designs is responsible only of the structural adequacy of this component based on the design criteria and loadings shown. It is the responsibility of the customer and/or the contractor to ensure the component suitability of the intended application, and to verify the dimensions and loads.

Lumber

1. Dry service conditions, unless noted otherwise
2. LVL not to be treated with fire retardant or corrosive

chemicals

Handling & Installation

1. LVL beams must not be cut or drilled
2. Refer to manufacturer's product information regarding installation requirements, multi-ply fastening details, beam strength values, and code approvals
3. Damaged Beams must not be used
4. Design assumes top edge is laterally restrained
5. Provide lateral support at bearing points to avoid lateral displacement and rotation

6. For flat roofs provide proper drainage to prevent ponding

Manufacturer Info

Metsä Wood
 301 Merritt 7 Building, 2nd Floor
 Norwalk, CT 06851
 (800) 622-5850
www.metsawood.com/us
 ICC-ES: ESR-3633


Comtech, Inc.
 1001 S. Reilly Road, Suite #639
 Fayetteville, NC
 USA
 28314
 910-864-TRUS



This design is valid until 1/8/2023

BM2 Kerto-S LVL 1.750" X 16.000" 2-Ply - PASSED

Level: Level

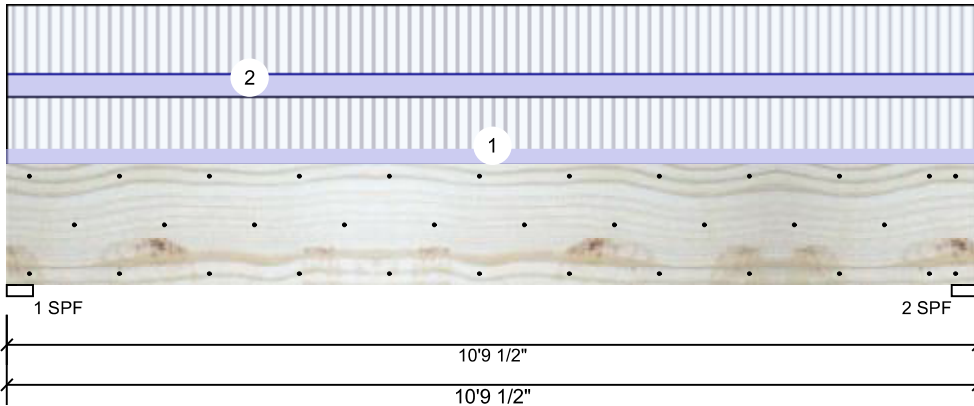

Member Information

| | |
|---------------------|---------------|
| Type: | Girder |
| Plies: | 2 |
| Moisture Condition: | Dry |
| Deflection LL: | 480 |
| Deflection TL: | 360 |
| Importance: | Normal |
| Temperature: | Temp <= 100°F |

| | |
|----------------|--------------|
| Application: | Floor |
| Design Method: | ASD |
| Building Code: | IBC/IRC 2015 |
| Load Sharing: | No |
| Deck: | Not Checked |

Reactions UNPATTERNED lb (Uplift)

| Brg | Live | Dead | Snow | Wind | Const |
|-----|------|------|------|------|-------|
| 1 | 3389 | 1200 | 0 | 0 | 0 |
| 2 | 3389 | 1200 | 0 | 0 | 0 |

Bearings

| Bearing | Length | Cap. | React D/L | Ib | Total | Ld. Case | Ld. Comb. |
|---------|--------|------|-------------|------|-------|----------|-----------|
| 1 - SPF | 3.500" | 88% | 1200 / 3389 | 4589 | L | D+L | |
| 2 - SPF | 3.500" | 88% | 1200 / 3389 | 4589 | L | D+L | |

Analysis Results

| Analysis | Actual | Location | Allowed | Capacity | Comb. | Case |
|--------------|----------------|----------|---------------|-------------|-------|------|
| Moment | 11397 ft-lb | 5'4 3/4" | 34565 ft-lb | 0.330 (33%) | D+L | L |
| Unbraced | 11397 ft-lb | 5'4 3/4" | 11746 ft-lb | 0.970 (97%) | D+L | L |
| Shear | 4386 lb | 1'6 5/8" | 11947 lb | 0.367 (37%) | D+L | L |
| LL Defl inch | 0.085 (L/1457) | 5'4 3/4" | 0.259 (L/480) | 0.330 (33%) | L | L |
| TL Defl inch | 0.115 (L/1076) | 5'4 3/4" | 0.345 (L/360) | 0.330 (33%) | D+L | L |

Design Notes

- 1 Fasten all plies using 3 rows of 10d Box nails (.128x3") at 12" o.c. Maximum end distance not to exceed 6".
- 2 Refer to last page of calculations for fasteners required for specified loads.
- 3 Girders are designed to be supported on the bottom edge only.
- 4 Top braced at bearings.
- 5 Bottom braced at bearings.
- 6 Lateral slenderness ratio based on single ply width.

| ID | Load Type | Location | Trib Width | Side | Dead 0.9 | Live 1 | Snow 1.15 | Wind 1.6 | Const. 1.25 | Comments |
|----|-------------|----------|------------|-----------|----------|---------|-----------|----------|-------------|----------|
| 1 | Uniform | | | Far Face | 89 PLF | 267 PLF | 0 PLF | 0 PLF | 0 PLF | F4 |
| 2 | Uniform | | | Near Face | 121 PLF | 361 PLF | 0 PLF | 0 PLF | 0 PLF | F2 |
| | Self Weight | | | | 12 PLF | | | | | |

Notes

Calculated Structured Designs is responsible only of the structural adequacy of this component based on the design criteria and loadings shown. It is the responsibility of the customer and/or the contractor to ensure the component suitability of the intended application, and to verify the dimensions and loads.

Lumber

1. Dry service conditions, unless noted otherwise
2. LVL not to be treated with fire retardant or corrosive chemicals

Handling & Installation

1. LVL beams must not be cut or drilled
2. Refer to manufacturer's product information regarding installation requirements, multi-ply fastening details, beam strength values, and code approvals
3. Damaged Beams must not be used
4. Design assumes top edge is laterally restrained
5. Provide lateral support at bearing points to avoid lateral displacement and rotation

6. For flat roofs provide proper drainage to prevent ponding

Manufacturer Info

Metsä Wood
 301 Merritt 7 Building, 2nd Floor
 Norwalk, CT 06851
 (800) 622-5850
www.metsawood.com/us
 ICC-ES: ESR-3633


Comtech, Inc.
 1001 S. Reilly Road, Suite #639
 Fayetteville, NC
 USA
 28314
 910-864-TRUS



This design is valid until 1/8/2023

GDH Kerto-S LVL 1.750" X 11.875" 2-Ply - PASSED

Level: Level

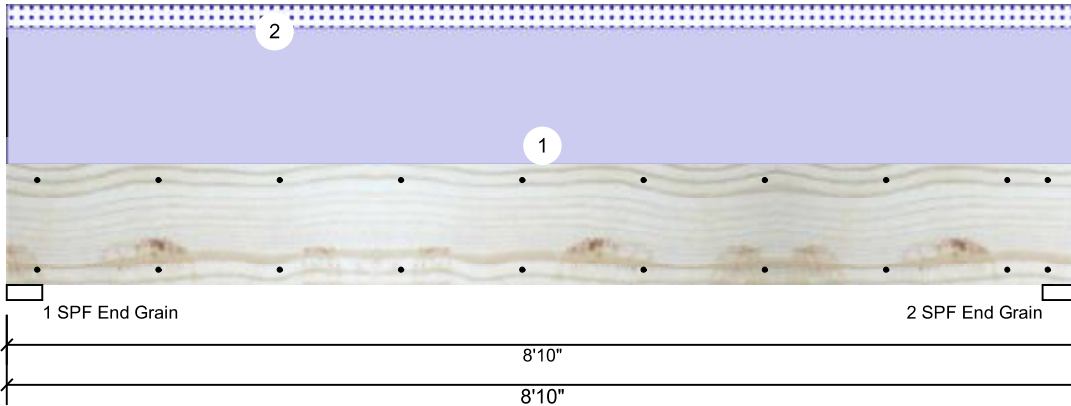

Member Information

| | |
|---------------------|---------------|
| Type: | Girder |
| Plies: | 2 |
| Moisture Condition: | Dry |
| Deflection LL: | 480 |
| Deflection TL: | 360 |
| Importance: | Normal |
| Temperature: | Temp <= 100°F |

| | |
|----------------|--------------|
| Application: | Floor |
| Design Method: | ASD |
| Building Code: | IBC/IRC 2015 |
| Load Sharing: | No |
| Deck: | Not Checked |

Reactions UNPATTERNED lb (Uplift)

| Brg | Live | Dead | Snow | Wind | Const |
|-----|------|------|------|------|-------|
| 1 | 0 | 1101 | 177 | 0 | 0 |
| 2 | 0 | 1101 | 177 | 0 | 0 |

Bearings

| Bearing | Length | Cap. React | D/L Ib | Total | Ld. Case | Ld. Comb. |
|-------------------|--------|------------|------------|-------|----------|-----------|
| 1 - SPF End Grain | 3.500" | 12% | 1101 / 177 | 1277 | L | D+S |
| 2 - SPF End Grain | 3.500" | 12% | 1101 / 177 | 1277 | L | D+S |

Analysis Results

| Analysis | Actual | Location | Allowed | Capacity | Comb. | Case |
|------------------------|------------|-----------|---------------|-------------|-------|---------|
| Moment | 2185 ft-lb | 4'5" | 17919 ft-lb | 0.122 (12%) | D | Uniform |
| Unbraced | 2536 ft-lb | 4'5" | 10756 ft-lb | 0.236 (24%) | D+S | L |
| Shear | 797 lb | 7'7 3/8" | 7980 lb | 0.100 (10%) | D | Uniform |
| LL Defl inch (L/18257) | 0.006 | 4'5 1/16" | 0.209 (L/480) | 0.030 (3%) | S | L |
| TL Defl inch (L/2525) | 0.040 | 4'5 1/16" | 0.279 (L/360) | 0.140 (14%) | D+S | L |

Design Notes

- 1 Fasten all plies using 2 rows of 10d Box nails (.128x3") at 12" o.c. Maximum end distance not to exceed 6".
- 2 Refer to last page of calculations for fasteners required for specified loads.
- 3 Girders are designed to be supported on the bottom edge only.
- 4 Top loads must be supported equally by all plies.
- 5 Top braced at bearings.
- 6 Bottom braced at bearings.
- 7 Lateral slenderness ratio based on single ply width.

| ID | Load Type | Location | Trib Width | Side | Dead 0.9 | Live 1 | Snow 1.15 | Wind 1.6 | Const. 1.25 | Comments |
|----|-------------|----------|------------|------|----------|--------|-----------|----------|-------------|-----------------|
| 1 | Uniform | | | Top | 200 PLF | 0 PLF | 0 PLF | 0 PLF | 0 PLF | Exterior Loads |
| 2 | Uniform | | | Top | 40 PLF | 0 PLF | 40 PLF | 0 PLF | 0 PLF | 2'-0" Gable End |
| | Self Weight | | | | 9 PLF | | | | | |

Notes

Calculated Structured Designs is responsible only of the structural adequacy of this component based on the design criteria and loadings shown. It is the responsibility of the customer and/or the contractor to ensure the component suitability of the intended application, and to verify the dimensions and loads.

Lumber

1. Dry service conditions, unless noted otherwise
2. LVL not to be treated with fire retardant or corrosive chemicals

Handling & Installation

1. LVL beams must not be cut or drilled
2. Refer to manufacturer's product information regarding installation requirements, multi-ply fastening details, beam strength values, and code approvals
3. Damaged Beams must not be used
4. Design assumes top edge is laterally restrained
5. Provide lateral support at bearing points to avoid lateral displacement and rotation

6. For flat roofs provide proper drainage to prevent ponding

This design is valid until 1/8/2023

Manufacturer Info

Metsä Wood
 301 Merritt 7 Building, 2nd Floor
 Norwalk, CT 06851
 (800) 622-5850
www.metsawood.com/us
 ICC-ES: ESR-3633

Comtech, Inc.
 1001 S. Reilly Road, Suite #639
 Fayetteville, NC
 USA
 28314
 910-864-TRUS

