


▲ = Denotes Left End of Truss  
(Reference Engineered Truss Drawing)

### Truss Placement Plan SCALE: NTS



**All Truss Reactions are Less than 3,000 lbs. Unless Noted Otherwise.**  
 -- Denotes Reaction Greater than 3,000 lbs.  
 Reaction / # of Studs


**LOAD CHART FOR JACK STUDS**

NO. OF JACKS	SPACING	LOAD (LBS)	NO. OF JACKS	SPACING	LOAD (LBS)
1	2550	3400	1	2550	3400
2	5100	6800	2	5100	6800
3	7650	10200	3	7650	10200
4	10200	13600	4	10200	13600
5	12750	17000	5	12750	17000
6	15300		6	15300	
7			7		
8			8		
9			9		

<b>BUILDER</b>	Weaver Development	<b>CITY / CO.</b>	Harnett Co. / Harnett
<b>JOB NAME</b>	Lot 69 Thomas Farm	<b>ADDRESS</b>	Lot 69 Thomas Farm
<b>PLAN</b>	Magnolia Elev. B	<b>MODEL</b>	Roof
<b>SEAL DATE</b>	Seal Date	<b>DATE REV.</b>	/ /
<b>QUOTE #</b>	Quote #	<b>DRAWN BY</b>	Christine Shivy
<b>JOB #</b>	J1220-5726	<b>SALES REP.</b>	Lenny Norris


<b>THIS IS A TRUSS PLACEMENT DIAGRAM ONLY.</b>	
These trusses are designed as individual building components to be incorporated into the building design at the specification of the building designer. See individual design sheets for each truss design identified on the placement drawing. The building designer is responsible for temporary and permanent bracing of the roof and floor system and for the overall structure. The design of the truss support structure including headers, beams, walls, and columns is the responsibility of the building designer. For general guidance regarding bracing, consult BCSB-1 and BCSB-3 provided with the truss delivery package or online at sbcindustry.com	
Bearing reactions less than or equal to 3000# are deemed to comply with the prescriptive Code requirements. The contractor shall refer to the attached Tables ( derived from the prescriptive Code requirements ) to determine the minimum foundation size and number of wood studs required to support reactions greater than 3000# but not greater than 15000#. A registered design professional shall be retained to design the support system for any reaction that exceeds those specified in the attached Tables. A registered design professional shall be retained to design the support system for all reactions that exceed 15000#.	
Signature <u>Christine Shivy</u> Christine Shivy	

<b>COMTECH</b>
<b>ROOF &amp; FLOOR TRUSSES &amp; BEAMS</b>
Reilly Road Industrial Park Fayetteville, N.C. 28309 Phone: (910) 864-8787 Fax: (910) 864-4444

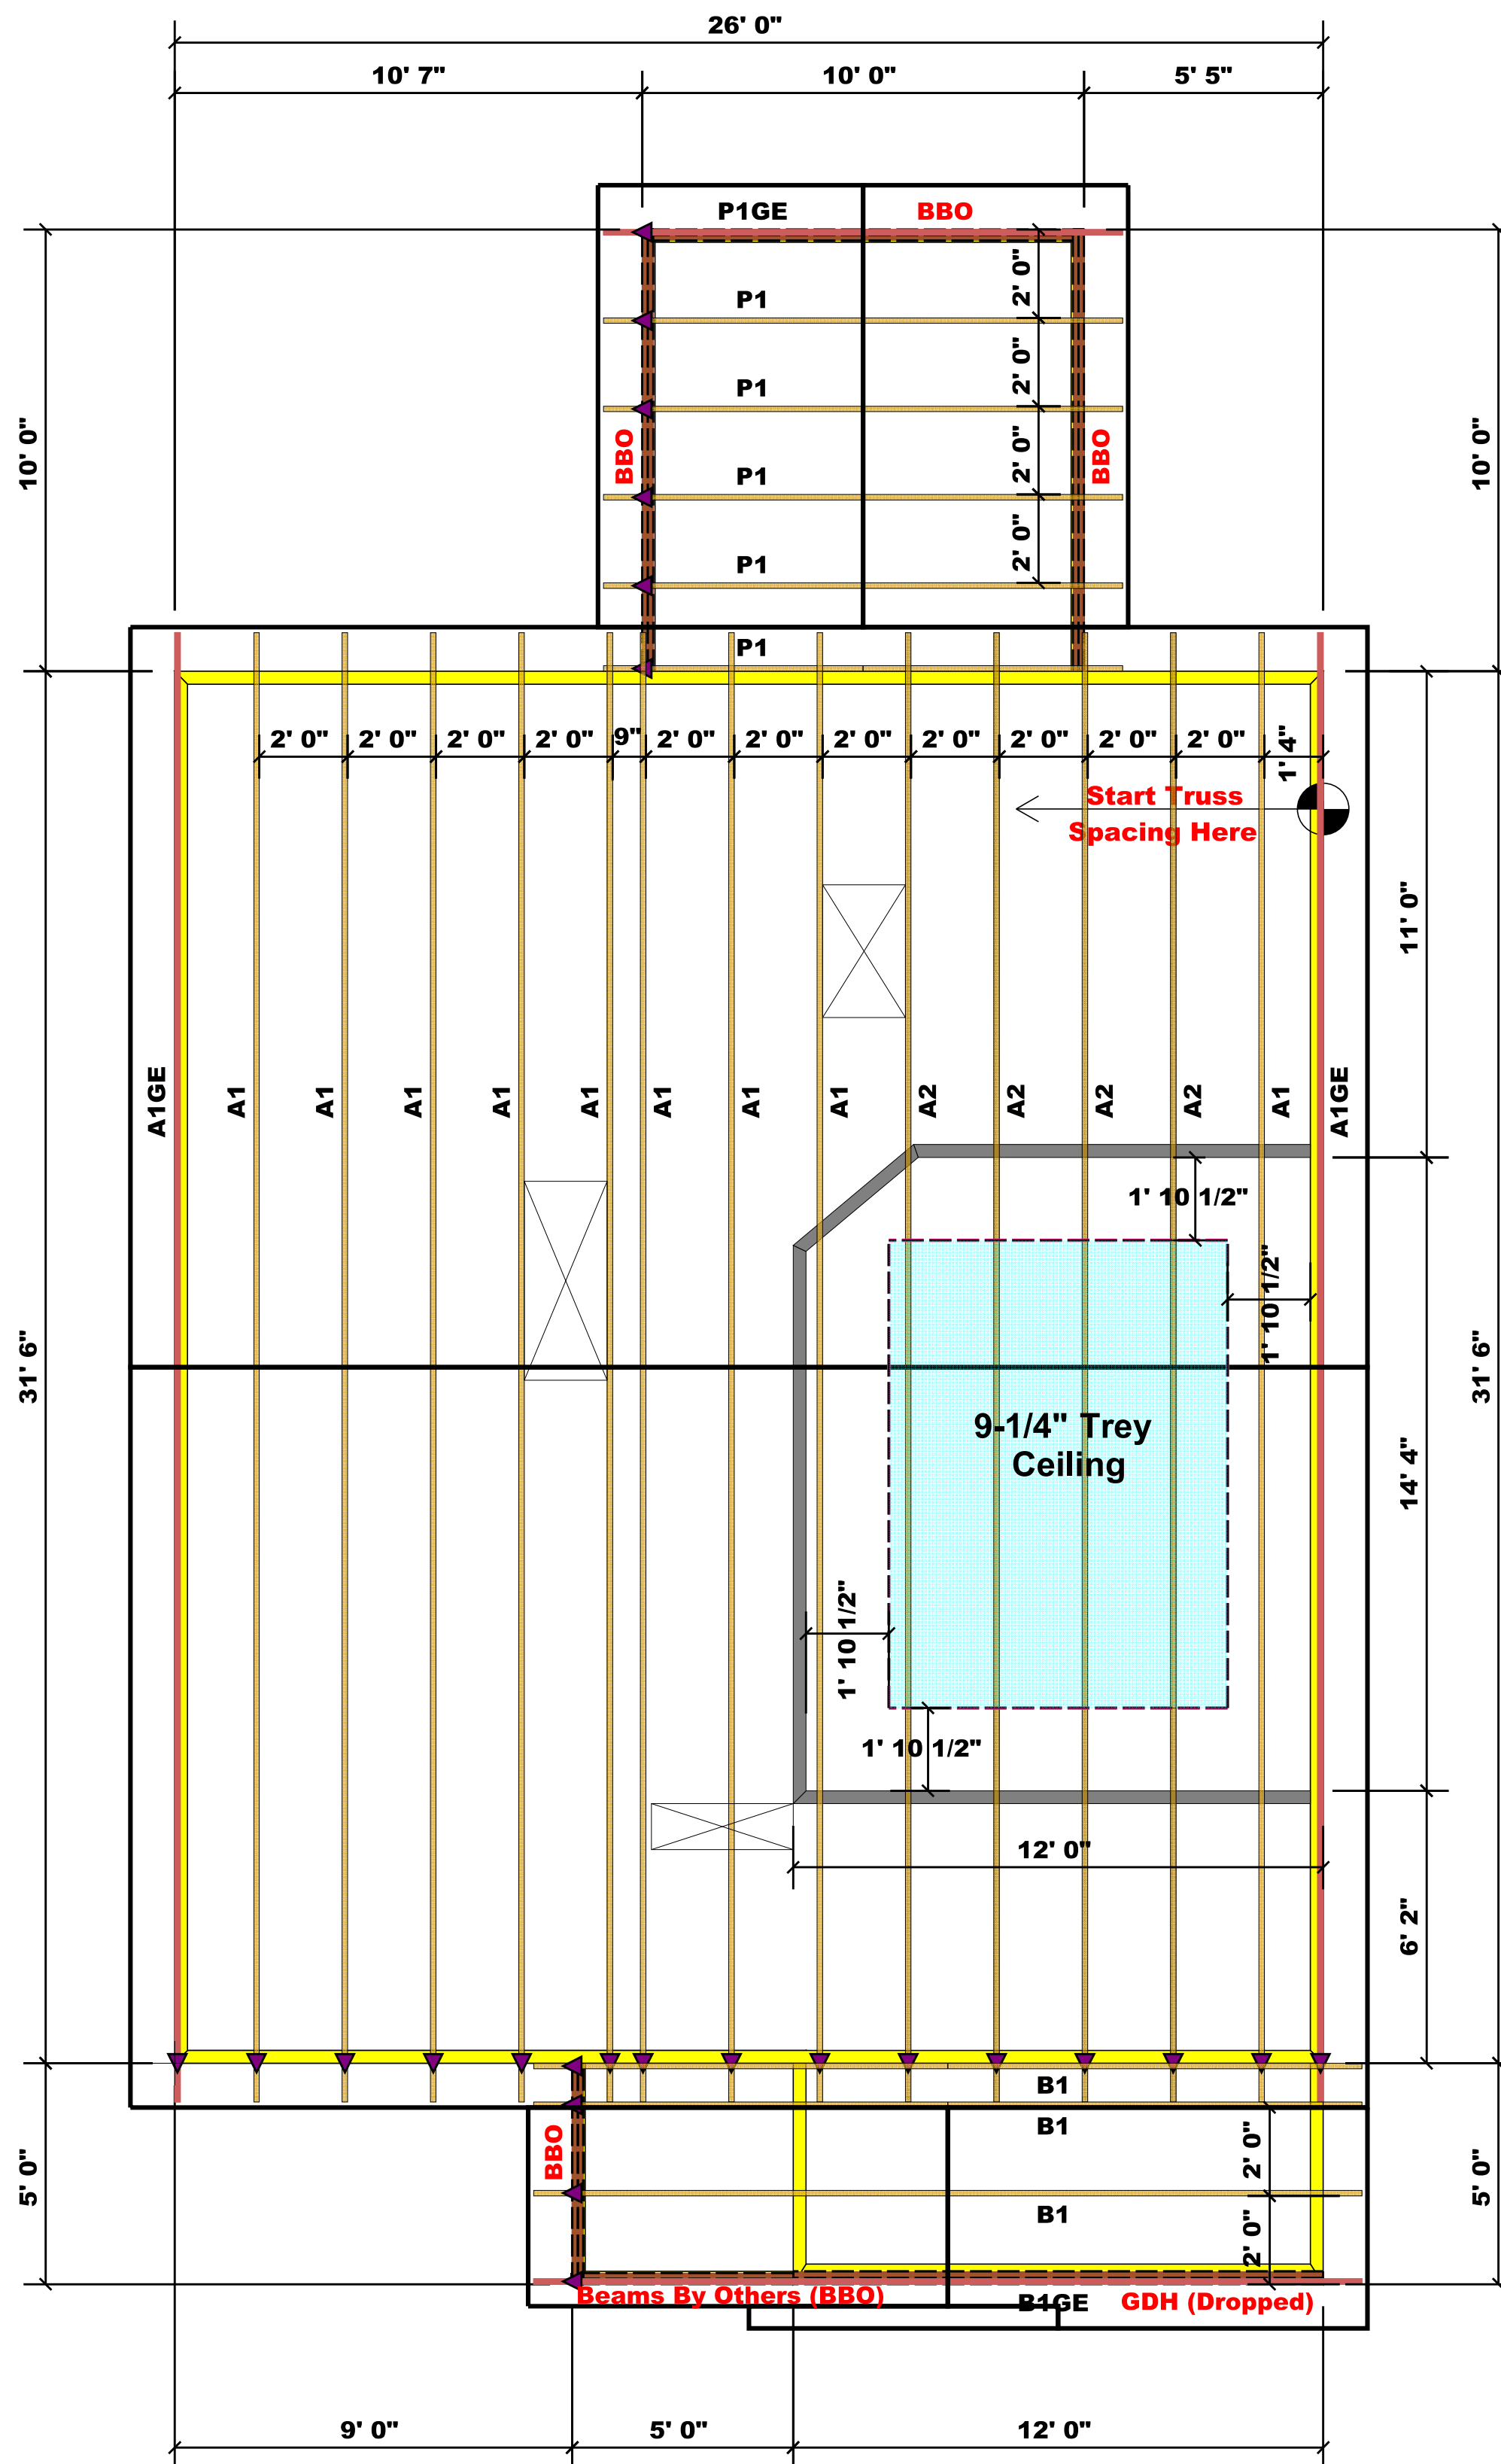

▲ = Denotes Left End of Truss  
(Reference Engineered Truss Drawing)

### Truss Placement Plan SCALE: NTS



**All Truss Reactions are Less than 3,000 lbs. Unless Noted Otherwise.**  
 -- Denotes Reaction Greater than 3,000 lbs. Reaction / # of Studs

**LOAD CHART FOR JACK STUDS**

NO. OF JACKS	SPACING	LOAD (LBS.)	NO. OF JACKS	SPACING	LOAD (LBS.)
1	2550	3400	1	2550	3400
2	5100	6800	2	5100	6800
3	7650	10200	3	7650	10200
4	10200	13600	4	10200	13600
5	12750	17000	5	12750	17000
6	15300		6	15300	
7			7		
8			8		
9			9		

<b>BUILDER</b>	Weaver Development	<b>CITY / CO.</b>	Harnett Co. / Harnett
<b>JOB NAME</b>	Lot 69 Thomas Farm	<b>ADDRESS</b>	Lot 69 Thomas Farm
<b>PLAN</b>	Magnolia Elev. B	<b>MODEL</b>	Roof
<b>SEAL DATE</b>	Seal Date	<b>DATE REV.</b>	//
<b>QUOTE #</b>	Quote #	<b>DRAWN BY</b>	Christine Shivy
<b>JOB #</b>	J1220-5726	<b>SALES REP.</b>	Lenny Norris

<b>THIS IS A TRUSS PLACEMENT DIAGRAM ONLY.</b>	
These trusses are designed as individual building components to be incorporated into the building design at the specification of the building designer. See individual design sheets for each truss design identified on the placement drawing. The building designer is responsible for temporary and permanent bracing of the roof and floor system and for the overall structure. The design of the truss support structure including headers, beams, walls, and columns is the responsibility of the building designer. For general guidance regarding bracing, consult BCSB-B1 and BCSB-B3 provided with the truss delivery package or online at sbcindustry.com	
Bearing reactions less than or equal to 3000# are deemed to comply with the prescriptive Code requirements. The contractor shall refer to the attached Tables (derived from the prescriptive Code requirements) to determine the minimum foundation size and number of wood studs required to support reactions greater than 3000# but not greater than 15000#. A registered design professional shall be retained to design the support system for any reaction that exceeds those specified in the attached Tables. A registered design professional shall be retained to design the support system for all reactions that exceed 15000#.	
Signature	<u>Christine Shivy</u> Christine Shivy



**ROOF & FLOOR TRUSSES & BEAMS**  
 Reilly Road Industrial Park  
 Fayetteville, N.C. 28309  
 Phone: (910) 864-8787  
 Fax: (910) 864-4444