

NOTICE TO CONTRACTOR
All construction must comply with current NC Building Codes and is subject to field inspection and verification.

APPROVED
Limited building only review
Permit holder responsible for full compliance with the code

02/22/2021





FRONT ELEVATION

Scale: 1/4" = 1'0"

9'0" CEILING HEIGHT FIRST FLOOR
(HEADER HEIGHT 7'6")
8'0" CEILING HEIGHT SECOND FLOOR
(HEADER HEIGHT 7')

FRAME WINDOWS TO HEADER HEIGHT



LEFT ELEVATION

Scale: 1/8" = 1'0"



RIGHT ELEVATION

Scale: 1/8" = 1'0"



REAR ELEVATION

Scale: 1/8" = 1'0"

PLAN:
MISES 1.0

SHEET TITLE:
ELEVATIONS

PROJECT ADDRESS:
42 NAVAHO TRAIL
SUMMERLIN LOT 35

DESIGNED BY:
Precision Custom Homes
Raeford, NC
Shaun@PrecisionCustomHomesNC.com

DATE:


1/12/21

SCALE:

1/4" = 1'

SHEET:

A-1

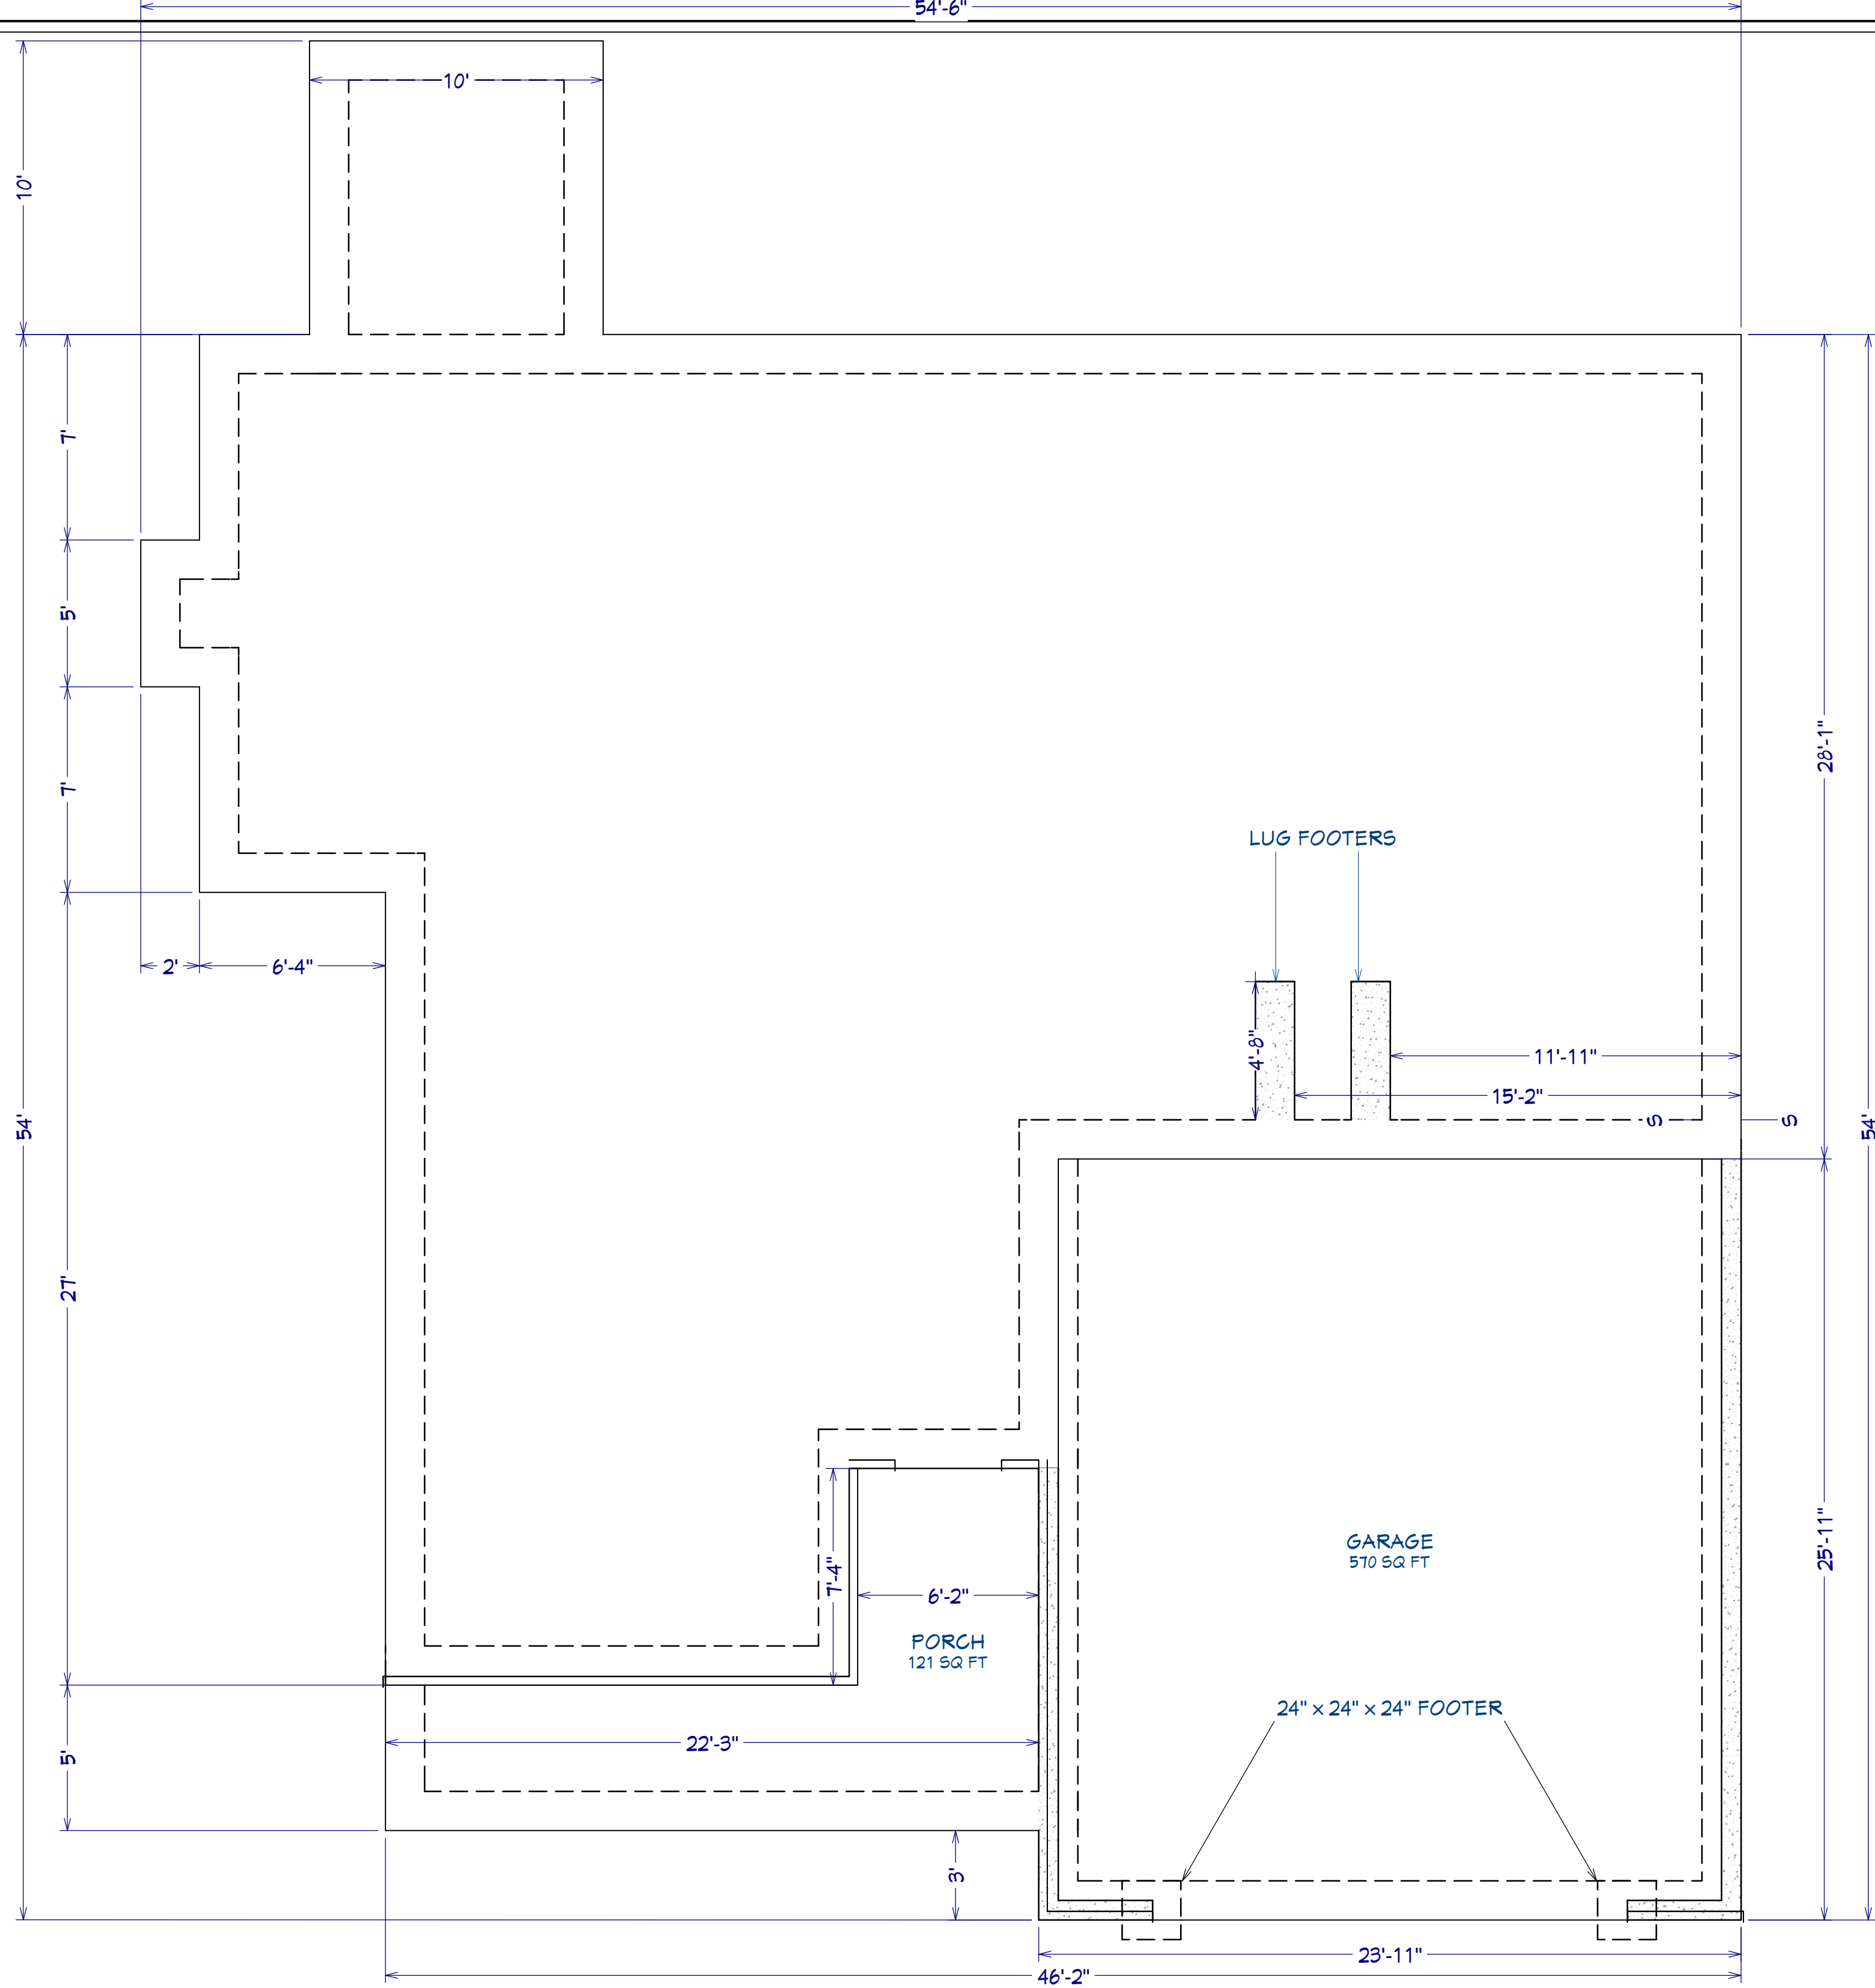

AREA SCHEDULE	
1ST FLOOR AREA	1,785 SF
2ND FLOOR AREA	646 SF
TOTAL HEATED AREA	2,431 SF
GARAGE	606 SF
FRONT PORCH	156 SF
REAR PORCH	100 SF
TOTAL AREA UNDER ROOF	3,293 SF

FOUNDATION PLAN
Scale: 1/4" = 1'0"

PLAN:
MISES 1.0

SHEET TITLE:
FOUNDATION


PROJECT ADDRESS:
42 NAVAHO TRAIL
SUMMERLIN LOT 35

DESIGNED BY:
Precision Custom Homes
Raeferd, NC
Shaun@PrecisionCustomHomesNC.com


DATE:
1/12/21

SCALE:
1/4" = 1'

SHEET:
A-2

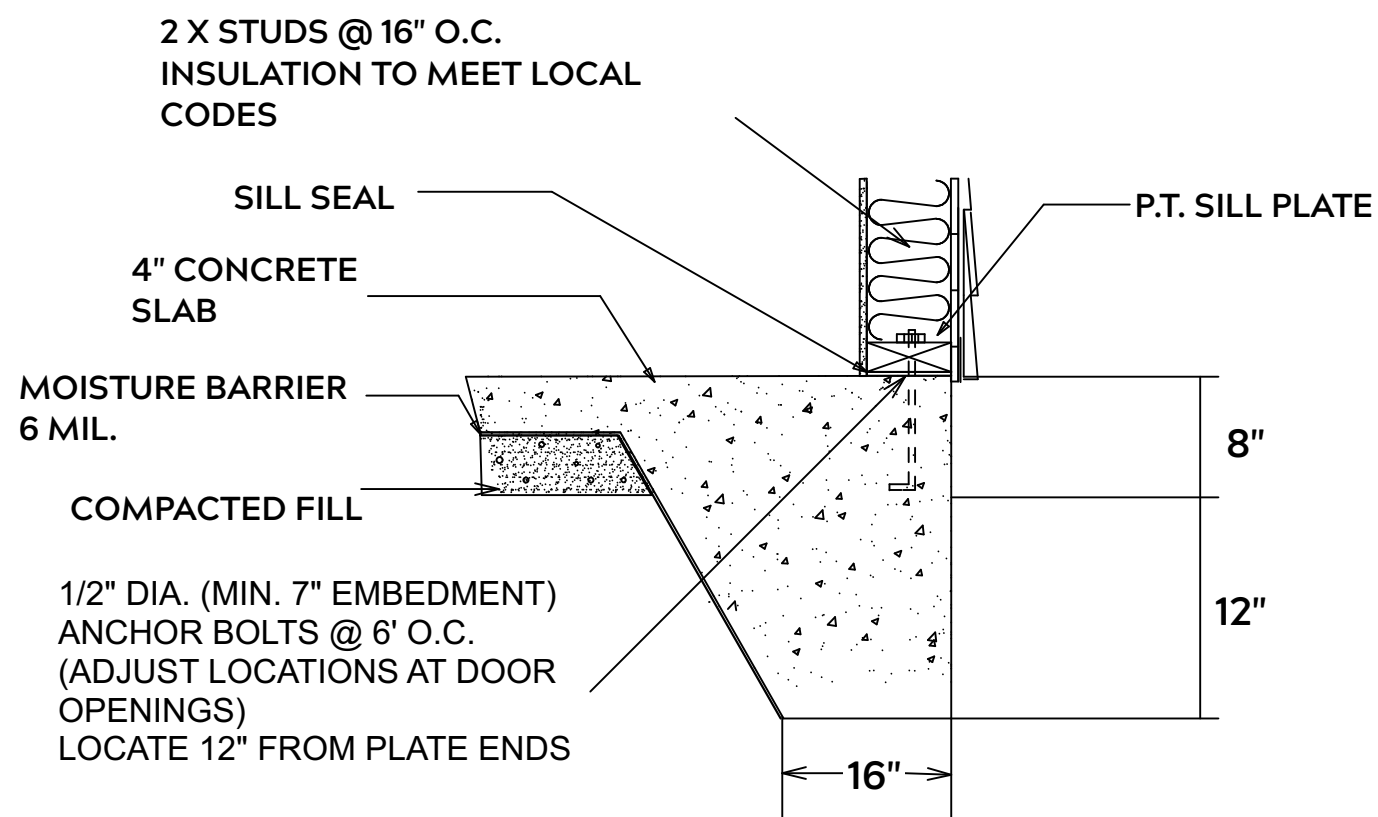

MONOLITHIC SLAB

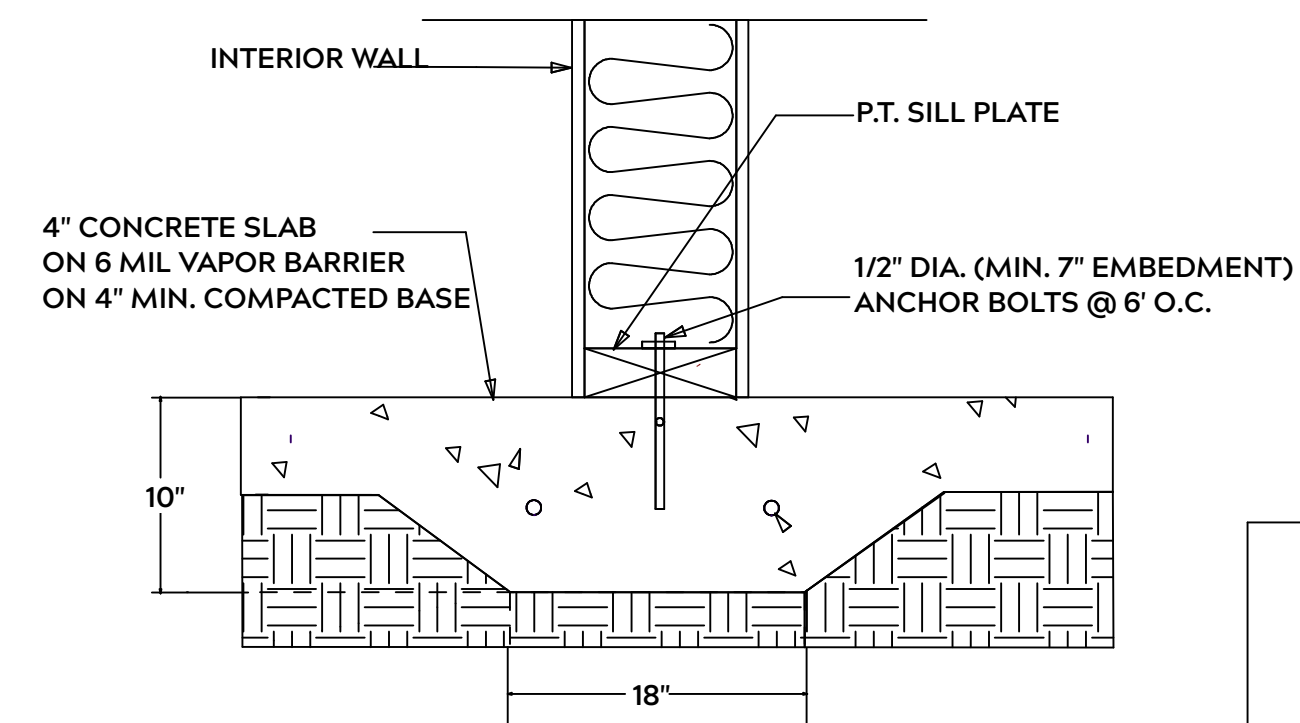

LUG FOOTING

FOUNDATION NOTES:

ALL FOOTINGS SHALL BEAR ON ORIGINAL UNDISTURBED SOIL
THE 28 DAY COMPRESSIVE STRENGTH OF ALL FOOTINGS IS 3000 PSI

PROVIDE WATER PROOFING AND PERIMTER DRAINS AS REQUIRED

FOOTING WIDTHS ARE BASED ON A LOAD BEARING SOIL CAPACITY OF 2000 PSI

PROVIDE 6 MIL POLY VAPOR BARRIER TO COVER GROUND IN CRAWL SPACE AND GROUND UNDER POURED CONCRETE

ALL ANCHOR BOLTS TO BE 1/2" X 12" LONG. ANCHOR BOLTS SHALL BE SPACED AT A MAXIMUM OF 6' ON CENTER AND NO MORE THEN 1' FROM EACH CORNER

GENERAL FRAMING NOTES:

ALL LUMBER IN CONTACT WITH CONCRETE OR MASONRY SHALLE BE PRESSURE TREATED

FRAMING LUMBER SHALL BE SYP #2 GRADE AND / OR SPRUCE PINE FIR #1 AND / OR KILN DRIED

WHERE PRE-ENGINEERED JOISTS AND TRUSSES ARE USED, MANUFACTURER SHALL PROVIDE DRAWINGS / SCHEMATICS, WHICH SHALL BEAR OF A N.C. ENGINEER

STUDS AND JOISTS SHALL NOT BE CUT TO INSTALL PLUMBING OR WIRING WITHOUT ADDING METAL OR WOOD SIDE PANELS TO STRENGTHEN MEMBER TO ITS ORIGINAL CAPACITY

NAIL MULTIPLE MEMBERS WITH 2 ROWS OF 16d NAILS STAGGERED 32" O.C. AND USE 3 X 16d NAILS 2" IN AT EACH END.


NAIL FLOOR JOISTS TO SILL PLATE WITH WITH 8d TOE NAILS

ALL EXPOSED FRAMING ON PORCHES OR DECKS SHALL BE PRESSURE TREATED

PROVIDE WATERPROOFING AND DRAINS AS REQUIRED


ALL FRAMING TO BE 16" O.C. WALL FRAMING DIMENSIONS ARE BASED ON 2X4 OR 2X6 EXTERIOR WALLS AND 2X4 INTERIOR WALLS. DOULBE / TRIPLE JACK STUDS AS NECESSARY UNDER HEADERS AS REQUIRED

LVL'S TO BE SIZED BY OTHERS (TRUSS MANUFACTURER)

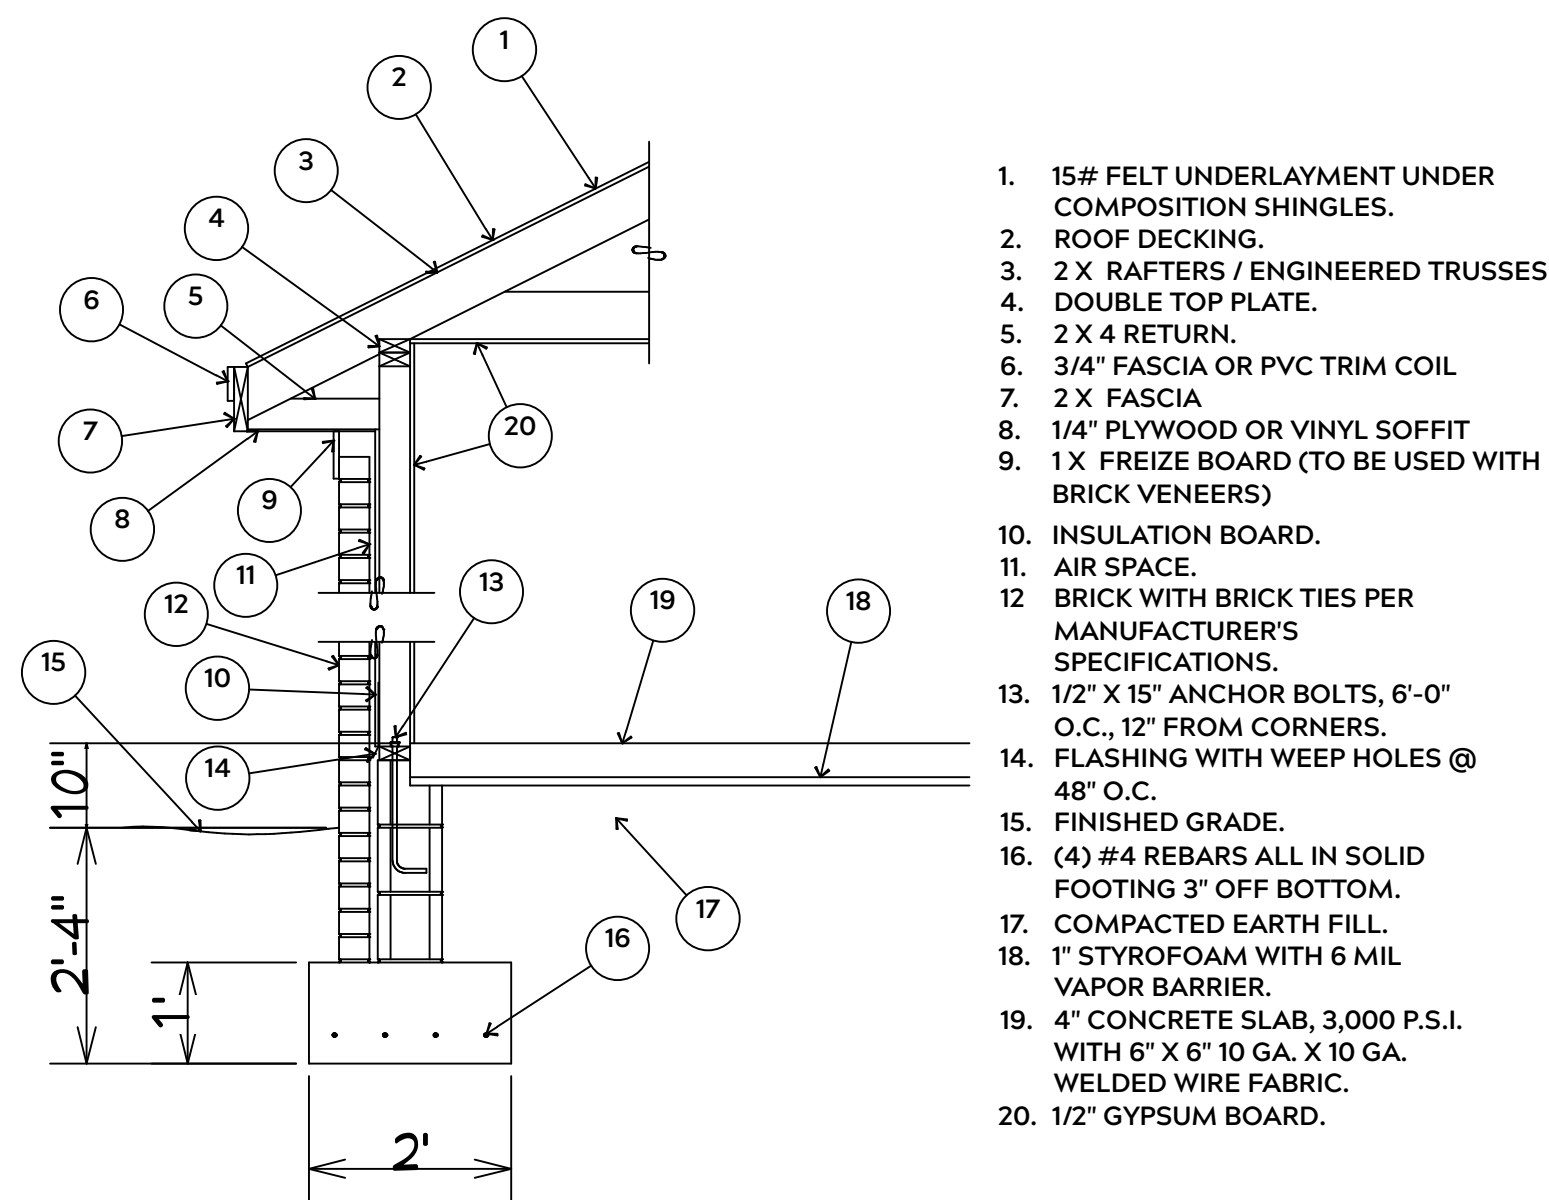


EXTERIOR WALL SECTION


1. 15# FELT UNDERLAYMENT UNDER COMPOSITION SHINGLES.
2. ROOF DECKING.
3. 2 X RAFTERS / ENGINEERED TRUSSES
4. DOUBLE TOP PLATE.
5. 2 X 4 RETURN.
6. 3/4" FASCIA OR PVC TRIM COIL
7. 2 X FASCIA
8. 1/4" PLYWOOD OR VINYL SOFFIT
9. 1 X FREIZE BOARD (TO BE USED WITH BRICK VENEERS)
10. INSULATION BOARD.
11. AIR SPACE.
12. BRICK WITH BRICK TIES PER MANUFACTURER'S SPECIFICATIONS.
13. 1/2" X 15" ANCHOR BOLTS, 6'-0" O.C., 12" FROM CORNERS.
14. FLASHING WITH WEEP HOLES @ 48" O.C.
15. FINISHED GRADE.
16. (4) #4 REBARs ALL IN SOLID FOOTING 3" OFF BOTTOM.
17. COMPACTED EARTH FILL.
18. 1" STYROFOAM WITH 6 MIL VAPOR BARRIER.
19. 4" CONCRETE SLAB, 3,000 P.S.I. WITH 6" X 6" 10 GA. X 10 GA. WELDED WIRE FABRIC.
20. 1/2" GYPSUM BOARD.

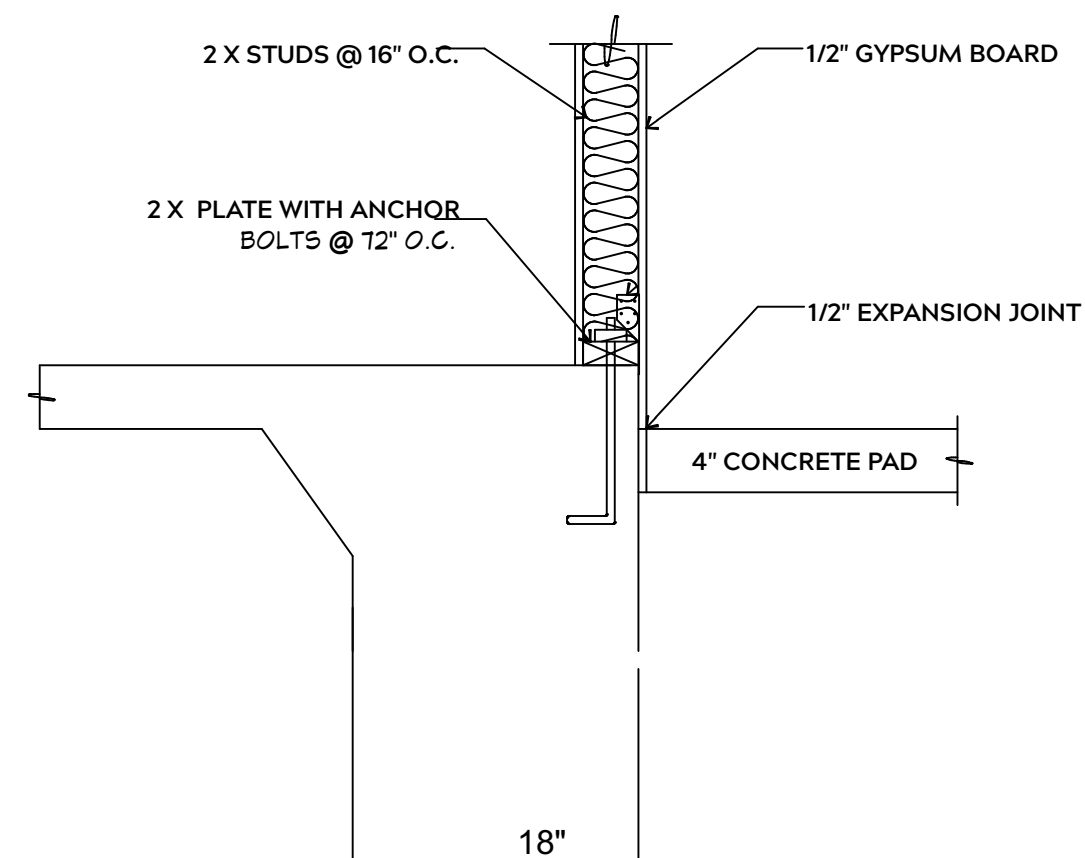


INTERIOR WALL @ GARAGE STEP DOWN

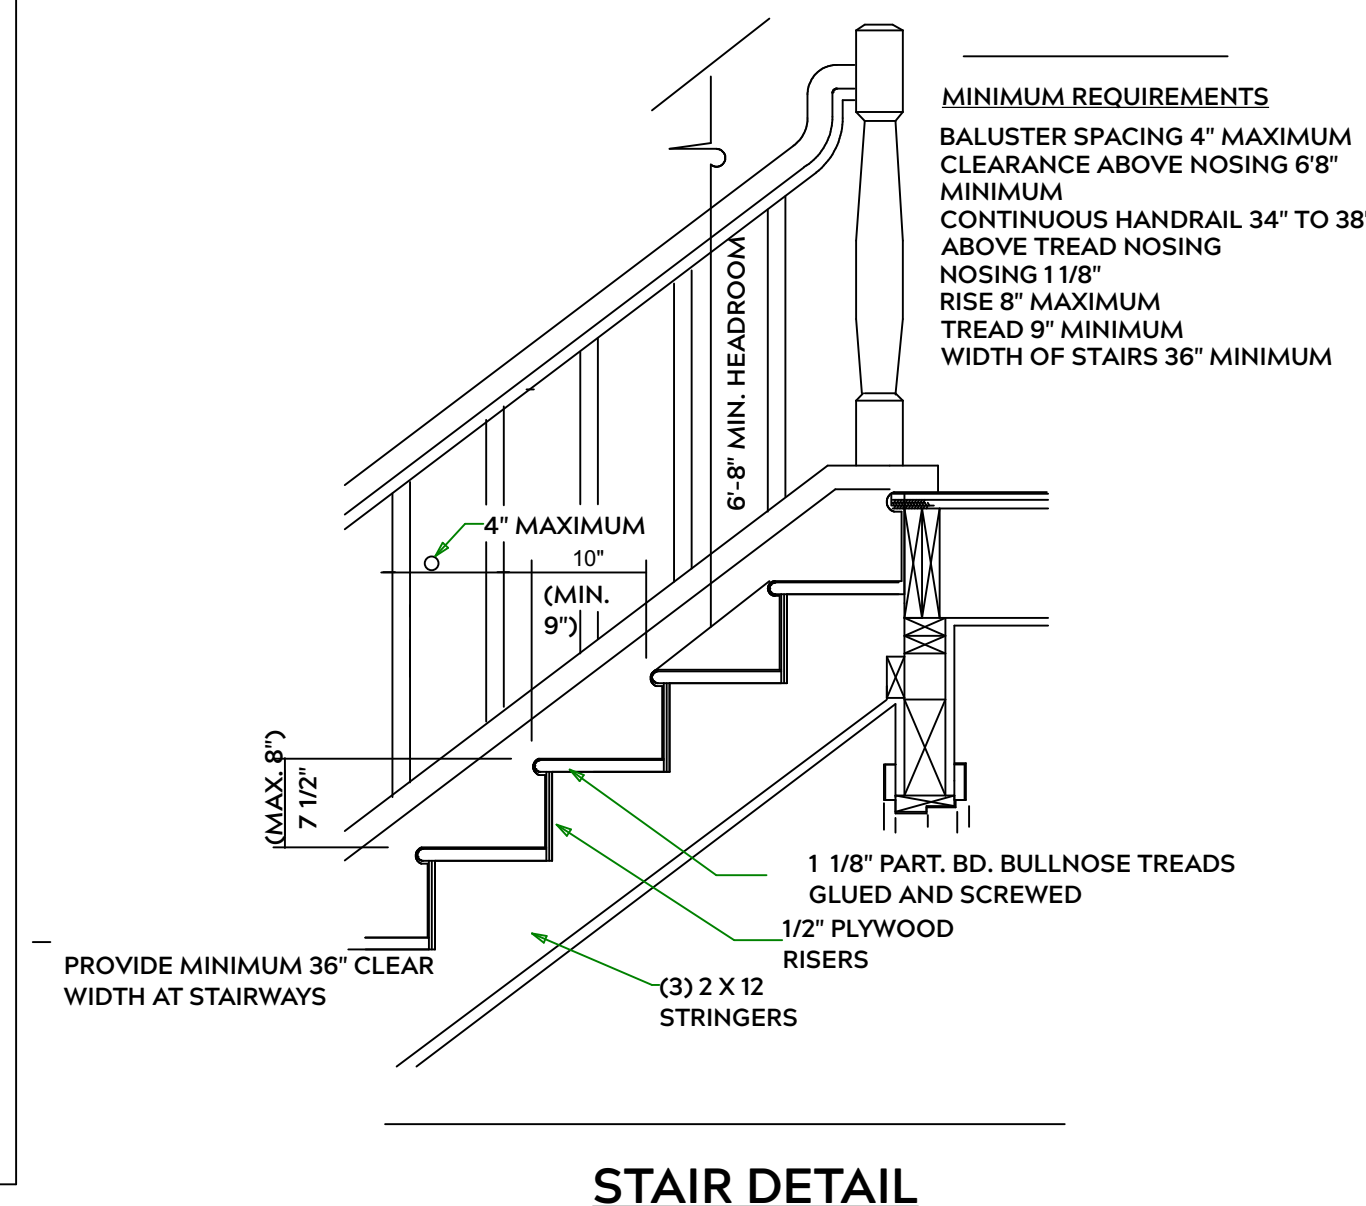

STAIR DETAIL

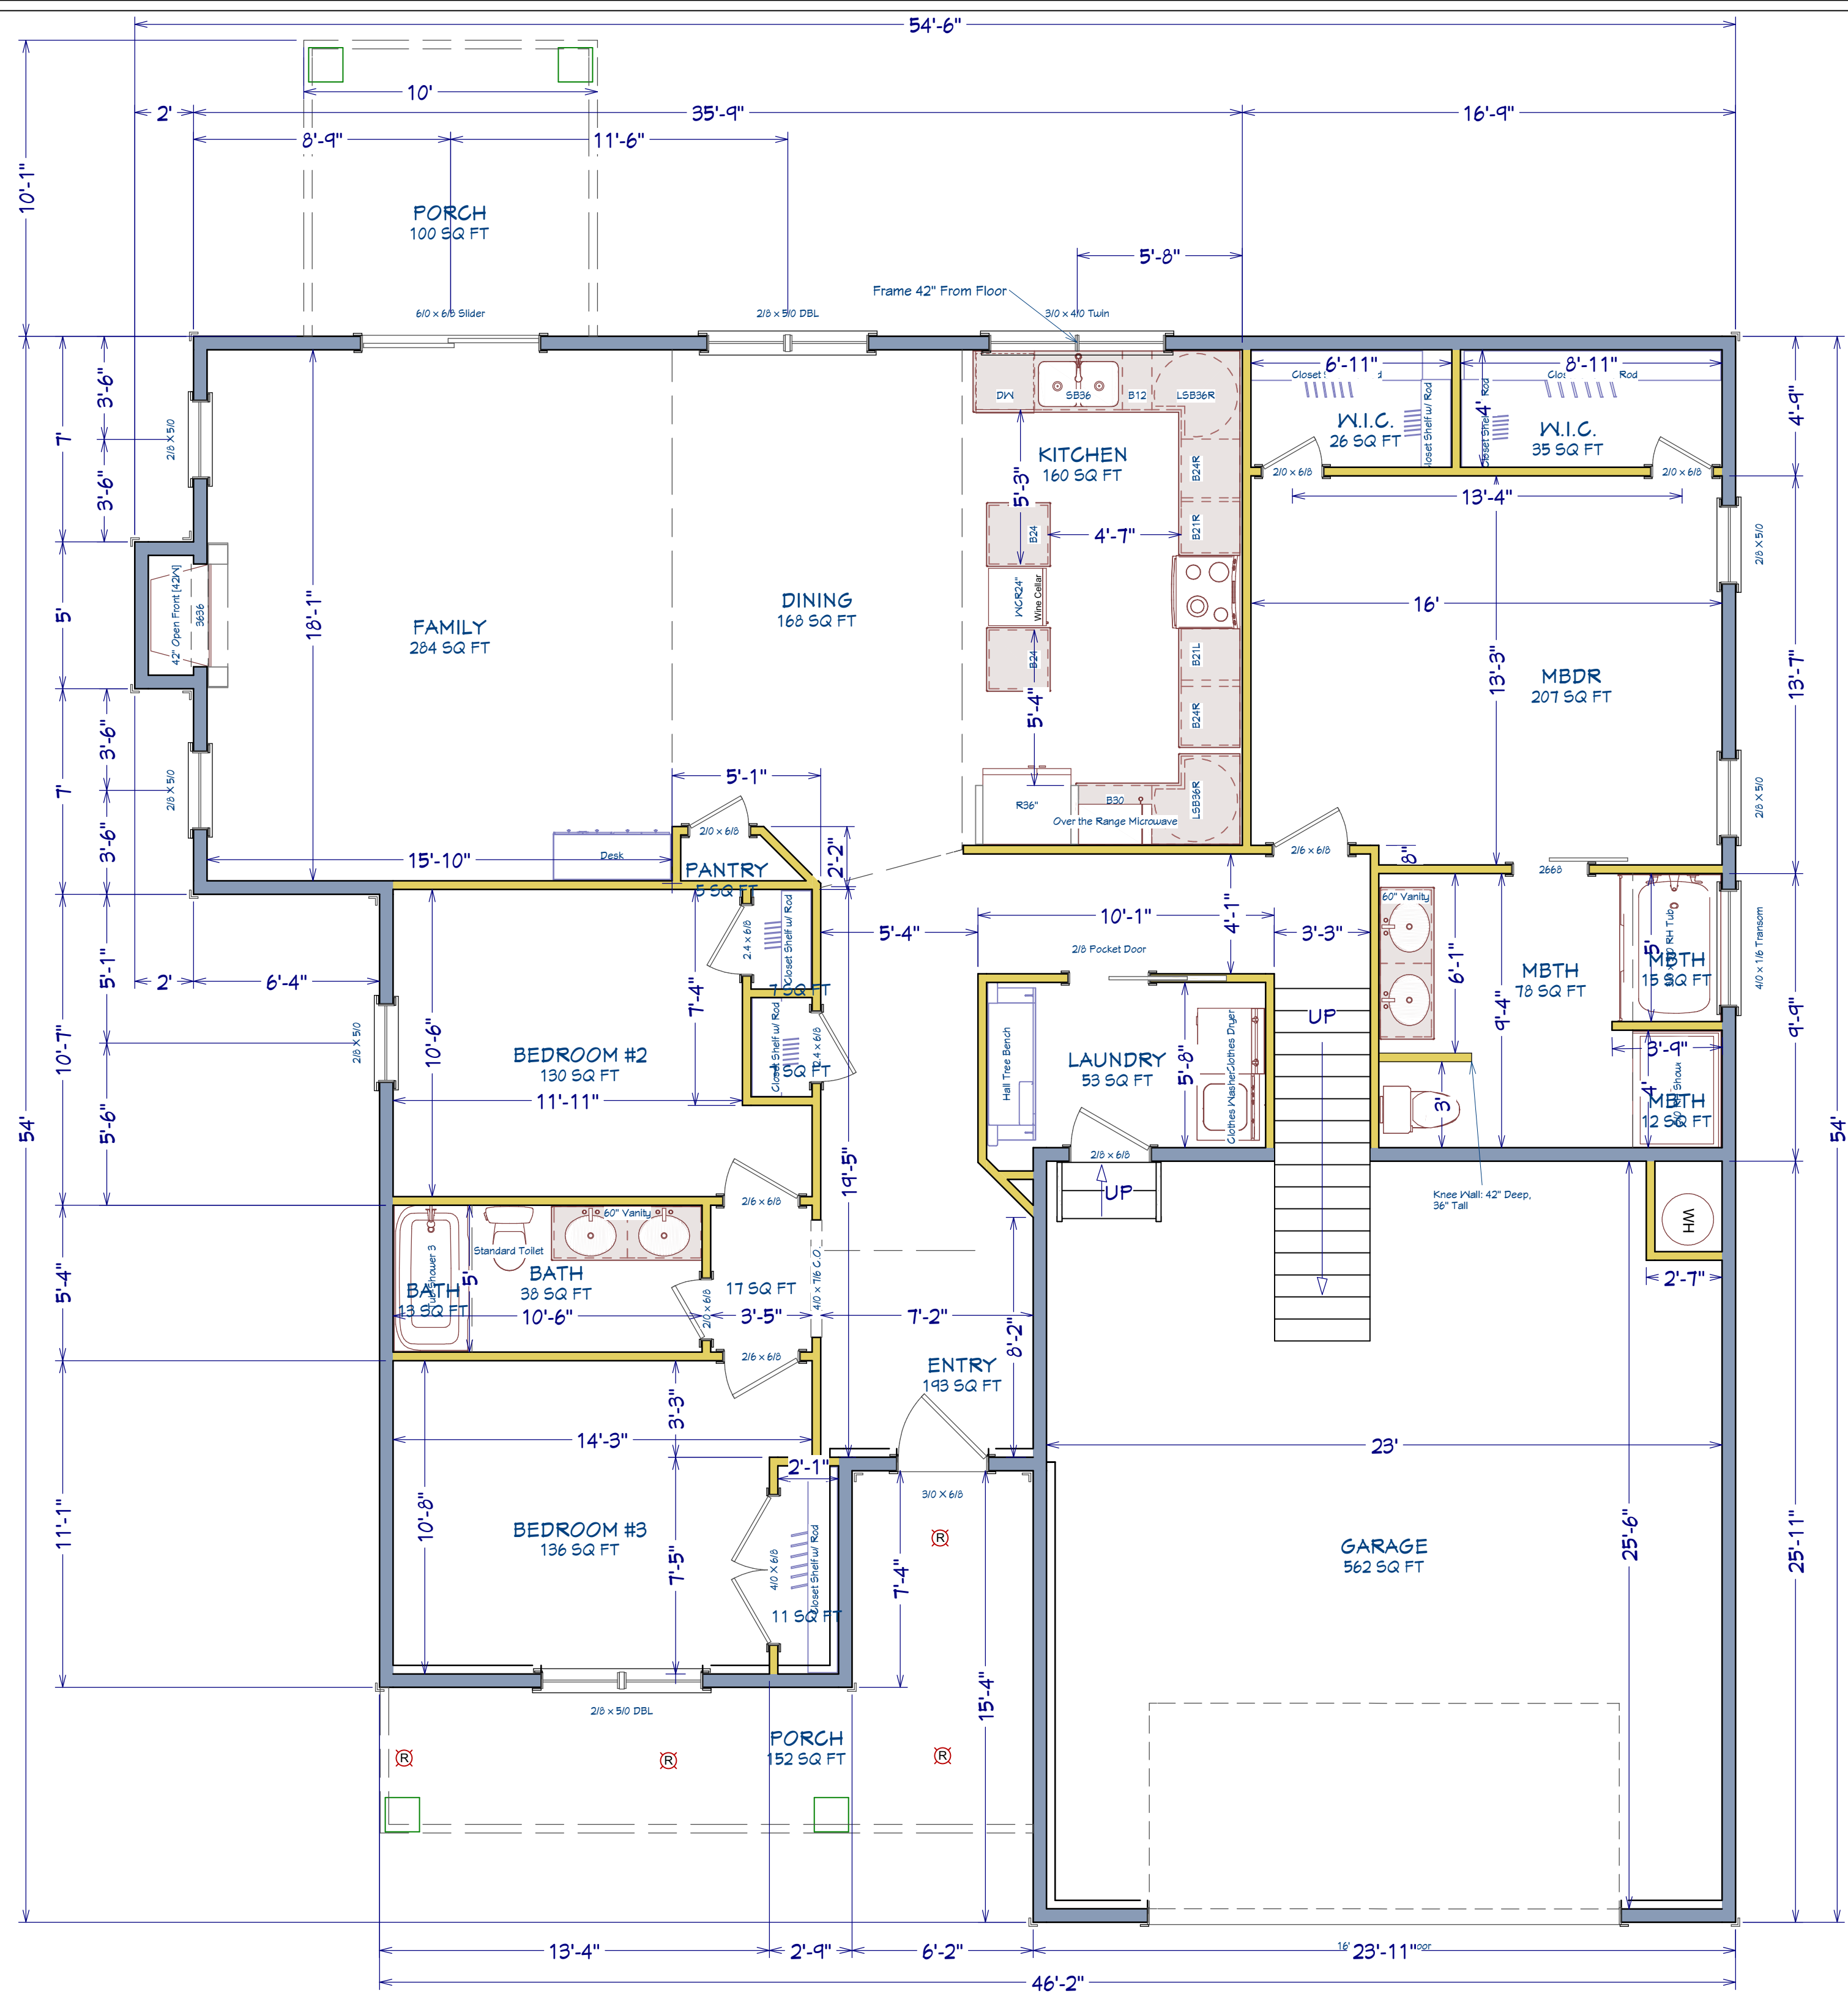

AREA SCHEDULE	
1ST FLOOR AREA	1,785 SF
2ND FLOOR AREA	646 SF
TOTAL HEATED AREA	2,431 SF
GARAGE	606 SF
FRONT PORCH	156 SF
REAR PORCH	100 SF
TOTAL AREA UNDER ROOF	3,243 SF

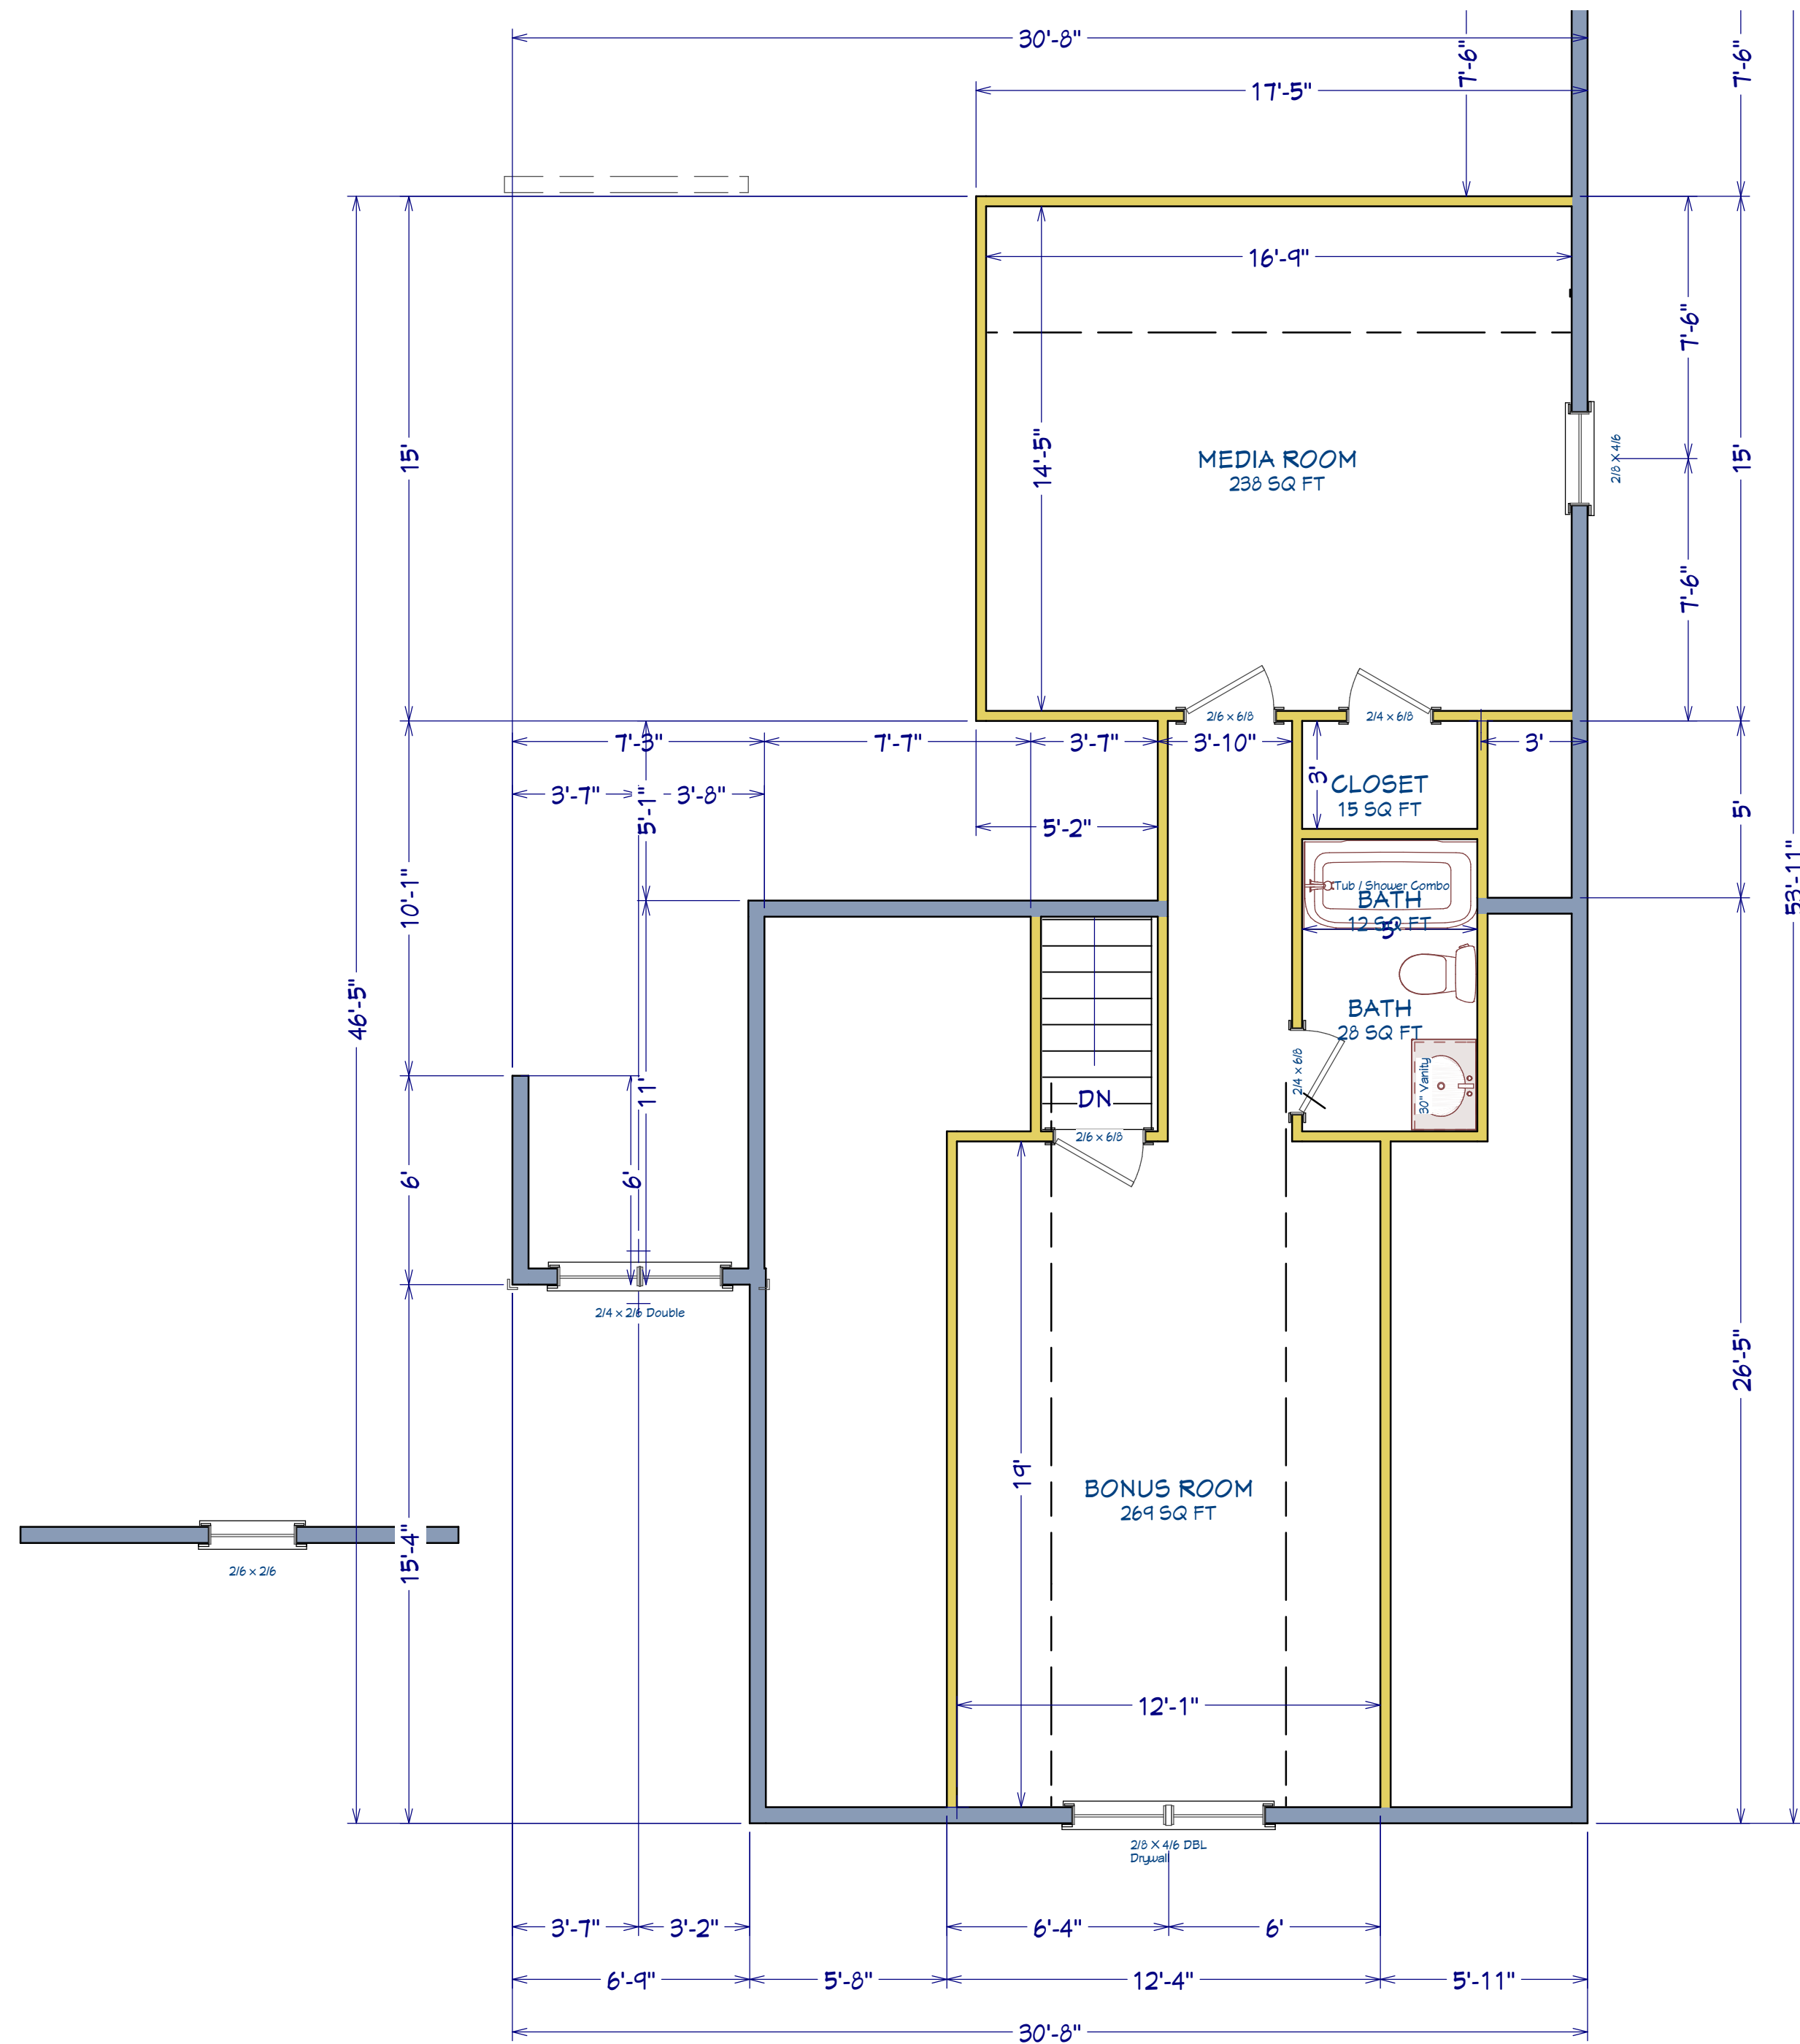

AREA SCHEDULE	
1ST FLOOR AREA	1,785 SF
2ND FLOOR AREA	646 SF
TOTAL HEATED AREA	2,431 SF
GARAGE	606 SF
FRONT PORCH	156 SF
REAR PORCH	100 SF
TOTAL AREA UNDER ROOF	3,293 SF

2nd Floor



ROOF & FLOOR TRUSSES & BEAMS


Reilly Road Industrial Park
Fayetteville, N.C. 28309
Phone: (910) 864-8787
Fax: (910) 864-4444

THIS IS A TRUSS PLACEMENT DIAGRAM ONLY.
These trusses are designed as individual building components to be incorporated into the building design at the specification of the building designer. The individual design sheets for each truss design identified on the drawing are the responsibility of the building designer. The building designer, as responsible for the structure and its components, shall be responsible for the design of the truss support structure including headers, beams, walls, and columns. The responsibility of the building designer for general guidance regarding trusses, consult ICC-ES E-1001 and E-1002 provided with the truss delivery package or online @ secondary.com

Bearing reactions less than or equal to 3000# are deemed to comply with the prescriptive Code requirements. The contractor shall refer to the attached Tables (derived from the prescriptive Code requirements) to determine the minimum foundation size and number of wood studs required to support reactions greater than 3000# but not greater than 1500#. A registered design professional shall be retained to design the support system for any reaction that exceeds those specified in the attached Tables. A registered design professional shall be retained to design the support system for all reactions that exceed 1500#.

Signature: _____

Neil Baggett

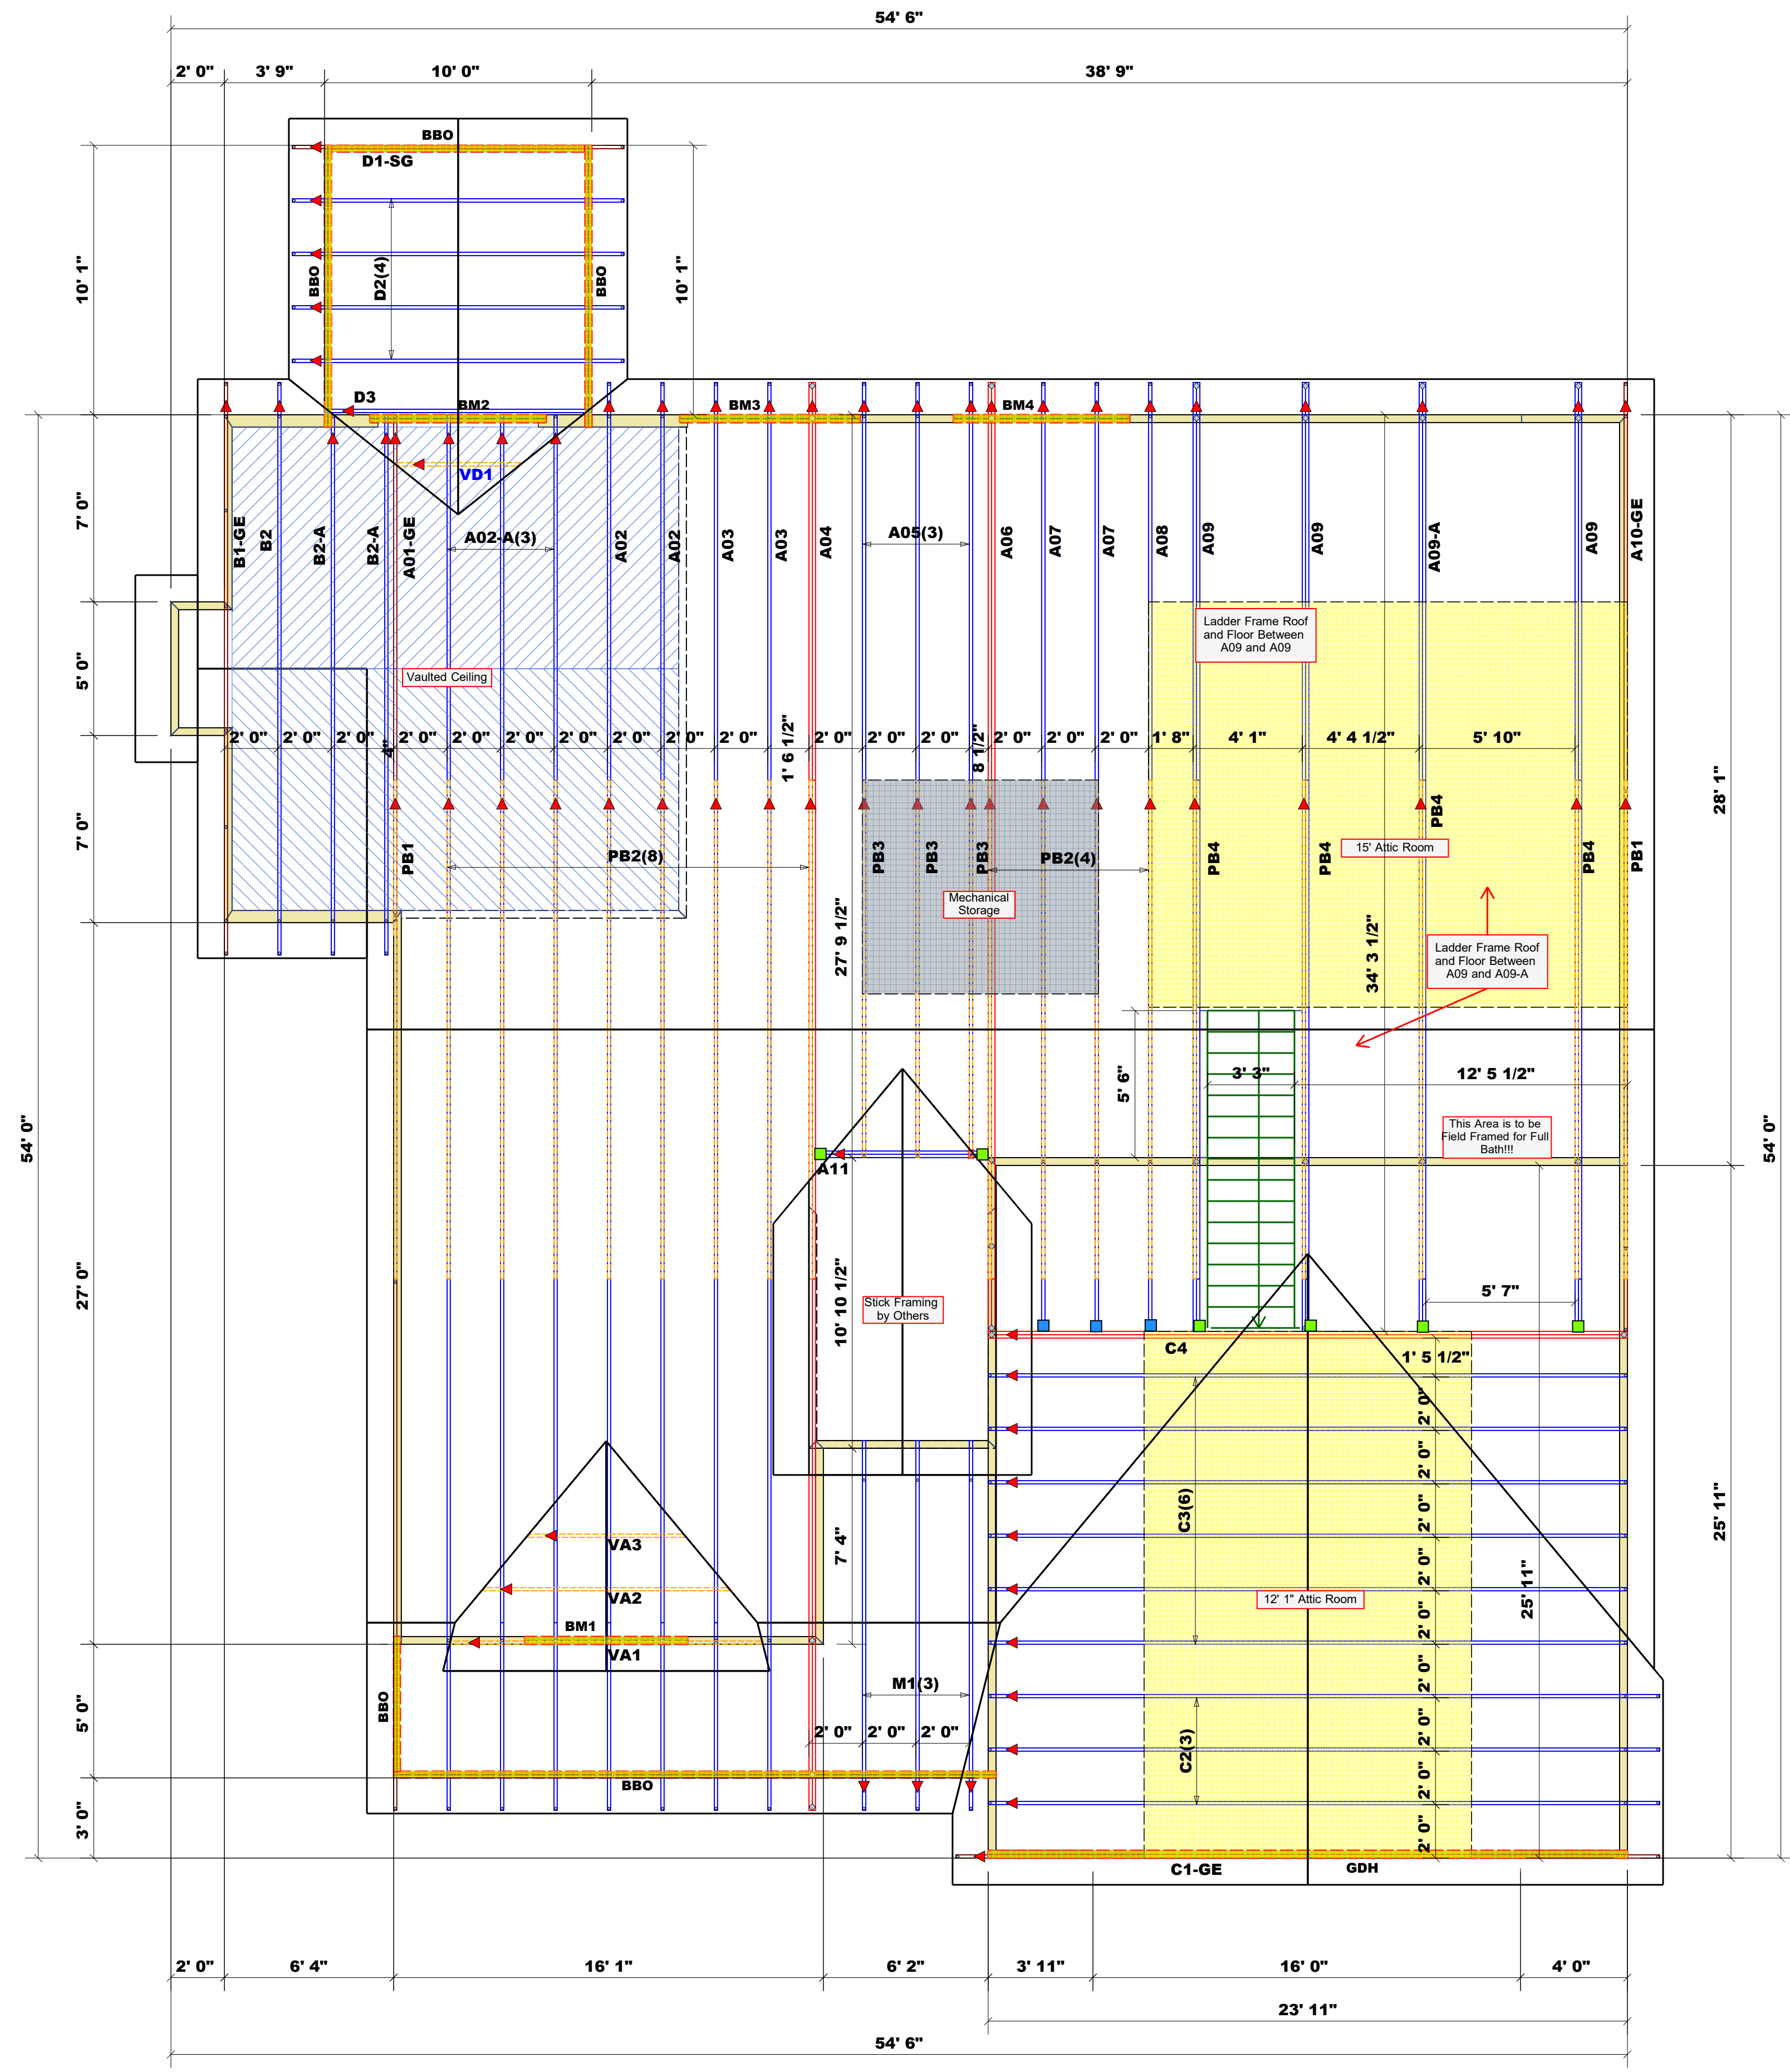

- Dimension Notes**
1. All exterior wall to wall dimensions are to face of stud unless noted otherwise
 2. All interior wall dimensions are to face of stud unless noted otherwise
 3. All exterior wall to truss dimensions are to face of stud unless noted otherwise

Hatch Legend

- Vaulted Ceiling
- Padded HVAC
- Drop Beam

Roof Area = 3863.44 sq.ft.
Ridge Line = 108.13 ft.
Hip Line = 0 ft.
Horiz. OH = 240.92 ft.
Raked OH = 290.56 ft.
Decking = 133 sheets

All Walls Shown Are Considered Load Bearing

▲ = Indicates Left End of Truss (Reference Engineered Truss Drawing)
Do Not Erect Trusses Backwards

1 Truss Placement Plan
Scale: 1/4"=1'

Products

PlotID	Length	Product	Plies	Net Qty
BM1	7' 0"	1-3/4"x 9-1/4" LVL Kerto-S	2	2
BM2	7' 0"	1-3/4"x 9-1/4" LVL Kerto-S	2	2
BM3	7' 0"	1-3/4"x 9-1/4" LVL Kerto-S	2	2
BM4	7' 0"	1-3/4"x 9-1/4" LVL Kerto-S	2	2
GDH	24' 0"	1-3/4"x 11-7/8" LVL Kerto-S	2	2

Connector Information

Sym	Product	Manuf	Qty	Supported Member	Header	Truss
■	HUS26	USP	3	Varies	16d/3-1/2"	16d/3-1/2"
■	THD26-2	USP	6	Varies	16d/3-1/2"	10d/3"

COUNTY	Harnett
ADDRESS	Lot 35 Summerlin
MODEL	Roof
DATE REV.	1/21/2021
DRAWN BY	Neil Baggett
SALESMAN	Neil Baggett

BUILDER	Precision Custom Homes
JOB NAME	Lot 35 Summerlin
PLAN	Mises 1.0
SEAL DATE	1/12/2021
QUOTE #	Quote #
JOB #	J1220-5661

LOAD CHART FOR JACK STUDS
BASED ON TABLES 502.2.1 & 502

END REACTION (KIP)	REQ'D STUDS FOR 10' SPACING	REQ'D STUDS FOR 12" SPACING	REQ'D STUDS FOR 16" SPACING	END REACTION (KIP)	REQ'D STUDS FOR 10' SPACING	REQ'D STUDS FOR 12" SPACING	REQ'D STUDS FOR 16" SPACING
1700	1	2550	1	3400	1	3400	1
3400	2	5100	2	6800	2	6800	2
5100	3	7650	3	10200	3	10200	3
6800	4	10200	4	13600	4	13600	4
8500	5	12750	5	17000	5	17000	5
10200	6	15300	6				
11900	7						
13600	8						
15300	9						