



# ROOF & FLOOR TRUSSES & BEAMS


Reilly Road Industrial Park  
Fayetteville, N.C. 28309  
Phone: (910) 864-8787  
Fax: (910) 864-4444

**THIS IS A TRUSS PLACEMENT DIAGRAM ONLY.**  
These trusses are designed as individual building components to be incorporated into the building design at the specification of the building designer. The individual design sheets for each truss design identified on the drawing are the responsibility of the building designer. The building designer, as a responsible professional, shall ensure that all necessary and appropriate structural analysis and design is performed for the roof and floor system and for the overall structure. The design of the truss support structure including headers, beams, walls, and columns is the responsibility of the building designer. For general guidance regarding trusses, consult ICC-ES ECR-1001 and ICC-ES ECR-1002 provided with the truss delivery package or online @ [www.comtech.com](http://www.comtech.com)

Bearing reactions less than or equal to 3000# are deemed to comply with the prescriptive Code requirements. The contractor shall refer to the attached Tables (derived from the prescriptive Code requirements) to determine the minimum foundation size and number of wood studs required to support reactions greater than 3000# but not greater than 1500#. A registered design professional shall be retained to design the support system for any reaction that exceeds those specified in the attached Tables. A registered design professional shall be retained to design the support system for all reactions that exceed 1500#.

Signature: \_\_\_\_\_

Neil Baggett

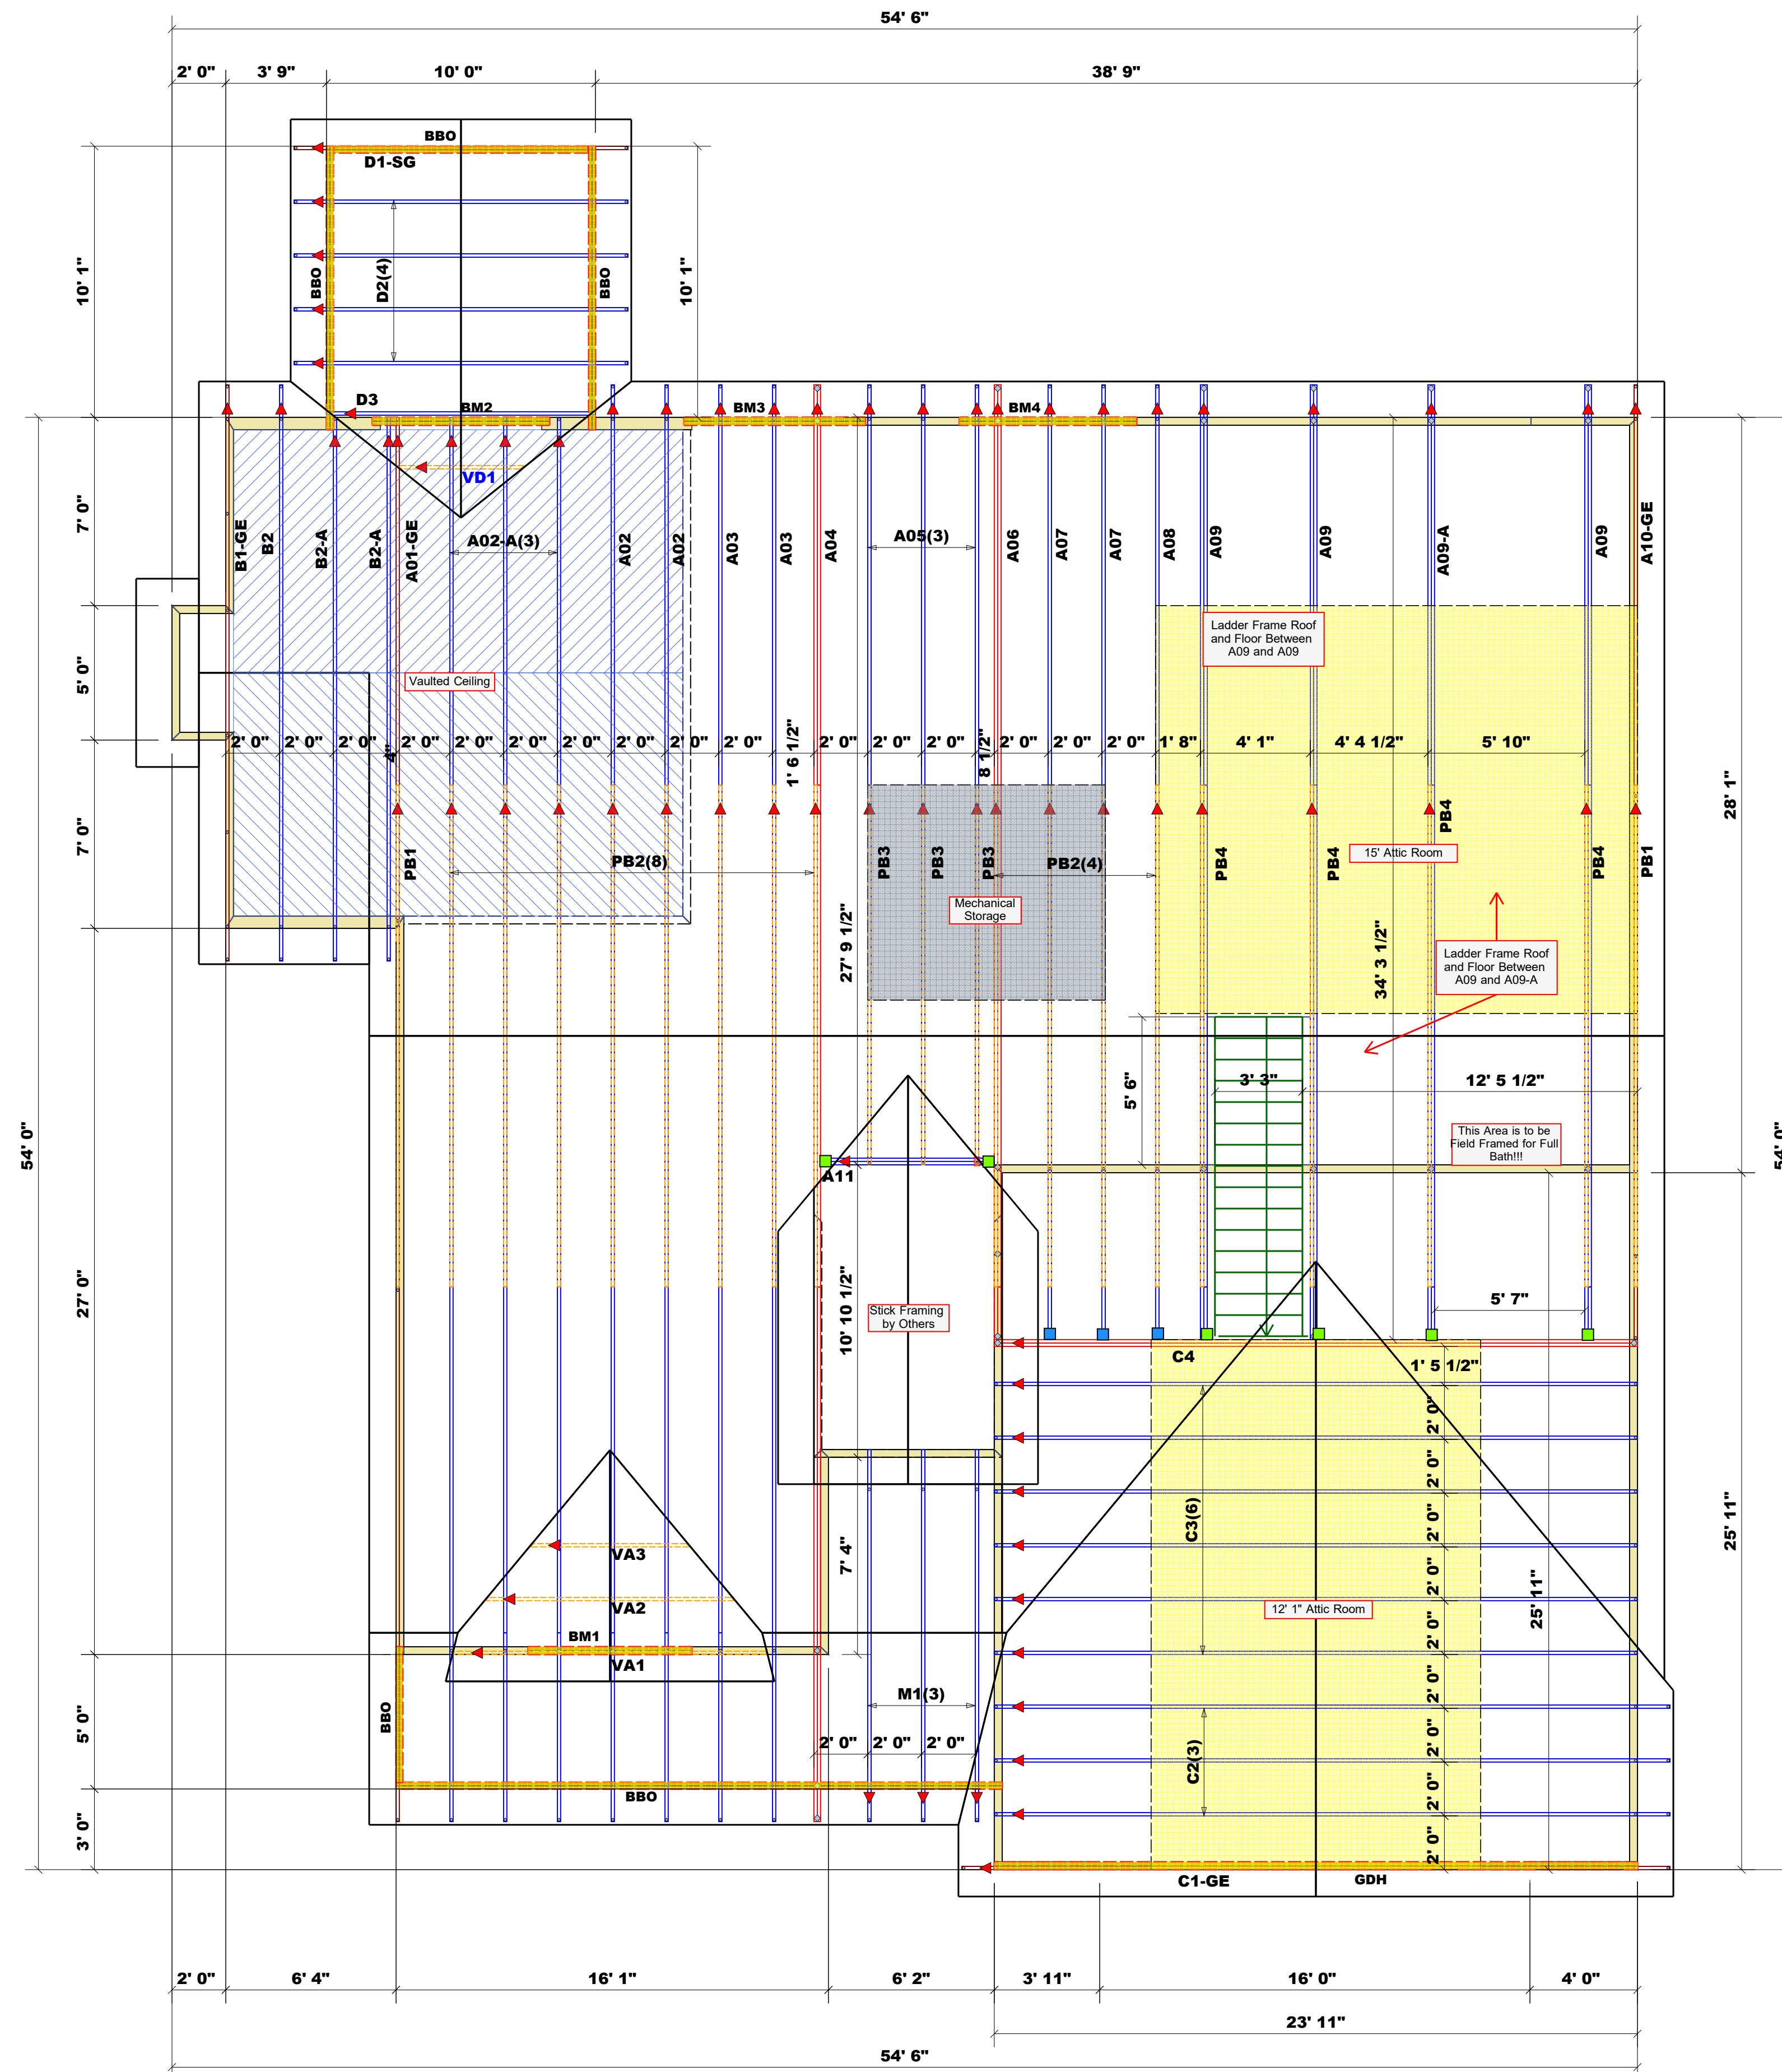

- Dimension Notes**
1. All exterior wall to wall dimensions are to face of stud unless noted otherwise
  2. All interior wall dimensions are to face of stud unless noted otherwise
  3. All exterior wall to truss dimensions are to face of stud unless noted otherwise

**Hatch Legend**

- Vaulted Ceiling
- Padded HVAC
- Drop Beam

Roof Area = 3863.44 sq.ft.  
Ridge Line = 108.13 ft.  
Hip Line = 0 ft.  
Horiz. OH = 240.92 ft.  
Raked OH = 290.56 ft.  
Decking = 133 sheets

All Walls Shown Are Considered Load Bearing

▲ = Indicates Left End of Truss (Reference Engineered Truss Drawing)  
Do Not Erect Trusses Backwards

1 Truss Placement Plan  
Scale: 1/4"=1'

**Products**

PlotID	Length	Product	Plies	Net Qty
BM1	7' 0"	1-3/4"x 9-1/4" LVL Kerto-S	2	2
BM2	7' 0"	1-3/4"x 9-1/4" LVL Kerto-S	2	2
BM3	7' 0"	1-3/4"x 9-1/4" LVL Kerto-S	2	2
BM4	7' 0"	1-3/4"x 9-1/4" LVL Kerto-S	2	2
GDH	24' 0"	1-3/4"x 11-7/8" LVL Kerto-S	2	2

**Connector Information**

Sym	Product	Manuf	Qty	Supported Member	Header	Truss
■	HUS26	USP	3	Varies	16d/3-1/2"	16d/3-1/2"
■	THD26-2	USP	6	Varies	16d/3-1/2"	10d/3"

COUNTY	Hamnett
ADDRESS	Lot 35 Summerlin
MODEL	Roof
DATE REV.	1/21/2021
DRAWN BY	Neil Baggett
SALESMAN	Neil Baggett

BUILDER	Precision Custom Homes
JOB NAME	Lot 35 Summerlin
PLAN	Mises 1.0
SEAL DATE	1/12/2021
QUOTE #	Quote #
JOB #	J1220-5661

**LOAD CHART FOR JACK STUDS**  
BASED ON TABLES 502.2.1 & 502

END REACTION (KIP)	REQ'D STUDS FOR JACK STUDS (KIP)	REQ'D STUDS FOR HEADER/BEAM (KIP)	END REACTION (KIP)	REQ'D STUDS FOR JACK STUDS (KIP)	REQ'D STUDS FOR HEADER/BEAM (KIP)
1700	1	2550	1	3400	1
3400	2	5100	2	6800	2
5100	3	7650	3	10200	3
6800	4	10200	4	13600	4
8500	5	12750	5	17000	5
10200	6	15300	6		
11900	7				
13600	8				
15300	9				