.

Harnett County Department of Public Health


Improvement Permit

PROPERTY LOCATION: 161 Mill Bend Dr. (Rawls Ch. Rd SR 141				
ISSUED TO: Dan Ryan Builders SUBDIVISION Olde Mill Village LOT # 62				
NEW REPAIR EXPANSION Site Improvements required prior to Construction Authorization Issuance: Type of Structure: 51X37 (3bed/2.5ba)w/garage				
Proposed Wastewater System Type: 25% Reduction Svs.				
Projected Daily Flow: 360 GPD				
Number of bedrooms: 3 Number of Occupants: 6max				
Basement Tes: No ———————————————————————————————————				
Pump Required: No				
Type of reality supply.				
Permit conditions: to expiration				
Authorized State Agent:: Date: 62/11/2021 SEE ATTACHED SITE SKETCH				
The issuance of this permit by the Health Department in no way guarantees the issuance of other permits. The permit holder is responsible for checking with appropriate governing bodies in meeting their requirements. This site is subject to revocation if the site plan, plat, or the intended use changes. The Improvement Permit shall not be affected by a change in ownership of the site. This permit is subject to compliance with the provisions of the Laws and Rules for Sewage Treatment and Disposal and to conditions of this permit.				
Construction Authorization				
(Required for Building Permit)				
The construction and installation requirements of Rules .1950, .1952, .1954, .1955, .1956, .1957, .1958, and .1959 are incorporated by references into this permit and shall be met. Systems shall be installed in accordance with the attached system layout.				
ISSUED TO: Dan Ryan Builders PROPERTY LOCATION: 161 Mill Bend Dr. (Rawls Ch. Rd SR.1 SUBDIVISION Olde Mill Village LOT # 62				
Facility Type: 51X37 (3bed/2.5ba)w/gar. 🗵 New 🔲 Expansion 🔲 Repair				
Basement? Yes No Basement Fixtures? Yes No				
Type of Wastewater System** 25% NEOGCHOUT 8787EM (Initial) Wastewater Flow: 360 GPD				
(See note below, if applicable)				
25% 1203CTDN 513. (Repair)				
Installation Requirements/Conditions_ Number of trenches4				
Septic Tank Size 1006 gallons Exact length of each trench 75 feet Trench Spacing: 9 Feet on Center				
Pump Tank Size 1000 gallons Trenches shall be installed on contour at a Soil Cover: 6 inches				
Maximum Trench Depth of: (Sa inches (Maximum soil cover shall not exceed				
(Trench bottoms shall be level to +/-1/4" 36" above the trench bottom)				
in all directions)				
Pump Requirements: ft. TDH vs GPM inches below pipe				
Aggregate Depth: inches above pipe Conditions: PUMP TO MESTING DIGOT: [MOPOSAL BY ADAMS SEL				
Conditions: PUMP TO MESTUM DIBOX; PROPOSAL BY ADAMS 86,1				
WATER LINES (INCLUDING IRRIGATION) MUST BE 10FT. FROM ANY PART OF SEPTIC SYSTEM OR REPAIR AREA. NO UTILITIES ALLOWED IN INITIAL OR REPAIR DRAIN FIELD AREA.				
** applicable: [understand the system type specified is different from the type specified on the application. I accept the specifications of this permit.				
Owner/Legal Representative Signature: Date:				
This Construction Authorization is subject to revocation if the site plan, plat, or the intended use changes. The Construction Authorization shall not be transferred when there is a change in ownership of the site. This				
Construction Authorization is subject to compliance with the provisions of the Laws and Rules for Sewage Treatment and Disposal and to the conditions of this permit.				
6211				
Authorized State Agent: Date: Date:				
Andrew Construction Authorization Expiration Date:				

Harnett County Department of Public Health Site Sketch


Property Location: 161 Mill	Bend Dr. (Rawls Ch. Rd SR 1415)		
Issued To: Dan Ryan Builder			Lot # <u>62</u>
Authorized State Agent:	c minimum.	Date: _	02/11/2021
	AMOREN CORRIN		,

* PROPOSAL BY ADAMS SOIL CONSULTING

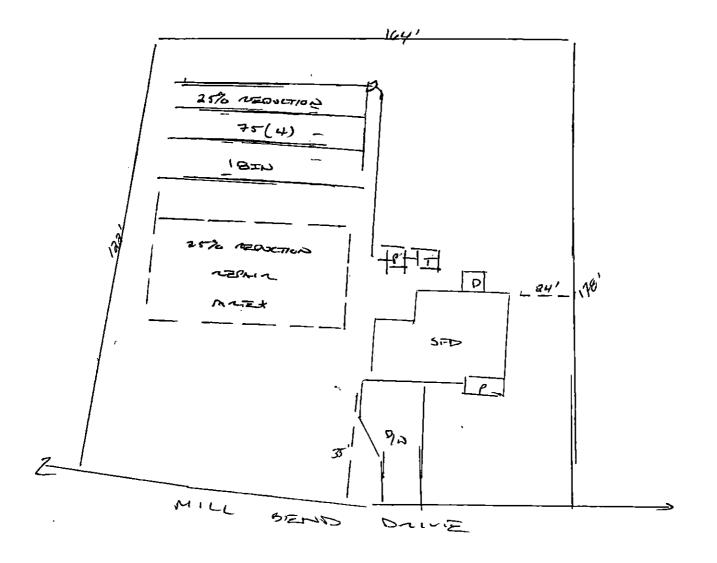


This drawing is for illustrative purposes only. System installation must meet all pertinent laws, rules, and regulations.

Olde Mill Village 3-Bedroom Layout Lot #62

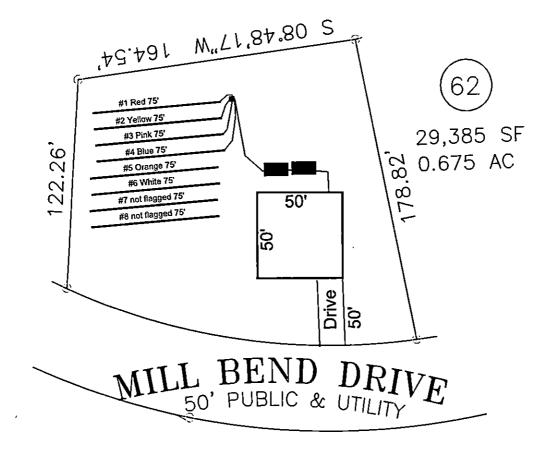

System: Pump to D-Box Lines: 1-4, (300') 0.3 LTAR 18" Trench Bottom Accepted Status System Repair: Pump to D-Box Lines: 5-8, (300') 0.3 LTAR 18" Trench Bottom Accepted Status System



Adams Soil Consulting 919-414-6761 Job #699