



J&R Homes
 2844 Norrington Road
 3-Bedroom Septic Proposal
 Harnett County PIN# 0537-20-1839

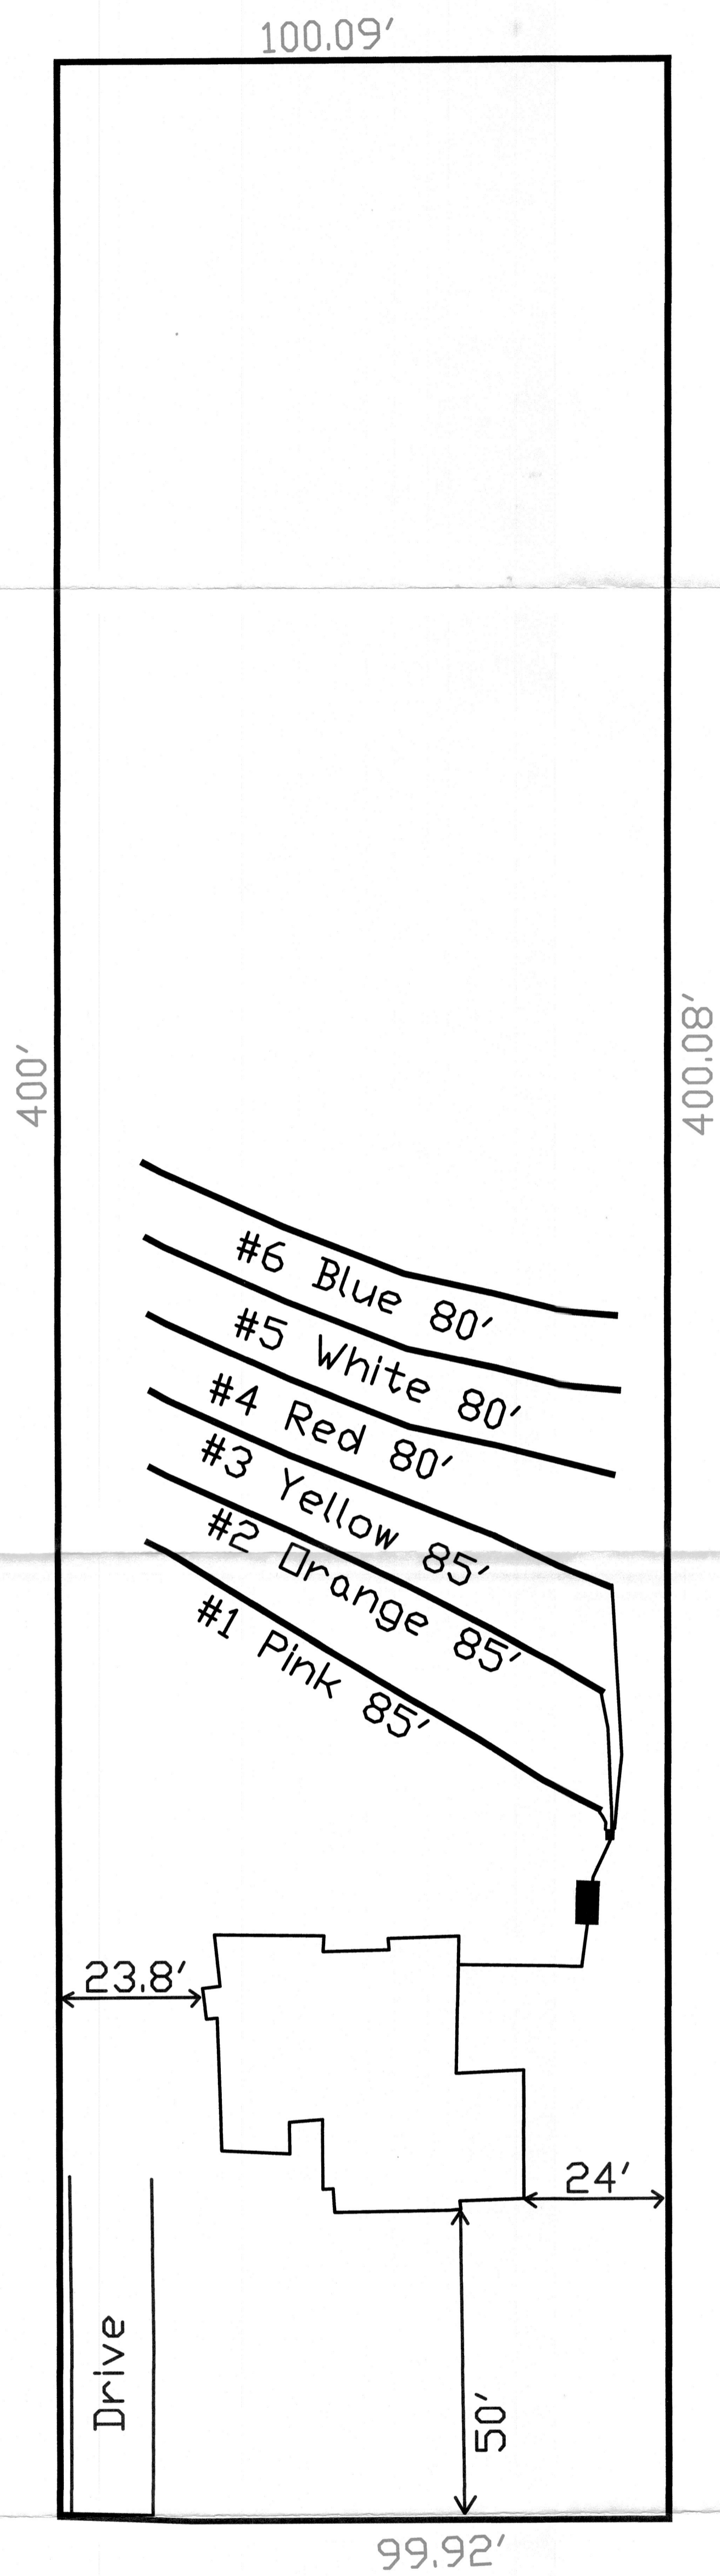

System: Gravity to D-Box
 Lines: 1-3 (255')
 0.35 LTAR
 18" Trench Bottom
 Accepted Status System
 Repair: Gravity to D-Box
 Lines: 4-6 (240')
 0.375 LTAR
 18" Max Trench Bottom
 Accepted Status System

Norrington Road

GRAPHIC SCALE
 1" = 50'

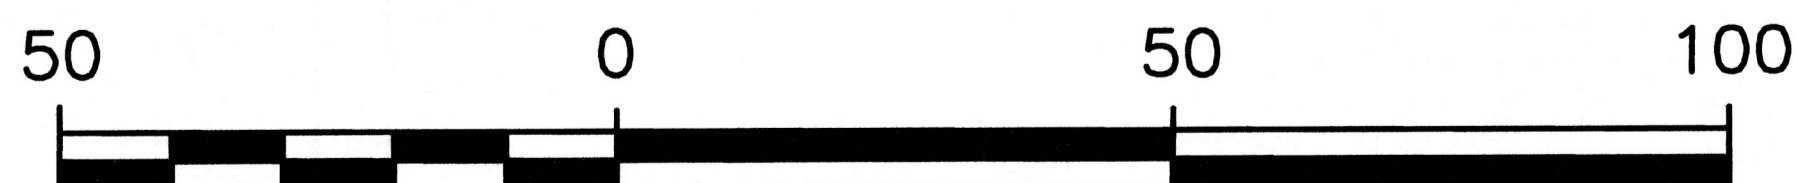

Adams
 Soil Consulting
 919-414-6761
 Job #1091