REVISION LOG

REVISION:001

DATE: 10/08/2020

- ADD DELUXE KITCHEN OPTION CHANGE FOYER & 4 SEASONS ROOM TO ARCHED OPENING
- ADD NICHE TO SHOWER IN OWNER'S BATH.
 SHIFT WINDOW IN GARAGE UNDER STAIR RAKE FOR CLEARANCE IN BUNGALOW ELEVATION.
 CHANGE WANSOCT TURNING CORRER AT PORCH TO OPTIONAL.
 REMOVED TOWEL RING IN BATH 3



McKee

Homes, Inc.

LOT 1018 - ANDERSON CREEK CARRIAGE GLEN 01.25.2021

Palazzo 2020 - LH

'CLASSIC'

	ARCHITECTURAL DRAWINGS						
Sheet No.	Sheet Description	Sheet No.	Sheet Description				
0.0	Cover Sheet						
2.1	First Floor Plan						
2.4	Sitting Room Plan & Elevations						
2.5	Screen Patio Plan & Elevations						
3.1	Front & Rear Elevations (Slab)						
3.2	Side Elevations (Slab)						
3.3	Roof Plan						
4.0	Building Sections (Slab)						
5.1	First Floor Electrical						
8.1	First Floor Flooring Plan						

DESIGN CRITERIA:

THIS PLAN IS TO BE BUILT IN CONFORMANCE WITH THE 2018 NORTH CAROLINA STATE BUILDING CODE: RESIDENTIAL CODE

DIMENSIONS SHALL GOVERN OVER SCALE, AND CODE SHALL GOVERN OVER DIMENSIONS.

SQUAR	FOOT/	4GE
	ELEVAT	10N 'A'
	UNHEATED	HEATED
FIRST FLOOR	0	1716
COVERED PORCH	131	0
PATIO	321	0
FRONT PORCH	71	0
2 CAR GARAGE	486	0
SUBTOTALS	1009	1 <i>7</i> 16
TOTAL UNDER ROOF	27	25
0	PTIONS	
	UNHEATED S.F.	HEATED S.F.
OPT SITTING ROOM	0	+131
OPT SCREEN PATIO	131	0







	DRAWN	BY:			
OTS	ORIGINA	L REL	EASE DAT	E:	
П.	CURREN	IT REL	EASE DAT	E:	
11x17 SHEETS ARE 1/2 SCALE PLOTS	DEV #	DATE	/ DESCR	IPTION	
/2	\	DAIL	/ DEJUN	II IION	
RE 1	<u> </u>	-			
Z A	$ \Delta $				
Ë	Δ	H			
17 8		<u> </u>			
11×					
75					
155				11	


Palazzo 2020 - LH Cover Sheet 'Classic'

0.0a

General Floor Plan Notes


General Floor Plan Notes shall apply unless noted otherwise on plan.

- Wall Heights: Typically 9'-1 1/2" at first floor 8'-1 1/2' at second floor, and 8'-1 1/2' at attics U.N.O. All walls are constructed using a double top plate. Splices at Double Top Plate do not need to occur at Vertical Studs but must be at least 24' apart from Joint in other Top Plate layer. Special wall heights are noted on plans where they occur.
- Wall Thickness is typically 3 1/2". 2x6 frame shall be used at walls that back up to plumbing fixtures.
 Walls greater than 10' high shall be framed with 2x6 framing or greater and will be noted as a special condition where it occurs on plan.
- Typical header height shall be 8'-0" AFF at First Floor, and 7'-2" AFF at Second Floor U.N.O.
- Jacks: Openings up to 3'-4" wide shall have (1) 2x4
 jack stud SPF on each side. Openings greater than
 3'-4" wide shall have (2) 2x4 jack studs SPF on each
- 5. Soffits, Coffered Ceilings, Trey Ceilings and other significant ceiling plan elements are shown on the floor plans and are denoted as single dashed lines. Unless specifically call out as included, Kitchens do not include soffits over wall cabinetry.
- Door & Window Frames, where occurring near corners, shall be a minimum of 4 1/2" from corner. Except for walk-in closets with doors near a corner, doors at closets shall be centered on closet.
- Windows: Shall have at least (1) window in each sleeping room, that meets egress. Shall be provided with tempered glass at hazardous glazing areas. False windows shall be installed with obscure glazing.
- Closets for clothing or coat storage shall be equipped with 1 rod/shelf. Closets for linen shall have 4 open equal shelves. Closets for pantries shall have 4 equal wood shelves, painted.
- Stair treads shall be a min of 9" deep, risers shall be a maximum of 8 1/4", unless noted otherwise, per the current North Carolina Residential Code
- 10. Handrails and Guards at stairs shall be 34" above the finished surface of the ramp surface of the stair Handrails at landings and overlooks of multilevel spaces shall be 36" above finished floor. Guards (pickets or ballstens) shall be spaced with no more than 4" between guards.
- 11. Attic Access shall be provided at all attic area with a height greater than 30°. Minimum clear attic access shall be 20° x 30°. Pull down stairs and access doors in knee walls meeting minimum criteria are also acceptable.
- 12. Garage Door to Living Space shall be 2'-8" x 6'-8" minimum size and shall be 20 minute fire rated and
- 13. Garage Walls, as a minimum, shall be separated from living space by installing 1/2" gypsum board on the garage side of the wall. With habilable space above, the inside of all garage walls require 1/2" GWB supporting 5/8" type X GWB on ceiling.



SHIPLAP DETAIL

SCALE: 3/16"=1'-0" ON 11x17, 3/4"=1'-0" ON 22x34

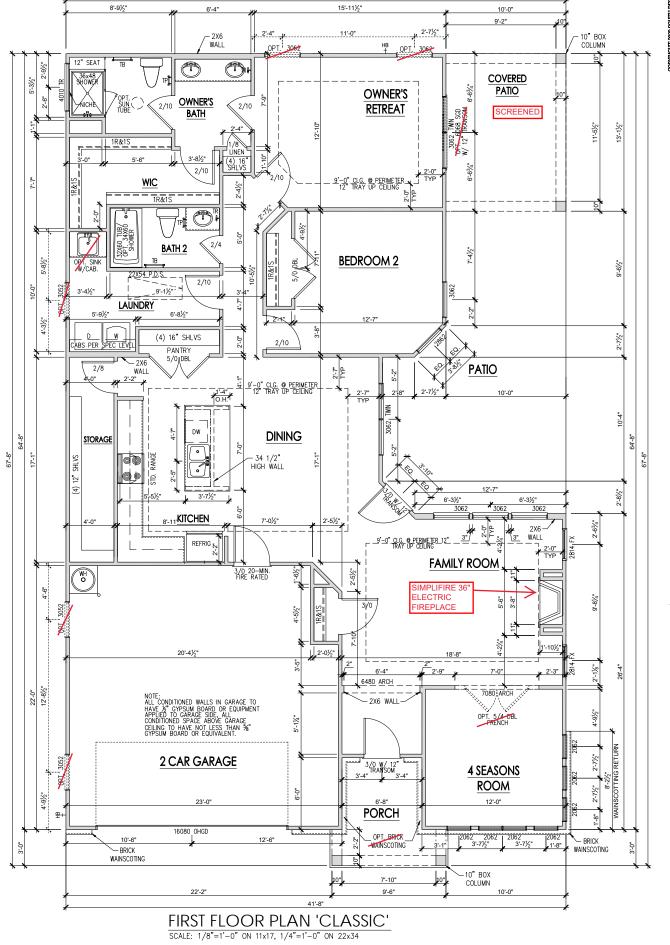

SOUTH DESIGNS
P.O. Box 688

P.O. Box 688
Wake Forest, NC 27588
(O) 919-556-2226
(F) 919-556-2228
www.southdesigns.com

This plan is the property of South Designs, Inc. and may not be reproduced without the expressed written consent of South Designs, Inc. these drawings are offered to the named client for a conditional one time. The conditional use is limited to the lot or property as specified herein, and only for said location. South Designs, Inc. assumes no liability or any home constructed from these plans. Contractor or Builder shall verify or any home constructed from these plans. Contractor or Builder shall verify all dimensions and conditions prior to construction. Caution must be exercised when making changes to these drawings. If changes are made to these drawings, contact South Designs, Inc.

McKee



DRAIN BY:

ORIGINAL RELEASE DATE:


CURRENT RELEASE DATE:


REV # IDATE / DESCRIPTION


A

A

Palazzo 2020 - LH
First Floor Plan 'Classic'

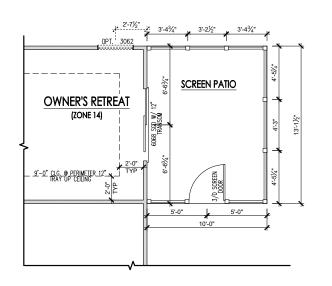

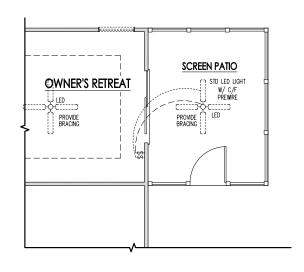

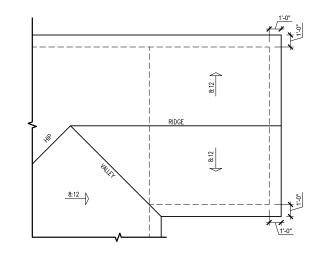

SCREENED PATIO ROOF PLAN

PARTIAL RIGHT SIDE ELEVATION

SCALE: 1/8"=1'-0" ON 11x17, 1/4"=1'-0" ON 22x34

SCALE: 1/8"=1'-0" ON 11x17, 1/4"=1'-0" ON 22x34

SOUTH DESIGNS P.O. Box 688 Wake Forest, NC 27588 (O) 919-556-2226 (F) 919-556-2228

This plan is the property of South Designs, Inc. and may not be reproduced without the expressed written consent of South Designs, Inc. these drainings are offered to the lot of property as specified herein, and only for soil focation. South Designs, Inc. assumes no liability for any home constructed from these plans. Contractor or Builder shall verify of any home constructed from these plans. Contractor or Builder shall verify all dimensions and conditions prior to construction. Qualion must be exercised when making changes for these drainings. If changes are made to these drainings, If changes are made to these drainings, contract South Designs, Inc.





ORIGINAL RELEASE DAT CURRENT RELEASE DATE: Screen Patio Plan & Elevations 'Classic'

2020 - LH Palazzo

1<u>ST FLR PLATE</u>

WINDOW HDR HT

— SCREEN ENCLOSURE

1ST FLR FF

2.5a

SCREENED PATIO FLOOR PLAN SCREENED PATIO ELECTRICAL SCALE: 1/8"=1'-0" ON 11x17, 1/4"=1'-0" ON 22x34 SCALE: 1/8"=1'-0" ON 11x17, 1/4"=1'-0" ON 22x34

> SLOPE PER ELEVATION 1ST FLR PLATE WINDOW HDR HT OPT. WINDOW

PARTIAL FRONT SIDE ELEVATION SCALE: 1/8"=1'-0" ON 11x17, 1/4"=1'-0" ON 22x34

8:12

— SCREEN ENCLOSURE

SCREENED PATIO REAR ELEVATION SCALE: 1/8"=1'-0" ON 11x17, 1/4"=1'-0" ON 22x34

General Elevation Notes

General Elevation Notes shall apply unless

- 1. Roof shall be finished with architectural composition
- Ridge Vent shall be provided and installed on all ridges greater than 6' in length per manufacturer's specifications.
- 3. Soffit Vent shall be continuous soffit vent
- House Wrap, "tyvek" or approved equal shall be installed over entire exterior wall per manufacturer's specifications and recommendations.
- Flashing shall be provided above all door and window openings, above finish wall material changes and at wall surfaces where lower roof areas abut vertical wall surfaces.
- Porch Railings shall be provided at all porch walking surfaces greater than 30" above adjacent finished grade. It shall be 36" high with guards spaced no more than 4" apart. Consult community specifications for material.
- Finish Wall Material shall be as noted on elevation drawings.
- 8. Brick Veneer, if included on elevation shall be tied to wall surface with galvanized corrugated metal ties at a rate of 24" oc horizontally and 16" oc vertically so that no more than 2.67sf of brick is supported by (1) tie. Space between face of wall and back face of brick shall be limited to a maximum of 1". Flashing shall be provided behind brick above all wall openings and at base of brick wall. Flashing shall be a minimum of 6-mil poly or other corrosion resistant material and shall be installed so that it laps under the house wrap material an minimum of 2".

 Weepholes shall be provided at a rate of 48" oc and shall not be less than 3/16" in diameter and shall be located immediately above flashing. located immediately above flashing.
- Brick Veneer Support Lintels shall be provided if brick veneer is included on elevation. Lintels shall be provided as listed in the following schedule and shall have a minimum bearing length of 6". Masonry Lintels shall be provided so that deflection is limited to L/600.


Masonry Opening Lintel Schedule

Opening Size Angle


up to 4'-0" 4'-1" to 5'-6" 5'-7" to 6'-6" 6'-7" to 8'-4" 8'-5" to 16'-4" 3-1/2" x 3-1/2" x 5/16" 4" x 3-1/2" x 5/16" LLV 5" x 3-1/2" x 5/16" LLV 6" x 3-1/2" x 5/16" LLV 7" x 4" x 3/8" LLV

DBL. LV 16"X32" GABLE VENT— 8:12 SHINGLES AS SPECIFIED -SHINGLES AS SPECIFIED 6" FASCIA TYP. -6" FRIEZE TYP. 8:12 1ST FLR PLATE WINDOW HDR HT FYPON BRACKET BKT10X16X4 -— SMOOTH PANEL SIDING AS SPECIFIED 6" HEAD -HORIZ. SIDING AS SPECIFIED BRICK — WAINSCOTING ST FLR FF 10" SQ. COLUMN AS SPECIFIED

> FRONT ELEVATION 'CLASSIC' (SLAB) SCALE: 1/4" = 1'-0" ON 22x34, 1/8" = 1'-0" ON 11x17

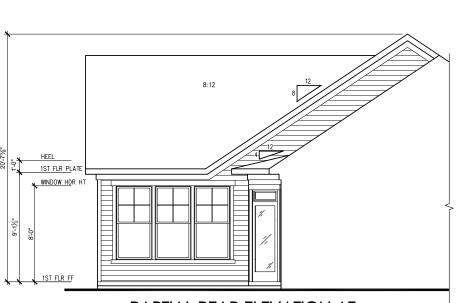

PARTIAL REAR ELEVATION AT **FAMILY ROOM** SCALE: 1/8"=1'-0" ON 11x17, 1/4"=1'-0" ON 22x34

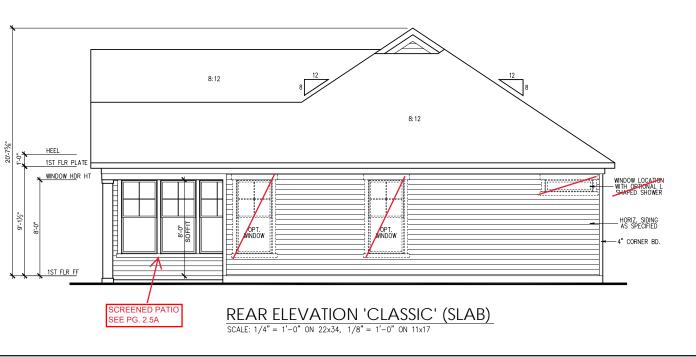

SOUTH **DESIGNS** P.O. Box 688 Wake Forest, NC 27588 (O) 919-556-2226 (F) 919-556-2228 www.southdesigns.com

This plan is the property of South Designs, Inc. and may not be reproduced without the expressed written consent of South Designs, Inc. These drainings ore offered to the named client for a conditional one Is mitted to the lot or property as specified herein, and only for said location. South Designs, Inc. assumes no liability or any home constructed from these plans. Contractor or Builder shall verify of any home construction. Coultion must be exercised when making changes for these drainings. If changes are made to these drainings, contact South Designs, Inc.



EPCON

(0	DRAWN				
LOTS			EASE DATE		
<u>а</u>	CURREN	IT REL	EASE DATE	3	
11x17 SHEETS ARE 1/2 SCALE PLOTS	REV #	DATE	/ DESCRI	PTION	
1/2	Δ				
RE	<u>~</u>	H			
2					
Ë	Δ	_			
N S					
1,×1				٦	
1					_
SHEETS					ssic
풀	l			- 1	ا بَک

Front & Rear Elevations 'Cla Palazzo

General Elevation Notes

General Elevation Notes shall apply unless noted otherwise on plan.

- Roof shall be finished with architectural composition shingles with slopes as noted on plan.
- Ridge Vent shall be provided and installed on all ridges greater than 6' in length per manufacturer's specifications.
- 3. Soffit Vent shall be continuous soffit vent
- House Wrap, "tyvek" or approved equal shall be installed over entire exterior wall per manufacturer's specifications and recommendations.
- Flashing shall be provided above all door and window openings, above finish wall material changes and at wall surfaces where lower roof areas abut vertical wall surfaces.
- Porch Railings shall be provided at all porch walking surfaces greater than 30" above adjacent finished grade. It shall be 36" high with guards spaced no more than 4" apart. Consult community specifications for material.
- Finish Wall Material shall be as noted on elevation
- Brick Veneer, if included on elevation shall be tied to wall surface with galvanized corrugated metal ties at a rate of 24" oc horizontally and 16" oc vertically so a rate of 24" oc horizontally and 16" oc vertically so that no more than 2.67sf of brick is supported by (1) tie. Space between face of wall and back face of brick shall be limited to a maximum of 1". Hashing shall be provided behind brick above all wall openings and at base of brick wall. Flashing shall be a minimum of 6-mil poly or other corrosion resistant material and shall be installed so that it laps under the house wrap material a minimum of 2". Weepholes shall be provided at a rate of 48" oc and shall not be less than 3/16" in diameter and shall be located immediately above flashing.
- Brick Veneer Support Lintels shall be provided if brick veneer is included on elevation. Lintels shall be provided as listed in the following schedule and shall have a minimum bearing length of 6". Masonry Lintels shall be provided so that deflection is limited

Masonry Opening Lintel Schedule

Opening Size	An

up to	4'-0"		3-1/2" x 3-1/2" x 5/16
4'-1"	to	5'-6"	4" x 3-1/2" x 5/16" LL\
5'-7"	to	6'-6"	5" x 3-1/2" x 5/16" LL\
6'-7"	to	8'-4"	6" x 3-1/2" x 5/16" LL\
8'-5"	to	16'-4"	7" x 4" x 3/8" LLV

8:12 8:12 HEEL 1ST FLR PLATE WINDOW HDR HT FYPON BRACKET — BKT10X16X4 HORIZ. SIDING AS SPECIFIED OPT. WINDOW -4" CORNER BD. BRICK WAINSCOTING — 6" TRIM TO COVER BRICK

LEFT SIDE ELEVATION 'CLASSIC' (SLAB)

SCALE: 1/4" = 1'-0" ON 22x34, 1/8" = 1'-0" ON 11x17




This plan is the property of South Designs, Inc. and may not be reproduced without the expressed written consent of South Designs, Inc. These drainings are offered to the named client for a conditional one time. The conditional use is limited to the lot or property as specified herein, and only for soid location. South Designs, Inc. assumes no liability for any home constructed from these plans. Contractor or Builder shall verify of all dimensions and conditions prior to construction. Caution must be exercised when making changes or emde to these drainings. If changes are made to these drainings, contract South Designs, Inc.

McKee



	DRAWN BY:			
STS	ORIGINAL REL	EASE DATE:		-
J.	CURRENT REI	EASE DATE:		-
ALE				-
SC	REV # DATE	/ DESCRIPTIO	N	_
1/2	ا∆ا			-
띪	 			-
∢ σ				-
EET				_
꼾				
ED ON DRAWINGS RELATE TO FULL SIZE 34x22 SHEETS - 11x17 SHEETS ARE 1/2 SCALE PLOTS				ı
- 1			ll	l
ET3			ll	l
HE I			ll	l
22	_		ୂଧ	l
34×.			Side Elevations 'Classic'	l
ZE			🚝	l
S	Palazzo 2020 -		ا يَرِ ا	l
Ū.	8		🚆	l
2	N		윤	l
Ш	၂ ႙		&	l
ELA			은	l
ω ω	<u> </u>		ᄪᆡᄧᆛ	l
ING	ا م ^م		풀	l
RA	_		📆	l
_ 			ıl	l
ō				l
핕		l l	ıl	ı

3.2a

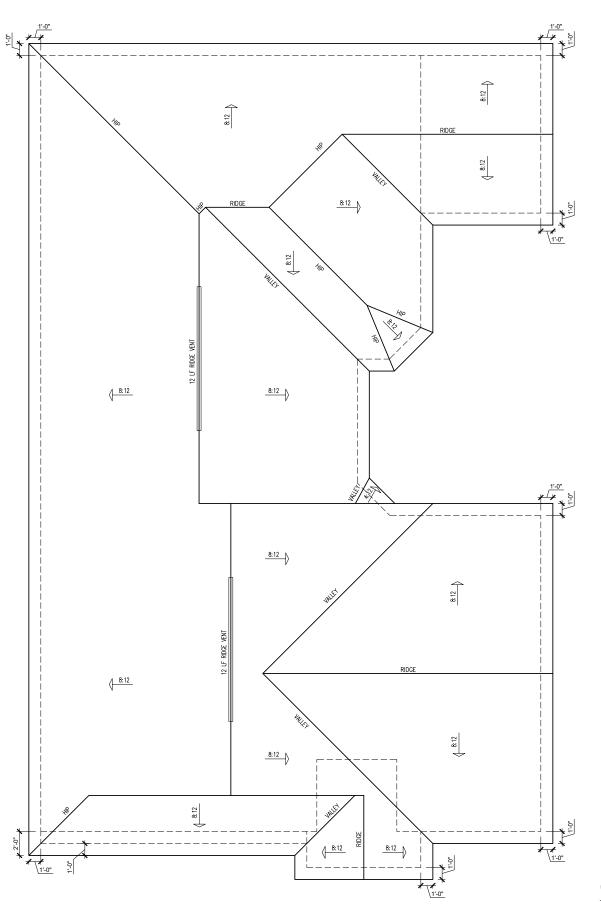

ATTIC VENT SCHEDULE									
elevation 'classic'									
MAIN HOUSE SQ FTG 2424 AT / NEAR RIDGE AT / NEAR EAVE									
VENT TYPE SQ. FT. REQUIRED RANGE			SQ. FT.	PERCENT OF TOTAL	POT LARGE (SQ. FT. EACH)	POT SMALL (SQ. FT. EACH)	RIDGE VENT (SQ. FT. PER LF)	EAVE VENT (SQ. IN. EACH)	CONT. VEN
			SUPPLIED SUPPLIED	0.4236	0.2778	0.125	0.1944	0.0625	
RIDGE VENT	3.23	4.04	3.00	46.60	0	0	24.00		
SOFFIT VENTS	4.85	4.04	3.44	53.40				0	55.00
TOTAL (MIN)	8.08	8.08	6.44	100.00	POT VENTS MAY BE REQUIRED IF THERE IS INSUFFICIENT RIDGE AVAILABLE				



This plan is the property of South Designs, Inc. and may not be reproduced without the expressed written consent of South Designs, Inc. These drainings are offered to the named client for a conditional one time. The conditional use is limited to the lot or property as specified herein, and only for soil faccition. South Designs, Inc. assumes no liability for any home constructed from these plans. Contractor or Builder shall verify all dimensions and conditions prior to construction. Caution must be exercised when making changes for these drainings. If changes are made to these drainings, contract South Designs, Inc.






	DRAWN	BY:			
STC	ORIGINA	l rel	EASE DATE	:	
7	CURREN	T REL	EASE DATI	:	
ALE					
SC	REV #	DATE	/ DESCRI	PTION	
1/2	Δ				
Ä	 →				
γ	$ \Delta $				
ĒĒ	_				
φ	_				
11x17 SHEETS ARE 1/2 SCALE PLOTS		1		1	
-				1	
v				-	

Palazzo 2020 - LH Roof Plan 'Classic'

'CLASSIC' ROOF PLAN SCALE: 1/4" = 1'-0" ON 22x34, 1/8" = 1'-0" ON 11x17


3.3a



RISER HEIGHTS PER STAIR CONFIGURATION						
PLATE HEIGHT	10" FLOOR SYSTEM	14" FLOOR SYSTEM	16" FLOOR SYSTEM			
8'-1 1/2"	14 RISERS @ 7 11/16"	15 RISERS @ 7 1/2"	15 RISERS @ 7 5/8"			
9'-1 1/2"	16 RISERS @ 7 1/2"	16 RISERS @ 7 3/4"	17 RISERS @ 7 7/16"			
10'-1 1/2"	17 RISERS @ 7 3/4"	18 RISERS @ 7 9/16"	18 RISERS @ 7 11/16"			

TYPICAL STAIR DETAIL


SCALE: 1" = 1'-0" ON 22x34, 1/2" = 1'-0" ON 11x17

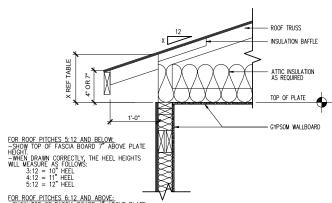

FOR ROOF PITCHES 6:12 AND ABOVE:
-SHOW TOP OF FASCIA BOARD 4" ABOVE PLATE
HEIGHT.
-WHEN DRAWN CORRECTLY, THE HEEL HEIGHTS
WILL MEASURE AS FOLLOWS:

IMPORTANT REMINDER: THE LOWEST PITCH ROOF ALWAYS MANDATES THE CONDITION. FOR EXAMPLE, A ROOF WITH A 4:12 PITCH AND A 6:12 PITCH, WOULD FOLLOW THE 7" ABOVE PLATE HEIGHT RULE. THE HEEL FOR THE 6:12 ROOF IN THIS CONDITION WILL DIFFER FROM WHAT IS LISTED HERE.


ENERGY HEEL DETAIL: CZ 2 & 3 SCALE: 1" = 1'-0" ON 22x34, 1/2" = 1'-0" ON 11x17

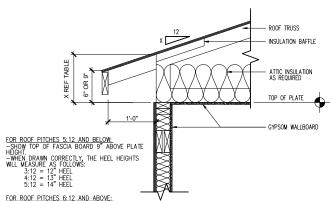

FOR ROOF PITCHES 6:12 AND ABOVE:
SHOW TOP OF FASCIA BOARD 6" ABOVE PLATE
HEIGHT.
HEIGH

IMPORTANT REMINDER: THE LOWEST PITCH ROOF ALWAYS MANDATES THE CONDITION. FOR EXAMPLE, A ROOF WITH A 4:12 PITCH AND A 6:12 PITCH, WOULD FOLLOW THE 9" ABOVE PLATE HELGHT RULE. THE HEEL FOR THE 6:12 ROOF IN THIS CONDITION WILL DIFFER FROM WHAT IS LISTED HERE.

ENERGY HEEL DETAIL: CZ 4 & 5 SCALE: 1" = 1'-0" ON 22x34, 1/2" = 1'-0" ON 11x17

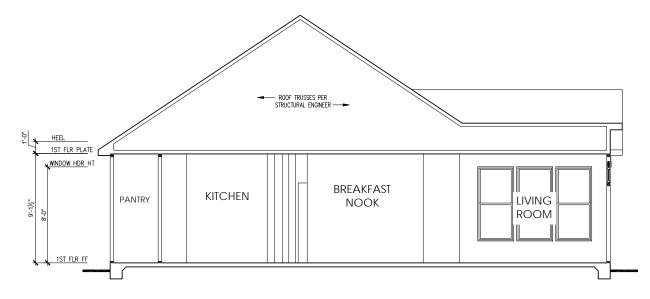

BUILDING SECTION 1 - ELEVATION 'A' & 'B' (SLAB) SCALE: 1/4" = 1'-0" ON 22x34, 1/8" = 1'-0" ON 11x17

SOUTH **DESIGNS** P.O. Box 688 Wake Forest, NC 27588 (O) 919-556-2226 (F) 919-556-2228

This plan is the property of South Designs, Inc. and may not be approached without the expressed effective of the expressed o





	DRAWN BY:
OTS	ORIGINAL RELEASE DATE:
4	CURRENT RELEASE DATE:
SALE	
11x17 SHEETS ARE 1/2 SCALE PLOTS	REV # DATE / DESCRIPTION
1	
ARE	
ETS	
꿂	
7	11 11 1
- 1	
,	

Building Sections 'Classic' Palazzo 2020 - LH

4.0a


ELECTRICAL SYMBOL KEY LIGHT FIXTURES CEILING SURFACE MOUNT LIGHT RECESSED CAN LIGHT LED PUCK LIGHT WP RECESSED CAN LIGHT WATERPROOF RECESSED CAN - EYEBALL ● PENDANT LIGHTING ₩ MALL SCONCE HALL MOUNT LIGHT FLOOD LIGHT OUTLETS DUPLEX OUTLET € GFI OUTLET GFI-NP WATERPROOF GFI OUTLET SWITCHED 1/2 HOT DUPLEX OUTLET 220V OUTLET TELEPHONE OUTLET CATV (TELEVISION) OUTLET UNDER-COUNTER OR CONCEALED OUTLETS Ø CEILING MOUNTED DUP. OUTLET #LOOR MOUNTED DUP. OUTLET SWITCHES SINGLE POLE SMITCH \$3 THREE-MAY SMITCH \$4 FOUR-MAY SMITCH ELECTRICAL DISCONNECT MISC FIXTURES EXHAUST FAN UNCTION BOX \oplus_{220V} JUNCTION BOX 220V CARBON MONOXIDE DETECTOR OR SMOKE DETECTOR CARBON MONOXIDE DETECTOR AND SMOKE DETECTOR ELECTRIC METER ELECTRICAL PANEL DOOR BELL CHIME DOOR BELL PUSH BUTTON CEILING FAN PREWIRE [8] FLUORESCENT LIGHT

General Power and Lighting Notes shall apply unless noted otherwise on plans.

Building Code, and the National Electric Code. Alarm devices shall meet NFPA 72.

- Smoke Alarms Shall be provided as a minimum of (1) per floor, including basements (if applicable), (1) in each sleep room, and (1) outside each sleeping area, within the immediate vicinity of sleeping rooms. When more than one alarm is required, the alarm devices shall be interconnected in such a manner that the activation of one alarm will activate all of the alarms. Smoke alarms shall be hard wired to permanent power and shall have
- Switches For lighting, fans, etc. shall be installed at heights illustrated on this page and shall be located a minimum of 4 1/2" from door openings to allow for the proper installation of door casings. Switches, thermostats, security pads, and other similar devices shall be grouped together and installed thoughtfully for convenience of use and to avoid placement within centers of wall areas.


Note: This plan is a diagram showing approximate locations of convenience outlets based on requirements found in the NC Residential Code and N.E.C. Actual positions may vary from

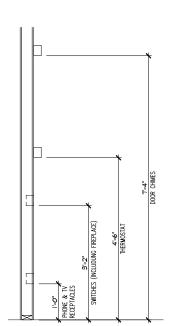

ELECTRICAL BOX HEIGHTS



All work shall be installed per the current NC Residential

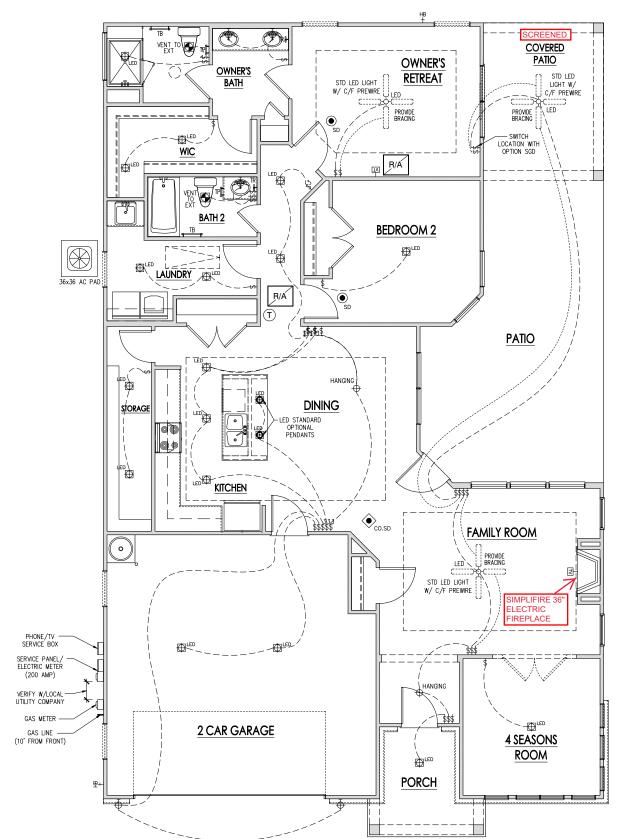

FIRST FLOOR ELECTRICAL PLAN 'CLASSIC'

SCALE: 1/8"=1'-0" ON 11x17, 1/4"=1'-0" ON 22x34



This plan is the property of South Designs, Inc. and may not be reproduced without the appressed written consent of South Designs, Inc. These drawings are offered to the named client for a conditional one time use. The conditional use is limited to the lot or property as specified herein, and only for soid location.

(F) 919-556-2228

www.southdesigns.com

and only for soid location.

South Designs, Inc. assumes no liability
for any home constructed from these
plans. Contractor or Builder shall verify
all dimensions and conditions prior to
construction. Courtion must be
exercised when making changes to
these drawings. If changes are made
to these drawings, contact South
Designs, Inc.






	DRAWN BY:		
OTS	ORIGINAL RELE	ASE DATE:	
립	CURRENT RELE	ASE DATE:	
11x17 SHEETS ARE 1/2 SCALE PLOTS	REV # DATE	/ DESCRIPTIO	N
/5) DECOME NO	
7E 1	= -		
S. A.			
Ę			
- S			
11×1			
1			
STI			_

First Floor Electrical 'Classic' 프 2020 Palazzo



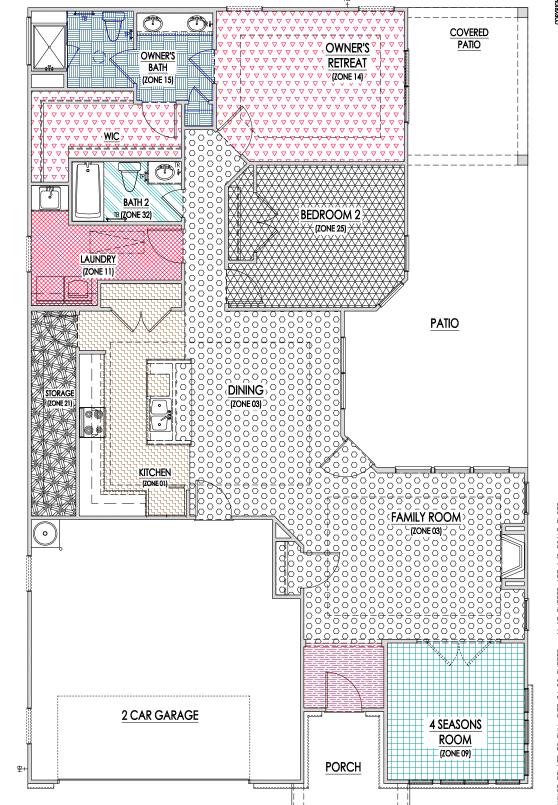

SOUTH **DESIGNS** P.O. Box 688 Wake Forest, NC 27588 (O) 919-556-2226 (F) 919-556-2228

This plan is the property of South Designs, Inc. and may not be reproduced without the expressed written consent of South Designs, Inc. These drawings are offered to the named client for a conditional one time to the lot or property as specified herein, and only for solid location. South Designs, Inc. assumes no liability or any home constructed from these plans. Contractor or Builder shall verified ill dimensions and conditions prior to construction. Osution must be exercised when making changes are made to these drawings. If changes are made to these drawings, contact South Designs, Inc.



ļ		_
	DRAWN BY:	
OTS	ORIGINAL RELEASE DATE:	_
7	CURRENT RELEASE DATE:	—
Ä.		_
SHEETS ARE 1/2 SCALE PLOTS	REV # DATE / DESCRIPTION	
73	<u> </u>	
П 1	4	
AR	 ∆	_
ST3	=	_
H	I∆ 	—
8		
11×17		ī
- [Ш
Ŋ	∥ "ა	ш

First Floor Flooring Plan 'Classi 2020 - LH Palazzo

FIRST FLOOR FLOORING PLAN 'CLASSIC'

SCALE: 1/8"=1'-0" ON 11x17, 1/4"=1'-0" ON 22x34

FLOORING

AREAS

ZONE AREA ONE 00

ONF 01

ONE 09

ONE 11

ONE 14

ONE 15

ONF 21

ONE 25

ZONE 32

36.82 SF 118.49 SF

534.80 SF

131.36 SF

73.25 SF 72.04 SF

193.40 SF

77.92 SF

63.74 SF

168.35 SF

27.70 SF

STRUCTURAL PLANS FOR:

PALAZZO 2020 - LEFT HAND

INDEX OF SHEETS		REVISION LOG		
SHEET	TITLE	DATE	REVISED BY	REVISION
Т	TITLE SHEET: PROJECT INFORMATION AND NOTES	09/17/2020	AWC	ADDED PDS AND HVAC PAD TO STRUCTURAL LAYOUT
GN1.0	GENERAL NOTES	11/11/2020	AWC	REVISED ALL MASONRY EXTENDED FOOTINGS
GN1.1	GENERAL NOTES			
S0.1	SLAB FOUNDATION PLAN			
S0.9	CRAWLSPACE FOUNDATION PLAN			
S1.0	FIRST FLOOR CEILING FRAMING PLAN			
S2.0	SECOND FLOOR CEILING FRAMING PLAN			
S3.0	FIRST FLOOR WALL BRACING PLAN			
S4.0	ROOF FRAMING PLAN			
D1.0 - D9.0	DETAILS			

NOTES

- ENGINEER'S SEAL APPLIES TO STRUCTURAL COMPONENTS ONLY. ENGINEER'S SEAL DOES NOT CERTIFY DIMENSIONAL ACCURACY OR ARCHITECTURAL LAYOUT, INCLUDING ROOF GEOMETRY. JDSfaulkner, PLLC ASSUMES NO LIABILITY FOR CHANGES MADE TO THESE PLANS BY OTHERS, OR FOR CONSTRUCTION METHODS, OR FOR ANY DEVIATION FROM THE PLANS, ENGINEER TO BE NOTIFIED PRIOR TO CONSTRUCTION IF ANY DISCREPANCIES ARE NOTED ON THE
- 2. DIMENSIONS SHALL GOVERN OVER SCALE, AND CODE SHALL GOVERN OVER DIMENSIONS.
- 3. PLANS MUST HAVE SIGNED SEAL TO BE VALID AND ARE LIMITED TO THE FOLLOWING USES:
 - A. IF THESE PLANS ARE ISSUED AS A MASTER-PLAN SET, THE SET IS VALID FOR 18 MONTHS FROM THE DATE ON THE SEAL, UNLESS ANY CODE-REQUIRED UPDATES ARE PLACED IN EFFECT BY THE MUNICIPALITY.
 - B. IF THESE PLANS ARE NOT ISSUED AS A MASTER-PLAN SET, THE SET IS VALID FOR A CONDITIONAL, ONE-TIME USE FOR THE LOT OR ADDRESS SPECIFIED ON THE

CODE

ALL CONSTRUCTION, WORKMANSHIP, AND MATERIAL QUALITY AND

NORTH CAROLINA **STATE BUILDING CODE:** RESIDENTIAL CODE

ENGINEER OF RECORD

JDSfaulkner, PLLC **ENGINEERING, BUILDING DESIGN, & CONSTRUCTION CONSULTING SERVICES** 8600 'D' JERSEY COURT RALEIGH, NC 27617 FIRM LIC. NO: P-0961 PROJECT REFERENCE: 20902056



P-0961



20902056 AWC

11/11/2020

TITLE SHEET

NOTE: ALL CHAPTERS, SECTIONS, TABLES, AND FIGURES CITED WITHOUT A PUBLICATION TITLE ARE FROM THE APPLICABLE RESIDENTIAL CODE (SEE TITLE SHEET).

GENERAL

- IT IS THE CONTRACTOR'S RESPONSIBILITY TO VERIFY ALL DIMENSIONS PRIOR TO CONSTRUCTION. FURTHERMORE, CONTRACTOR IS ULTIMATELY RESPONSIBLE FOR CONSTRUCTION MEANS, METHODS, AND SAFETY ON SITE. NOTIFY JDSfaulkner, PLLC IMMEDIATELY IF DISCREPANCIES ON PLAN EXIST.
- 2. BRACED-WALL DESIGN IS BASED ON SECTION R602.10 WALL BRACING. PRIMARY PRESCRIPTIVE METHOD TO BE CS-WSP. SEE WALL BRACING PLANS AND DETAILS FOR ADDITIONAL INFORMATION.
- ALL NON-PRESCRIPTIVE SOLUTIONS ARE BASED ON GUIDELINES ESTABLISHED IN THE AMERICAN SOCIETY OF CIVIL ENGINEERS PUBLICATION ASCE 7 AND THE NATIONAL DESIGN SPECIFICATION FOR WOOD CONSTRUCTION SPECIAL DESIGN PROVISIONS FOR WIND AND SEISMIC.
- SEISMIC DESIGN SHALL BE PER SECTION R301.2.2 SEISMIC PROVISIONS, INCLUDING ASSOCIATED TABLES AND FIGURES, BASED ON LOCAL SEISMIC DESIGN CATEGORY.

DESIGN LOADS

ASSUMED SOIL	REARING-CAPACITY	2 000 PS

	LIVE LOAD
ULTIMATE DESIGN WIND SPEED	115 MPH, EXPOSURE B
GROUND SNOW	15 PSF
ROOF	20 PSF
RESIDENTIAL CODE TABLE R301.5	LIVE LOAD (PSF)
DWELLING UNITS	40
SLEEPING ROOMS	30
ATTICS WITH STORAGE	20
ATTICS WITHOUT STORAGE	10
STAIRS	40
DECKS	40
EXTERIOR BALCONIES	60
PASSENGER VEHICLE GARAGES	50
FIRE ESCAPES	40
GUARDS AND HANDRAILS	200 (pounds, concentrated

COMPONENT AND CLADDING LOADS, INCLUDING THOSE FOR DOORS AND WINDOWS, SHALL BE DERIVED FROM TABLES R301.2(2) AND R301.2(3) FOR A BUILDING WITH A MEAN ROOF HEIGHT OF 35 FEET, LOCATED IN EXPOSURE B.

	ABBR	EVIATIONS	KS LVL	KING STUD COLUMN
			LVL	LAMINATED VENEER
	ABV	ABOVE		LUMBER
	AFF	ABOVE FINISHED FLOOR	MAX	MAXIMUM
	ALT	ALTERNATE	MECH	MECHANICAL
	BRG	BEARING	MFTR	MANUFACTURER
	BSMT	BASEMENT	MIN	MINIMUM
	CANT	CANTILEVER	NTS	NOT TO SCALE
	CJ	CEILING JOIST	OA	OVERALL
	CLG	CEILING	ОС	ON CENTER
	CMU	CONCRETE MASONRY UNIT	PT	PRESSURE TREATED
	CO	CASED OPENING	R	RISER
	COL	COLUMN	REF	REFRIGERATOR
	CONC	CONCRETE	RFG	ROOFING
	CONT	CONTINUOUS	RO	ROUGH OPENING
	D	CLOTHES DRYER	RS	ROOF SUPPORT
	DBL	DOUBLE	SC	STUD COLUMN
	DIAM	DIAMETER	SF	SQUARE FOOT (FEET)
	DJ	DOUBLE JOIST	SH	SHELF / SHELVES
	DN	DOWN	SHTG	SHEATHING
	DP	DEEP	SHW	SHOWER
	DR	DOUBLE RAFTER	SIM	SIMILAR
	DSP	DOUBLE STUD POCKET	SJ	SINGLE JOIST
	EA.	EACH	SP	STUD POCKET
	EE	EACH END	SPEC'D	SPECIFIED
		EQUAL	SQ	SQUARE
		EXTERIOR	T	TREAD
		FORCED-AIR UNIT	TEMP	TEMPERED GLASS
	FDN	FOUNDATION	THK	THICK(NESS)
	FF	FINISHED FLOOR	TJ	TRIPLE JOIST
	FLR	FLOOR(ING)	TOC	TOP OF CURB / CONCRETE
	FP	FIREPLACE	TR	TRIPLE RAFTER
	FTG	FOOTING	TYP	TYPICAL
	HB	HOSE BIBB	UNO	UNLESS NOTED OTHERWIS
l	HDR	HEADER	W	CLOTHES WASHER
l	HGR	HANGER	WH	WATER HEATER
ĺ	JS	JACK STUD COLUMN	WWF	WELDED WIRE FABRIC
ĺ	00	JACK CIGD COLUMN	XJ	EXTRA JOIST
1				

MATERIALS

 INTERIOR / TRIMMED FRAMING LUMBER SHALL BE #2 SPRUCE PINE FIR (SPF) WITH THE FOLLOWING DESIGN PROPERTIES (#2 SOUTHERN YELLOW PINE MAY BE SUBSTITUTED):

Fb = 875 PSI Fv = 70 PSI E = 1.4E6 PSI

 FRAMING LUMBER EXPOSED TO WEATHER OR IN CONTACT WITH THE GROUND, CONCRETE, OR MASONRY SHALL BE PRESSURE TREATED #2 SOUTHERN YELLOW PINE (SYP) WITH THE FOLLOWING DESIGN PROPERTIES:

Fb = 975 PSI Fv = 95 PSI E = 1.6E6 PSI

3. LVL STRUCTURAL MEMBERS TO BE LAMINATED VENEER LUMBER WITH THE FOLLOWING MINIMUM DESIGN PROPERTIES:

Fb = 2600 PSI Fv = 285 PSI E = 1.9E6 PSI

4. PSL STRUCTURAL MEMBERS TO BE PARALLEL STRAND LUMBER WITH THE FOLLOWING MINIMUM DESIGN PROPERTIES:

5. LSL STRUCTURAL MEMBERS TO BE LAMINATED STRAND LUMBER WITH THE FOLLOWING MINIMUM DESIGN PROPERTIES:

Fb = 2250 PSI Fv = 400 PSI E = 1.55E6 PSI

- STRUCTURAL STEEL WIDE-FLANGE BEAMS SHALL CONFORM TO ASTM A992. Fy = 50 KSI
- REBAR SHALL BE DEFORMED STEEL CONFORMING TO ASTM A615, GRADE 60.
- POURED CONCRETE COMPRESSIVE STRENGTH TO BE A MINIMUM 3,000 PSI AT 28 DAYS. MATERIALS USED TO PRODUCE CONCRETE SHALL COMPLY WITH THE APPLICABLE STANDARDS LISTED IN AMERICAN CONCRETE INSTITUTE STANDARD ACI 318 OR ASTM C1157
- CONCRETE SUBJECT TO MODERATE OR SEVERE WEATHERING PROBABILITY PER TABLE R301.2(1) SHALL BE AIR-ENTRAINED WHEN REQUIRED BY TABLE R402.2.
- 10. CONCRETE MASONRY UNITS (CMU) SHALL CONFORM TO AMERICAN CONCRETE INSTITUTE PUBLICATION 530: BUILDING CODE REQUIREMENTS AND SPECIFICATIONS FOR MASONRY STRUCTURES AND COMPANION COMMENTARIES AND THE MASONRY SOCIETY PUBLICATION TMS 402/602: BUILDING CODE REQUIREMENTS AND SPECIFICATIONS FOR MASONRY STRUCTURES.
- 11. MORTAR SHALL COMPLY WITH ASTM INTERNATIONAL STANDARD C270
- INDICATED MODEL NUMBERS FOR ALL METAL HANGERS, STRAPS, FRAMING CONNECTORS, AND HOLD-DOWNS ARE SIMPSON STRONG-TIE BRAND. EQUIVALENT USP BRAND PRODUCTS ARE ACCEPTABLE.
- 13. REFER TO I-JOIST EQUIVALENCE CHART ON I-JOIST DETAIL SHEET FOR SUBSTITUTION OF MANUFACTURER SERIES.

FOUNDATION

- MINIMUM ALLOWABLE SOIL BEARING CAPACITY IS ASSUMED TO BE 2,000 PSF. IT IS THE CONTRACTOR'S RESPONSIBILITY TO VERIFY SOIL BEARING CAPACITY IF UNSATISFACTORY CONDITIONS FYIST
- 2. CONCRETE FOUNDATION WALLS TO BE SELECTED AND CONSTRUCTED PER SECTION R404 OR AMERICAN CONCRETE INSTITUTE STANDARD ACI 318.
- 3. MASONRY FOUNDATION WALLS TO BE SELECTED AND CONSTRUCTED PER SECTION R404 AND/OR AMERICAN CONCRETE INSTITUTE PUBLICATION 530: BUILDING CODE REQUIREMENTS AND SPECIFICATIONS FOR MASONRY STRUCTURES AND COMPANION COMMENTARIES AND/OR THE MASONRY SOCIETY PUBLICATION TMS 402/602: BUILDING CODE REQUIREMENTS AND SPECIFICATIONS FOR MASONRY STRUCTURES.
- 4. CONCRETE WALL HORIZONTAL REINFORCEMENT TO BE PER TABLE R404.1.2(1) OR AS NOTED OR DETAILED. CONCRETE WALL VERTICAL REINFORCEMENT TO BE PER TABLES R404.1.2(3 AND 4) OR AS NOTED OR DETAILED. ALL CONCRETE WALLS SHALL COMPLY WITH APPLICABLE PROVISIONS OF CHAPTER 6.
 - A. TABLES ASSUME THAT WALLS HAVE PERMANENT LATERAL SUPPORT AT THE TOP AND BOTTOM.
 - B. FOUNDATION DRAINS ARE ASSUMED AT ALL WALLS PER SECTION R405.
- 5. PLAIN-MASONRY WALL DESIGN TO BE PER TABLE R404.1.1(1) OR AS NOTED OR DETAILED. MASONRY WALLS WITH VERTICAL REINFORCEMENT TO BE PER TABLES R404.1.1 (2 THROUGH 4) OR AS NOTED OR DETAILED. ALL MASONRY WALLS SHALL COMPLY WITH APPLICABLE PROVISIONS OF CHAPTER 6.
 - A. TABLES ASSUME THAT WALLS HAVE PERMANENT LATERAL SUPPORT AT THE TOP AND BOTTOM.
 - B. WALL REINFORCING SHALL BE PLACED ACCORDING TO FOOTNOTE (c) OF THE TABLES (REINFORCING IS NOT CENTERED IN WALL).
 - C. FOUNDATION DRAINS ARE ASSUMED AT ALL WALLS PER SECTION R405.
- 6. WOOD SILL PLATES TO BE ANCHORED TO THE FOUNDATION WITH 1/2" DIAMETER ANCHOR BOLTS WITH MINIMUM 7" EMBEDMENT, SPACED A MAXIMUM OF 6'-0" OC AND WITHIN 12" FROM THE ENDS OF EACH PLATE SECTION. INSTALL MINIMUM (2) ANCHOR BOLTS PER SECTION. SEE <u>SECTION R403.1.6</u> FOR SPECIFIC CONDITIONS.
- 7. THE UNSUPPORTED HEIGHT OF SOLID MASONRY PIERS SHALL NOT EXCEED TEN TIMES THEIR LEAST DIMENSION. UNFILLED, HOLLOW PIERS MAY BE USED IF THE UNSUPPORTED HEIGHT IS NOT MORE THAN FOUR TIMES THEIR LEAST DIMENSION.
- 8. CENTERS OF PIERS TO BEAR IN THE MIDDLE THIRD OF THE FOOTINGS, AND GIRDERS SHALL CENTER IN THE MIDDLE THIRD OF THE PIERS.
- 9. ALL FOOTINGS TO HAVE MINIMUM 2" PROJECTION ON EACH SIDE OF FOUNDATION WALLS (SEE DETAILS).
- 10. ALL REBAR NOTED IN CONCRETE TO HAVE AT LEAST 2" COVER FROM EDGE OF CONCRETE TO EDGE OF REBAR.
- 11. FRAMING TO BE FLUSH WITH FOUNDATION WALLS.
- 12. WITH CLASS 1 SOILS, VAPOR BARRIER AND CRUSHED STONE MAY BE OMITTED.

FRAMING

- ALL BEARING HEADERS TO BE (2) 2x6 SUPPORTED W/ MIN (1) JACK STUD AND (1) KING STUD EACH END, UNO.
- 2. ALL NON-BEARING HEADERS TO BE (2) 2x4, UNO.
- 3. NON-BEARING INTERIOR WALLS NOT MORE THAN 10' NOMINAL HEIGHT AND NOT SHOWN AS BRACED WALLS MAY BE FRAMED WITH 2x4 STUDS @ 24" OC.
- 4. SOLID BLOCKING TO BE PROVIDED AT ALL POINT LOADS THROUGH FLOOR LEVELS TO THE FOUNDATION OR TO OTHER STRUCTURAL COMPONENTS.
- ALL BEAMS SPECIFIED ARE MINIMUM SIZES ONLY. LARGER MEMBERS MAY SUBSTITUTED AS NEEDED FOR EASE OF CONSTRUCTION.
- 6. ALL EXTERIOR WALLS TO BE FULLY SHEATHED WITH 7/16" OSB.
- PORCH / PATIO COLUMNS TO BE 4x4 MINIMUM PRESSURE-TREATED LUMBER.
- A. ATTACH PORCH COLUMNS TO SLAB / FDN WALL USING ABA, ABU, ABW, OR CPT SIMPSON POST BASES TO FIT COLUMN SIZES NOTED ON PLAN -OR- ANY OTHER COLUMN CONNECTION WITH 500# UPLIFT CAPACITY.
- B. ATTACH PORCH COLUMNS TO PORCH BEAMS USING AC OR BC SIMPSON POST CAPS TO FIT COLUMN SIZES NOTED ON PLAN -OR- ANY OTHER COLUMN CONNECTION WITH 500# UPLIFT CAPACITY.
- C. TRIM OUT COLUMN(S) AND BEAM(S) PER BUILDER AND DETAILS.
- 8. ALL ENGINEERED WOOD PRODUCTS (LVL, PSL, LSL, ETC.) SHALL BE INSTALLED WITH CONNECTIONS PER MANUFACTURER SPECIFICATIONS.
- ENGINEERED WOOD FLOOR SYSTEMS AND ROOF TRUSS SYSTEMS:
 A. SHOP DRAWINGS FOR THE SYSTEMS SHALL BE PROVIDED TO THE ENGINEER OF RECORD FOR REVIEW AND COORDINATION BEFORE CONSTRUCTION.
 - B. TRUSS PROFILES SHALL BE SEALED BY THE TRUSS MANUFACTURER.
 - C. INSTALLATION OF THE SYSTEMS SHALL BE PER MANUFACTURER'S INSTRUCTIONS.
 - D. TRUSS LAYOUT AND PLACEMENT BY MANUFACTURER TO COINCIDE WITH THE SUPPORT LOCATIONS SHOWN IN THESE DRAWINGS.
- 10. ALL BEAMS TO BE CONTINUOUSLY SUPPORTED LATERALLY AND SHALL BEAR FULL WIDTH ON THE SUPPORTING WALLS OR COLUMNS INDICATED, WITH A MINIMUM OF THREE STUDS, UNO.
- 11. ALL STEEL BEAMS TO BE SUPPORTED AT EACH END WITH A MIN BEARING LENGTH OF 3 1/2" AND FULL FLANGE WIDTH. BEAMS MUST BE ATTACHED AT EACH END WITH A MINIMUM OF FOUR 16d NAILS OR TWO 1/2" x 4" LAG SCREWS, UNO.
- 12. STEEL FLITCH BEAMS TO BE BOLTED TOGETHER USING (2) ROWS OF 1/2" DIAMETER BOLTS (ASTM 307) WITH WASHERS PLACED UNDER THE THREADED END OF THE BOLT. BOLTS TO BE SPACED AT 24" OC (MAX) AND STAGGERED TOP AND BOTTOM OF BEAM (2" EDGE DISTANCE), WITH TWO BOLTS TO BE LOCATED AT 6" FROM EACH END OF FLITCH BEAM.
- 13. WHEN A 4-PLY LVL BEAM IS USED, ATTACH WITH (1) 1/2" DIAMETER BOLT, 12" OC, STAGGERED TOP AND BOTTOM, 1 1/2" MIN FROM ENDS. ALTERNATE EQUIVALENT ATTACHMENT METHOD MAY BE USED, SUCH AS SDS, SDW, OR TRUSSLOK SCREWS (SEE MANUFACTURER SPECIFICATIONS).
- 14. FOR STUD COLUMNS OF 4-OR-MORE STUDS, INSTALL SIMPSON STRONG-TIE CS16 STRAPS ACROSS STUDS @ 30" OC, 6" MAX FROM PLATES, ON INSIDE FACE OF COLUMN (EXTERIOR WALL), ON BOTH FACES OF COLUMN (INTERIOR WALL).
- 15. FLOOR JOISTS ADJACENT AND PARALLEL TO THE EXTERIOR FOUNDATION WALL SHALL BE PROVIDED WITH FULL-DEPTH SOLID BLOCKING, NOT LESS THAN TWO (2) INCHES NOMINAL IN THICKNESS, PLACED PERPENDICULAR TO THE JOIST AT SPACING NOT MORE THAN FOUR (4) FEET. THE BLOCKING SHALL BE NAILED TO THE FLOOR SHEATHING, THE SILL PLATE, THE JOIST, AND THE EXTERIOR RIM JOIST / BOARD.
- 16. BRACED WALL PANELS SHALL BE FASTENED TO MEET THE UPLIFT-RESISTANCE REQUIREMENTS IN CHAPTERS 6 AND 8 OF THE APPLICABLE CODE (SEE TITLE SHEET). REQUIREMENTS OF THE STRUCTURAL DRAWINGS THAT EXCEED THE CODE MINIMUM SHALL BE MET.



P-0961

PJERSEY CT, RALEIGH NC 27617 919,480,1075

DIECCOM; WWW, JDSfaulkner, COM

BBLE FOR CHANGES MADE TO PLANS DUE

RANY CHANGES TO PLANS MADE IN THE FIERS. DRAWINGS ARE PROVIDED TO CLIENT F

COREN OVER SCALE AND COME SUPPLY

INFO@JDSialkner.

JDSfaultner PLLC IS NOT LIABLI
COOPTRACTOR METHODS OR A
BY CONTRACTOR OR BY OTHER
THE LOT NUMBER, PROPERTY, O
SHEET. DIMENSIONS SHALL. G

ER. OR AS NOTEI

HAND

LEFT

2020

CAROLINA

PALAZZO LOCATION:

20902056

ATE. IDE

11/11/2020

HOMES

MCKEE

GENERAL NOTES

AWC

<u>GN10</u>

FASTENER SCHEDULE		
CONNECTION	3" x 0.131" NAIL	3" x 0.120" NAIL
JOIST TO SILL PLATE	(4) TOE NAILS	(4) TOE NAILS
SOLE PLATE TO JOIST / BLOCKING	NAILS @ 8" OC (typical) (4) PER 16" SPACE (at braced panels)	NAILS @ 8" OC (typical) (4) PER 16" SPACE (at braced panels)
STUD TO SOLE PLATE	(4) TOE NAILS	(4) TOE NAILS
TOP OR SOLE PLATE TO STUD	(3) FACE NAILS	(4) FACE NAILS
RIM JOIST OR BAND JOIST TO TOP PLATE OR SILL PLATE	TOE NAILS @ 6" OC	TOE NAILS @ 4" OC
BLOCKING BETWEEN JOISTS TO TOP PLATE OR SILL PLATE	(4) TOE NAILS	(4) TOE NAILS
DOUBLE STUD	NAILS @ 8" OC	NAILS @ 8" OC
DOUBLE TOP PLATES	NAILS @ 12" OC	NAILS @ 12" OC
DOUBLE TOP PLATES LAP (24" MIN LAP LENGTH)	(12) NAILS IN LAPPED AREA, EA SIDE OF JOINT	(12) NAILS IN LAPPED AREA, EA SIDE OF JOINT
TOP PLATE LAP AT CORNERS AND INTERSECTING WALLS	(3) FACE NAILS	(3) FACE NAILS
OPEN-WEB TRUSS BOTTOM CHORD TO TOP PLATES OR SILL PLATE (PARALLEL TO WALL)	NAILS @ 6" OC	NAILS @ 4" OC
BOTTOM CHORD OF TRUSS TO TOP PLATES OR SILL PLATE (PERPENDICULAR TO WALL)	(3) TOE NAILS	(3) TOE NAILS

SEE TABLE R602.3(1) FOR ADDITIONAL STRUCTURAL-MEMBER

DETAILS AND NOTES ON DRAWINGS GOVERN.

BALLOON WALL FRAMING SCHEDULE (USE THESE STANDARDS UNLESS NOTED OTHERWISE ON THE FRAMING PLAN SHEETS)

	MAX HEIGHT (PLATE TO PLATE)
FRAMING MEMBER SIZE	115 MPH ULTIMATE DESIGN WIND SPEED
2x4 @ 16" OC	10'-0"
2x4 @ 12" OC	12'-0"
	4-1-4-11
2x6 @ 16" OC	15'-0"
2x6 @ 12" OC	17'-9"
2x8 @ 16" OC	19'-0"
2x8 @ 12" OC	22'-0"
(2) 2x4 @ 16" OC	14'-6"
(2) 2x4 @ 12" OC	17'-0"
(2) 2x6 @ 16" OC	21'-6"
(2) 2x6 @ 12" OC	25'-0"
(2) 2x8 @ 16" OC	27'-0"
(2) 2x8 @ 12" OC	31'-0"

- a. ALL HEIGHTS ARE MEASURED SUBFLOOR TO TOP OF WALL PLATE.
- b. WHEN SPLIT-FRAMED WALLS ARE USED FOR HEIGHTS OVER 12', THE CONTRACTOR SHALL ADD 6' MINIMUM OF CS16 COIL STRAPPING (FULLY NAILED), CENTERED OVER THE WALL BREAK.
- c. FINGER-JOINTED MEMBERS MAY BE USED FOR CONTINUOUS HEIGHTS WHERE TRADITIONALLY MILLED LUMBER LENGTHS ARE
- d. FOR GREATER WIND SPEED, SEE ENGINEERED SOLUTION FOR CONDITION IN DRAWINGS.

ROOF SYSTEMS

TRUSSED ROOF - STRUCTURAL NOTES

- 1. PROVIDE CONTINUOUS BLOCKING THROUGH STRUCTURE FOR ALL POINT LOADS.

DENOTES OVER-FRAMED AREA

- 3. MINIMUM 7/16" OSB ROOF SHEATHING
- TRUSS LAYOUT AND PLACEMENT BY MANUFACTURER TO COINCIDE WITH THE SUPPORT LOCATIONS SHOWN. TRUSS PROFILES SHALL BE SEALED BY THE TRUSS MANUFACTURER. TRUSS PLANS TO BE COORDINATED WITH THE SEALED STRUCTURAL DRAWINGS. INSTALLATION SHALL BE IN ACCORDANCE WITH THE MANUFACTURER'S INSTRUCTIONS.
- MANUFACTURER TO PROVIDE REQUIRED UPLIFT CONNECTION.
- PROVIDE H2.5A (MINIMUM) OR EQUIVALENT AT EACH TRUSS-TO-TOP PLATE CONNECTION AT OVER-FRAMED AREAS, UNLESS NOTED OTHERWISE.
- 7. UPLIFT CONNECTION TO BE CARRIED THROUGH TO FLOOR SYSTEM.

STICK-FRAMED ROOF - STRUCTURAL NOTES

- PROVIDE 2x4 COLLAR TIES AT 48" OC AT UPPER THIRD OF RAFTERS. UNLESS NOTED OTHERWISE.
- 2. FUR RIDGES FOR FULL RAFTER CONTACT.
- 3. PROVIDE CONTINUOUS BLOCKING THROUGH STRUCTURE FOR ALL POINT LOADS.



DENOTES OVER-FRAMED AREA

- 5. MINIMUM 7/16" OSB ROOF SHEATHING
- 6. PROVIDE 2x4 RAFTER TIES AT 16" OC AT 45° BETWEEN RAFTERS AND CEILING JOISTS. USE (4) 16d NAILS AT EACH CONNECTION. RAFTER TIES MAY BE SPACED AT 48" OC AT LOCATIONS WHERE NO KNEE WALLS ARE INSTALLED.
- PROVIDE H2.5A (MINIMUM) OR EQUIVALENT AT EACH RAFTER-TO-TOP PLATE CONNECTION AT OVER-FRAMED AREAS, UNLESS NOTED OTHERWISE.
- 8. UPLIFT CONNECTION TO BE CARRIED THROUGH TO FLOOR

BRICK VENEER LINTEL SCHEDULE			
SPAN STEEL ANGLE SIZE END BEARING LENGT			
UP TO 42"	L3-1/2"x3-1/2"x1/4"	8" (MIN. @ EACH END)	
UP TO 72" L6"x4"x5/16"* (LLV)		8" (MIN. @ EACH END)	
OVER 72" L6"x4"x5/16"* (LLV) ATTACH LINTEL w/ 1/2" THRU BOLT @ 12" OC, 3" FROM EACH END			

* FOR QUEEN BRICK: LINTELS AT THIS CONDITION MAY BE 5"x3-1/2"x5/16"

NOTE: BRICK LINTELS AT SLOPED AREAS TO BE 4"x3-1/2"x1/4" STEEL ANGLE WITH 16D NAILS IN 3/16" HOLES IN 4" ANGLE LEG AT 12" OC TO TRIPLE RAFTER. WHEN THE SLOPE EXCEEDS 4:12 A MINIMUM OF 3"x3"x1/4" PLATES SHALL BE WELDED AT 24" OC ALONG THE STEEL ANGLE.





HAND

LEFT CAROLIN 2020 **PALAZZO**


20902056

11/11/2020

MCKEE HOMES

GENERAL NOTES

AWC

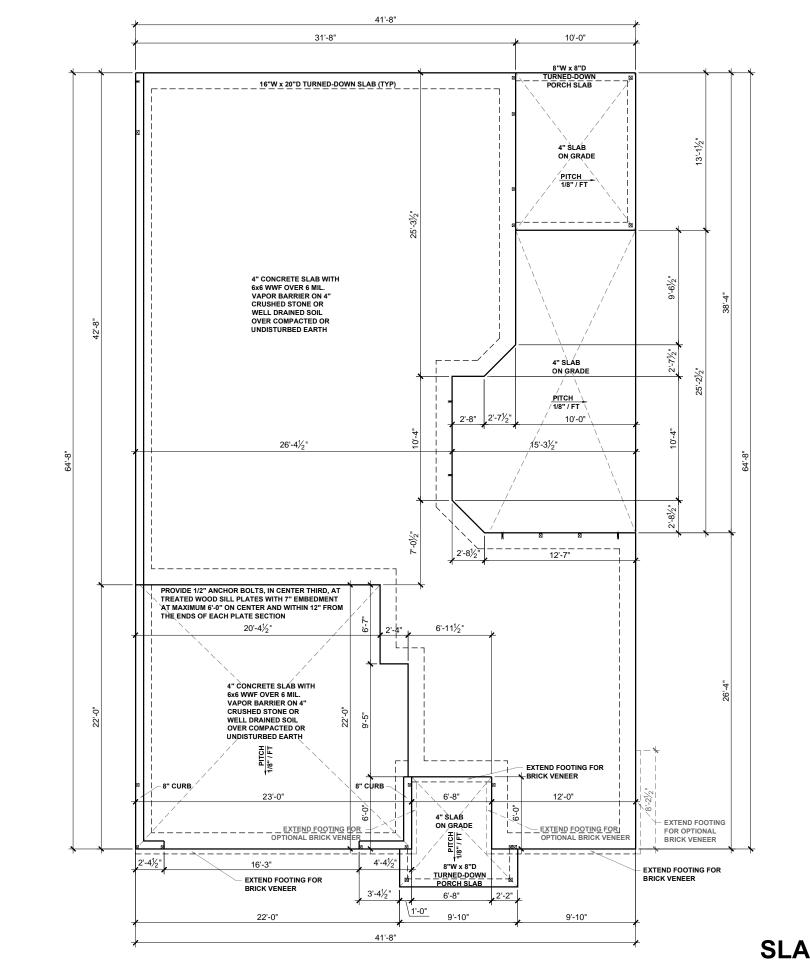

BEAM & POINT LOAD LEGEND

INTERIOR LOAD BEARING WALL

· - DOUBLE RAFTER / DOUBLE JOIST

WINDOW / DOOR HEADER


POINT LOAD TRANSFER

POINT LOAD FROM ABOVE BEARING ON BEAM / GIRDER

FOR WIND ZONES OF 120 MPH AND 130 MPH

-USE(3) #4 OR (2) #5 REBAR @ 3" ABOVE THE BOTTOM OF
THE FTG. THE BARS SHALL BE CONT. OR LAPPED 25"
@ ALL SPLICES. (TYP)

FOR WIND ZONES OF 120 MPH or ABOVE .USE1/2" ANCHOR BOLT AT 72" O.C. REFER TO R4504.2 FOR ADDITIONAL REQUIREMENTS AND SPACING



P-0961



DRAWN BY:

AWC

20902056

PALAZZO 2020


- LEFT HAND

11/11/2020

FOUNDATION PLAN

SLAB FOUNDATION PLAN - CLASSIC


SCALE: 1/8" = 1'-0"

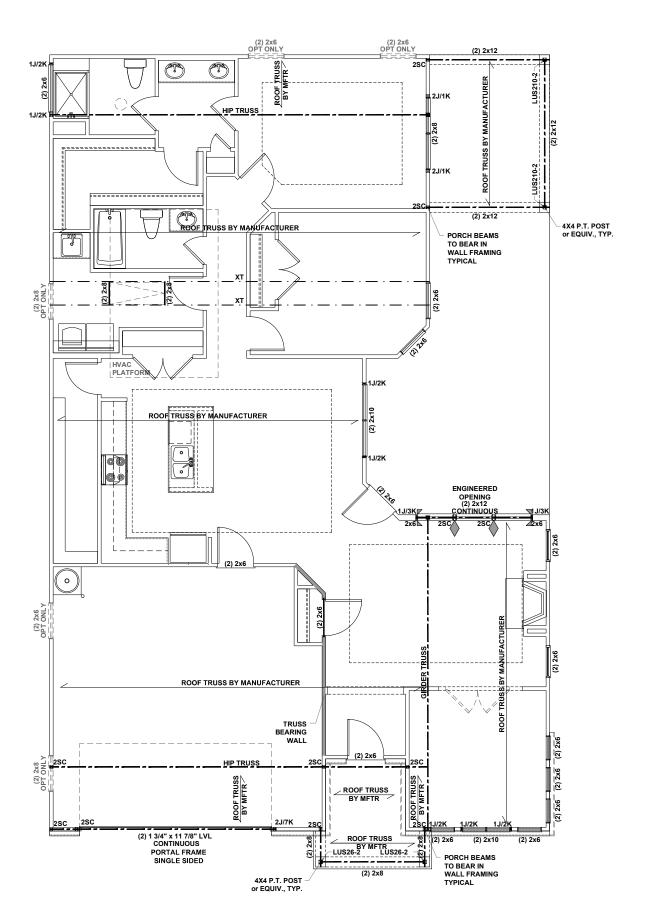



LCE4 BRACING CON.

- LCE4 CLIP TO HEADER JACK
 CONNECTION AND KBS1Z CLIP AT THE JACK BOTTOM PLATE CONNECTION
- CS16 STRAP FROM STUD, CROSS HEADER, TO WALL TOP PLATE, 36" LONG MIN.
- SIMPSON HTT4 HOLD DOWN FOR ATTACHMENT TO CONCRETE OR MSTA18 STRAP FOR WOOD



KBS1Z BRACING CON.

BEAM & POINT LOAD LEGEND

INTERIOR LOAD BEARING WALL

- - DOUBLE RAFTER / DOUBLE JOIST

WINDOW / DOOR HEADER POINT LOAD TRANSFER

BEARING ON BEAM / GIRDER

STRUCTURAL FRAMING NOTES - (SEE GENERAL NOTES SHEET FOR ADDITIONAL REQUIREMENTS.)

- w/ MIN (1) JACK AND (1) KING EACH END, UNO.
- MULTIPLE KING STUDS AS NOTED ON PLAN. ALL NON-BEARING HEADERS TO BE (2) 2x4 (1) J /
- PROVIDE CONTINUOUS BLOCKING THROUGH
- STRUCTURE FOR ALL POINT LOADS.
- ALL HANGERS AND CONNECTORS SPECIFIED ARE TO BE SIMPSON STRONG-TIE OR EQUIVALENT.
- ALL BEAMS SPECIFIED ARE MINIMUM SIZES ONLY. LARGER MEMBERS MAY SUBSTITUTED AS NEEDED FOR EASE OF CONSTRUCTION. MINIMUM
- ALL EXTERIOR WALLS TO BE FULLY SHEATHED
- FRONT PORCH COLUMNS TO BE MIN 4x4 PT ATTACHED AT TOP AND BOTTOM USING SIMPSON (OR FOLIV) COLUMN BASE OR SST A24 BRACKETS. TRIM OUT PER BUILDER.
- PORCH COLUMNS TO BE MIN 4x4 PT ATTACHED AT BOTTOM USING SIMPSON (OR EQUIV) ABA44 AND AT TOP USING CS 16 STRAPPING (12" MIN) TO PORCH HEADER / BAND.
- WHEN A 4-PLY LVL IS USED, ATTACH WITH (1) 1/2" Ø BOLT 12" OC STAGGERED, TOP AND BOTTOM, 1-1/2" MIN FROM ENDS. ALTERNATE ATTACHMENT EQUIVALENT METHOD MAY BE USED, SUCH AS SDW OR TRUSSLOK SCREWS (SEE MANUFACTURER'S SPECIFICATIONS)
- FOR STUD COLUMNS OF 4 OR MORE. INSTALL SST CS16 STRAPS @ 30" OC, 6" MAX FROM PLATES, ON INSIDE FACE OF COLUMN (EXTERIOR WALL), ON BOTH FACES OF COLUMN (INTERIOR WALL).

I-JOIST SPACING NOT TO EXCEED 19.2" OC IN LOCATIONS WITH TILE FINISH FLOOR


**REFER TO I-JOIST EQUIVALENCE CHART ON I-JOIST DETAIL SHEET FOR SUBSTITUTION OF MANUFACTURER SERIES

FLOOR FRAMING TO BE 14" DEEP TJI 210 SERIES OR EQUAL, 19.2" OC MAXIMUM SPACING -OR-

FLOOR FRAMING TO BE 14" DEEP FLOOR TRUSSES, 19.2" OC MAXIMUM SPACING

OPTIONAL FRENCH DOORS AT 4 SEASONS ROOM DO NOT AFFECT STRUCTURE

BATH 2 OPTION DOES NOT AFFECT STRUCTURE



P-0961



AWC

20902056

LEFT

2020


PALAZZO

11/11/2020

FIRST FLOOR CEILING FRAMING PLAN

FIRST FLOOR CEILING FRAMING PLAN - CLASSIC

SCALE: 1/8" = 1'-0"

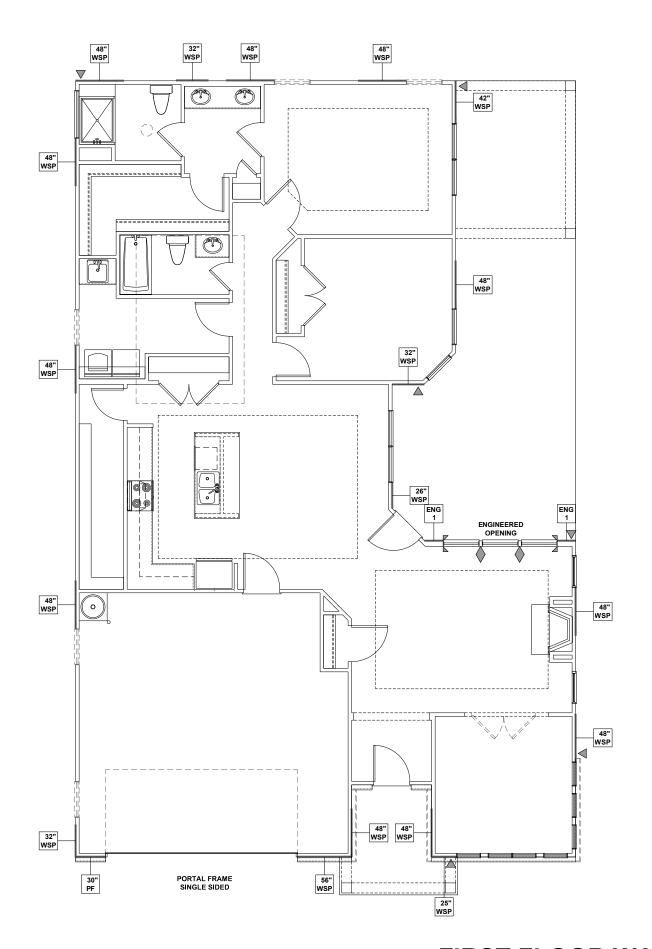




LCE4 BRACING CON.

■ LCE4 CLIP TO HEADER JACK
■ CONNECTION AND KB51Z CLIP AT THE JACK BOTTOM PLATE CONNECTION

CS16 STRAP FROM STUD, CROSS HEADER, TO WALL TOP PLATE, 36" LONG MIN.

SIMPSON HTT4 HOLD DOWN FOR ATTACHMENT TO CONCRETE OR MSTA18 STRAP FOR WOOD CONNECTIONS.



KBS1Z BRACING CON.

WALL BRACING REQUIREMENTS

- MINIMUM PANEL WIDTH IS 24" FIGURES BASED ON THE CONTINUOUS SHEATHING METHOD USING THE RECTANGLE CIRCUMSCRIBED AROUND THE FLOOR PLAN OR PORTION OF THE FLOOR PLAN. IF NO RECTANGLE IS NOTED. THE STRUCTURE HAS BEEN FIGURED ALL WITHIN ONE RECTANGLE.
- PANELS MAY SHIFT UP TO 36" EITHER DIRECTION FOR EASE OF CONSTRUCTION (NAILING & BLOCK REQUIREMENTS STILL APPLY).
- FOR ADDITIONAL WALL BRACING INFORMATION, REFER TO WALL BRACING DETAIL SHEET(S). - SCHEMATIC BELOW INDICATES HOW SIDES OF RECTANGLE ARE TO BE INTERPRETED IN BRACING CHART WHEN APPLIED TO STRUCTURE:



CS16 STRAP FROM STUD, CROSS HEADER, TO WALL TOP PLATE, 36" LONG MINIMUM

SIMPSON MSTA15 HOLD DOWN CAPACITY OF 970 POUNDS PER ANCHOR WITH (12) 10d NAILS. STRAF TO BE LOCATED AT EDGE OF BRACED WALL PANEL. (CS16 STRAPPING MAY BE SUBSTITUTED w/ SIMILAR LENGTH AND NAILING PATTERN.) USE HTT4 FOR ATTACHMENT TO CONCRETE.

NUMERICAL LENGTH SCALED LENGTH OF WALL PANEL
AT LOCATION — OF PANEL PANEL TYPE

ENGINEERED WALL SCHEDULE

ENG1: CONTINUOUSLY SHEATH WITH 7/16" OSB ATTACHED WITH 8d NAILS @ 6" OC EDGE AND 12" OC FIELD. FULLY BLOCKED AT ALL PANEL

ENG2: CONTINUOUSLY SHEATH WITH 7/16" OSB WITH 10d NAILS @ 3" OC EDGE AND 3" OC FIELD. FULLY BLOCKED AT ALL PANEL EDGES

ENG3: CONTINUOUSLY SHEATH 7/16" OSB ATTACHED
BOTH SIDES WITH 8d NAILS @ 4" OC EDGE
AND 8" OC FIELD. FULLY BLOCKED AT ALL

ENG4: CONTINUOUSLY SHEATH 7/16" OSB ATTACHED WITH 8d NAILS @ 4" OC EDGE AND 8" OC FIELD. FULLY BLOCKED AT ALL PANEL EDGES.

WALL BRACING NOTE:


WALLS WITH REQUIRED LENGTH LISTED AS "N/A" DO NOT MEET THE REQUIREMENTS OF PRESCRIPTIVE WALL BRACING FOUND IN THE NCRC. THESE WALLS HAVE BEEN ENGINEERED BASED ON DESIGN
GUIDELINES ESTABLISHED IN ASCE-07 AND THE NDS WIND & SEISMIC PROVISIONS SUPPLEMENT.

WALL BRACING: RECTANGLE 1

SIDE	REQUIRED LENGTH	PROVIDED LENGTH
FRONT	12.5 FT.	12.6 FT.
RIGHT	8.4 FT.	17.7 FT.
REAR	12.5 FT.	14.7 FT.
LEFT	8.4 FT.	14.7 FT.

HIGH-SPEED WIND ZONES

FOR LOCATIONS OF 130 MPH OR MORE LTIMATE DESIGN WIND SPEED WALLS SHALL BE BRACED PER THE LATEST ADOPTED EDITION OF THE AMERICAN SOCIETY OF CIVIL ENGINEERS PUBLICATION ASCE 7 OR STANDARD FOR RESIDENTIAL CONSTRUCTION IN HIGH-WIND REGIONS (ICC 600).



P-0961



- LEFT HAND

PALAZZO 2020

AWC


20902056

11/11/2020

MCKEE HOMES

FIRST FLOOR WALL BRACING PLAN

FIRST FLOOR WALL BRACING PLAN - CLASSIC SCALE: 1/8" = 1'-0" LAYOUTS AND SPECIFICATIONS FOR NON-HIGH WINDS LOCATIONS ONLY

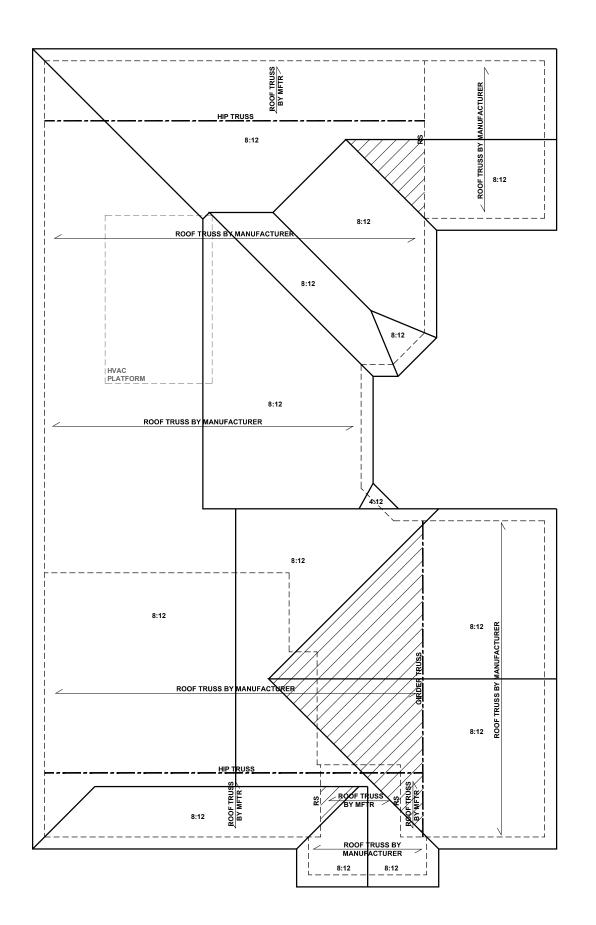

ROOF FRAMING PLAN - CLASSIC

SCALE: 1/8" = 1'-0"

BEAM & POINT LOAD LEGEND

INTERIOR LOAD BEARING WALL

······ DOUBLE RAFTER / DOUBLE JOIST

---- STRUCTURAL BEAM / GIRDER

WINDOW / DOOR HEADER POINT LOAD TRANSFER

BEARING ON BEAM / GIRDER

TRUSSED ROOF - STRUCTURAL NOTES

PROVIDE CONTINUOUS BLOCKING THROUGH STRUCTURE FOR ALL POINT LOADS.

DENOTES OVER-FRAMED AREA

- 4. TRUSS LAYOUT AND PLACEMENT BY MANUFACTURER TO COINCIDE WITH THE SUPPORT LOCATIONS SHOWN. TRUSS PROFILES SHALL BE SEALED BY THE TRUSS MANUFACTURER. TRUSS PLANS TO BE COORDINATED WITH THE SEALED STRUCTURAL ACCORDANCE WITH THE MANUFACTURER'S
- . MANUFACTURER TO PROVIDE REQUIRED UPLIFT
- PROVIDE H2.5A (MINIMUM) OR EQUIVALENT AT EACH TRUSS-TO-TOP PLATE CONNECTION AT OVER-FRAMED AREAS, UNLESS NOTED
- UPLIFT CONNECTION TO BE CARRIED THROUGH TO FLOOR SYSTEM.

ATTIC VENTILATION - SIDE LOAD

THE TOTAL NET-FREE VENTILATION AREA SHALL NOT BE LESS THAN 1/150 OF THE AREA OF THE ATTIC SPACE TO BE VENTILATED. THE TOTAL VENTILATION MAY BE REDUCED TO 1/300 PROVIDED AT LEAST 50% BUT NOT MORE THAN 80% OF THE REQUIRED **VENTILATION BE LOCATED IN THE UPPER PORTION OF** THE AREA TO BE VENTILATED, OR AT LEAST 3'
ABOVE THE SOFFIT VENTILATION INTAKE.

2405 SQUARE FEET OF TOTAL ATTIC / 150 =

TRUSSES SHALL BE ATTACHED TO SUPPORT WALL FOR UPLIFT RESISTANCE. CONTINUOUS OSB WALL SHEATHING BELOW PROVIDES CONTINUOUS UPLIFT RESISTANCE TO FOUNDATION. ALL TRUSSES SUPPORTED BY INTERMEDIATE SUPPORT WALLS, KNEEWALLS, OR BEAMS SHALL BE ATTACHED TO

ROOF SPAN IS MEASURED HORIZONTALLY BETWEEN FURTHEST SUPPORT POINTS.

OVER 28'

CONNECTOR NAILING PER TABLE 602.3(1)


NCRBC 2018 EDITION

(1) SIMPSON H2.5A HURRICANE

CLIP TO DBL TOP PLATE OR BEAM

OR (1) SIMPSON H3 CLIP TO SINGLE 2x4 PLATE

SEE HIGH WINDS DETAILS FOR ADDITIONAL FORMATION IF CONSTRUCTED IN HIGH WINDS AREA





AWC


PALAZZO 2020


20902056


- LEFT


11/11/2020


ROOF FRAMING PLAN

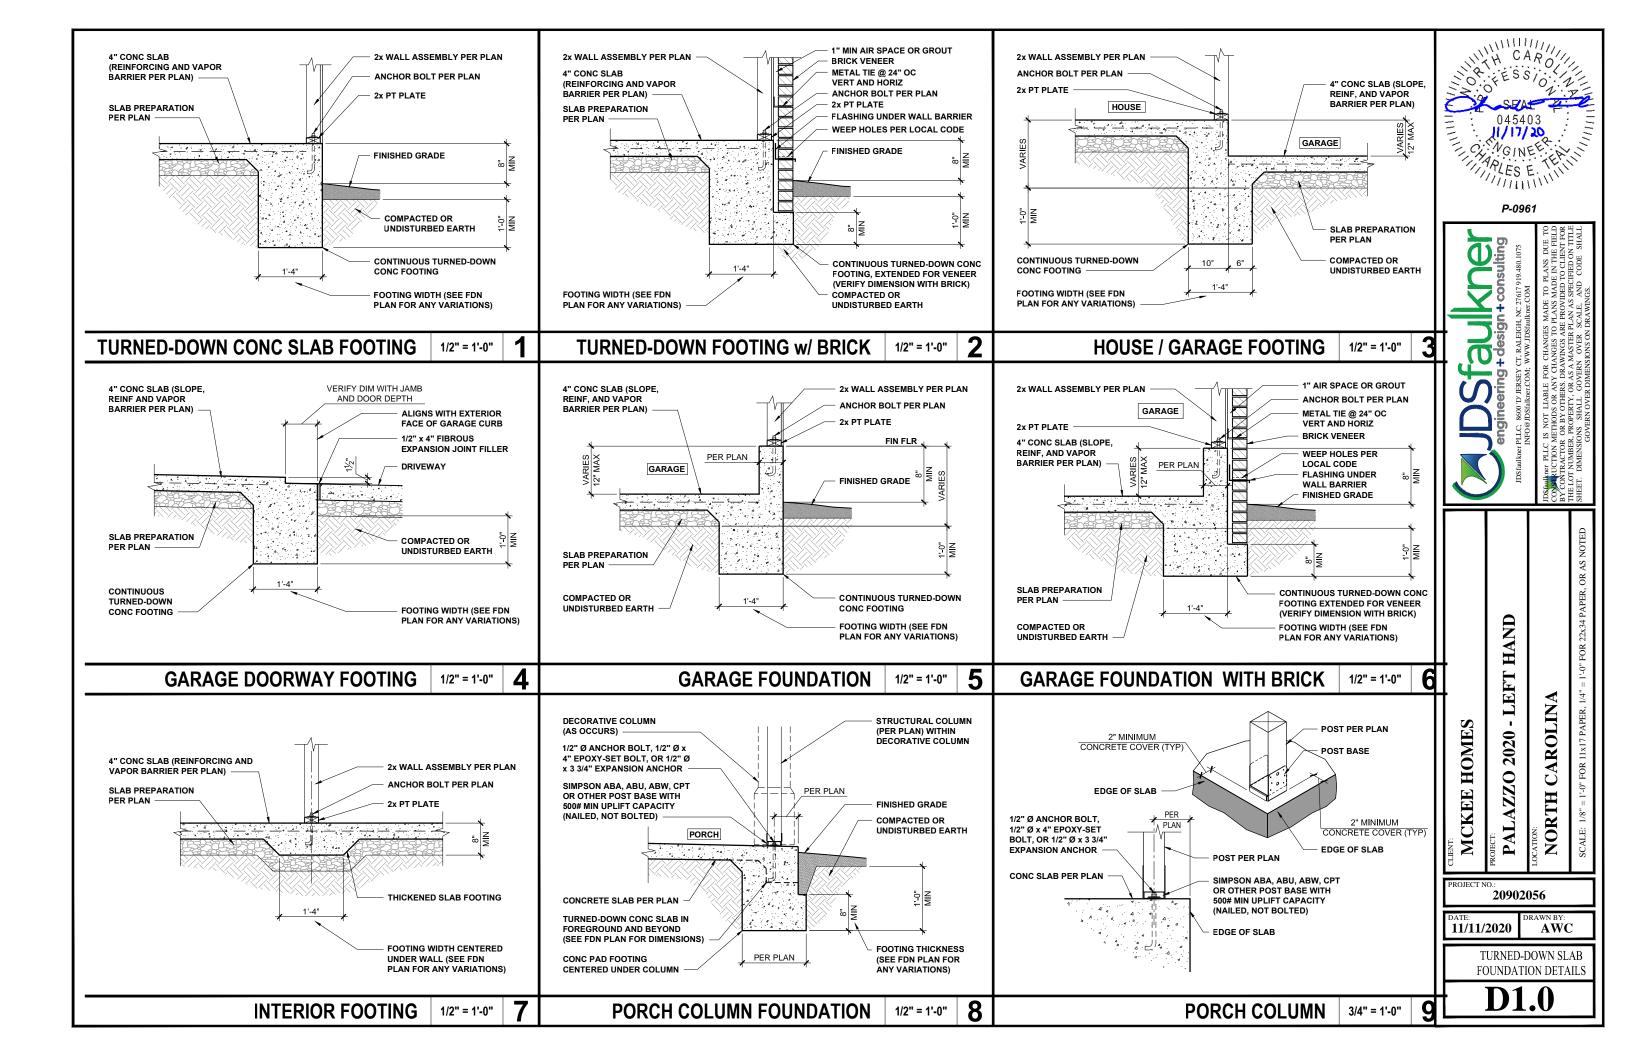


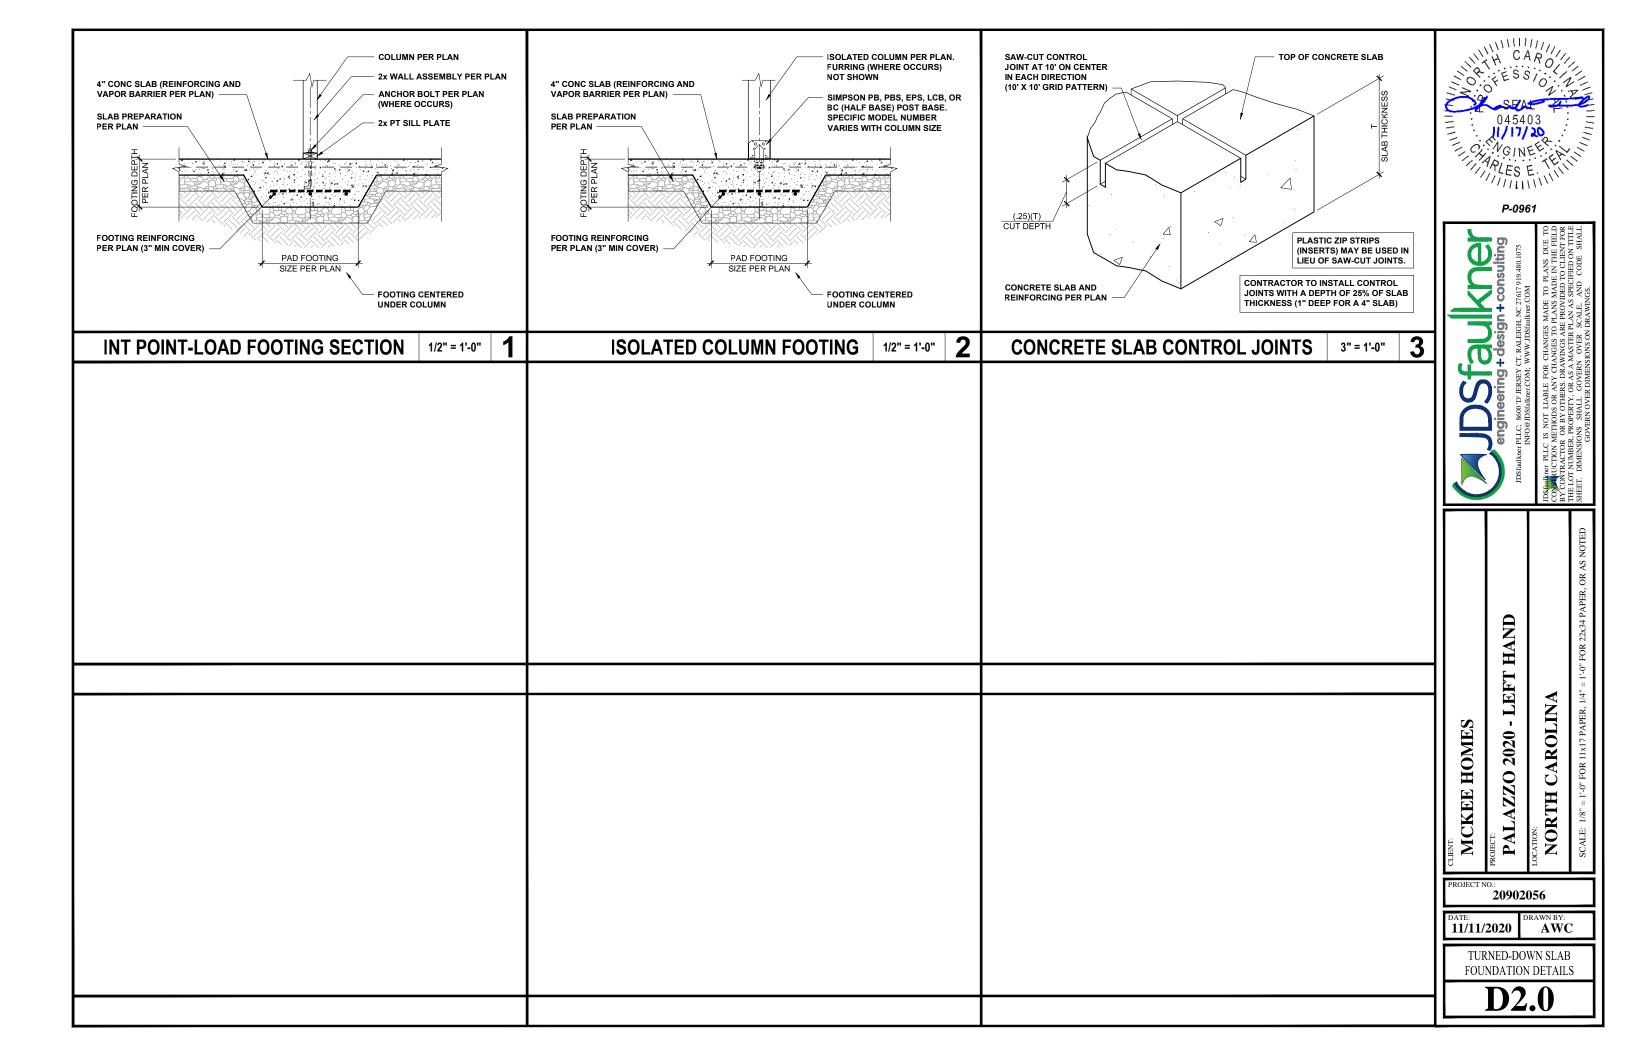


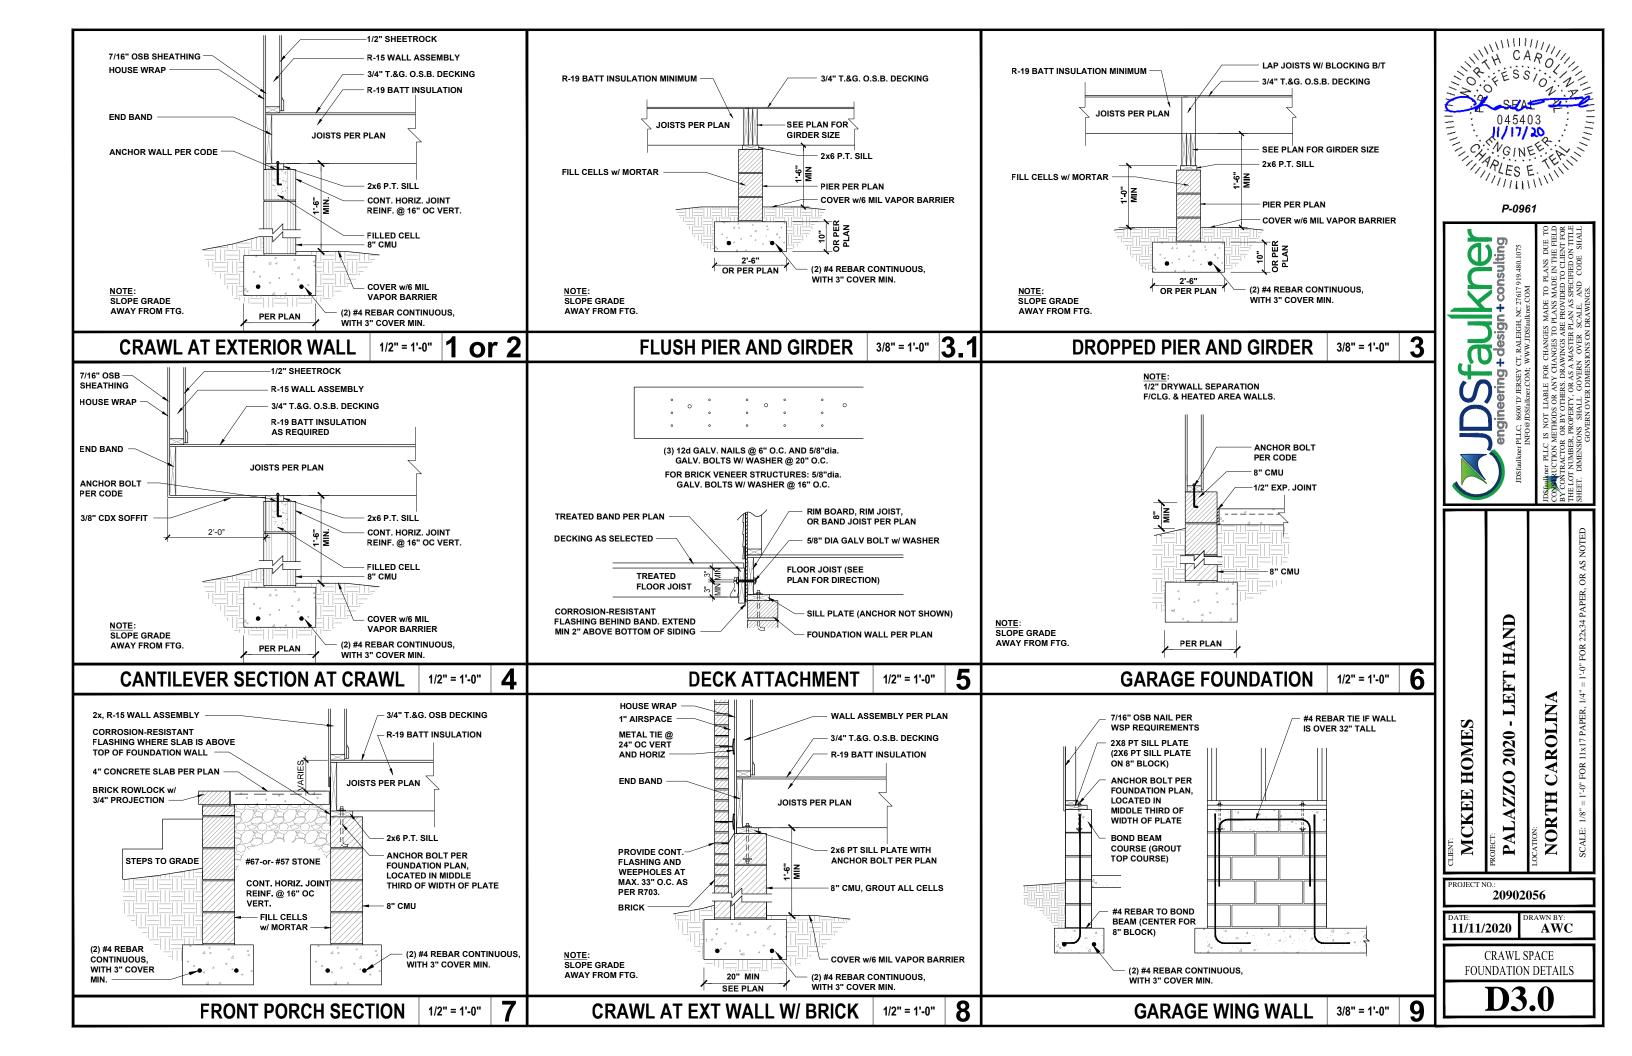


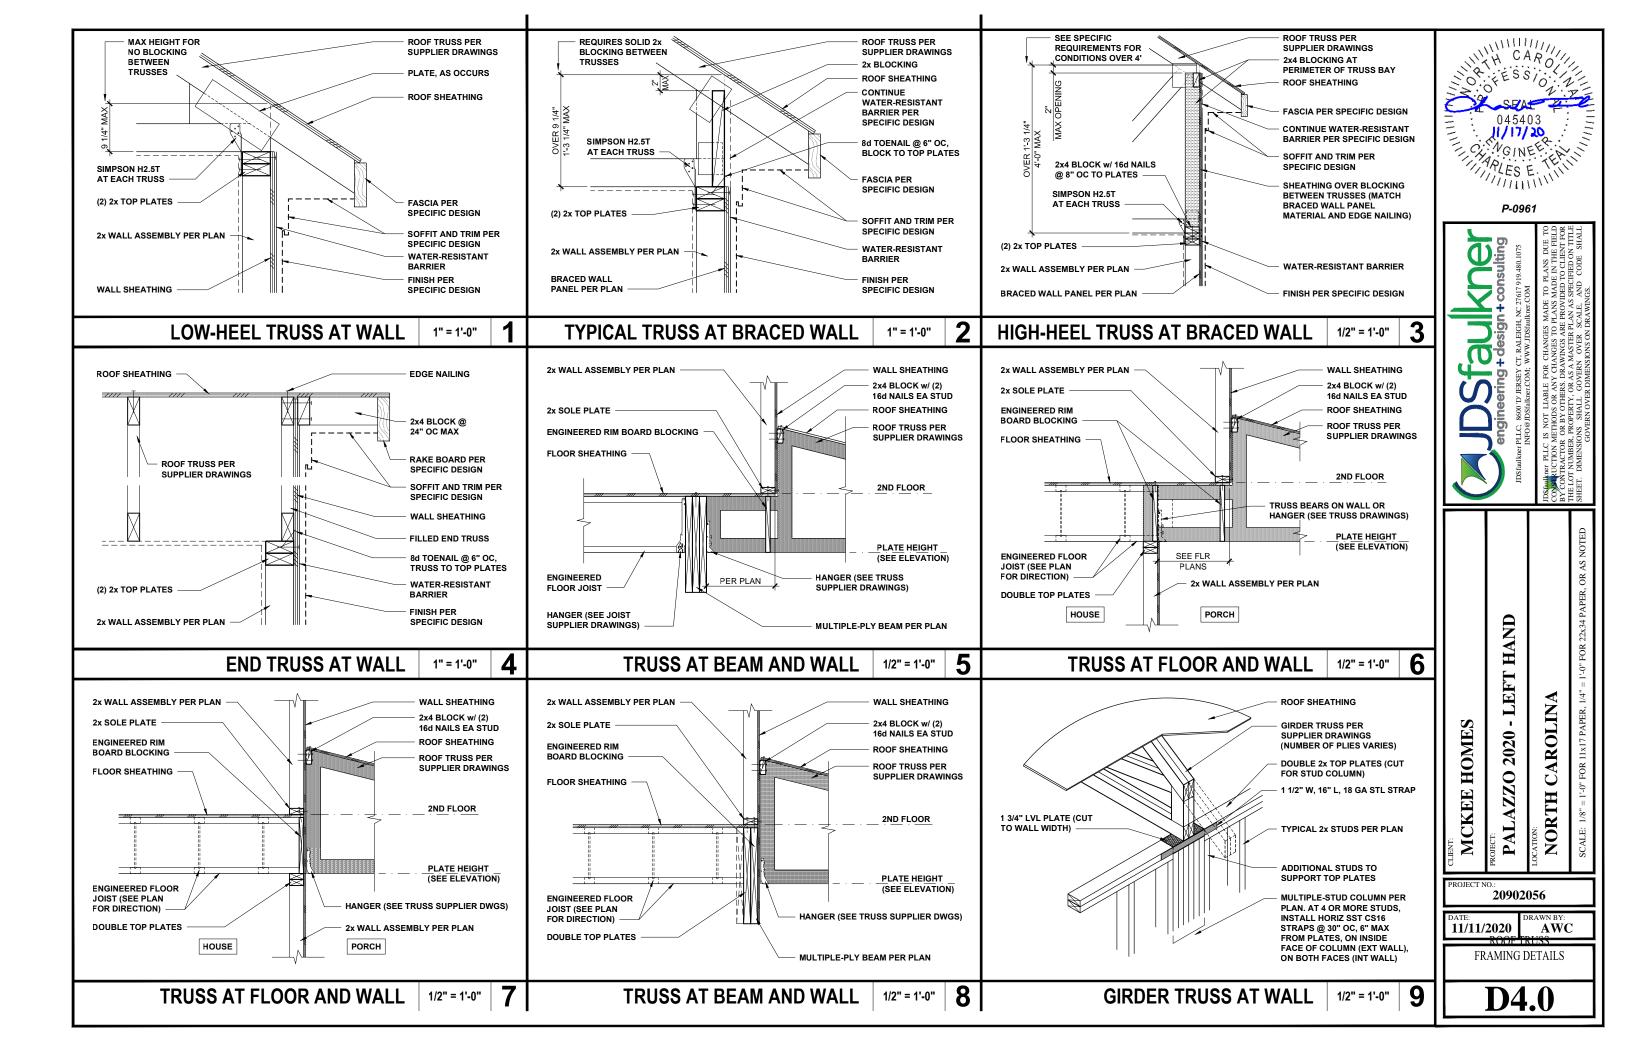


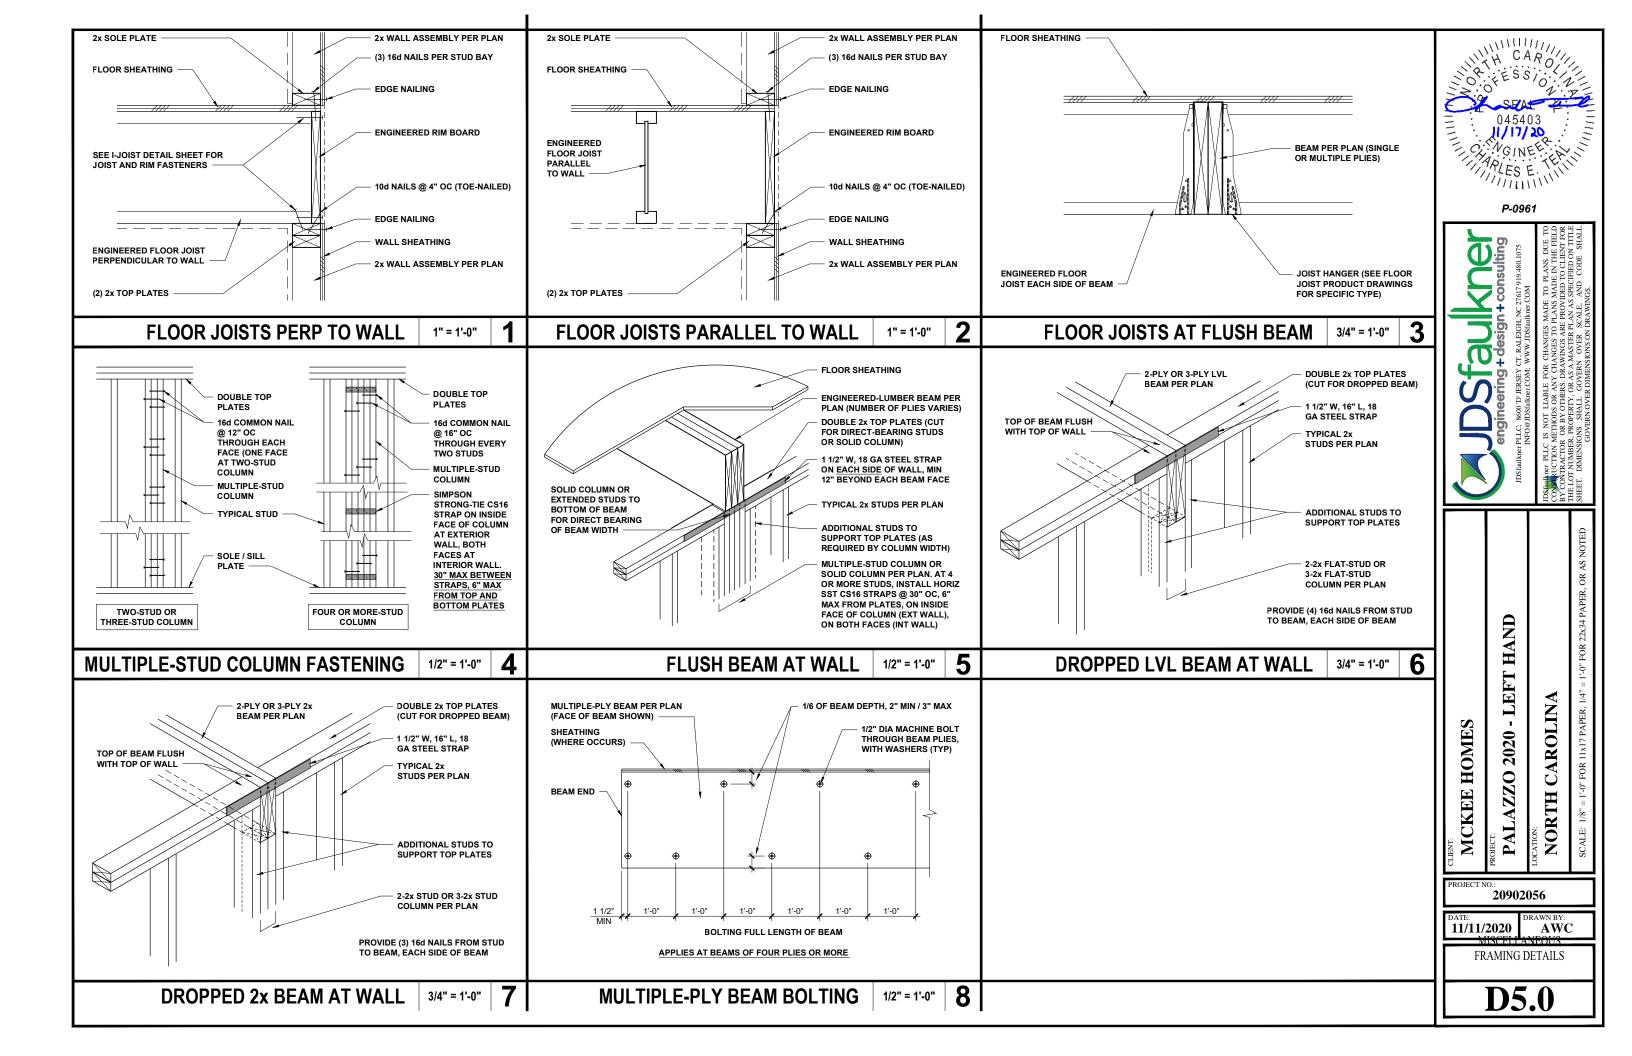

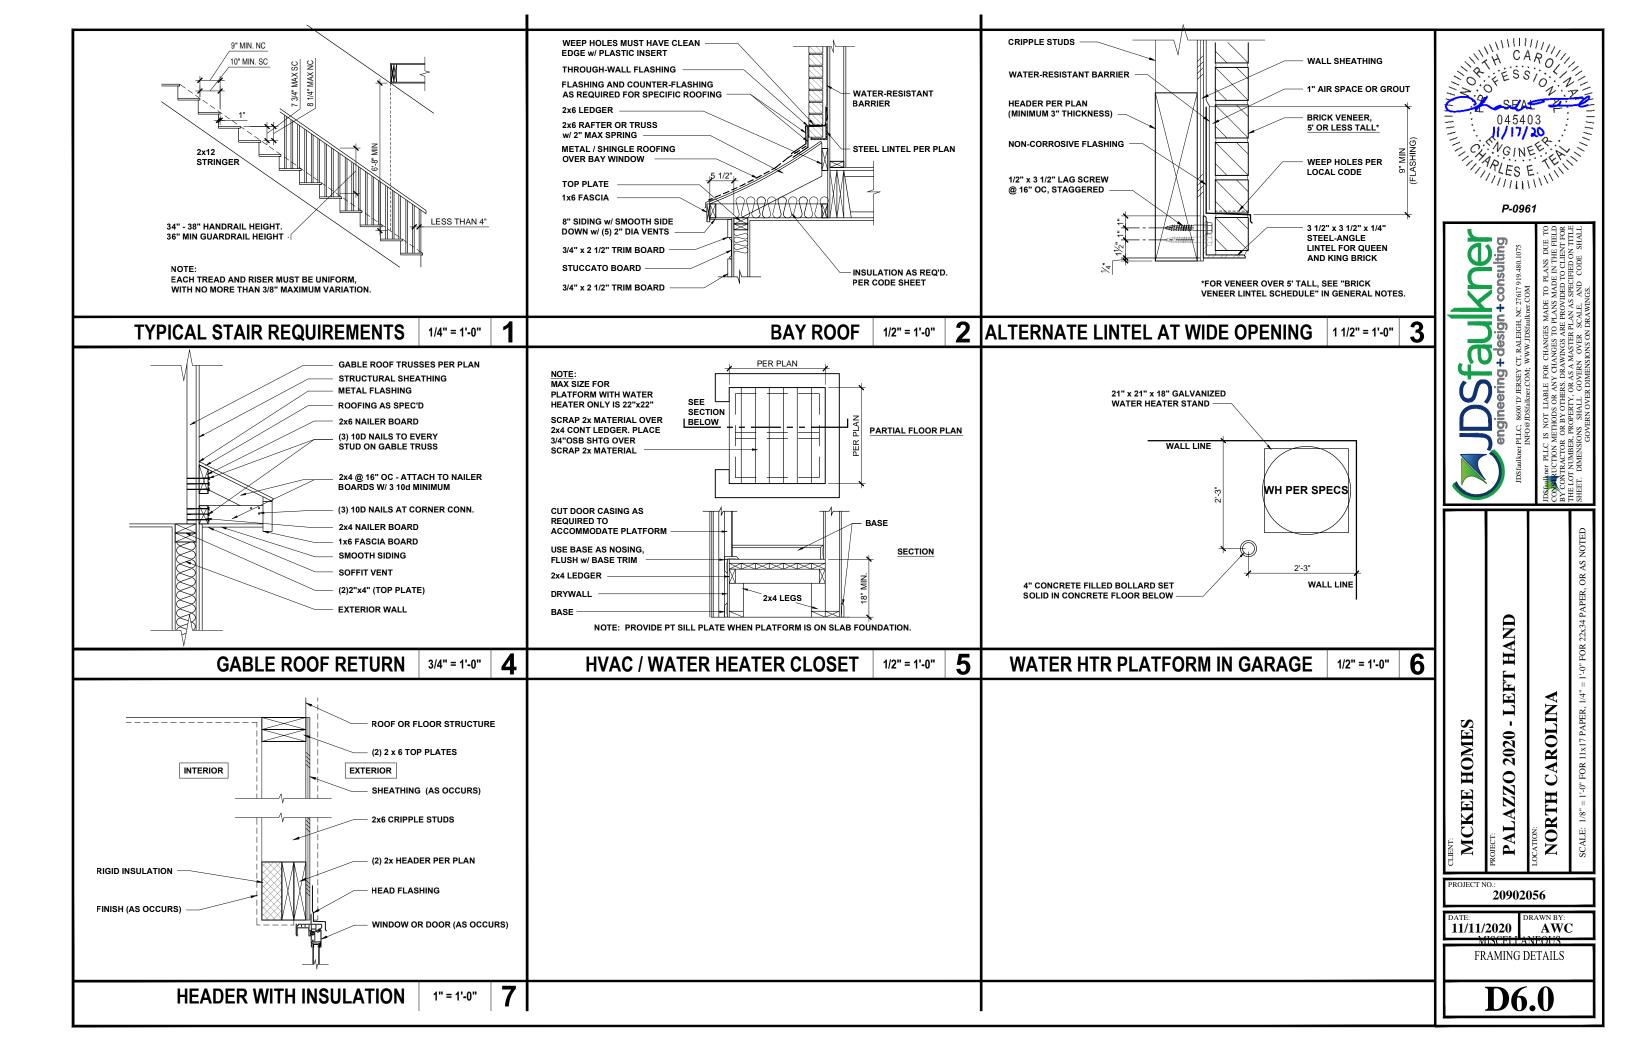

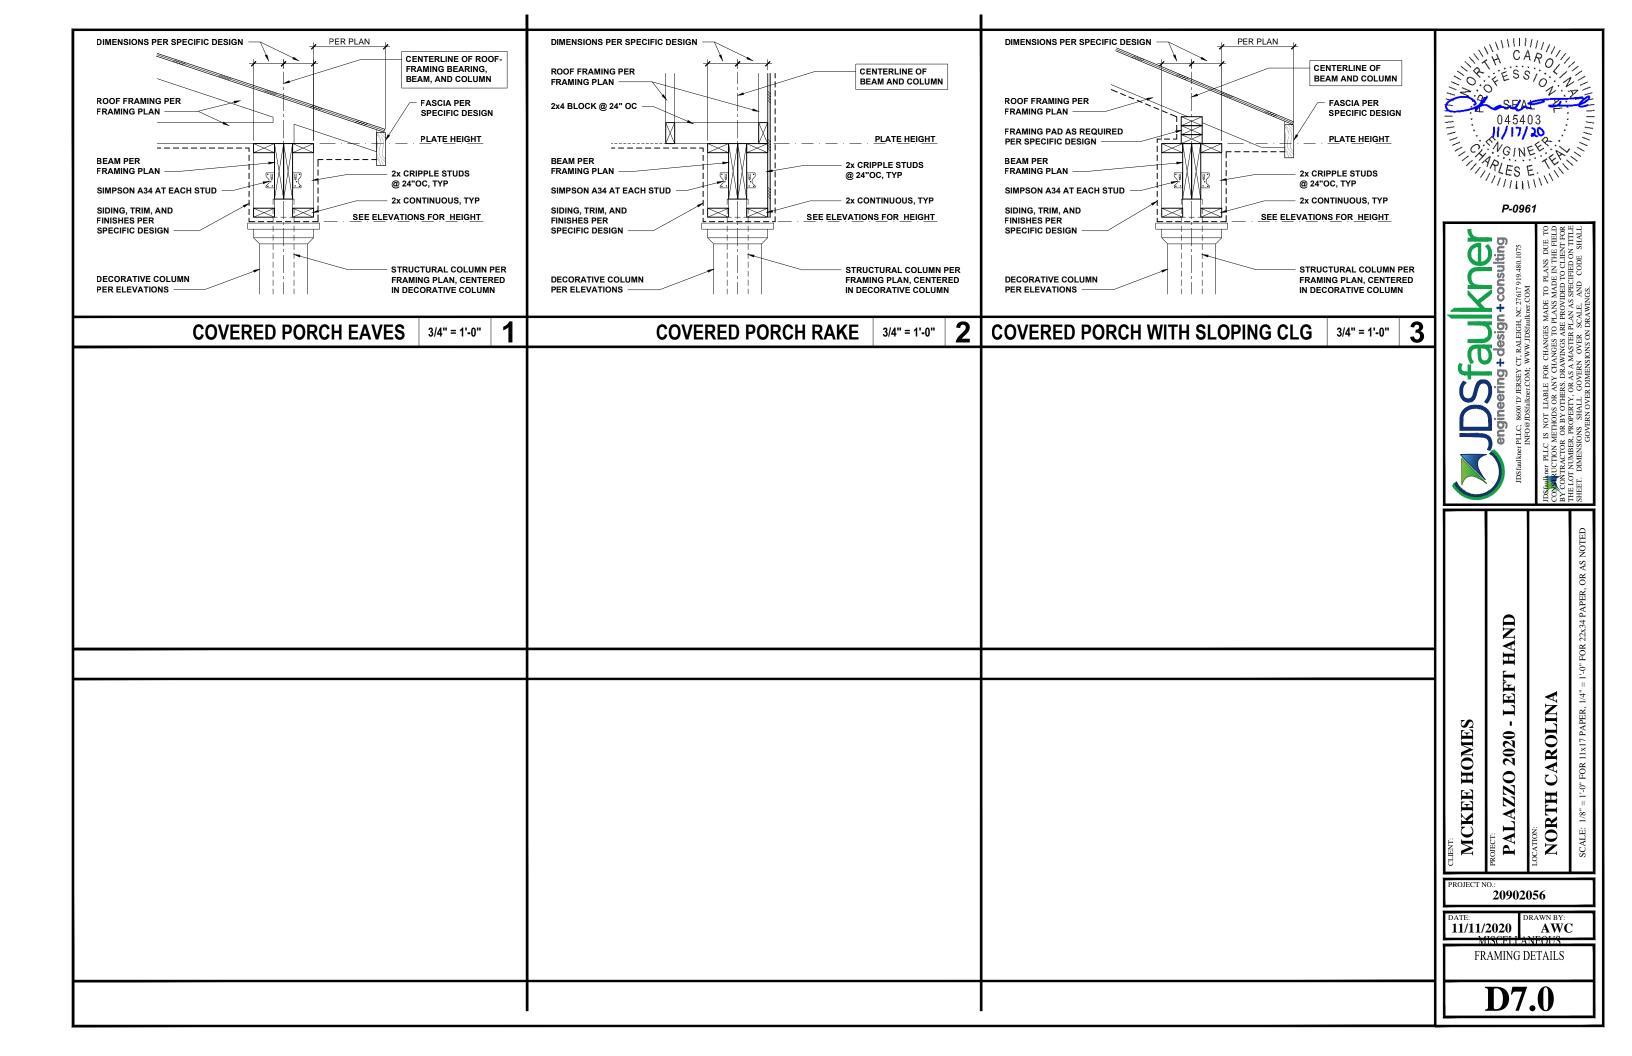

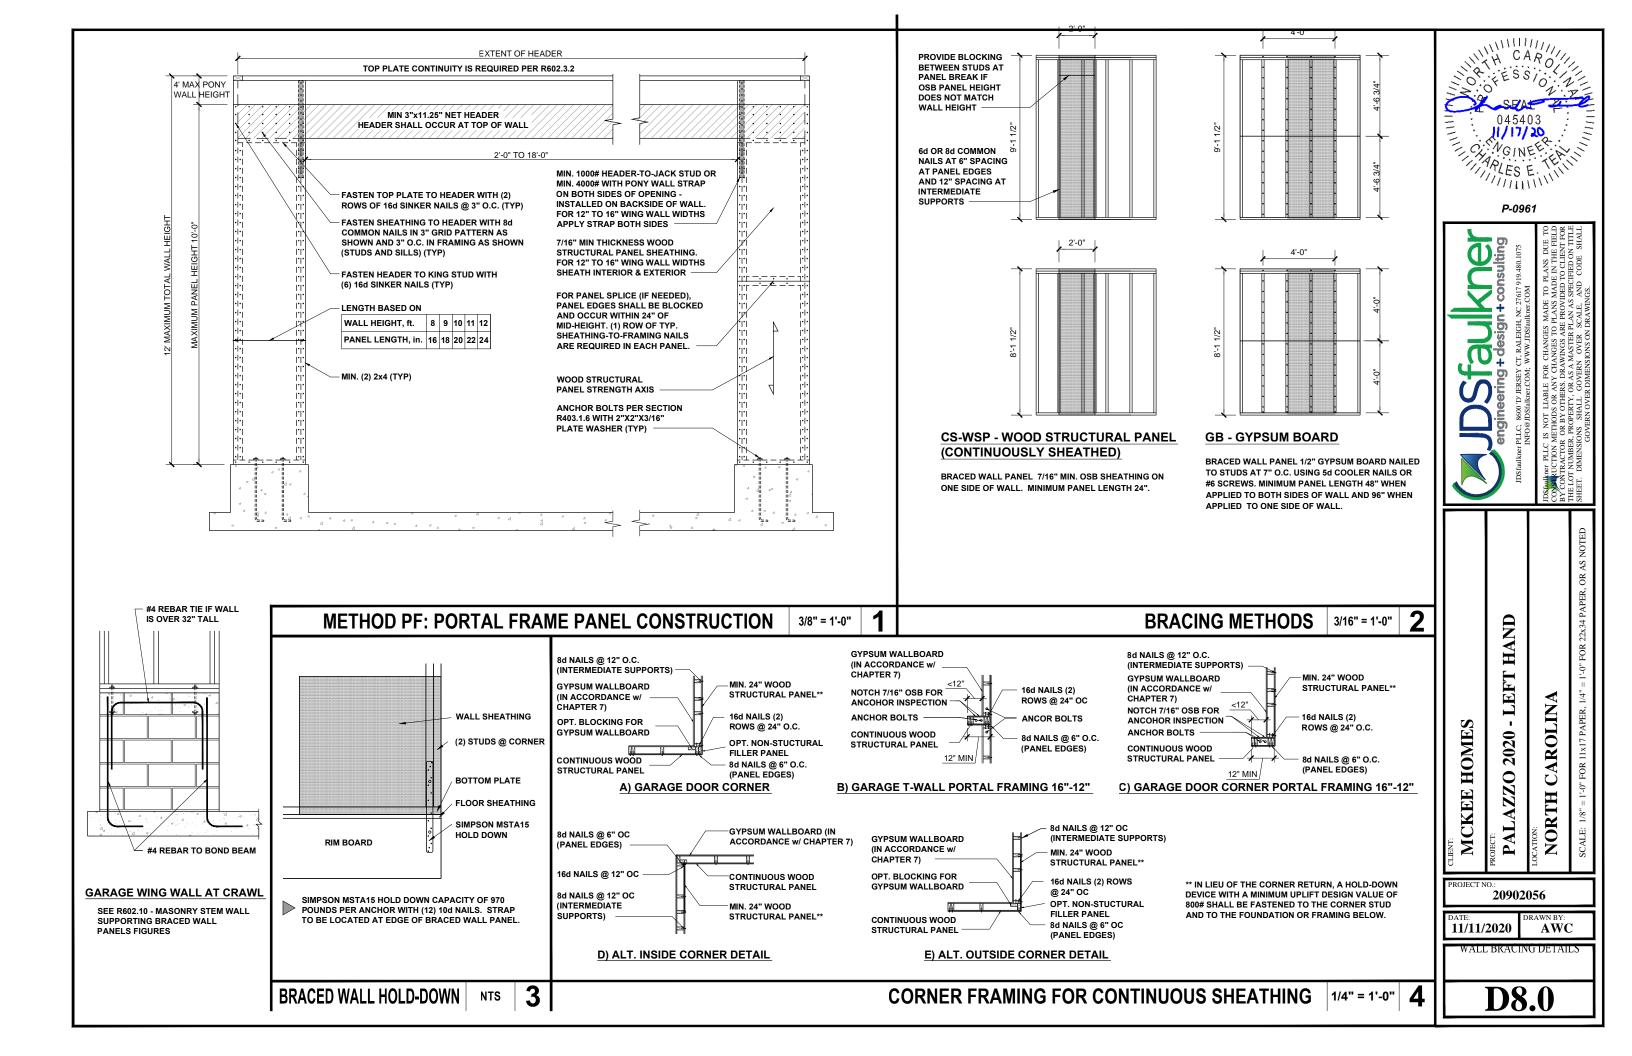

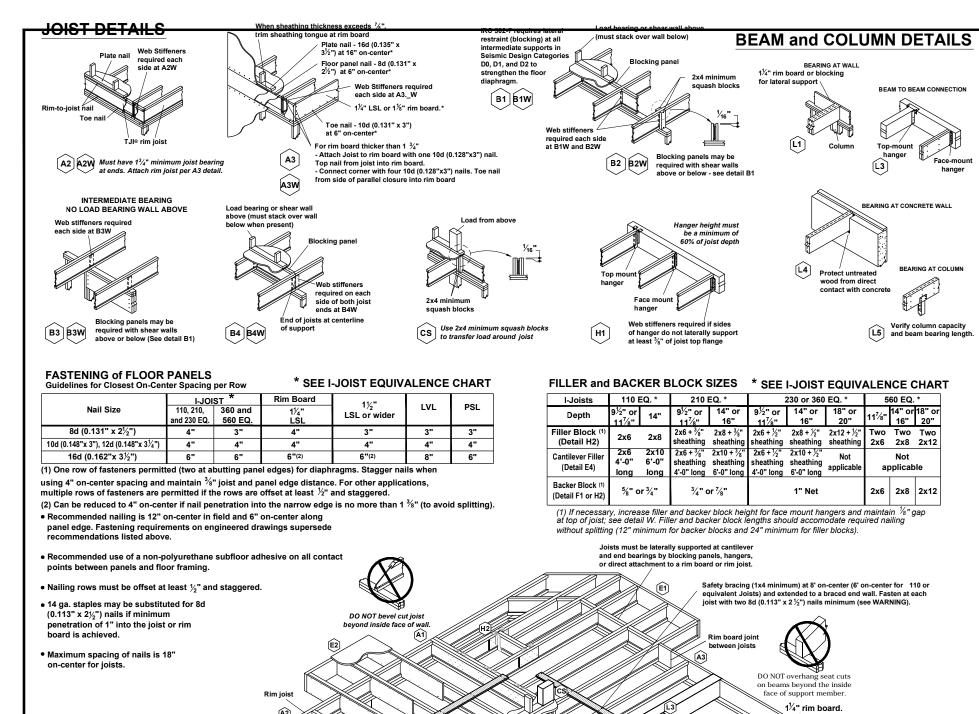

Use B1 or B2 at

see note 3 under

it may shrink after

installation. Use only

DO NOT 11

<u>(15)</u>

P

End of joists at

wood from direct

1%" knockouts at

face of wall or beam


INSTALLATION TIPS

Subfloor adhesive will improve floor performance, but may not be required.

Squash blocks and blocking panels carry stacked vertical loads (details B1 and B2). Packing out the web of a joist (with web stiffeners) is not a substitute for squash blocks or blocking panels.


When joists are doubled at non-load bearing parallel partitions, space joists apart the width of the wall for plumbing or HVAC.

Additional joist at plumbing drop (see detail).



* I-JOIST EQUIVALENCY CHART

EQUIVALENT IN SPAN AND SPACING			
Depth	Mftr & Series	Mftr & Series	Mftr & Series
	TJI - 110	BCI 4500	
9 4"	TJI - 210	BCI 5000	
•	TJI - 230	BCI 6000	EverEdge 20
		BCI 6500	
	TJI - 110	BCI 4500	
	TJI - 210	BCI 5000	
11 ⁷ 8"	TJI - 230	BCI 6000	EverEdge 20
		BCI 6500	
	TJI - 360	BCI 60'S	EverEdge 30
	TJI - 560	BCI 90'S	EverEdge 50/60
	TJI - 110	BCI 4500	
	TJI - 210	BCI 5000	
14"	TJI - 230	BCI 6000	EverEdge 20
		BCI 6500	
	TJI - 360	BCI 60'S	EverEdge 30
	TJI - 560	BCI 90'S	EverEdge 50/60
	TJI - 110	BCI 4500	
	TJI - 210	BCI 5000	
16"	TJI - 230	BCI 6000	EverEdge 20
	·	BCI 6500	
	TJI - 360	BCI 60'S	EverEdge 30
- [TJI - 560	BCI 90'S	EverEdge 50/60

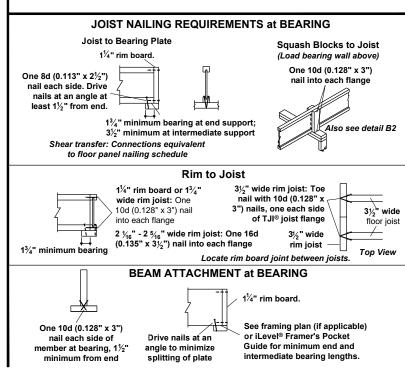



P-0961



AROLIN

じ

20902056

LEFT

2020

ALAZZO

4

CKEE

11/11/2020 AWC

DETAILS

