Crossing at Anderson Creek 161- 39 Lake Crest Drive, Spring Lake, 28390 Harnett County Created: 1/8/2021

House Plan: Braxton Elevation: B Stone/Brick Option: #1 Foundation: Slab Foundation Finish: 3 Sides Parged Garage Hand: Left Garage: 2 Car Front Garage Door:(1) 16x8 Front Porch: Concrete Roof: Truss Siding: Vinyl Ceiling Height 1st Floor: 9' Ceiling Height 2nd Floor: 9' Door Frame Height 1st Floor: 83" Door Frame Height 2nd Floor: 83" Windows 1st Floor: 6/0 Front, 5/0 rear/sides Windows 2nd Floor: 5/0





# OPTIONS


Covered Porch Bedroom #4 Trey Ceiling in Master Bedroom Trey Ceiling in Dining Room

Total Heated Sq. Ft.: 2216 Total Unheated Sq. Ft.: 810 Total SQ FT: 3026

Bedrooms: 4 Full Bathrooms: 2 Half Bathrooms: 1

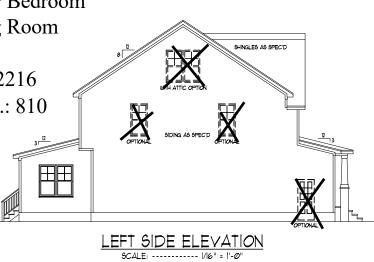





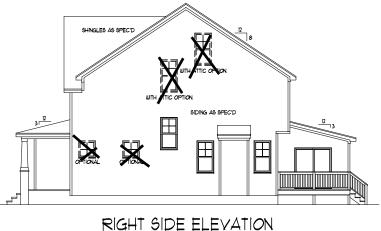


GHI SIDE ELEVAI 9CALE: ------ 1/16" = 1'-0"






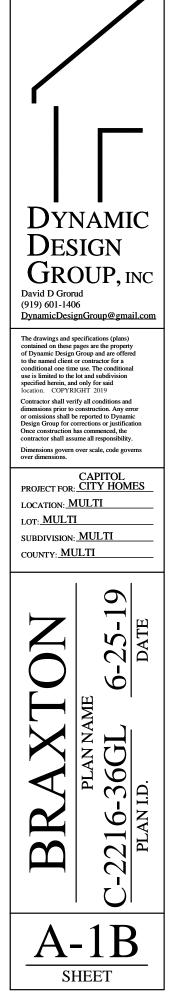


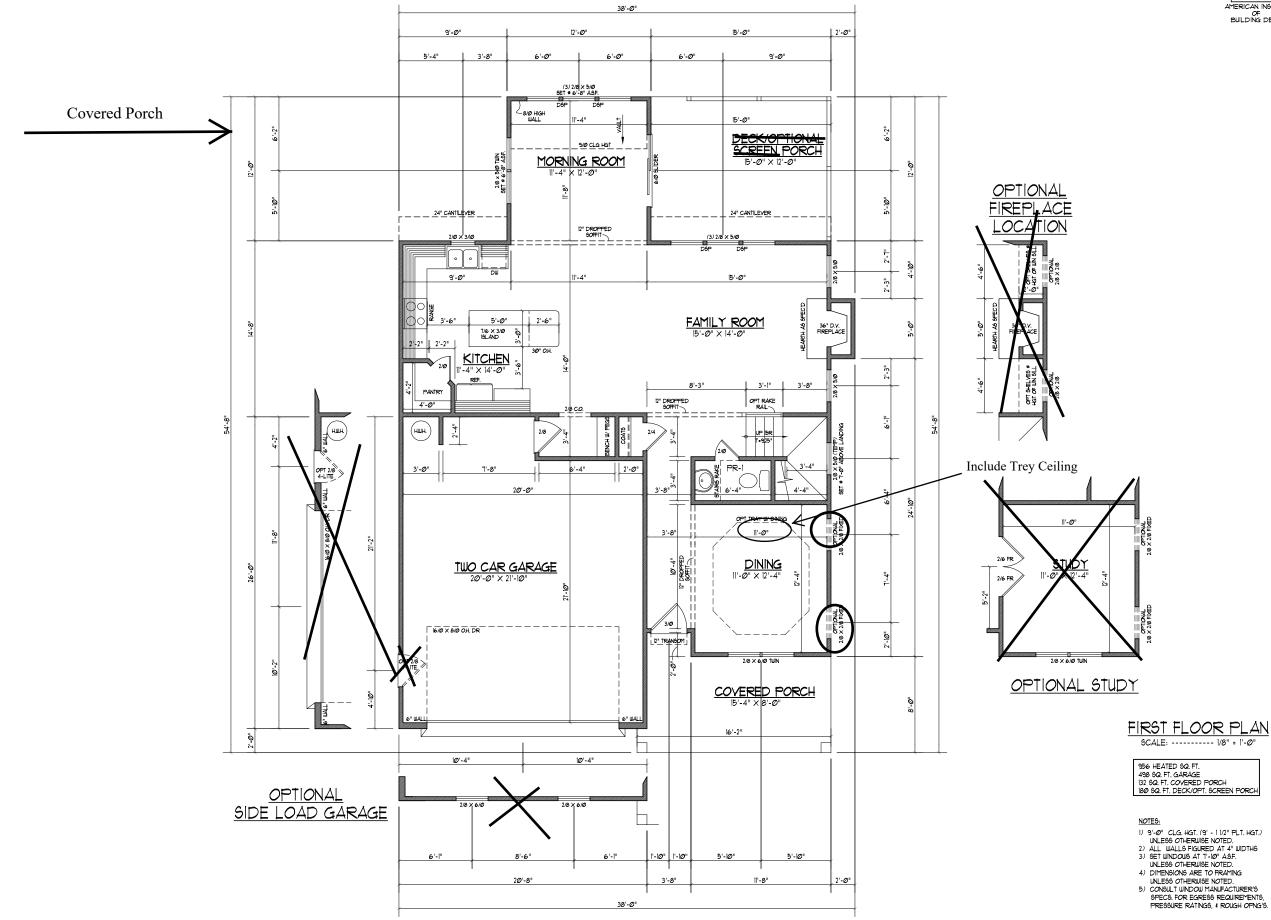




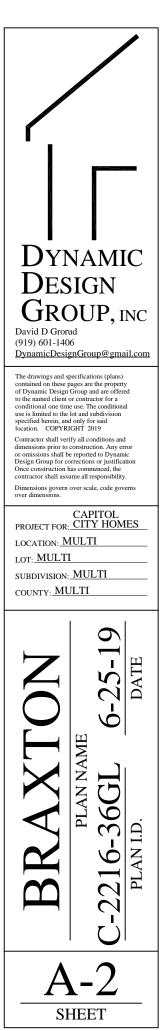


# OPT SCREEN PORCH/BBQ DECK

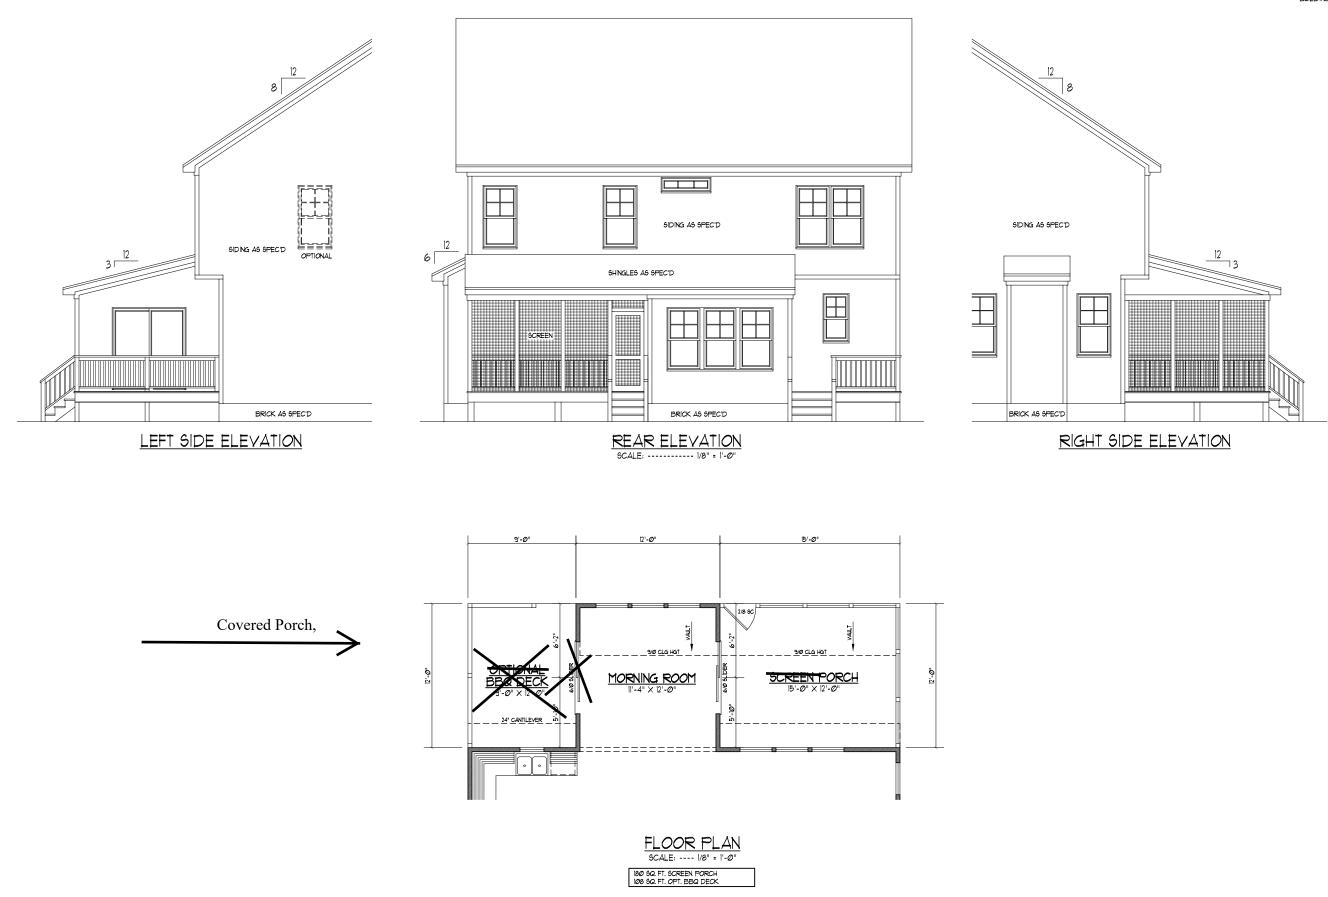





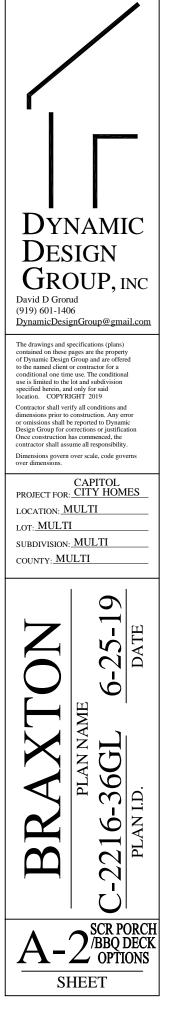

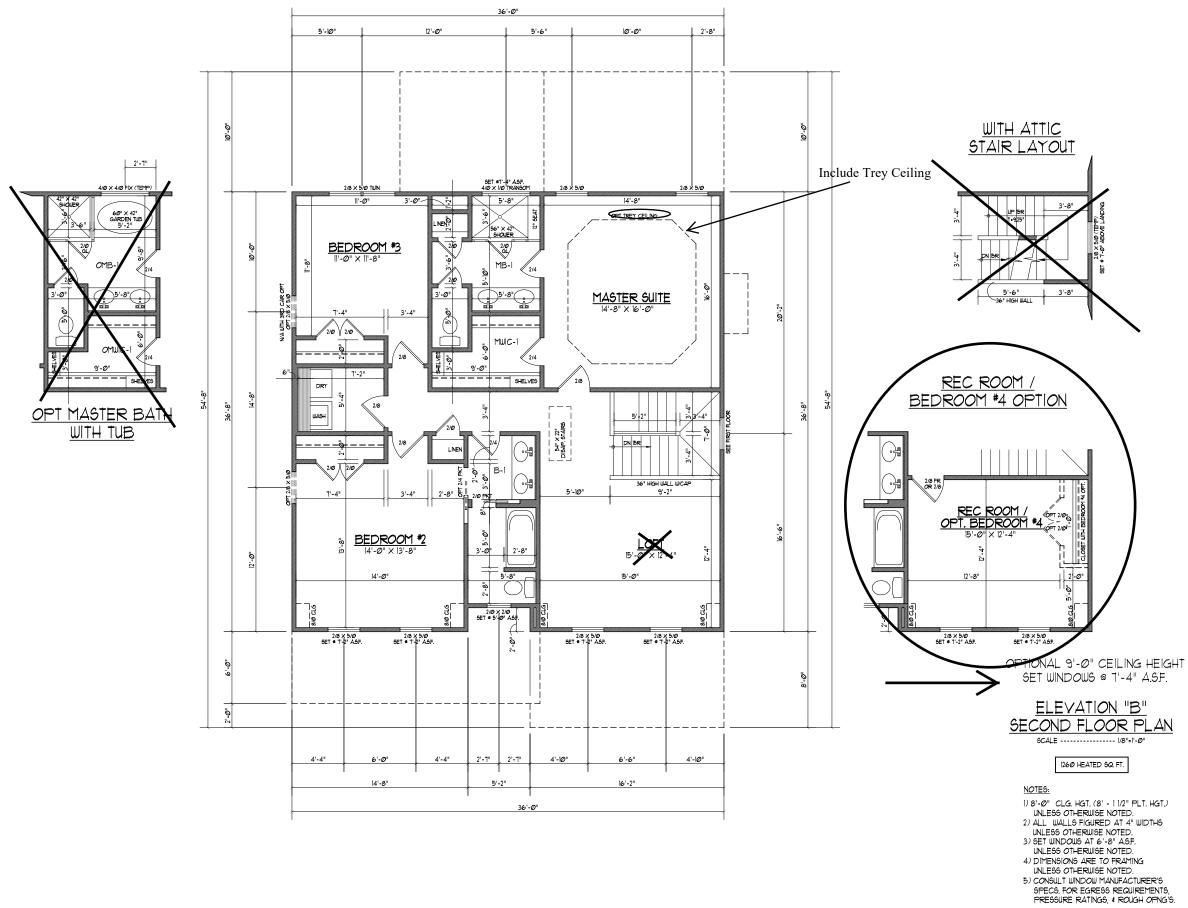





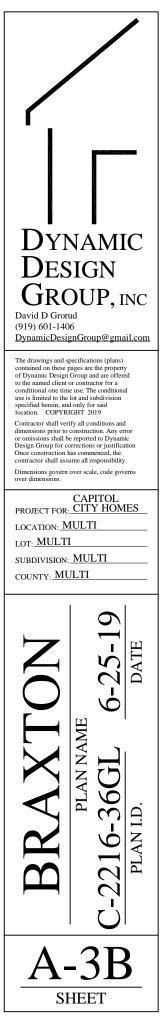

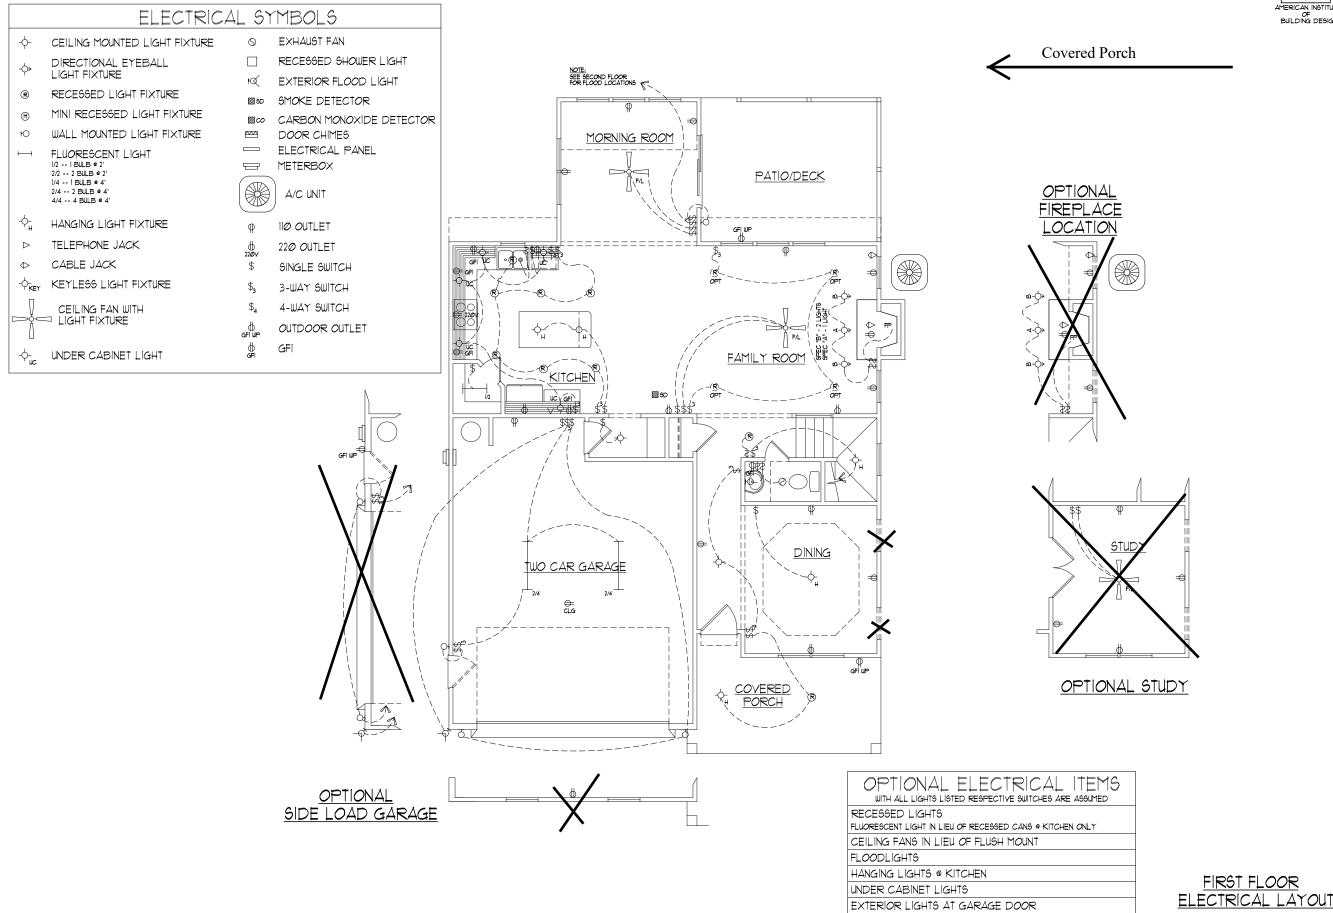



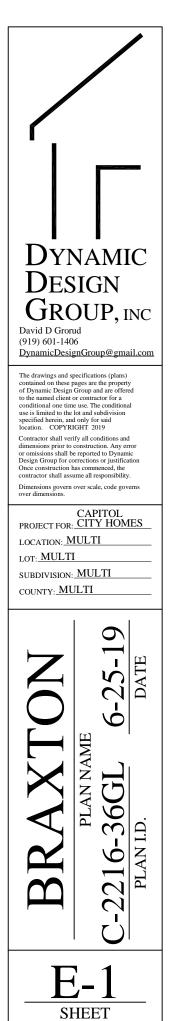


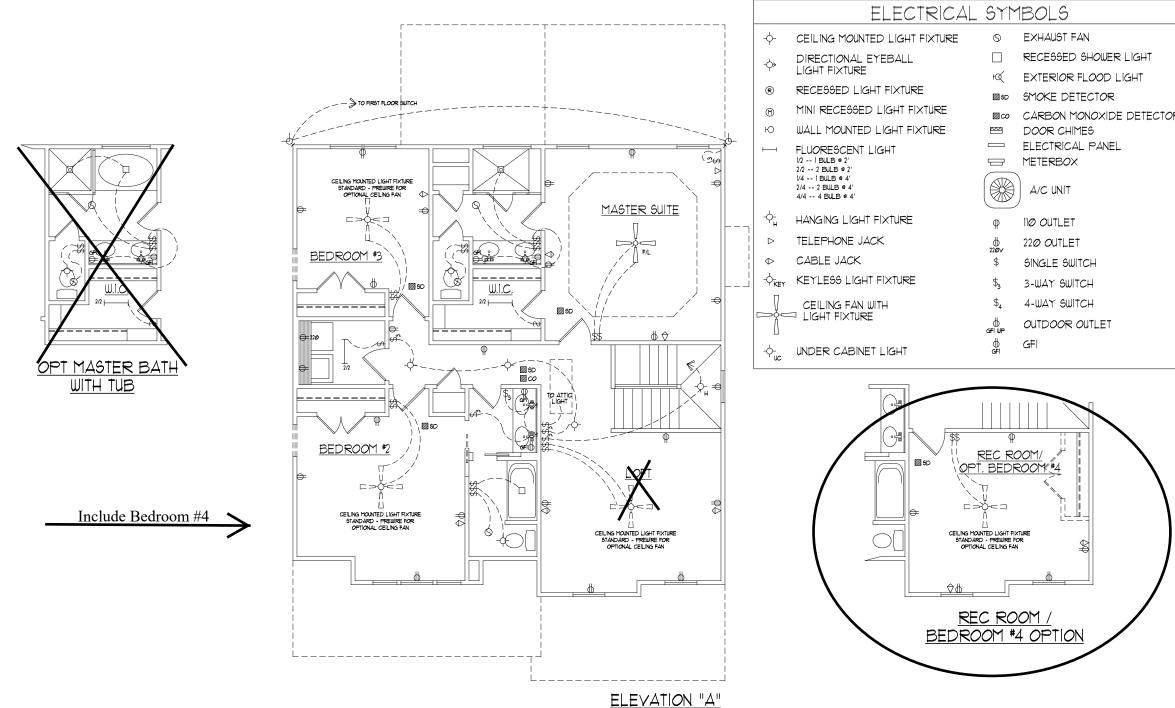




EXHAUST FAN
RECESSED SHOWER LIGHT
EXTERIOR FLOOD LIGHT
SMOKE DETECTOR
CARBON MONOXIDE DETECTOR
DOOR CHIMES
ELECTRICAL PANEL
METERBOX
A/C UNIT
110 OUTLET
220 OUTLET
SINGLE SWITCH
3-WAY SWITCH
4-WAY SWITCH
OUTDOOR OUTLET
GFI



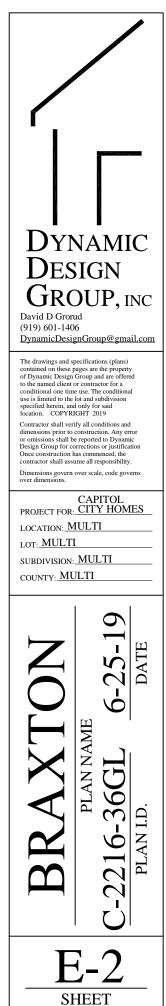

	ELECTRICAL	STM	1BC
-¢-	CEILING MOUNTED LIGHT FIXTURE	0	EXH
-¢>	DIRECTIONAL EYEBALL LIGHT FIXTURE		REC
R	RECESSED LIGHT FIXTURE	⊦≪ ⊠ 5D	EXT! SMO
1	MINI RECESSED LIGHT FIXTURE	© co	CAR
ю	WALL MOUNTED LIGHT FIXTURE		DOC
	FLUORESCENT LIGHT		ELEC
	l/2 I BULB @ 2' 2/2 2 BULB @ 2'		MET
	//4 1 BULB ● 4' 2/4 2 BULB ● 4' 4/4 4 BULB ● 4'		) д/с
	HANGING LIGHT FIXTURE	φ	110 0
	TELEPHONE JACK	22øv	22Ø
♦	CABLE JACK	\$	SING
-\$_KEY	KEYLESS LIGHT FIXTURE	\$3	3-W/
Į Ų	CEILING FAN WITH	\$4	4-W,
	□ LIGHT FIXTURE	GFIWP	OUTI
-¢- uc	UNDER CABINET LIGHT	Ğ₽	GFI

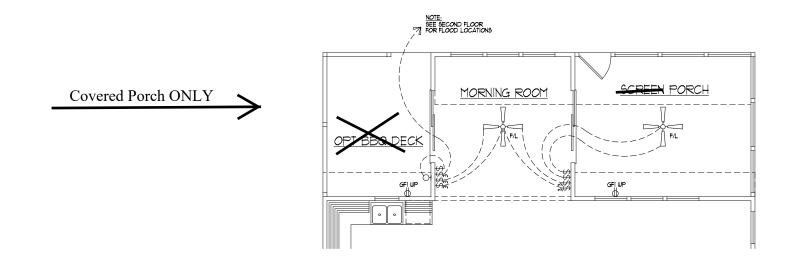



## OLS

HAUST FAN

- CESSED SHOWER LIGHT
- TERIOR FLOOD LIGHT
- OKE DETECTOR
- ARBON MONOXIDE DETECTOR DOR CHIMES ECTRICAL PANEL ITERBOX

/C UNIT

OUTLET

OUTLET


NGLE SWITCH


UAY SWITCH


UAY SWITCH


TDOOR OUTLET



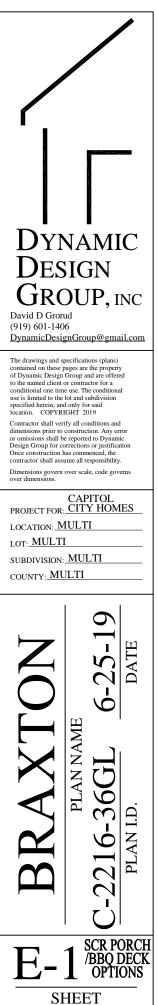

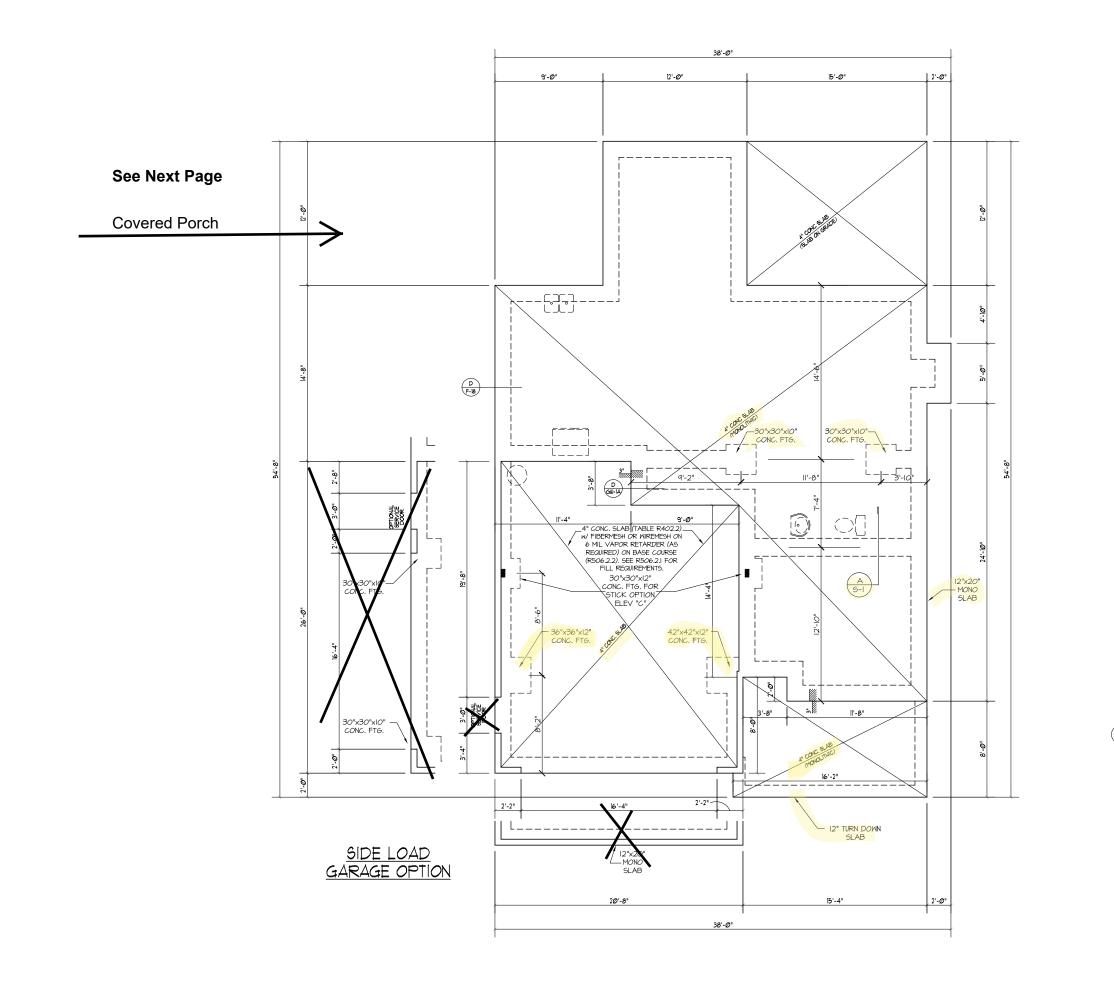

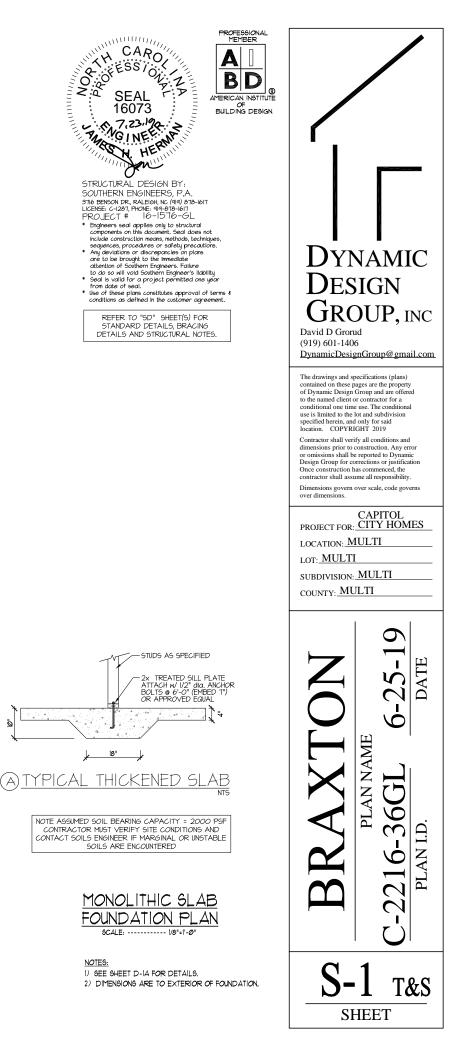

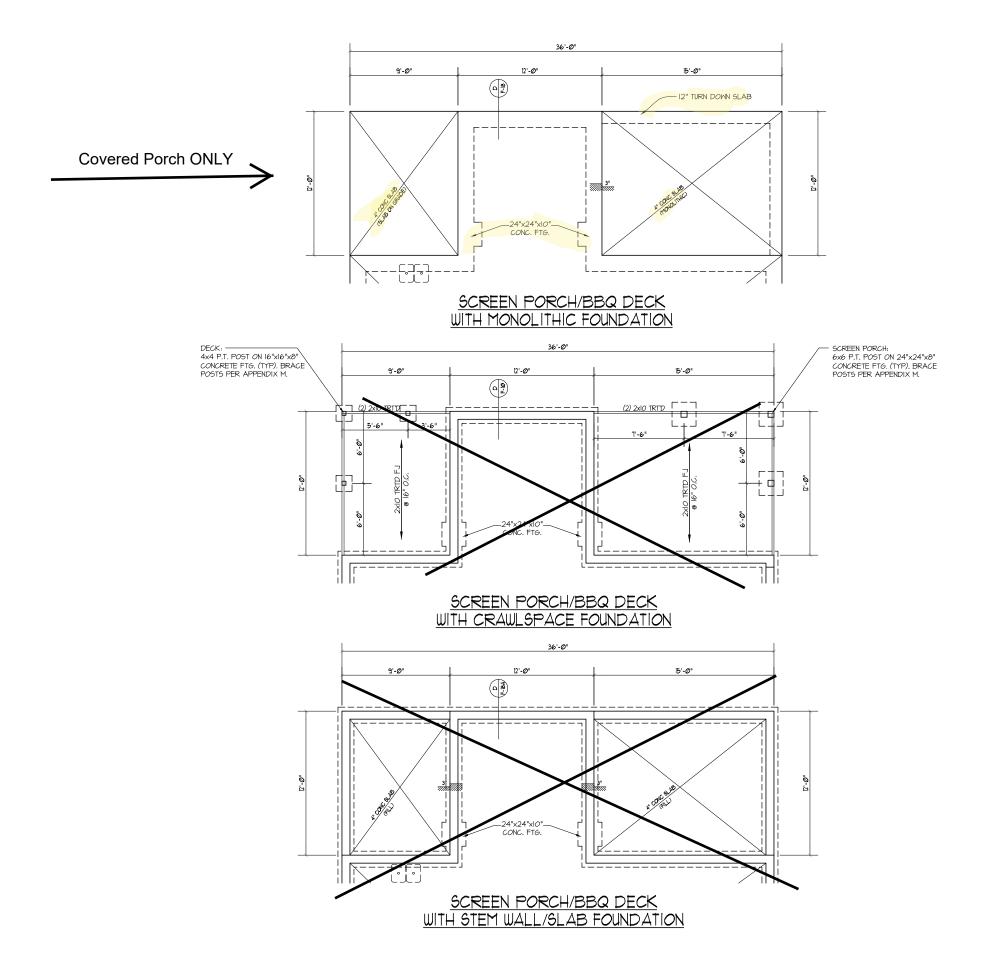



PROFESSIONAL MEMBER A BD AMERICAN INSTITUTE OF BUILDING DESIGN

- STRUCTURAL DESIGN BY: SOUTHERN ENGINEERS, P.A. 316 BENGON DR., RALEIGH, NC (914) 876-1611 LICENEE. C-1281, PHONE: 914-876-1617 PROJECT # 16-1576-6L Engineers seal applies only to structural components on this document. Seal does not include construction means, methods, techniques, sequences, procedures or sofely pre-eatlors. Any deviations or discrepancies on plans are to be brought to the immediate attention of southern Engineers's liability Seal Is valid for a project permitted one year from date of seal. Use of these plans constitutes approval of terms 4 conditions as defined in the customer agreement.

REFER TO "SD" SHEET(S) FOR STANDARD DETAILS, BRACING DETAILS AND STRUCTURAL NOTES.


## SCREEN PORCH/BBQ DECK FOUNDATION OPTIONS

SCALE: ----- 1/8"=1'-Ø"

NOTES:

1) SEE SHEET D-1A FOR DETAILS.


2) DIMENSIONS ARE TO EXTERIOR OF FOUNDATION.

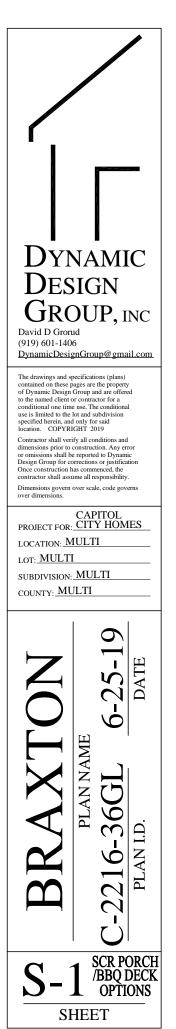


- ALL EXTERIOR AND LOAD BEARING HEADERS 1 SHALL BE MIN. (2)2x6 (4" WALL) OR (3)2x6 (6' WALL) WITH (1) SUPPORT STUD AND (1) KING STUD, UNLESS NOTED OTHERWISE.
- 2 THE NUMBER SHOWN AT BEAM AND HEADER SUPPORTS INDICATES THE NUMBER OF SUPPORT STUDS REQUIRED IN STUD POCKET OR COLUMN. THE NUMBER OF KING STUDS FOR HEADERS SHALL BE ACCORDING TO ITEM "d" IN TABLE R602.3(5) OR AS BELOW:
- UP TO 4' SPAN: (I) KING STUD E/E OVER 4' AND TO 8' SPAN: (2) KING STUDS
- OVER 8' AND UP TO 10' SPAN: (3) KING ...
- STUDS E/E OVER IO' SPAN: (4) KING STUDS E/E


FRAMING NOTES

- NC (2018 NCRC): Wind: 115-120 mph
- BRACING METHOD AND TYPE: CONTINUOUSLY SHEATHED WSP: CS-WSP. NOTE THAT THE WALL BRACING AMOUNT PROVIDED ON THE PLANS. (DETAILS AND SPECIFICATIONS) IS GREATER THAN THE AMOUNT OF WALL BRACING REQUIRED BY THE CODE. SEE NOTES BELOW FOR DETAILS AND SPECIFICATIONS FOR WALL BRACING AND WALL FRAMING.
- 2. EXTERIOR WALL SHEATHING: WALLS SHALL BE BRACED BY SHEATHING WALLS ON ALL STORIES WITH WOOD STRUCTURAL PANEL SHEATHING (WSP) (EXPOSURE B: 7/16". EXPOSURE C: 15/32"). SHEATHING SHALL BE ATTACHED WITH & NAILS AT A 6"/12" NAILING PATTERN (6" OC AT PANEL EDGES AND 12" OC AT INTERMEDIATE SUPPORTS). INSTALL BLOCKING AT ALL PANEL EDGES.
- 3. WSP SHEATHING SHALL EXTEND TO THE UPPERMOST DOUBLE BEARING PLATE. BLOCK AT ROOF AND ATTACH BRACED WALLS PER CODE. MSP SHEATHING BETWEEN FLOORS SHALL BE SPLICED ALONG CONTINUOUS BAND OR THE MSP SHEATHING MAY BE SPLICED ACROSS STUDS (CONTINUOUS ACROSS FLOOR SYSTEM) WITH BLOCKING AT PANEL EDGES. (MINIMUM 12" BEYOND FLOOR BREAK) OR OTHER APPROVED METHOD
- 4. "HD" = HOLDOWN: HOLD-DOWN DEVICE (NOTED AS "HD" ON PLANS) SHALL BE AN 800 POUND CAPACITY ASSEMBLY AS NOTED ON PLANS. SEE DETAILS FOR HD ASSEMBLY.
- \*\*GROUND/FIRST FLOOR: USE "HD HOLD-DOWN DETAIL" ON SD SHEET OR EQUIV.)
- \*\*UPPER FLOORS: ATTACH BASE OF KING STUD WITH A SIMPSON CS22 STRAP DOWN ACROSS THE BAND AND DOWN TO A STUD BELOW OR HEADER BELOW. EXTEND STRAP 7" MIN ALONG EACH STUD (OR HEADER) AND ATTACH EACH END W/ (7) 8d NAILS.
- 5. INTERIOR BRACED WALL: (NOTED AS "IBW" ON PLANS) ATTACH I/2" GYPSUM BOARD (GB) ON EACH SIDE OF WALL WITH A MIN. OF 5d COOLER NAILS OR #6 SCREWS @ 7" O.C. ALONG THE EDGES AND AT INTERMEDIATE SUPPORTS.
- 6. INTERIOR BRACED WALL-WOOD STRUCTURAL PANEL: (NOTED AS "IBM-WSP" ON PLANS). ATTACH ONE SIDE WITH 1/6" MSP SHEATHING WITH 8d NAILS AT A 6"/12" NAILING PATTERN (6" OC AT PANEL EDGES AND 12" OC AT INTERMEDIATE SUPPORTS). INSTALL BLOCKING AT ALL PANEL EDGES. ATTACH GB OVER WSP AS REQUIRED. ATTACH OPPOSITE SIDE WITH 1/2" 6B WITH A MIN. OF 5d COOLER NAILS OR #6 SCREWS @ 7" OC ALONG THE EDGES AND AT INTERMEDIATE SUPPORTS












SD.

SD

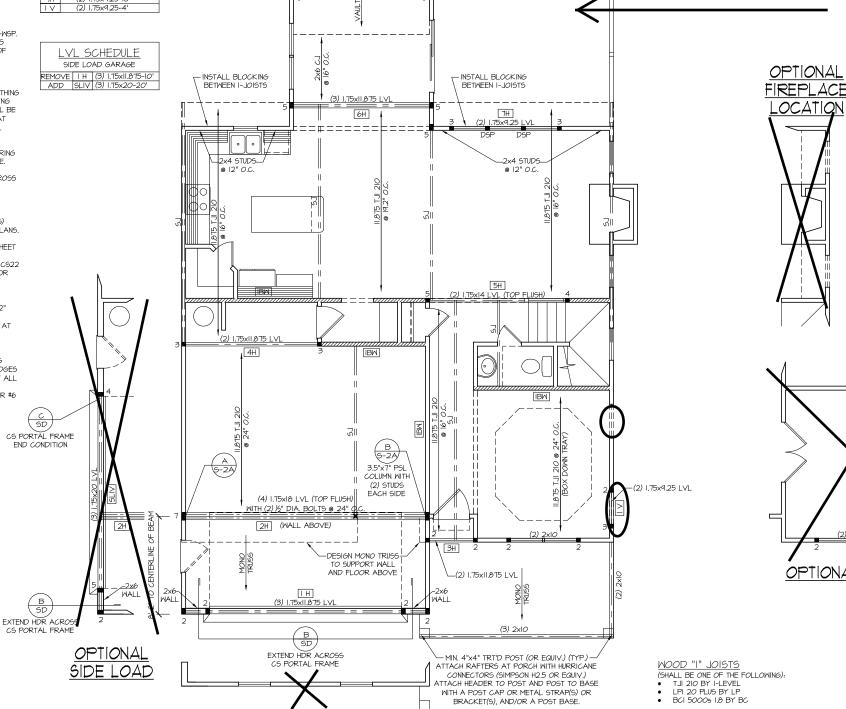

B SD


EXTEND HDR ACROSS


**CS PORTAL FRAME** 


ALL WOOD "I"JOISTS SHALL BE INSTALLED ACCORDING TO MANUFACTURER'S SPECIFICATIONS.

**Covered Porch** 

- INSTALL SQUASH BLOCKS, WEB STIFFENERS, ETC. AS REQUIRED BY AND ACCORDING TO THE I- IOIST MANUFACTURER'S SPECIFICATIONS AND INSTRUCTIONS
- HANGERS FOR I- IDISTS ARE THE RESPONSIBILITY OF THE I-JOIST SUPPLIER.

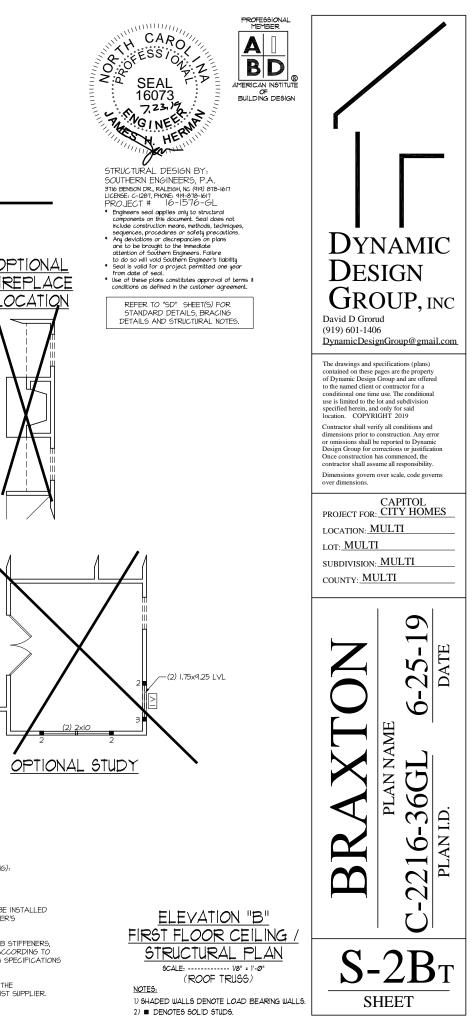

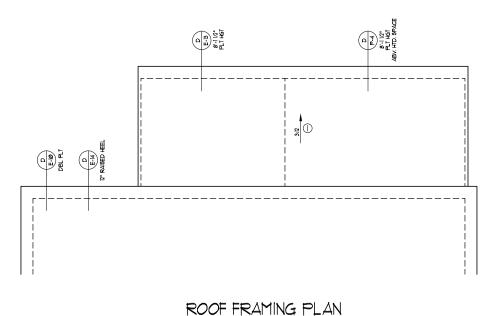

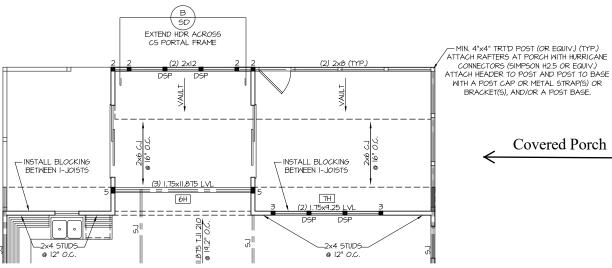

CEILING / STRUCTURAL PLAN

WITH A POST CAP OR METAL STRAP(S) OR BRACKET(S), AND/OR A POST BASE.


Covered Porch




REFER TO "SD" SHEET(S) FOR STANDARD DETAILS, BRACING DETAILS AND STRUCTURAL NOTES.




NOTES: 1) SHADED WALLS DENOTE LOAD BEARING WALLS. 2) DENOTES SOLID STUDS. 3) SEE SHEET D-IB FOR DETAILS.

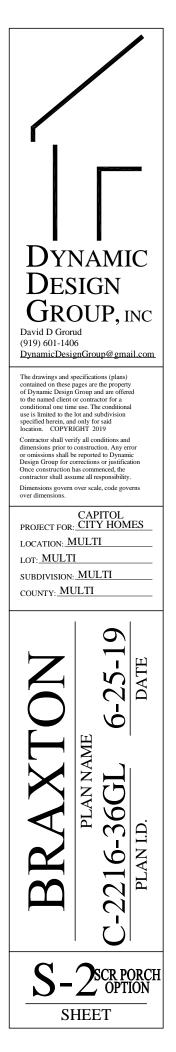




### FRAMING NOTES

- NC (2018 NCRC): Wind: 115-120 mph
- BRACING METHOD AND TYPE: CONTINUOUSLY SHEATHED MSP: CS-MSP. NOTE THAT THE WALL BRACING AMOUNT PROVIDED ON THE PLANS (DETAILS AND SPECIFICATIONS) IS GREATER THAN THE AMOUNT OF WALL BRACING REQUIRED BY THE CODE. SEE NOTES BELOW FOR DETAILS AND SPECIFICATIONS FOR WALL BRACING AND WALL FRAMING
- 2. EXTERIOR WALL SHEATHING: WALLS SHALL BE BRACED BY SHEATHING MALLS ON ALL STORFING WALLS SHALL DE NAALD DE STILATING MALLS ON ALL STORFING WITH MOOD STRUCTURAL PANEL SHEATHING (WSP) (EXPOSURE B: T/I6". EXPOSURE C: 15/32"). SHEATHING SHALL BE ATTACHED WITH 8d NAILS AT A 6"/I2" NAILING PATTERN (6" OC. AT PANEL EDGES AND 12" OC AT INTERMEDIATE SUPPORTS). INSTALL BLOCKING AT ALL PANEL EDGES.
- 3. WSP SHEATHING SHALL EXTEND TO THE UPPERMOST DOUBLE BEARING PLATE. BLOCK AT ROOF AND ATTACH BRACED WALLS PER CODE. WSP SHEATHING BETWEEN FLOORS SHALL BE SPLICED ALONG CONTINUOUS BAND OR THE WSP SHEATHING MAY BE SPLICED ACROSS STUDS (CONTINUOUS ACROSS FLOOR SYSTEM) WITH BLOCKING AT PANEL EDGES. (MINIMUM 12" BEYOND FLOOR BREAK) OR OTHER APPROVED METHOD.
- 4. "HD" = HOLDOWN: HOLD-DOWN DEVICE (NOTED AS "HD" ON PLANS) SHALL BE AN 800 POUND CAPACITY ASSEMBLY AS NOTED ON PLANS. SEE DETAILS FOR HD ASSEMBLY.
- \*\*GROUND/FIRST FLOOR: USE "HD HOLD-DOWN DETAIL" ON SD SHEET (OR EQUIV.)
- \*\*UPPER FLOORS: ATTACH BASE OF KING STUD WITH A SIMPSON CS22 STRAP DOWN ACROSS THE BAND AND DOWN TO A STUD BELOW OR HEADER BELOW. EXTEND STRAP 7" MIN ALONG EACH STUD (OR HEADER) AND ATTACH EACH END W/ (7) 8d NAILS.
- 5. INTERIOR BRACED WALL: (NOTED AS "IBW" ON PLANS) ATTACH I/2" GYPSUM BOARD (GB) ON EACH SIDE OF WALL WITH A MIN. OF 5d COOLER NAILS OR #6 SCREWS (  $7^{\prime\prime}$  O.C. ALONG THE EDGES AND AT INTERMEDIATE SUPPORTS.
- 6. INTERIOR BRACED WALL-WOOD STRUCTURAL PANEL: (NOTED AS "IBM-MSP" ON PLANS). ATTACH ONE SIDE WITH  ${\cal H}_6$ " MSP SHEATHING WITH 8d NAILS AT A 6"/12" NAILING PATTERN (6" OC AT PANEL EDGES AND 12" OC AT INTERMEDIATE SUPPORTS). INSTALL BLOCKING AT ALL PANEL EDGES. ATTACH GB OVER WSP AS REQUIRED. ATTACH OPPOSITE SIDE WITH 1/2" GB WITH A MIN. OF 5d COOLER NAILS OR #6 SCREWS @ 7" OC ALONG THE EDGES AND AT INTERMEDIATE SUPPORTS

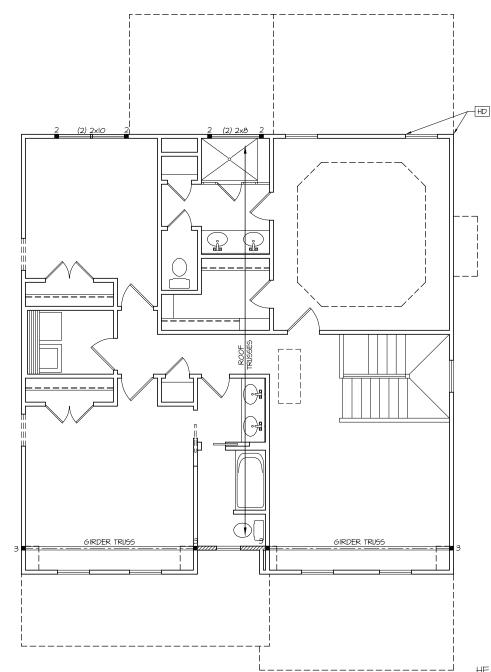

#### TRUSS SYSTEM REQUIREMENTS NC (2018 NCRC): Wind: 115-120 mph


- TRUSS SYSTEM LAYOUTS (PLACEMENT PLANS) SHALL BE DESIGNED IN ACCORDANCE WITH SEALED STRUCTURAL PLANS. ANY NEED TO CHANGE TRUSSES SHALL BE COORDINATED WITH SOUTHERN ENGINEERS
- TRUSS SCHEMATICS (PROFILES) SHALL BE 2. PREPARED AND SEALED BY TRUSS MANUFACTURER
- ALL TRUSSES SHALL BE DESIGNED FOR BEARING З. ON SPF #2 OR #3 PLATES OR LEDGERS (UNO).
- ALL REQUIRED ANCHORS FOR TRUSSES DUE TO UPLIET OR BEARING SHALL MEET THE REQUIREMENTS AS SPECIFIED ON THE TRUSS SCHEMATICS.

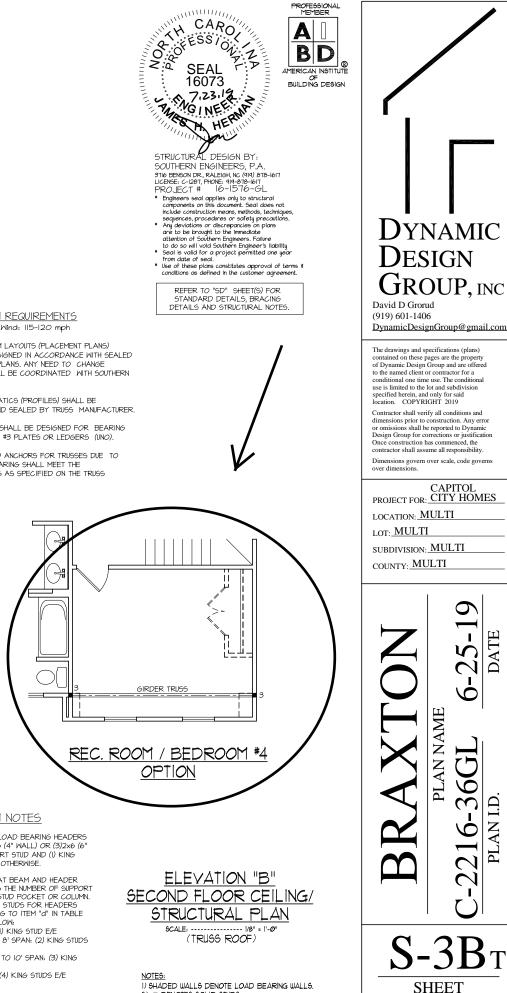

### HEADER / BEAM NOTES

- ALL EXTERIOR AND LOAD BEARING HEADERS SHALL BE MIN. (2)2×6 (4" WALL) OR (3)2×6 (6" WALL) WITH (I) SUPPORT STUD AND (I) KING STUD, UNLESS NOTED OTHERWISE
- 2. THE NUMBER SHOWN AT BEAM AND HEADER SUPPORTS INDICATES THE NUMBER OF SUPPORT STUDS REQUIRED IN STUD POCKET OR COLUMN. THE NUMBER OF KING STUDS FOR HEADERS SHALL BE ACCORDING TO ITEM "d" IN TABLE R602.3(5) OR AS BELOW: UP TO 4' SPAN: (I) KING STUD E/E
- OVER 4' AND TO 8' SPAN: (2) KING STUDS E/E
- OVER 8' AND UP TO IO' SPAN: (3) KING STUDS E/E
- OVER IO' SPAN: (4) KING STUDS E/E

SHADED WALLS DENOTE LOAD BEARING WALLS.
 DENOTES SOLID STUDS.

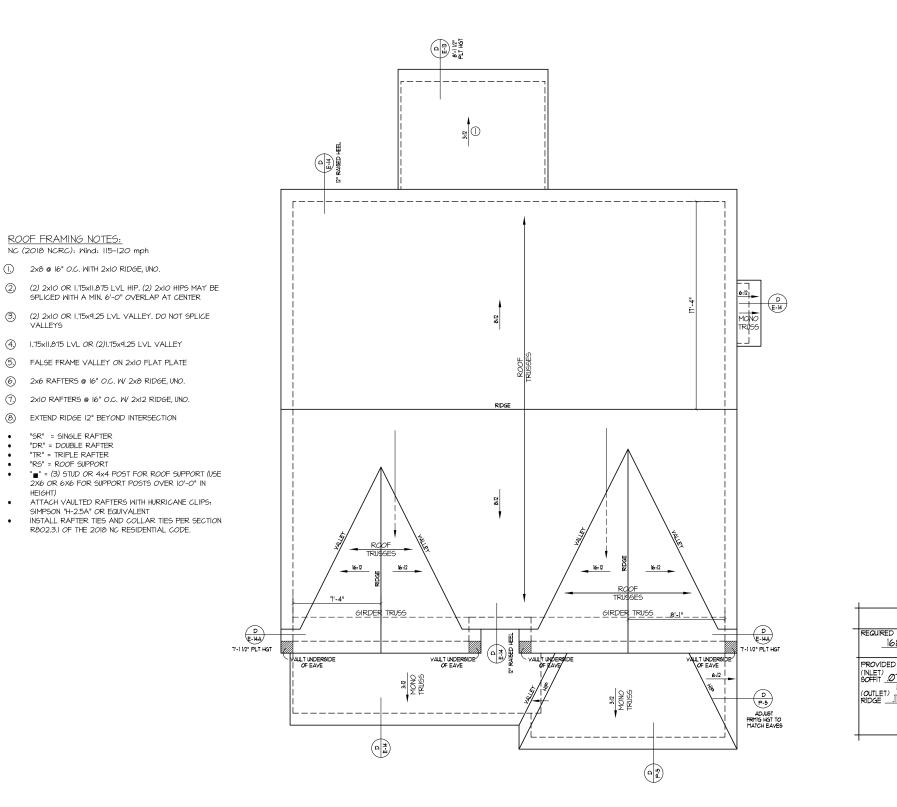

2)

3)


4)

5)

6)

1


8.

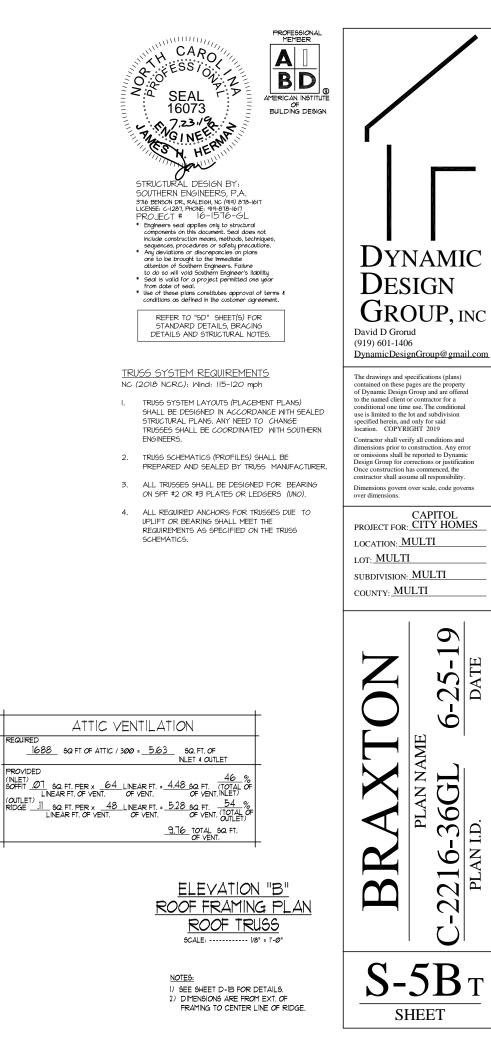


#### STRUCTURAL NOTES

### NC (2018 NCRC): Wind: 115-120 mph


- ENGINEER'S SEAL APPLIES ONLY TO STRUCTURAL COMPONENTS INCLUDING ROOF RAFTERS, HIPS VALLEYS, RIDGES, FLOORS, WALLS, BEAMS AND HEADERS, COLUMNS, CANTILEVERS, OFFSET LOAD BEARING MALLS, PIER & GIRDER SYSTEM, FOOTING, AND PILING SYSTEM. ENGINEER'S SEAL DOES NOT CERTIFY DIMENSIONAL ACCURACY OR ARCHITECTURAL LAYOUT INCLUDING ROOF SYSTEM. ALL REQUIREMENTS FOR PROFESSIONAL CERTIFICATION SHALL BE PROVIDED BY THE APPROPRIATE PROFESSIONAL. SOUTHERN ENGINEERS, P.A. CERTIFIES ONLY THE STRUCTURAL COMPONENTS AS SPECIFICALLY STATED.
- 2. ALL CONSTRUCTION SHALL CONFORM TO THE LATEST REQUIREMENTS OF RESIDENTIAL CODE, PLUS ALL LOCAL CODES AND REGULATIONS. THE STRUCTURAL ENGINEER IS NOT RESPONSIBLE FOR, AND WILL NOT HAVE CONTROL OF, CONSTRUCTION MEANS, METHODS, TECHNIQUES, SEQUENCES OR PROCEDURES, OR FOR SAFETY PRECAUTIONS AND PROGRAMS IN CONNECTION WITH THE CONSTRUCTION WORK, NOR WILL THE ENGINEER BE RESPONSIBLE FOR THE CONTRACTOR'S FAILURE TO CARRY OUT THE CONSTRUCTION WORK IN ACCORDANCE WITH THE CONTRACT DOCUMENTS. "CONSTRUCTION REVIEW" SERVICES ARE NOT PART OF OUR CONTRACT ALL MEMBERS SHALL BE FRAMED ANCHORED, TIED AND BRACED IN ACCORDANCE WITH GOOD CONSTRUCTION PRACTICE AND THE BUILDING CODE.
- DESIGN LOADS (LISTED AS: LIVE LOAD, DEAD LOAD, DEFLECTION)
  ROOMS OTHER THAN SLEEPING ROOMS: (40 PSF, IO PSF, L/360)
- SLEEPING ROOMS: (30 PSF, 10 PSF, L/360) ATTIC WITH PERMANENT STAIR (40 PSE 10 PSE 1/360)
- ATTIC WITHOUT PERMANENT STAIR: (20 PSF, IO PSF, L/360)
- ATTIC WITHOUT STORAGE: (IO PSF, IO PSF, L/240)
- STAIRS: (40 PSF, 10 PSF, L/360)
- EXTERIOR BALCONIES: (60 PSF, 10 PSF, L/360) DECKS: (40 PSF, 10 PSF, L/360)
- GUARDRAILS AND HANDRAILS: (200 LBS)
- PASSSENGER VEHICLE GARAGES: (50 PSF. 10 PSF. L/360) FIRE ESCAPES: (40 PSF, 10 PSF, L/360)
- SNOW: (20 PSF)
- 4. WALLS SHALL BE BRACED BY SHEATHING WALLS ON ALL STORIES WITH WOOD STRUCTURAL PANELS. SEE FRAMING NOTES FOR THICKNESS AND NAILING REQUIREMENTS
- 5. SEE APPENDIX M (DCA6) FOR EXTERIOR DECK REQUIREMENTS INCLUDING ATTACHMENTS FOR LATERAL LOADS
- CONCRETE SHALL HAVE A MINIMUM 28 DAY STRENGTH OF 3000 PSI AND A MAXIMUM SLUMP OF 5 INCHES UNLESS NOTED OTHERWISE (UNO). AIR ENTRAINED PER TABLE 402.2. ALL CONCRETE SHALL BE PROPORTIONED, MIXED, HANDLED, SAMPLED, TESTED, AND PLACED IN ACCORDANCE WITH ACI STANDARDS. ALL SAMPLES FOR PUMPING SHALL BE TAKEN FROM THE EXIT END OF THE PUMP, CONTROL JOINTS IN SLABS SHALL BE SPACED ON A GRID OF +-30 TIMES THE DEPTH (D). CONTROL JOINTS SHALL BE SAWCUT TO A DEPTH OF I/D. (I.E. 4" CONCRETE SLABS SHALL HAVE 1/4" DEEP CONTROL JOINTS SAWCUT IN SLAB ON A +-10'-0" X +-10'-0" GRID).
- ALLOWABLE SOIL BEARING PRESSURE ASSUMED TO BE 2000 PSF. THE CONTRACTOR MUST 7. CONTACT A GEOTECHNICAL ENGINEER AND THE STRICTUAL ENGINEER IF UNSATISFACTORY SUBSURFACE CONDITIONS ARE ENCOUNTERED. THE SURFACE AREA ADJACENT TO THE FOUNDATION WALL SHALL BE PROVIDED WITH ADEQUATE DRAINAGE, AND SHALL BE GRADED SO AS TO DRAINSURFACE WATER AWAY FROM FOUNDATION WALLS.
- 8. ALL FRAMING LUMBER SHALL BE SPF #2 (Fb = 875 PSI) UNLESS NOTED OTHERWISE (UNO), ALL TREATED LUMBER SHALL BE SYP # 2. PLATE MATERIAL MAY BE SPF # 3 OR SYP #3 (Fc(perp) = 425 PSI - MIN)
- 9. L.V.L. SHALL BE LAMINATED VENEER LUMBER: Fb=2600 PSI, Fv=285 PSI, F=19×10 PSI
- P.L. SHALL BE PARALLEL STRAND LUMPER: Fb=2000 P3I, Fv=200 P3I, E=2.0x10 P3I,
  P.S. L.S.L. SHALL BE LAMINATED STRAND LUMBER: Fb=2250 P3I, Fv=400 P3I, E=1.55x10 P3I.
- INSTALL ALL CONNECTIONS PER MANUFACTURERS INSTRUCTIONS. IQ. ALL ROOF TRUES AND I- WIST LAYOUTS SHALL BE PREPARED IN ACCORDANCE WITH THE
- SEALED STRUCTURAL DRAWINGS. TRUSSES AND I-JOIST SHALL BE INSTALLED ACCORDING TO THE MANUFACTURE'S SPECIFICATIONS. ANY CHANGE IN TRUSS OR I-JOIST LAYOUT SHALL BE COORDINATED WITH SOUTHERN ENGINEERS.
- ALL STRUCTURAL STEEL SHALL BE ASTM A-36. STEEL BEAMS SHALL BE SUPPORTED AT EACH END WITH A MINIMUM BEARING LENGTH OF 3 1/2" INCHES AND FULL FLANGE WIDTH. PROVIDE SOLID BEARING FROM BEAM SUPPORT TO FOUNDATION. BEAMS SHALL BE ATTACHED TO EACH SUPPORT WITH TWO LAG SCREWS (1/2" DIAMETER x 4" LONG) LATERAL SUPPORT IS CONSIDERED. ADEQUATE PROVIDING THE JOST ARE TO HAILED TO THE SOLE PLATE, AND SOLE PLATE IS NAILED OR BOLTED TO THE BEAM FLANGE @ 48" O.C. ALL STEEL TIBING SHALL BE ASTM A500. LAP ALL REBAR SPLICES 30 BAR DIAMETERS.
- 12. REBAR SHALL BE DEFORMED STEEL, ASTMOIS, GRADE 60.
- 13 FLITCH BEAMS SHALL BE BOLTED TOGETHER VAING (2) ROWS OF 1/2" DIAMETER BOLTS (ASTM A325) WITH WASHERS PLACED WIDER THE THREADED END OF BOLT. BOLTS SHALL BE SPACED AT 24" O.C. (MAX), AND STAGGERED AT THE TOP AND BOTTOM OF BEAM (2" EDGE DISTANCE), WITH 2 BOLTS LOCATED AT 6" FROM EACH END.
- 14. BRICK LINTELS (WHEN REQUIRED) SHALL BE 3 1/2"x3 1/2"x1/4" STEEL ANGLE FOR UP TO 6'-0" SPAN AND 6"x4"x5/16" STEEL ANGLE WITH 6" LEG VERTICAL FOR SPANS UP TO 9'-0". SEE PLANS FOR SPANS OVER 9'-O". SEE ALSO SECTION R703.7.3 LINTELS.

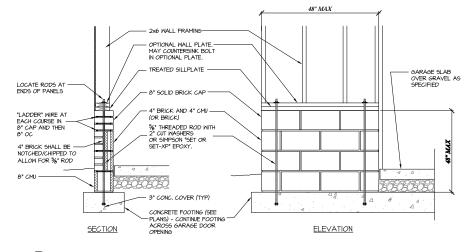



GARAGE 'WING WALL' REINFORCING Ά (CODE REFERENCE: IRC FIGURE R602.10.5.3)

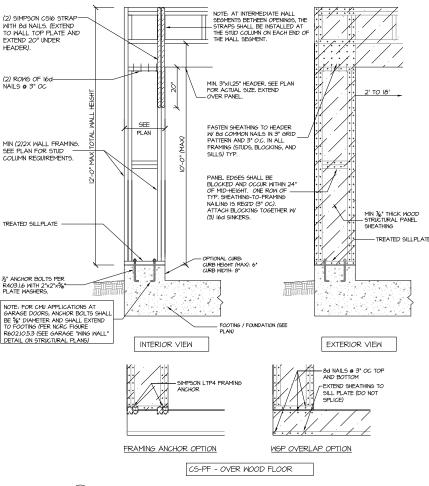


(B) CS-PF: CONTINUOUS PORTAL FRAME CONSTRUCTION DETAIL AND APPLICATION BASED ON NCRC FIGURE R602.IO.I - PORTAL FRAME CONSTRUCTION

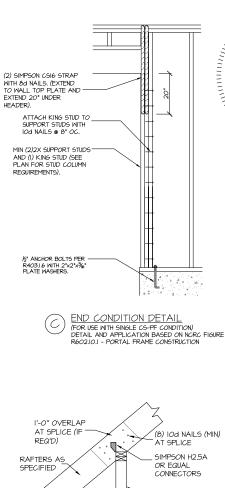









(<u>204D</u>)-SD)-

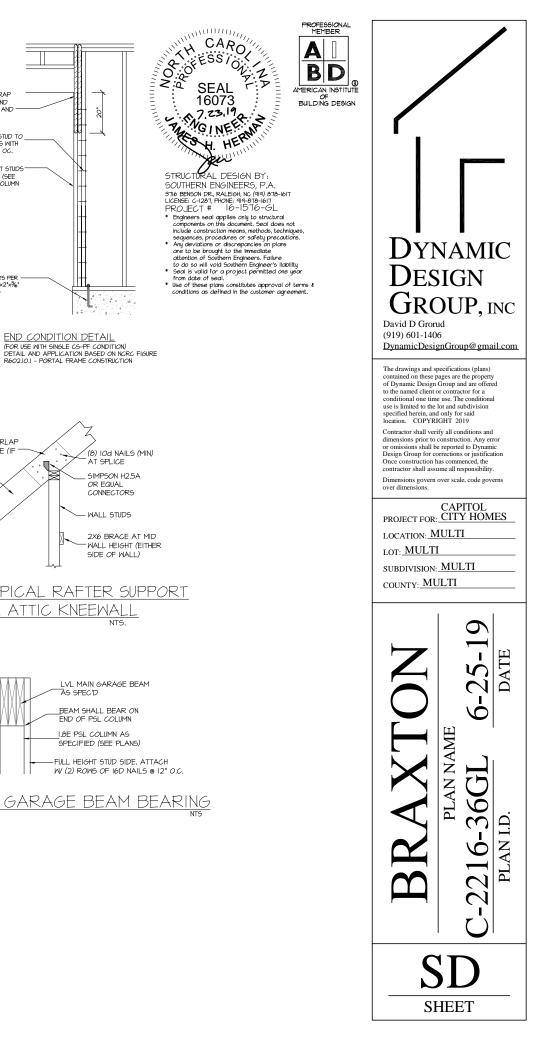

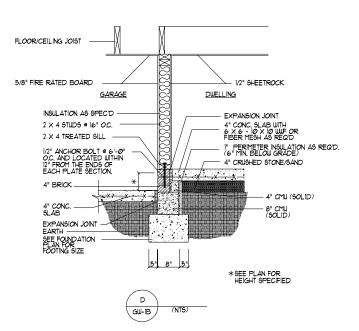

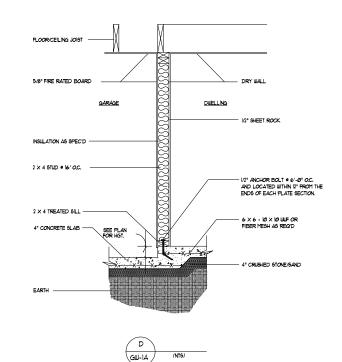

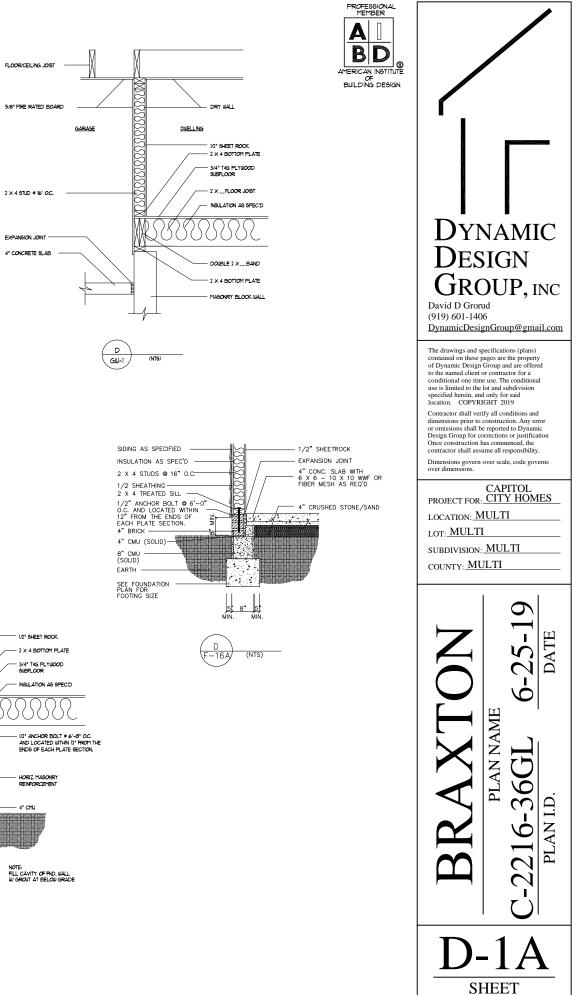



SIDING AS SPECIFIED

2 × 4 STUDS # 16" O.C.

2 × 4 TREATED SILL

8" SOLID MASONRY CA

1/2 SHEATHING

4" BRICK

4" CMU

FARTH

SEE FOUNDATION PLAN FOR FOOTING SIZE

F-16 ,

HORIZ MASONRY

D

F-18A

