

Trenco
818 Soundside Rd
Edenton, NC 27932

Re: 21020046-B
163 Crossings-Kessler C-Roof

The truss drawing(s) referenced below have been prepared by Truss Engineering Co. under my direct supervision based on the parameters provided by Carter Components (Sanford, NC)).

Pages or sheets covered by this seal: E15385575 thru E15385597

My license renewal date for the state of North Carolina is December 31, 2021.

North Carolina COA: C-0844



February 5, 2021

Gilbert, Eric


IMPORTANT NOTE: The seal on these truss component designs is a certification that the engineer named is licensed in the jurisdiction(s) identified and that the designs comply with ANSI/TPI 1. These designs are based upon parameters shown (e.g., loads, supports, dimensions, shapes and design codes), which were given to MiTek or TRENCO. Any project specific information included is for MiTek's or TRENCO's customers file reference purpose only, and was not taken into account in the preparation of these designs. MiTek or TRENCO has not independently verified the applicability of the design parameters or the designs for any particular building. Before use, the building designer should verify applicability of design parameters and properly incorporate these designs into the overall building design per ANSI/TPI 1, Chapter 2.

Job	Truss	Truss Type	Qty	Ply	163 Crossings-Kessler C-Roof	E15385575
21020046-B	T3GE	Monopitch Supported Gable	1	1	Job Reference (optional)	

Carter Components (Sanford), Sanford, NC - 27332,

8.430 s Nov 30 2020 MiTek Industries, Inc. Fri Feb 5 12:41:53 2021 Page 1

ID: xgAp6L5?n01tuWo8jgtJIVzEbO5-UQFJJW7M2LExJXtrGr3LmeekIR?C7yq1zX73lzoBGC

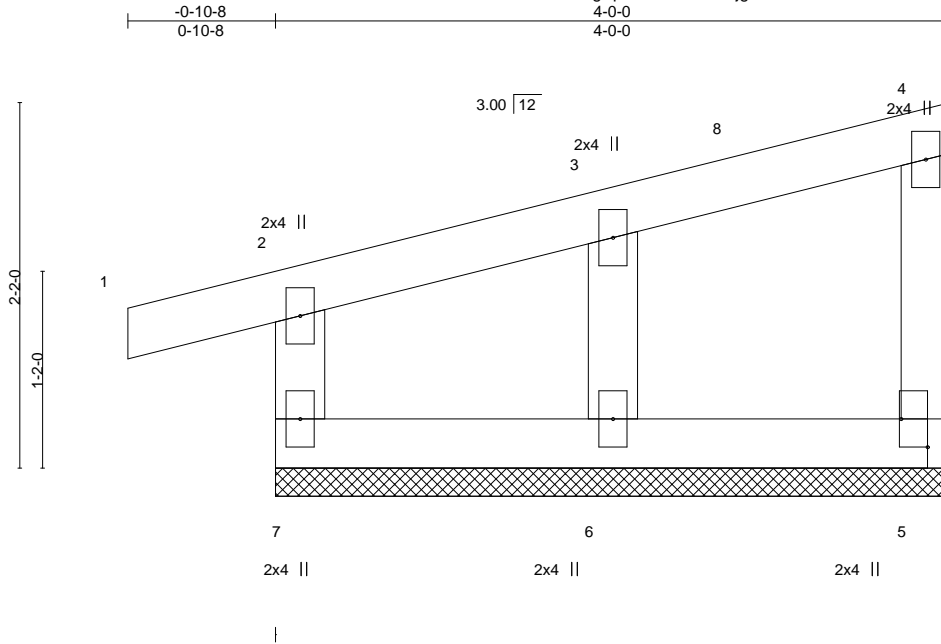

Scale = 1:13.7

Plate Offsets (X,Y)-- [5:Edge,0-1-14]

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof) 20.0	2-0-0	TC 0.14	Vert(LL) -0.00	1	n/r	120	MT20	244/190
Snow (Pf/Pg) 13.9/20.0	Plate Grip DOL 1.15	BC 0.06	Vert(CT) -0.00	1	n/r	120		
TCDL 10.0	Lumber DOL 1.15	WB 0.04	Horz(CT) -0.00	5	n/a	n/a		
BCLL 0.0 *	Rep Stress Incr YES	Matrix-R						
BCDL 10.0	Code IRC2015/TPI2014						Weight: 18 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
 BOT CHORD 2x4 SP No.2
 WEBS 2x4 SP No.3
 OTHERS 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 4-0-0 oc purlins, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.

REACTIONS.

(size) 7=4-0-0, 5=4-0-0, 6=4-0-0
 Max Horz 7=58(LC 12)
 Max Uplift 7=-32(LC 11), 5=-1(LC 15), 6=-12(LC 15)
 Max Grav 7=141(LC 2), 5=63(LC 2), 6=154(LC 2)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) and C-C Exterior(2) zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.33
- 2) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- 3) TCLL: ASCE 7-10; Pr=20.0 psf (roof live load: Lumber DOL=1.15 Plate DOL=1.15); Pg=20.0 psf (ground snow); Pf=13.9 psf (flat roof snow: Lumber DOL=1.15 Plate DOL=1.15); Category II; Exp B; Fully Exp.; Ct=1.10; Min. flat roof snow load governs.
- 4) Unbalanced snow loads have been considered for this design.
- 5) This truss has been designed for greater of min roof live load of 12.0 psf or 2.00 times flat roof load of 13.9 psf on overhangs non-concurrent with other live loads.
- 6) Gable requires continuous bottom chord bearing.
- 7) Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
- 8) Gable studs spaced at 2-0-0 oc.
- 9) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 10) One RT7A USP connectors recommended to connect truss to bearing walls due to UPLIFT at jt(s) 7, 5, and 6. This connection is for uplift only and does not consider lateral forces.



February 5, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




818 Soundside Road
 Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	163 Crossings-Kessler C-Roof	E15385576
21020046-B	T3	Monopitch	8	1	Job Reference (optional)	

Carter Components (Sanford), Sanford, NC - 27332,

8.430 s Nov 30 2020 MiTek Industries, Inc. Fri Feb 5 12:41:52 2021 Page 1

ID: xgAp6L5?n01tuWo8jgtJlVzEbO5-0Ehx5A6kH164iNIHfYKqoZ5SoL4wTgmhoJnaXJzoBGD
4-0-0
4-0-0

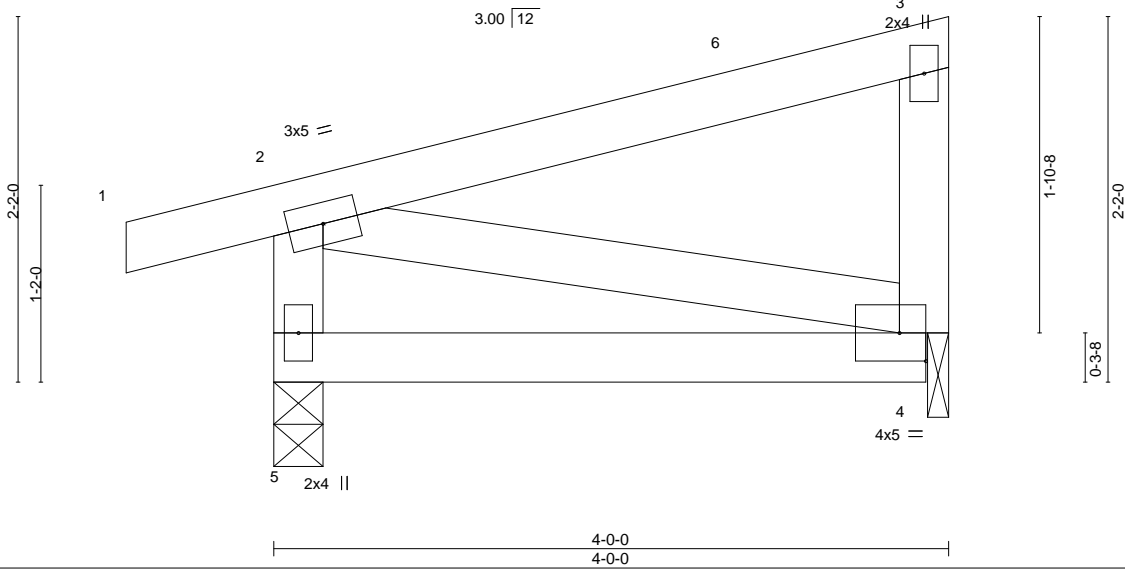


LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	I/defl	L/d	PLATES	GRIP
TCLL (roof) 20.0	2-0-0	TC 0.22	Vert(LL) 0.00	5	****	240	MT20	244/190
Snow (Pf/Pg) 13.9/20.0	Plate Grip DOL 1.15	BC 0.11	Vert(CT) -0.01	4-5	>999	180		
TCDL 10.0	Lumber DOL 1.15	WB 0.03	Horz(CT) -0.00	4	n/a	n/a		
BCLL 0.0 *	Rep Stress Incr YES	Matrix-MP						
BCDL 10.0	Code IRC2015/TPI2014						Weight: 22 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 4-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.3	

REACTIONS. (size) 5=0-3-8, 4=0-1-8
 Max Horz 5=58(LC 12)
 Max Uplift 5=-35(LC 11), 4=-7(LC 15)
 Max Grav 5=218(LC 2), 4=140(LC 2)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-**
- 1) Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) and C-C Exterior(2) zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.33
 - 2) TCLL: ASCE 7-10; Pr=20.0 psf (roof live load: Lumber DOL=1.15 Plate DOL=1.15); Pg=20.0 psf (ground snow); Pf=13.9 psf (flat roof snow: Lumber DOL=1.15 Plate DOL=1.15); Category II; Exp B; Fully Exp.; Ct=1.10; Min. flat roof snow load governs.
 - 3) Unbalanced snow loads have been considered for this design.
 - 4) This truss has been designed for greater of min roof live load of 12.0 psf or 2.00 times flat roof load of 13.9 psf on overhangs non-concurrent with other live loads.
 - 5) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - 6) Bearing at joint(s) 4 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
 - 7) Provide mechanical connection (by others) of truss to bearing plate at joint(s) 4.
 - 8) One RT7A USP connectors recommended to connect truss to bearing walls due to UPLIFT at jt(s) 5 and 4. This connection is for uplift only and does not consider lateral forces.

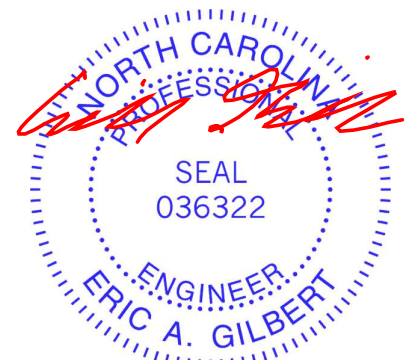

February 5, 2021


Job	Truss	Truss Type	Qty	Ply	163 Crossings-Kessler C-Roof	E15385577
21020046-B	T4	Monopitch	2	1	Job Reference (optional)	

Carter Components (Sanford),

Sanford, NC - 27332,

8.430 s Nov 30 2020 MiTek Industries, Inc. Fri Feb 5 12:41:54 2021 Page 1

ID: xgAp6L5?n01tuWo8jgtJlVzEbO5-ydphWs8?pfMoxhS8OzMlt_AqD9nGxaL_GcGhbBzoBGB

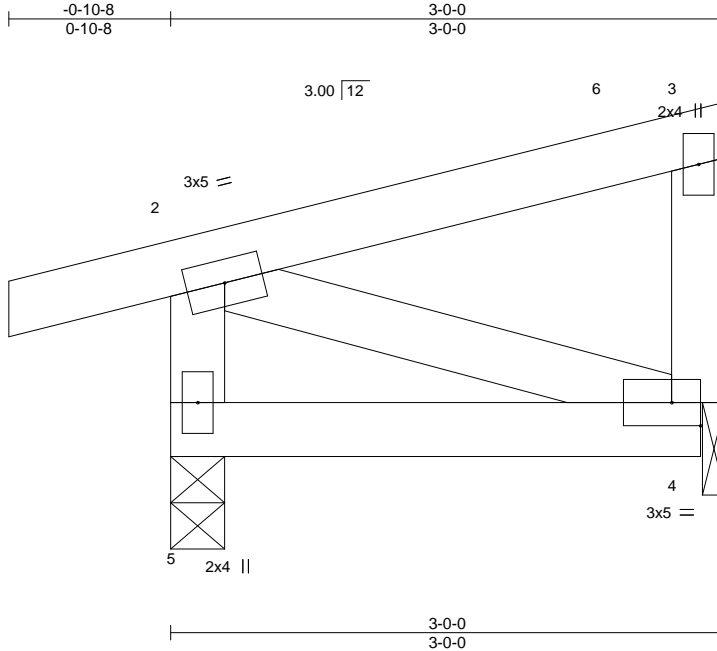

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	I/defl	L/d	PLATES	GRIP
TCLL (roof) 20.0	2-0-0	TC 0.10	Vert(LL) 0.00	5	****	240	MT20	244/190
Snow (Pf/Pg) 13.9/20.0	Plate Grip DOL 1.15	BC 0.06	Vert(CT) -0.00	4-5	>999	180		
TCDL 10.0	Lumber DOL 1.15	WB 0.03	Horz(CT) -0.00	4	n/a	n/a		
BCLL 0.0 *	Rep Stress Incr YES	Matrix-MP						
BCDL 10.0	Code IRC2015/TPI2014						Weight: 17 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 3-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.3	

REACTIONS. (size) 5=0-3-8, 4=0-1-8
 Max Horz 5=50(LC 12)
 Max Uplift 5=-36(LC 11), 4=-8(LC 12)
 Max Grav 5=181(LC 2), 4=97(LC 2)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-**
- 1) Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) and C-C Exterior(2) zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.33
 - 2) TCLL: ASCE 7-10; Pr=20.0 psf (roof live load; Lumber DOL=1.15 Plate DOL=1.15); Pg=20.0 psf (ground snow); Pf=13.9 psf (flat roof snow; Lumber DOL=1.15 Plate DOL=1.15); Category II; Exp B; Fully Exp.; Ct=1.10; Min. flat roof snow load governs.
 - 3) Unbalanced snow loads have been considered for this design.
 - 4) This truss has been designed for greater of min roof live load of 12.0 psf or 2.00 times flat roof load of 13.9 psf on overhangs non-concurrent with other live loads.
 - 5) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - 6) Bearing at joint(s) 4 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
 - 7) Provide mechanical connection (by others) of truss to bearing plate at joint(s) 4.
 - 8) One RT7A USP connectors recommended to connect truss to bearing walls due to UPLIFT at jt(s) 5 and 4. This connection is for uplift only and does not consider lateral forces.



February 5, 2021

Job	Truss	Truss Type	Qty	Ply	163 Crossings-Kessler C-Roof	E15385578
21020046-B	T5A	Half Hip	1	1	Job Reference (optional)	

Carter Components (Sanford), Sanford, NC - 27332,

8.430 s Nov 30 2020 MiTek Industries, Inc. Fri Feb 5 12:41:56 2021 Page 1

ID:PtKcJg6dYK9kVgNLGOOYljzEbO4-v?xRxY9FLGcVB?cWWOmzPGAeyTnPUKHjwng4zoBG9

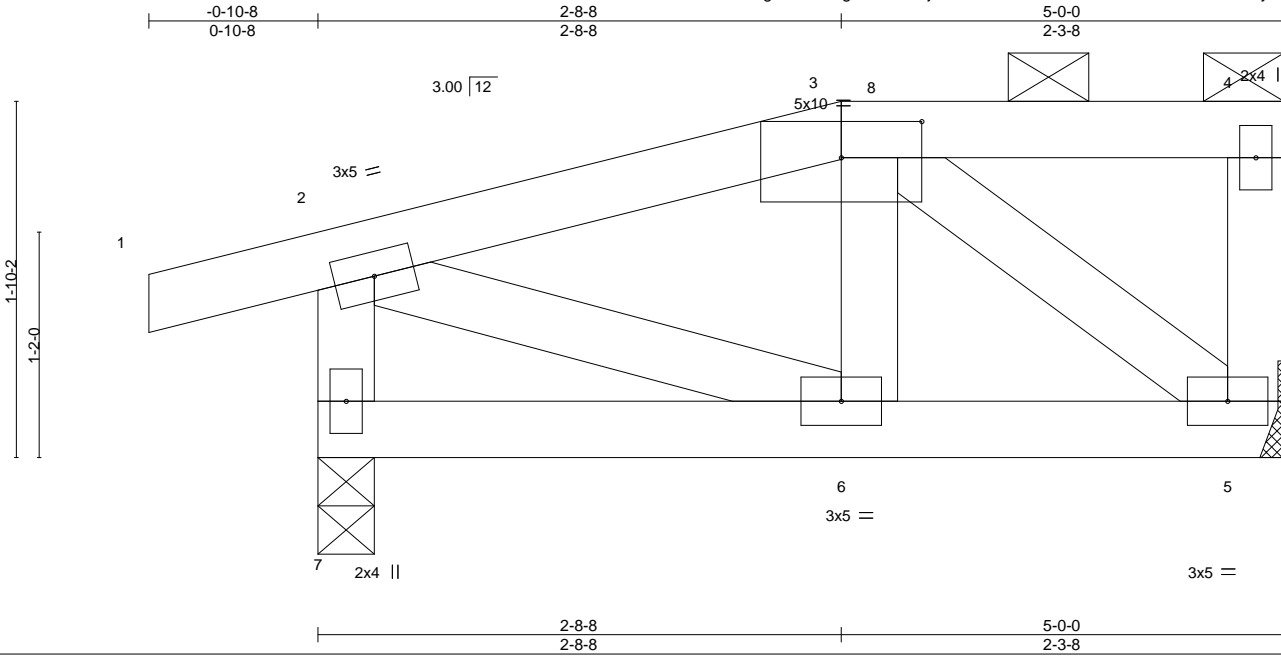


Plate Offsets (X,Y)-- [3:0-5-0,0-2-4]

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof) 20.0	2-0-0	TC 0.10	Vert(LL) -0.00	6	>999	240	MT20	244/190
Snow (Pf/Pg) 18.9/20.0	Plate Grip DOL 1.15	BC 0.05	Vert(CT) -0.00	6-7	>999	180		
TCDL 10.0	Lumber DOL 1.15	WB 0.06	Horz(CT) -0.00	5	n/a	n/a		
BCLL 0.0 *	Rep Stress Incr YES	Matrix-MP					Weight: 28 lb	FT = 20%
BCDL 10.0	Code IRC2015/TPI2014							

LUMBER-

TOP CHORD 2x4 SP No.2
 BOT CHORD 2x4 SP No.2
 WEBS 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 5-0-0 oc purlins, except end verticals, and 2-0-0 oc purlins: 3-4.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.


(size) 7=0-3-8, 5=Mechanical
 Max Horz 7=49(LC 12)
 Max Uplift 7=-37(LC 11), 5=-9(LC 12)
 Max Grav 7=282(LC 35), 5=186(LC 34)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-7=-258/157

NOTES-

- 1) Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) and C-C Exterior(2) zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.33
- 2) TCLL: ASCE 7-10; Pr=20.0 psf (roof live load: Lumber DOL=1.15 Plate DOL=1.15); Pg=20.0 psf (ground snow); Pf=18.9 psf (flat roof snow: Lumber DOL=1.15 Plate DOL=1.15); Category II; Exp B; Fully Exp.; Ct=1.10, Lu=50-0-0; Min. flat roof snow load governs. Rain surcharge applied to all exposed surfaces with slopes less than 0.500/12 in accordance with IBC 1608.3.4.
- 3) Unbalanced snow loads have been considered for this design.
- 4) This truss has been designed for greater of min roof live load of 12.0 psf or 2.00 times flat roof load of 13.9 psf on overhangs non-concurrent with other live loads.
- 5) Provide adequate drainage to prevent water ponding.
- 6) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 7) Refer to girder(s) for truss to truss connections.
- 8) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 5.
- 9) One RT7A USP connectors recommended to connect truss to bearing walls due to UPLIFT at jt(s) 7. This connection is for uplift only and does not consider lateral forces.
- 10) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

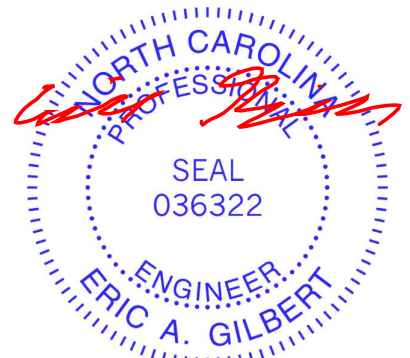

February 5, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




818 Soundside Road
 Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	163 Crossings-Kessler C-Roof	E15385579
21020046-B	T5	Roof Special	5	1	Job Reference (optional)	

Carter Components (Sanford), Sanford, NC - 27332,

8.430 s Nov 30 2020 MiTek Industries, Inc. Fri Feb 5 12:41:55 2021 Page 1

ID:PtKcJg6dYK9kvGnLGOOYIjzEbO4-RpN3jC8dayUeZr1KyhtXQBjyfY4ig0Y7VG0E8ezoBGA

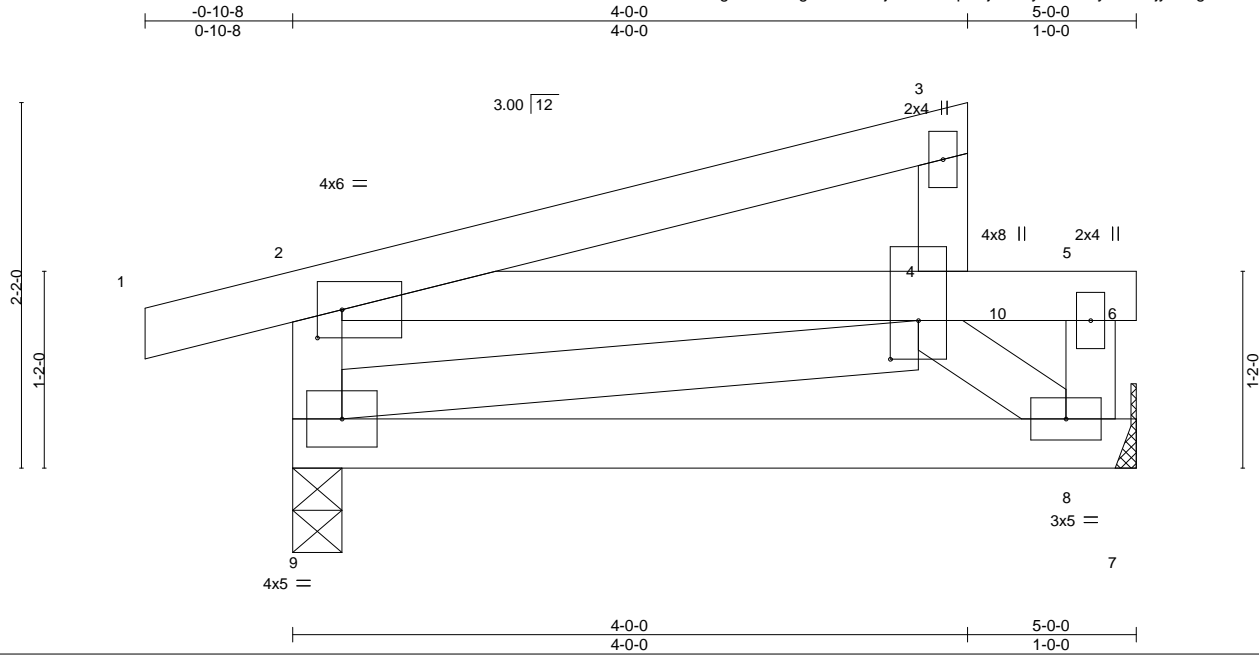

Scale = 1:13.7

Plate Offsets (X,Y)-- [2:0-1-12,0-2-0], [4:0-2-12,0-2-0]

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL (roof) 20.0	2-0-0	TC 0.31	in (loc) l/defl L/d	MT20	244/190
Snow (Pf/Pg) 18.9/20.0	Plate Grip DOL 1.15	BC 0.24	Vert(LL) 0.00 9 **** 240		
TCDL 10.0	Lumber DOL 1.15	WB 0.10	Vert(CT) -0.03 8-9 >999 180		
BCLL 0.0 *	Rep Stress Incr NO	Matrix-MP	Horz(CT) 0.00 8 n/a n/a		
BCDL 10.0	Code IRC2015/TPI2014			Weight: 32 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
 BOT CHORD 2x4 SP No.2
 WEBS 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 4-0-0 oc purlins, except end verticals, and 2-0-0 oc purlins: 2-6.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 9=0-3-8, 8=Mechanical
 Max Horz 9=48(LC 12)
 Max Uplift 9=-37(LC 11), 8=-21(LC 15)
 Max Grav 9=332(LC 35), 8=626(LC 33)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

BOT CHORD 8-9=-192/294
 WEBS 5-8=-282/138, 4-8=-416/271, 4-9=-302/146

NOTES-

- Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) and C-C Exterior(2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.33
- TCLL: ASCE 7-10; Pr=20.0 psf (roof live load); Lumber DOL=1.15 Plate DOL=1.15; Pg=20.0 psf (ground snow); Pf=18.9 psf (flat roof snow); Lumber DOL=1.15 Plate DOL=1.15; Category II; Exp B; Fully Exp.; Ct=1.10, Lu=50-0-0; Min. flat roof snow load governs. Rain surcharge applied to all exposed surfaces with slopes less than 0.500/12 in accordance with IBC 1608.3.4.
- Unbalanced snow loads have been considered for this design.
- This truss has been designed for greater of min roof live load of 12.0 psf or 2.00 times flat roof load of 13.9 psf on overhangs non-concurrent with other live loads.
- Provide adequate drainage to prevent water ponding.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 8.
- One RT7A USP connectors recommended to connect truss to bearing walls due to UPLIFT at jt(s) 9. This connection is for uplift only and does not consider lateral forces.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
- Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s). The design/selection of such connection device(s) is the responsibility of others.
- In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard

1) Dead + Snow (balanced): Lumber Increase=1.15, Plate Increase=1.15
 Uniform Loads (plf)
 Vert: 1-2=-48, 2-3=-48, 7-9=-20, 4-6=-58



February 5, 2021

Continued on page 2

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSITPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



818 Soundside Road
 Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	163 Crossings-Kessler C-Roof	E15385579
21020046-B	T5	Roof Special	5	1	Job Reference (optional)	

Carter Components (Sanford), Sanford, NC - 27332,

8.430 s Nov 30 2020 MiTek Industries, Inc. Fri Feb 5 12:41:55 2021 Page 2
 ID:PtkCJg6dYK9kVgNLGOOYIjzEbO4-RpN3jC8dayUeZr1KyhtXQBjyfY4ig0Y7VG0E8ezoBGA

LOAD CASE(S) Standard
 Concentrated Loads (lb)
 Vert: 10=-400(F)

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




818 Soundside Road
 Edenton, NC 27932

Job 21020046-B	Truss T5B	Truss Type Half Hip Structural Gable	Qty 1	Ply 1	163 Crossings-Kessler C-Roof Job Reference (optional)	E15385580
-------------------	--------------	-----------------------------------------	----------	----------	----------------------------------------------------------	-----------

Carter Components (Sanford), Sanford, NC - 27332,

8.430 s Nov 30 2020 MiTek Industries, Inc. Fri Feb 5 12:41:57 2021 Page 1

ID:PtKcJg6dYK9kVgNLGOOYIjzEbO4-NCVq8uAt6akMo9Bi45v?VcoGQMo88x6QyaVLCWzoBG8

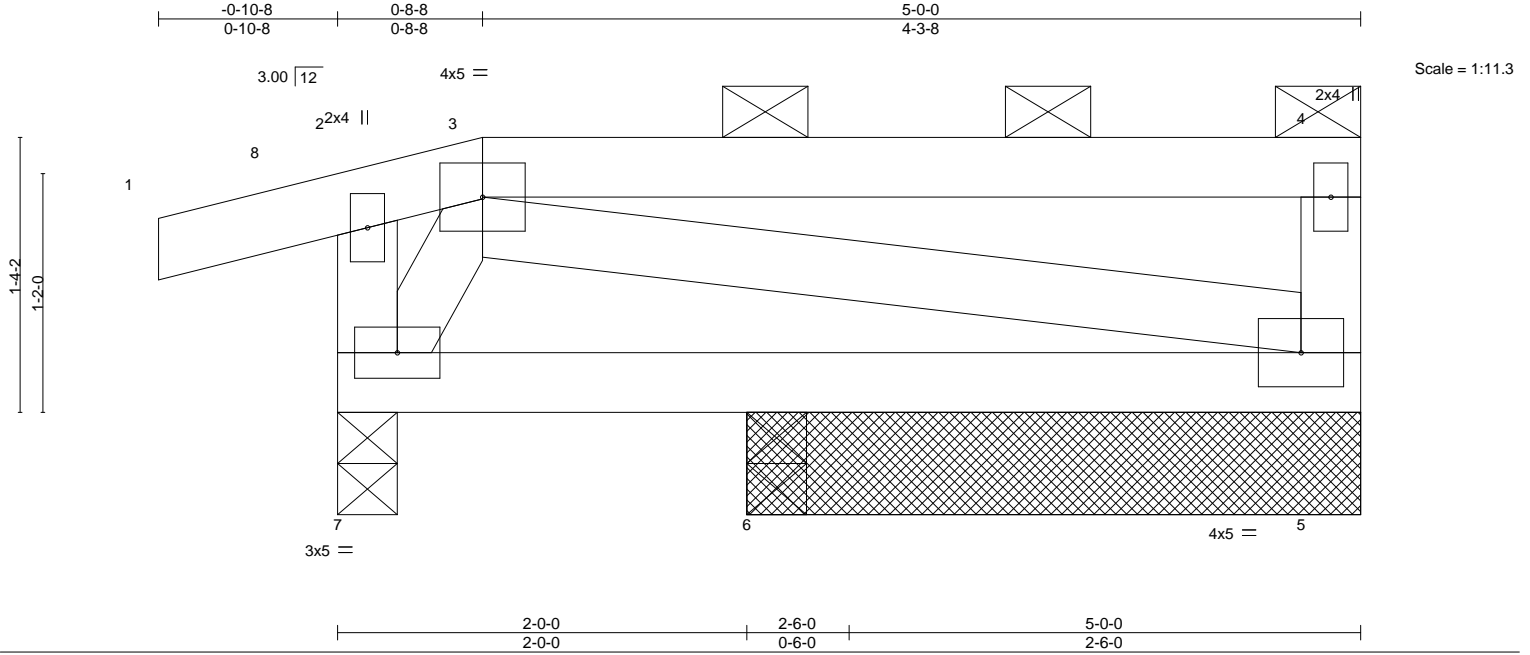

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL (roof) 20.0	2-0-0	TC 0.42	in (loc) l/defl L/d	MT20	244/190
Snow (Pf/Pg) 18.9/20.0	Plate Grip DOL 1.15	BC 0.05	Vert(LL) 0.00 6 **** 240		
TCDL 10.0	Lumber DOL 1.15	WB 0.03	Vert(CT) -0.00 5-6 >999 180		
BCLL 0.0 *	Rep Stress Incr YES	Matrix-MP	Horz(CT) -0.00 5 n/a n/a		
BCDL 10.0	Code IRC2015/TPI2014			Weight: 26 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 5-0-0 oc purlins, except end verticals, and 2-0-0 oc purlins: 3-4.
BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.

REACTIONS.

(size) 5=3-0-0, 7=0-3-8, 6=0-3-8
Max Horz 7=34(LC 12)
Max Uplift 5=-26(LC 12), 7=-59(LC 11)
Max Grav 5=190(LC 34), 7=222(LC 2), 6=60(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) and C-C Exterior(2) -0-10-8 to 4-10-4 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.33
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- TCLL: ASCE 7-10; Pr=20.0 psf (roof live load: Lumber DOL=1.15 Plate DOL=1.15); Pg=20.0 psf (ground snow); Pf=18.9 psf (flat roof snow: Lumber DOL=1.15 Plate DOL=1.15); Category II; Exp B; Fully Exp.; Ct=1.10, Lu=50-0-0; Min. flat roof snow load governs. Rain surcharge applied to all exposed surfaces with slopes less than 0.500/12 in accordance with IBC 1608.3.4.
- Unbalanced snow loads have been considered for this design.
- This truss has been designed for greater of min roof live load of 12.0 psf or 2.00 times flat roof load of 13.9 psf on overhangs non-concurrent with other live loads.
- Provide adequate drainage to prevent water ponding.
- Gable studs spaced at 2-0-0 oc.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- One RT7A USP connectors recommended to connect truss to bearing walls due to UPLIFT at jt(s) 5 and 7. This connection is for uplift only and does not consider lateral forces.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



February 5, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




818 Soundside Road
Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	163 Crossings-Kessler C-Roof	E15385581
21020046-B	T2GR	Common Girder	1	2	Job Reference (optional)	

Carter Components (Sanford), Sanford, NC - 27332,

8.430 s Nov 30 2020 MiTek Industries, Inc. Fri Feb 5 12:41:50 2021 Page 1

ID:TNeFWbLs0X_ZGWSZK6GEZizEerr-4saAgV5UIQsMS49M97HMj80?WXMMy?c6OL?ITSQzoBGF



4x6 ||

Scale = 1:79.2

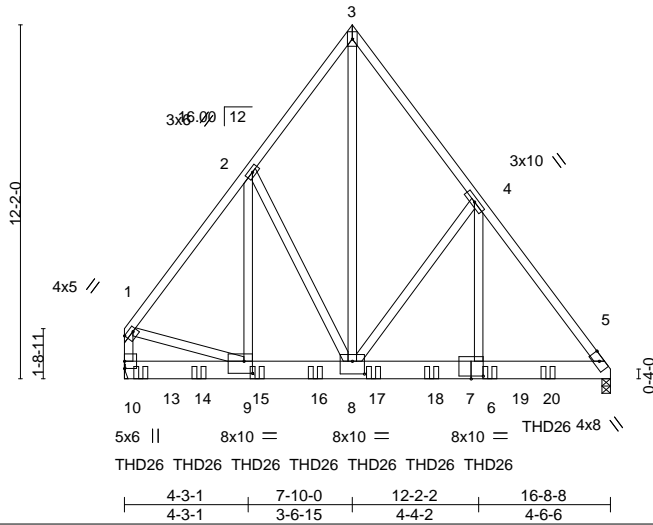


Plate Offsets (X,Y)-- [1:0-3-8,Edge], [7:0-5-0,0-1-2], [8:0-5-0,0-5-4], [9:0-3-8,0-5-0]

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof) 20.0	2-0-0	TC 0.65	Vert(LL) -0.06	6-8	>999	240	MT20	244/190
Snow (Pf/Pg) 13.9/20.0	Plate Grip DOL 1.15	BC 0.27	Vert(CT) -0.12	6-8	>999	180		
TCDL 10.0	Lumber DOL 1.15	WB 0.68	Horz(CT) 0.01	5	n/a	n/a		
BCLL 0.0 *	Rep Stress Incr NO	Matrix-MSH						
BCDL 10.0	Code IRC2015/TPI2014						Weight: 311 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
 BOT CHORD 2x8 SP 2400F 2.0E
 WEBS 2x4 SP No.2 *Except*
 1-10,1-9: 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 5-0-8 oc purlins, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 5=0-3-8, 10=Mechanical
 Max Horz 10=-261(LC 5)
 Max Grav 5=5353(LC 3), 10=6379(LC 3)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.


TOP CHORD 1-2=-4660/0, 2-3=-3682/0, 3-4=-3707/0, 4-5=-5707/0, 1-10=-4616/0
 BOT CHORD 9-10=-202/385, 8-9=0/2741, 6-8=0/3393, 5-6=0/3393
 WEBS 2-9=0/1702, 2-8=-1237/0, 3-8=0/5579, 4-8=-2040/0, 4-6=0/3042, 1-9=0/2674

NOTES-

- 2-ply truss to be connected together with 10d (0.131"x3") nails as follows:
 Top chords connected as follows: 2x4 - 1 row at 0-9-0 oc.
 Bottom chords connected as follows: 2x8 - 2 rows staggered at 0-6-0 oc.
 Webs connected as follows: 2x4 - 1 row at 0-9-0 oc.
- All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope); cantilever left and right exposed ; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.33
- TCLL: ASCE 7-10; Pr=20.0 psf (roof live load: Lumber DOL=1.15 Plate DOL=1.15); Pg=20.0 psf (ground snow); Pf=13.9 psf (flat roof snow: Lumber DOL=1.15 Plate DOL=1.15); Category II; Exp B; Fully Exp.; Ct=1.10
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Refer to girder(s) for truss to truss connections.
- Use USP THD26 (With 18-16d nails into Girder & 12-10d x 1-1/2 nails into Truss) or equivalent spaced at 2-0-0 oc max. starting at 0-6-12 from the left end to 14-6-12 to connect truss(es) to front face of bottom chord.
- Fill all nail holes where hanger is in contact with lumber.

LOAD CASE(S) Standard

- Dead + Snow (balanced): Lumber Increase=1.15, Plate Increase=1.15
 Uniform Loads (plf)
 Vert: 1-3=-48, 3-5=-48, 5-10=-20
 Concentrated Loads (lb)
 Vert: 13=-1068(F) 14=-1062(F) 15=-1062(F) 16=-1062(F) 17=-1062(F) 18=-1062(F) 19=-1062(F) 20=-1062(F)

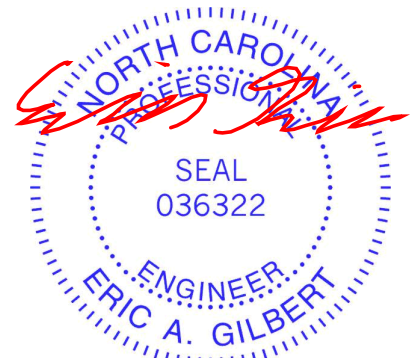

February 5, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



818 Soundside Road
 Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	163 Crossings-Kessler C-Roof	E15385582
21020046-B	T2GE	Roof Special Supported Gable	1	1	Job Reference (optional)	

Carter Components (Sanford), Sanford, NC - 27332,


8.430 s Nov 30 2020 MiTek Industries, Inc. Fri Feb 5 12:41:48 2021 Page 1

ID:IFTVCrDyc8c7RqWRBIZfcNzEes0-8TSQFp3EDpbeDm?_2iFuejwnokj3XpM5uhpMOYzoBGH

0-7-0 4-6-0 9-0-0 9-10-8
0-7-0 4-6-0 4-6-0 0-10-8

4x5 =

Scale = 1:49.8

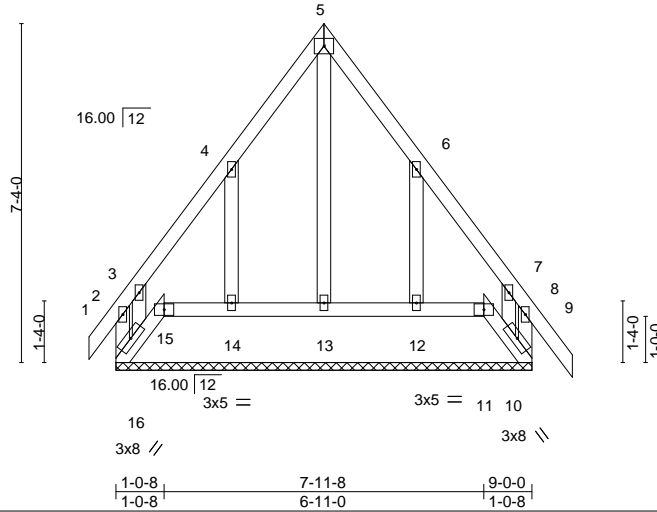

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof) 20.0	2-0-0	TC 0.16	Vert(LL) -0.00	9	n/r	120	MT20	244/190
Snow (Pf/Pg) 13.9/20.0	Plate Grip DOL 1.15	BC 0.11	Vert(CT) -0.01	9	n/r	120		
TCDL 10.0	Lumber DOL 1.15	WB 0.25	Horz(CT) 0.00	10	n/a	n/a		
BCLL 0.0 *	Rep Stress Incr YES	Matrix-R						
BCDL 10.0	Code IRC2015/TPI2014						Weight: 67 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
 BOT CHORD 2x4 SP No.2
 WEBS 2x4 SP No.3
 OTHERS 2x4 SP No.3 *Except*
 5-13: 2x4 SP No.2

BRACING-

TOP CHORD Sheathed or 6-0-0 oc purlins, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.

REACTIONS.

All bearings 9-0-0.
 (lb) - Max Horz 16=-175(LC 11)
 Max Uplift All uplift 100 lb or less at joint(s) 10, 11 except 16=-266(LC 9), 15=-174(LC 12), 14=-127(LC 13), 12=-124(LC 14)
 Max Grav All reactions 250 lb or less at joint(s) 10, 15, 11, 14, 12 except 16=309(LC 12), 13=251(LC 13)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 4-5=-260/314, 5-6=-260/314
 WEBS 5-13=-427/288, 4-14=-256/253, 6-12=-255/246

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) and C-C Exterior(2) zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.33
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- TCLL: ASCE 7-10; Pr=20.0 psf (roof live load: Lumber DOL=1.15 Plate DOL=1.15); Pg=20.0 psf (ground snow); Pf=13.9 psf (flat roof snow: Lumber DOL=1.15 Plate DOL=1.15); Category II; Exp B; Fully Exp.; Ct=1.10
- This truss has been designed for greater of min roof live load of 12.0 psf or 2.00 times flat roof load of 13.9 psf on overhangs non-concurrent with other live loads.
- All plates are 2x4 MT20 unless otherwise indicated.
- Gable requires continuous bottom chord bearing.
- Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
- Gable studs spaced at 2-0-0 oc.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- One RT7A USP connectors recommended to connect truss to bearing walls due to UPLIFT at jt(s) 16, 10, and 15. This connection is for uplift only and does not consider lateral forces.
- One RT16A USP connectors recommended to connect truss to bearing walls due to UPLIFT at jt(s) 11, 14, and 12. This connection is for uplift only and does not consider lateral forces.
- Beveled plate or shim required to provide full bearing surface with truss chord at joint(s) 16, 10, 15, 11, 13, 14, 12.



February 5, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSITPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



818 Soundside Road
 Edenton, NC 27932

Job 21020046-B	Truss T1AGE	Truss Type GABLE	Qty 1	Ply 1	163 Crossings-Kessler C-Roof Job Reference (optional)	E15385583
-------------------	----------------	---------------------	----------	----------	----------------------------------------------------------	-----------

Carter Components (Sanford), Sanford, NC - 27332,

8.430 s Nov 30 2020 MiTek Industries, Inc. Fri Feb 5 12:41:37 2021 Page 1

ID:eDGOGYH5RH5R9qJrZErXyLHGy2xKpQDCP4fsvvYJhPzvHlZqSttUMTfHVgzoBGS

-0-10-8 13-4-0 20-4-0 36-8-0 37-6-8
 0-10-8 13-4-0 7-0-0 16-4-0 0-10-8

Scale = 1:69.6

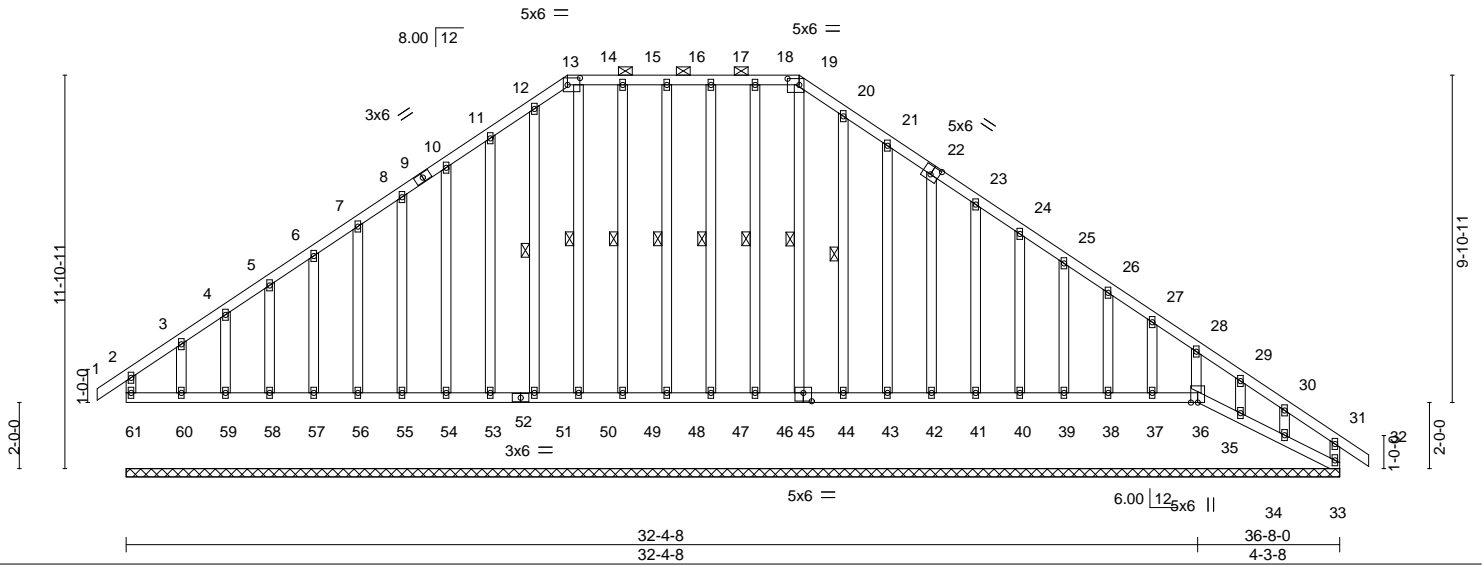


Plate Offsets (X,Y)-- [13:0-4-8,0-2-8], [19:0-4-4,0-2-4], [22:0-3-0,0-3-0], [45:0-3-0,0-3-0]

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL (roof) 20.0	2-0-0	TC 0.17	in (loc) l/defl L/d	MT20	244/190
Snow (Pf/Pg) 18.9/20.0	Plate Grip DOL 1.15	BC 0.09	Vert(LL) -0.00 32 n/r 120		
TCDL 10.0	Lumber DOL 1.15	WB 0.11	Vert(CT) -0.00 32 n/r 120		
BCLL 0.0 *	Rep Stress Incr YES	Matrix-R	Horz(CT) 0.01 33 n/a n/a		
BCDL 10.0	Code IRC2015/TPI2014			Weight: 344 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
 BOT CHORD 2x4 SP No.2
 WEBS 2x4 SP No.3
 OTHERS 2x4 SP No.2 *Except*
 6-57,5-58,4-59,3-60,24-40,25-39,26-38,27-37,28-36,29-35,30-34: 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 13-19. Rigid ceiling directly applied or 6-0-0 oc bracing.
 BOT CHORD
 WEBS 1 Row at midpt 19-45, 18-46, 17-47, 16-48, 15-49, 14-50, 12-51, 20-44

REACTIONS.

All bearings 36-8-0.
 (lb) - Max Horz 61=-237(LC 9)
 Max Uplift All uplift 100 lb or less at joint(s) 33, 47, 48, 49, 53, 54, 55, 56, 57, 58, 59, 44, 43, 42, 41, 40, 39, 38, 37 except 61=-143(LC 9), 60=-116(LC 10), 34=-104(LC 14)
 Max Grav All reactions 250 lb or less at joint(s) 61, 36, 33, 45, 46, 47, 48, 49, 50, 51, 53, 54, 55, 56, 57, 58, 59, 60, 44, 43, 42, 41, 40, 39, 38, 37, 35, 34

FORCES.

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 8-10=-213/254, 10-11=-245/293, 11-12=-285/339, 12-13=-288/342, 13-14=-259/314, 14-15=-259/314, 15-16=-259/314, 16-17=-259/314, 17-18=-259/314, 18-19=-260/314, 19-20=-298/358, 20-21=-275/328, 21-22=-238/285

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) and C-C Exterior(2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.33
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- TCLL: ASCE 7-10; Pr=20.0 psf (roof live load: Lumber DOL=1.15 Plate DOL=1.15); Pg=20.0 psf (ground snow); Pf=18.9 psf (flat roof snow: Lumber DOL=1.15 Plate DOL=1.15); Category II; Exp B; Fully Exp.; Ct=1.10, Lu=50-0-0; Min. flat roof snow load governs. Rain surcharge applied to all exposed surfaces with slopes less than 0.500/12 in accordance with IBC 1608.3.4.
- This truss has been designed for greater of min roof live load of 12.0 psf or 2.00 times flat roof load of 13.9 psf on overhangs non-concurrent with other live loads.
- Provide adequate drainage to prevent water ponding.
- All plates are 2x4 MT20 unless otherwise indicated.
- Gable requires continuous bottom chord bearing.
- Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
- Gable studs spaced at 1-4-0 oc.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.



February 5, 2021

Continued on page 2

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



818 Soundside Road
 Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	163 Crossings-Kessler C-Roof	E15385583
21020046-B	T1AGE	GABLE	1	1	Job Reference (optional)	

Carter Components (Sanford), Sanford, NC - 27332,

8.430 s Nov 30 2020 MiTek Industries, Inc. Fri Feb 5 12:41:38 2021 Page 2
ID:eDGOGYH5RrEPYbOPzr9qJRzEerx-QYre9OxyakL30EE3Sc3YEcW40il3BK6da7Oq17zoBGR

NOTES-

- 12) One RT16A USP connectors recommended to connect truss to bearing walls due to UPLIFT at jt(s) 61, 47, 48, 49, 53, 54, 55, 56, 57, 58, 59, 60, 44, 43, 42, 41, 40, 39, 38, 37, and 34. This connection is for uplift only and does not consider lateral forces.
- 13) One RT7A USP connectors recommended to connect truss to bearing walls due to UPLIFT at jt(s) 33. This connection is for uplift only and does not consider lateral forces.
- 14) Beveled plate or shim required to provide full bearing surface with truss chord at joint(s) 61, 36, 45, 46, 47, 48, 49, 50, 51, 53, 54, 55, 56, 57, 58, 59, 60, 44, 43, 42, 41, 40, 39, 38, 37, 35, 34.
- 15) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



818 Soundside Road
Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	163 Crossings-Kessler C-Roof	E15385584
21020046-B	T1A	Roof Special	4	1	Job Reference (optional)	

Carter Components (Sanford), Sanford, NC - 27332,

8.430 s Nov 30 2020 MiTek Industries, Inc. Fri Feb 5 12:41:34 2021 Page 1

ID:eDGOGYH5RbEPYbOPzr9qJRzEerx-Ync7J1uSWVrdYcwHdm?c4mLCu5jFFLg1fVQduMzoBGV

0-10-8 6-9-12 13-4-0 20-4-0 26-10-4 32-4-8 36-8-0 37-6-8
 0-10-8 6-9-12 6-6-4 7-0-0 6-6-4 5-6-4 4-3-8 0-10-8

Scale = 1:71.4

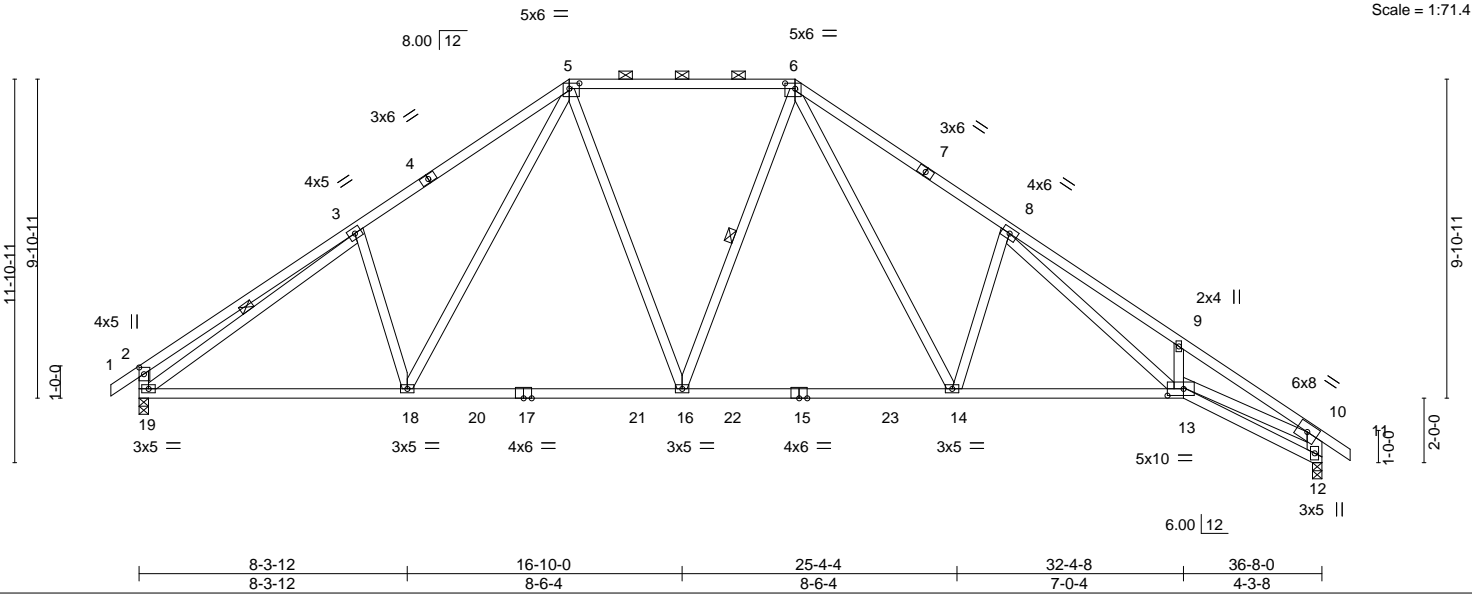


Plate Offsets (X,Y)-- [2:0-2-8,0-1-12], [5:0-3-12,0-2-0], [6:0-3-12,0-2-0], [13:0-6-0,0-2-8]

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof) 20.0	Plate Grip DOL 1.15	TC 0.95	Vert(LL) -0.28	14-16	>999	240	MT20	244/190
Snow (Pf/Pg) 18.9/20.0	Lumber DOL 1.15	BC 0.97	Vert(CT) -0.51	14-16	>855	180		
TCDL 10.0	Rep Stress Incr YES	WB 0.78	Horz(CT) 0.27	12	n/a	n/a		
BCLL 0.0 *	Code IRC2015/TPI2014	Matrix-MSH						
BCDL 10.0							Weight: 232 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied, except end verticals, and 2-0-0 oc purlins (2-2-0 max.): 5-6.
BOT CHORD 2x4 SP No.2	BOT CHORD Rigid ceiling directly applied or 2-2-0 oc bracing.
WEBS 2x4 SP No.2 *Except* 9-13,2-19: 2x4 SP No.3, 10-12: 2x6 SP No.2	WEBS 1 Row at midpt 6-16, 3-19

REACTIONS. (size) 12=0-3-8, 19=0-3-8
 Max Horz 19=-236(LC 9)
 Max Grav 12=1518(LC 2), 19=1513(LC 2)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-3=-523/244, 3-5=-1942/489, 5-6=-1420/385, 6-8=-2330/540, 8-9=-4045/742,
 9-10=-4089/599, 2-19=-484/228, 10-12=-1584/326
 BOT CHORD 18-19=-117/1701, 16-18=0/1367, 14-16=0/1401, 13-14=-181/2025, 12-13=-56/339
 WEBS 3-18=-306/244, 5-18=-141/546, 5-16=-22/392, 6-14=-209/1045, 8-14=-722/300,
 8-13=-331/1815, 3-19=-1616/153, 10-13=-377/3174

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) and C-C Exterior(2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.33
 - TCLL: ASCE 7-10; Pr=20.0 psf (roof live load: Lumber DOL=1.15 Plate DOL=1.15); Pg=20.0 psf (ground snow); Pf=18.9 psf (flat roof snow: Lumber DOL=1.15 Plate DOL=1.15); Category II; Exp B; Fully Exp.; Ct=1.10, Lu=50-0-0; Min. flat roof snow load governs. Rain surcharge applied to all exposed surfaces with slopes less than 0.500/12 in accordance with IBC 1608.3.4.
 - This truss has been designed for greater of min roof live load of 12.0 psf or 2.00 times flat roof load of 13.9 psf on overhangs non-concurrent with other live loads.
 - Provide adequate drainage to prevent water ponding.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - Bearing at joint(s) 12 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
 - Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



February 5, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



818 Soundside Road
 Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	163 Crossings-Kessler C-Roof	E15385585
21020046-B	T1BGE	GABLE	2	1	Job Reference (optional)	

Carter Components (Sanford), Sanford, NC - 27332,

8.430 s Nov 30 2020 MiTek Industries, Inc. Fri Feb 5 12:41:42 2021 Page 1

ID:3oyXuaJ_jcc_P27_fzjXx3zEeru-JJ59?m_TezrVvrXqhS8UOShcEJVP71gDVIM2AUzoBGN

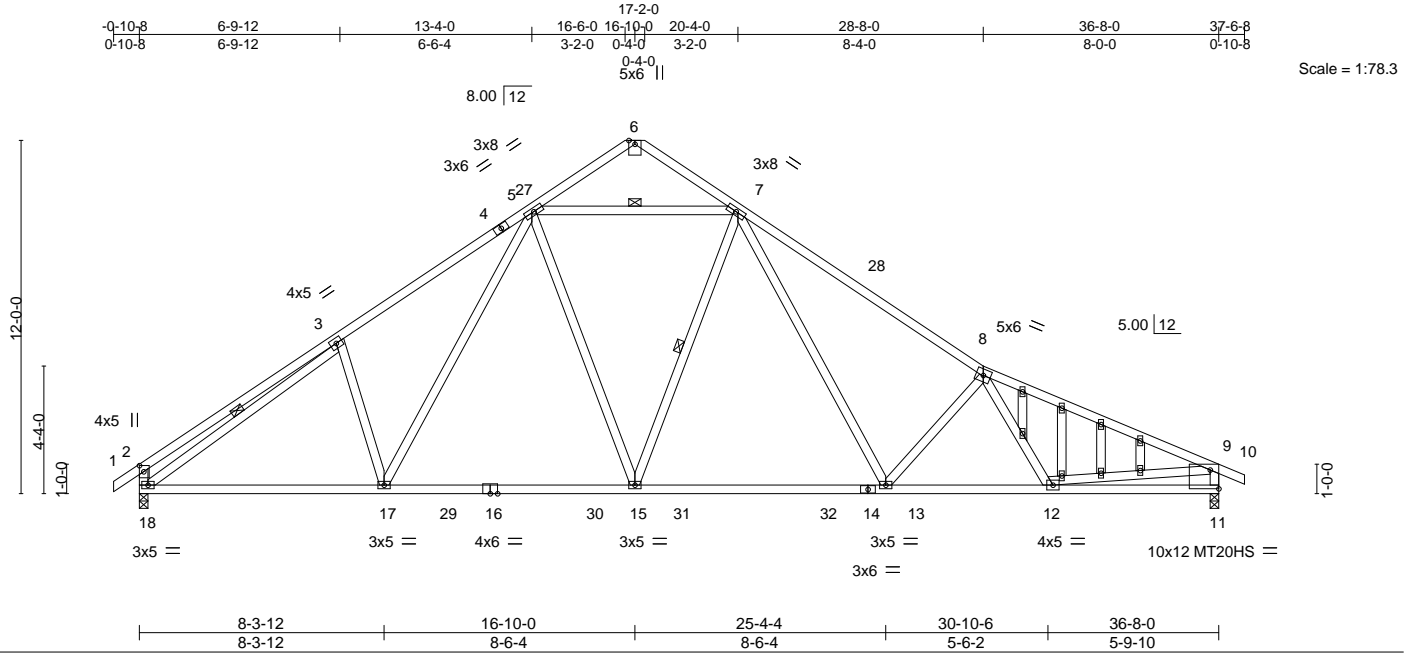


Plate Offsets (X,Y)-- [2:0-2-8,0-1-12], [11:Edge,0-7-11]

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL (roof) 20.0	2-0-0	TC 0.80	in (loc) l/defl L/d	MT20	244/190
Snow (Pf/Pg) 13.9/20.0	Plate Grip DOL 1.15	BC 0.83	Vert(LL) -0.21 15-17 >999 240	MT20HS	187/143
TCDL 10.0	Lumber DOL 1.15	WB 0.52	Vert(CT) -0.37 13-15 >999 180		
BCLL 0.0 *	Rep Stress Incr YES	Matrix-MSH	Horz(CT) 0.08 11 n/a n/a		
BCDL 10.0	Code IRC2015/TPI2014			Weight: 246 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2 *Except*
6-8: 2x4 SP 2400F 2.0E, 8-10: 2x4 SP No.1
BOT CHORD 2x4 SP No.2 *Except*
14-16: 2x4 SP No.1
WEBS 2x4 SP No.2 *Except*
8-13,8-12: 2x4 SP No.3
OTHERS 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 1 Row at midpt 7-15, 3-18, 5-7

REACTIONS.

(size) 18=0-3-8, 11=0-3-8
Max Horz 18=-255(LC 13)
Max Uplift 11=-6(LC 16)
Max Grav 18=1547(LC 29), 11=1516(LC 2)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-557/255, 3-5=-2002/478, 7-8=-2286/506, 8-9=-2459/438, 2-18=-504/237,
9-11=-1452/357
BOT CHORD 17-18=-172/1774, 15-17=-41/1468, 13-15=-71/1502, 12-13=-335/2251, 11-12=-211/540
WEBS 3-17=-272/233, 5-17=-130/510, 5-15=-50/443, 7-13=-166/840, 8-13=-752/301,
3-18=-1646/137, 9-12=-85/1792, 5-7=-1427/440

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) and C-C Exterior(2) zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.33
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- TCLL: ASCE 7-10; Pr=20.0 psf (roof live load: Lumber DOL=1.15 Plate DOL=1.15); Pg=20.0 psf (ground snow); Pf=13.9 psf (flat roof snow: Lumber DOL=1.15 Plate DOL=1.15); Category II; Exp B; Fully Exp.; Ct=1.10
- Unbalanced snow loads have been considered for this design.
- This truss has been designed for greater of min roof live load of 12.0 psf or 2.00 times flat roof load of 13.9 psf on overhangs non-concurrent with other live loads.
- All plates are MT20 plates unless otherwise indicated.
- All plates are 2x4 MT20 unless otherwise indicated.
- Gable studs spaced at 1-4-0 oc.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- One RT7A USP connectors recommended to connect truss to bearing walls due to UPLIFT at jt(s) 11. This connection is for uplift only and does not consider lateral forces.



February 5, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MI-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




818 Soundside Road
Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	163 Crossings-Kessler C-Roof	E15385586
21020046-B	T1B	Roof Special	3	1	Job Reference (optional)	

Carter Components (Sanford), Sanford, NC - 27332,

8.430 s Nov 30 2020 MiTek Industries, Inc. Fri Feb 5 12:41:41 2021 Page 1

ID:3oyXuaJ_jcc_P27_fzjXx3zEeru-r7XnnQ_rtfjethye8kdFsE8RUv9AOaQ3H5dVeSzoBGO

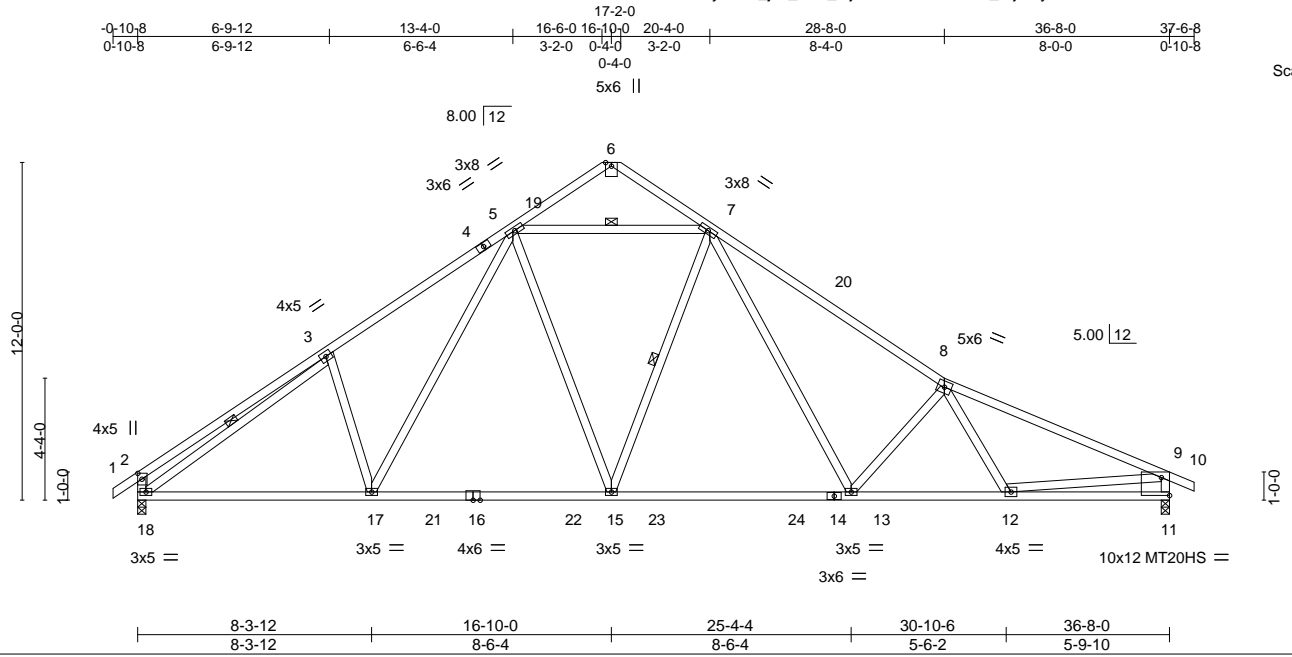

Scale = 1:81.9

Plate Offsets (X,Y)-- [2:0-2-8,0-1-12], [1:Edge,0-7-11]

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL (roof) 20.0	2-0-0	TC 0.80	in (loc) l/defl L/d	MT20	244/190
Snow (Pf/Pg) 13.9/20.0	Plate Grip DOL 1.15	BC 0.83	Vert(LL) -0.21 15-17 >999 240	MT20HS	187/143
TCDL 10.0	Lumber DOL 1.15	WB 0.52	Vert(CT) -0.37 13-15 >999 180		
BCLL 0.0 *	Rep Stress Incr YES	Matrix-MSH	Horz(CT) 0.08 11 n/a n/a		
BCDL 10.0	Code IRC2015/TPI2014			Weight: 236 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2 *Except*
6-8: 2x4 SP 2400F 2.0E, 8-10: 2x4 SP No.1
BOT CHORD 2x4 SP No.2 *Except*
14-16: 2x4 SP No.1
WEBS 2x4 SP No.2 *Except*
8-13,8-12: 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 1 Row at midpt 7-15, 3-18, 5-7

REACTIONS.


(size) 18=0-3-8, 11=0-3-8
Max Horz 18=-255(LC 13)
Max Uplift 11=-6(LC 16)
Max Grav 18=1547(LC 29), 11=1516(LC 2)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-557/255, 3-5=-2002/478, 7-8=-2286/506, 8-9=-2459/438, 2-18=-504/237,
9-11=-1452/357
BOT CHORD 17-18=-172/1774, 15-17=-41/1468, 13-15=-71/1502, 12-13=-335/2251, 11-12=-211/540
WEBS 3-17=-272/233, 5-17=-130/510, 5-15=-50/443, 7-13=-166/840, 8-13=-752/301,
3-18=-1646/137, 9-12=-85/1792, 5-7=-1427/440

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) and C-C Exterior(2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.33
- TCLL: ASCE 7-10; Pr=20.0 psf (roof live load: Lumber DOL=1.15 Plate DOL=1.15); Pg=20.0 psf (ground snow); Pf=13.9 psf (flat roof snow: Lumber DOL=1.15 Plate DOL=1.15); Category II; Exp B; Fully Exp.; Ct=1.10
- Unbalanced snow loads have been considered for this design.
- This truss has been designed for greater of min roof live load of 12.0 psf or 2.00 times flat roof load of 13.9 psf on overhangs non-concurrent with other live loads.
- All plates are MT20 plates unless otherwise indicated.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- One RT7A USP connectors recommended to connect truss to bearing walls due to UPLIFT at jt(s) 11. This connection is for uplift only and does not consider lateral forces.

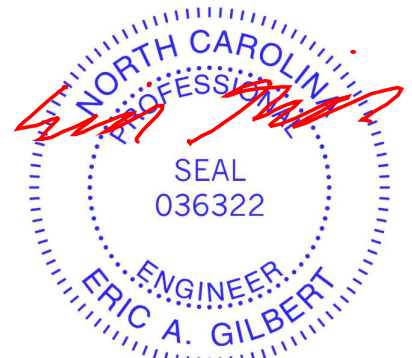

February 5, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



818 Soundside Road
Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	163 Crossings-Kessler C-Roof	E15385587
21020046-B	T1	FAN	8	1		

Carter Components (Sanford), Sanford, NC - 27332,

8.430 s Nov 30 2020 MiTek Industries, Inc. Fri Feb 5 12:41:32 2021 Page 1

ID:7PqmTuHjB_MG9IzbXYg3sezEerw-cOUNuLiB_uavlJmv6Lz8_LG?UH6VnU9ICBxWpTzoBGX



Scale = 1:74.8

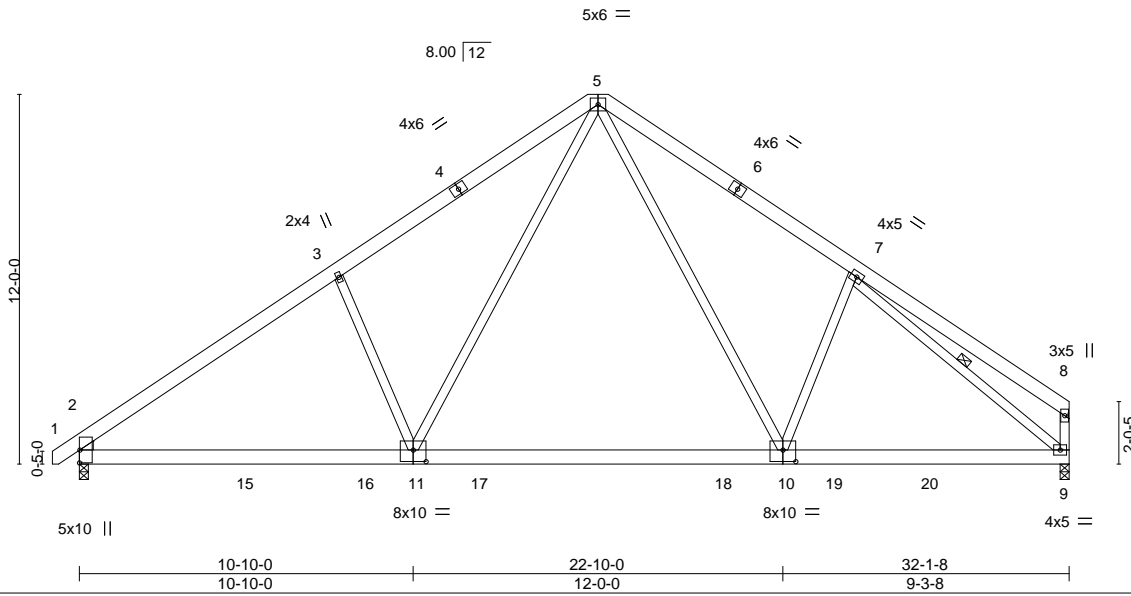


Plate Offsets (X,Y)-- [10:0-5-0,0-4-8], [11:0-5-0,0-4-8]

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL (roof) 20.0	2-0-0	TC 0.37	in (loc) l/defl L/d	MT20	244/190
Snow (Pf/Pg) 13.9/20.0	Plate Grip DOL 1.15	BC 0.67	Vert(LL) -0.23 10-11 >999 240		
TCDL 10.0	Lumber DOL 1.15	WB 0.59	Vert(CT) -0.36 10-11 >999 180		
BCLL 0.0 *	Rep Stress Incr YES	Matrix-MSH	Horz(CT) 0.04 9 n/a n/a		
BCDL 10.0	Code IRC2015/TPI2014			Weight: 240 lb	FT = 20%

LUMBER-

TOP CHORD 2x6 SP No.2
 BOT CHORD 2x6 SP No.2
 WEBS 2x4 SP No.2 *Except*
 8-9: 2x4 SP No.3

WEDGE
 Left: 2x4 SP No.3

REACTIONS. (size) 2=0-3-8, 9=0-3-8
 Max Horz 2=250(LC 12)
 Max Grav 2=1443(LC 25), 9=1393(LC 26)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-3=-1929/328, 3-5=-1796/443, 5-7=-1649/420, 8-9=-259/130
 BOT CHORD 2-11=-217/1653, 10-11=-27/1047, 9-10=-179/1291
 WEBS 3-11=-455/302, 5-11=-163/953, 5-10=-123/695, 7-10=-263/270, 7-9=-1601/204

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) and C-C Exterior(2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.33
- TCLL: ASCE 7-10; Pr=20.0 psf (roof live load: Lumber DOL=1.15 Plate DOL=1.15); Pg=20.0 psf (ground snow); Pf=13.9 psf (flat roof snow: Lumber DOL=1.15 Plate DOL=1.15); Category II; Exp B; Fully Exp.; Ct=1.10
- This truss has been designed for greater of min roof live load of 12.0 psf or 2.00 times flat roof load of 13.9 psf on overhangs non-concurrent with other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.



February 5, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



818 Soundside Road
 Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	163 Crossings-Kessler C-Roof	E15385588
21020046-B	T1GE	GABLE	1	1	Job Reference (optional)	

Carter Components (Sanford),

Sanford, NC - 27332,

8.430 s Nov 30 2020 MiTek Industries, Inc. Fri Feb 5 12:41:45 2021 Page 1

ID:7PqmTuHjB_MG9lzbXYg3sezEerw-jumHdn1LxuD3MJGPNaiB04IH4WiSKUDfBjbinDzoBGK

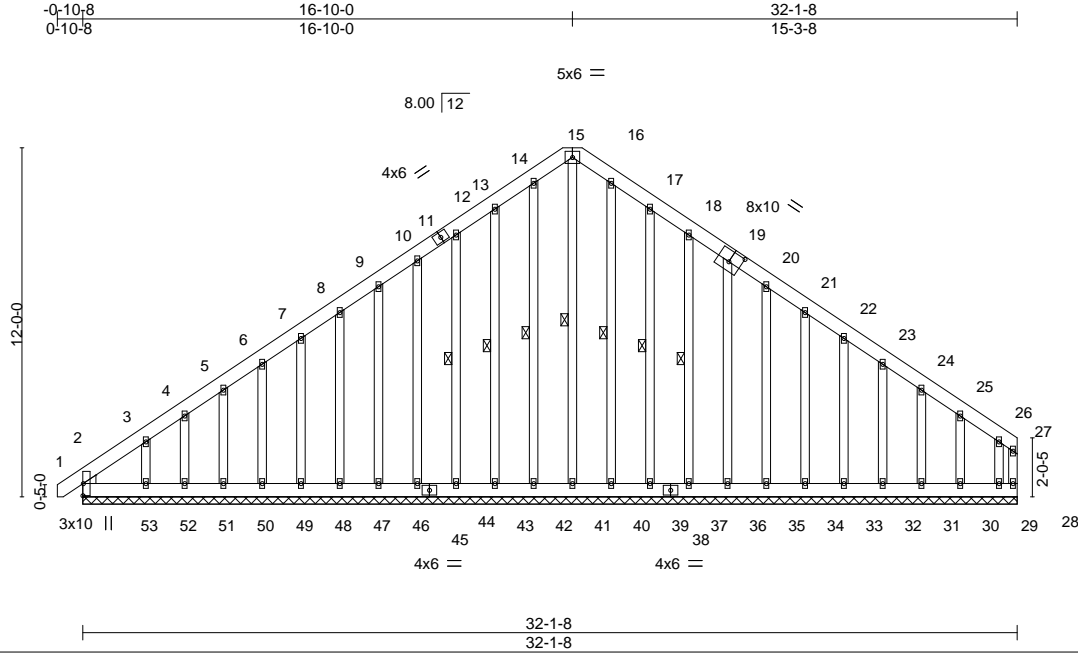


Plate Offsets (X,Y)-- [19:0-5-0,0-4-8]

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL (roof) 20.0	2-0-0	TC 0.12	in (loc) l/defl L/d	MT20	244/190
Snow (Pf/Pg) 13.9/20.0	Plate Grip DOL 1.15	BC 0.04	Vert(LL) -0.00 1 n/r 120		
TCDL 10.0	Lumber DOL 1.15	WB 0.15	Vert(CT) 0.00 1 n/r 120		
BCLL 0.0 *	Rep Stress Incr YES	Matrix-SH	Horz(CT) 0.00 28 n/a n/a		
BCDL 10.0	Code IRC2015/TPI2014			Weight: 383 lb	FT = 20%

LUMBER-

TOP CHORD 2x6 SP No.2
 BOT CHORD 2x6 SP No.2
 WEBS 2x4 SP No.3
 OTHERS 2x4 SP No.2 *Except*
 6-50,5-51,4-52,3-53,23-32,24-31,25-30,26-29: 2x4 SP No.3

WEDGE
 Left: 2x4 SP No.3

REACTIONS.

All bearings 32-1-8.
 (lb) - Max Horz 2=250(LC 10)
 Max Uplift All uplift 100 lb or less at joint(s) 28, 41, 42, 43, 44, 46, 47, 48, 49, 50, 51, 52, 53, 39, 37, 36, 35, 34, 33, 32, 31, 30 except 2=-135(LC 9), 29=-117(LC 14)
 Max Grav All reactions 250 lb or less at joint(s) 2, 28, 41, 42, 43, 44, 46, 47, 48, 49, 50, 51, 52, 53, 40, 39, 37, 36, 35, 34, 33, 32, 31, 30, 29

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-285/266, 10-12=-243/283, 12-13=-281/327, 13-14=-316/371, 14-15=-304/356, 15-16=-304/356, 16-17=-316/371, 17-18=-280/326, 18-19=-244/283

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) and C-C Exterior(2) zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.33
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- TCLL: ASCE 7-10; Pr=20.0 psf (roof live load: Lumber DOL=1.15 Plate DOL=1.15); Pg=20.0 psf (ground snow); Pf=13.9 psf (flat roof snow: Lumber DOL=1.15 Plate DOL=1.15); Category II; Exp B; Fully Exp.; Ct=1.10
- This truss has been designed for greater of min roof live load of 12.0 psf or 2.00 times flat roof load of 13.9 psf on overhangs non-concurrent with other live loads.
- All plates are 2x4 MT20 unless otherwise indicated.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 1-4-0 oc.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- One RT7A USP connectors recommended to connect truss to bearing walls due to UPLIFT at jt(s) 2, 28, 41, 42, 43, 44, 46, 47, 48, 49, 50, 51, 52, 53, 39, 37, 36, 35, 34, 33, 32, 31, 30, and 29. This connection is for uplift only and does not consider lateral forces.



February 5, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




818 Soundside Road
 Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	163 Crossings-Kessler C-Roof	E15385589
21020046-B	V3	Valley	1	1	Job Reference (optional)	


Carter Components (Sanford), Sanford, NC - 27332,

8.430 s Nov 30 2020 MiTek Industries, Inc. Fri Feb 5 12:41:58 2021 Page 1

ID:EebFdWED8msrg7gqljc7hozEes_rO3CMEBVttsDQImvdpQE2qLU7m69tNGZBEEukzzoBG7



Scale = 1:60.0

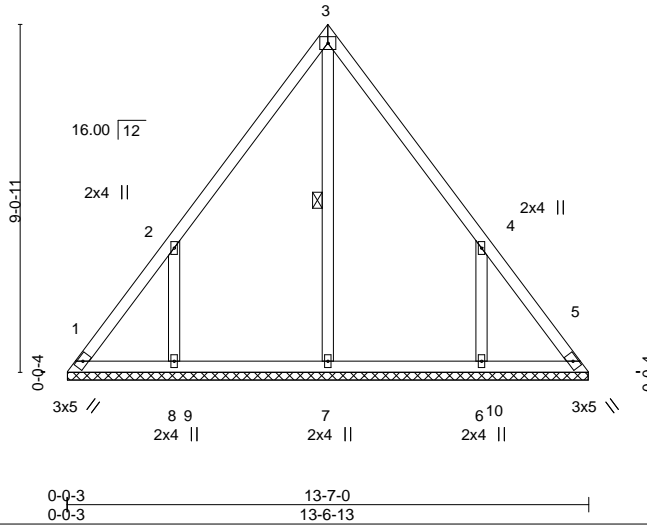

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof) 20.0	2-0-0	TC 0.23	Vert(LL)	n/a	-	n/a	MT20	244/190
Snow (Pf/Pg) 13.9/20.0	Plate Grip DOL 1.15	BC 0.19	Vert(CT)	n/a	-	n/a		
TCDL 10.0	Lumber DOL 1.15	WB 0.11	Horz(CT)	0.00	5	n/a		
BCLL 0.0 *	Rep Stress Incr YES	Matrix-SH					Weight: 74 lb	FT = 20%
BCDL 10.0	Code IRC2015/TPI2014							

LUMBER-

TOP CHORD 2x4 SP No.2
 BOT CHORD 2x4 SP No.2
 OTHERS 2x4 SP No.3 *Except*
 3-7: 2x4 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
 WEBS 1 Row at midpt 3-7

REACTIONS.


All bearings 13-6-10.
 (lb) - Max Horz 1=186(LC 10)
 Max Uplift All uplift 100 lb or less at joint(s) 1, 5 except 8=205(LC 13), 6=204(LC 14)
 Max Grav All reactions 250 lb or less at joint(s) 1, 5 except 7=338(LC 27), 8=437(LC 24), 6=437(LC 25)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

WEBS 2-8=-417/378, 4-6=-417/378

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) and C-C Exterior(2) zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.33
- TCLL: ASCE 7-10; Pr=20.0 psf (roof live load; Lumber DOL=1.15 Plate DOL=1.15); Pg=20.0 psf (ground snow); Pf=13.9 psf (flat roof snow; Lumber DOL=1.15 Plate DOL=1.15); Category II; Exp B; Fully Exp.; Ct=1.10
- Gable requires continuous bottom chord bearing.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- One RT7A USP connectors recommended to connect truss to bearing walls due to UPLIFT at jt(s) 1, 5, 8, and 6. This connection is for uplift only and does not consider lateral forces.

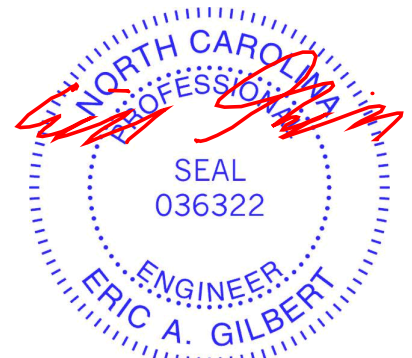

February 5, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




818 Soundside Road
 Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	163 Crossings-Kessler C-Roof	E15385590
21020046-B	V4	Valley	1	1	Job Reference (optional)	

Carter Components (Sanford), Sanford, NC - 27332,


8.430 s Nov 30 2020 MiTek Industries, Inc. Fri Feb 5 12:41:59 2021 Page 1

ID:EebFdWED8msrg7gqljc7hozEes_-JacaZaC7eB_42SL5BWYTa1ueOASmcqBjPu_RHPzoBG6



4x5 =

Scale = 1:51.3

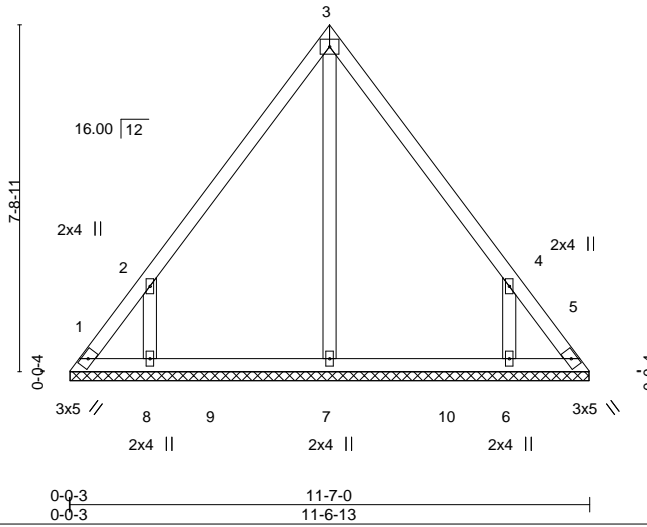


LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof) 20.0	2-0-0	TC 0.26	Vert(LL)	n/a	-	n/a	MT20	244/190
Snow (Pf/Pg) 13.9/20.0	Plate Grip DOL 1.15	BC 0.16	Vert(CT)	n/a	-	n/a		
TCDL 10.0	Lumber DOL 1.15	WB 0.12	Horz(CT)	0.00	5	n/a		
BCLL 0.0 *	Rep Stress Incr YES	Matrix-SH					Weight: 60 lb	FT = 20%
BCDL 10.0	Code IRC2015/TPI2014							

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD 2x4 SP No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
OTHERS 2x4 SP No.3 *Except*	
3-7: 2x4 SP No.2	

REACTIONS. All bearings 11-6-10.
 (lb) - Max Horz 1=157(LC 10)
 Max Uplift All uplift 100 lb or less at joint(s) 5 except 1=118(LC 11), 8=196(LC 13), 6=196(LC 14)
 Max Grav All reactions 250 lb or less at joint(s) 1, 5 except 7=314(LC 27), 8=396(LC 24), 6=396(LC 25)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 WEBS 2-8=-423/396, 4-6=-423/396

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) and C-C Exterior(2) zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.33
 - TCLL: ASCE 7-10; Pr=20.0 psf (roof live load: Lumber DOL=1.15 Plate DOL=1.15); Pg=20.0 psf (ground snow); Pf=13.9 psf (flat roof snow: Lumber DOL=1.15 Plate DOL=1.15); Category II; Exp B; Fully Exp.; Ct=1.10
 - Gable requires continuous bottom chord bearing.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - One RT7A USP connectors recommended to connect truss to bearing walls due to UPLIFT at jt(s) 1, 5, 8, and 6. This connection is for uplift only and does not consider lateral forces.

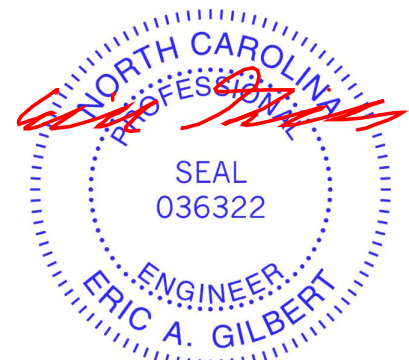


February 5, 2021

Job	Truss	Truss Type	Qty	Ply	163 Crossings-Kessler C-Roof	E15385591
21020046-B	V5	Valley	1	1	Job Reference (optional)	

Carter Components (Sanford), Sanford, NC - 27332,


8.430 s Nov 30 2020 MiTek Industries, Inc. Fri Feb 5 12:42:00 2021 Page 1

ID:iq9ersFrv3_iIHf0sQ7ME0zEerz-nnAynvCIOV6xfcvHIETI7FQoNZmclHtseYj?przoBG5



4x5 =

Scale = 1:41.9

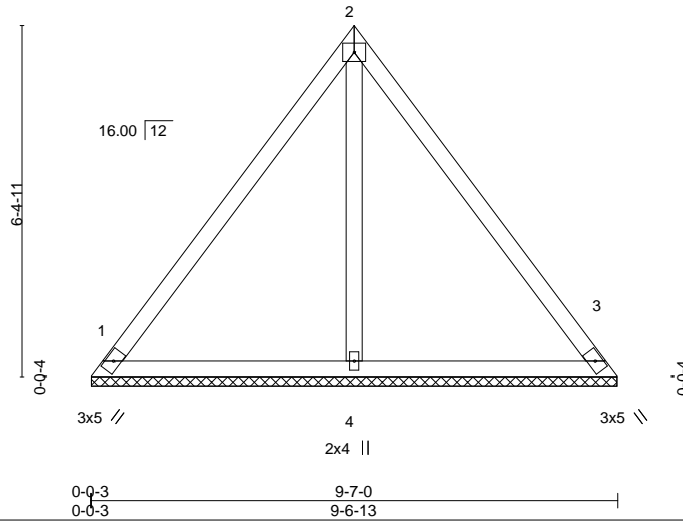

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL (roof) 20.0	2-0-0	TC 0.31	in (loc) l/defl L/d	MT20	244/190
Snow (Pf/Pg) 13.9/20.0	Plate Grip DOL 1.15	BC 0.32	Vert(LL) n/a - n/a 999		
TCDL 10.0	Lumber DOL 1.15	WB 0.09	Vert(CT) n/a - n/a 999		
BCLL 0.0 *	Rep Stress Incr YES	Matrix-SH	Horz(CT) 0.00 3 n/a n/a		
BCDL 10.0	Code IRC2015/TPI2014			Weight: 45 lb	FT = 20%

LUMBER-
TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
OTHERS 2x4 SP No.2


BRACING-
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (size) 1=9-6-10, 3=9-6-10, 4=9-6-10
Max Horz 1=128(LC 9)
Max Uplift 1=10(LC 14), 3=2(LC 13)
Max Grav 1=207(LC 2), 3=207(LC 2), 4=306(LC 2)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) and C-C Exterior(2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.33
- TCLL: ASCE 7-10; Pr=20.0 psf (roof live load: Lumber DOL=1.15 Plate DOL=1.15); Pg=20.0 psf (ground snow); Pf=13.9 psf (flat roof snow: Lumber DOL=1.15 Plate DOL=1.15); Category II; Exp B; Fully Exp.; Ct=1.10
- Gable requires continuous bottom chord bearing.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- One RT7A USP connectors recommended to connect truss to bearing walls due to UPLIFT at jt(s) 1 and 3. This connection is for uplift only and does not consider lateral forces.

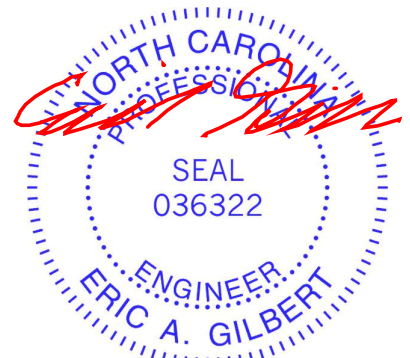

February 5, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



818 Soundside Road
Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	163 Crossings-Kessler C-Roof	E15385592
21020046-B	V6	Valley	1	1	Job Reference (optional)	

Carter Components (Sanford), Sanford, NC - 27332,


8.430 s Nov 30 2020 MiTek Industries, Inc. Fri Feb 5 12:42:01 2021 Page 1

ID:iq9ersFrv3_iIHf0sQ7ME0zEerz-FzkK_FDO9oEoHmUUJx_xgSzyYz9Q4In0tCTYLHzoBG4



4x5 =

Scale = 1:34.1

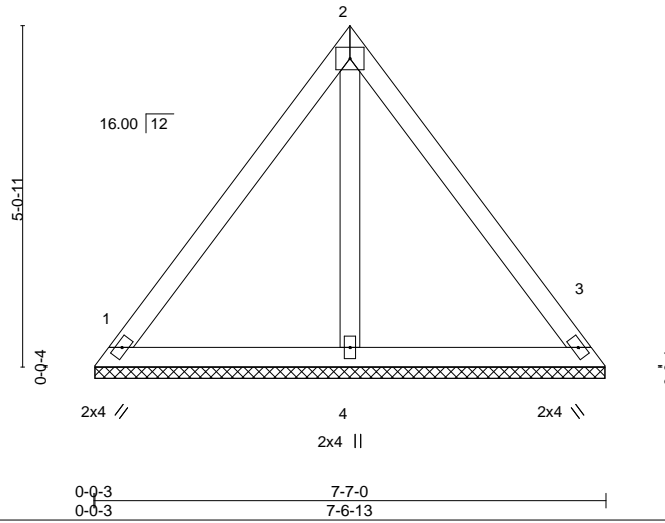

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof) 20.0	2-0-0	TC 0.35	Vert(LL)	n/a	-	n/a	MT20	244/190
Snow (Pf/Pg) 13.9/20.0	Plate Grip DOL 1.15	BC 0.09	Vert(CT)	n/a	-	n/a		
TCDL 10.0	Lumber DOL 1.15	WB 0.05	Horz(CT)	0.00	3	n/a		
BCLL 0.0 *	Rep Stress Incr YES	Matrix-P					Weight: 35 lb	FT = 20%
BCDL 10.0	Code IRC2015/TPI2014							

LUMBER-
 TOP CHORD 2x4 SP No.2
 BOT CHORD 2x4 SP No.2
 OTHERS 2x4 SP No.3

BRACING-
 TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (size) 1=7-6-10, 3=7-6-10, 4=7-6-10
 Max Horz 1=100(LC 9)
 Max Uplift 1=-26(LC 14), 3=-20(LC 13)
 Max Grav 1=181(LC 2), 3=181(LC 2), 4=198(LC 2)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) and C-C Exterior(2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.33
- TCLL: ASCE 7-10; Pr=20.0 psf (roof live load: Lumber DOL=1.15 Plate DOL=1.15); Pg=20.0 psf (ground snow); Pf=13.9 psf (flat roof snow: Lumber DOL=1.15 Plate DOL=1.15); Category II; Exp B; Fully Exp.; Ct=1.10
- Gable requires continuous bottom chord bearing.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- One RT7A USP connectors recommended to connect truss to bearing walls due to UPLIFT at jt(s) 1 and 3. This connection is for uplift only and does not consider lateral forces.



February 5, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



818 Soundside Road
 Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	163 Crossings-Kessler C-Roof	E15385593
21020046-B	V7	Valley	1	1	Job Reference (optional)	

Carter Components (Sanford), Sanford, NC - 27332,


8.430 s Nov 30 2020 MiTek Industries, Inc. Fri Feb 5 12:42:02 2021 Page 1

ID:iq9ersFrv3_i1HF0sQ7ME0zEerz-j9IjBbE0w6Mfvw3gsfVACgWAvNWKpCR96sC6tkzoBG3



4x5 =

Scale = 1:25.9

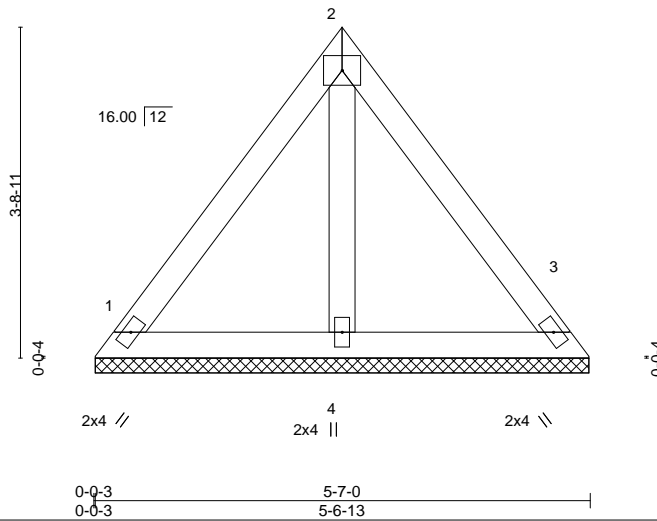

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof) 20.0	2-0-0	TC 0.18	Vert(LL)	n/a	-	n/a	MT20	244/190
Snow (Pf/Pg) 13.9/20.0	Plate Grip DOL 1.15	BC 0.05	Vert(CT)	n/a	-	n/a		
TCDL 10.0	Lumber DOL 1.15	WB 0.02	Horz(CT)	0.00	3	n/a		
BCLL 0.0 *	Rep Stress Incr YES	Matrix-P					Weight: 25 lb	FT = 20%
BCDL 10.0	Code IRC2015/TPI2014							

LUMBER-

TOP CHORD 2x4 SP No.2
 BOT CHORD 2x4 SP No.2
 OTHERS 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 5-7-0 oc purlins.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.


REACTIONS.

(size) 1=5-6-10, 3=5-6-10, 4=5-6-10
 Max Horz 1=71(LC 12)
 Max Uplift 1=19(LC 14), 3=-14(LC 13)
 Max Grav 1=129(LC 2), 3=129(LC 2), 4=141(LC 2)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) and C-C Exterior(2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.33
- TCLL: ASCE 7-10; Pr=20.0 psf (roof live load: Lumber DOL=1.15 Plate DOL=1.15); Pg=20.0 psf (ground snow); Pf=13.9 psf (flat roof snow: Lumber DOL=1.15 Plate DOL=1.15); Category II; Exp B; Fully Exp.; Ct=1.10
- Gable requires continuous bottom chord bearing.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- One RT7A USP connectors recommended to connect truss to bearing walls due to UPLIFT at jt(s) 1 and 3. This connection is for uplift only and does not consider lateral forces.

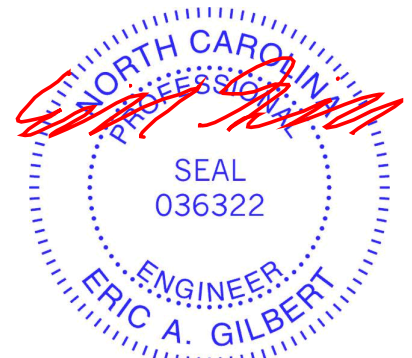

February 5, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



818 Soundside Road
 Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	163 Crossings-Kessler C-Roof	E15385594
21020046-B	T2SE	Roof Special Structural Gable	1	1	Job Reference (optional)	

Carter Components (Sanford), Sanford, NC - 27332,

8.430 s Nov 30 2020 MiTek Industries, Inc. Fri Feb 5 12:41:51 2021 Page 1
ID:5cxTQtsVuVnpxZc_0HIXVWzEa?K-Y28Yur56Wk_D4EjZrobGLYCdXgk54Yaf20_tzoBGE

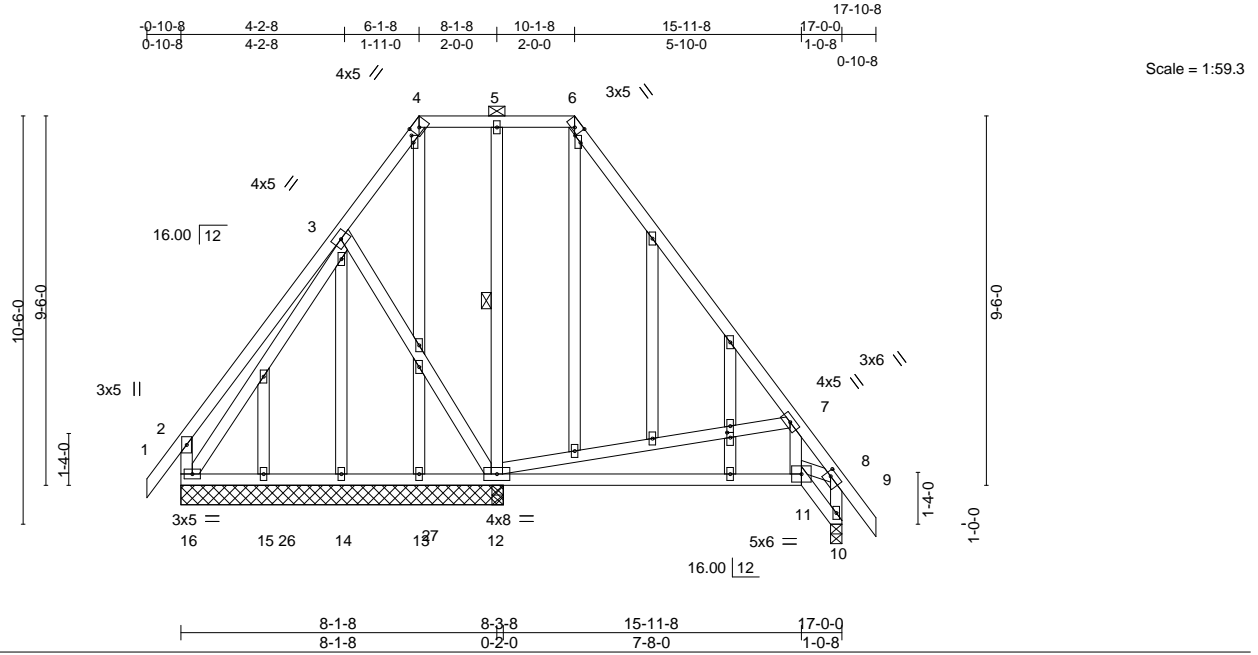


Plate Offsets (X,Y)-- [4:0-2-3,Edge], [4:0-2-3,0-0-10], [6:Edge,0-1-10], [6:0-2-3,Edge], [8:0-1-8,0-1-12], [25:0-1-9,0-1-0]

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL (roof) 20.0	1-11-4	TC 0.57	in (loc) l/defl L/d	MT20	244/190
Snow (Pf/Pg) 18.9/20.0	Plate Grip DOL 1.15	BC 0.35	Vert(LL) -0.01 11-12 >999 240		
TCDL 10.0	Lumber DOL 1.15	WB 0.57	Vert(CT) -0.10 11-12 >999 180		
BCLL 0.0 *	Rep Stress Incr YES	Matrix-MSH	Horz(CT) 0.02 10 n/a n/a		
BCDL 10.0	Code IRC2015/TPI2014			Weight: 173 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
 BOT CHORD 2x4 SP No.2
 WEBS 2x4 SP No.2 *Except*
 8-10,7-11,8-11,2-16: 2x4 SP No.3
 OTHERS 2x4 SP No.2 *Except*
 13-17,15-19,23-25,24-25: 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 4-6.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing, Except: 6-0-0 oc bracing: 10-11.
 WEBS 1 Row at midpt 5-12

REACTIONS.

All bearings 8-3-8 except (jt=length) 10=0-3-8.
 (lb) - Max Horz 16=243(LC 12)
 Max Uplift All uplift 100 lb or less at joint(s) 10, 12, 16, 13
 Max Grav All reactions 250 lb or less at joint(s) 14, 15 except 10=540(LC 2), 12=414(LC 29), 16=480(LC 2)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-400/387, 3-4=-268/221, 8-10=-519/58, 2-16=-450/380, 6-7=-401/182,
 7-8=-564/110
 BOT CHORD 11-12=-159/549
 WEBS 7-12=-540/337, 8-11=-210/602, 3-16=-254/122

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) and C-C Exterior(2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.33
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- TCLL: ASCE 7-10; Pr=20.0 psf (roof live load); Lumber DOL=1.15 Plate DOL=1.15; Pg=20.0 psf (ground snow); Pf=18.9 psf (flat roof snow); Lumber DOL=1.15 Plate DOL=1.15; Category II; Exp B; Fully Exp.; Ct=1.10, Lu=50-0-0; Min. flat roof snow load governs. Rain surcharge applied to all exposed surfaces with slopes less than 0.500/12 in accordance with IBC 1608.3.4.
- This truss has been designed for greater of min roof live load of 12.0 psf or 2.00 times flat roof load of 13.9 psf on overhangs non-concurrent with other live loads.
- Provide adequate drainage to prevent water ponding.
- All plates are 2x4 MT20 unless otherwise indicated.
- Gable studs spaced at 2-0-0 oc.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Bearing at joint(s) 10 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- One RT7A USP connectors recommended to connect truss to bearing walls due to UPLIFT at jt(s) 10, 12, 16, and 13. This connection is for uplift only and does not consider lateral forces.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



February 5, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSITPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



818 Soundside Road
 Edenton, NC 27932

Job 21020046-B	Truss T1AGR	Truss Type COMMON GIRDER	Qty 1	Ply 3	163 Crossings-Kessler C-Roof	E15385595
-------------------	----------------	-----------------------------	----------	----------	------------------------------	-----------

Carter Components (Sanford), Sanford, NC - 27332,

8.430 s Nov 30 2020 MiTek Industries, Inc. Fri Feb 5 12:41:40 2021 Page 1

ID:eDGOGYH5RrEPYbOPzr9qJRzEerx-NwzOa4zD6LbnGXORa160J1bL2V?tfB9w2Rtx6?zoBGP

0-10-8	4-5-2	8-6-12	12-8-6	16-10-0	22-0-0	25-0-8	32-3-0	33-6-8	36-8-0
0-10-8	4-5-2	4-1-10	4-1-10	4-1-10	5-2-0	3-0-8	7-2-8	1-3-8	3-1-8

Scale = 1:78.3

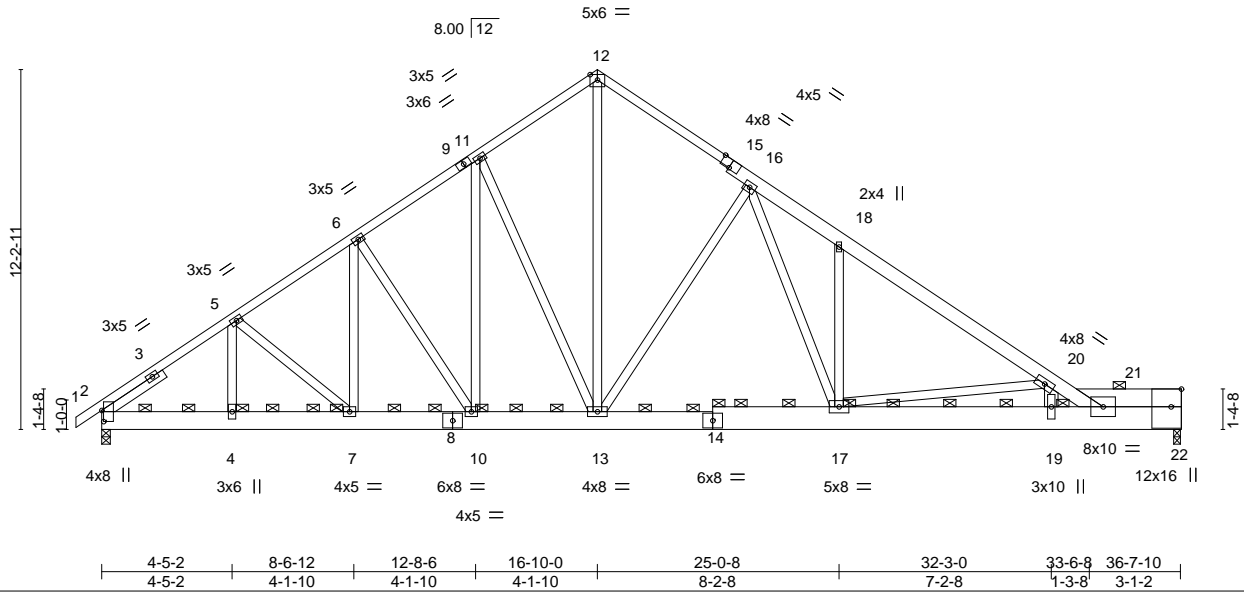


Plate Offsets (X,Y)-- [2:0-4-9,0-0-12], [15:0-4-0,Edge], [22:0-7-4,Edge]

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL (roof) 20.0	2-0-0	TC 0.46	in (loc) l/defl L/d	MT20	244/190
Snow (Pf/Pg) 18.9/20.0	Plate Grip DOL 1.15	BC 0.00	Vert(LL) -0.18 18-20 >999 240		
TCDL 15.0	Lumber DOL 1.15	WB 0.27	Vert(CT) -0.26 18-20 >999 180		
BCLL 0.0 *	Rep Stress Incr YES	Matrix-MSH	Horz(CT) 0.01 22 n/a n/a		
BCDL 15.0	Code IRC2015/TPI2014			Weight: 1011 lb	FT = 20%

LUMBER-
 TOP CHORD 2x4 SP No.2 *Except*
 15-21: 2x6 SP No.2, 21-22: 2x8 SP 2400F 2.0E
 BOT CHORD 2x8 SP 2400F 2.0E *Except*
 14-22: 2x10 SP 2400F 2.0E
 WEBS 2x4 SP No.2 *Except*
 4-5,5-7: 2x4 SP No.3, 19-20: 2x6 SP No.2
 SLIDER Left 2x4 SP No.3 -1 2-6-0

BRACING-
 TOP CHORD Sheathed or 6-0-0 oc purlins, except
 2-0-0 oc purlins (10-0-0 max.): 22-23.
 BOT CHORD 10-0-0 oc bracing.
 JOINTS 1 Brace at Jt(s): 4, 7, 10, 13, 17


REACTIONS. (size) 2=0-3-8, 22=0-2-12
 Max Horz 2=244(LC 8)
 Max Uplift 2=-634(LC 10), 22=-627(LC 10)
 Max Grav 2=3026(LC 2), 22=3343(LC 2)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-5=-3934/869, 5-6=-3989/897, 6-11=-3602/843, 11-12=-3195/789, 12-16=-3281/772,
 16-18=-5798/1239, 18-20=-5811/1107, 20-21=-10139/1912, 2-4=-681/3206,
 4-7=-681/3206, 7-10=-614/3281, 10-13=-489/2924, 13-17=-576/3708, 17-19=-1607/8571,
 19-21=-1607/8571, 21-22=-101/513
 WEBS 4-5=-266/22, 6-7=-171/440, 6-10=-653/231, 10-11=-237/664, 11-13=-814/302,
 12-13=-782/3071, 13-16=-2066/495, 16-17=-641/2927, 17-18=-704/205, 17-20=-3919/824,
 19-20=-462/2614

NOTES-

- 3-ply truss to be connected together with Simpson SDS 1/4 x 4-1/2 screws as follows:
 Top chords connected as follows: 2x4 - 1 row at 0-9-0 oc, 2x6 - 2 rows staggered at 0-9-0 oc, 2x8 - 2 rows staggered at 0-9-0 oc.
 Bottom chords connected as follows: 2x8 - 2 rows staggered at 0-9-0 oc, 2x10 - 2 rows staggered at 0-9-0 oc.
 Webs connected as follows: 2x4 - 1 row at 0-9-0 oc, 2x6 - 2 rows staggered at 0-9-0 oc.
- All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope); cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.33
- TCLL: ASCE 7-10; Pr=20.0 psf (roof live load); Lumber DOL=1.15 Plate DOL=1.15; Pg=20.0 psf (ground snow); Pf=18.9 psf (flat roof snow); Lumber DOL=1.15 Plate DOL=1.15; Category II; Exp B; Fully Exp.; Ct=1.10, Lu=50-0-0; Min. flat roof snow load governs. Rain surcharge applied to all exposed surfaces with slopes less than 0.500/12 in accordance with IBC 1608.3.4.
- This truss has been designed for greater of min roof live load of 12.0 psf or 2.00 times flat roof load of 13.9 psf on overhangs non-concurrent with other live loads.
- Provide adequate drainage to prevent water ponding.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.

Confirmed on general connection (by others) of truss to bearing plate at joint(s) 22.

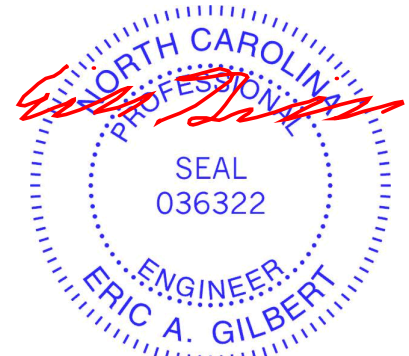

February 5, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



818 Soundside Road
 Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	163 Crossings-Kessler C-Roof	E15385595
21020046-B	T1AGR	COMMON GIRDER	1	3	Job Reference (optional)	

Carter Components (Sanford), Sanford, NC - 27332,

8.430 s Nov 30 2020 MiTek Industries, Inc. Fri Feb 5 12:41:40 2021 Page 2
 ID:eDGOGYH5RhEPYbOPzr9qJRzEerx-NwzOa4zD6LbnGXORa160J1bL2V?fb9w2Rtx6?zoBGP

NOTES-

- 10) One RT8A USP connectors recommended to connect truss to bearing walls due to UPLIFT at jt(s) 2 and 22. This connection is for uplift only and does not consider lateral forces.
- 11) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



818 Soundside Road
 Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	163 Crossings-Kessler C-Roof	E15385596
21020046-B	T2	Roof Special	2	1	Job Reference (optional)	

Carter Components (Sanford), Sanford, NC - 27332,

8.430 s Nov 30 2020 MiTek Industries, Inc. Fri Feb 5 12:41:47 2021 Page 1
 ID:3oyXuaJ_jcc_P27_fzjXx3zEeru-gHu22T2cSVTnbcQnU?kf5VOSiKEqoKHf14pr5zoBGI

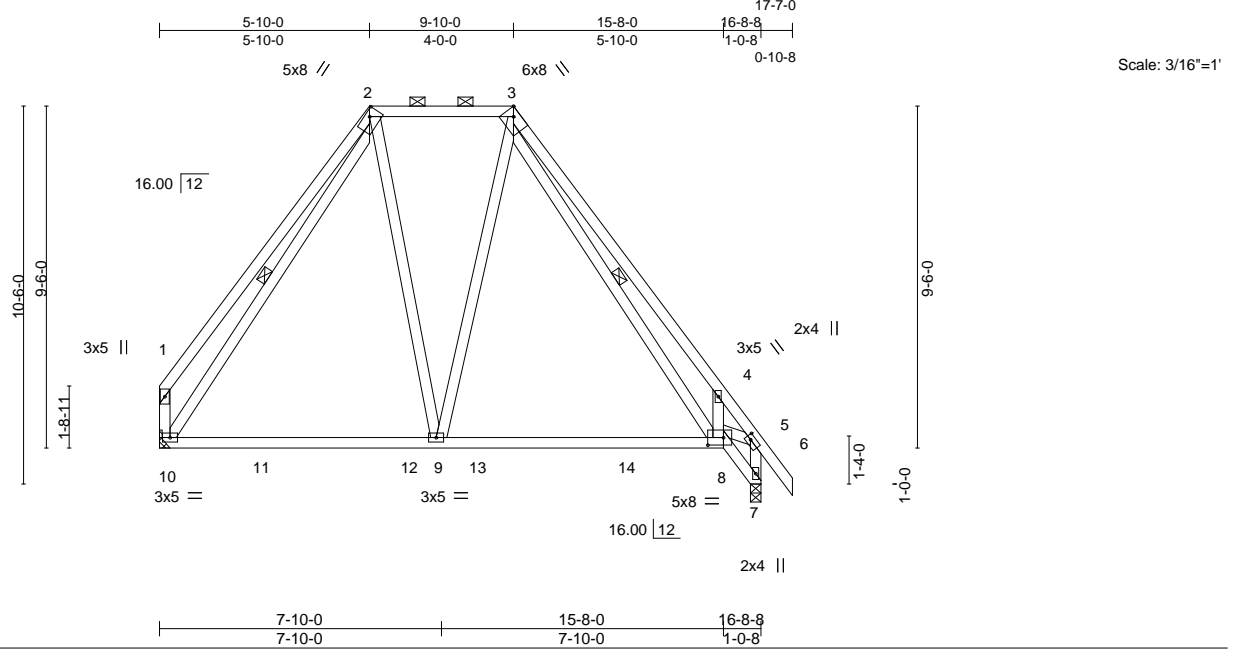


Plate Offsets (X,Y)-- [2:0-3-0,0-1-8], [3:0-2-13,Edge], [5:0-1-8,0-1-8], [8:0-5-4,0-2-8]

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL (roof) 20.0	1-11-4	TC 0.81	in (loc) l/defl L/d	MT20	244/190
Snow (Pf/Pg) 18.9/20.0	Plate Grip DOL 1.15	BC 0.68	Vert(LL) -0.11 8-9 >999 240		
TCDL 10.0	Lumber DOL 1.15	WB 0.37	Vert(CT) -0.21 8-9 >960 180		
BCLL 0.0 *	Rep Stress Incr YES	Matrix-MSH	Horz(CT) -0.05 10 n/a n/a		
BCDL 10.0	Code IRC2015/TPI2014			Weight: 132 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
 BOT CHORD 2x4 SP No.2
 WEBS 2x4 SP No.2 *Except*
 5-7,4-8,5-8,1-10: 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 2-3.
 BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.
 WEBS 1 Row at midpt 3-8, 2-10

REACTIONS.


(size) 7=0-3-8, 10=Mechanical
 Max Horz 7=-239(LC 9)
 Max Grav 7=721(LC 25), 10=697(LC 26)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-2=-503/435, 2-3=-385/226, 3-4=-1364/880, 4-5=-955/261, 5-7=-876/189,
 1-10=-512/402
 BOT CHORD 9-10=-35/333, 8-9=-81/384, 7-8=-319/298
 WEBS 2-9=-58/305, 3-8=-748/948, 4-8=-793/662, 5-8=-226/679, 2-10=-454/114

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) and C-C Exterior(2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.33
- TCLL: ASCE 7-10; Pr=20.0 psf (roof live load); Lumber DOL=1.15 Plate DOL=1.15; Pg=20.0 psf (ground snow); Pf=18.9 psf (flat roof snow); Lumber DOL=1.15 Plate DOL=1.15; Category II; Exp B; Fully Exp.; Ct=1.10, Lu=50-0-0; Min. flat roof snow load governs. Rain surcharge applied to all exposed surfaces with slopes less than 0.500/12 in accordance with IBC 1608.3.4.
- This truss has been designed for greater of min roof live load of 12.0 psf or 2.00 times flat roof load of 13.9 psf on overhangs non-concurrent with other live loads.
- Provide adequate drainage to prevent water ponding.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Refer to girder(s) for truss to truss connections.
- Bearing at joint(s) 7 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

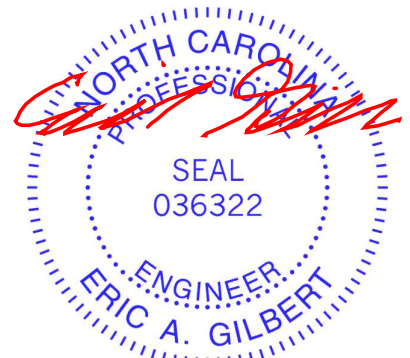

February 5, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




818 Soundside Road
 Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	163 Crossings-Kessler C-Roof	E15385597
21020046-B	V8	Valley	1	1	Job Reference (optional)	

Carter Components (Sanford), Sanford, NC - 27332,

8.430 s Nov 30 2020 MiTek Industries, Inc. Fri Feb 5 12:42:03 2021 Page 1

ID:iq9ersFrv3_iIHf0sQ7ME0zEerz-CMs5PxFehQUWW4esQM0Plt2NUns?YfsJKWyfQAzoBG2

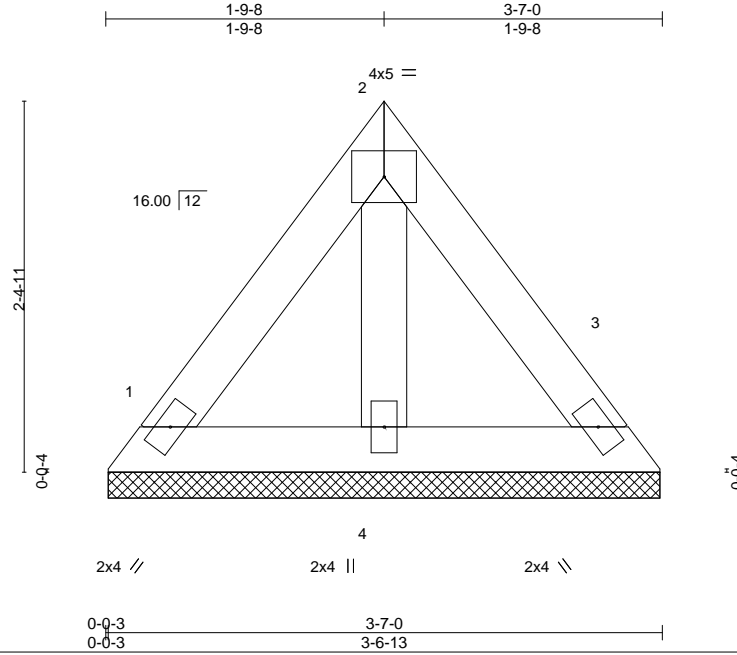

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof) 20.0	2-0-0	TC 0.06	Vert(LL)	n/a	-	n/a	MT20	244/190
Snow (Pf/Pg) 13.9/20.0	Plate Grip DOL 1.15	BC 0.02	Vert(CT)	n/a	-	n/a		
TCDL 10.0	Lumber DOL 1.15	WB 0.01	Horz(CT)	0.00	3	n/a		
BCLL 0.0 *	Rep Stress Incr YES	Matrix-P					Weight: 15 lb	FT = 20%
BCDL 10.0	Code IRC2015/TPI2014							

LUMBER-
TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
OTHERS 2x4 SP No.3

BRACING-
TOP CHORD Structural wood sheathing directly applied or 3-7-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (size) 1=3-6-10, 3=3-6-10, 4=3-6-10
Max Horz 1=43(LC 10)
Max Uplift 1=11(LC 14), 3=9(LC 13)
Max Grav 1=78(LC 2), 3=78(LC 2), 4=85(LC 2)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) and C-C Exterior(2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.33
- TCLL: ASCE 7-10; Pr=20.0 psf (roof live load: Lumber DOL=1.15 Plate DOL=1.15); Pg=20.0 psf (ground snow); Pf=13.9 psf (flat roof snow: Lumber DOL=1.15 Plate DOL=1.15); Category II; Exp B; Fully Exp.; Ct=1.10
- Gable requires continuous bottom chord bearing.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- One RT7A USP connectors recommended to connect truss to bearing walls due to UPLIFT at jt(s) 1 and 3. This connection is for uplift only and does not consider lateral forces.



February 5, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.


Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




818 Soundside Road
Edenton, NC 27932

Symbols

PLATE LOCATION AND ORIENTATION



Center plate on joint unless x, y offsets are indicated. Dimensions are in ft-in-sixteenths. Apply plates to both sides of truss and fully embed teeth.

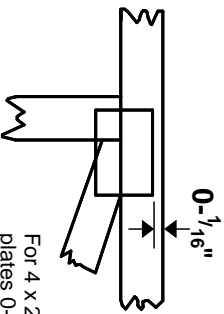

For 4 x 2 orientation, locate plates 0- 1/16" from outside edge of truss.



This symbol indicates the required direction of slots in connector plates.

* Plate location details available in **MITek 20/20 software** or upon request.

PLATE SIZE

4 X 4


The first dimension is the plate width measured perpendicular to slots. Second dimension is the length parallel to slots.

LATERAL BRACING LOCATION



Indicated by symbol shown and/or by text in the bracing section of the output. Use T or I bracing if indicated.

BEARING




Indicates location where bearings (supports) occur. Icons vary but reaction section indicates joint number where bearings occur. Min size shown is for crushing only.

Industry Standards:

ANSI/TPI 1: National Design Specification for Metal Plate Connected Wood Truss Construction.
DSB-89: Design Standard for Bracing, Building Component Safety Information, Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses.

Numbering System

6-4-8
dimensions shown in ft-in-sixteenths
(Drawings not to scale)

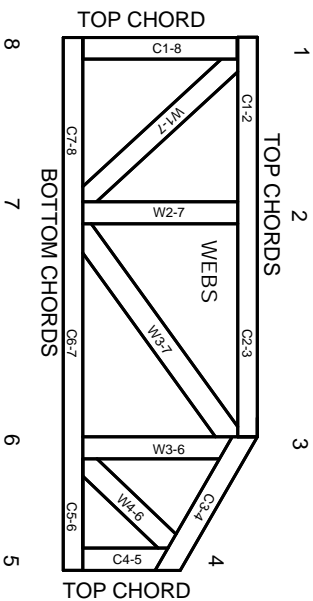

JOINTS ARE GENERALLY NUMBERED/LETTERED CLOCKWISE AROUND THE TRUSS STARTING AT THE JOINT FARTHEST TO THE LEFT.

CHORDS AND WEBS ARE IDENTIFIED BY END JOINT NUMBERS/LETTERS.

PRODUCT CODE APPROVALS

ICC-ES Reports:

ESR-1311, ESR-1352, ESR1988
ER-3907, ESR-2362, ESR-1397, ESR-3282

Trusses are designed for wind loads in the plane of the truss unless otherwise shown.

Lumber design values are in accordance with ANSI/TPI 1 section 6.3 These truss designs rely on lumber values established by others.

© 2012 MITteK® All Rights Reserved



MITek Engineering Reference Sheet: MII-7473 rev. 5/19/2020



General Safety Notes

Failure to Follow Could Cause Property Damage or Personal Injury

1. Additional stability bracing for truss system, e.g. diagonal or X-bracing, is always required. See BCSI.
2. Truss bracing must be designed by an engineer. For wide truss spacing, individual lateral braces themselves may require bracing, or alternative Tor I bracing should be considered.
3. Never exceed the design loading shown and never stack materials on inadequately braced trusses.
4. Provide copies of this truss design to the building designer, erection supervisor, property owner and all other interested parties.
5. Cut members to bear tightly against each other.
6. Place plates on each face of truss at each joint and embed fully. Knots and wane at joint locations are regulated by ANSI/TPI 1.
7. Design assumes trusses will be suitably protected from the environment in accord with ANSI/TPI 1.
8. Unless otherwise noted, moisture content of lumber shall not exceed 19% at time of fabrication.
9. Unless expressly noted, this design is not applicable for use with fire retardant, preservative treated, or green lumber.
10. Camber is a non-structural consideration and is the responsibility of truss fabricator. General practice is to camber for dead load deflection.
11. Plate type, size, orientation and location dimensions indicated are minimum plating requirements.
12. Lumber used shall be of the species and size, and in all respects, equal to or better than that specified.
13. Top chords must be sheathed or purlins provided at spacing indicated on design.
14. Bottom chords require lateral bracing at 10 ft. spacing, or less, if no ceiling is installed, unless otherwise noted.
15. Connections not shown are the responsibility of others.
16. Do not cut or alter truss member or plate without prior approval of an engineer.
17. Install and load vertically unless indicated otherwise.
18. Use of green or treated lumber may pose unacceptable environmental, health or performance risks. Consult with project engineer before use.
19. Review all portions of this design (front, back, words and pictures) before use. Rewriting pictures alone is not sufficient.
20. Design assumes manufacture in accordance with ANSI/TPI 1 Quality Criteria.
21. The design does not take into account any dynamic or other loads other than those expressly stated.