


DOOR OPTION

### SQUARE FOOTAGE

949 SQ. FT. ist FLOOR: 1351 SQ. FT. 2nd FLOOR: TOTAL: 2300 SQ. FT. FRONT PORCH: 137 SQ. FT. STD. REAR PATIO: GARAGE: 401 SQ. FT.

SQUARE FOOTAGE (OPTIONS) 9<del>99 3</del>Q. FT FIRST FLOOR (BRICK): SECOND FLOOR (BRICK): 1405 SQ. FT. TOTAL (BRICK): 24Ø4 SQ. FT. GARAGE (BRICK): 418 SQ. FT. FRONT PORCH (WRAP OPTION): 53 SQ. FT. REAR PORCH (8-Ø DEEP): 96 SQ. FT. REAR PORCH (12-0 DEEP): 144 SQ. FT. OPT. PATIO/ DECK. (8-0 DEEP) 88 SQ. FT. OPT. PATIO/ DECK: (12-0 DEEP) 132 SQ. FT. I-CAR GARAGE: 240 SQ. FT.



RENAISSANCE

RESIDENTIAL DESIGN, INC. RALEIGH, NC 27612 (919) 649-4128 WWW.RRDCAROLINA.COM

"The art of transforming your vision into reality." RENAISSANCE RESIDENTIAL DESIGN, INC. RESERVES THE RIGHT TO MAKE MODIFICATIONS TO FLOOR PLANS, DIMENSIONS, MATERIALS, AND SPECIFICATIONS WITHOUT NOTICE THESE DRAWINGS ARE FOR THE PURPOSE OF CONVEYING AN

ARCHITECTURAL CONCEPT ONLY.

RENAISSANCE RESIDENTIAL DESIGN, INC. HEREBY EXPRESSLY RESERVES ITS COMMON LAW COPYRIGHT AND OTHER PROPERTY RIGHTS IN THESE PLANS. THESE PLANS AND DRAWINGS ARE NOT TO BE REPRODUCED, CHANGED, OR COPIED IN ANY FORM OR MANNER WITHOUT FIRST OBTAINING THE EXPRESS WRITTEN CONSENT OF RENAISSANCE RESIDENTIAL DESIGN, INC. NOR ARE THEY TO BE ASSIGNED TO ANY THIRD PARTY WITHOUT FIRST OBTAINING SAID WRITTEN PERMISSION AND CONSENT.

j.s.<u>Thompson</u> ENGINEERING, INC 606 WADE AVE., SUITE 104 RALEIGH, NC 27605 PHONE: (919) 789-9919 FAX: (919) 789-9921

N.C. LICENSE NO.: C-1733



A&G RESIDENT CAMDEN

DATE: SEPTEMBER 28, 2020

REV.:

SCALE: 1/4"=1'-0" DRAWN BY: WG

ENGINEERED BY: WFB

REVIEWED BY: MGS

FIRST FLOOR

PLAN A-4

TO BE 2 x 4 @ 24" O.C. (UNO). 2x6 WALL

\* SHADED INTERIOR WALLS ARE TO BE 2 x 6 @ 16" O.C. (LOAD BEARING) OR

2 x 6 @ 24" O.C. (NON-LOAD BEARING)


\*NOTE: ALL EXTERIOR WALLS AND ATTIC


WALLS ARE TO BE 2 x 6 @ 16" O.C. (UNO).

TO BE 2 x 4 @ 16" O.C. (UNO) AND

(NOT AVAILABLE WITH

OPTIONAL THIRD CAR GARAGE)

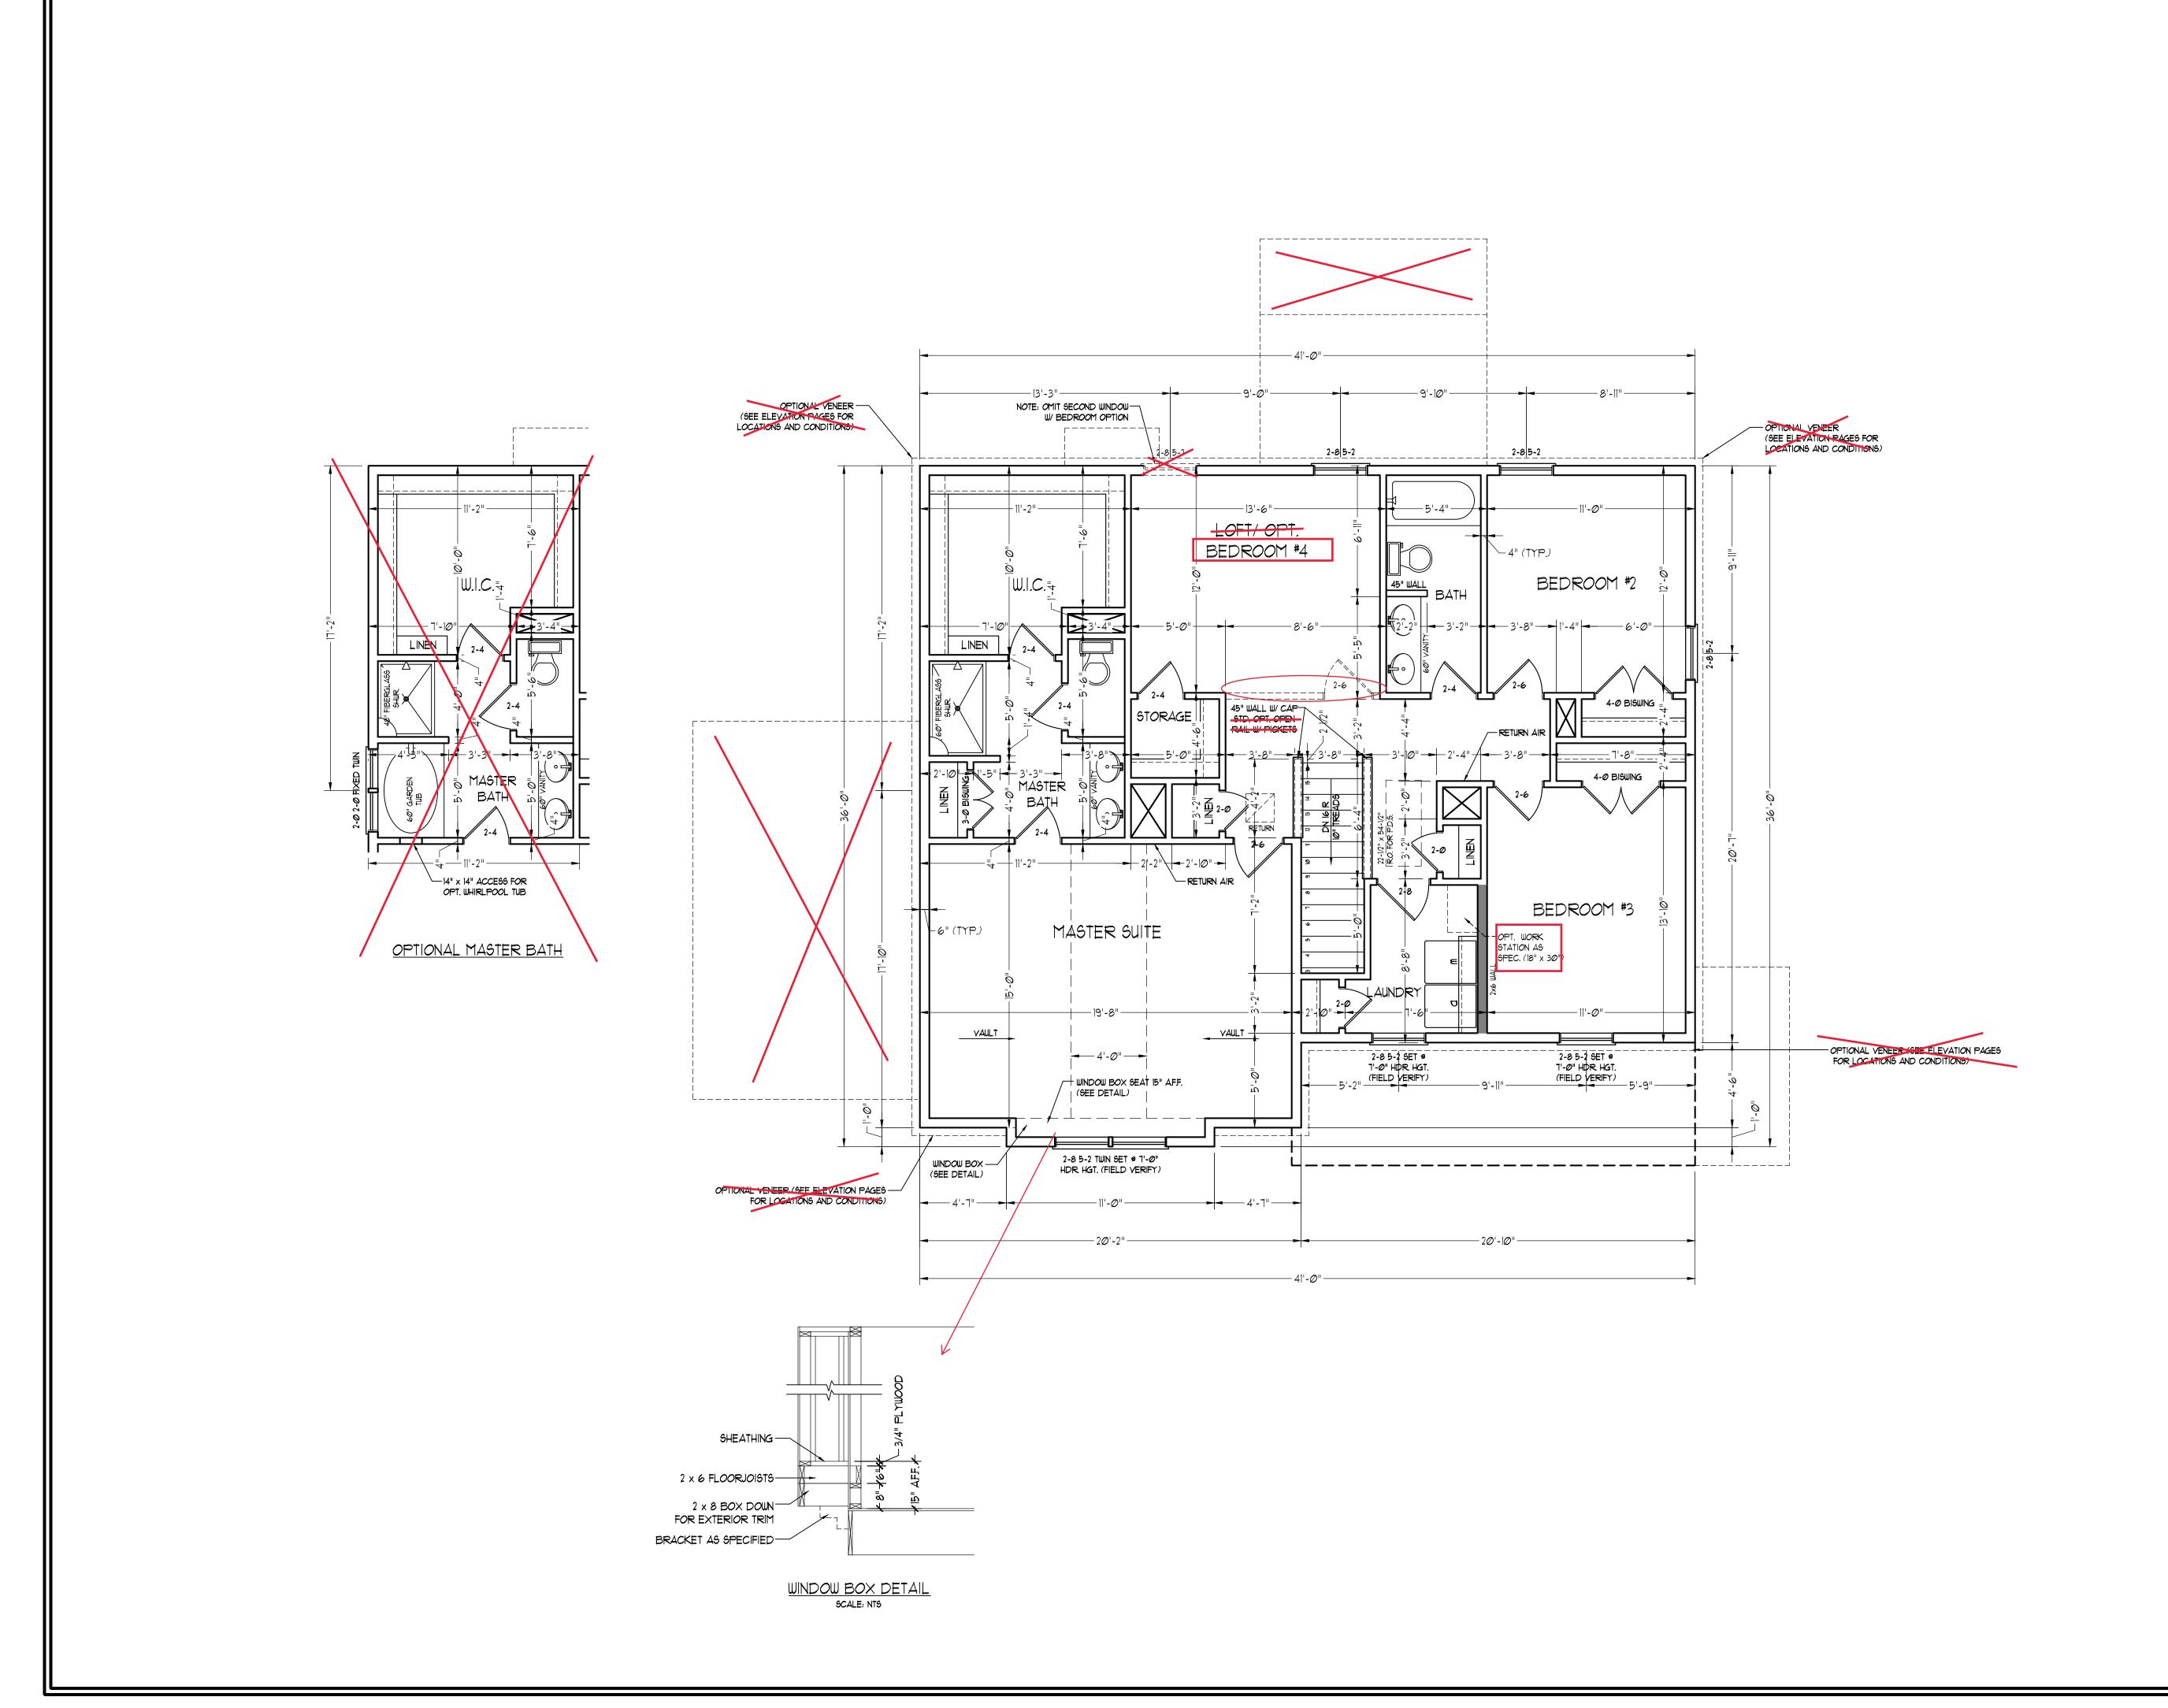



# RENAISSANCE

RESIDENTIAL DESIGN, INC. RALEIGH, NC 27612 (919) 649-4128

WWW.RRDCAROLINA.COM
"The art of transforming your vision into reality."


RENAISSANCE RESIDENTIAL DESIGN, INC.
RESERVES THE RIGHT TO MAKE
MODIFICATIONS TO FLOOR PLANS,
DIMENSIONS, MATERIALS, AND
SPECIFICATIONS WITHOUT NOTICE.
THESE DRAWINGS ARE FOR THE
PURPOSE OF CONVENTION Y

RENAISSANCE RESIDENTIAL DESIGN, INC.
HEREBY EXPRESSLY RESERVES ITS
COMMON LAW COPYRIGHT AND OTHER
PROPERTY RIGHTS IN THESE PLANS.
THESE PLANS AND DRAWINGS ARE NOT
TO BE REPRODUCED, CHANGED, OR
COPIED IN ANY FORM OR MANNER
WITHOUT FIRST OBTAINING THE EXPRESS
WRITTEN CONSENT OF RENAISSANCE
RESIDENTIAL DESIGN, INC. NOR ARE
THEY TO BE ASSIGNED TO ANY THIRD
PARTY WITHOUT FIRST OBTAINING SAID
WRITTEN PERMISSION AND CONSENT.

ARCHITECTURAL CONCEPT ONLY.

J.S.THOMPSON ENGINEERING, INC 606 WADE AVE., SUITE 104 RALEIGH, NC 27605 PHONE: (919) 789-9919 FAX: (919) 789-9921

N.C. LICENSE NO.: C-1733



PRICES, PROMOTIONS, INCENTIVES, FEATURES, OPTIONS, FLOOR PLANS, ELEVATIONS, DESIGNS, MATERIALS AND DIMENSIONS ARE SUBJECT TO CHANGE WITHOUT NOTICE. DUARE FOOTAGE AND DIMENSIONS ARE ESTIMATED AND MAY ARY IN ACTUAL CONSTRUCTION. ACTUAL POSITION OF HOUSE ON LOT WILL BE DETERMINED BY THE SITE PLAN AND PLOT AN. FLOOR PLANS AND ELEVATION RENDERINGS ARE ARTIST CONCEPTIONS. FLOOR PLANS ARE THE COPYRIGHTED PROPERTY OF A&G RESIDENTIAL. ANY USE, REPRODUCTION, ADAPTATION, OR DISPLAY OF THE PLANS IS STRICTLY PROHIBITED. SEE NEW HOME SALES CONSULTANT FOR

A&G RESIDENTIAL CAMDEN

DATE: SEPTEMBER 28, 2020

REV.:

SCALE: 1/4"=1'-0"


DRAWN BY: WG

ENGINEERED BY: WFB

**REVIEWED BY: MGS** 

SECOND FLOOR PLAN

A-5

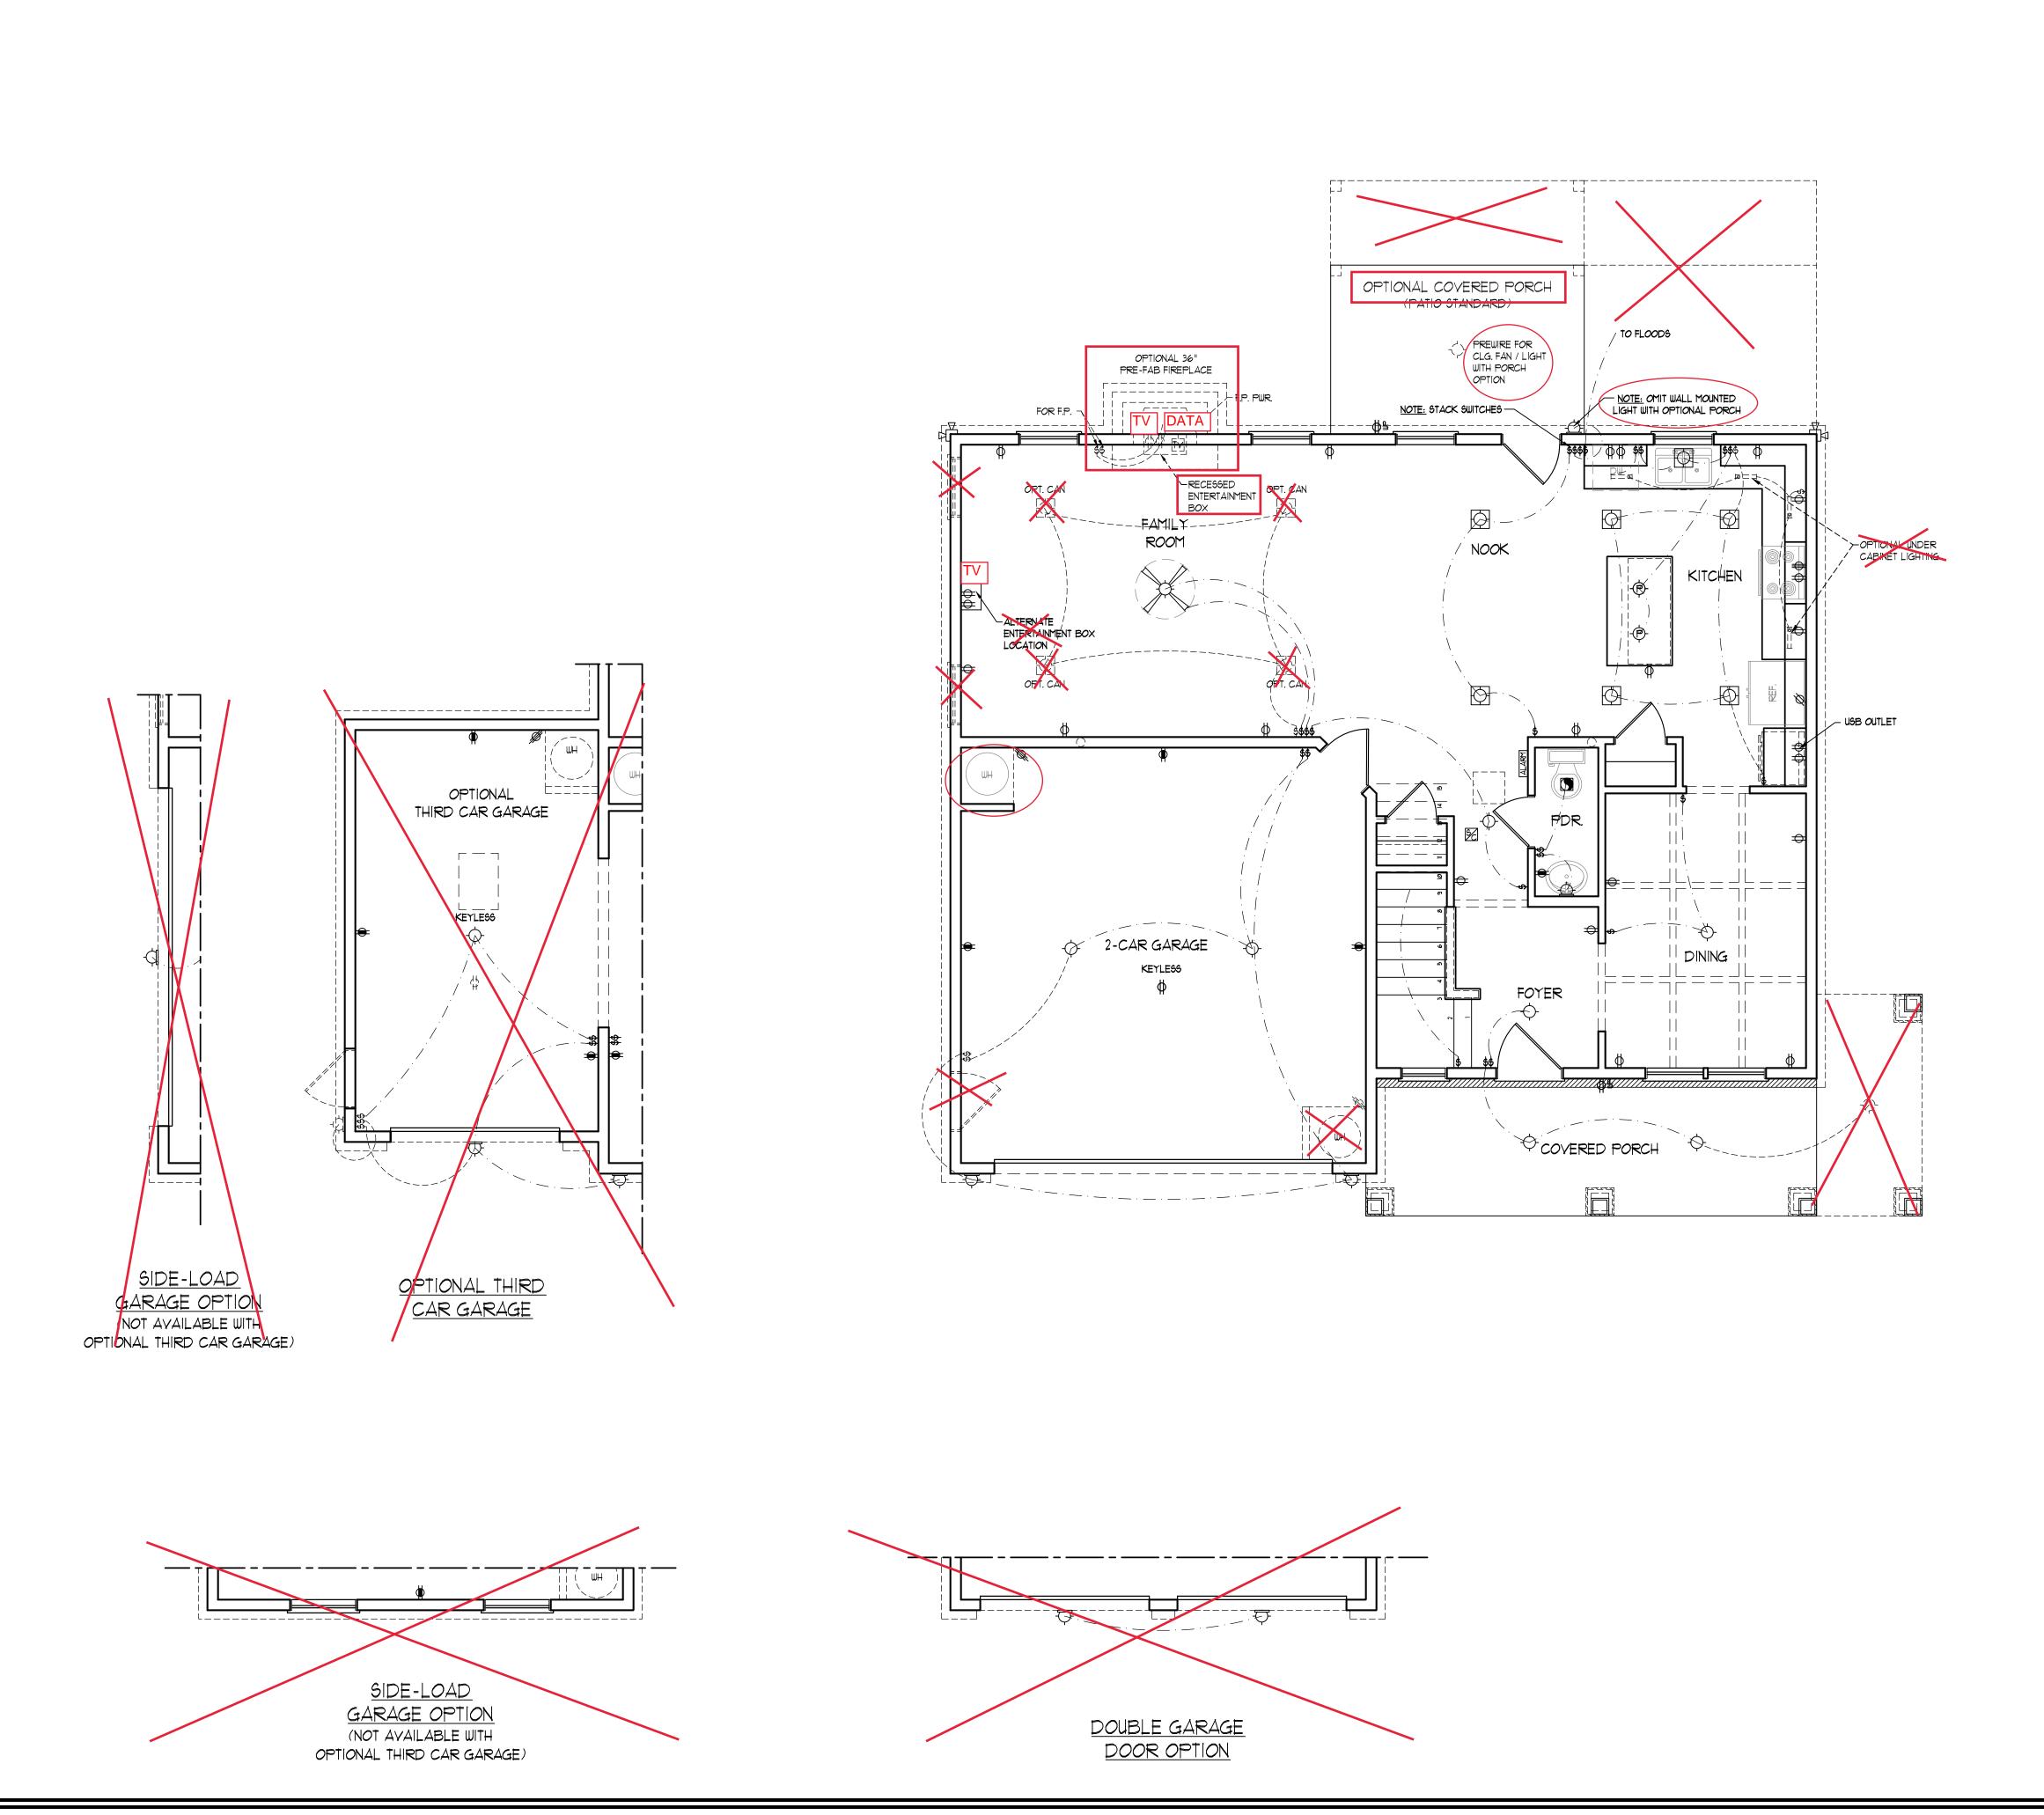



- 1.) BLOCK AND WIRE FOR ALL CELING FANS PER PLAN.
- 2.) VANITY LIGHTS TO BE SET
- 90" A.F.F. (TYP.)
- 3.) ADDITIONAL EXTERIOR OUTLETS REQUIRED BY CODE TO BE LOCATED BY ELECTRICIAN.
- 4.) PLACE SWITCHES 8" (MIN.) FROM ROUGH OPENINGS.


#### ELECTRICAL LEGEND

- ⇒ IIØ Y OUTLET
- ⇒
   IIØ ∨ GFI OUTLET
- ⇒ 110 V SWITCHED OUTLET
- BB 👄 110 V BASEBOARD OUTLET
- 4-PLEX
- COUNTER OR FLOOR MOUNTED
- COUNTER OR FLOOR MOUNTED 110V GF1
- WEATHERPROOF **⇒** 22Ø ∨ OUTLET
- Ø 110 V DEDICATED CIRCUIT
- ► SPECIAL PURPOSE (240 V, ETC.)
- WALL MOUNT LIGHT
- -P- PENDANT LIGHT
- RECESSED CAN LIGHT
- MINI CAN LIGHT EYEBALL LIGHT
- FLUORESCENT LIGHT
- undercabinet light
- FLOOD LIGHT
- \$ SWITCH \$D DIMMER SWITCH
- ▲ TELEPHONE
- riangle data
- TELEPHONE AND DATA
- TV- TY CONNECTION
- TV/ DATA
- CD- CONDUIT FOR COMPONENT WIRING
- SPEAKER 110 V 9MOKE/ CM DETECTOR
- SD 110 Y SMOKE DETECTOR
- EXHAUST FAN









RENAISSANCE


RESIDENTIAL DESIGN, INC. RALEIGH, NC 27612 (919) 649-4128 WWW.RRDCAROLINA.COM

"The art of transforming your vision into reality."

RENAISSANCE RESIDENTIAL DESIGN, INC. MODIFICATIONS TO FLOOR PLANS, DIMENSIONS, MATERIALS, AND SPECIFICATIONS WITHOUT NOTICE. THESE DRAWINGS ARE FOR THE PURPOSE OF CONVEYING AN ARCHITECTURAL CONCEPT ONLY.

RENAISSANCE RESIDENTIAL DESIGN, INC. COMMON LAW COPYRIGHT AND OTHER PROPERTY RIGHTS IN THESE PLANS. THESE PLANS AND DRAWINGS ARE NOT TO BE REPRODUCED, CHANGED, OR COPIED IN ANY FORM OR MANNER WITHOUT FIRST OBTAINING THE EXPRESS WRITTEN CONSENT OF RENAISSANCE RESIDENTIAL DESIGN, INC. NOR ARE THEY TO BE ASSIGNED TO ANY THIRD PARTY WITHOUT FIRST OBTAINING SAID WRITTEN PERMISSION AND CONSENT.

j.s.<u>Thompson</u> ENGINEERING, INC 606 WADE AVE., SUITE 104 RALEIGH, NC 27605 PHONE: (919) 789-9919 FAX: (919) 789-9921 N.C. LICENSE NO.: C-1733



A&G RESIDENTIAL CAMDEN

DATE: SEPTEMBER 28, 2020

REV.:

SCALE: 1/4"=1'-0"


DRAWN BY: WG ENGINEERED BY: WFB

REVIEWED BY: MGS

FIRST FLOOR ELECTRICAL PLAN

E-1

 $C: \label{locuments} \label{locuments} Comden \label{locuments} A\&G \conden\c$ 

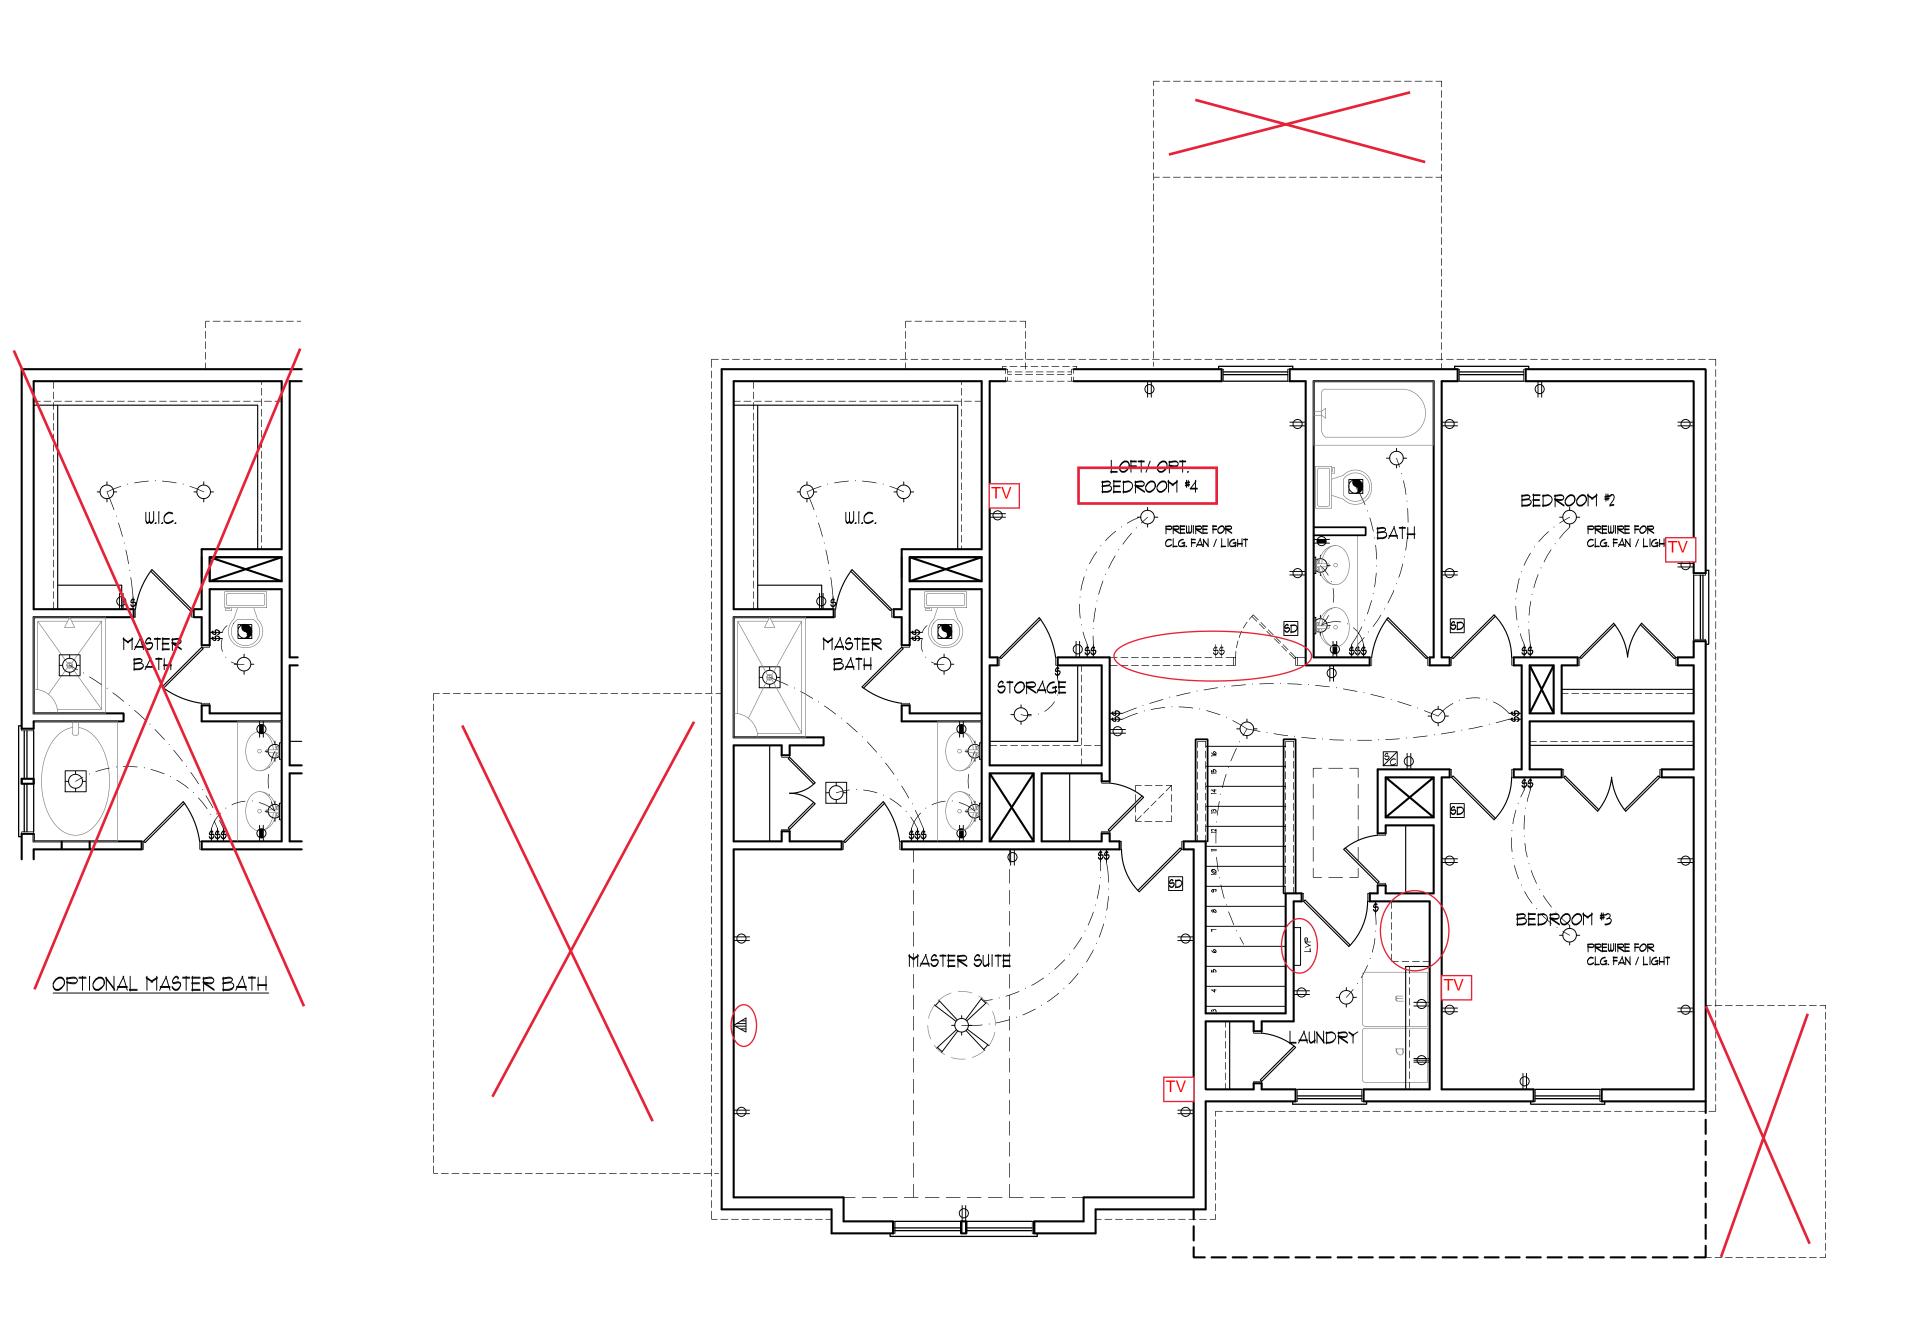

 $\label{locuments} C:\Users\Wade\Documents\Projects\A\&G\Camden\Camden\_9-14-20.dwg,\ 10/2/2020\ 9:27:33\ AM$ 

## ELECTRICAL LAYOUT NOTES:

- BLOCK AND WIRE FOR ALL CELING FANS PER PLAN.
- 2.) VANITY LIGHTS TO BE SET
- 90" AFF. (TYP.)

3.) ADDITIONAL EXTERIOR OUTLETS REQUIRED BY CODE TO BE

- LOCATED BY ELECTRICIAN.
- 4.) PLACE SWITCHES 8" (MIN.) FROM ROUGH OPENINGS.

### ELECTRICAL LEGEND

- → IIØ ∨ OUTLET
- →
   IIØ ∨ GFI OUTLET
- → IIØ Y SWITCHED OUTLET

BB 👄 IIØ V BASEBOARD OUTLET

- 4-PLEX
- COUNTER OR FLOOR MOUNTED
- COUNTER OR FLOOR MOUNTED 110Y GFI
- ₩ WEATHERPROOF
- 220 ∨ OUTLET

  ...
- Ø 110 V DEDICATED CIRCUIT
- # 220 Y DEDICATED CIRCUIT
- SPECIAL PURPOSE (240 V, ETC.)
- WALL MOUNT LIGHT
- CEILING MOUNT LIGHT


  PENDANT LIGHT
- RECESSED CAN LIGHT
- MINI CAN LIGHT
- EYEBALL LIGHT
- FLUORESCENT LIGHT

  UNDERCABINET LIGHT
- FLOOD LIGHT
- \$ SWITCH
- \$D DIMMER SWITCH
- ▲ TELEPHONE
  △ DATA
- TELEPHONE AND DATA
- TV- TV CONNECTION
- TV/ DATA
- CD- CONDUIT FOR COMPONENT WIRING
- SP SPEAKER
- 110 V SMOKE/ CO DETECTOR
- 5D 110 V SMOKE DETECTOR
- EXHAUST FAN





NG FAN W/ LIGHT




RENAISSANCE RESIDENTIAL DESIGN, INC.

RALEIGH, NC 27612
(919) 649-4128
WWW.RRDCAROLINA.COM
"The art of transforming your vision into reality."

RENAISSANCE RESIDENTIAL DESIGN, INC.
RESERVES THE RIGHT TO MAKE
MODIFICATIONS TO FLOOR PLANS,
DIMENSIONS, MATERIALS, AND
SPECIFICATIONS WITHOUT NOTICE.
THESE DRAWINGS ARE FOR THE
PURPOSE OF CONVEYING AN
ARCHITECTURAL CONCEPT ONLY.

RENAISSANCE RESIDENTIAL DESIGN, INC. HEREBY EXPRESSLY RESERVES ITS COMMON LAW COPYRIGHT AND OTHER PROPERTY RIGHTS IN THESE PLANS. THESE PLANS AND DRAWINGS ARE NOT TO BE REPRODUCED, CHANGED, OR COPIED IN ANY FORM OR MANNER WITHOUT FIRST OBTAINING THE EXPRESS WRITTEN CONSENT OF RENAISSANCE RESIDENTIAL DESIGN, INC. NOR ARE THEY TO BE ASSIGNED TO ANY THIRD PARTY WITHOUT FIRST OBTAINING SAID WRITTEN PERMISSION AND CONSENT.

J.S.THOMPSON ENGINEERING, INC 606 WADE AVE., SUITE 104 RALEIGH, NC 27605 PHONE: (919) 789-9919 FAX: (919) 789-9921 N.C. LICENSE NO.: C-1733



AIGES, PROMOTIONS, INCENTIVES, FEATURES, OPTIONS, 1:LOOR PLANS, ELEVATIONS, DESIGNS, MATERIALS AND MENSIONS ARE SUBJECT TO CHANGE WITHOUT NOTICE. ARE FOOTAGE AND DIMENSIONS ARE ESTIMATED AND MAY IN ACTUAL CONSTRUCTION. ACTUAL POSITION OF HOUSE ILOT WILL BE DETERMINED BY THE SITE PLAN AND PLOT I. FLOOR PLANS AND ELEVATION RENDERINGS ARE ARTIST CONCEPTIONS. FLOOR PLANS ARE THE COPYRIGHTED OPERTY OF A&G RESIDENTIAL. ANY USE, REPRODUCTION, ADAPTATION OR DISPLAY OF THE PLANS IS STRICTLY AND HISTED. SEE WHEN HOME SALES CONSULTANT FOR THE PLANS IS STRICTLY AND HISTED.

A&G RESIDENTIAL CAMDEN

DATE: SEPTEMBER 28, 2020

REV.:

SCALE: 1/4"=1'-0"


DRAWN BY: WG


ENGINEERED BY: WFB

REVIEWED BY: MGS

SECOND FLOOR ELECTRICAL PLAN

E-2

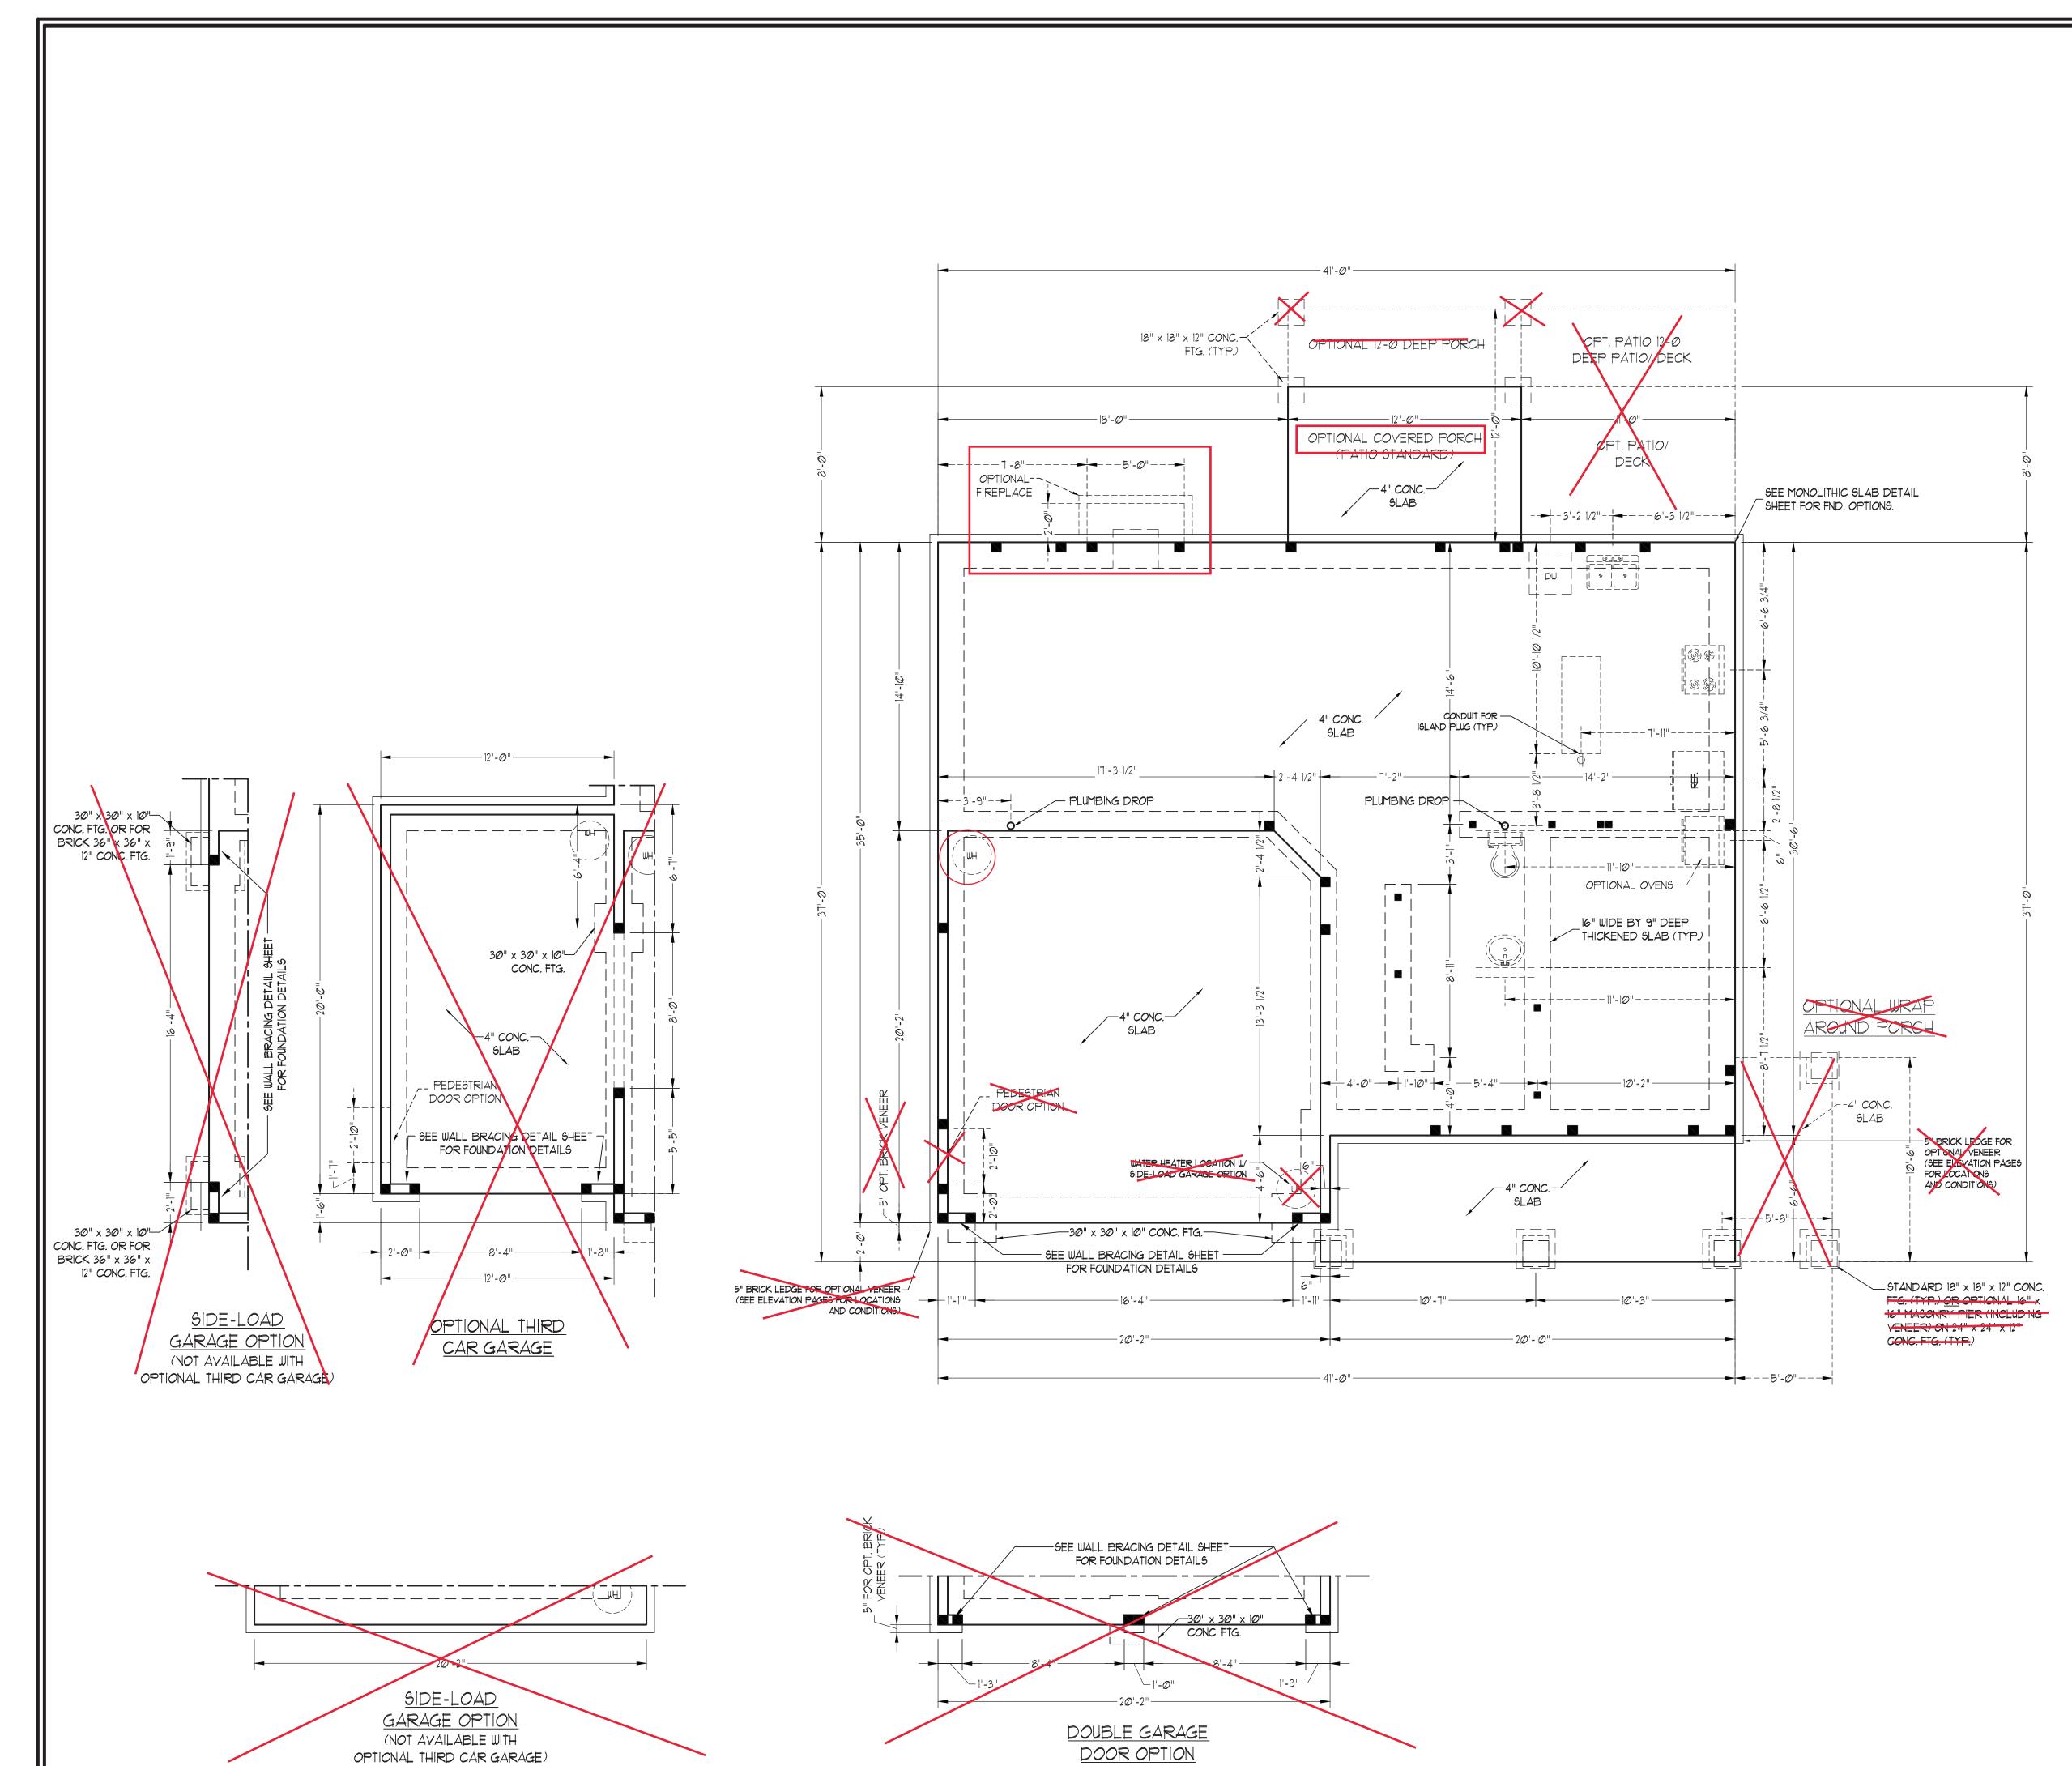



# RENAISSANCE

130 MPH ULTIMATE DESIGN WIND SPEED NOTES FOR LESS THAN <u>30' MEAN ROOF HEIGHT:</u>

- ENGINEER'S SEAL APPLIES ONLY TO STRUCTURAL COMPONENTS. ENGINEER'S SEAL DOES NOT CERTIFY DIMENSIONAL
- INCLUDING ROOF SYSTEM.
- 3. INSTALL 1/2" ANCHOR BOLTS 4'-0" O.C. AND WITHIN 1'-0" FROM END OF EACH CORNER. ANCHOR BOLTS MUST EXTEND A MINIMUM OF
- 4. MEAN ROOF HEIGHT IS LESS THAN 30 FEET. 5. EXTERIOR WALLS DESIGNED FOR 130 MPH
- 6. WALL CLADDING DESIGNED FOR +18.2 PSF
- NEGATIVE PRESSURE (TYP). 1. ROOF CLADDING DESIGNED FOR +16.7 PSF AND -21 PSF FOR ROOF PITCHES 1/12 TO 12/12
- EXTERIOR WALLS OF ALL STORIES IN ACCORDANCE WITH SECTION R602.10.3 OF THE NORC, 2018 EDITION. SEE THE WALL
- 9. ENERGY EFFICIENCY COMPLIANCE AND INSULATION VALUES OF THE BUILDING TO BE NCRC, 2018 EDITION.
- RESIDENTIAL CODE, 2018 EDITION. 3. INSTALL 1/2" ANCHOR BOLTS 6'-0" O.C. AND WITHIN 1'-0" FROM END OF EACH CORNER.
- 1" INTO MASONRY OR CONCRETE. LOCATE BOLT WITHIN MIDDLE THIRD OF PLATE WIDTH.
- NEGATIVE PRESSURE (TYP). 1. ROOF CLADDING DESIGNED FOR +14.2 PSF AND -18 PSF FOR ROOF PITCHES 1/12 TO 12/12 AND +10 PSF AND -36 PSF FOR ROOF
- PITCHED 2.25/12 TO 1/12. 8. INSTALL 1/16" OSB SHEATHING ON ALL EXTERIOR WALLS OF ALL STORIES IN ACCORDANCE WITH SECTION R602.10.3 OF THE NCRC, 2018 EDITION. SEE THE WALL
- ADDITIONAL STRUCTURAL INFORMATION.

- ACCURACY OR ARCHITECTURAL LAYOUT
- 2. STRUCTURAL DESIGN PER NORTH CAROLINA RESIDENTIAL CODE, 2018 EDITION.
- 1" INTO MASONRY OR CONCRETE. LOCATE BOLT WITHIN MIDDLE THIRD OF PLATE WIDTH.
- AND -24 PSF (+/- INDICATE POSITIVE /
- AND +10.5 PSF AND -43 PSF FOR ROOF PITCHED 2.25/12 TO 7/12. 8. INSTALL 1/16" OSB SHEATHING ON ALL
- BRACING NOTES AND DETAILS SHEET FOR MORE INFORMATION.
- IN ACCORDANCE WITH CHAPTER II OF THE 10. REFER TO NOTES AND DETAIL SHEETS FOR
- ADDITIONAL STRUCTURAL INFORMATION.

#### 120 MPH ULTIMATE DESIGN WIND SPEED NOTES FOR LESS THAN <u>30' MEAN ROOF HEIGHT:</u>

- ENGINEER'S SEAL APPLIES ONLY TO STRUCTURAL COMPONENTS. ENGINEER'S SEAL DOES NOT CERTIFY DIMENSIONAL ACCURACY OR ARCHITECTURAL LAYOUT INCLUDING ROOF SYSTEM.
- STRUCTURAL DESIGN PER NORTH CAROLINA
- ANCHOR BOLTS MUST EXTEND A MINIMUM OF
- 4. MEAN ROOF HEIGHT IS LESS THAN 30 FEET. 5. EXTERIOR WALLS DESIGNED FOR 120 MPH
- 6. WALL CLADDING DESIGNED FOR +15.5 PSF AND -20 PSF (+/- INDICATE POSITIVE /
- BRACING NOTES AND DETAILS SHEET FOR MORE INFORMATION.
- 9. ENERGY EFFICIENCY COMPLIANCE AND INSULATION VALUES OF THE BUILDING TO BE IN ACCORDANCE WITH CHAPTER II OF THE NCRC, 2018 EDITION.
- 10. REFER TO NOTES AND DETAIL SHEETS FOR

# RESIDENTIAL DESIGN, INC. RALEIGH, NC 27612


(919) 649-4128 WWW.RRDCAROLINA.COM 'The art of transforming your vision into re ality."

> RENAISSANCE RESIDENTIAL DESIGN, INC. MODIFICATIONS TO FLOOR PLANS, DIMENSIONS, MATERIALS, AND SPECIFICATIONS WITHOUT NOTICE THESE DRAWINGS ARE FOR THE PURPOSE OF CONVEYING AN ARCHITECTURAL CONCEPT ONLY.

RENAISSANCE RESIDENTIAL DESIGN, INC. HEREBY EXPRESSLY RESERVES ITS COMMON LAW COPYRIGHT AND OTHER PROPERTY RIGHTS IN THESE PLANS. THESE PLANS AND DRAWINGS ARE NOT TO BE REPRODUCED, CHANGED, OR COPIED IN ANY FORM OR MANNER WITHOUT FIRST OBTAINING THE EXPRESS

WRITTEN CONSENT OF RENAISSANCE RESIDENTIAL DESIGN, INC. NOR ARE THEY TO BE ASSIGNED TO ANY THIRD PARTY WITHOUT FIRST OBTAINING SAID WRITTEN PERMISSION AND CONSENT.

J.S.THOMPSON ENGINEERING. INC 606 WADE AVE., SUITE 104 RALEIGH, NC 27605 PHONE: (919) 789-9919 FAX: (919) 789-9921 N.C. LICENSE NO.: C-1733



A&G RESIDENTIA CAMDEN



DATE: SEPTEMBER 28, 2020 REV.:

SCALE: 1/4"=1'-0"

DRAWN BY: WG

ENGINEERED BY: WFB REVIEWED BY: MGS

MONO SLAB FOUNDATION PLAN

S-1

GARAGE THOD PF

SIDE-LOAD

GARAGE OPTION

(NOT AVAILABLE WITH

OPTIONAL THIRD CAR GARAGE

### BRACED WALL DESIGN

RECTANGLE B RECTANGLE A

SIDE IA (FRONT LOAD) SIDE IB METHOD: CS-WSP/PF/GB METHOD: CS-WSP/PF TOTAL REQUIRED LENGTH: 4.56' TOTAL REQUIRED LENGTH: 15.1' TOTAL PROVIDED LENGTH: 6' TOTAL PROVIDED LENGTH: 21.6' SIDE 2A SIDE 2B METHOD: CS-WSP METHOD: CS-WSP

TOTAL REQUIRED LENGTH: 15.1' TOTAL REQUIRED LENGTH: 4.56 TOTAL PROVIDED LENGTH: 20.66' TOTAL PROVIDED LENGTH: 12' SIDE 3B SIDE 3A (SIDE LOAD) METHOD: CS-WSP/PF METHOD: CS-WSP TOTAL REQUIRED LENGTH: 17.55' TOTAL REQUIRED LENGTH: 3.19' TOTAL PROVIDED LENGTH: 15.58'

TOTAL PROVIDED LENGTH: 17.9' <u> SIDE 4A</u>

SIDE 4B/3A SHARED METHOD: CS-WSP METHOD: CS-WSP/GB TOTAL REQUIRED LENGTH: 17.55' TOTAL REQUIRED LENGTH: 20.74' TOTAL PROVIDED LENGTH: 30.5' TOTAL PROVIDED LENGTH: 24.8'

BRACED WALL DESIGN NOTES:

BRACED WALL DESIGN PER SECTION R602.10 OF THE

NCRC 2018 EDITION. CS-WSP REFERS TO "CONTINUOUS SHEATHING - WOOD STRUCTURAL PANELS" CONTRACTOR IS TO INSTALL 1/16" OSB

ON ALL EXTERIOR WALLS ATTACHED w/ 8d NAILS SPACED 6" O.C. ALONG PANEL EDGES AND 12" O.C. IN THE FIELD. \*GB REFERS TO "GYPSUM BOARD" CONTRACTOR IS TO INSTALL 1/2" (MIN.) GYPSUM WALL BOARD WHERE NOTED ON THE PLANS. FASTEN GB WITH 1 1/4" SCREWS OR 1 5/8" NAILS SPACED 1" O.C. ALONG PANEL EDGES AND IN THE FIELD INCLUDING TOP AND

BOTTOM PLATES. BRACED WALL DESIGN APPLIED IN WIND ZONES UP TO 130 MPH. FOR HIGH WIND ZONES, BRACE WALLS ARE TO BE CONSTRUCTED IN ACCORDANCE WITH CHAPTER 45 OF THE NCRC 2018 EDITION.

SEE NOTES AND DETAIL SHEETS FOR ADDITIONAL BRACED WALL INFORMATION.

NOTE: TJI 110 JOISTS MAY BE INSTALLED IN LIEU OF BCI 4500s-1.8 JOISTS AT THE DEPTH AND SPACING INDICATED ON THE PLAN

\*NOTE: ALL EXTERIOR WALLS AND ATTIC WALLS ARE TO BE 2 x 6 @ 16" O.C. (UNO). 2 x 4 @ 16" O.C. EXTERIOR WALLS MAY BE CONSTRUCTED IN LIEU OF 2 x 6 WALLS (UNO). ALL INTERIOR LOAD BEARING WALLS ARE TO BE 2 x 4 @ 16" O.C. (UNO) AND NON-LOAD BEARING INTERIOR WALLS ARE TO BE 2 x 4 @ 24" O.C. (UNO).

> LINTEL SCHEDULE FOR BRICKMATURAL STONE SUPPORT LENGTH (FT.) <u>SIZE OF LINTEL</u> UP TO 4 FT.  $L 3 \frac{1}{2} \times 3 \frac{1}{2} \times \frac{1}{4}$ L 5 x 3 1/2 x 5/16 LLV 4-8 8 AND GREATER L 6 x 4 x 5/16 LLV

#### BRICK SUPPORT NOTES:

LINTEL SCHEDULE APPLIES TO ALL OPENINGS IN BRICK VENEER (UNO). SEE ARCH DWGS. FOR SIZE AND LOCATION OF OPENINGS.

(LLV) = LONG LEG VERTICAL LENGTH = CLEAR OPENING

EMBED ALL ANGLE IRONS MIN. 4" EACH SIDE INTO VENEER TO PROVIDE BEARING. FOR ALL HEADERS 8'-0" AND GREATER IN LENGTH, ATTACH STEEL ANGLE TO HEADER W/ 1/2" LAG SCREWS @ 12" O.C.

STAGGERED. FOR ALL BRICK SUPPORT @ ROOF LINES, FASTEN (2) 2 x 10 BLOCKING BETWEEN STUDS w/ (4) 12d NAILS PER PLY. FASTEN A 6" x 4" x 5/16" STEEL ANGLE TO (2) 2 x 10 BLOCKING w/ (2) 1/2" LAG SCREWS @ 12" O.C. STAGGERED. SEE SECTION RT03.8.2.1 OF THE 2018 NCRC FOR ADDITIONAL BRICK SUPPORT INFORMATION. PRECAST REINFORCED CONCRETE LINTELS ENGINEERED BY OTHERS MAY BE

USED IN LIEU OF STEEL LINTELS.

ALL LOAD BEARING HEADERS TO BE

INSTALL AN EXTRA JOIST UNDER

WINDOW AND DOOR HEADERS TO BE SUPPORTED w/(1) JACK STUD AND (1) KING STUD EA. END (UNO.). SEE TABLE R602.7.5 FOR ADDITIONAL KING STUD

GIRDER OR FOUNDATION. ALL SQUARES TO BE (2) STUDS (UNO.)

UPLIFT CONNECTORS AT TOP (UNO.)

REFER TO NOTES AND DETAIL SHEETS FOR ADDITIONAL STRUCTURAL INFORMATION.

RENAISSANCE RESIDENTIAL DESIGN, INC

RALEIGH, NC 27612

(919) 649-4128 WWW.RRDCAROLINA.COM "The art of transforming your vision into re ality."

> RENAISSANCE RESIDENTIAL DESIGN, INC. MODIFICATIONS TO FLOOR PLANS, DIMENSIONS, MATERIALS, AND SPECIFICATIONS WITHOUT NOTICE THESE DRAWINGS ARE FOR THE PURPOSE OF CONVEYING AN ARCHITECTURAL CONCEPT ONLY

RENAISSANCE RESIDENTIAL DESIGN, INC. HEREBY EXPRESSLY RESERVES ITS COMMON LAW COPYRIGHT AND OTHER PROPERTY RIGHTS IN THESE PLANS. THESE PLANS AND DRAWINGS ARE NOT TO BE REPRODUCED, CHANGED, OR COPIED IN ANY FORM OR MANNER WITHOUT FIRST OBTAINING THE EXPRESS WRITTEN CONSENT OF BENAISSANCE RESIDENTIAL DESIGN, INC. NOR ARE THEY TO BE ASSIGNED TO ANY THIRD PARTY WITHOUT FIRST OBTAINING SAID WRITTEN PERMISSION AND CONSENT.

J.S.THOMPSON ENGINEERING, INC 606 WADE AVE., SUITE 104 RALEIGH, NC 27605 PHONE: (919) 789-9919 FAX: (919) 789-9921 N.C. LICENSE NO.: C-1733



# STRUCTURAL NOTES:

ALL FRAMING LUMBER TO BE SPF #2 (UNO). ALL TREATED LUMBER TO BE SYP #2 (UNO.)

(2)  $2 \times 6$  (UNO).

WALLS PARALLEL TO FLOOR JOISTS WHERE NOTED ON THE PLANS.

REQUIREMENTS. SQUARES DENOTE POINT LOADS WHICH REQUIRE SOLID BLOCKING TO

6. ALL 4 x 4 POSTS SHALL BE ANCHORED TO SLABS W/ SIMPSON ABU44 POST BASES (OR EQUAL) AND 6 x 6 POSTS w/ ABU66 POST BASES (OR EQUAL) (UNO). ALL 4 x 4 AND 6 x 6 POSTS TO BE INSTALLED WITH 100 LB CAPACITY

FOR FIBERGLASS, ALUMINUM, OR COLUMN ENG. BY OTHERS, SECURE TO SLAB w/ (2) METAL ANGLES USING 2" CONC. SCREWS. FASTEN ANGLES TO COLUMNS w/ 1/4" THROUGH BOLTS w/ NUTS AND WASHERS. LOCATE ANGLES ON OPPOSITE SIDES OF COLUMN. THROUGH BOLTS MUST BE INSTALLED PRIOR TO SETTING COLUMN.

3 RESIDENTIAI 1DEN

DATE: SEPTEMBER 28, 2020


REV.: SCALE: 1/4"=1'-0"

DRAWN BY: WG

ENGINEERED BY: WFB

**REVIEWED BY: MGS** 

SECOND FLOOR FRAMING PLAN

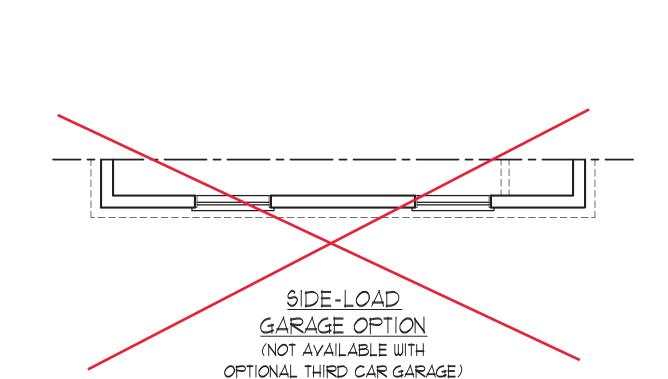

JACKS ÉA. BEARING POINT.

GARAGE PORTAL FRAME. SEE-

OPTIONAL THIRD

CAR GARAGE


METHOD PF WALL BRACING DETAIL

-12'-0/ SIDE IB RECTANGLE B

CONTRIBUTES 21/9"

2'-2" CONTRIBUTES 3'-3"

 $+(3)2 \times 4 OR$ (3)2 x 6

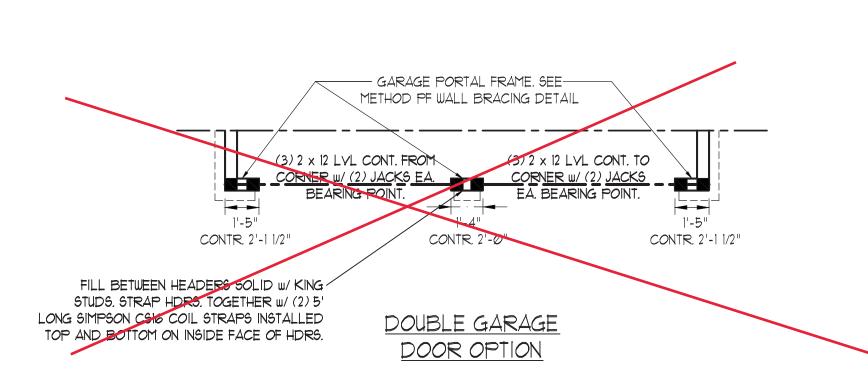

OPTIONAL 10'-0" DEEP

COVERED PORCH

NEINEERED BY OTHERS

 $|(2)2 \times 10$ 

(1) 1 3/4" × 14" L√L FL\USH

EXTRA JOIST

O.C. (OR EQUAL)

\_\_\_\_\_\_2'-4" | → # Ω Ω Ω | → 3'-5" → w/ (2) JACKS EA. END

 $4 \times 4$  TRTD.

POST MIN. (TYP.)

W/ OPT. 12'-Ø" DEEP PORCH

FIREPLACE

| \_\_\_\_\_\_

 $(2) 2 \times 10 \text{ m}/(2)$ 

- JACKS EA. END -

−16'-9" GB CONTRIBUTES 8'-4 1/2" (FRONT LOAD ONLY ------

 $(2) \mid 3/4" \times 16" \text{ LVL w}/(3) \mid 2 \times 6 \text{ OR } (5) \mid 2 \times 4 \text{ EA. END.}$ 

SET TOP OF BEAM FLUSH w/ TOP OF JOISTS.

14" BCI 4500s @ 16"

O.C. (OR EQUAL)

(3) | 3/4" x | 1 1/8" LYL CONT. FROM CORNER TO

CORNER w/ (3) 2 x 6 EA. BEARING POINT OR

OR w/ BRICK ABOVE: (3) | 3/4" x |8" LVL

GARAGE PORTAL FRAME. SEE

METHOD PF WALL BRACING DETAIL

CONTR. 3'-1 1/2"

 $|(2)2 \times |\emptyset|$ 

 $(3)2 \times 10$ 

<u>PORCH</u>: (3) 2 x 4

(1) 1 3/4" x 14" LVL

FLUSH w/ SIMPSON -

HUS1.81/10 HGR.

CONTR. 3'-1 1/2"

OR2X6

— 13'-6" -

MIN. (TYP.)

(3)2 x 10

-4 x 4 TRTD POST

 $(2)2 \times 10$ 

-w/ OPT. 12'-0" DEEP

PORCH: (3) 2 x 4

MIN. (TYP.)

4'-2 1/2"-

(2) 2 x 10 |

W/ OPT. 121-Ø" DEEP PORCH.

4'-8 1/2"-

(1) 1 3/4" x 14"

LVL FLUSH

14" BCI 45ØØs @ 24" | \

(2) | 3/4" × 9 |/4" L√L

2'-4 3/4"-/


ROOF TRUSSES

ENGINEERED BY

O.C. (OR EQUAL)

33736 10/1/2020

SEE WINDOW BOX DETAIL

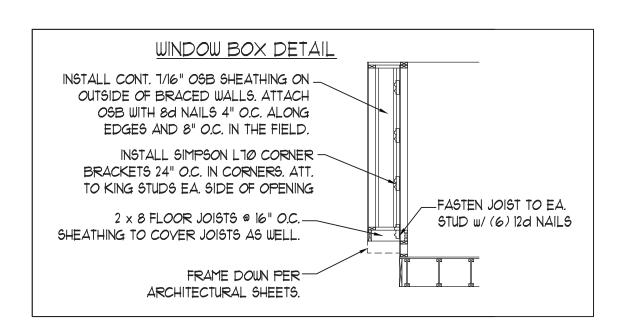

### BRACED WALL DESIGN NOTES:

WALL INFORMATION.

- BRACED WALL DESIGN PER SECTION R602.10 OF THE NCRC 2018 EDITION.
- CS-WSP REFERS TO "CONTINUOUS SHEATHING WOOD STRUCTURAL PANELS" CONTRACTOR IS TO INSTALL 1/16" OSB ON ALL EXTERIOR WALLS ATTACHED w/ 8d NAILS SPACED 6" O.C. ALONG PANEL EDGES AND 12" O.C. IN THE FIELD.
- \*GB REFERS TO "GYPSUM BOARD" CONTRACTOR IS TO INSTALL 1/2" (MIN.) GYPSUM WALL BOARD WHERE NOTED ON THE PLANS. FASTEN GB WITH 1 1/4" SCREWS OR 1 5/8" NAILS SPACED 1" O.C. ALONG PANEL EDGES AND IN THE FIELD INCLUDING TOP AND BOTTOM PLATES.
- BRACED WALL DESIGN APPLIED IN WIND ZONES UP TO 130 MPH. FOR HIGH WIND ZONES, BRACE WALLS ARE TO BE CONSTRUCTED IN ACCORDANCE WITH CHAPTER 45 OF THE NCRC 2018 EDITION.

SEE NOTES AND DETAIL SHEETS FOR ADDITIONAL BRACED

- 1. PER SECTION R602.10.3.2 OF THE 2018 NCRC, THE AMOUNT OF BRACING ON THE SECOND FLOOR EXCEEDS THE AMOUNT REQUIRED FOR THE FIRST FLOOR AND NO BRACED WALL ANALYSIS IS REQUIRED.
- 2. SHEATH ALL EXTERIOR WALLS WITH 1/16" OSB SHEATHING ATTACHED WITH 8d NAILS AT 6" O.C. ALONG PANEL EDGES AND 12" O.C. IN THE FIELD.

\*NOTE: ALL EXTERIOR WALLS AND ATTIC WALLS ARE TO BE 2 x 6 @ 16" O.C. (UNO). 2 x 4 @ 16" O.C. EXTERIOR WALLS MAY BE CONSTRUCTED IN LIEU OF 2 x 6 WALLS (UNO). ALL INTERIOR LOAD BEARING WALLS ARE TO BE 2 x 4 @ 16" O.C. (UNO) AND NON-LOAD BEARING INTERIOR WALLS ARE TO BE 2 x 4 @ 24" O.C. (UNO).

r					
	LINTEL SCHEDULE FOR				
	BRICKNATURAL STONE SUPPORT				
	LENGTH (FT.)	<u>SIZE OF LINTEL</u>			
	UP TO 4 FT.	L 3 1/2 x 3 1/2 x 1/4			
	4-8	L 5 x 3 1/2 x 5/16 LLv			
	8 AND GREATER	L 6 x 4 x 5/16 LLV			
	BRICK SUPPORT NOTES:				

- LINTEL SCHEDULE APPLIES TO ALL OPENINGS IN BRICK VENEER (UNO). SEE ARCH DWGS. FOR SIZE AND LOCATION OF OPENINGS.
- (LLV) = LONG LEG VERTICAL LENGTH = CLEAR OPENING
- EMBED ALL ANGLE IRONS MIN. 4" EACH SIDE INTO VENEER TO PROVIDE BEARING.
- FOR ALL HEADERS 8'-0" AND GREATER IN LENGTH, ATTACH STEEL ANGLE TO HEADER W/ 1/2" LAG SCREWS @ 12" O.C. STAGGERED. FOR ALL BRICK SUPPORT @ ROOF LINES,
- FASTEN (2) 2 x 10 BLOCKING BETWEEN STUDS W/ (4) 12d NAILS PER PLY. FASTEN  $A 6" \times 4" \times 5/16"$  STEEL ANGLE TO (2) 2  $\times$ 10 BLOCKING w/ (2) 1/2" LAG SCREWS @ 12" O.C. STAGGERED. SEE SECTION RT03.8.2.1 OF THE 2018 NCRC FOR ADDITIONAL BRICK SUPPORT INFORMATION. PRECAST REINFORCED CONCRETE LINTELS ENGINEERED BY OTHERS MAY BE

USED IN LIEU OF STEEL LINTELS.

#### TABLE R602.7.5 MINIMUM NUMBER OF FULL HEIGHT STUDS AT EACH END OF HEADERS IN EXTERIOR WALLS

33736

10/1/2020

	PACING (INCHES) E R602.3(5) 24
16	24
1	1
2	1
3	2
5	3
6	4
	1 2 3 5 6

# STRUCTURAL NOTES:

- ALL FRAMING LUMBER TO BE #2 SPF
- 2. ALL LOAD BEARING HEADERS TO BE (2)  $2 \times 6$  (UNO).
- B. WINDOW AND DOOR HEADERS TO BE SUPPORTED w/ (1) JACK STUD AND (1) KING STUD EA. END (UNO.). SEE TABLE R602.7.5 FOR ADDITIONAL KING STUD REQUIREMENTS.
- SQUARES DENOTE POINT LOADS WHICH REQUIRE SOLID BLOCKING TO GIRDER OR FOUNDATION. SQUARES TO BE (2) STUDS (UNO.)
- REFER TO NOTES AND DETAIL SHEETS FOR ADDITIONAL STRUCTURAL INFORMATION.



RENAISSANCE RESIDENTIAL DESIGN, INC.

(919) 649-4128 WWW.RRDCAROLINA.COM "The art of transforming your vision into re ality."


RENAISSANCE RESIDENTIAL DESIGN, INC. MODIFICATIONS TO FLOOR PLANS, DIMENSIONS, MATERIALS, AND SPECIFICATIONS WITHOUT NOTICE THESE DRAWINGS ARE FOR THE PURPOSE OF CONVEYING AN

ARCHITECTURAL CONCEPT ONLY

RALEIGH, NC 27612

RENAISSANCE RESIDENTIAL DESIGN, INC. HEREBY EXPRESSLY RESERVES ITS COMMON LAW COPYRIGHT AND OTHER PROPERTY RIGHTS IN THESE PLANS. THESE PLANS AND DRAWINGS ARE NOT TO BE REPRODUCED, CHANGED, OR COPIED IN ANY FORM OR MANNER WRITTEN CONSENT OF RENAISSANCE RESIDENTIAL DESIGN, INC. NOR ARE THEY TO BE ASSIGNED TO ANY THIRD PARTY WITHOUT FIRST OBTAINING SAID WRITTEN PERMISSION AND CONSENT.

J.S.THOMPSON ENGINEERING, INC 606 WADE AVE., SUITE 104 RALEIGH, NC 27605 PHONE: (919) 789-9919 FAX: (919) 789-9921 N.C. LICENSE NO.: C-1733



A&G RESIDENTIAL CAMDEN

DATE:	SEPTEMBER 28,	202

SCALE: 1/4"=1'-0" DRAWN BY: WG

ENGINEERED BY: WFB

REVIEWED BY: MGS

ATTIC FLOOR FRAMING PLAN

S-3


ATTIC VENT CALCULATION:

286 SQ. FT. OF ATTIC DIVIDED BY 150 REQUIRES 1.9 SQ. FT. OF NET


FREE VENTILATING AREA (MIN.).

OPTIONAL THIRD

CAR GARAGE

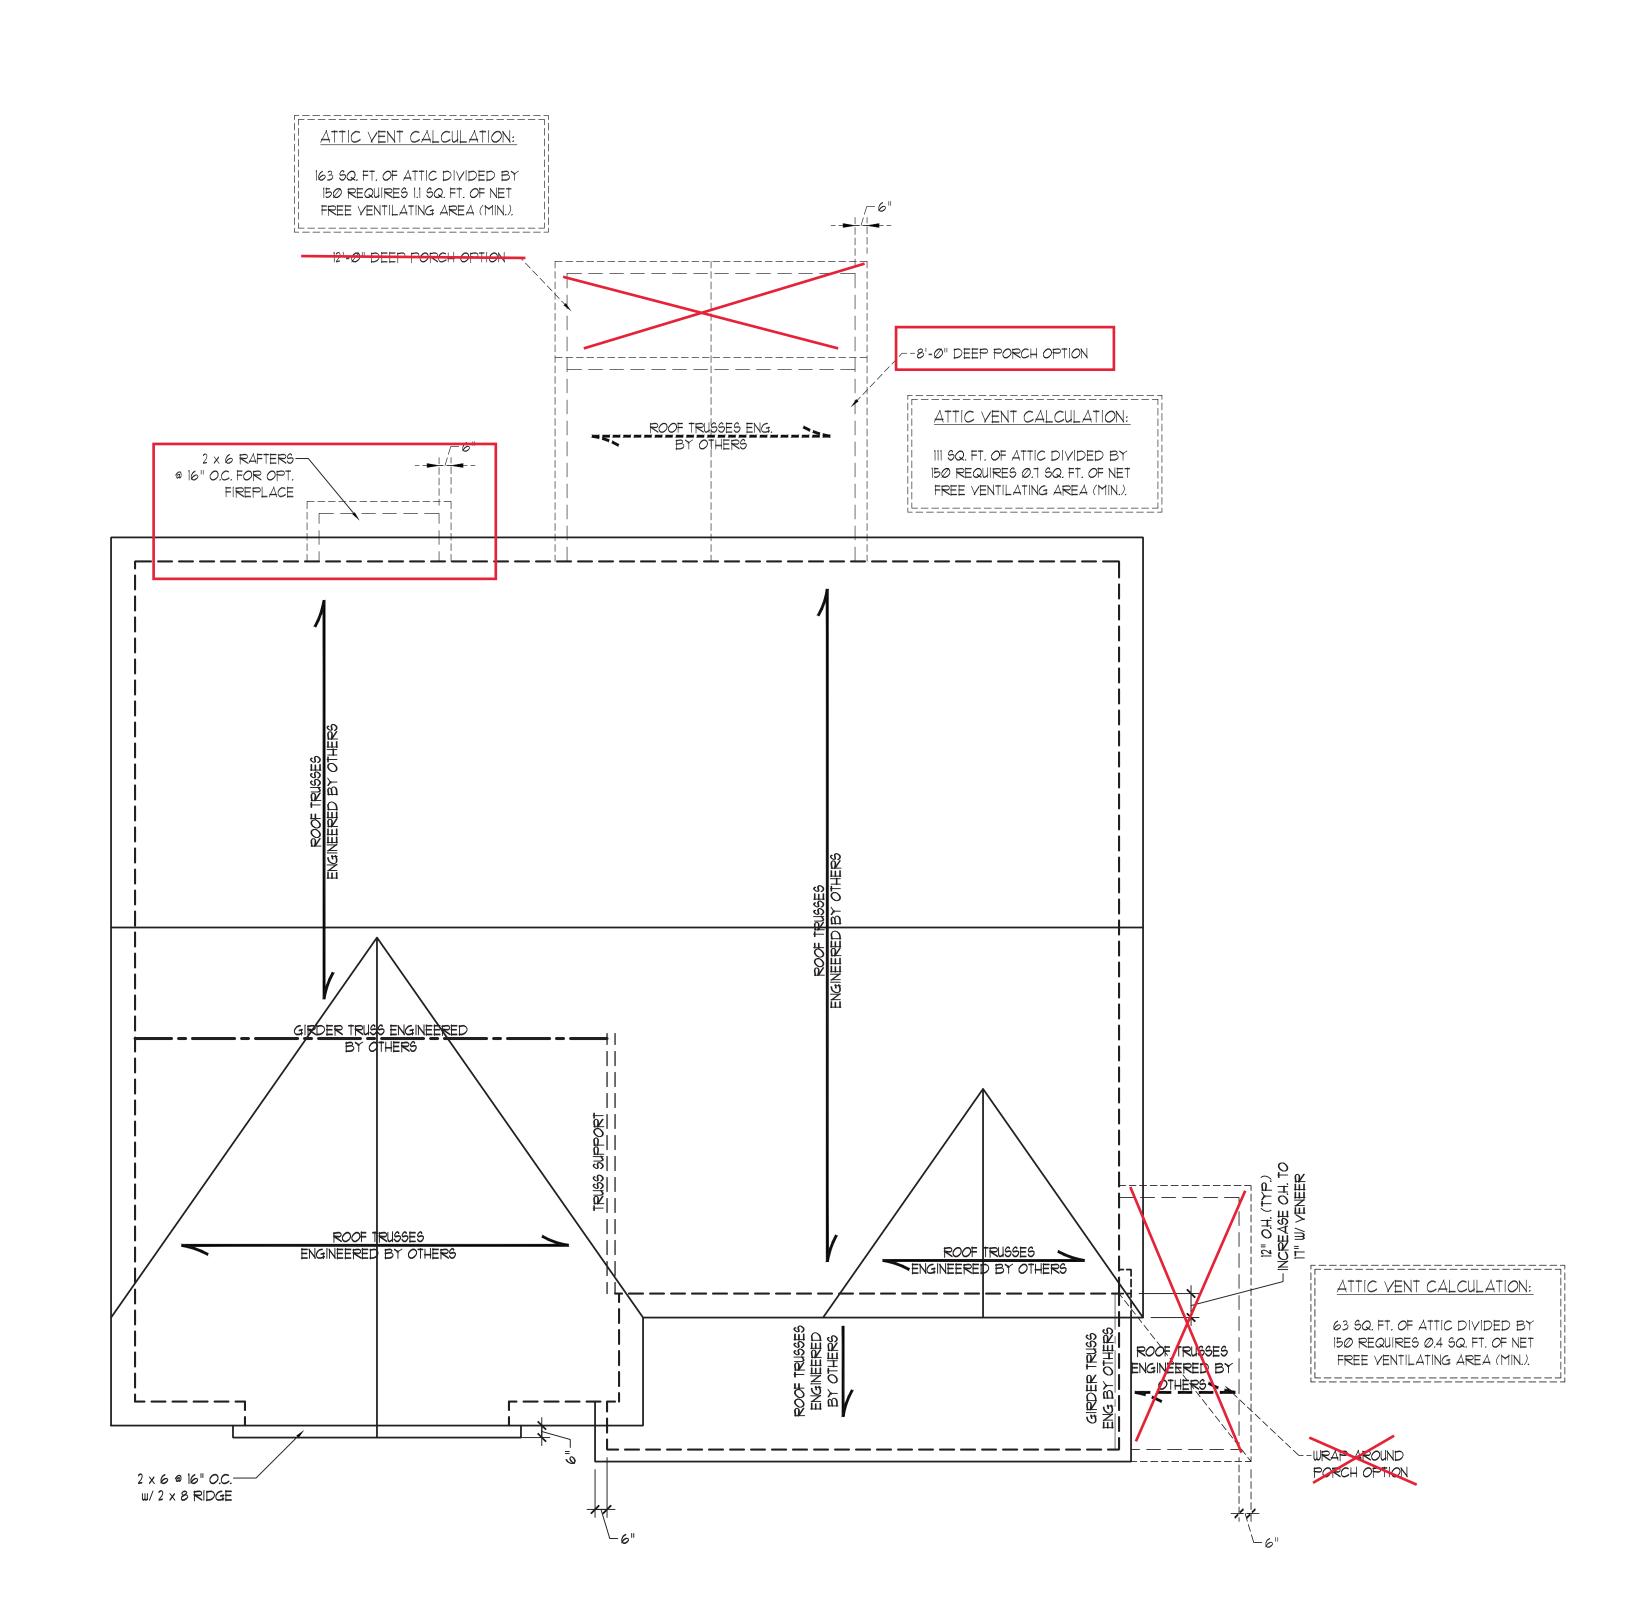

ELEVATION B



# RENAISSANCE

RESIDENTIAL DESIGN, INC. RALEIGH, NC 27612

ATTIC VENT CALCULATION:

1630 SQ. FT. OF ATTIC DIVIDED BY

150 REQUIRES 10.9 SQ. FT. OF NET

FREE VENTILATING AREA (MIN.).

STRUCTURAL NOTES:

ALL FRAMING LUMBER TO BE #2

FRAME DORMER WALLS ON TOP

OF DOUBLE OR TRIPLE RAFTERS.

HIP SPLICES ARE TO BE SPACED

MEMBERS WITH THREE ROWS OF

ROOF SECTIONS W/ 2 x 8 RIDGES,

SIMPSON H2.5A HURRICANE TIES @ 32" O.C. MAX. PASS HURRICANE TIES THROUGH NOTCH IN ROOF SHEATHING. EACH RAFTER IS TO BE FASTENED TO THE FLAT YALLEY WITH A MIN. OF (6) 12d

REFER TO SECTION R802.II OF THE 2018 NCRC FOR REQUIRED UPLIFT RESISTANCE AT RAFTERS AND

REFER TO NOTES AND DETAIL SHEETS FOR ADDITIONAL STRUCTURAL INFORMATION.

BRICK SUPPORT NOTE:

1. FASTEN (2) 2 × 10 BLOCKING BETWEEN WALL STUDS w/ (4) 12d NAILS PER PLY. FASTEN A 6" × 4" × 5/16" STEEL ANGLE TO (2) 2 × 10 BLOCKING w/ (2) 1/2" LAG SCREWS @ 12" O.C.

STAGGERED. SEE SECTION RTØ3.82.1. OF THE 2018 NCRC FOR ADDITIONAL BRICK

2. WHERE ROOF SLOPES EXCEED 7:12, INSTALL 3" x 3" x 1/4" STEEL PLATE STOPS AT 24" O.C. PER SECTION RT03.8.2.1 OF THE NORTH CAROLINA RESIDENTIAL CODE, 2018

SUPPORT INFORMATION.

EDITION.

12d NAILS @ 16" O.C. (TYP.)

STICK FRAME OVER-FRAMED

2 x 6 RAFTERS @ 16" O.C. AND FLAT 2 x 10 VALLEYS OR USE

FASTEN FLAT VALLEYS TO RAFTERS OR TRUSSES WITH

CIRCLES DENOTE (3) 2 x 4 POSTS

SPF (UNO).

FOR ROOF SUPPORT.

A MIN. OF 8'-0". FASTEN

VALLEY TRUSSES.

TOE NAILS.

TRUSSES.

(919) 649-4128

WWW.RRDCAROLINA.COM

"The art of transforming your vision into re ality."

RENAISSANCE RESIDENTIAL DESIGN, INC.
RESERVES THE RIGHT TO MAKE
MODIFICATIONS TO FLOOR PLANS,
DIMENSIONS, MATERIALS, AND
SPECIFICATIONS WITHOUT NOTICE.
THESE DRAWINGS ARE FOR THE

PURPOSE OF CONVEYING AN ARCHITECTURAL CONCEPT ONLY.

RENAISSANCE RESIDENTIAL DESIGN, INC. HEREBY EXPRESSLY RESERVES ITS COMMON LAW COPYRIGHT AND OTHER PROPERTY RIGHTS IN THESE PLANS. THESE PLANS AND DRAWINGS ARE NOT TO BE REPRODUCED, CHANGED, OR

COPIED IN ANY FORM OR MANNER
WITHOUT FIRST OBTAINING THE EXPRESS
WRITTEN CONSENT OF RENAISSANCE
RESIDENTIAL DESIGN, INC. NOR ARE
THEY TO BE ASSIGNED TO ANY THIRD
PARTY WITHOUT FIRST OBTAINING SAID
WRITTEN PERMISSION AND CONSENT.

J.S.THOMPSON ENGINEERING, INC 606 WADE AVE., SUITE 104 RALEIGH, NC 27605 PHONE: (919) 789-9919

FAX: (919) 789-9921

N.C. LICENSE NO.: C-1733



PRICES, PROMOTIONS, INCENTIVES, FEATURES, OPTIONS, FLOOR PLANS, ELEVATIONS, DESIGNS, MATERIALS AND DIMENSIONS ARE SUBJECT TO CHANGE WITHOUT NOTICE. UARE FOOTAGE AND DIMENSIONS ARE ESTIMATED AND MAY BY IN ACTUAL CONSTRUCTION. ACTUAL POSITION OF HOUSE ON LOT WILL BE DETERMINED BY THE SITE PLAN AND PLOT AN. FLOOR PLANS AND ELEVATION RENDERINGS ARE ARTIST CONCEPTIONS. FLOOR PLANS ARE THE COPYRIGHTED ROPERTY OF A&G RESIDENTIAL. ANY USE, REPRODUCTION, ADAPTATION, OR DISPLAY OF THE PLANS IS STRICTLY PROHIBITED. SEE NEW HOME SALES CONSULTANT FOR

A&G RESIDENTIAL CAMDEN

SEAL 33736

WINDOWS OF THE STREET OF THE STR

DATE: SEPTEMBER 28, 2020
REV.:

SCALE: 1/4"=1'-0"


DRAWN BY: WG

REVIEWED BY: MGS

ENGINEERED BY: WFB

ROOF PLAN ELEVATION - B

S-4

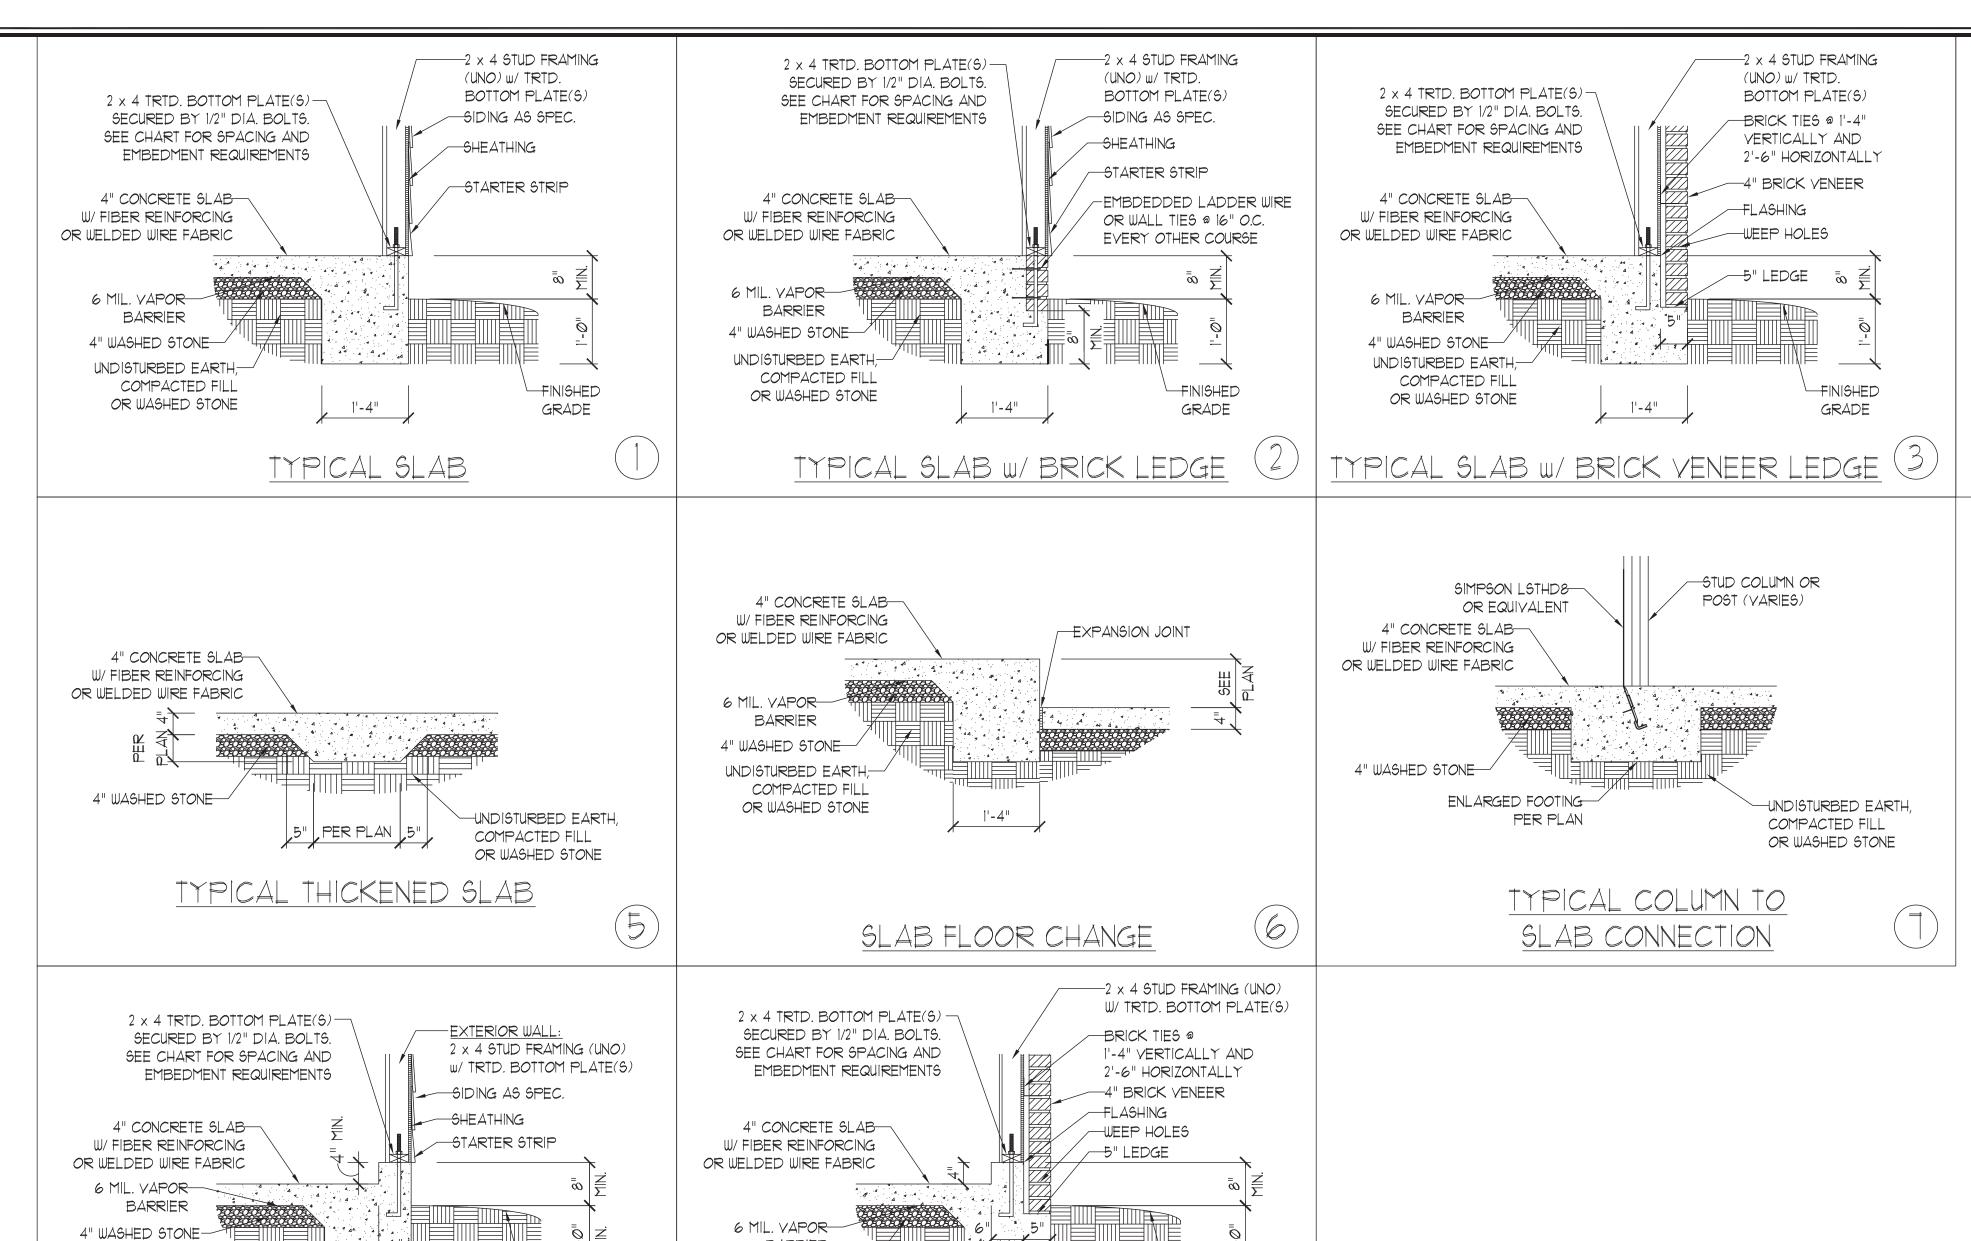

1'-4"

GARAGE CURB W/ BRICK LEDGE

1'-4"

SLAB AT GARAGE DOOR

THREADED ROD WITH EPOXY,

TO PROVIDE EQUIVALENT

LIEU OF 1/2" ANCHOR BOLTS.

SIMPSON TITEN HD, OR APPROVED

ANCHORS SPACED AS REQUIRED

ANCHOR BOLTS MAY BE USED IN

ANCHORAGE TO 1/2" DIAMETER

NOTE:

GARAGE DOOR JAMB

A . A . A . A . A . A . A . A . A

-FINISHED GRADE

SLOPE SLAB 1/8" PER FOOT

BARRIER

4" WASHED STONE

UNDISTURBED EARTH,— COMPACTED FILL OR WASHED STONE

4" CONCRETE SLAB

W/ FIBER REINFORCING

OR WELDED WIRE FABRIC

6 MIL. VAPOR BARRIER

4" WASHED STONE

UNDISTURBED EARTH,-

COMPACTED FILL OR

130 MPH

4'-Ø" O.C.

INSTALL MIN. (2) ANCHORS PER

PLATE SECTION AND (1)

ANCHOR WITHIN 12" OF CORNERS

15" INTO MASONRY

7" INTO CONCRETE

WASHED STONE

UNDISTURBED EARTH

COMPACTED FILL OR WASHED STONE

> 2 x 4 STUD FRAMING-(UNO) W/ TRTD.

> > BOTTOM PLATE(S)

4" CONCRETE -SLAB W/ FIBER

REINFORCING

UNDISTURBED EARTH, 6" 6" 6" 6" 6" 6" 6" 6"

4" WASHED STONE-

WIND ZONE

SPACING

EMBEDMENT

1'-4"

GARAGE CURB

STEP IN GARAGE

120 MPH

6'-0" O.C.

INSTALL MIN. (2) ANCHORS PER

PLATE SECTION AND (1)

ANCHOR WITHIN 12" OF CORNERS

7"

FINISHED GRADE

-4" CONCRETE \$LAB w/ FIBER REINFORCING OR

WELDED WIRE FABRIC

 $-2 \times 4$  TRTD. BOTTOM PLATE(5)

EMBEDMENT REQUIREMENTS

ANCHOR SPACING AND EMBEDMENT

SECURED BY 1/2" DIA. BOLTS. SEE CHART FOR SPACING AND

8

4" CONCRETE SLAB
W/ FIBER REINFORCING
OR WELDED WIRE FABRIC

4" WASHED STONE


UNDISTURBED EARTH,
COMPACTED FILL
OR WASHED STONE

POST BASE PER PLAN
FINISHED GRADE

1"-4"

PORCH/SCREEN PORCH

4" WASHED STONE

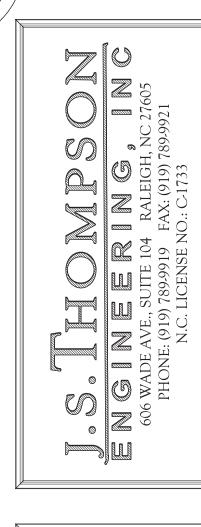

MONOLITHIC SLAB FOUNDATION DETAILS



SEAL 33736 & G. STRAMENTO 10/1/2020

DATE: NOVEMBER 1, 2018

SCALE: NTS

DRAWN BY: JST

ENGINEERED BY: JST

\_\_\_\_\_

FOUNDATION DETAILS

This sealed page is to be used in conjunction with a full plan set engineered by J.S. Thompson Engineering, Inc. only. Use of this individual sealed page within architectural pages or shop drawings by others is a punishable offense under N.C. Statute § 89C-23

ES

DATE: MAY 18, 2020

SCALE: 1/4" = 1'-0" DRAWN BY: JST

ENGINEERED BY: JST

**BRACED WALL** 

NOTES AND DETAILS AND PF DETAIL

GENERAL WALL BRACING NOTES

WALL BRACING DESIGNED IN ACCORDANCE WITH CHAPTER 6 OF THE 2018 NC RESIDENTIAL BUILDING CODE (NCRC). TABLES AND FIGURES REFERENCED ARE FROM THE 2018 NCRC. SEE THIS SHEET FOR GENERAL DETAILS. REFER TO THE 2018 NCRC FOR ADDITIONAL INFORMATION AS NEEDED

AND SHEAR FORCES IN ACCORDANCE WITH ACCEPTED ENGINEERED PRACTICE. SEE STRUCTURAL SHEETS FOR BRACED WALL LOCATIONS, DIMENSIONS, HOLD DOWN TYPE AND LOCATIONS, BRACED WALL LINE KEY WITH WALL DESIGN SUMMARY OF REQUIRED/PROVIDED TOTALS FOR EACH WALL LINE AND ANY SPECIAL NOTES

BRACED EXTERIOR WALLS SUPPORTING ROOF TRUSSES AND RAFTERS, INCLUDING STORIES BELOW THE TOP FLOOR, HAVE

BEEN DESIGNED PER R602.3.5 (3). WALL SHEATHING AND FASTENERS HAVE BEEN DESIGNED TO RESIST COMBINED UPLIFT


OR REQUIREMENTS. 5. ALL EXTERIOR WALLS ARE TO BE SHEATHED WITH CS-WSP IN ACCORDANCE WITH SECTION R602.10.3 UNLESS NOTED


6. ALL EXTERIOR AND INTERIOR WALLS TO HAVE 1/2" GYPSUM INSTALLED. WHEN NOT USING METHOD "GB", GYPSUM TO BE FASTENED PER TABLE R102.3.5. METHOD GB TO BE FASTENED PER TABLE R602.10.1


CS-WSP REFERS TO THE "CONTINUOUS SHEATHING - WOOD STRUCTURAL PANELS" WALL BRACING METHOD. 1/16" OSB SHEATHING IS TO BE INSTALLED ON ALL EXTERIOR WALLS ATTACHED W/6d COMMON NAILS OR 8d (2 1/2" LONG x Ø.113" DIAMETER) NAILS SPACED 6" O.C. ALONG PANEL EDGES AND 12" O.C. IN THE FIELD (U.N.O.,


GB REFERS TO THE "GYPSUM BOARD" WALL BRACING METHOD. 1/2" (MIN.) GYPSUM WALL BOARD IS TO BE INSTALLED ON BOTH SIDES OF THE BRACED WALL FASTENED WITH 1 1/4" SCREWS OR 1 5/8" NAILS SPACED 1" O.C. ALONG PANEL EDGES INCLUDING TOP AND BOTTOM PLATES AND INTERMEDIATE SUPPORTS (U.N.O.). VERIFY ALL FASTENER OPTIONS FOR 1/2" AND 5/8" GYPSUM PRIOR TO CONSTRUCTION. FOR INTERIOR FASTENER OPTIONS SEE TABLE R7/02.3.5. FOR EXTERIOR FASTENER OPTIONS SEE TABLE R602.3(1). EXTERIOR GB TO BE INSTALLED VERTICALLY.


REQUIRED BRACED WALL LENGTH FOR EACH SIDE OF THE CIRCUMSCRIBED RECTANGLE ARE INTERPOLATED PER TABLE R602. 10.3. METHOD CS-WSP CONTRIBUTES ITS ACTUAL LENGTH, METHOD GB CONTRIBUTES .5 ITS ACTUAL LENGTH, AND METHOD PF CONTRIBUTES 1.5 TIMES ITS ACTUAL LENGTH.

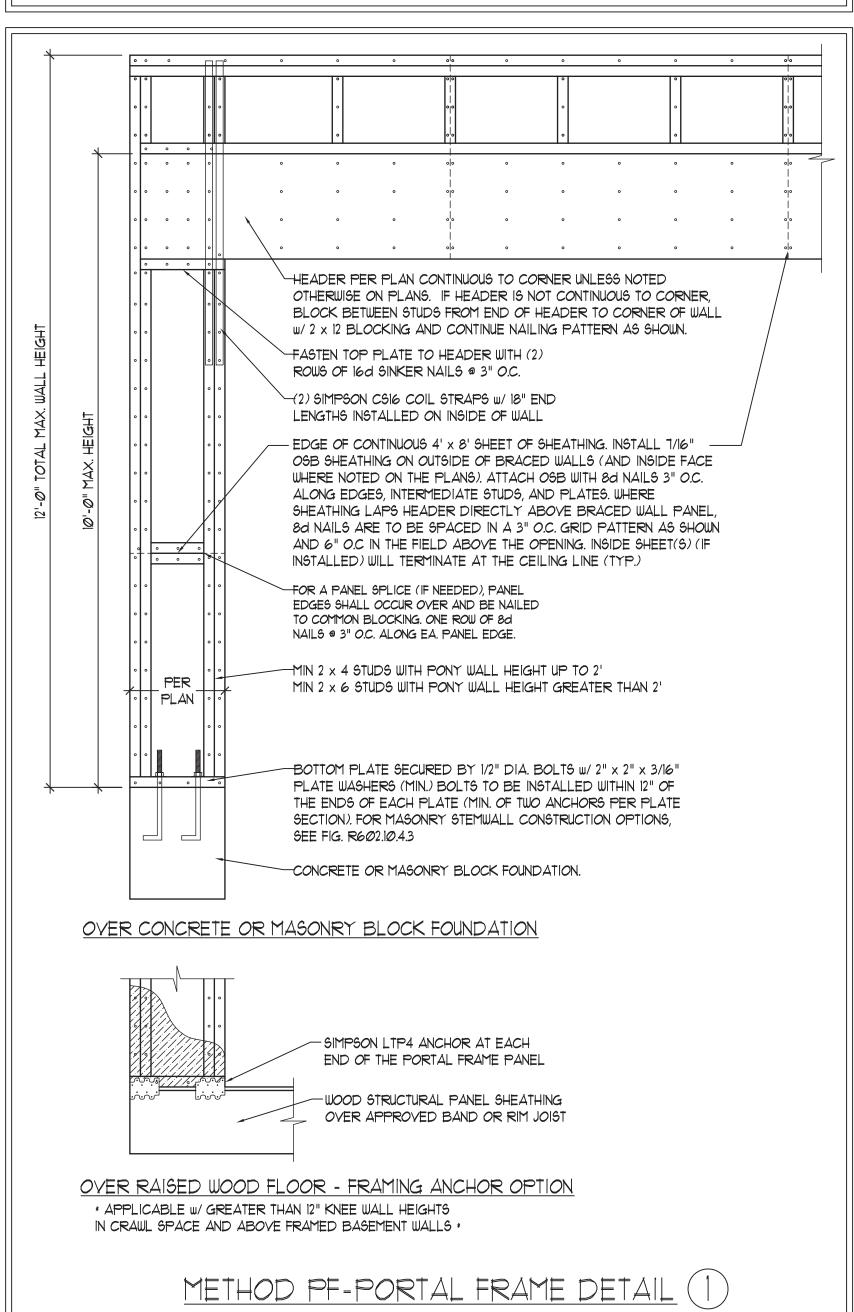

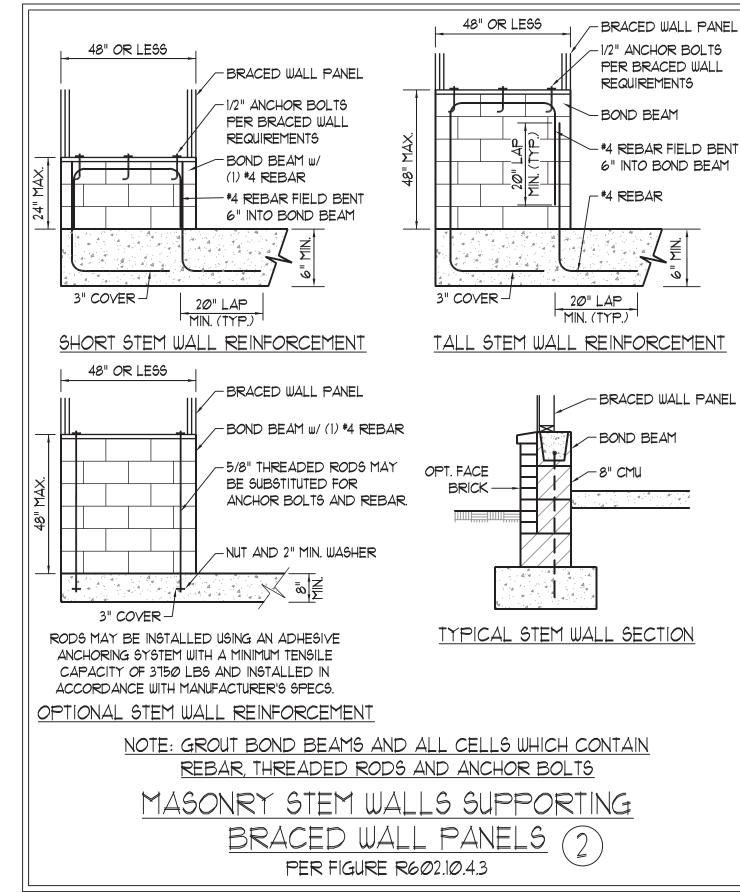


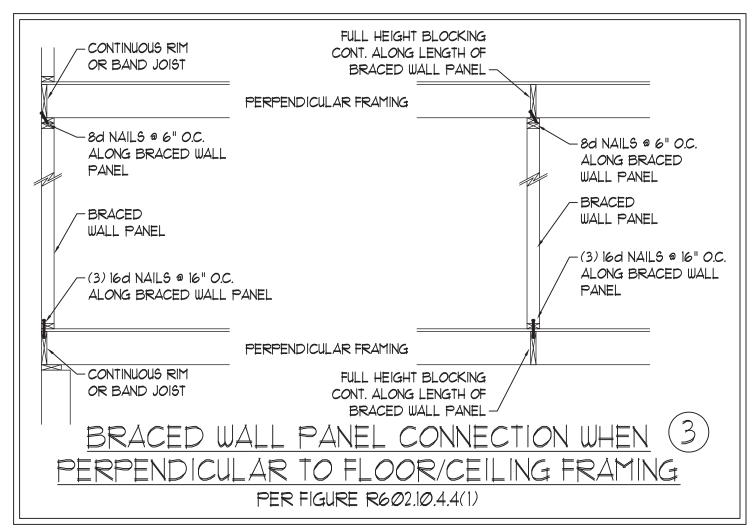


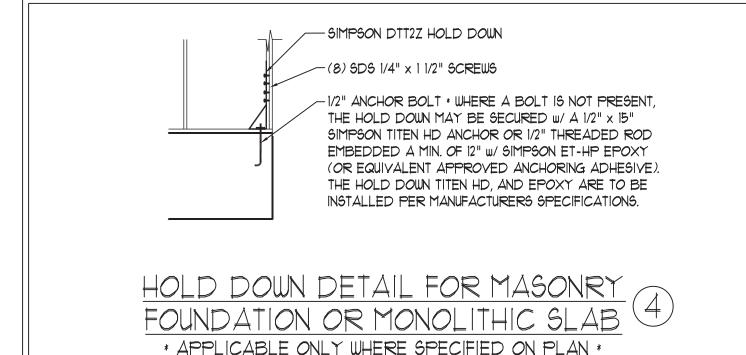

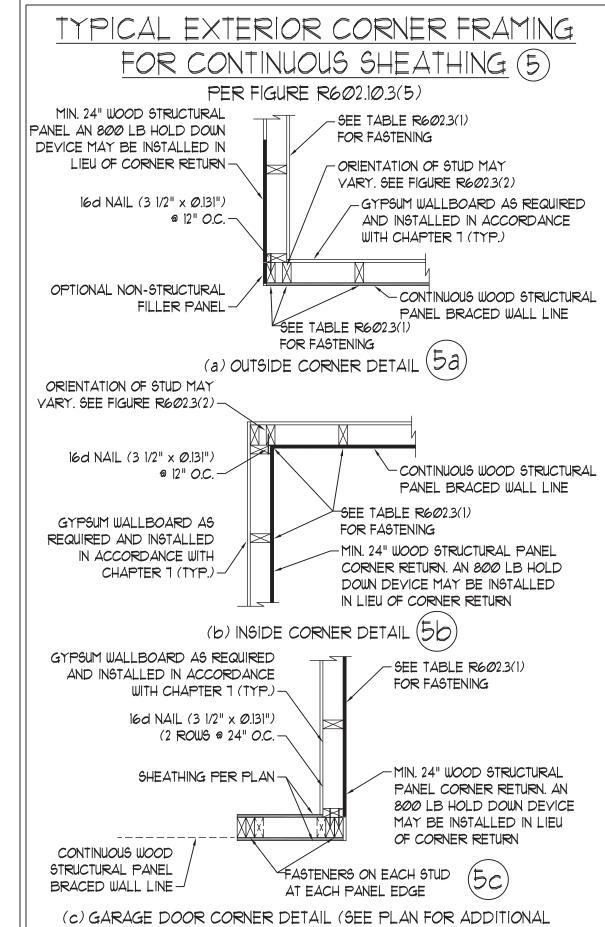

STRUCTURAL INFORMATION OR ALTERNATE CONFIGURATIONS)

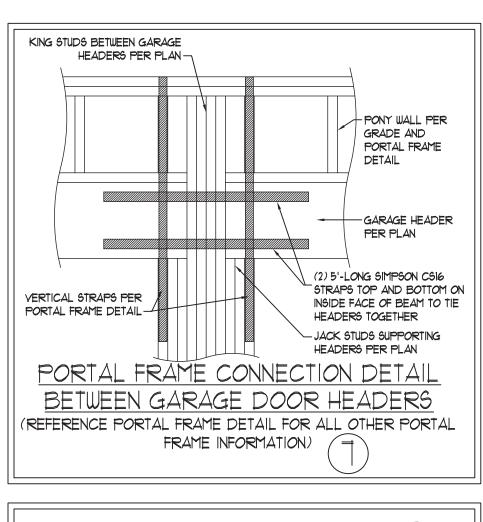

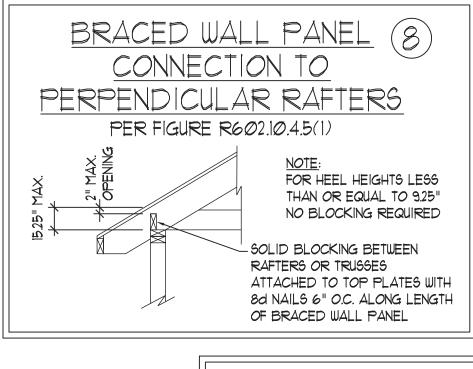

CONNECTION TO

PERPENDICULAR ROOF

TRUSSES

PER FIGURE R602.10.4.5(3)

(OR ALTERNATIVE: FIGURE R602.10.4.5(2))

6'-0" MAX.

2 x BLOCKING


NAILING PER


TABLE


33736

10/1/2020

R602.3(1)

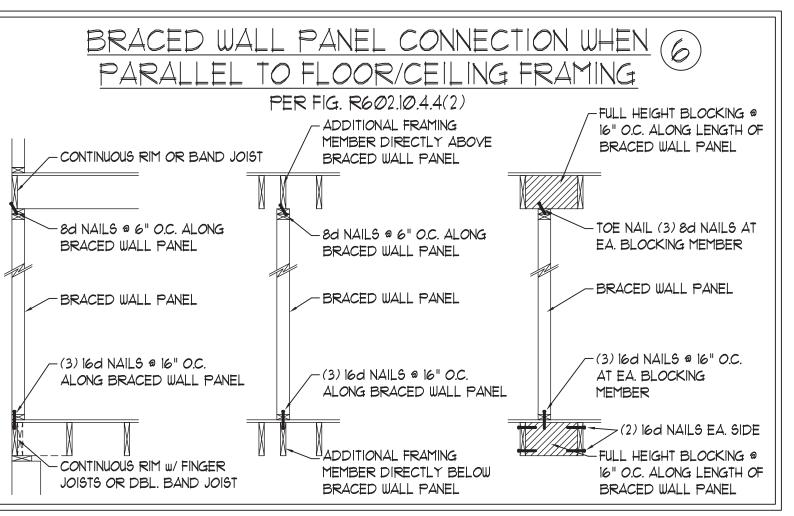

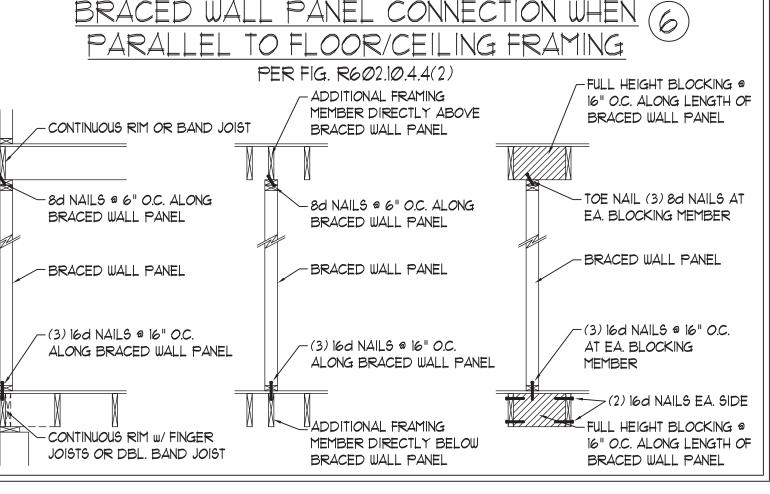

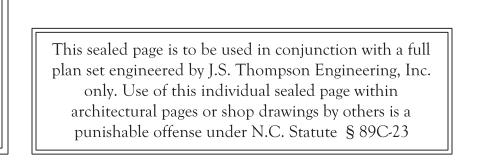

# GENERAL NOTES

- 1. ENGINEER'S SEAL APPLIES ONLY TO STRUCTURAL COMPONENTS INCLUDING ROOF RAFTERS, HIPS, VALLEYS, RIDGES, FLOORS, WALLS, BEAMS, HEADERS, COLUMNS, CANTILEVERS, OFFSET LOAD BEARING WALLS, PIERS, GIRDER SYSTEM AND FOOTING. ENGINEER'S SEAL DOES NOT CERTIFY DIMENSIONAL ACCURACY OF ARCHITECTURAL LAYOUT INCLUDING ROOF. ENGINEER'S SEAL DOES NOT APPLY TO 1-JOIST OR FLOOR/ROOF TRUSS LAYOUT DESIGN AND ACCURACY.
- 2. ALL CONSTRUCTION SHALL CONFORM TO THE LATEST REQUIREMENTS OF THE NORTH CAROLINA RESIDENTIAL CODE (NCRC), 2018 EDITION, PLUS ALL LOCAL CODES AND REGULATIONS. THE STRUCTURAL ENGINEER IS NOT RESPONSIBLE FOR, AND WILL NOT HAVE CONTROL OF, CONSTRUCTION MEANS, METHODS, TECHNIQUES, SEQUENCES OR PROCEDURES, OR SAFETY PRECAUTIONS AND PROGRAMS IN CONNECTION WITH THE CONSTRUCTION WORK. NOR WILL THE ENGINEER BE RESPONSIBLE FOR THE CONTRACTORS FAILURE TO CARRY OUT THE CONSTRUCTION WORK IN ACCORDANCE WITH THE CONTRACT DOCUMENTS.
- 3. STRUCTURAL DESIGN BASED ON THE PROVISIONS OF THE NCRC, 2018 EDITION (R301,4 R301,7)

DESIGN CRITERIA:	LIVE LOAD (PSF)	DEAD LOAD (PSF)	DEFLECTION (IN)	
ATTIC WITH LIMITED STORAGE	2Ø	10	L/240 (L/360 w/ BRITTLE FINISHES)	
ATTIC WITHOUT STORAGE	10	10	L/360	
DECK9	40	10	L/360	
EXTERIOR BALCONIES	40	10	L/360	
FIRE ESCAPES	40	10	L/360	
HANDRAILS/GUARDRAILS	200 LB OR 50 (PLF)	10	L/360	
PASSENGER VEHICLE GARAGE	50	10	L/360	
ROOMS OTHER THAN SLEEPING ROOM	40	10	L/360	
SLEEPING ROOMS	3Ø	10	L/360	
STAIRS	40	10	L/360	
WIND LOAD	(BASED ON TABLE R3Ø1.2(4) WIND ZONE AND EXPOSURE)			
GROUND SNOW LOAD: Pg	20 (PSF)			

- I-JOIST SYSTEMS DESIGNED WITH 12 PSF DEAD LOAD AND DEFLECTION (IN) OF L/480 - FLOOR TRUSS SYSTEMS DESIGNED WITH 15 PSF DEAD LOAD

- 4. FOR 115 AND 120 MPH WIND ZONES, FOUNDATION ANCHORAGE 15 TO COMPLY WITH SECTION R403.1.6 OF THE NCRC, 2018 EDITION. FOR 130 MPH, 140 MPH, AND 150 MPH WIND ZONES, FOUNDATION ANCHORAGE 15 TO COMPLY WITH SECTION 4504 OF THE NCRC, 2018 EDITION.
- 5. ENERGY EFFICIENCY COMPLIANCE AND INSULATION VALUES OF THE BUILDING TO BE IN ACCORDANCE WITH CHAPTER 11 OF THE NCRC, 2018 EDITION.

# FOOTING AND FOUNDATION NOTES

- I. FOUNDATION DESIGN BASED ON A MINIMUM ALLOWABLE BEARING CAPACITY OF 2000 PSF. CONTACT GEOTECHNICAL ENGINEER IF BEARING CAPACITY IS NOT ACHIEVED.
- 2. FOR ALL CONCRETE SLABS AND FOOTINGS, THE AREA WITHIN THE PERIMETER OF THE BUILDING ENVELOPE SHALL HAVE ALL VEGETATION, TOP SOIL AND FOREIGN MATERIAL REMOVED. FILL MATERIAL SHALL BE FREE OF VEGETATION AND FOREIGN MATERIAL. THE FILL SHALL BE COMPACTED TO ASSURE UNIFORM SUPPORT OF THE SLAB, AND EXCEPT WHERE APPROVED, THE FILL DEPTHS SHALL NOT EXCEED 24" FOR CLEAN SAND OR GRAVEL. A 4" THICK BASED COURSE CONSISTING OF CLEAN GRADED SAND OR GRAVEL SHALL BE PLACED. A BASE COURSE IS NOT REQUIRED WHERE A CONCRETE SLAB IS INSTALLED ON WELL-DRAINED OR SAND-GRAVEL MIXTURE SOILS CLASSIFIED AS GROUP I, ACCORDING TO THE UNITED SOIL CLASSIFICATION SYSTEM IN ACCORDANCE WITH TABLE R405.1 OF THE NCRC, 2018 EDITION.
- 3. PROPERLY DEWATER EXCAVATION PRIOR TO POURING CONCRETE WHEN BOTTOM OF CONCRETE SLAB IS AT OR BELOW WATER TABLE. IF APPLICABLE, 3/4" 1" DEEP CONTROL JOINTS ARE TO BE SAWED WITHIN 4 TO 12 HOURS OF CONCRETE FINISHING AND WALL LOCATIONS HAVE BEEN MARKED. ADJUST WHERE NECESSARY.
- 4. CONCRETE SHALL CONFORM TO SECTION R402.2 OF THE NCRC, 2018 EDITION. CONCRETE REINFORCING STEEL TO BE ASTM A615 GRADE 60. WELDED WIRE FABRIC TO BE ASTM A185. MAINTAIN A MINIMUM CONCRETE COVER AROUND REINFORCING STEEL OF 3" IN FOOTINGS AND 1 1/2" IN SLABS. FOR POURED CONCRETE WALLS, CONCRETE COVER FOR REINFORCING STEEL MEASURED FROM THE INSIDE FACE OF THE WALL SHALL NOT BE LESS THAN 3/4". CONCRETE COVER FOR REINFORCING STEEL MEASURED FROM THE OUTSIDE FACE OF THE WALL SHALL NOT BE LESS THAN 1 1/2" FOR #5 BARS OR SMALLER, AND NOT LESS THAN 2" FOR #6 BARS OR LARGER.
- 5. MASONRY UNITS TO CONFORM TO ACE 530/ASCE 5/TMS 402. MORTAR SHALL COMFORM TO ASTM C270.
- 6. THE UNSUPPORTED HEIGHT OF MASONRY PIERS SHALL NOT EXCEED FOUR TIMES THEIR LEAST DIMENSION FOR UNFILLED HOLLOW CONCRETE MASONRY UNITS AND TEN TIMES THEIR LEAST DIMENSION FOR SOLID OR SOLID FILLED PIERS. PERS MAY BE FILLED SOLID WITH CONCRETE OR TYPE M OR S MORTAR. PIERS AND WALLS SHALL BE CAPPED WITH 8" OF SOLID MASONRY.
- 1. THE CENTER OF EACH OF THE PIERS SHALL BEAR IN THE MIDDLE THIRD OF ITS RESPECTIVE FOOTING. EACH GIRDER SHALL BEAR IN THE MIDDLE THIRD OF THE PIERS.
- 8. ALL CONCRETE AND MASONRY FOUNDATION WALLS ARE TO BE CONSTRUCTED IN ACCORDANCE WITH THE PROVISIONS OF SECTION R404 OF THE NCRC, 2018 EDITION OR IN ACCORDANCE WITH ACI 318, ACI 332, NCMA TR68-A OR ACE 530/ASCE 5/TMS 402. MASONRY FOUNDATION WALLS ARE TO BE REINFORCED PER TABLE R404.1.1(1), R404.1.1(2), R404.1.1(3), OR R404.1.1(4) OF THE NCRC, 2018 EDITION. CONCRETE FOUNDATION WALLS ARE TO BE REINFORCED PER TABLE R404.1.1(5) OF THE NCRC, 2018 EDITION. STEP CONCRETE FOUNDATION WALLS TO 2 x 6 FRAMED WALLS AT 16" O.C. WHERE GRADE PERMITS (UNO).

This sealed page is to be used in conjunction with a full plan set engineered by J.S. Thompson Engineering, Inc. only. Use of this individual sealed page within architectural pages or shop drawings by others is a punishable offense under N.C. Statute § 89C-23

# FRAMING NOTES

- 1. ALL FRAMING LUMBER SHALL BE #2 SPF MINIMUM (Fb = 875 PSI, Fv = 375 PSI, E = 16000000 PSI) UNLESS NOTED OTHERWISE (UNO). ALL TREATED LUMBER SHALL BE #2 SYP MINIMUM (Fb = 975 PSI, Fv = 175 PSI, E = 16000000 PSI) UNLESS NOTED OTHERWISE (UNO).
- 2. LAMINATED VENEER LUMBER (LVL) SHALL HAVE THE FOLLOWING MINIMUM PROPERTIES: Fb = 2600 PSI, Fv = 285 PSI, E = 1900000 PSI.

  LAMINATED STRAND LUMBER (LSL) SHALL HAVE THE FOLLOWING MINIMUM PROPERTIES: Fb = 2325 PSI, Fv = 310 PSI, E = 1550000 PSI.

  PARALLEL STRAND LUMBER (PSL) UP TO 1" DEPTH SHALL HAVE THE FOLLOWING MINIMUM PROPERTIES: Fc = 2500 PSI, E = 18000000 PSI.

  PARALLEL STRAND LUMBER (PSL) MORE THAN 1" DEPTH SHALL HAVE THE FOLLOWING MINIMUM PROPERTIES: Fc = 2900 PSI, E = 20000000 PSI. INSTALL ALL CONNECTIONS PER MANUFACTURER'S SPECIFICATIONS.
- 3. STRUCTURAL STEEL SHALL CONFORM TO THE FOLLOWING ASTM SPECIFICATIONS

A. W AND WT 6HAPE6: ASTM A992

B. CHANNELS AND ANGLES: ASTM A36

C. PLATES AND BARS: ASTM A36

D. HOLLOW STRUCTURAL SECTIONS: ASTM A500 GRADE B

E. STEEL PIPE: ASTM A53, GRADE B, TYPE E OR S

4. STEEL BEAMS SHALL BE SUPPORTED AT EACH END WITH A MINIMUM BEARING LENGTH OF 3 1/2" AND FULL FLANGE WIDTH (UNO). PROVIDE SOLID BEARING FROM BEAM SUPPORT TO FOUNDATION. BEAMS SHALL BE ATTACHED AT THE BOTTOM FLANGE TO EACH SUPPORT AS FOLLOWS (UNO):

A. WOOD FRAMING:

B. CONCRETE

C. MASONRY (FULLY GROUTED)

(2) 1/2" DIA. x 4" WEDGE ANCHORS

(2) 1/2" DIA. x 4" LONG SIMPSON TITEN HD ANCHORS

LATERAL SUPPORT IS CONSIDERED ADEQUATE PROVIDING THE JOISTS ARE TOE NAILED TO THE 2x NAILER ON TOP OF THE STEEL BEAM, AND THE 2x NAILER IS SECURED TO THE TOP OF THE STEEL BEAM w/ (2) ROWS OF SELF TAPPING SCREWS @ 16" O.C. OR (2) ROWS OF 1/2" DIAMETER BOLTS @ 16" O.C. IF 1/2" BOLTS ARE USED TO FASTEN THE NAILER, THE STEEL BEAM SHALL BE FABRICATED w/ (2) ROWS OF 9/16" DIAMETER HOLES @ 16" O.C.

- 5. SQUARES DENOTE POINT LOADS WHICH REQUIRE SOLID BLOCKING TO GIRDER OR FOUNDATION. SHADED SQUARES DENOTE POINT LOADS FROM ABOVE WHICH REQUIRE SOLID BLOCKING TO SUPPORTING MEMBER BELOW.
- 6. ALL LOAD BEARING HEADERS TO CONFORM TO TABLE R602.7(1) AND R602.7(2) OF THE NCRC, 2018 EDITION OR BE (2) 2 x 6 WITH (1) JACK AND (1) KING STUD EACH END (UNO), WHICHEVER IS GREATER ALL HEADERS TO BE SECURED TO EACH JACK STUD WITH (4) 8d NAILS. ALL BEAMS TO BE SUPPORTED WITH (2) STUDS AT EACH BEARING POINT (UNO). INSTALL KING STUDS PER SECTION R602.7.5 OF THE NORTH CAROLINA RESIDENTIAL CODE, 2018 EDITION.
- 1. ALL BEAMS, HEADERS, OR GIRDER TRUSSES PARALLEL TO WALL ARE TO BEAR FULLY ON (1) JACK OR (2) STUDS MINIMUM OR THE NUMBER OF JACKS OR STUDS NOTED. ALL BEAMS OR GIRDER TRUSSES PERPENDICULAR TO WALL AND SUPPORTED BY (3) STUDS OR LESS ARE TO HAVE I I/2" MINIMUM BEARING (UNO). ALL BEAMS OR GIRDER TRUSSES PERPENDICULAR TO WALL AND SUPPORTED BY MORE THAN (3) STUDS OR OTHER NOTED COLUMN ARE TO BEAR FULLY ON SUPPORT COLUMN FOR ENTIRE WALL DEPTH (UNO). BEAM ENDS THAT BUTT INTO ONE ANOTHER ARE TO EACH BEAR EQUAL LENGTHS (UNO).
- 8. FLITCH BEAMS SHALL BE BOLTED TOGETHER USING 1/2" DIAMETER BOLTS (ASTM A3ØT) WITH WASHERS PLACED AT THREADED END OF BOLT.
  BOLTS SHALL BE SPACED AT 24" CENTERS (MAXIMUM), AND STAGGERED AT TOP AND BOTTOM OF BEAM (2" EDGE DISTANCE), WITH (2) BOLTS LOCATED AT 6" FROM EACH END (UNO).
- 9. ALL 1-JOIST OR TRUSS LAYOUTS ARE TO BE IN COMPLIANCE WITH THE OVERALL DESIGN SPECIFIED ON THE PLANS. ALL DEVIATIONS ARE TO BE BROUGHT TO THE ATTENTION OF THE ENGINEER OF RECORD PRIOR TO INSTALLATION.
- IØ. BRACED WALL PANELS SHALL BE CONSTRUCTED ACCORDING TO THE NORTH CAROLINA RESIDENTIAL CODE 2018 EDITION WALL BRACING CRITERIA. THE AMOUNT, LENGTH, AND LOCATION OF BRACING SHALL COMPLY WITH ALL APPLICABLE TABLES IN SECTION R602.10.
- 11. PROVIDE DOUBLE JOIST UNDER ALL WALLS PARALLEL TO FLOOR JOISTS. PROVIDE SUPPORT UNDER ALL WALLS PARALLEL TO FLOOR TRUSSES OR 1-JOISTS PER MANUFACTURER'S SPECIFICATIONS. INSTALL BLOCKING BETWEEN JOISTS OR TRUSSES FOR POINT LOAD SUPPORT FOR ALL POINT LOADS ALONG OFFSET LOAD LINES.
- 12. FOR ALL HEADERS SUPPORTING BRICK VENEER THAT ARE LESS THAN 8'-0" IN LENGTH, REST A 6" x 4" x 5/16" STEEL ANGLE WITH 6" MINIMUM EMBEDMENT AT SIDES FOR BRICK SUPPORT (UN.O). FOR ALL HEADERS 8'-0" AND GREATER IN LENGTH, BOLT A 6" x 4" x 5/16" STEEL ANGLE TO HEADER WITH 1/2" LAG SCREWS AT 12" O.C. STAGGERED FOR BRICK SUPPORT. FOR ALL BRICK SUPPORT AT ROOF LINES, BOLT A 6" x 4" x 5/16" STEEL ANGLE TO (2) 2 x 10 BLOCKING INSTALLED w/ (4) 12d NAILS EA. PLY BETWEEN WALL STUDS WITH (2) ROWS OF 1/2" LAG SCREWS AT 12" O.C. STAGGERED AND IN ACCORDANCE WITH SECTION RT03.8.2.1 OF THE NCRC, 2018 EDITION.
- 13. FOR STICK FRAMED ROOFS: CIRCLES DENOTE (3) 2 x 4 POSTS FOR ROOF MEMBER SUPPORT. HIP SPLICES ARE TO BE SPACED A MINIMUM OF 8'-Ø". FASTEN MEMBERS WITH THREE ROWS OF 12d NAILS AT 16" O.C. FRAME DORMER WALLS ON TOP OF DOUBLE OR TRIPLE RAFTERS AS SHOWN (UNO).
- 14. FOR TRUSSED ROOFS: FRAME DORMER WALLS ON TOP OF 2 x 4 LADDER FRAMING AT 24" O.C. BETWEEN ADJACENT ROOF TRUSSES. STICK FRAME OVER-FRAMED ROOF SECTIONS WITH 2 x 8 RIDGES, 2 x 6 RAFTERS AT 16" O.C. AND FLAT 2 x 10 VALLEYS (UNO).
- 15. ALL 4 x 4 AND 6 x 6 POSTS TO BE INSTALLED WITH 700 LB CAPACITY UPLIFT CONNECTORS TOP AND BOTTOM (UNO.) POSTS MAY BE SECURED USING ONE SIMPSON H6 OR LTS12 UPLIFT CONNECTOR FASTENED TO THE BAND AT THE BOTTOM AND THE BEAM AT THE TOP OF EACH POST. ONE 16" SECTION OF SIMPSON CS16 COIL STRAPPING WITH (8) 8d HDG NAILS AT EACH END MAY BE USED IN LIEU OF EACH TWIST STRAP IF DESIRED. FOR MASONRY OR CONCRETE FOUNDATION USE SIMPSON POST BASE.



S TONDE AVE, SUITE 104 RALEIGH, N

STANDARD STRUCTURAL NOTES

DATE: OCTOBER 29, 2018

SCALE: 1/4" = 1'-0"

DRAWN BY: JES

ENGINEERED BY: JST

EET:

STRUCTURAL NOTES

SEAL 33736

SEAL 30786

SOURCE POTAGE

10/1/2020