

# Harnett County Department of Public Health

PERMIT # SPD2102-0071

## Operation Permit

New Installation  Septic Tank  Nitrification Line  Repair  Expansion

PROPERTY LOCATION: 521412 Clanton Light Rd

Name: (owner) K.B Homes Carolinas SUBDIVISION Highland Grove LOT # 42

System Installer: Thomas Thornberg

Basement with plumbing:  Garage  Number of Bedrooms 3


Type of Water Supply:  Community  Public  Well Distance from well \_\_\_\_\_ feet

System Type: Pump to 2500 TB/DV/SLW 522mg in B Types V and VI Systems expire in 5 years.

(In accordance with Table V a) Owner must contact Health Department 6 months prior to expiration for permit renewal.

*Pump to 2500 red.*

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

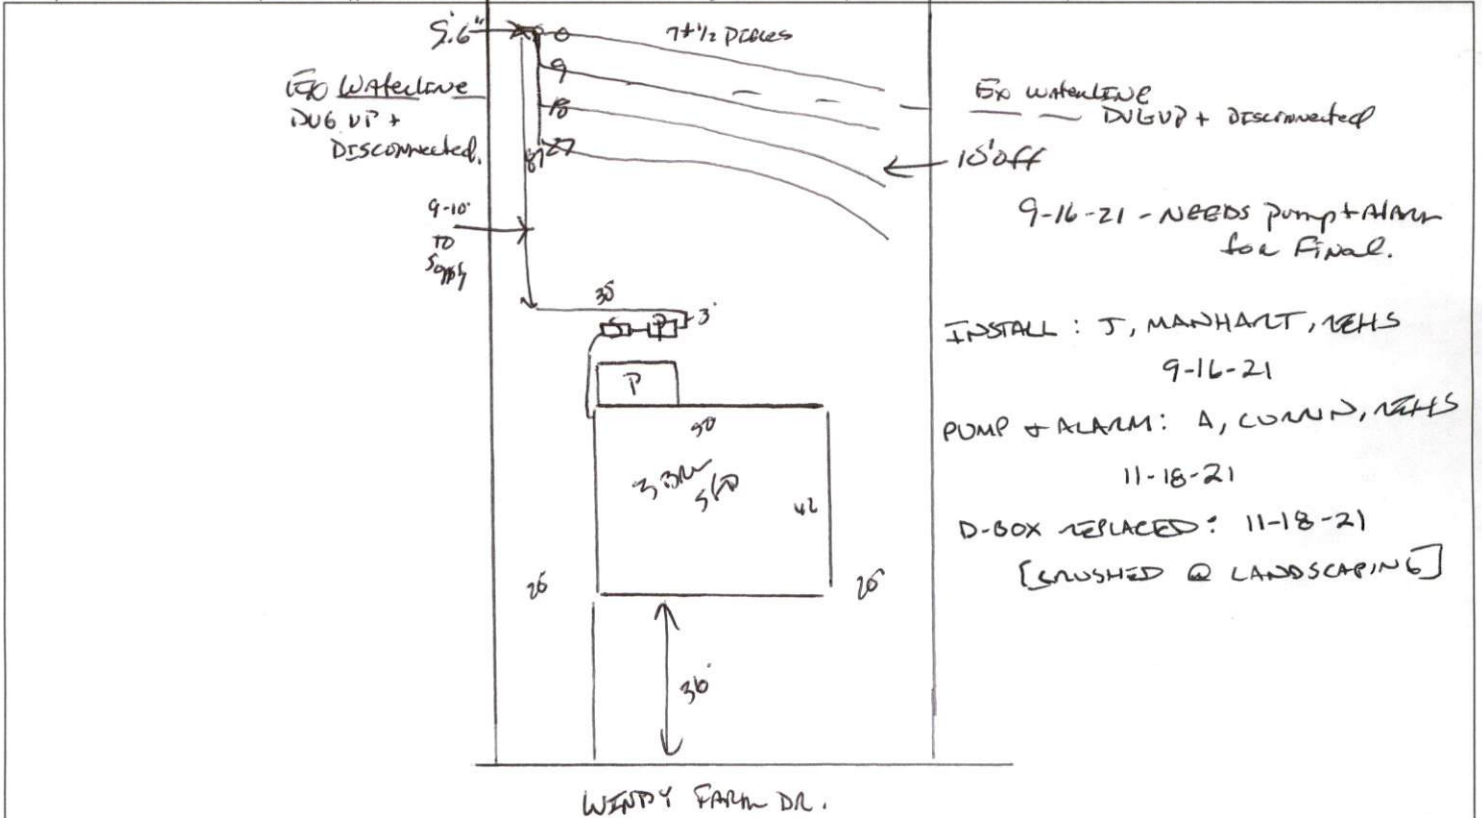

Ex waterline  
DUG UP + DISCONNECTED  
15' off  
9-16-21 - NEEDS pump + Alarm  
for Final.

INSTALL: J, MANHART, REHS  
9-16-21

PUMP + ALARM: A, COMIN, REHS  
11-18-21

D-BOX REPLACED: 11-18-21  
[CRASHED @ LANDSCAPING]

**PERMIT CONDITIONS:**

- I. Performance: System shall perform in accordance with Rule .1961.
- II. Monitoring: As required by Rule .1961.
- III. Maintenance: As required by Rule .1961. Other: \_\_\_\_\_  
Subsurface system operator required? Yes  No   
If yes, see attached sheet for additional operation conditions, maintenance and reporting.
- IV. Operation: \_\_\_\_\_
- V. Other: \_\_\_\_\_

D-Box  Pump  Alarm  H2O Line  PWR Line

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system:  Conventional  Other 2500 PWD Septic Tank: 1000 gallons Pump Tank: 1000 gallons  
Subsurface No. of exact length width of depth of  
Drainage Field ditches 4 of each ditch 75 feet ditches 3 feet ditches 24 inches  
French Drain Required: \_\_\_\_\_ Linear feet

Authorized State Agent [Signature] Date 11/18/2021