

# Harnett County Department of Public Health

## Operation Permit

PERMIT # SPD2102-0075

New Installation  Septic Tank  Nitrification Line  Repair  Expansion

PROPERTY LOCATION: 86 OLD HAMILTON RD. (SL1476)

Name: (owner) P. FARMS - STEVEN PATZ SUBDIVISION \_\_\_\_\_ LOT # \_\_\_\_\_

System Installer: RICKY HOLLAND


Basement with plumbing:  Garage  Number of Bedrooms 3

Type of Water Supply:  Community  Public  Well Distance from well 50+ feet

System Type: 2570 REDUCED LOW PROFILE CHAMBER Types V and VI Systems expire in 5 years.

(In accordance with Table V a) III B Owner must contact Health Department 6 months prior to expiration for permit renewal.

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

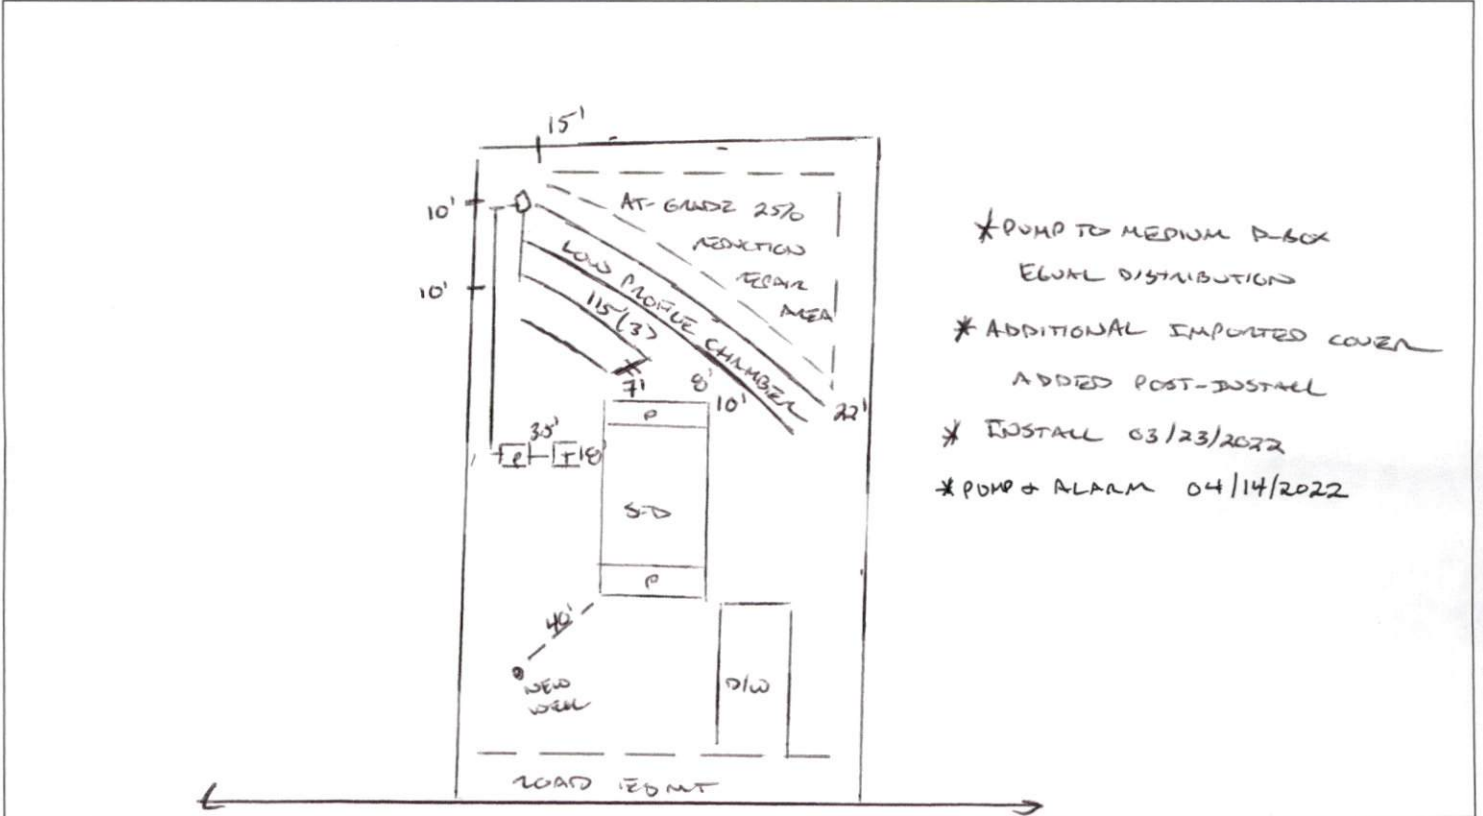

**PERMIT CONDITIONS:**

- OLD HAMILTON RD. (SL1476)
- I. Performance: System shall perform in accordance with Rule .1961.
  - II. Monitoring: As required by Rule .1961.
  - III. Maintenance: As required by Rule .1961. Other: \_\_\_\_\_  
Subsurface system operator required? Yes  No   
If yes, see attached sheet for additional operation conditions, maintenance and reporting.
  - IV. Operation: \_\_\_\_\_
  - V. Other: \_\_\_\_\_

\_\_\_\_\_ D-Box  \_\_\_\_\_ Pump  \_\_\_\_\_ Alarm  \_\_\_\_\_ H2O Line  \_\_\_\_\_ PWR Line

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system:  Conventional  Other SIS LOW PROFILE CHAMBER Septic Tank: 1000 gallons Pump Tank: 1000 gallons  
Subsurface No. of exact length III B width of depth of  
Drainage Field ditches 3 of each ditch 115 feet ditches 3 feet ditches 12 inches  
French Drain Required: \_\_\_\_\_ Linear feet [W] IMPORT

Authorized State Agent [Signature] Date 04/14/2022